


c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 17111dwgs\141837-2\dru015.dwg 7/13/2026 10:49 AM

DRUTEX S.A.


IGLO ENERGY CLASSIC CASEMENT WINDOW (HVHZ)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
 - ASTM E1886-13a
 - ASTM E1996-17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. WINDOW FRAME MATERIAL: uPVC
8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

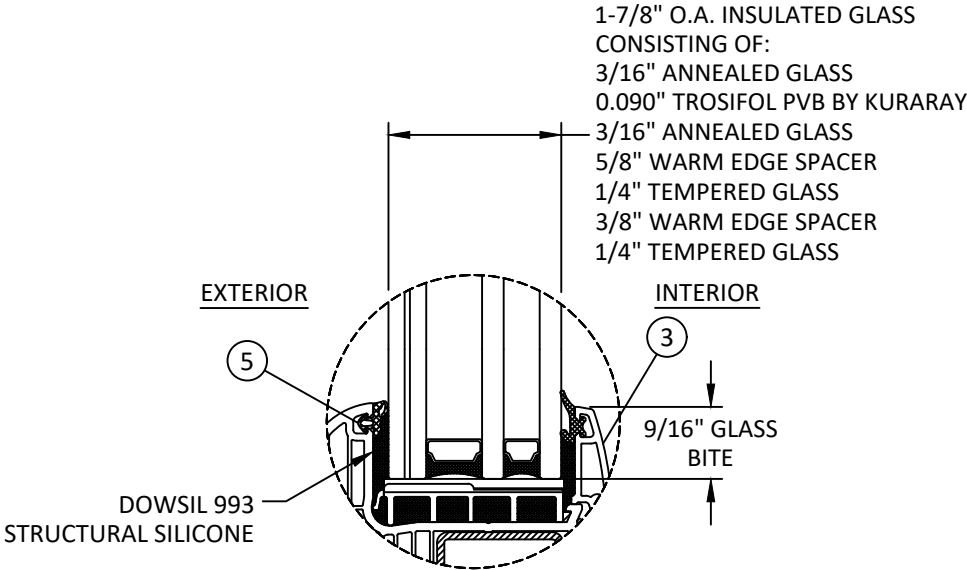

GLAZING DETAIL 1

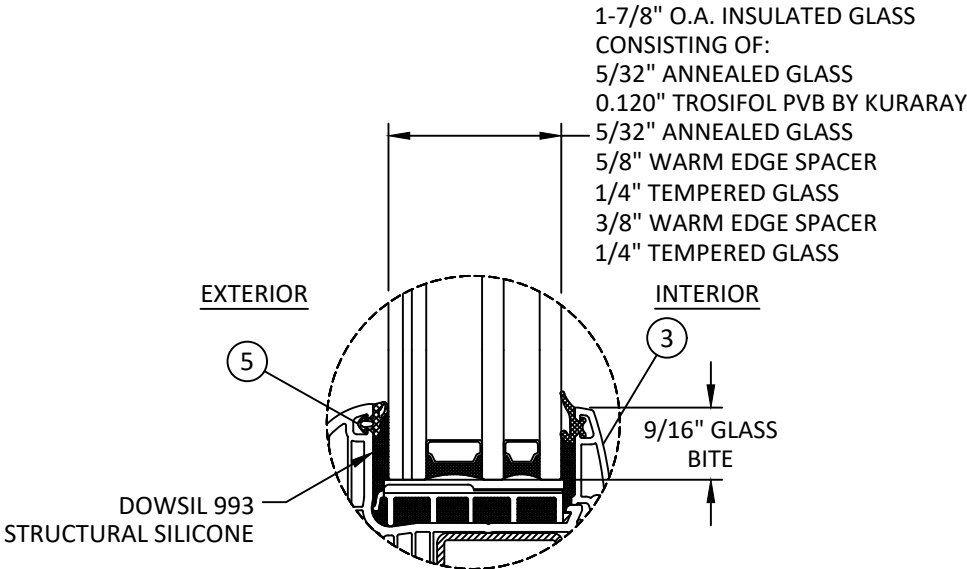

GLAZING DETAIL 2

- GLAZING NOTES:
1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAILS
2	"X" ELEVATION AND DESIGN PRESSURE TABLE
3	"XX" ELEVATION AND DESIGN PRESSURE TABLE
4	"X" ANCHOR LAYOUTS
5	"XX" ANCHOR LAYOUTS
6	VERTICAL SECTIONS
7	HORIZONTAL SECTIONS
8	HORIZONTAL SECTIONS CONTINUED
9	ANCHOR DETAILS AND INSTALLATION NOTES
10	ANCHOR DETAILS CONTINUED
11	BILL OF MATERIALS AND COMPONENTS

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
X	SEE TABLE ON SHEET 2			LARGE & SMALL MISSILE IMPACT
XX	SEE TABLE ON SHEET 3			



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC CASEMENT WINDOW (HVHZ) (IMPACT) GENERAL NOTES & GLAZING DETAILS


PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE REVISION	FB	10/23
2026 FBC UPDATE	LS	06/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.07 10:12:59 -0400

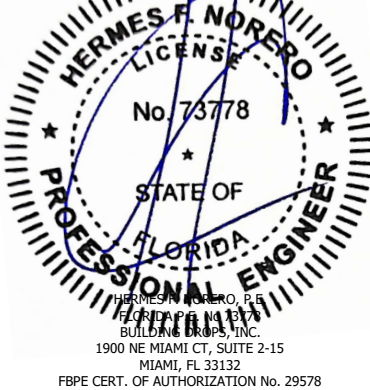

FL #:	FL41837
DATE:	12.12.2022
DWG. BY:	CHK. BY:
SH	HFN
SCALE:	NTS
DWG. #:	DRU015
SHEET:	REV.
1	B
OF 11	

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg(141837+2)\dru015.dwg 7/13/2026 10:49 AM

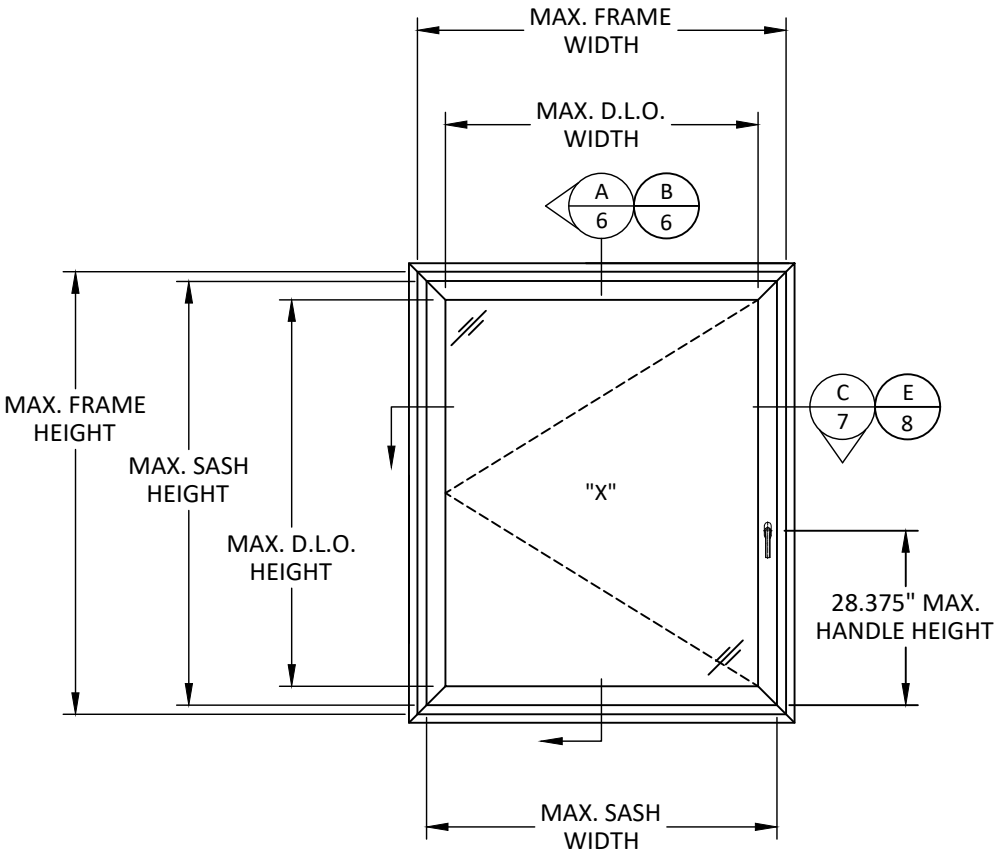

"X" ELEVATION

SASH HEIGHT = FRAME HEIGHT - 3.0"
SASH WIDTH = FRAME WIDTH - 3.0"
D.L.O. HEIGHT = FRAME HEIGHT - 8.8125"
D.L.O. WIDTH = FRAME WIDTH - 8.8125"

DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS.		GLASS TYPE 1	GLASS TYPE 2
FRAME WIDTH (in.)	FRAME HEIGHT (in.)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
36.0	54.0	55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
54.0		50.9	64.8
36.0	60.0	55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
54.0		50.9	64.8
60.0	66.0	45.8	58.3
36.0		55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
54.0		50.9	64.8
36.0	72.0	55.0	70.0
42.0		55.0	70.0
48.0		55.0	70.0
36.0	78.0	55.0	70.0
42.0		55.0	70.0
36.0	84.0	55.0	70.0
42.0		55.0	70.0
36.0	90.0	55.0	70.0
36.0	96.0	55.0	70.0

NOTE: ALL PRESSURES MEET WATER INFILTRATION REQUIREMENTS.



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC
CASEMENT WINDOW
(HVHZ) (IMPACT)
ELEVATION &
DESIGN PRESSURE TABLE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
FBC CODE REVISION	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL41837**

DATE: **12.12.2022**

DWG. BY: **SH** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **DRU015**

SHEET: **2** REV. **B**

OF 11

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 17111.dwg(141837-2)\dru015.dwg 7/13/2026 10:49 AM

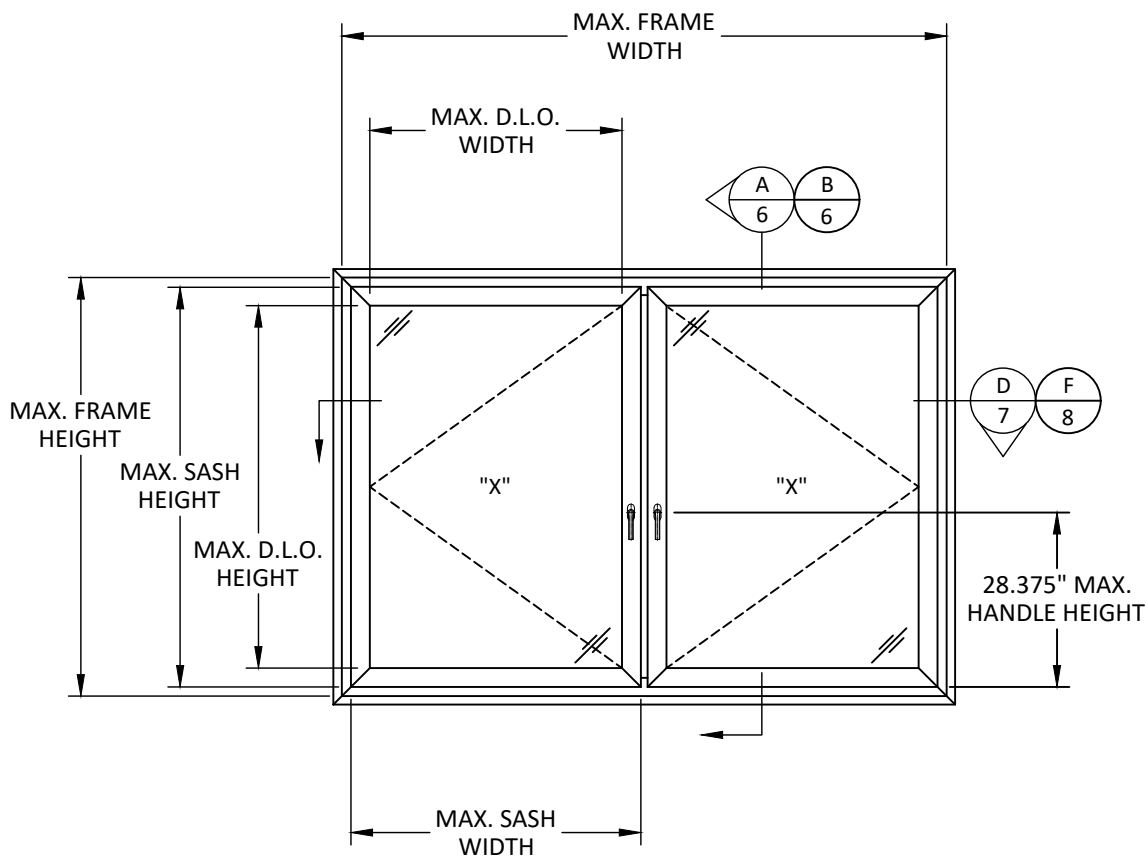

"XX" ELEVATION




SASH HEIGHT = FRAME HEIGHT/2 - 3.0"
SASH WIDTH = FRAME WIDTH/2 - 3.0"
D.L.O. HEIGHT = FRAME HEIGHT/2 - 8.8125"
D.L.O. WIDTH = FRAME WIDTH/2 - 8.8125"

DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS.		GLASS TYPE 1	GLASS TYPE 2
FRAME WIDTH (in.)	FRAME HEIGHT (in.)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
72.0	54.0	55.0	70.0
78.0		55.0	70.0
84.0		55.0	70.0
90.0		55.0	70.0
96.0		55.0	70.0
102.0		55.0	70.0
108.0		55.0	70.0
114.0		55.0	70.0
120.0	60.0	55.0	70.0
126.0		55.0	70.0
132.0		55.0	70.0
72.0		55.0	70.0
78.0		55.0	70.0
84.0		55.0	70.0
90.0		55.0	70.0
96.0		55.0	70.0

DESIGN PRESSURE TABLE (PSF)			
NOMINAL DIMS.		GLASS TYPE 1	GLASS TYPE 2
FRAME WIDTH (in.)	FRAME HEIGHT (in.)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
72.0	66.0	55.0	70.0
78.0		55.0	70.0
84.0		55.0	70.0
90.0		55.0	70.0
96.0		55.0	70.0
102.0		55.0	70.0
108.0	72.0	55.0	70.0
72.0		55.0	70.0
78.0		55.0	70.0
84.0		55.0	70.0
90.0		55.0	70.0
96.0		55.0	70.0
72.0	78.0	53.5	68.1
78.0		50.2	63.9
84.0		47.4	60.3
90.0		45.0	57.3
72.0		42.3	53.9
78.0		39.6	50.4
84.0	84.0	37.3	47.5
72.0		34.1	43.4
78.0		31.8	40.5
72.0	90.0	27.9	35.5
78.0		27.9	35.5
72.0	96.0	27.9	35.5

NOTE: ALL PRESSURES MEET WATER INFILTRATION REQUIREMENTS.

QUALIFIED CONFIGURATIONS

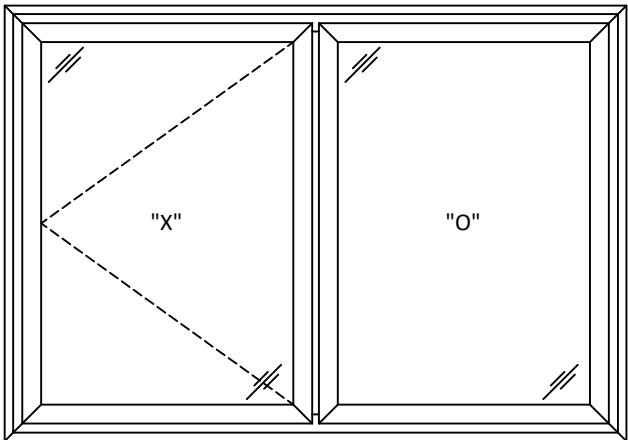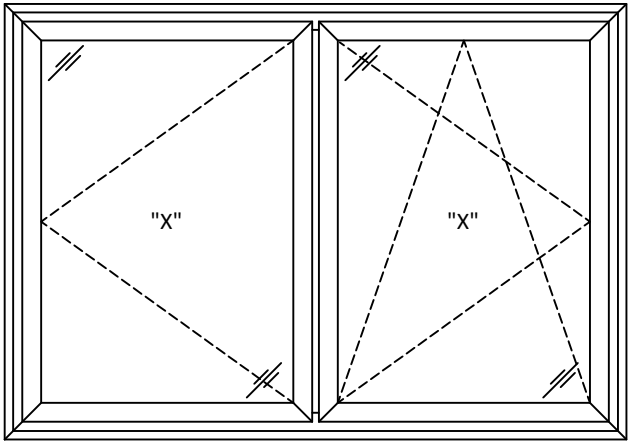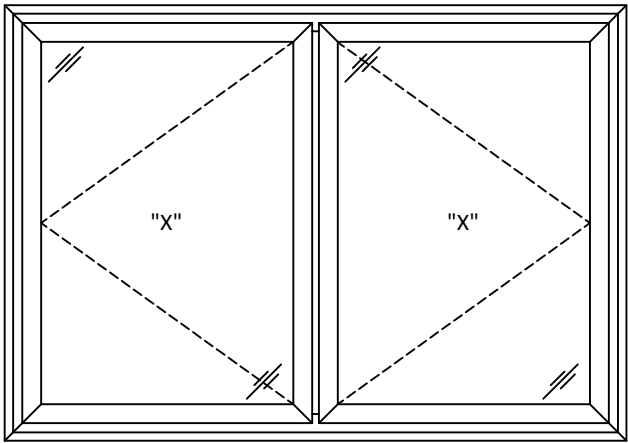

LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103


TITLE: IGLO ENERGY CLASSIC
CASEMENT WINDOW
(HVHZ) (IMPACT)
ELEVATION &
DESIGN PRESSURE TABLE

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-9478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE REVISION	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

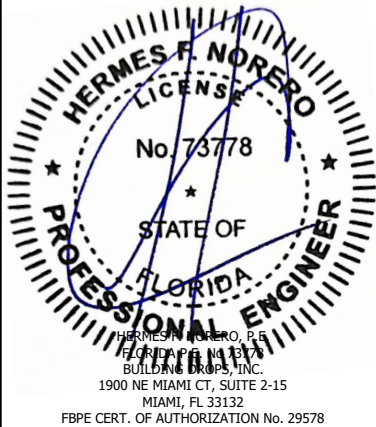

FL #: **FL41837**

DATE: **12.12.2022**

DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **DRU015**

SHEET: **3** REV. **B**

OF 11



INSTALLATION LEGEND:

	THROUGH FRAME/NAIL-FIN
	STRAP



NOTE: WHEN NAIL-FIN INSTALLATION IS USED, STRAPS MUST BE USED AT THE JAMBS.



LESZKA GIERZIEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

10 ENERGY CLASSIC ASSESSMENT WINDOW (HVHZ) (IMPACT)

ANCHOR LAYOUTS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15

E MIAMI COURT, STE. 2-15
MIAMI, FL 33132


PH: (954)399-8478
FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE REVISION	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

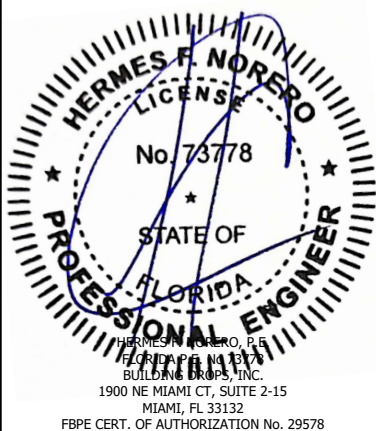

FL #: **FL41837**

DATE: 12.12.2022


DWG. BY: SH	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: DRU015

SHEET:	REV.
4	B

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg(141837+2)\drut015.dwg 7/13/2026 10:49 AM

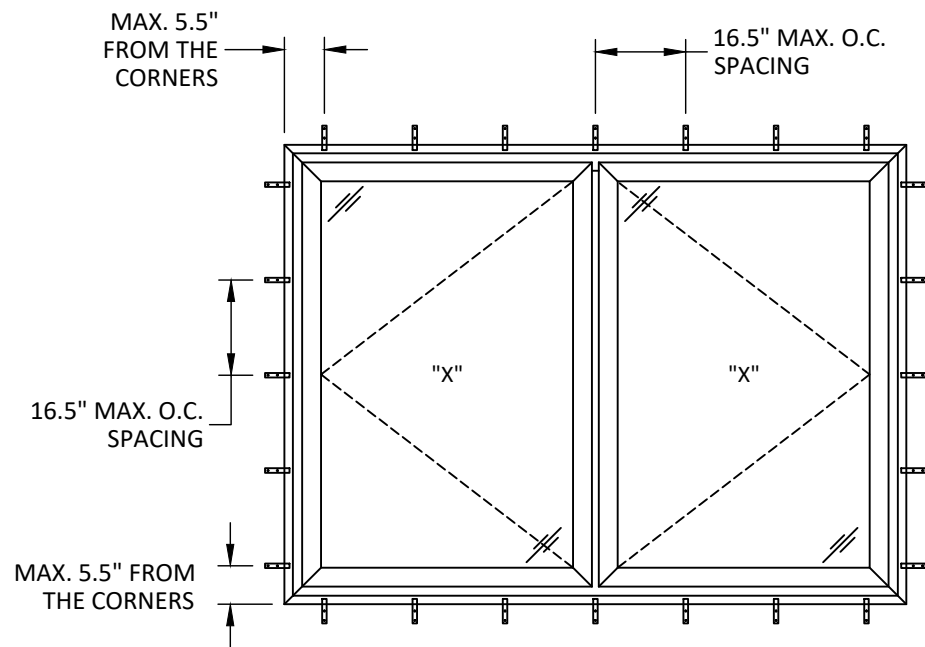


ANCHOR LAYOUT
STRAP INSTALLATION

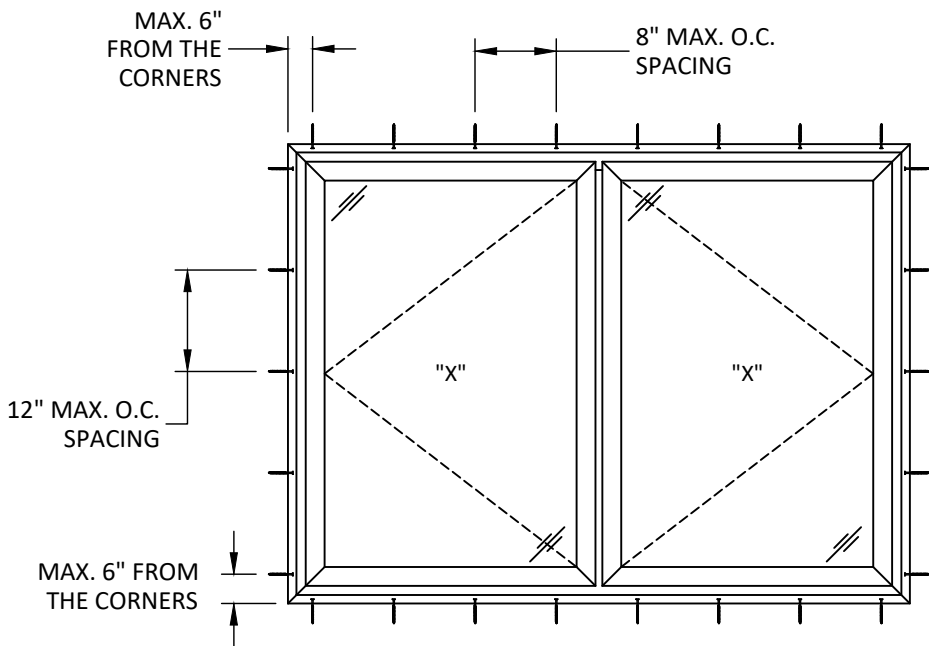

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

NOTE: TWO (2) INSTALLATION ANCHORS
PER STRAP LOCATION.

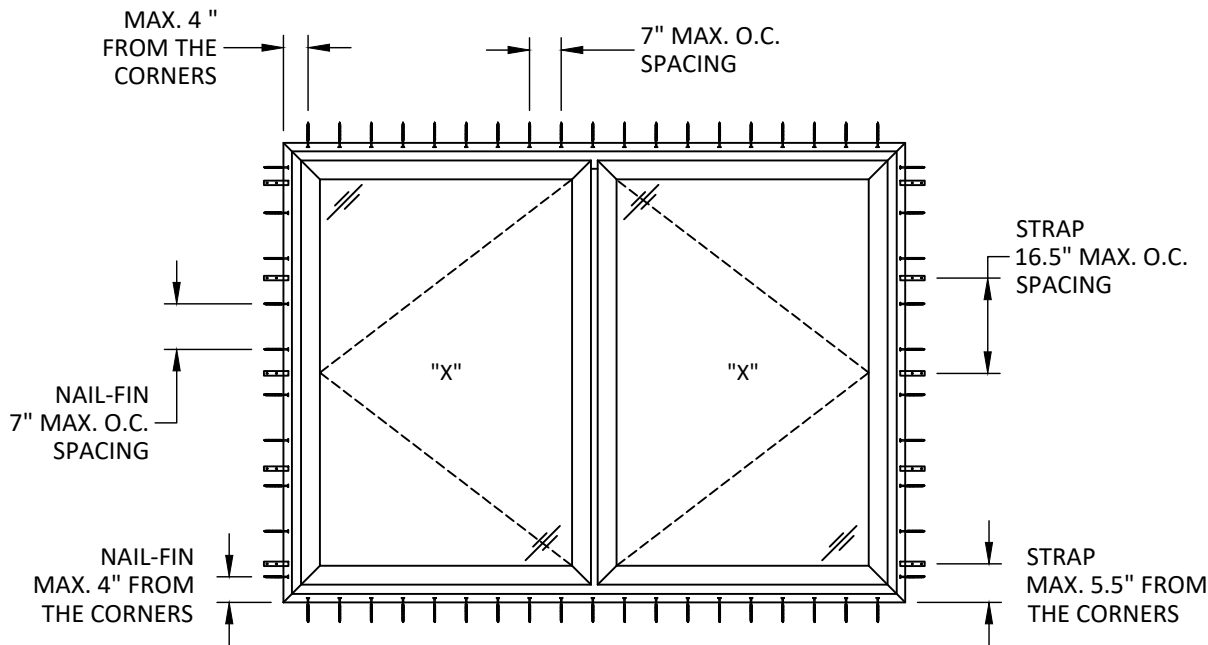

ANCHOR LAYOUT
NAIL-FIN & STRAP INSTALLATION

NOTE: WHEN NAIL-FIN INSTALLATION IS
USED, STRAPS MUST BE USED AT THE
JAMBS.

INSTALLATION LEGEND:
— THROUGH FRAME/NAIL-FIN
= STRAP



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC
CASEMENT WINDOW
(HVHZ) (IMPACT)

ANCHOR LAYOUTS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE REVISION	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

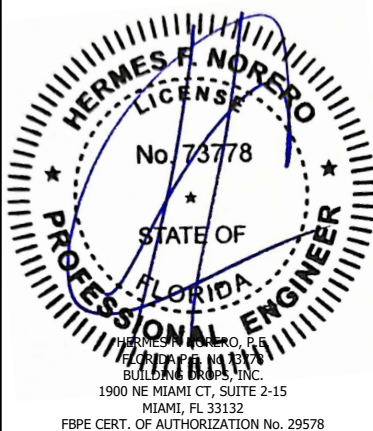

FL #: **FL41837**


DATE: **12.12.2022**

DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **DRU015**

SHEET: **5** REV. **B**

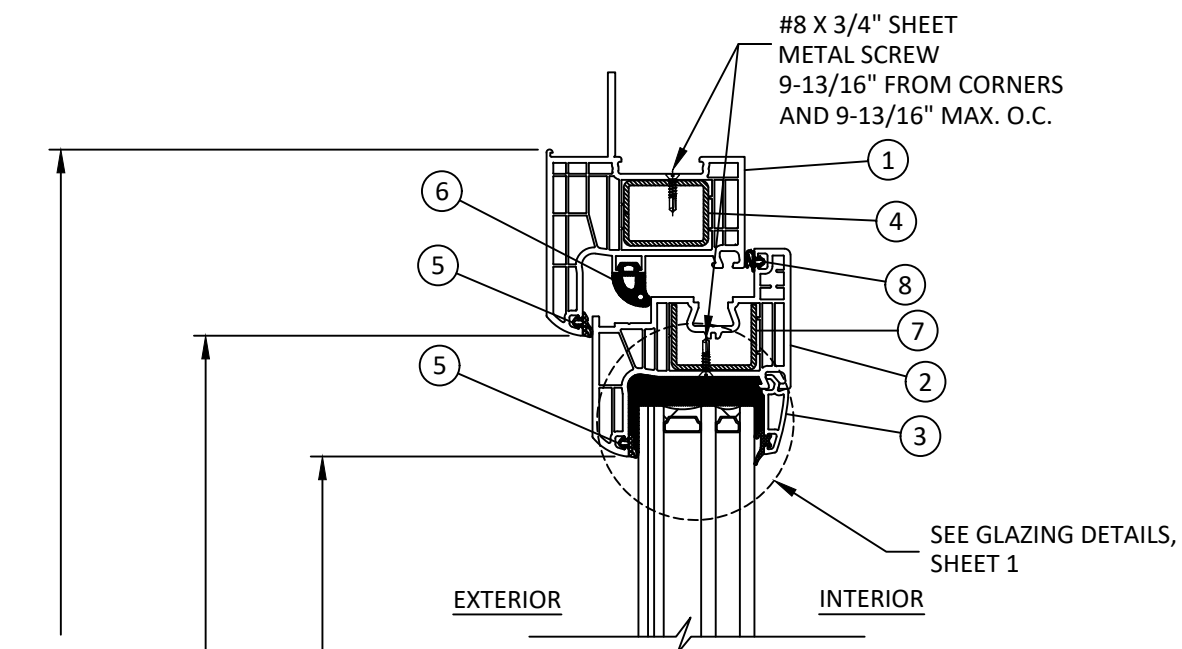MAX.
FRAME
HEIGHT


MAX.
SASH
HEIGHT

MAX.
D.L.O.
HEIGHT

EXTERIOR


INTERIOR

— SEE GLAZING DETAILS,
SHEET 1

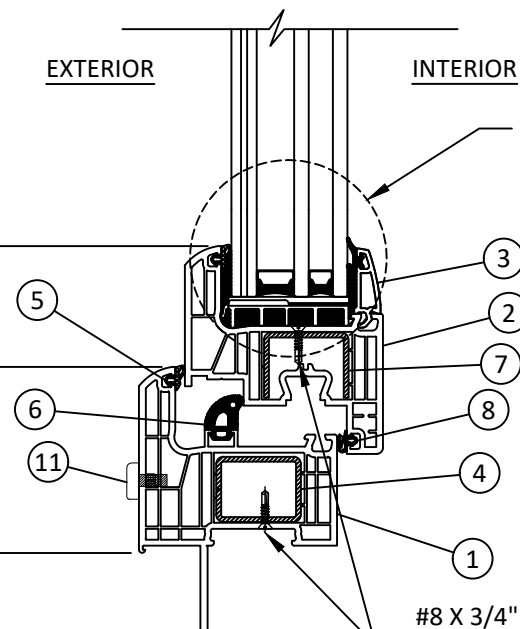

#8 X 3/4" SHEET
— METAL SCREW
9-13/16" FROM CORNERS
AND 9-13/16" MAX. O.C.

A
6 VERTICAL SECTION
FIN SECTION DETAIL

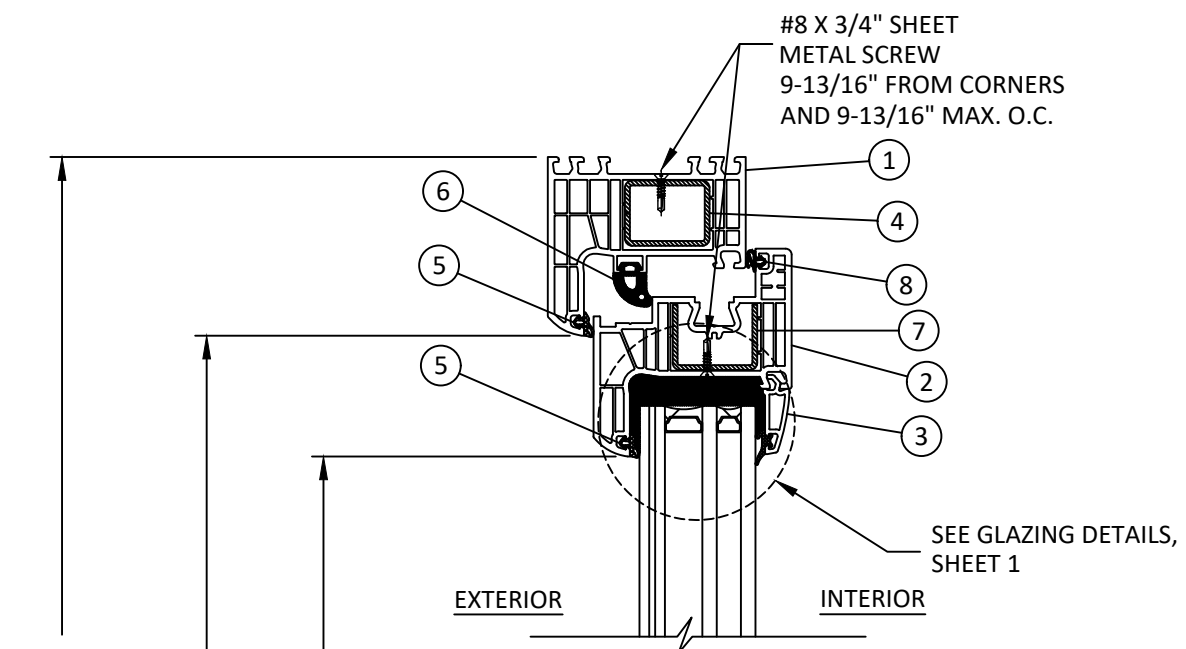MAX.
FRAME
HEIGHT


MAX.
SASH
HEIGHT

MAX.
D.L.O.
HEIGHT

EXTERIOR

INTERIOR

— SEE GLAZING DETAILS,
SHEET 1

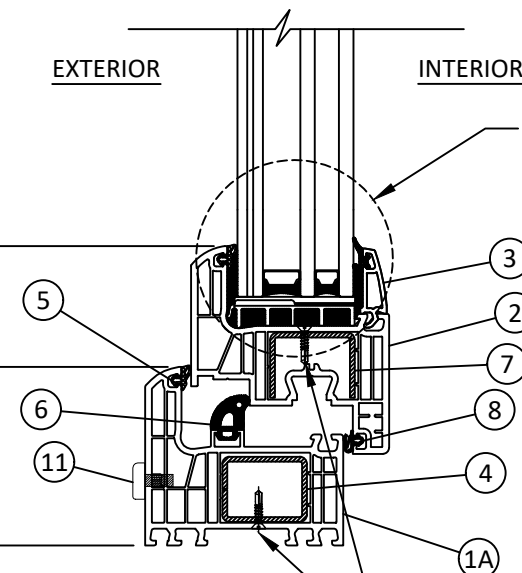

#8 X 3/4" SHEET
— METAL SCREW
9-13/16" FROM CORNERS
AND 9-13/16" MAX. O.C.

VERTICAL SECTION

FINLESS SECTION DETAIL



LESZKA GIERZIEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC
CASEMENT WINDOW
(HVHZ) (IMPACT)

VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15


MIAMI, FL 33132
PH: (954)399-8478

F11: (954) 353-8478
FAX: (954) 744.4738



REMARKS	BY	DATE
FBC CODE REVISION	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

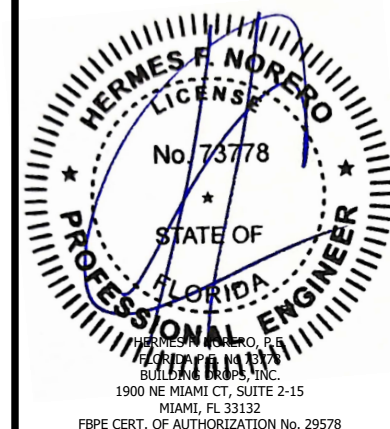

FL #: **FL41837**

DATE: 12.12.2022


DWG. BY: SH	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS


DWG. #: DRU015

SHEET: 6 REV. B

7/13/2026 10:49 AM
c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 17111.dwg\141837-2\dru015.dwg

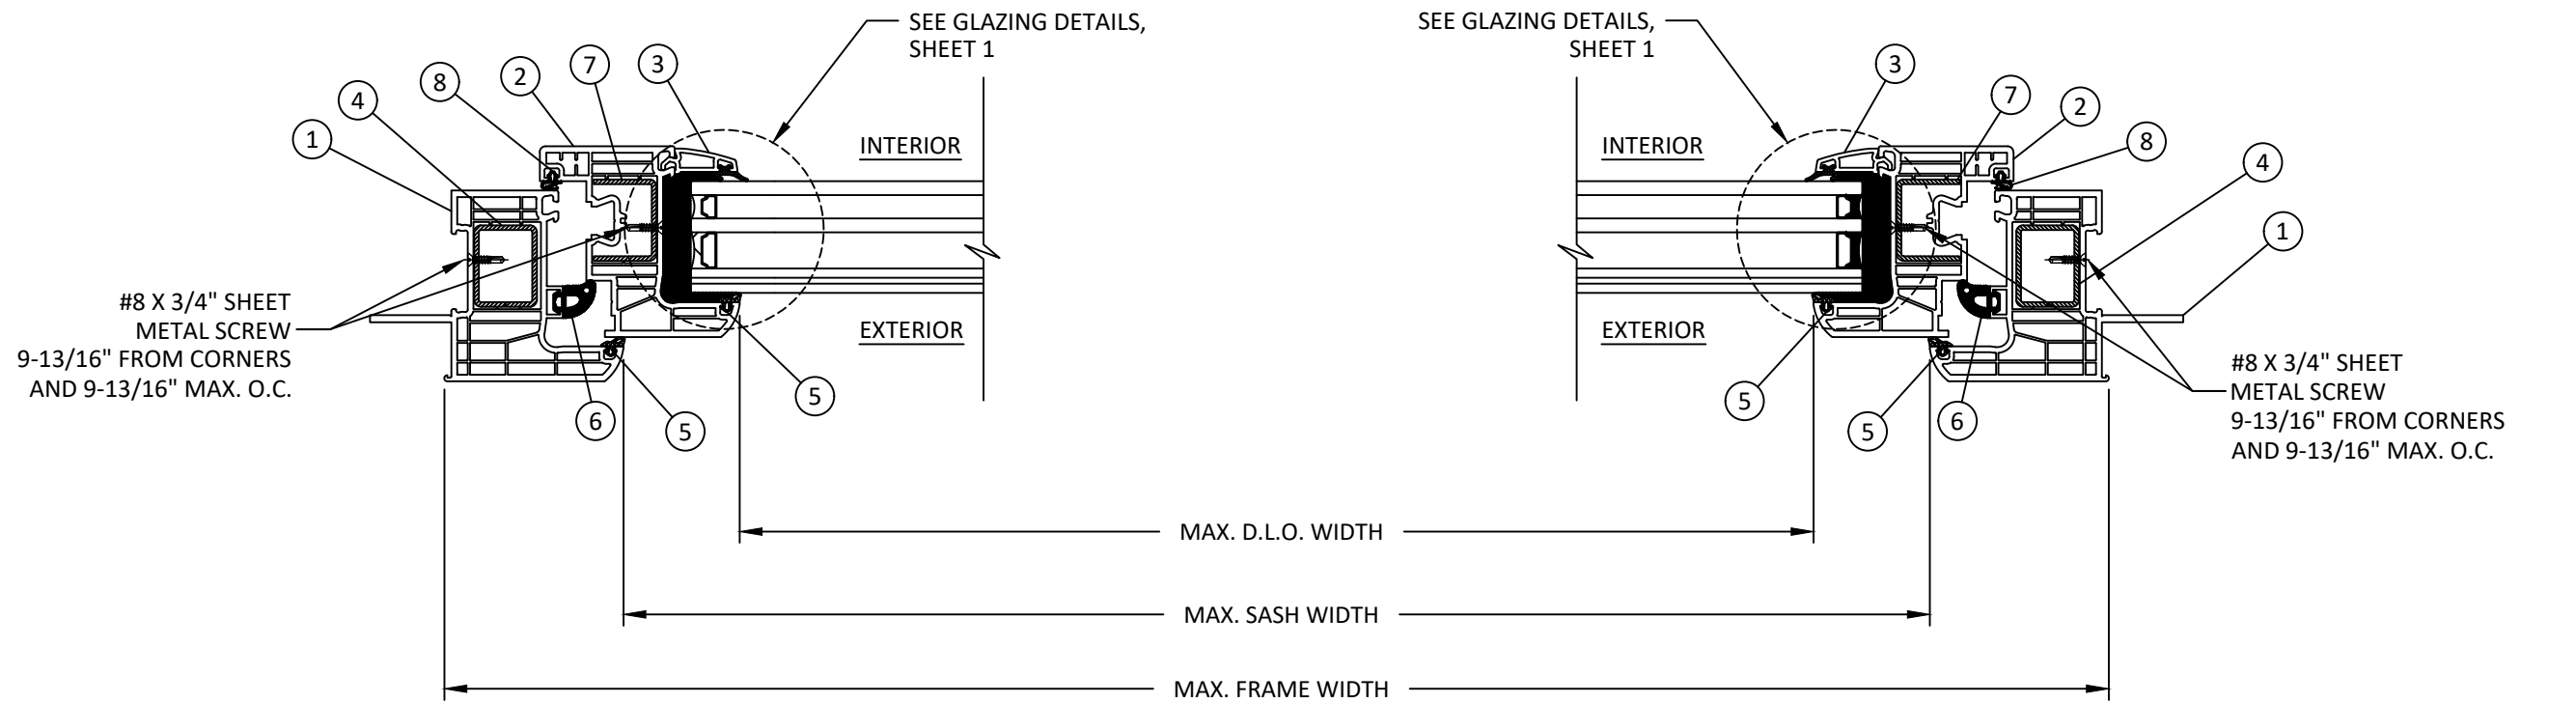

C
7
HORIZONTAL SECTION
FIN SECTION DETAIL

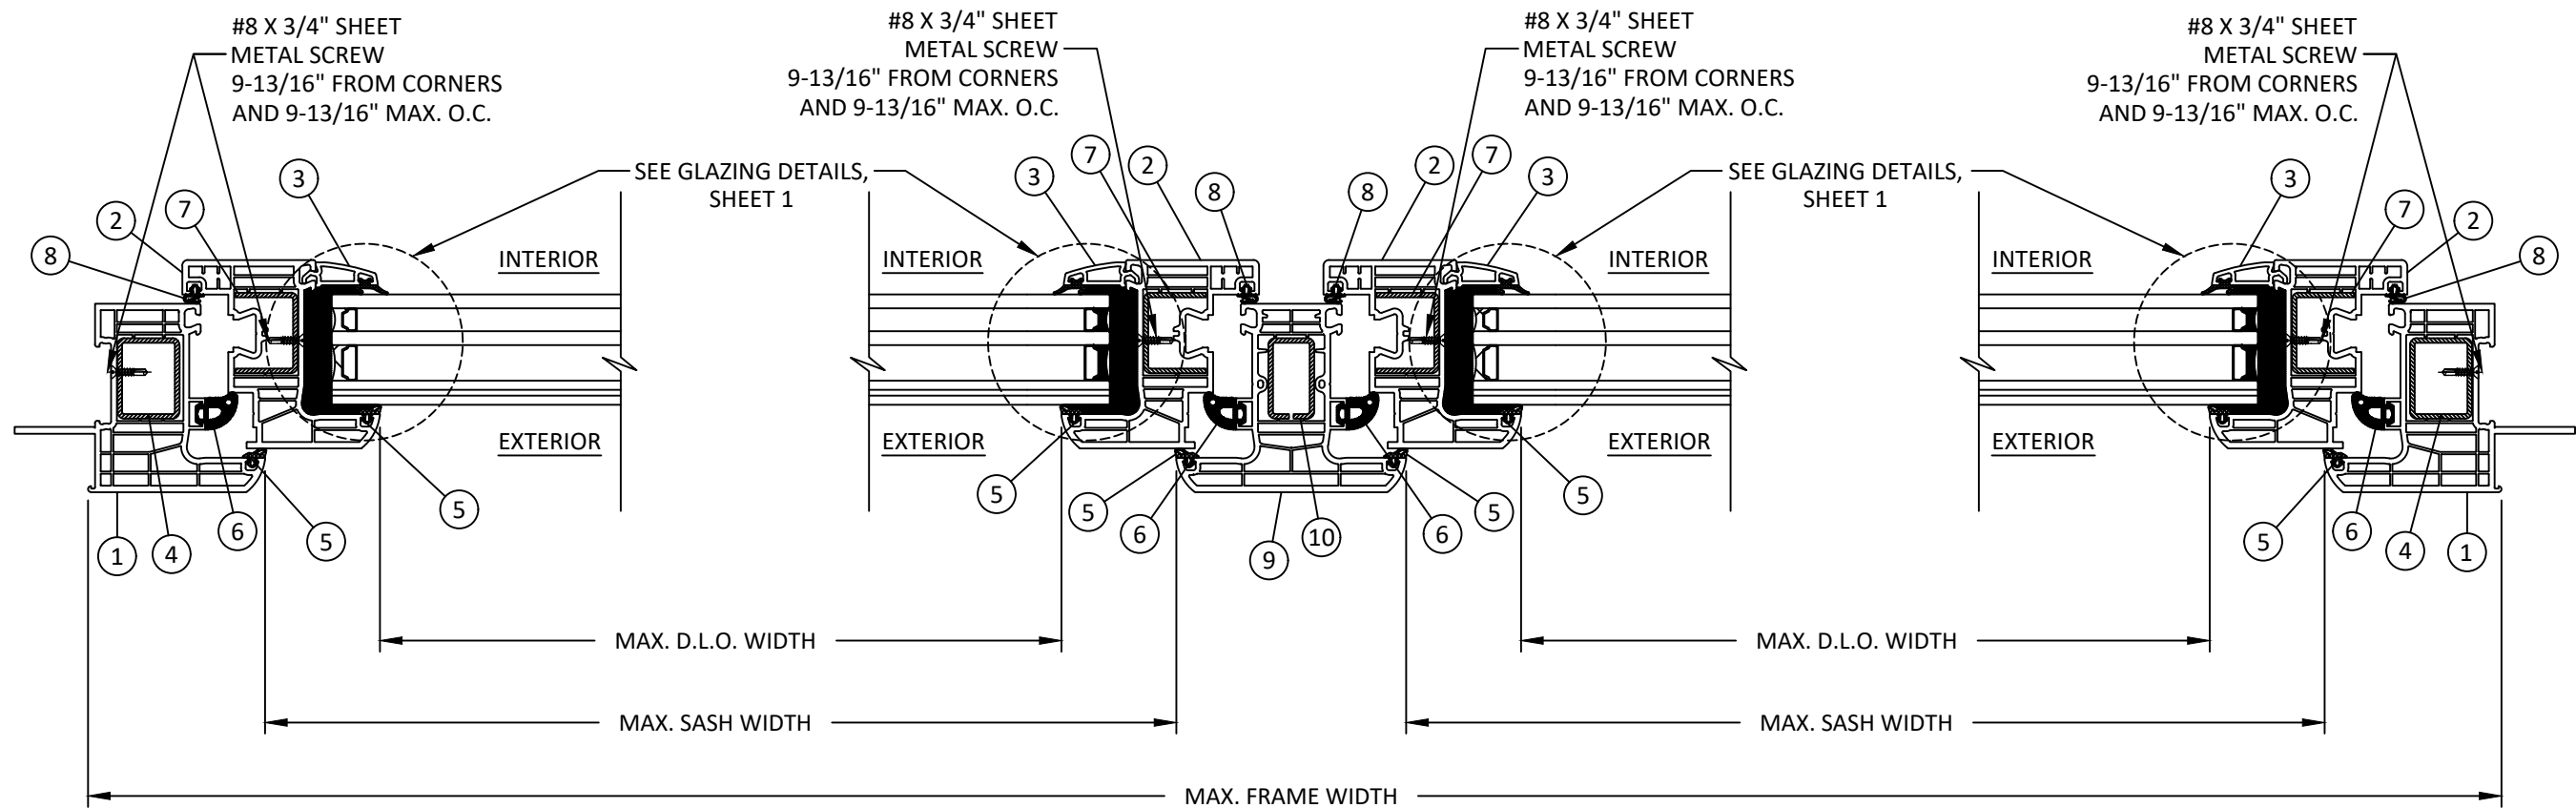

D
7
HORIZONTAL SECTION
FIN SECTION DETAIL



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE: IGLO ENERGY CLASSIC
CASEMENT WINDOW
(HVHZ) (IMPACT)

HORIZONTAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
FBC CODE REVISION	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

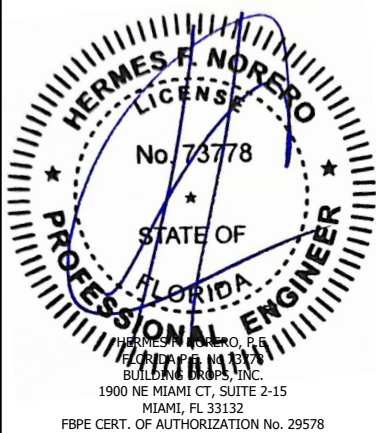


FL #:	FL41837
DATE:	12.12.2022
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	DRU015
SHEET:	7
REV.	B

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg 7/13/2026 10:50 AM

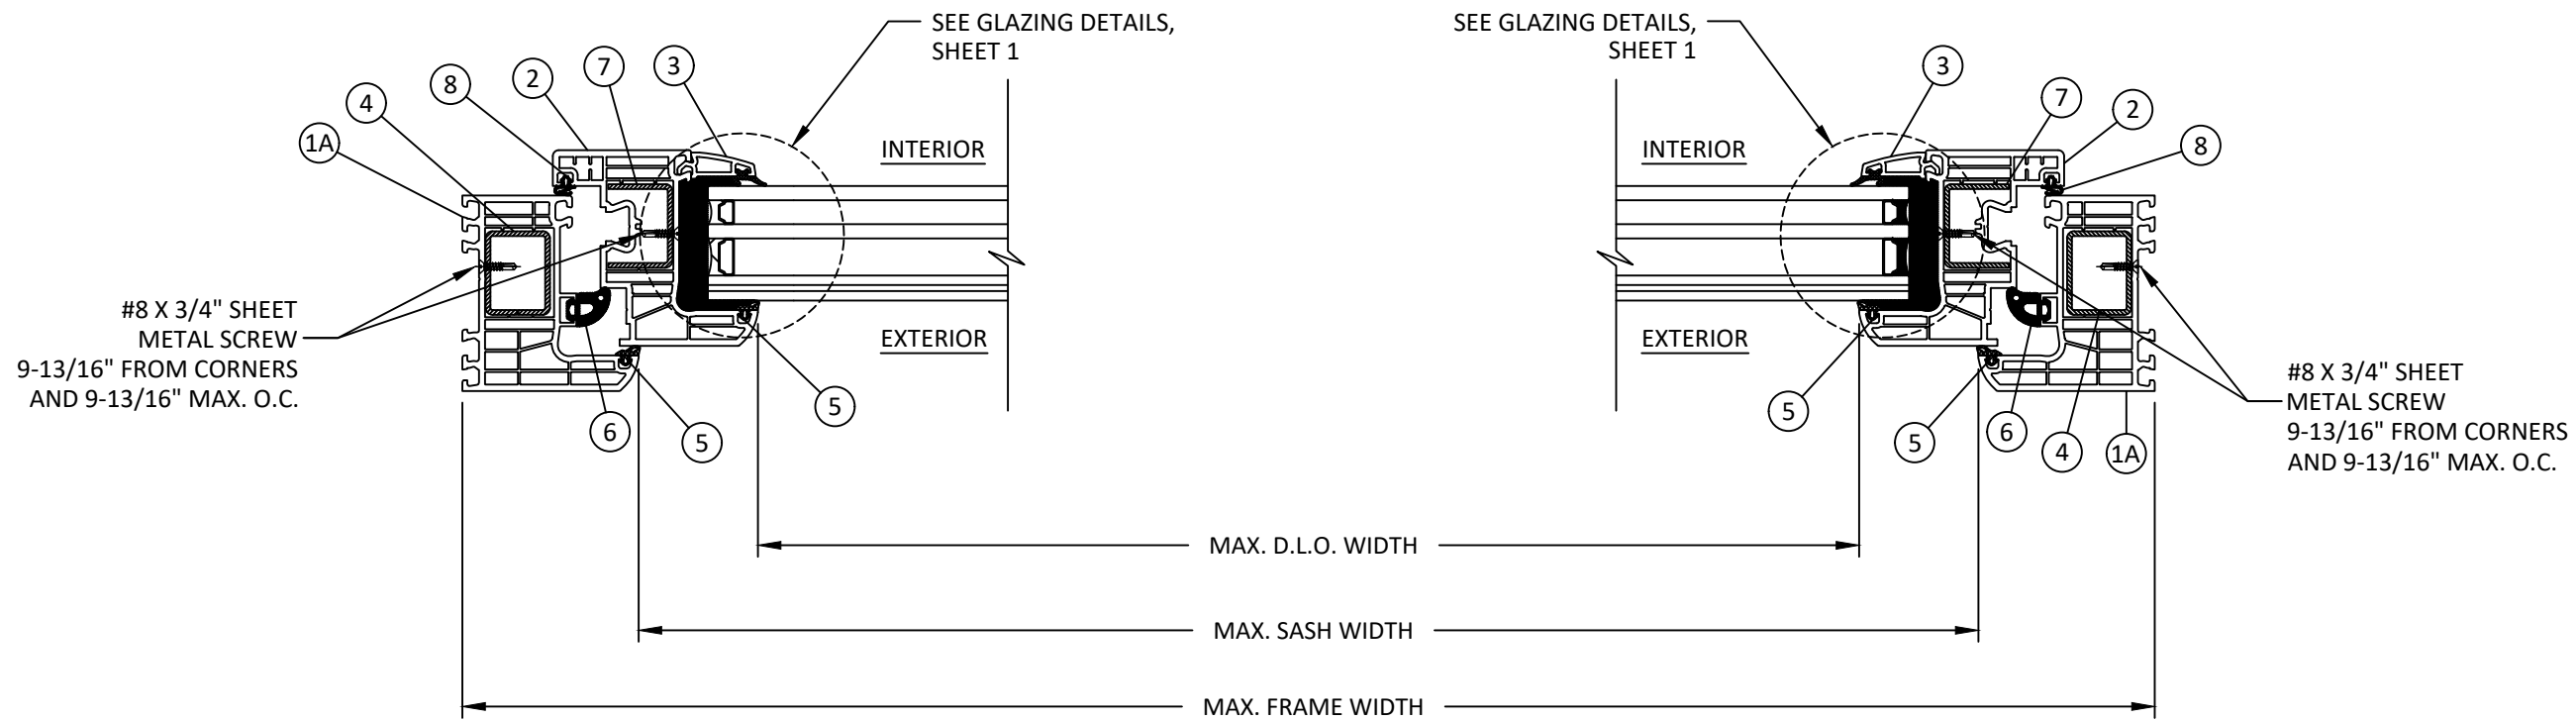

E
8
HORIZONTAL SECTION
FINLESS SECTION DETAIL

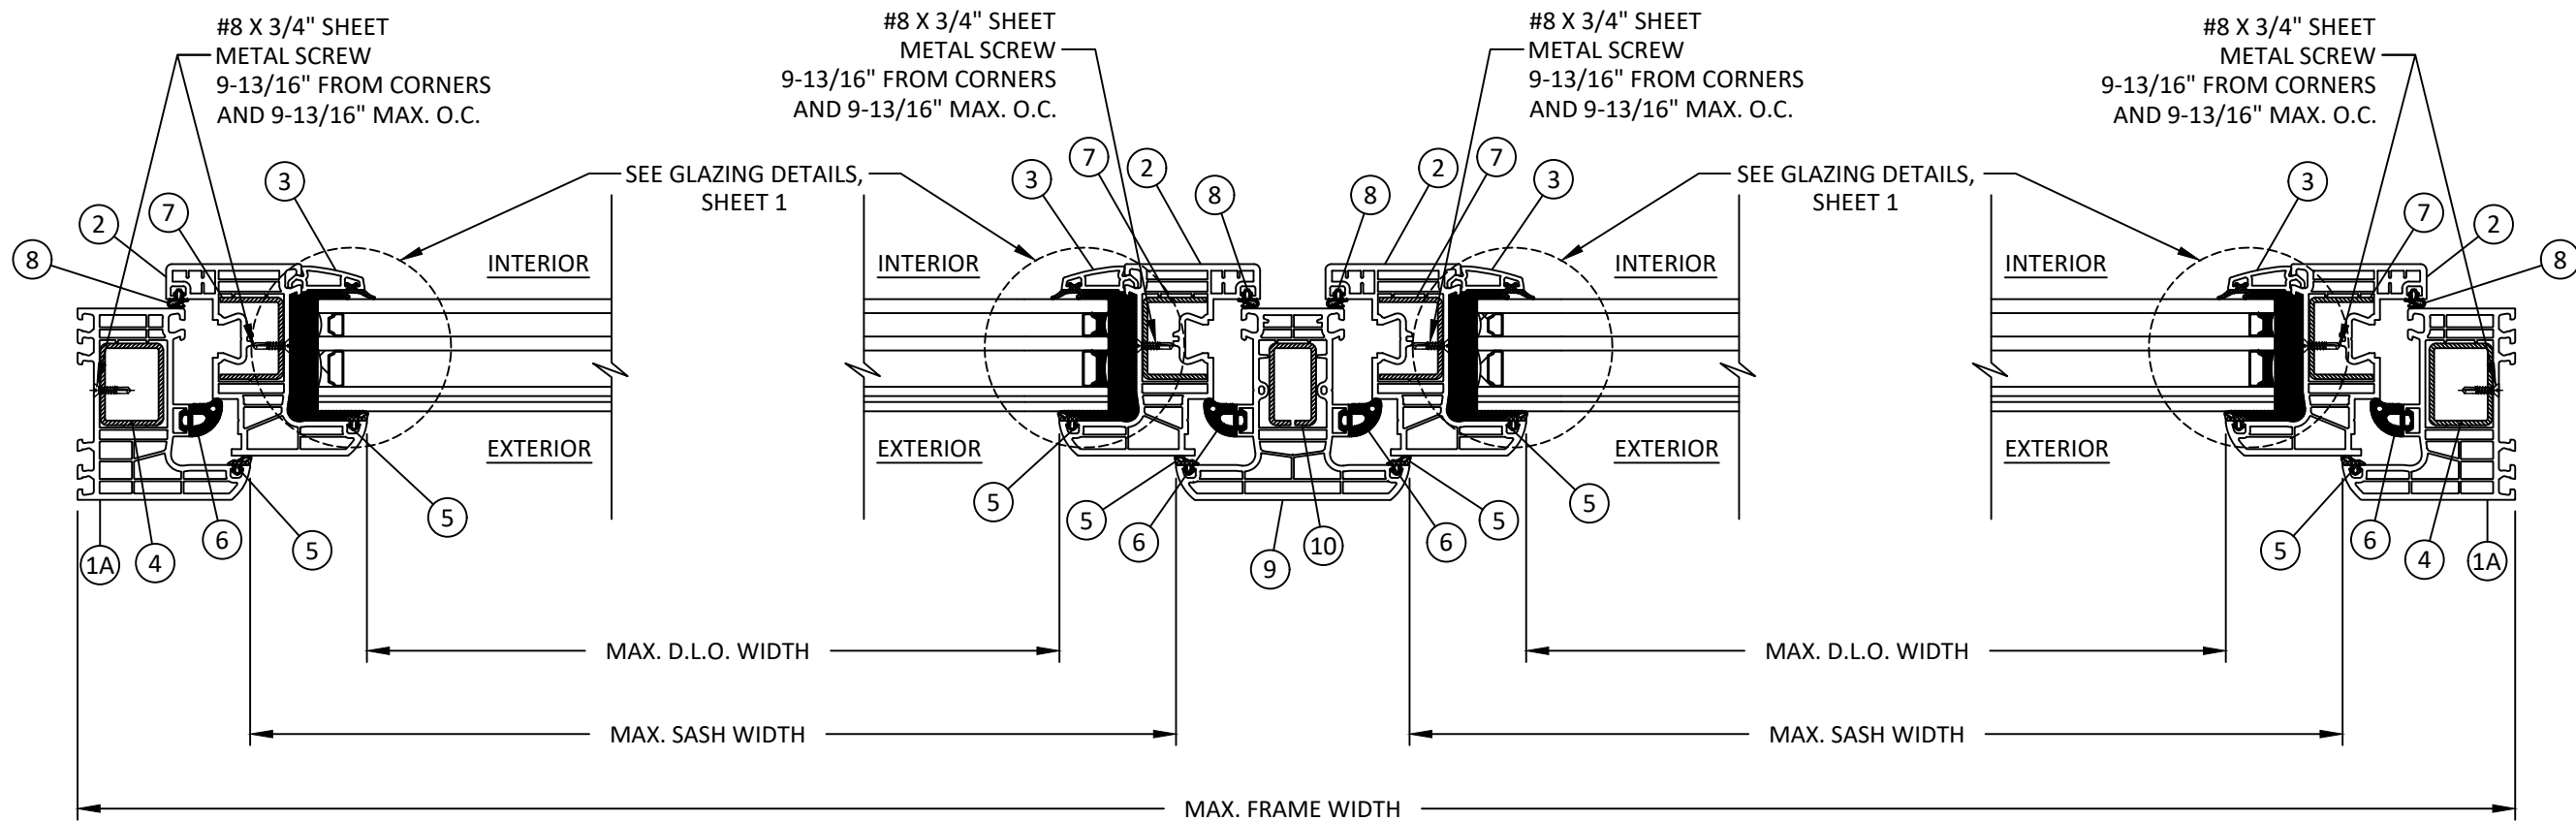

F
8
HORIZONTAL SECTION
FINLESS SECTION DETAIL



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103


TITLE: IGLO ENERGY CLASSIC
CASEMENT WINDOW
(HVHZ) (IMPACT)
HORIZONTAL SECTIONS
CONTINUED

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-9478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
FBC CODE REVISION	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

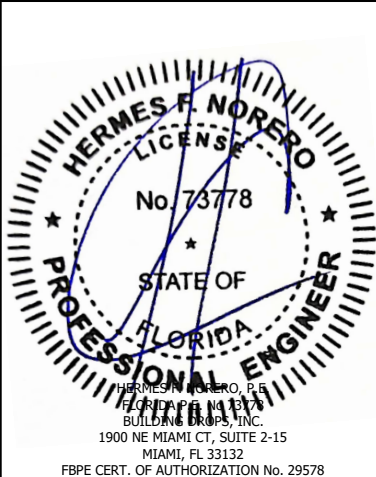

FL #:	FL41837
DATE:	12.12.2022
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	DRU015
SHEET:	8
REV.	B



NOTE: SILL & JAMB SIMILAR

- NOTE: HEAD & JAMB SIMILAR



DRUTEX
 ENGINEERED FOR YOU

TITLE: IGLO ENERGY CLASSIC
CASEMENT WINDOW
(HVHZ) (IMPACT)

PREPARED BY:  **BUILDING DROPS**
BUILDING DROPS, INC.
 1900 NE MIAMI COURT, STE. 2-15
 MIAMI, FL 33132
 PH: (954) 399-8478
 FAX: (954) 744-4738
 WEB: www.buildingdrops.com

REMARKS	BY	DATE
FBC CODE REVISION	FB	10/23
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

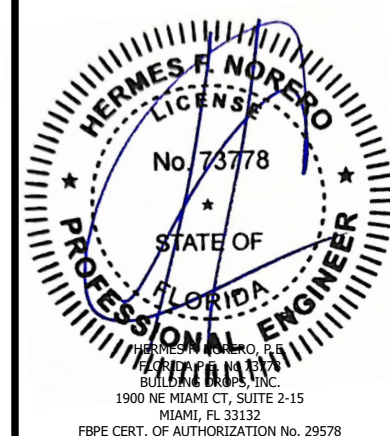

FL #: FL41837	
DATE: 12.12.2022	
DWG. BY: SH	CHK. BY: HFN
SCALE: NTS	
DWG. #: DRU015	
SHEET: 9	REV. B
OF 11	



D 10

HORIZONTAL SECTION

JAMB - NAIL-FIN & STRAP

