

LONGBOARD ARCHITECTURAL PRODUCTS

LINK & LOCK BATTEN SYSTEM

(HVHZ)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - SECTION 1709.8
 - ASTM E8-16
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 2X MEMBERS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- ALUMINUM SIDING MEETS THE REQUIREMENTS OF THE CURRENT FBC. APPLICATION OF ALUMINUM SIDING SHALL MEET REQUIREMENTS OF THE CURRENT FBC.
- ALUMINUM SIDING SPECIFICATIONS:
 - MATERIAL: 6063-T5
 - MINIMUM WALL THICKNESS: 0.0625"
- INSTALLATION OF SIDING ACCESSORIES SUCH AS END CAP AND MOUNTING CLIP SHALL BE DONE IN ACCORDANCE WITH THE FLORIDA BUILDING CODE AND THE MANUFACTURER'S INSTRUCTIONS.

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, SHEATHING AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - *FASTENERS INSTALLED WITHIN 300 FEET OF A SALTWATER COASTLINE IN EXTERIOR-PARTIALLY SHELTERED OR EXTERIOR-OPEN EXPOSED SPACES SHALL BE STAINLESS STEEL PER SECTION 1711.1.1.1 (ASTM A240 TYPE 304, A305, 316, OR 410).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED UNVENTED SPACES SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
 - CONNECTORS AND METAL PLATES USED BETWEEN 300 AND 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED VENTED SPACES, EXTERIOR-PARTIALLY SHELTERED OR EXTERIOR-OPEN EXPOSED SPACES SHALL BE ENHANCED GALVANIZED PER SECTION 1711.1.2.2 (ASTM A653 G185, ASTM A123 AT 2.0 OZ/SF MIN, OR TPI 1 COATING).
 - *CONNECTORS AND METAL PLATES USED WITHIN 300 FEET OF A SALTWATER COASTLINE IN EXTERIOR-PARTIALLY SHELTERED OR EXTERIOR-OPEN EXPOSED SPACES SHALL BE STAINLESS STEEL PER SECTION 1711.1.2.1 (ASTM A240 TYPE 316).
 - FASTENERS USED WITH CONNECTORS OR METAL PLATES SHALL HAVE A CORROSION-RESISTANT COATING OR COMPOSITION COMPATIBLE WITH THAT OF THE CONNECTOR/PLATE TO PREVENT GALVANIC CORROSION BETWEEN DISSIMILAR MATERIALS (SECTION 1711.1.1.3). EXCEPTION: FASTENERS AND CONNECTORS FULLY EMBEDDED IN CONCRETE OR MORTAR ARE EXEMPT FROM NOTES 4 AND 5 (SECTION 1711.1).
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- PRODUCT OF WALL MOUNTED SHALL BE INSTALLED IN FRONT OF CBS CONSTRUCTION (ASTM C90) OR 5/8" (5 PLY) PLYWOOD SUPPORTED BY 2X STUDS OR 2X6 – 18 GA. METAL STUDS, EACH AT 16" O.C.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & INSTALLATION NOTES
2	WALL MOUNT INSTALLATION
3	END TO END INSTALLATION
4	LARGER SPAN INSTALLATION
5	DESIGN PRESSURE TABLES
6	COMPONENTS

DESIGN RATING	
INSTALLATION METHOD	DESIGN PRESSURE
WALL MOUNT	SEE SHEET 4
END TO END	
LARGER SPAN	



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE:
LINK & LOCK BATTEN SYSTEM
(HVHZ)

GENERAL NOTES & INSTALLATION NOTES

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2023 FBC UPDATE	MS	08/08/2023
MISC. UPDATE	DI	04/30/2025
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.


Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.10.11 16:43:01 -0400'




HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT # 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL41842	
DATE:	11.04.22	
DWG. BY:	MS	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	LBD001	
SHEET:	1	REV. C
OF 6		

WALL MOUNT INSTALLATION

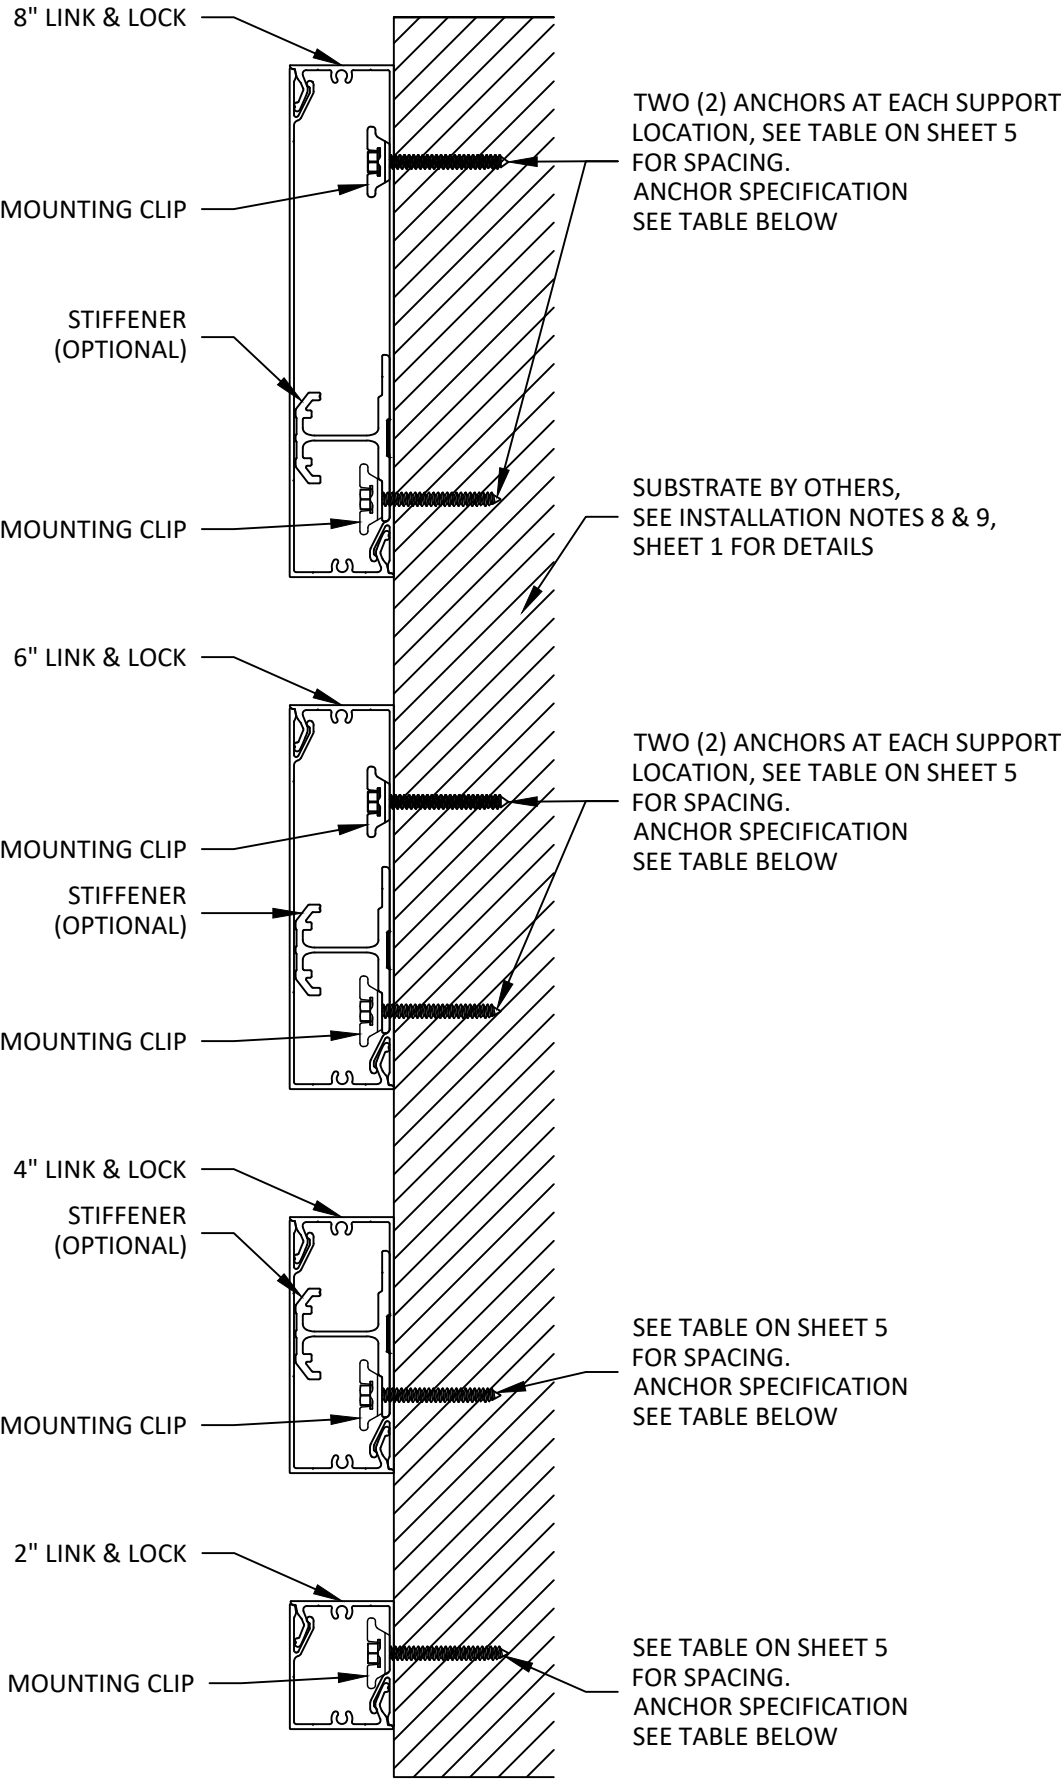

BATTEN ORIENTATION INSTALLATION

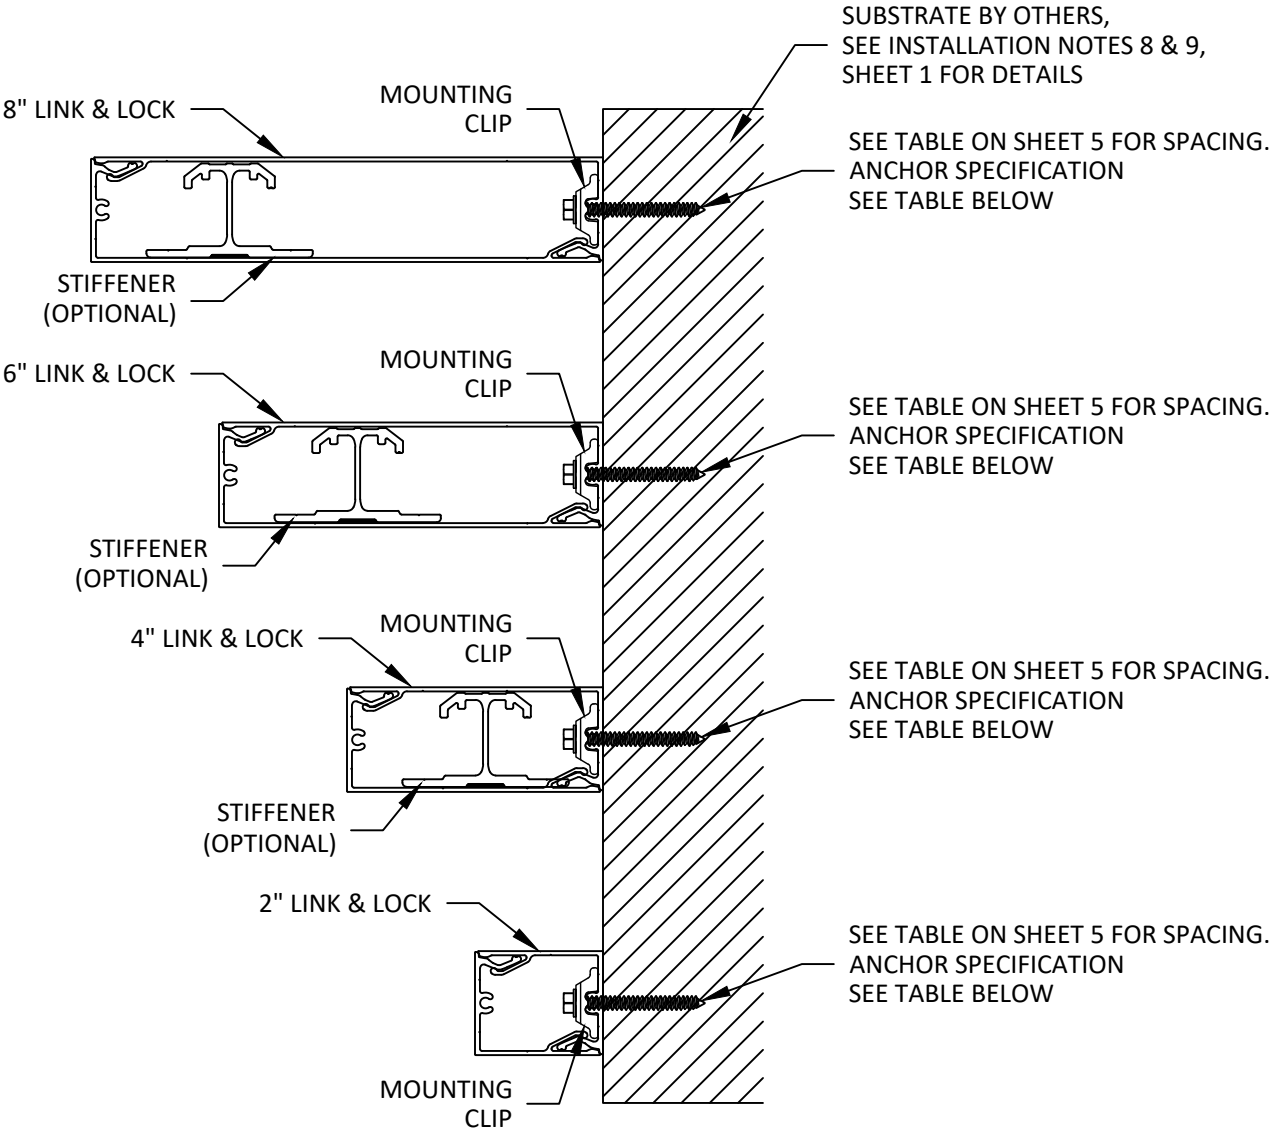

FIN ORIENTATION INSTALLATION

ANCHOR DESCRIPTION	SUBSTRATE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
#12 WOOD SCREW OR #12 GRK R4 SS SCREW*	MIN. S.G. = 0.55 WOOD	1-1/2"	1"
#12 SELF-DRILLING/TAPPING SCREW OR #12 DEWALT BIFLEX SS SCREW*	STEEL: MIN. 18 GA., MIN. Fy=33 KSI ALUM.: MIN. 1/8", MIN. 6063-T5	3 THREADS PENETRATION PAST METAL STRUCTURE	1/2"
3/16" ITW TAPCON OR 3/16" CRETE-FLEX SS SCREW*	CONCRETE MIN. F'C = 3000 PSI	1-1/2"	1-3/4"
	HOLLOW / GROUT-FILLED BLOCK PER ASTM C-90 MIN. F'C = 2000 PSI	1"	2"



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE:
LINK & LOCK BATTEN SYSTEM
(HVHZ)

WALL MOUNT INSTALLATION

PREPARED BY:

BUILDING DROPS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2023 FBC UPDATE	MS	08/08/2023
MISC. UPDATE	DI	04/30/2025
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT # 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL41842

DATE:

11.04.22

DWG. BY:

MS

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

LBD001

SHEET:

2



REV.

C

OF 6

END TO END INSTALLATION

SUBSTRATE BY OTHERS,
SEE INSTALLATION NOTE 8 & 9,
SHEET 1 FOR DETAILS

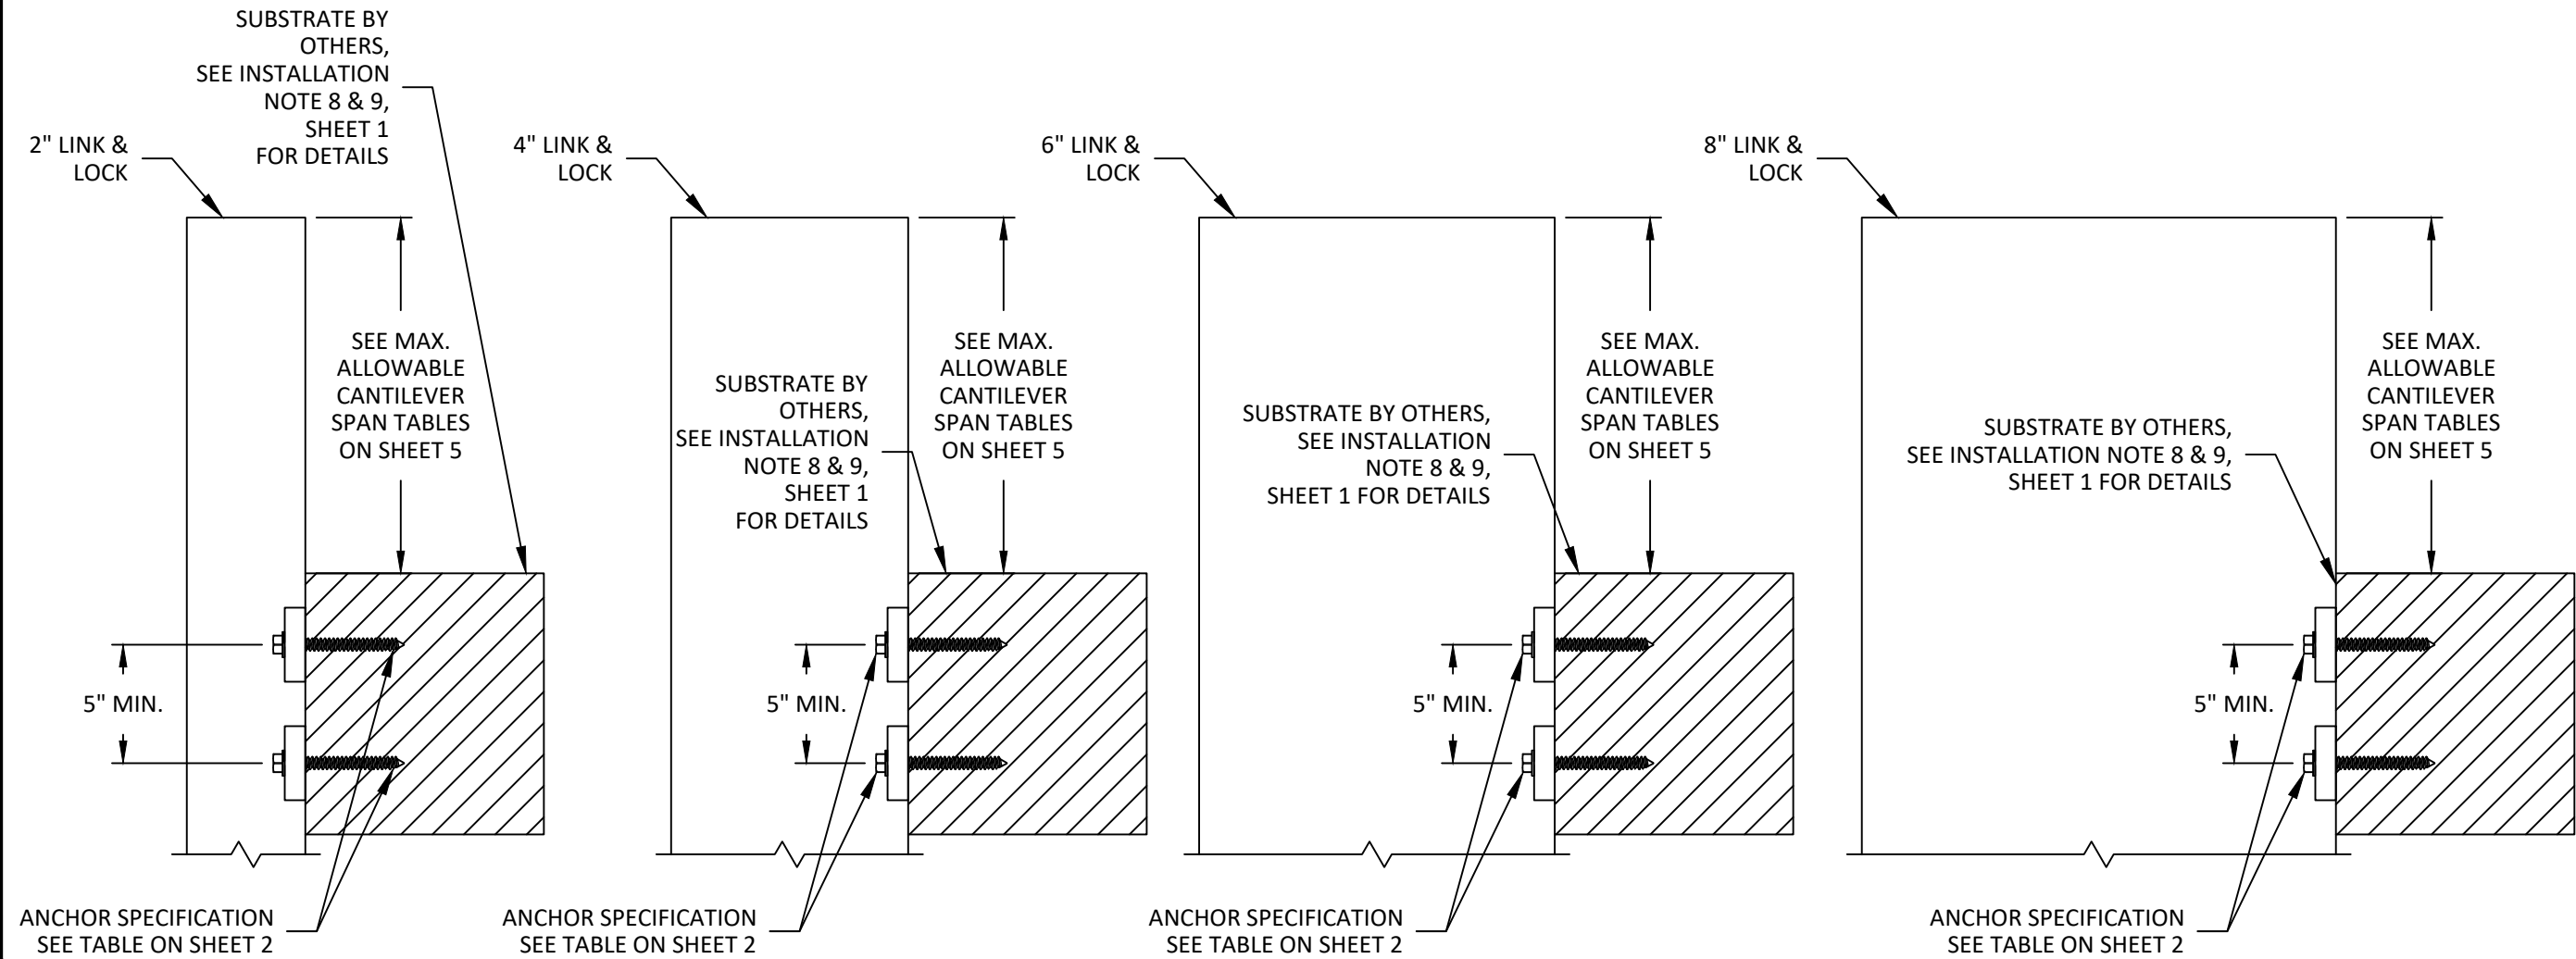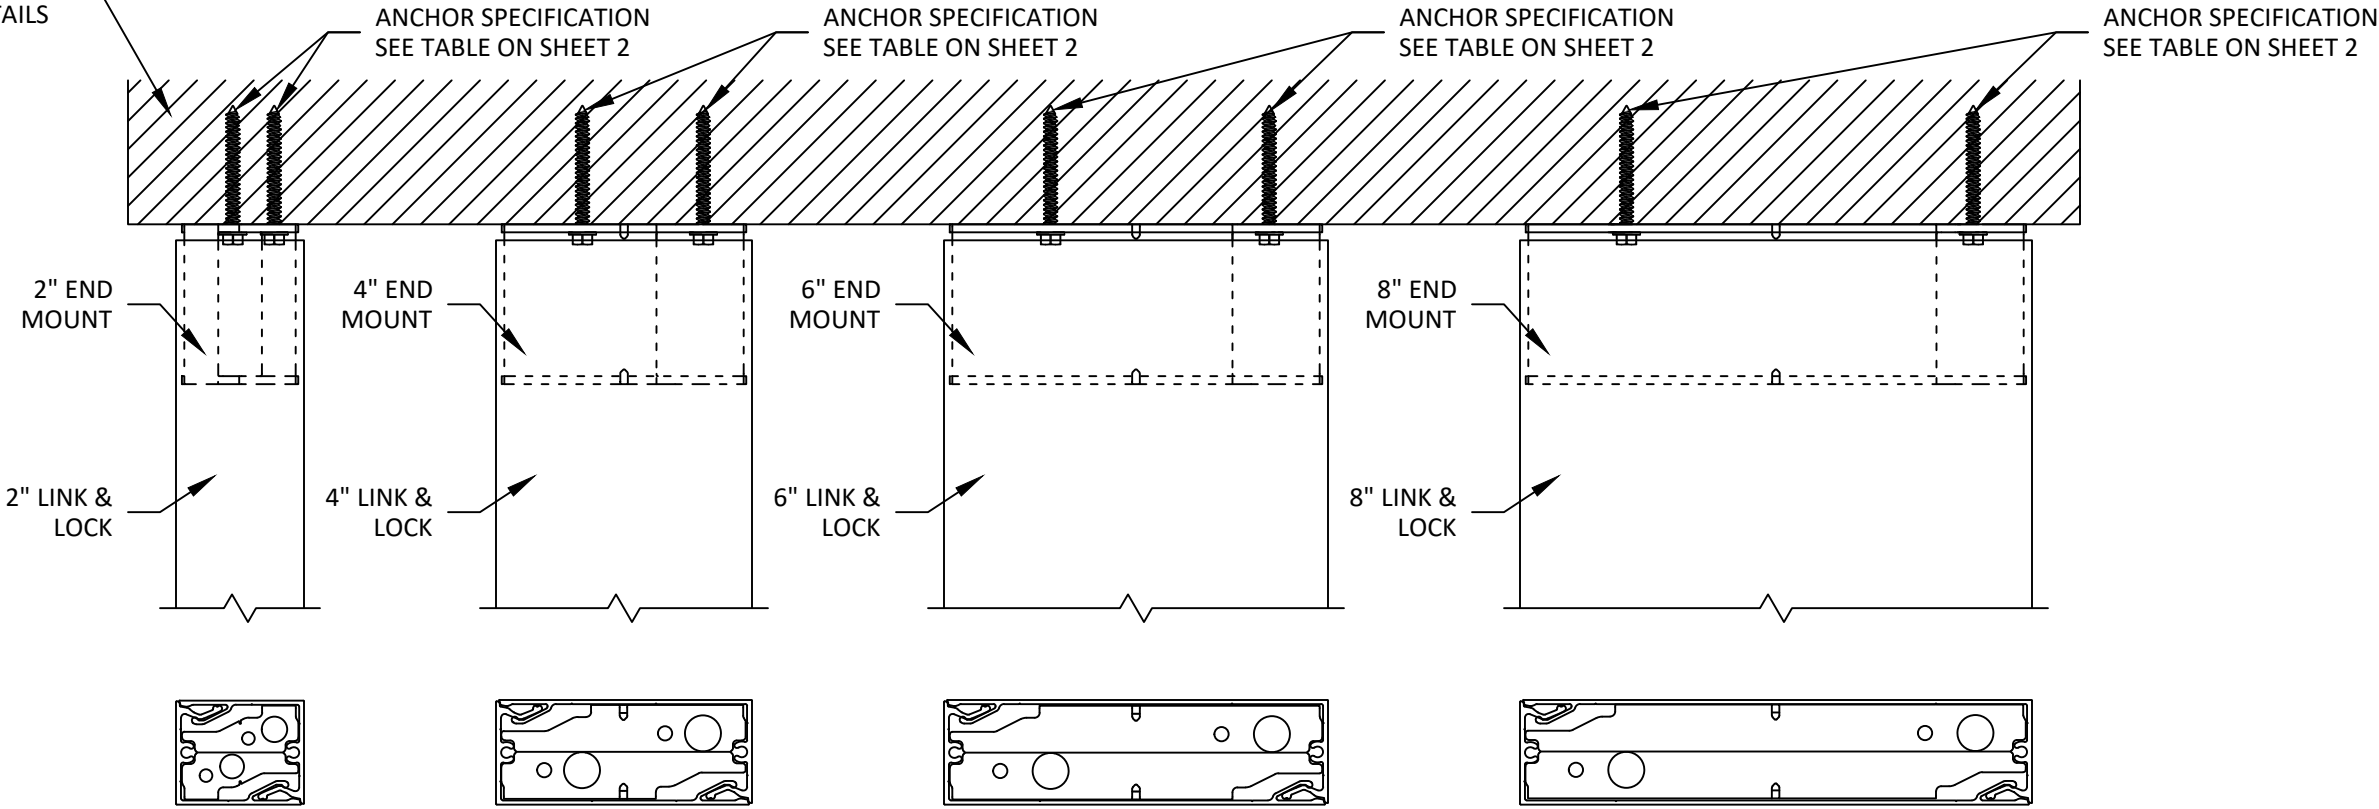

1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE:
LINK & LOCK BATTEN SYSTEM
(HVHZ)
END TO END INSTALLATION

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com


REMARKS	BY	DATE
2023 FBC UPDATE	MS	08/08/2023
MISC. UPDATE	DI	04/30/2025
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT # 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL41842
DATE:	11.04.22
DWG. BY:	MS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	LBD001
SHEET:	3
REV.	C

LARGER SPAN INSTALLATION

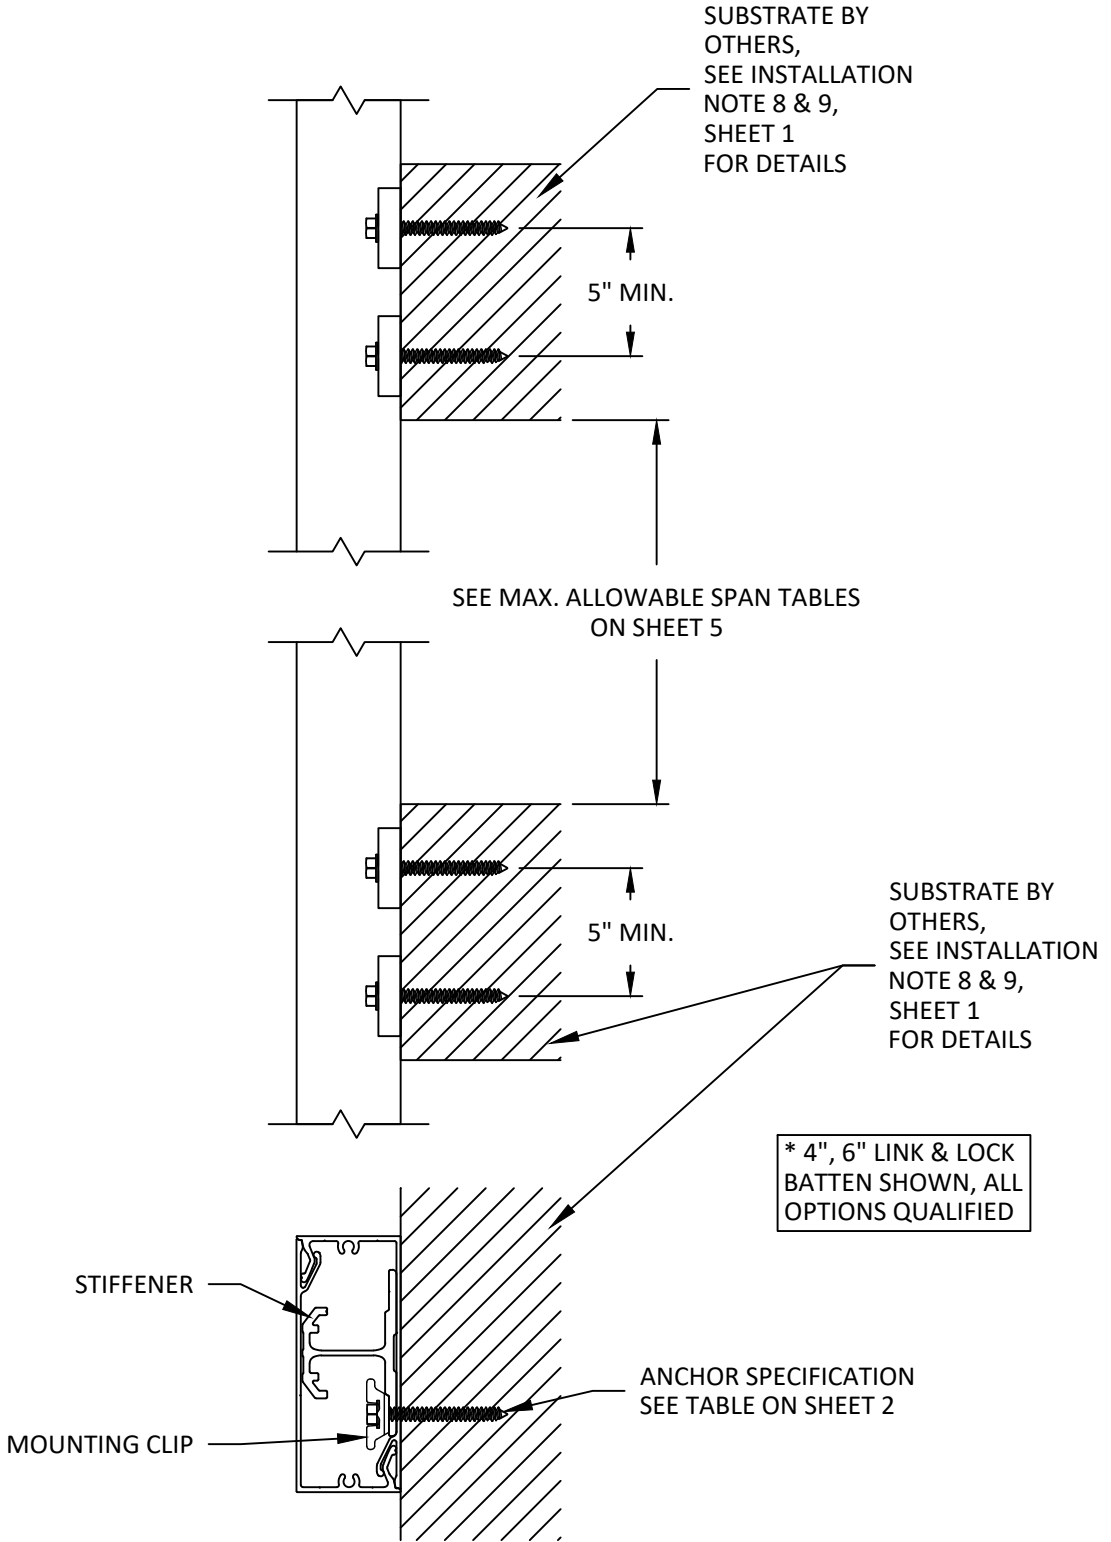

BATTEN ORIENTATION INSTALLATION

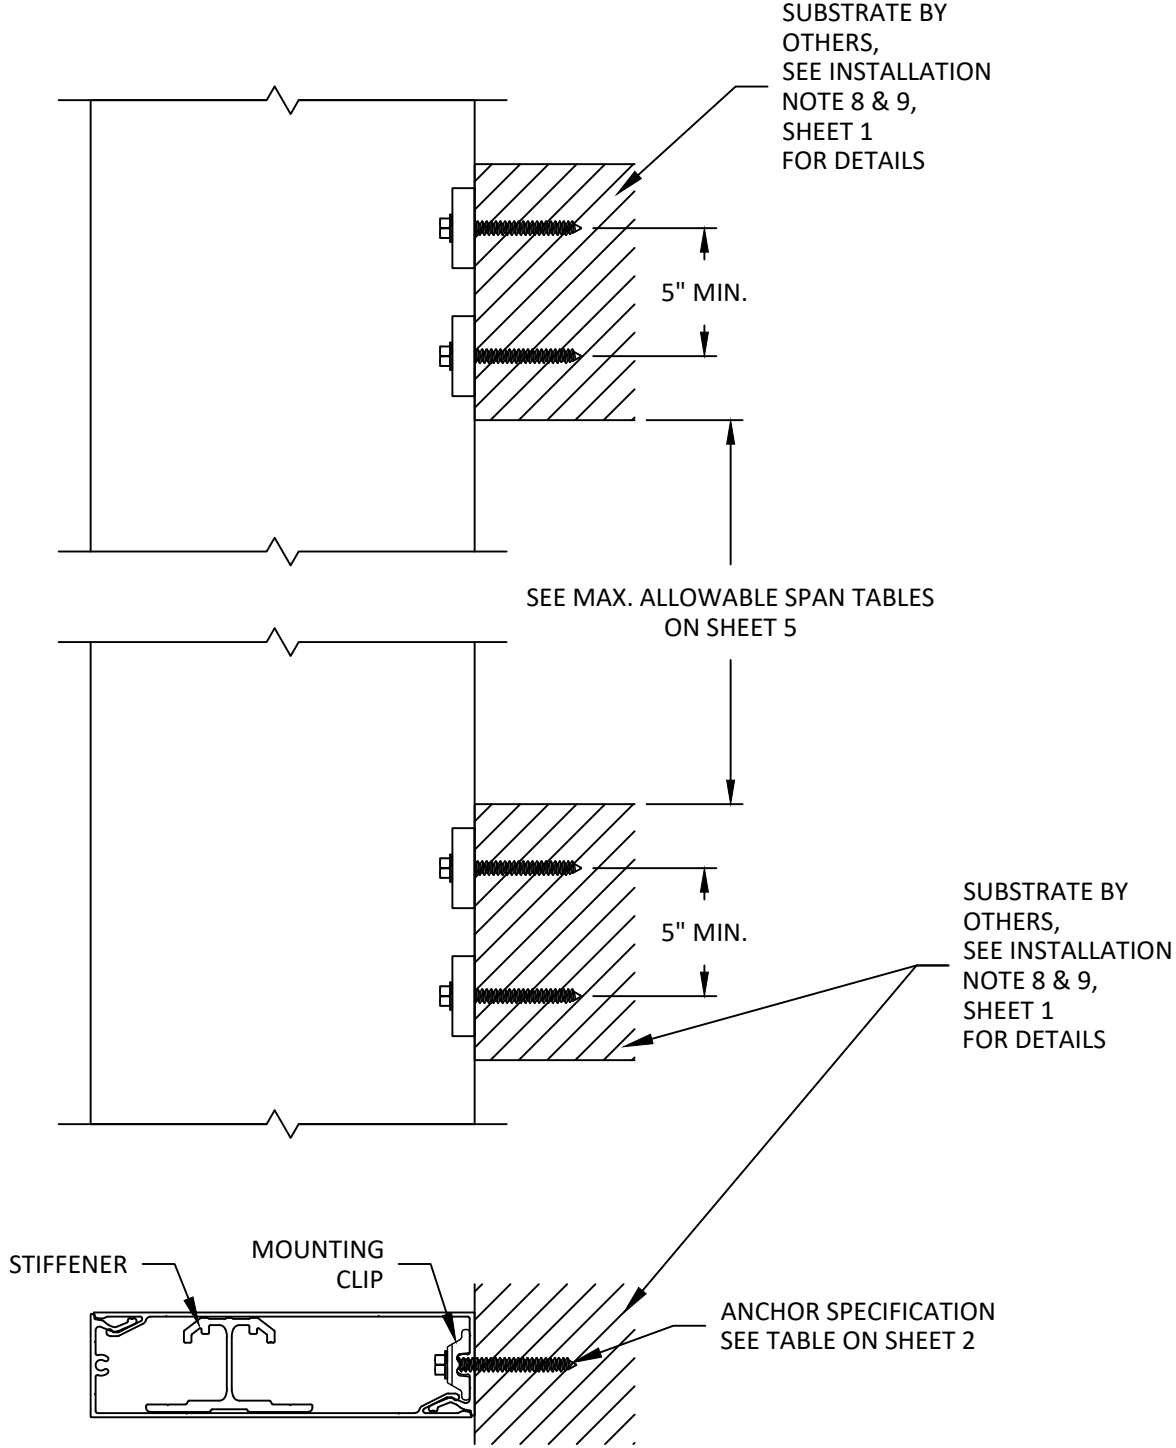

FIN ORIENTATION INSTALLATION



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE:
LINK & LOCK BATTEN SYSTEM
(HVHZ)

LARGER SPAN INSTALLATION

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2023 FBC UPDATE	MS	08/08/2023
MISC. UPDATE	DI	04/30/2025
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT # 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL41842
DATE:	11.04.22
DWG. BY:	MS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	LBD001
SHEET:	4
REV.	C

END TO END & LARGER SPAN DESIGN PRESSURE TABLES

ULTIMATE DESIGN PRESSURE* (PSF)	ALLOWABLE DESIGN PRESSURE* (PSF)	LINK & LOCK BATTEN MAX. ALLOWABLE SPAN (FT)			
		2" LINK & LOCK	4" LINK & LOCK	6" LINK & LOCK	8" LINK & LOCK
50	30	10.00	8.00	6.00	6.00
66.67	40	8.00	6.00	6.00	4.00
83.33	50	8.00	6.00	4.00	4.00
100	60	6.00	4.00	4.00	2.00
116.67	70	6.00	4.00	4.00	2.00
133.33	80	6.00	2.00	4.00	2.00
150	90	6.00	2.00	4.00	2.00
166.67	100	6.00	2.00	4.00	2.00
183.33	110	6.00	2.00	3.75	2.00
200	120	4.00	2.00	2.00	2.00

*NOTE: ALLOWABLE DP = ULTIMATE DP X 0.6

ULTIMATE DESIGN PRESSURE* (PSF)	ALLOWABLE DESIGN PRESSURE* (PSF)	LINK & LOCK BATTEN W/ STIFFENER MAX. ALLOWABLE SPAN (FT)		
		4" LINK & LOCK	6" LINK & LOCK	8" LINK & LOCK
50	30	12.00	10.00	8.00
66.67	40	10.00	8.00	6.00
83.33	50	8.00	6.00	6.00
100	60	8.00	6.00	4.00
116.67	70	6.00	5.00	4.00
133.33	80	6.00	5.00	3.75
150	90	4.00	4.50	3.25
166.67	100	4.00	4.00	3.00
183.33	110	4.00	3.75	2.75
200	120	4.00	3.25	2.50

*NOTE: ALLOWABLE DP = ULTIMATE DP X 0.6

ULTIMATE DESIGN PRESSURE* (PSF)	ALLOWABLE DESIGN PRESSURE* (PSF)	LINK & LOCK BATTEN MAX. ALLOWABLE CANTILEVER SPAN (FT)			
		2" LINK & LOCK	4" LINK & LOCK	6" LINK & LOCK	8" LINK & LOCK
50	30	7.00	6.25	4.50	3.25
66.67	40	6.25	5.00	3.25	2.50
83.33	50	5.75	4.00	2.75	2.00
100	60	5.50	3.25	2.25	1.50
116.67	70	5.25	2.75	1.75	1.25
133.33	80	5.00	2.00	1.50	1.25
150	90	4.50	2.00	1.50	1.00
166.67	100	4.00	2.00	1.25	1.00
183.33	110	3.75	1.75	1.25	0.75
200	120	3.25	1.50	1.00	0.75

*NOTE: ALLOWABLE DP = ULTIMATE DP X 0.6

ULTIMATE DESIGN PRESSURE* (PSF)	ALLOWABLE DESIGN PRESSURE* (PSF)	LINK & LOCK BATTEN W/ STIFFENER MAX. CANTILEVER ALLOWABLE SPAN (FT)		
		4" LINK & LOCK	6" LINK & LOCK	8" LINK & LOCK
50	30	6.75	4.50	3.25
66.67	40	5.00	3.25	2.50
83.33	50	4.00	2.75	2.00
100	60	3.25	2.25	1.50
116.67	70	2.75	1.75	1.25
133.33	80	2.50	1.50	1.25
150	90	2.25	1.50	1.00
166.67	100	2.00	1.25	1.00
183.33	110	1.75	1.25	0.75
200	120	1.50	1.00	0.75

*NOTE: ALLOWABLE DP = ULTIMATE DP X 0.6



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE:
LINK & LOCK BATTEN SYSTEM
(HVHZ)

DESIGN PRESSURE TABLES

PREPARED BY:
 BUILDING DROPS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (354)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2023 FBC UPDATE	MS	08/08/2023
MISC. UPDATE	DI	04/30/2025
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT # 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL41842**

DATE: **11.04.22**

DWG. BY: **MS** CHK. BY: **HFN**



SCALE: **NTS**

DWG. #: **LBD001**


SHEET: **5** REV. **C**

OF 6

COMPONENTS

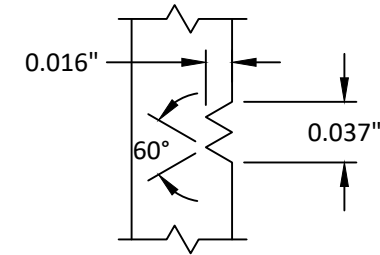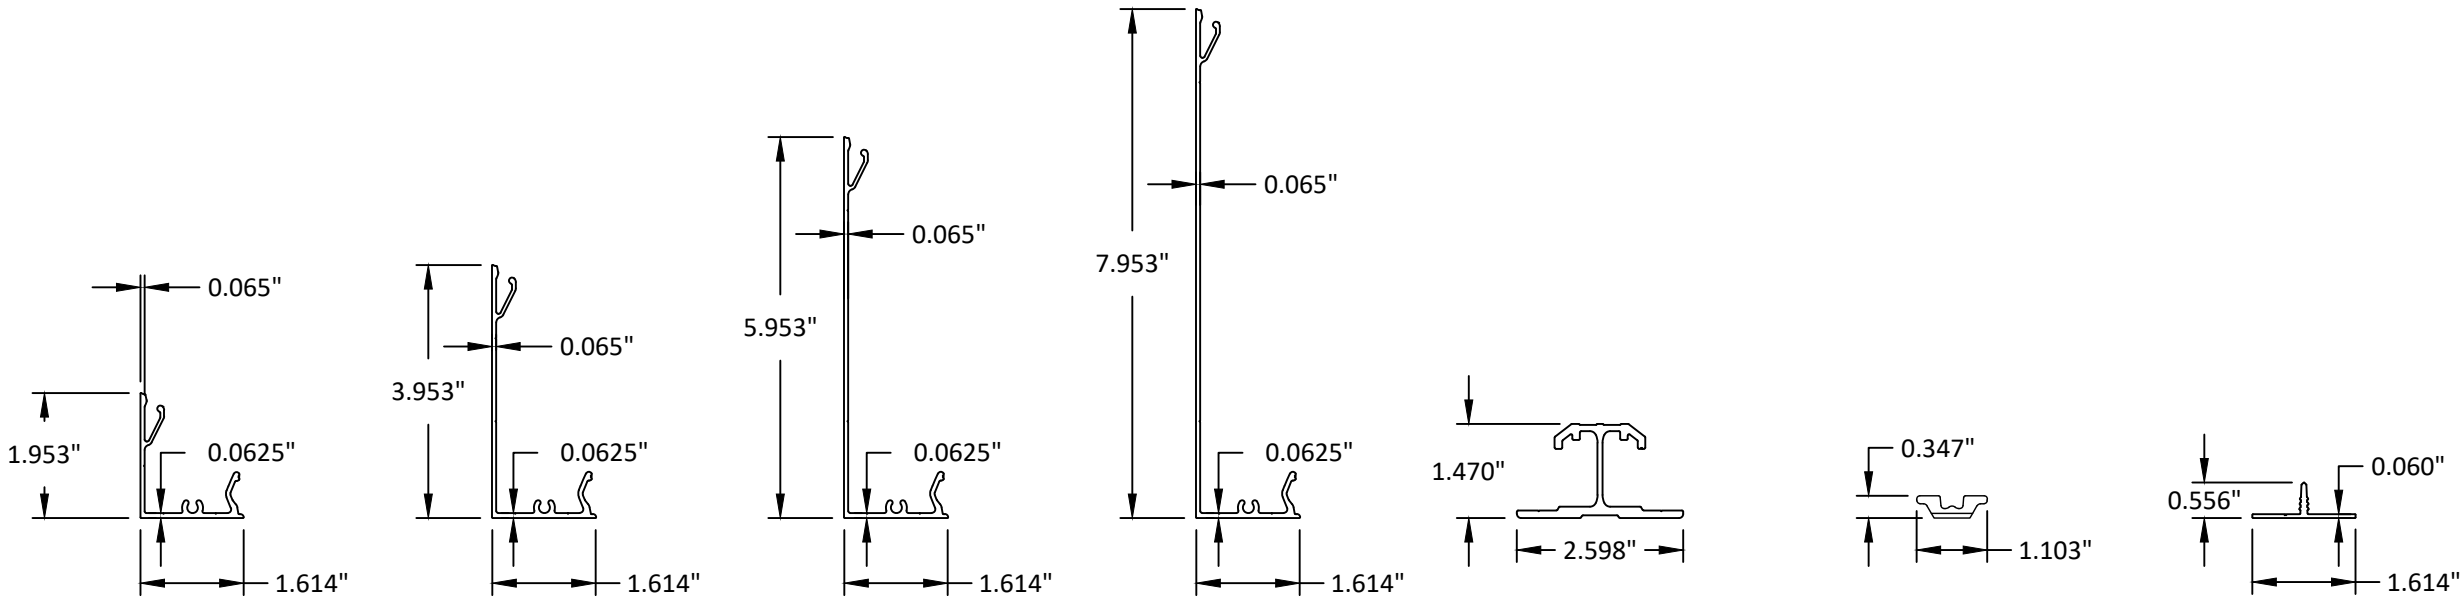

IDENTIFICATION EXTRUSION DIE LINE

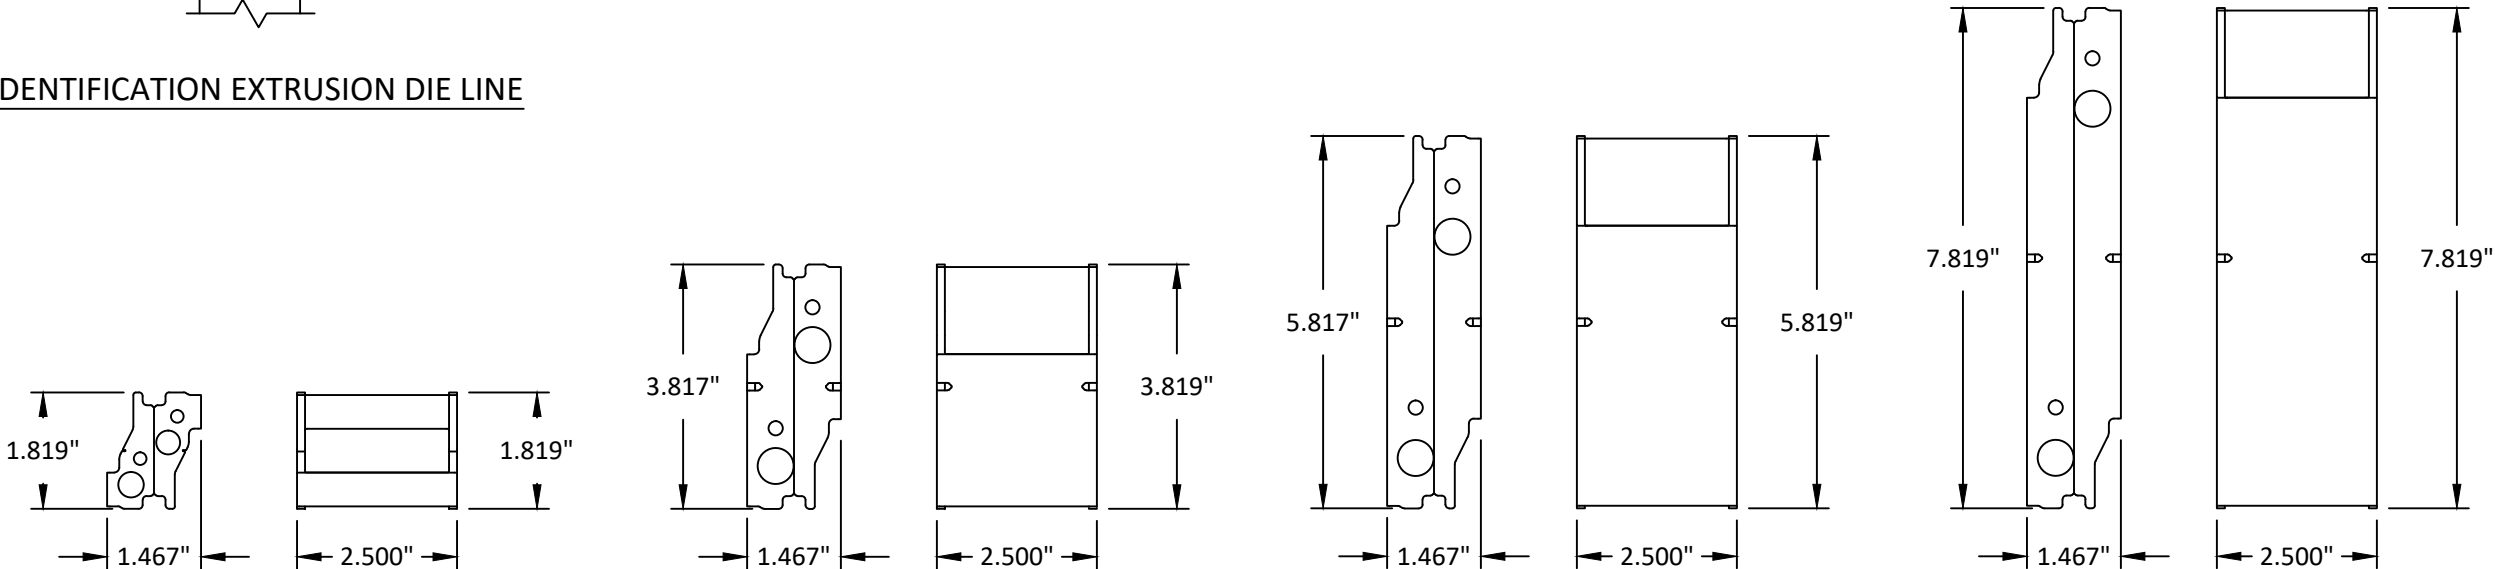

2" END MOUNT

4" END MOUNT

6" END MOUNT

8" END MOUNT



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE:
LINK & LOCK BATTEN SYSTEM
(HVHZ)

COMPONENTS

PREPARED BY:

BUILDING DROPS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2023 FBC UPDATE	MS	08/08/2023
MISC. UPDATE	DI	04/30/2025
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT # 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL41842
DATE:	11.04.22
DWG. BY:	CHK. BY:
MS	HFN
SCALE:	NTS
DWG. #:	LBD001
SHEET:	REV.
6	C