

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED DETAILS	05/18/26	R.L.

NOTES:


1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
5. FRAME MATERIAL: ALUMINUM 6063-T6
6. UNITS MUST BE GLAZED PER ASTM E1300, WITH SAFETY GLAZING.
7. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
8. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8".
9. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/8" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.

10. FOR ANCHORING INTO MASONRY/CONCRETE USE 3/16" ELCO ULTRA CON OR 1/4" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
11. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
12. ALL FASTENERS TO BE CORROSION RESISTANT.
13. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE – MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI.
 - C. GROUT FILLED MASONRY – STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
 - D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 .125" THICK MINIMUM


TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION AND RATINGS
3 – 4	CROSS SECTIONS
5 – 7	INSTALLATION DETAILS
8	COMPONENTS

THERMA-TRU 1750 INDIAN WOOD CIRCLE MAUMEE, OH 43537		
SERIES V-2 SLIDING GLASS DOOR 5x8 PANEL NON-IMPACT NOTES		
DRAWN: R.L.	DWG NO. 08-03871	REV A
SCALE NTS	DATE 11/03/22	SHEET 1 OF 8
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

SIGNED: 05/18/2026

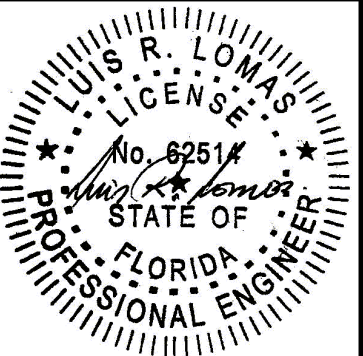

Luis R. Lomas P.E.
FL No.: 62514

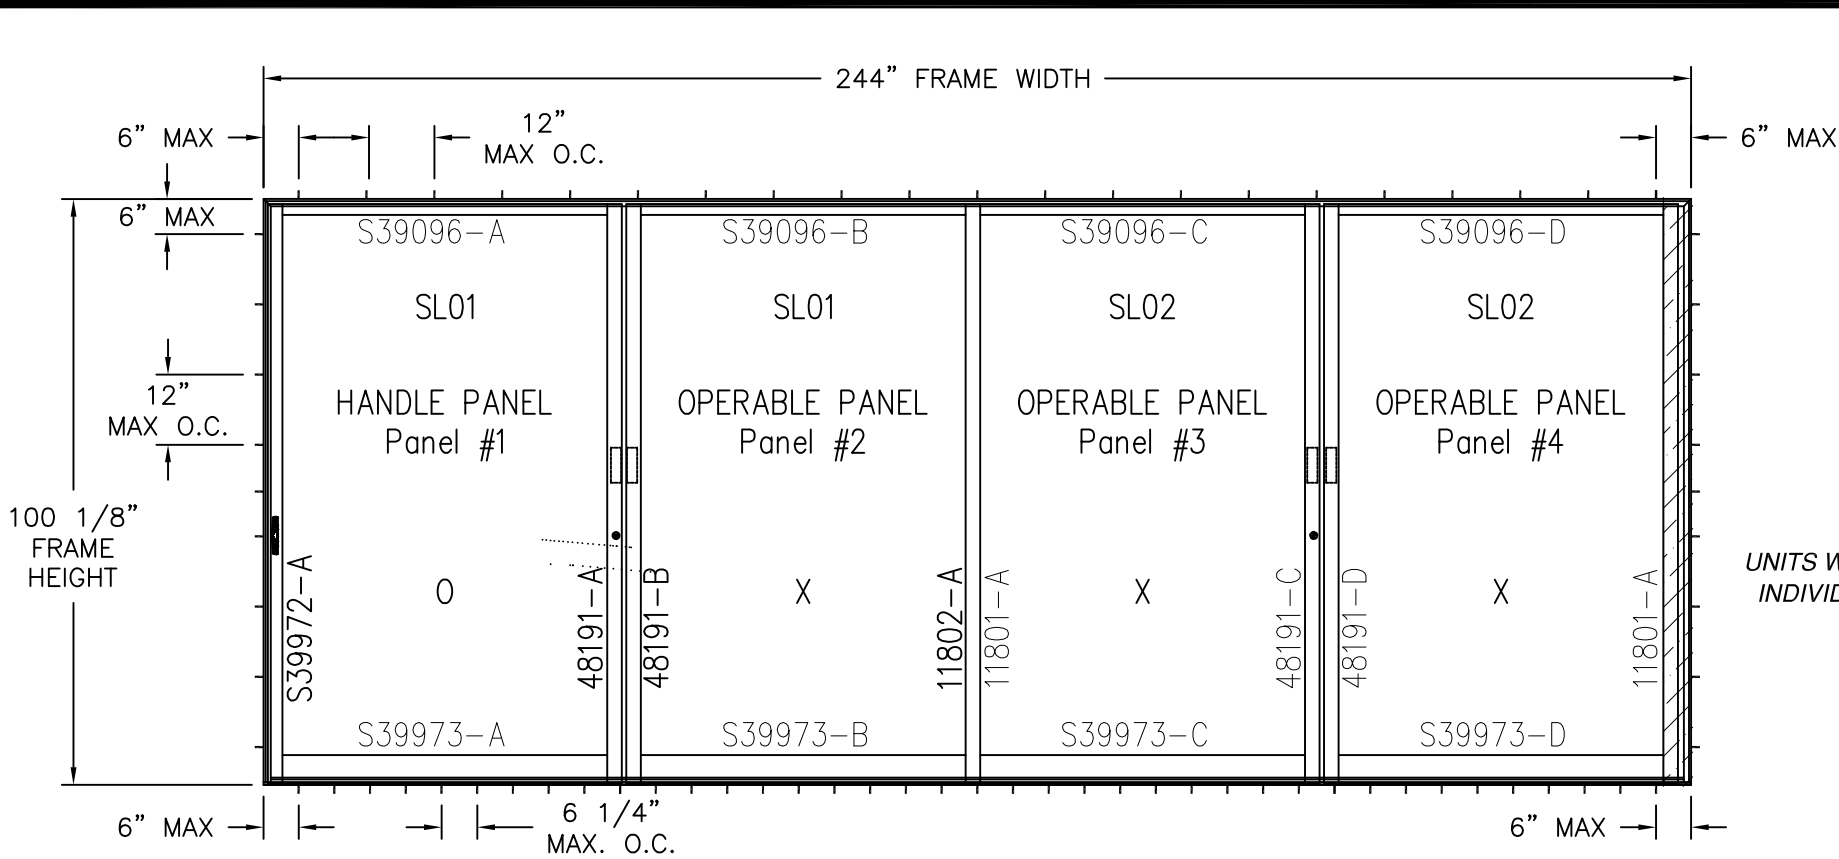

SERIES V-2 SLIDING GLASS DOOR 5x8 PANEL
EXTERIOR VIEW

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED DETAILS	05/18/26	R.L.

DESIGN PRESSURE RATING	IMPACT RATING
±65.0PSF	NONE

FOR ADDITIONAL SIZES SEE CHART #1

UNITS WITH 4 PANELS MAXIMUM IN UNLIMITED CONFIGURATIONS ARE APPROVED AS LONG AS
INDIVIDUAL PANEL AREA DOES NOT EXCEED 41.59 FT² AND FRAME AREA DOES NOT EXCEED
254.48 FT² AND USES VERTICAL CONDITIONS AS SHOWN.

Chart #1

Maximum Design pressure (psf)																
Panel Height (in)	Single Panel Width (in)															
	24.0		30.0		36.0		42.0		48.0		54.0		60.5		66.0	
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg
78.0	80.0	97.5	80.0	97.5	80.0	97.5	80.0	97.5	80.0	97.5	80.0	92.4	80.0	82.5	75.6	75.6
84.0	80.0	97.5	80.0	97.5	80.0	97.5	80.0	97.5	80.0	93.9	80.0	85.8	76.6	76.6	70.2	70.2
90.0	80.0	97.5	80.0	97.5	80.0	97.5	80.0	93.3	80.0	85.3	79.5	79.5	71.5	71.5	65.5	65.5
96.0	80.0	97.5	80.0	97.5	80.0	96.3	80.0	85.8	78.2	78.2	72.6	72.6	67.0	67.0	-	-
99.0	80.0	97.5	80.0	97.5	80.0	92.7	80.0	82.5	75.1	75.1	69.5	69.5	65.0	65.0	-	-
102.0	80.0	97.5	80.0	97.5	80.0	89.4	78.5	78.5	70.2	70.2	64.0	64.0	-	-	-	-
108.0	80.0	97.5	80.0	89.2	75.4	75.4	65.7	65.7	58.6	58.6	53.2	53.2	-	-	-	-
114.0	80.0	93.5	75.6	75.6	63.8	63.8	55.5	55.5	49.4	49.4	-	-	-	-	-	-
120.0	80.0	80.1	64.6	64.6	54.5	54.5	47.3	47.3	42.0	42.0	-	-	-	-	-	-
126.0	69.0	69.0	55.7	55.7	46.9	46.9	40.7	40.7	-	-	-	-	-	-	-	-
132.0	60.0	60.0	48.3	48.3	40.7	40.7	35.2	35.2	-	-	-	-	-	-	-	-
138.0	52.4	52.4	42.2	42.2	35.5	35.5	30.7	30.7	-	-	-	-	-	-	-	-
144.0	46.1	46.1	37.1	37.1	31.2	31.2	-	-	-	-	-	-	-	-	-	-
150.0	40.7	40.7	32.8	32.8	27.5	27.5	-	-	-	-	-	-	-	-	-	-
156.0	36.2	36.2	29.1	29.1	24.4	24.4	-	-	-	-	-	-	-	-	-	-

- NOTES:
- PANEL SIZE: 60 1/2" x 99"
 - D.L.O.: 55 1/2" x 92 5/16"

SIGNED: 05/18/2026

HARDWARE SCHEDULE	
A.	(2) POINT METAL LOCK WITH KEEPERS, 42" FROM BOTTOM OF LOCK STILE
B.	DUAL STAINLESS STEEL ROLLERS AT EACH END OF BOTTOM RAILS
C.	ALUMINUM REINFORCEMENT PANEL ADAPTER AT MEETING STILE IN PANELS 1 & 2

THERMA-TRU

1750 INDIAN WOOD CIRCLE
MAUMEE, OH 43537

SERIES V-2 SLIDING GLASS DOOR
5x8 PANEL NON-IMPACT
ELEVATION

DRAWN:
R.L.

DWG NO.
08-03871

REV
A

SCALE
NTS

DATE
11/03/22



SHEET
2 OF 8

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com



LUIS R. LOMAS
P.E.
No. 62514
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED DETAILS	05/18/26	R.L.

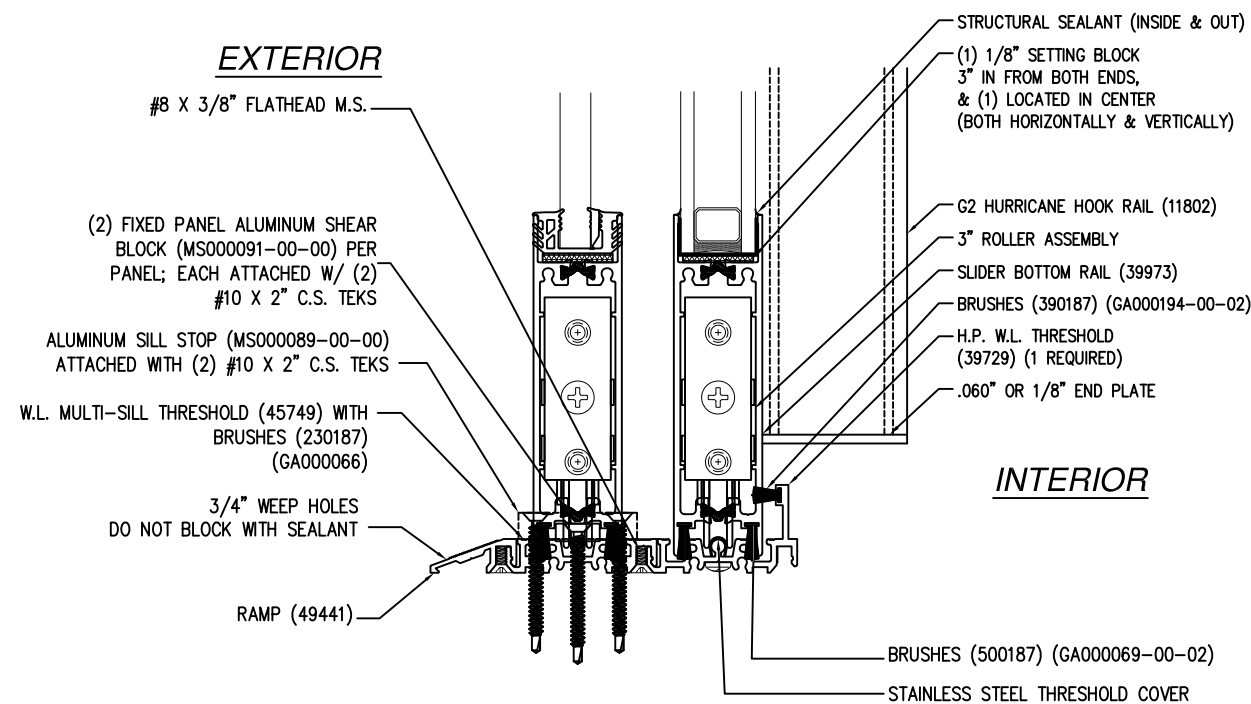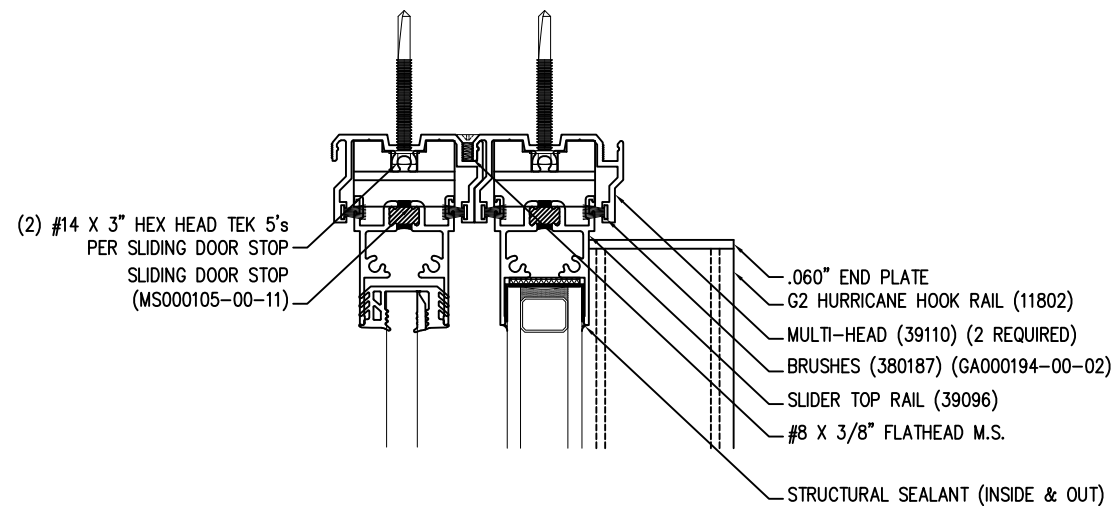


VERTICAL CROSS SECTION

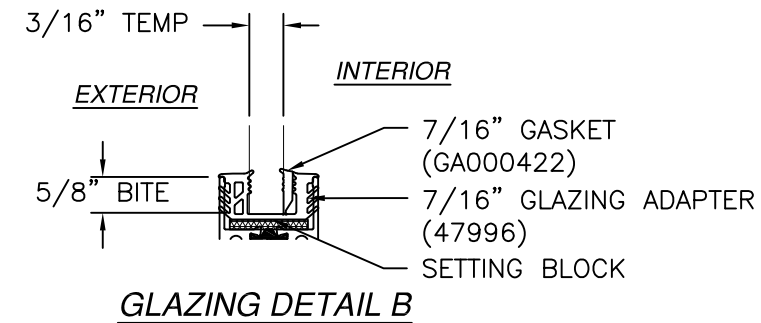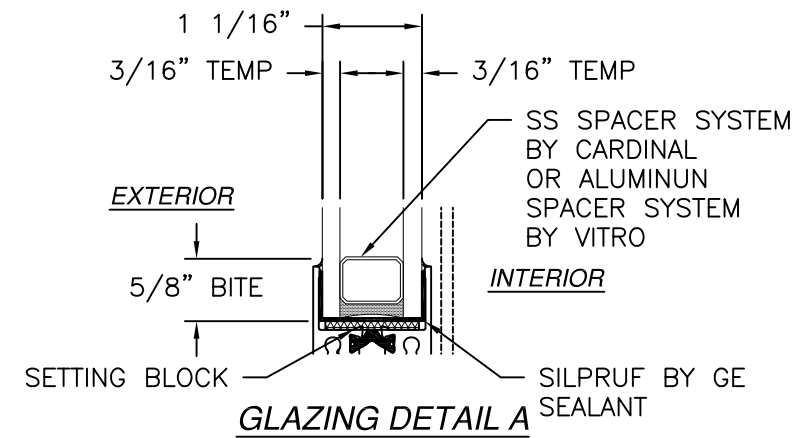


SIGNED: 05/18/2026

THERMA-TRU 1750 INDIAN WOOD CIRCLE MAUMEE, OH 43537		
SERIES V-2 SLIDING GLASS DOOR 5x8 PANEL NON-IMPACT CROSS SECTIONS AND GLAZING DETAILS		
DRAWN: R.L.	DWG NO. 08-03871	REV A
SCALE NTS	DATE 11/03/22	SHEET 3 OF 8
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

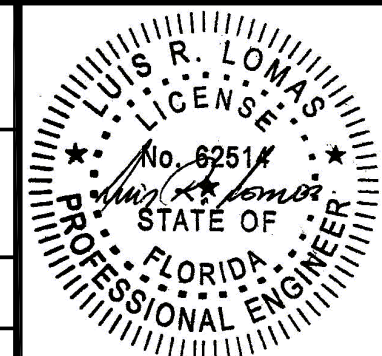


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED DETAILS	05/18/26	R.L.

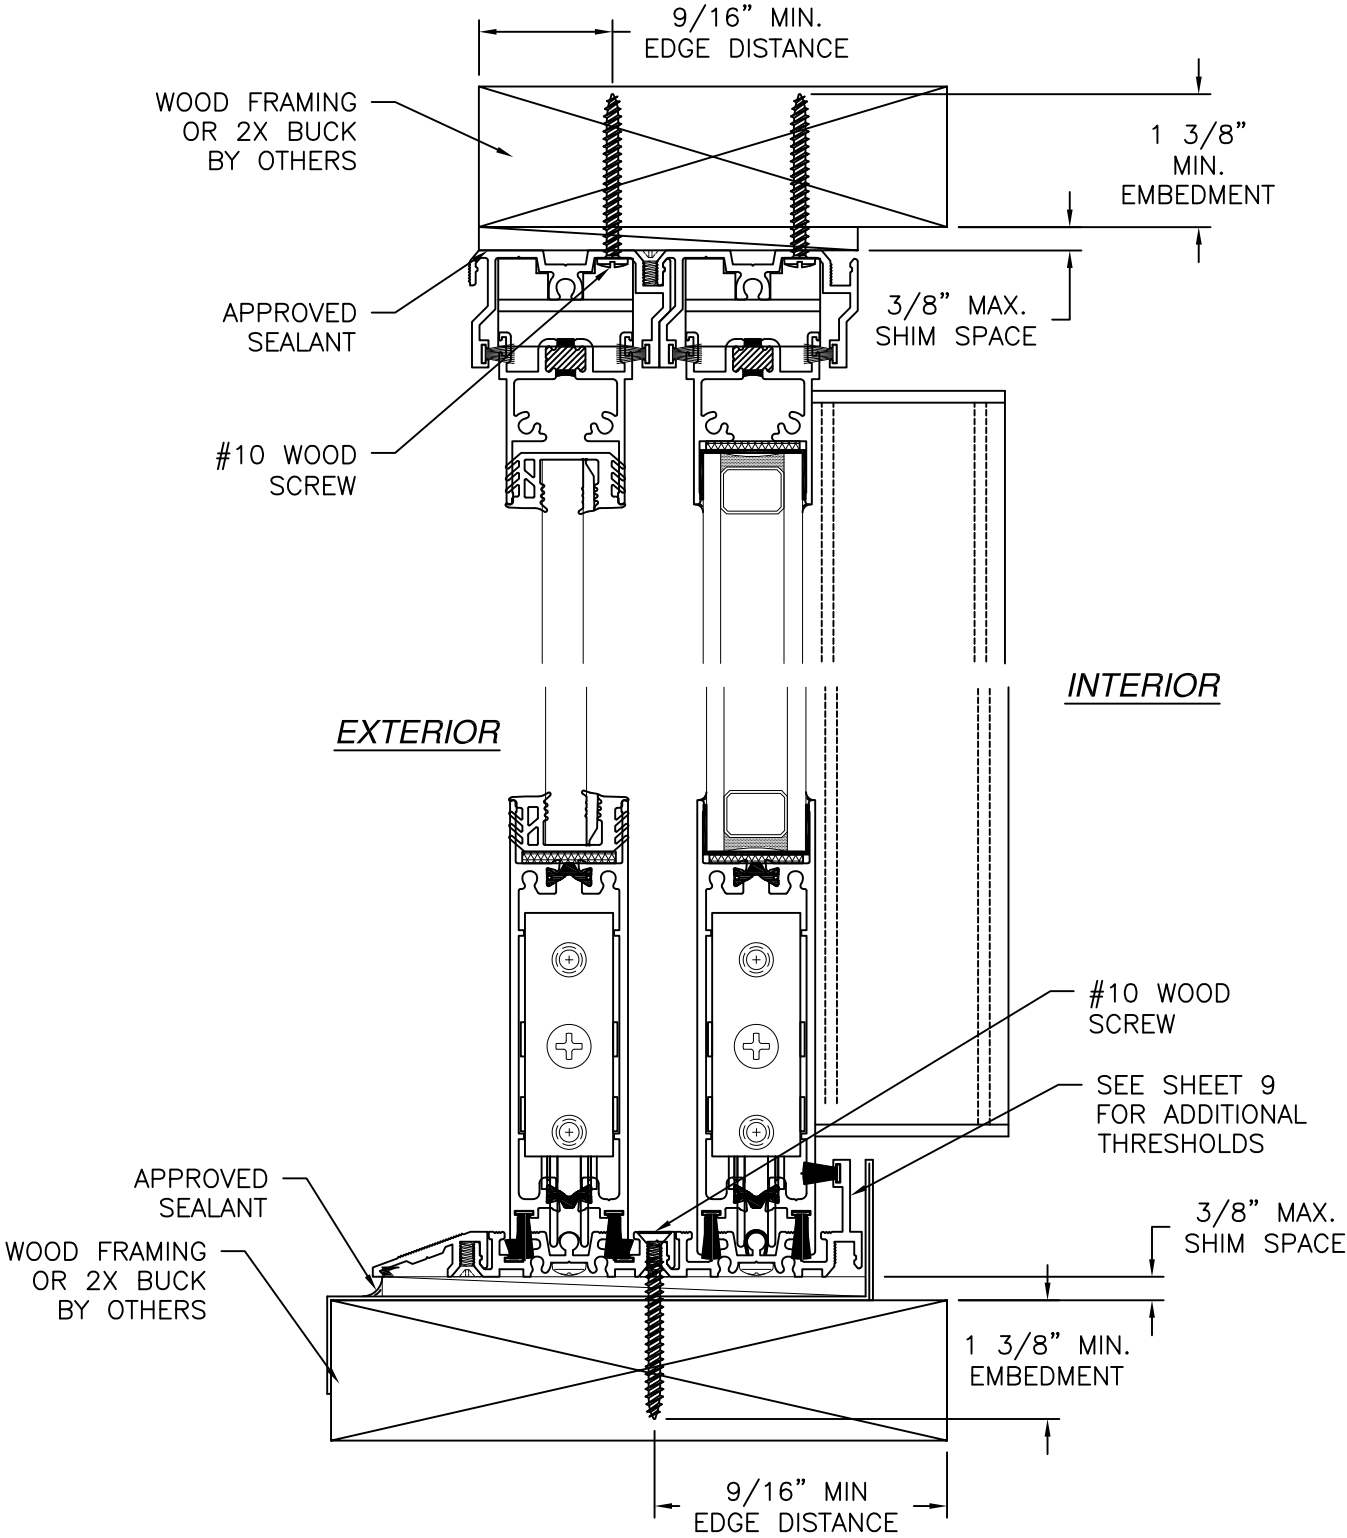

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

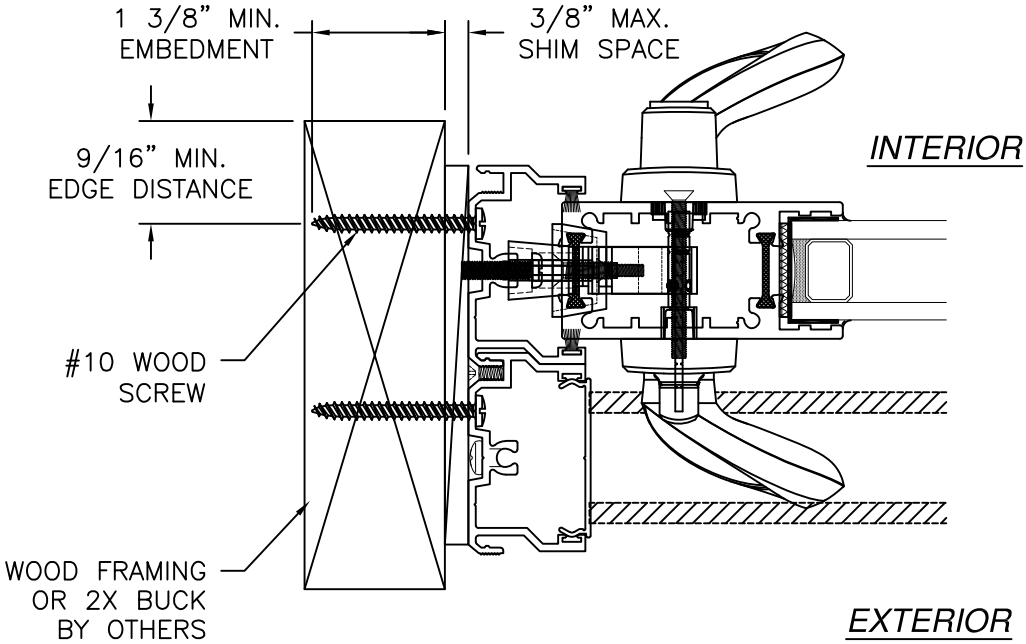

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

THERMA-TRU

1750 INDIAN WOOD CIRCLE
MAUMEE, OH 43537

SERIES V-2 SLIDING GLASS DOOR

5x8 PANEL NON-IMPACT

INSTALLATION DETAILS

DRAWN: R.L.

DWG NO. 08-03871

REV A

SCALE NTS

DATE 11/03/22


SHEET 5 OF 8

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903



434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/18/2026

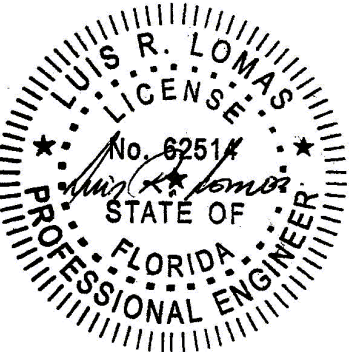

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED DETAILS	05/18/26	R.L.

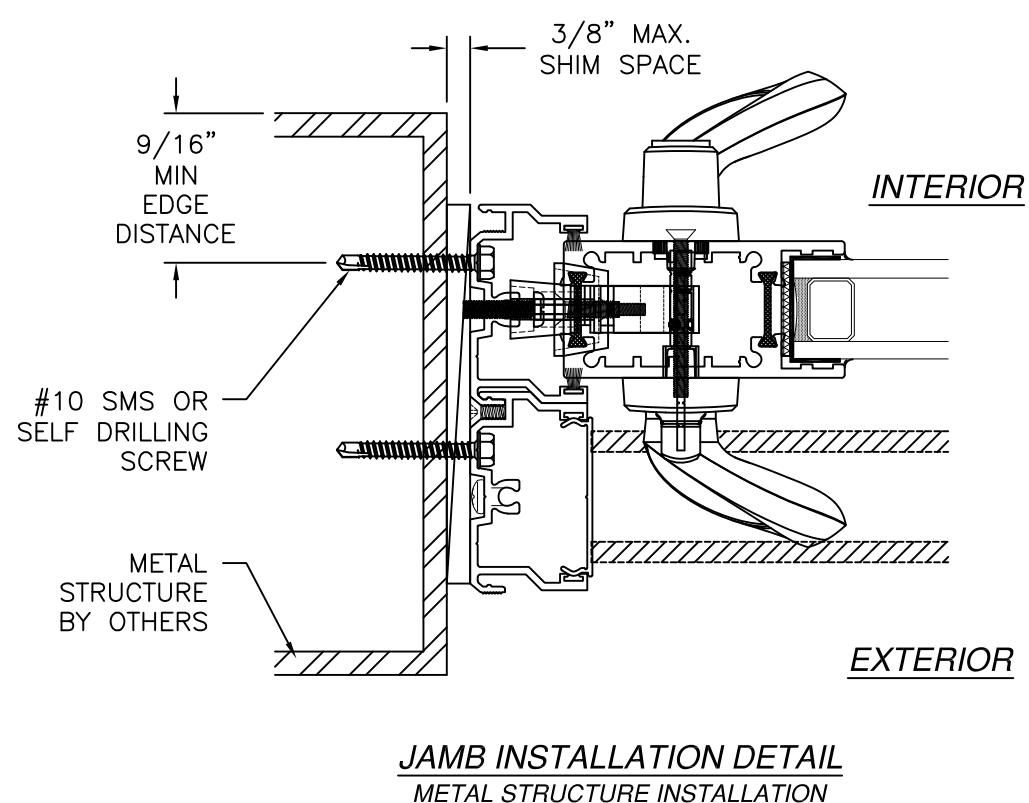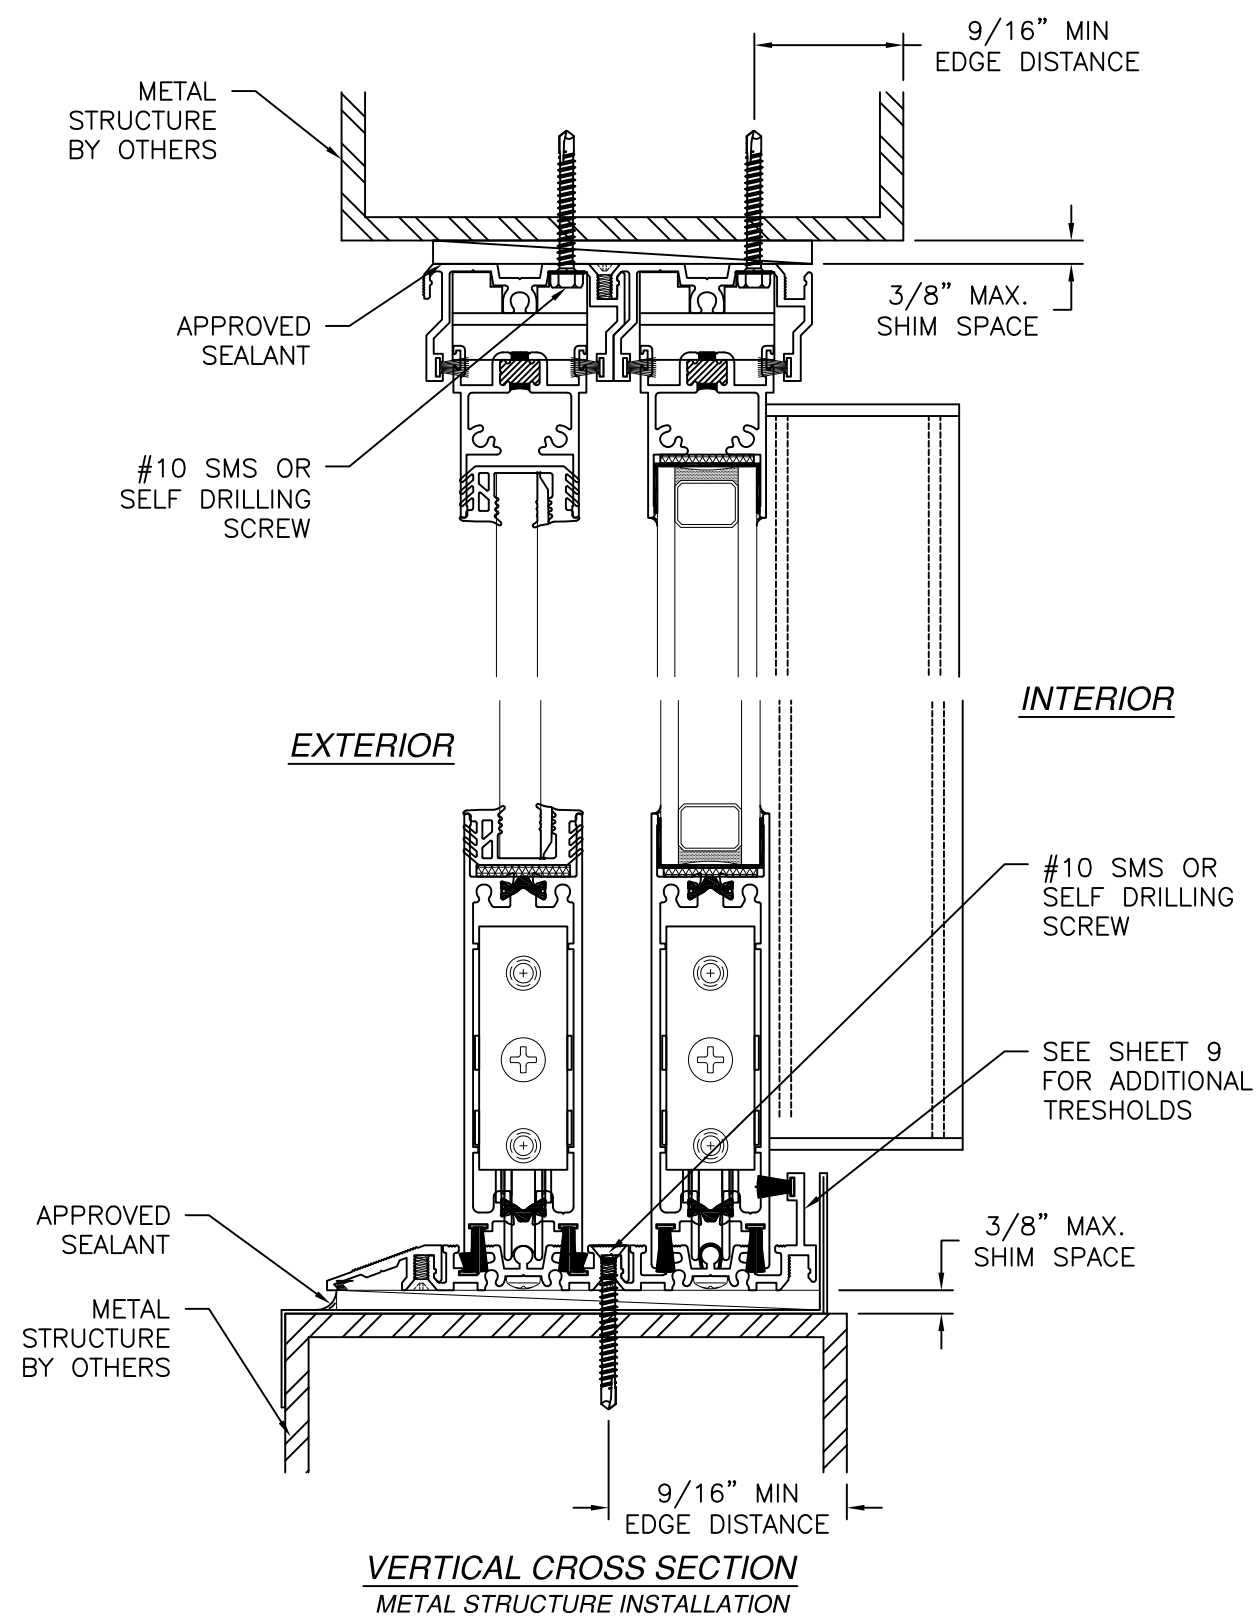

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

THERMA-TRU
1750 INDIAN WOOD CIRCLE
MAUMEE, OH 43537

SERIES V-2 SLIDING GLASS DOOR
5x8 PANEL NON-IMPACT
INSTALLATION DETAILS

DRAWN:
R.L.

DWG NO.
08-03871

REV
A

SCALE
NTS

DATE
11/03/22



SHEET
6 OF 8

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 05/18/2026

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED DETAILS	05/18/26	R.L.

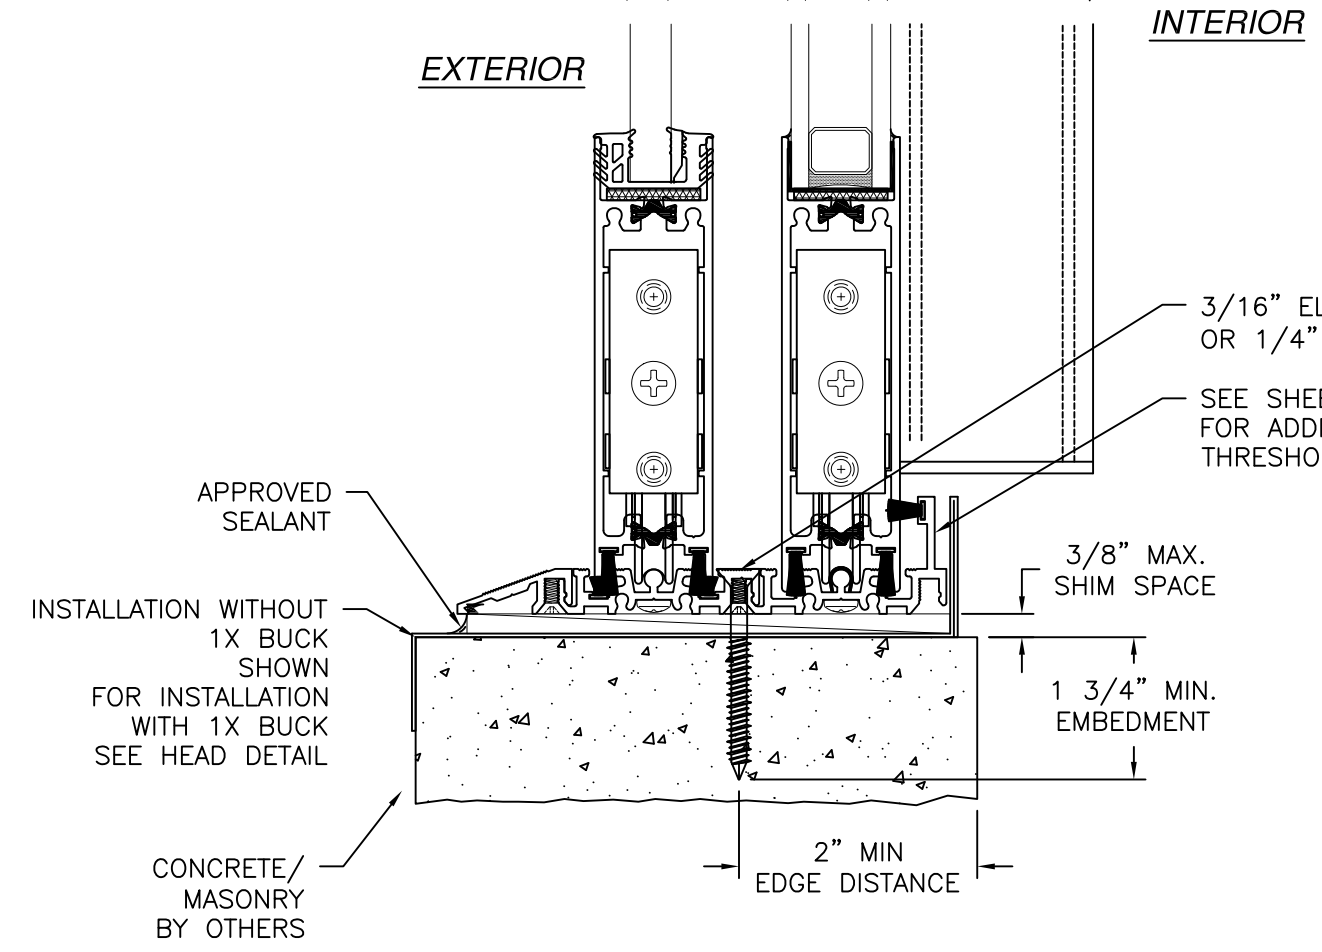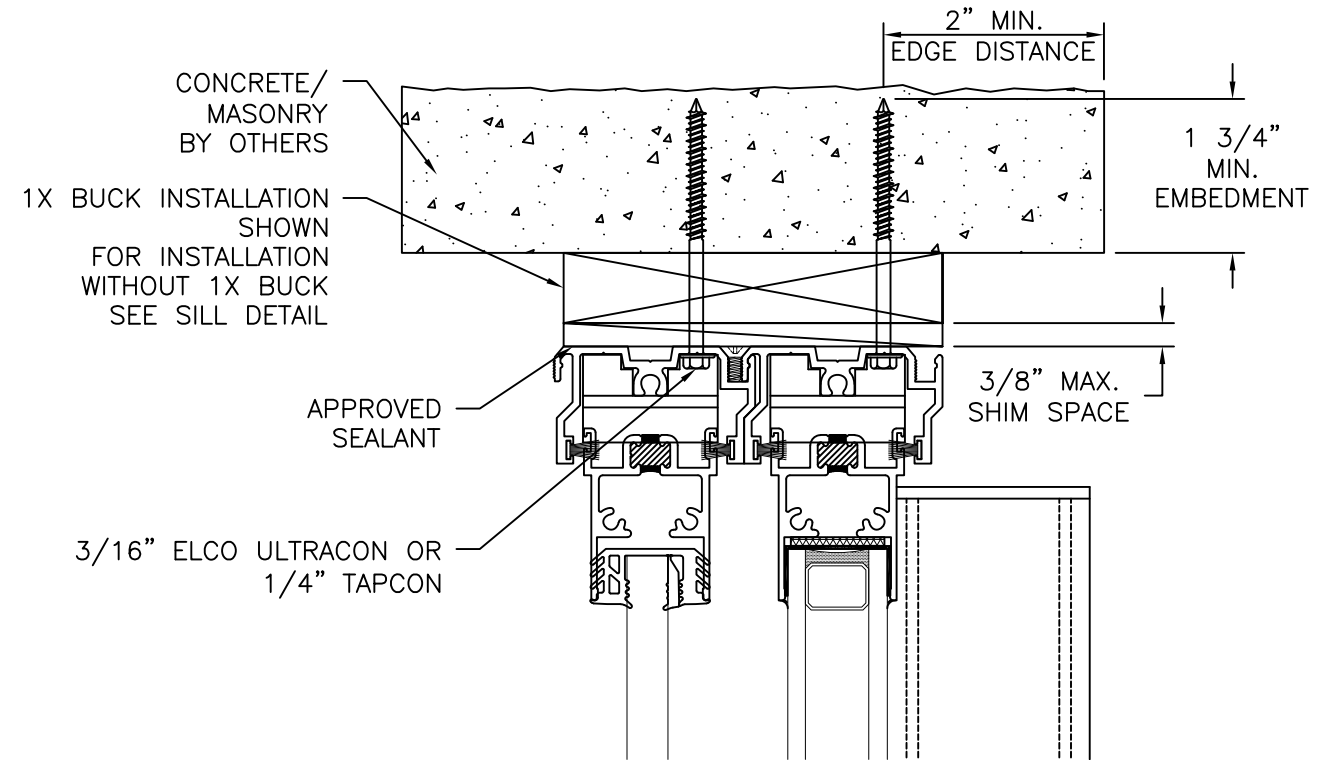

VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION

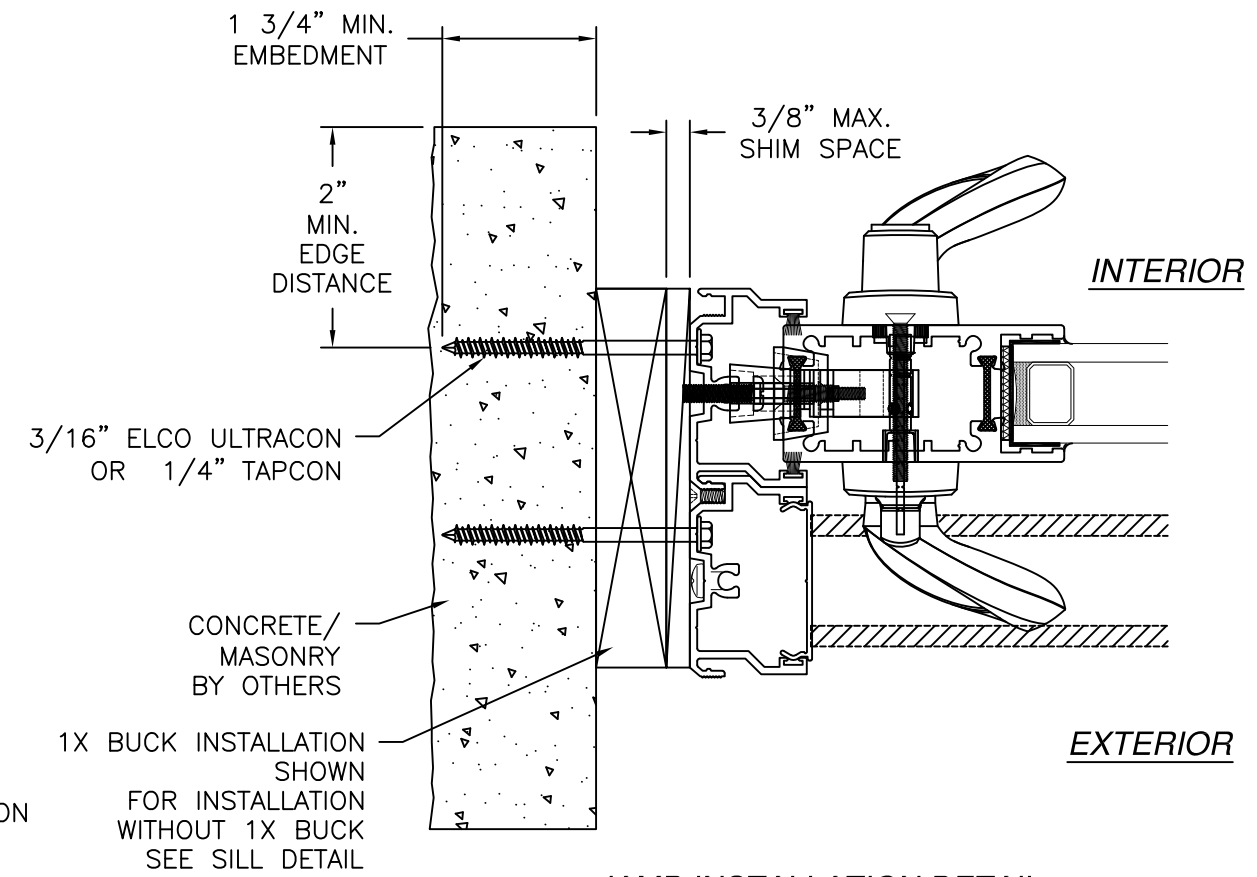

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

- NOTES:**
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

THERMA-TRU

1750 INDIAN WOOD CIRCLE
MAUMEE, OH 43537

SERIES V-2 SLIDING GLASS DOOR

5x8 PANEL NON-IMPACT

INSTALLATION DETAILS

DRAWN: R.L.

DWG NO. 08-03871

REV A

SCALE NTS

DATE 11/03/22


SHEET 7 OF 8

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903














434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/18/2026

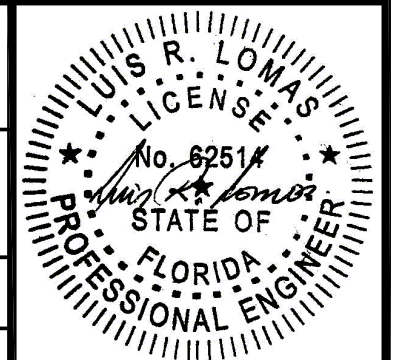

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED DETAILS	05/18/26	R.L.

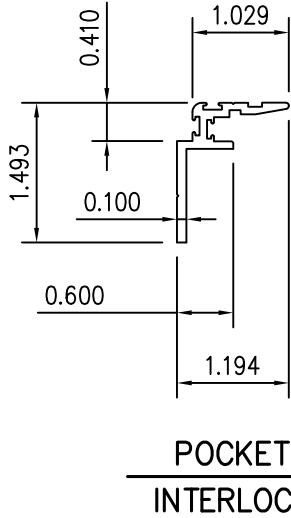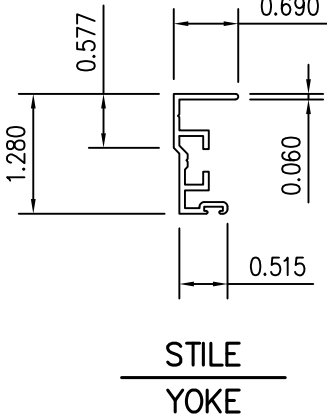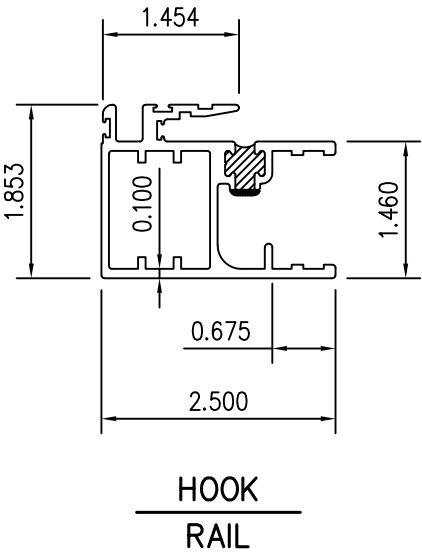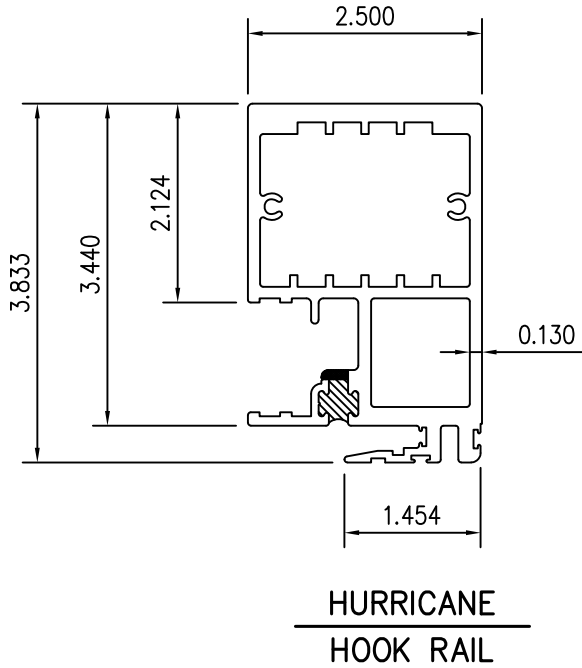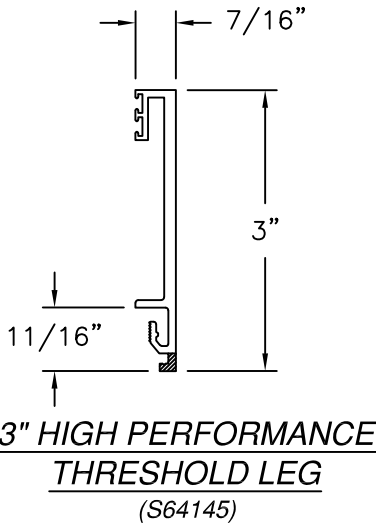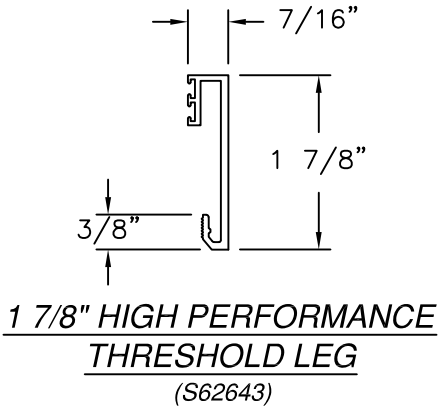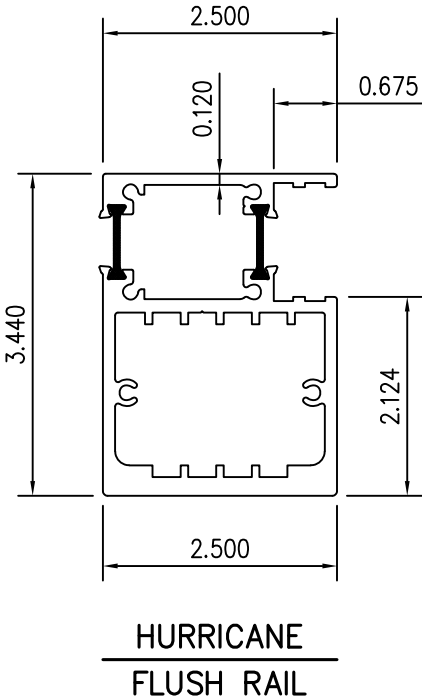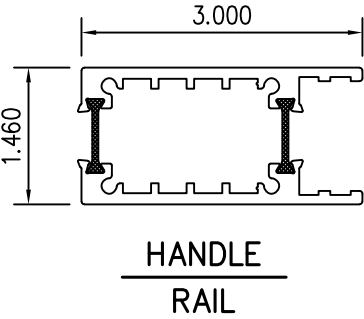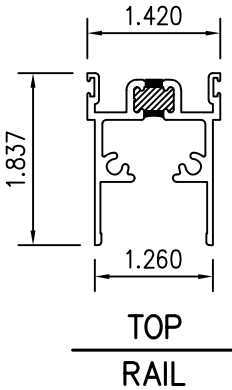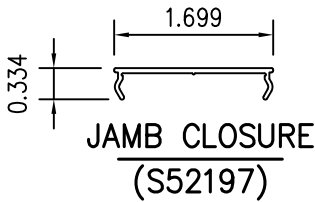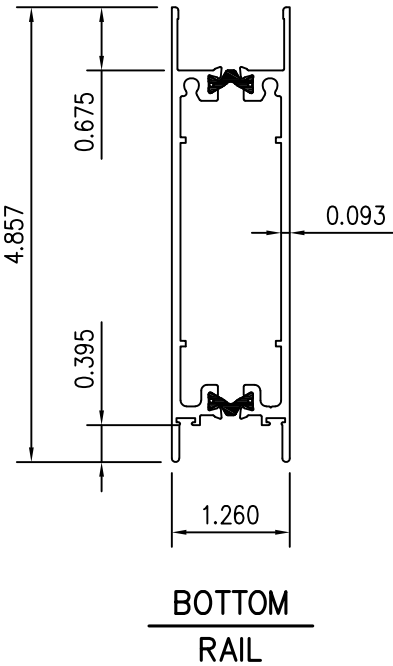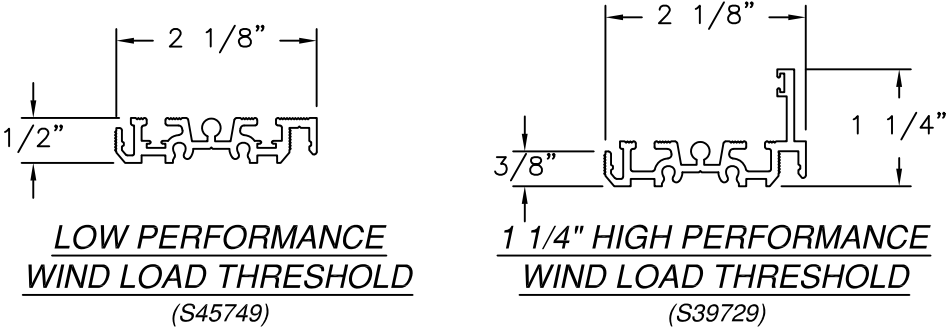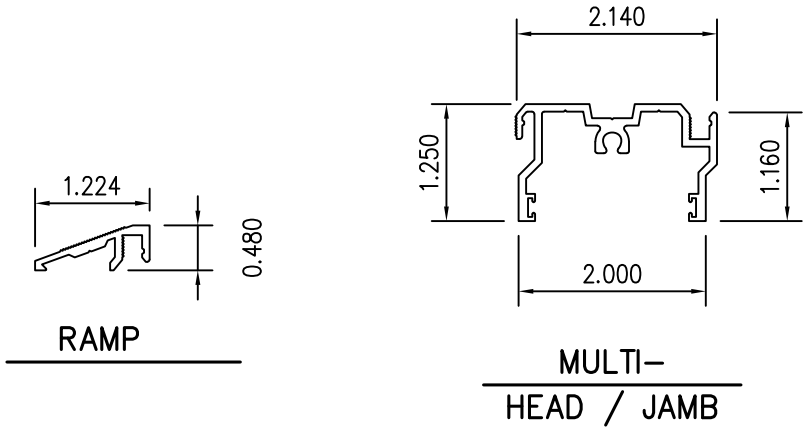

THERMA-TRU

1750 INDIAN WOOD CIRCLE
MAUMEE, OH 43537

SERIES V-2 SLIDING GLASS DOOR
5x8 PANEL NON-IMPACT
COMPONENTS

DRAWN:
R.L.

DWG NO.
08-03871

REV
A

SCALE NTS

DATE 11/03/22


SHEET 8 OF 8

L. ROBERTO LOMAS P.E.

208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

SIGNED: 05/18/2026

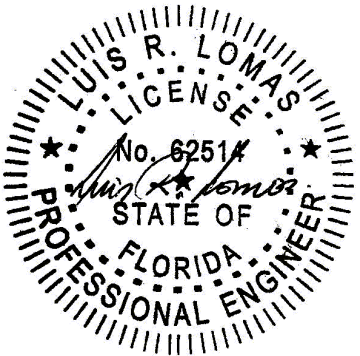

Luis R. Lomas P.E.
FL No.: 62514