


400 Zenway Blvd. Unit #1
Woodbridge, ON L4H 0S7

LS20 STEEL DOOR w/ VIEWER
in a
16 GA. HOLLOW METAL FRAME
w/ NAILING FLANGE
OUTSWING
"NON-IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures, & general notes
2	Door panel details
3	Elevation & horizontal cross sections
4	Vertical cross sections
5	Frame anchoring
6	Bill of materials & components

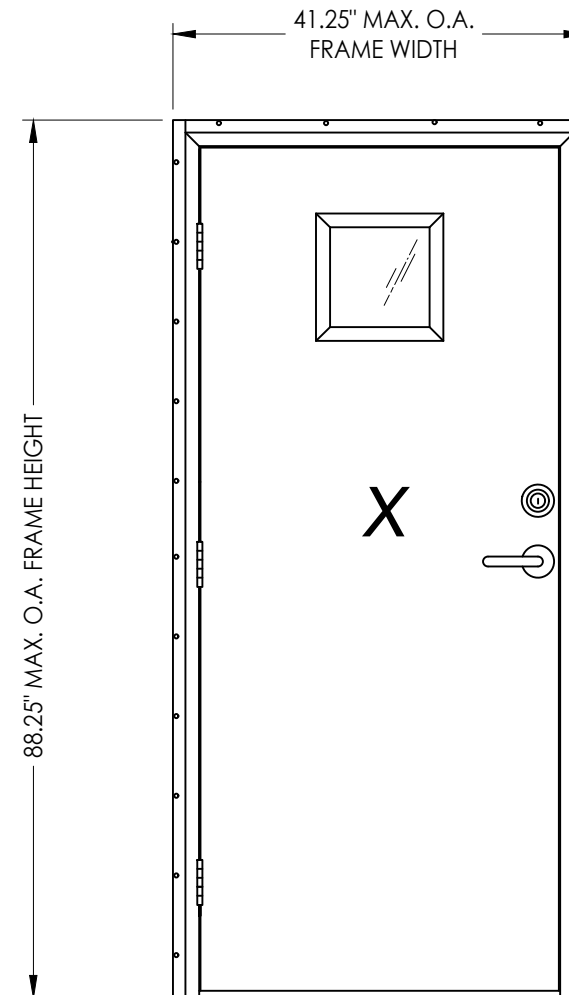

MAX. OVERALL DIMENSION	DESIGN PRESSURE (PSF)	
	POSITIVE	NEGATIVE
41.25" X 88.25"	+65.0	-65.0

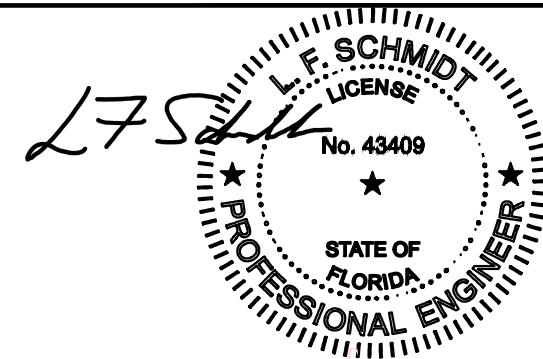


Digitally signed by Lyndon F Schmidt
Date: 2023.07.05 16:31:48 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.


THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

[illegible]

Z:\2023 FBC Drawings\Vision Hollow Metal\FL-41892 R1\FL-41892.2.dwg

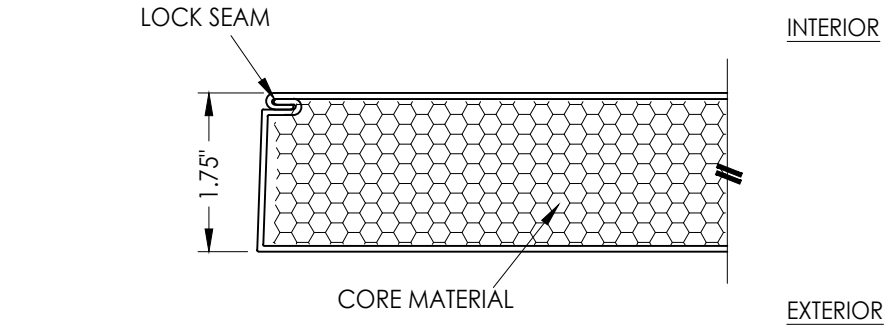


1
2 **HORIZONTAL CROSS SECTION**

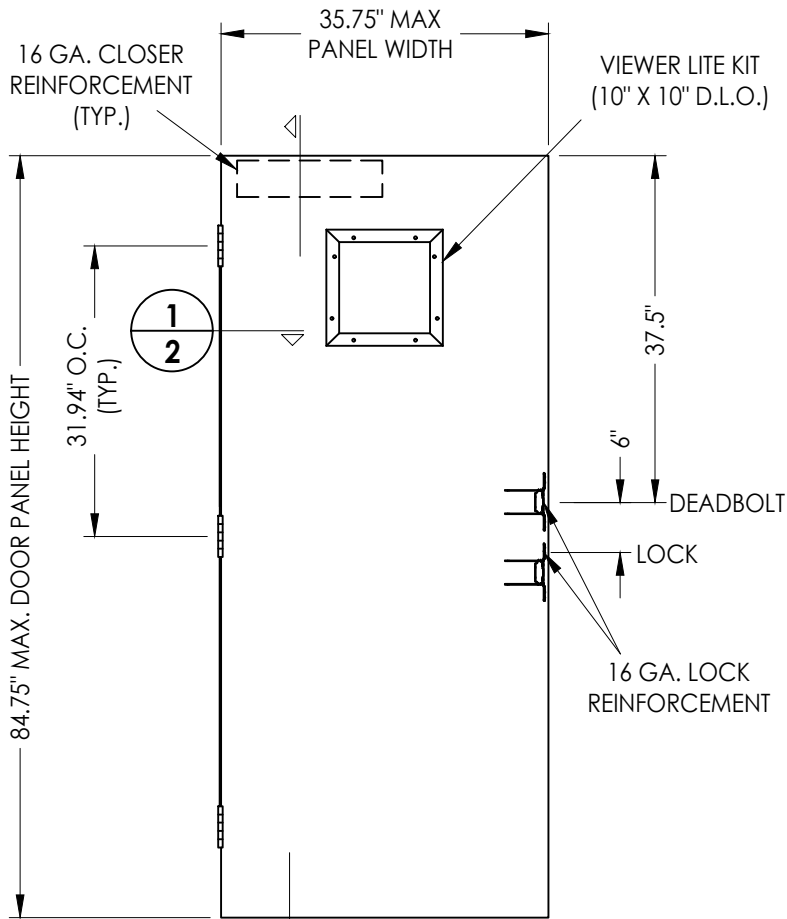


2
2 **OPAQUE DOOR PANEL**
7'-0" Door w/ Cylindrical Lock & Deadbolt

STEEL DOOR SKIN: 20 GA. (MIN. 0.032" THK.) GALV. STEEL
CORE MATERIAL: EPS FOAM (POLYSTYRENE - 1.0 PCF MIN. DENSITY)
OR ALTERNATE HONEYCOMB CORE

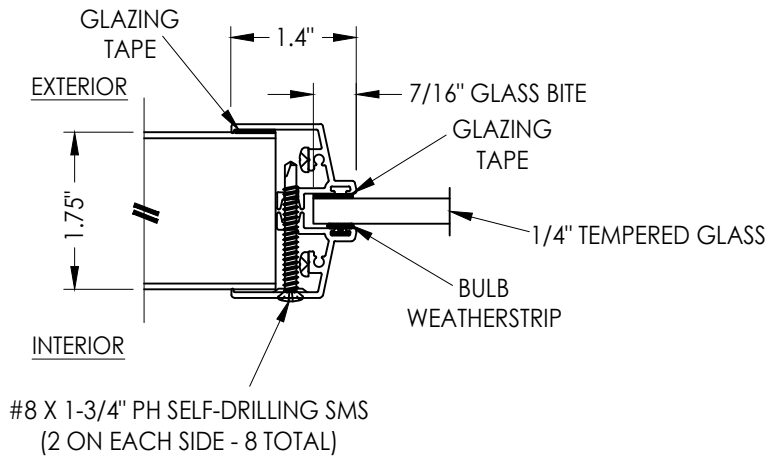


V1 **ALUMINUM VIEWER LITE KIT DETAIL**
WinTech



HARDWARE TABLE	
MANUFACTURER	MODEL
HAGER	LEVER: 2500 SERIES - GRADE 2
	DEADBOLT: 3200 SERIES - GRADE 2

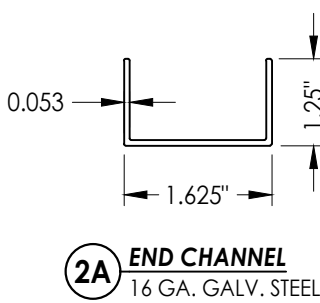

2A **END CHANNEL**
16 GA. GALV. STEEL

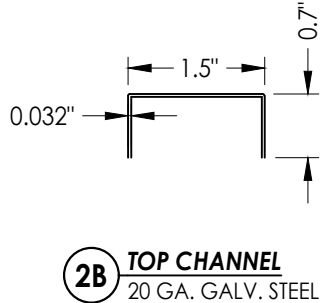

2B **TOP CHANNEL**
20 GA. GALV. STEEL

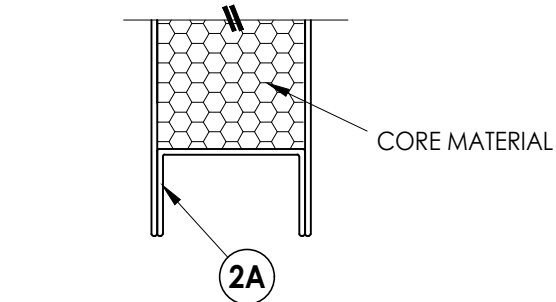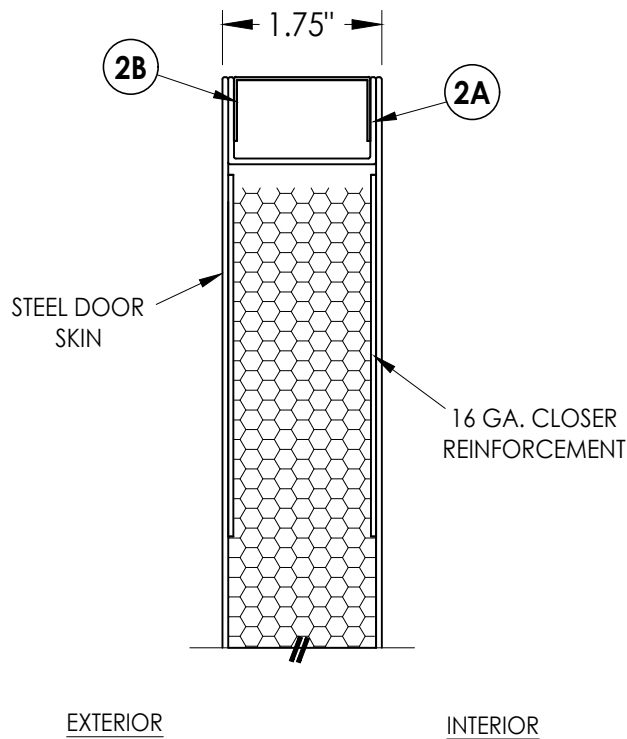

2
2 **VERTICAL CROSS SECTION**

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:
VISION HOLLOW METAL

PART OR ASSEMBLY:

DOOR
PANEL DETAILS

NO.	DATE	REVISIONS
1	7/05/23	UPDATE TO 8TH ED. (2023) FBC
LFS	BY	

DATE: 01/26/23

SCALE: N.T.S.




DWG. BY: LFS

CHK. BY: RW

DRAWING NO.:



FL-41892.2

SHEET 2 OF 6

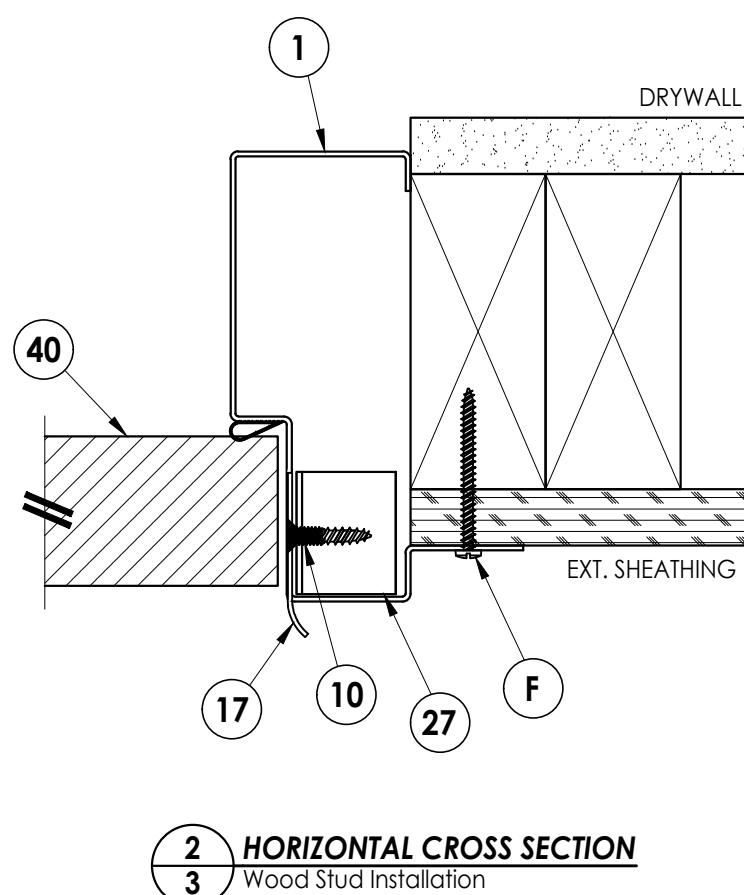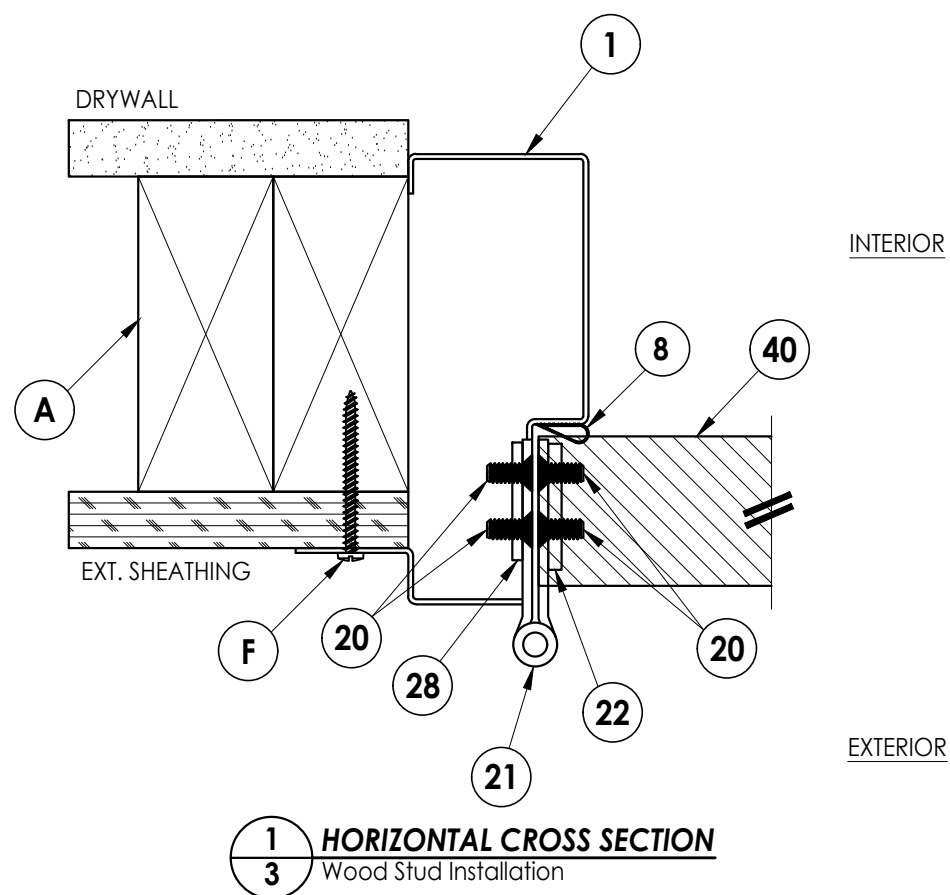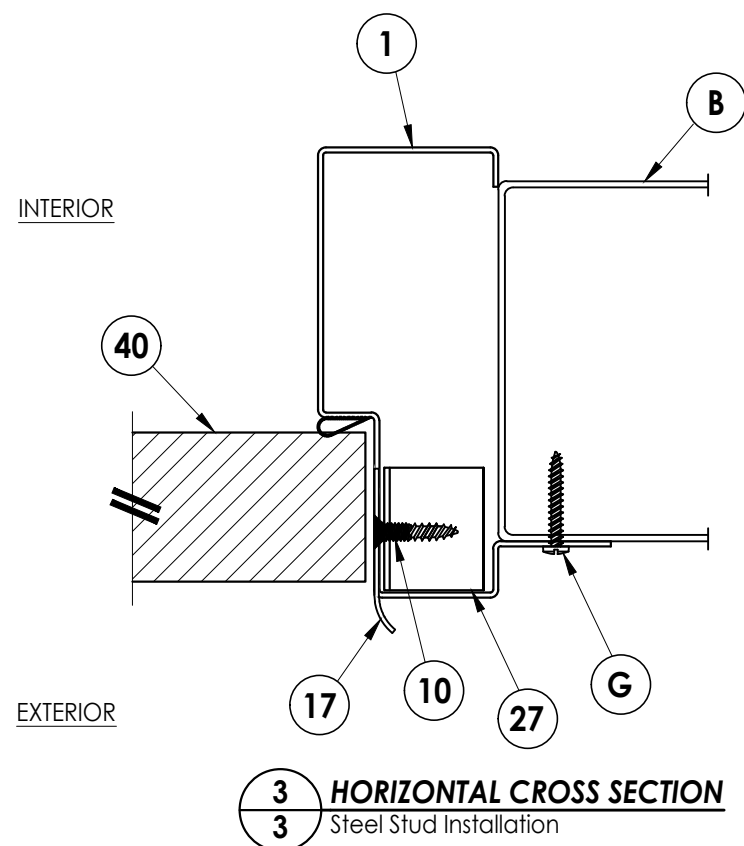




DATE: 01/26/23		PRODUCT:		Documents Prepared By:	
SCALE: N.T.S.		VISION HOLLOW METAL		Lyndon F. Schmidt	
DWG. BY: LFS				P.E. No. 43409	
CHK. BY: RW					
DRAWING NO.: FL-41892.2		PART OR ASSEMBLY:		 BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
		ELEVATIONS			
NO. DATE		LFS			
REVISIONS		BY			
SHEET 3 OF 6					

Z:\2023 FBC Drawings\Vision Hollow Metal\FL-41892 R1\FL-41892.2.dwg

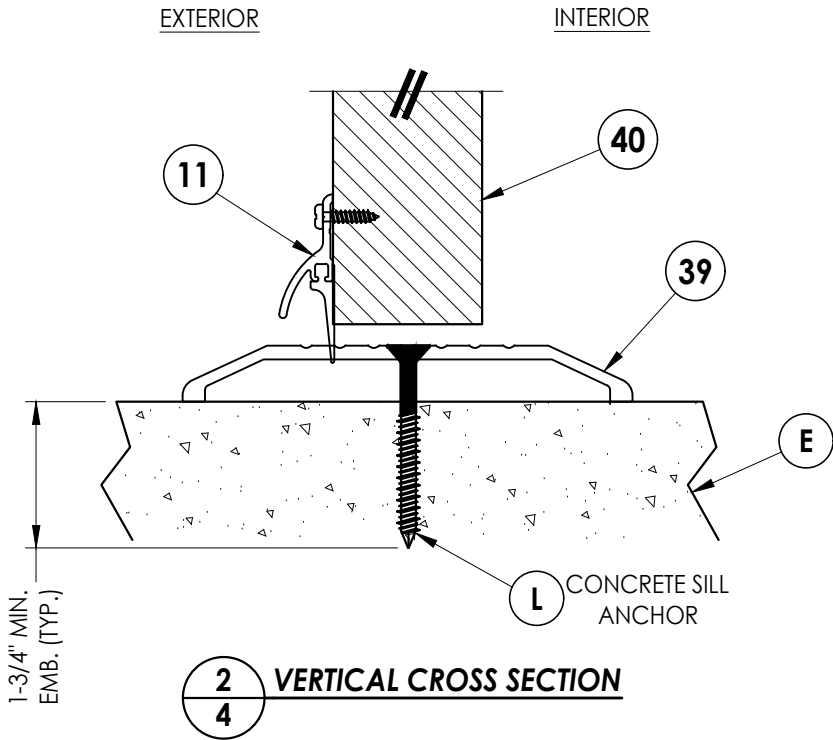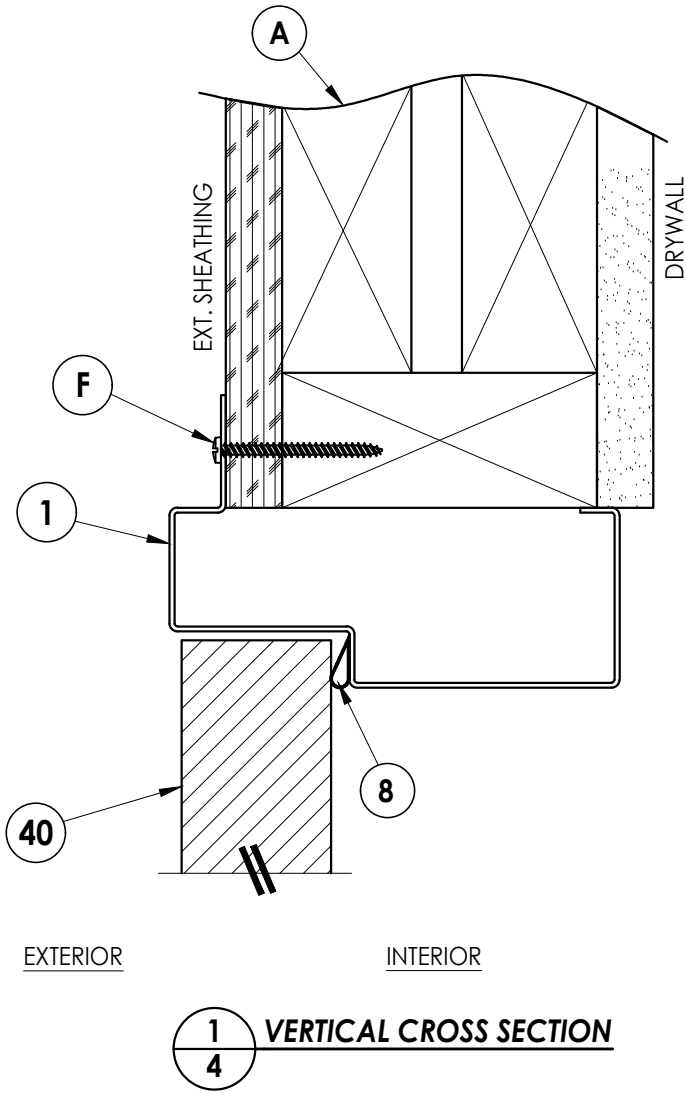

DATE: 01/26/23				Documents Prepared By:			
SCALE: N.T.S.				Lyndon F. Schmidt			
DWG. BY: LFS				P.E. No. 43409			
CHK. BY: RW				<i>RW</i> BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
DRAWING NO.: FL-41892.2							
SHEET 4 OF 6				PRODUCT: VISION HOLLOW METAL			
				PART OR ASSEMBLY: VERTICAL CROSS SECTIONS			
</							

Z:\2023 FBC Drawings\Vision Hollow Metal\FL-41892 R1\FL-41892.2.dwg

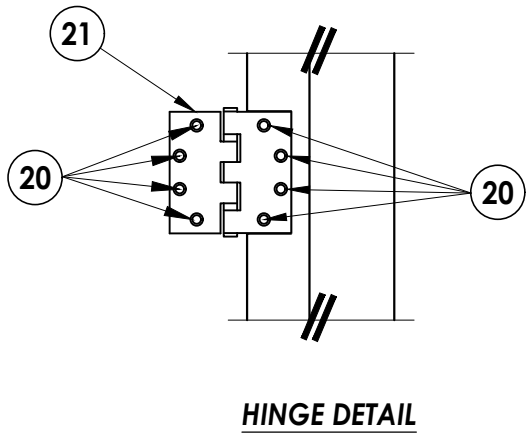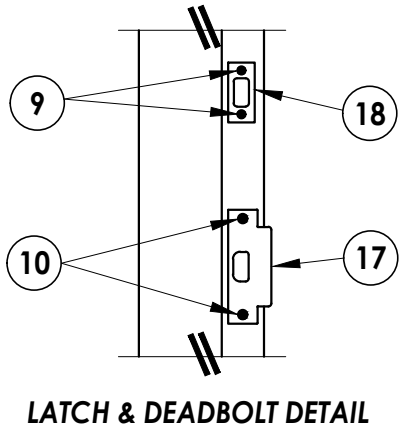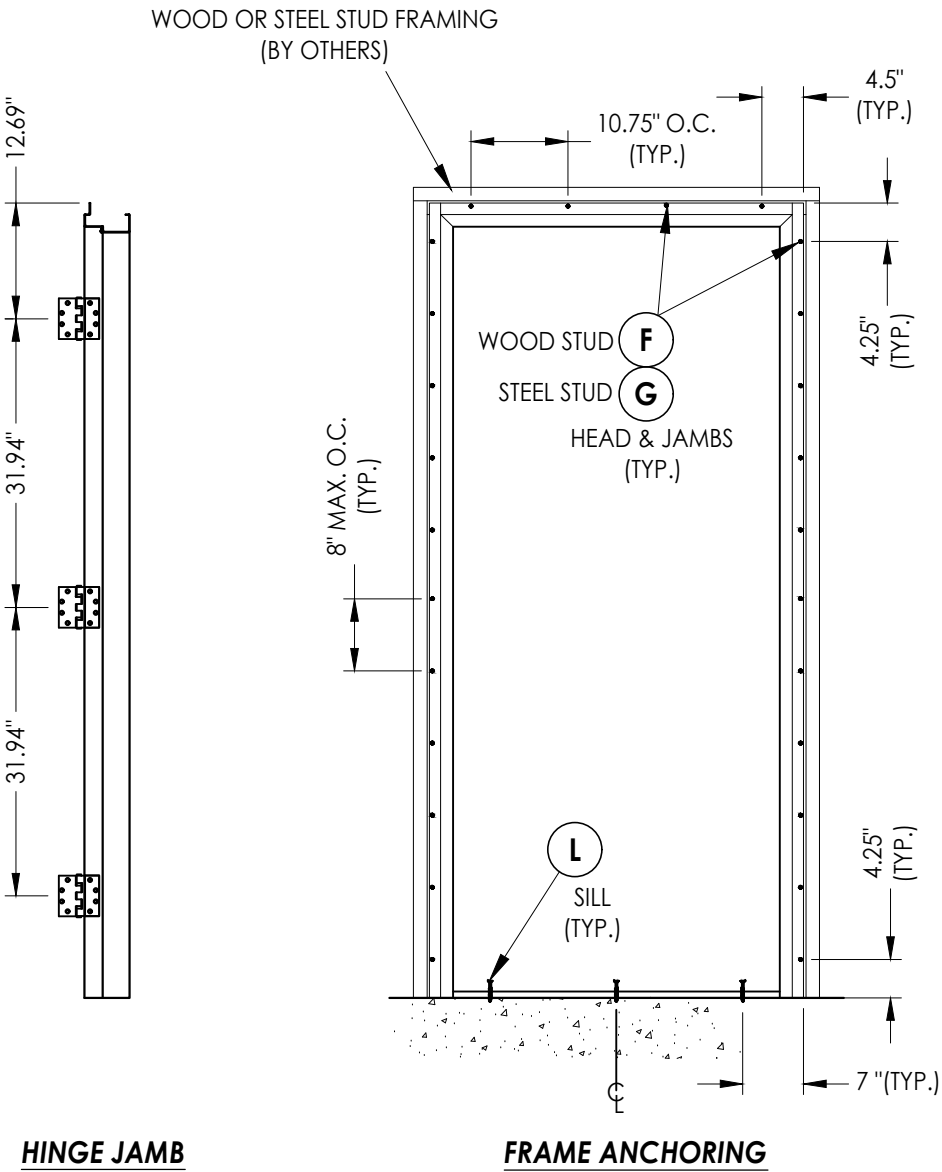

CONCRETE ANCHOR NOTES:

- Concrete screw locations at the corners may be adjusted to maintain a minimum 1" edge distance to mortar joints. If concrete screw locations noted as "MAX. O.C." must be adjusted to maintain the minimum edge distance to mortar joints, additional concrete screws may be required to ensure the maximum on center dimension is not exceeded.
- Concrete anchor table:

ANCHOR TYPE	ANCHOR LOCATION	ANCHOR SIZE	MANUFACTURER	MIN. EDGE DISTANCE	MIN. EMBEDMENT
CONCRETE ANCHOR SCREW	SILL	1/4"	TAPCON® (ITW BUILDEX) ULTRA CON+® (DeWALT) TAPPER+® (POWERS)	2-1/2"	1-3/4"

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT: VISION HOLLOW METAL				PART OR ASSEMBLY: FRAME ANCHORING			
				REVISIONS			
				1	7/05/23	UPDATE TO 8TH ED. (2023)	FBC
				NO.	DATE		BY
				DATE: 01/26/23			
				SCALE: N.T.S.			
				DWG. BY: LFS			
				CHK. BY: RW			
				DRAWING NO.: FL-41892.2			
				SHEET 5 OF 6			

