

LONGBOARD ARCHITECTURAL PRODUCTS

TEXTURED PLANK WALL CLADDING SYSTEM

(HVHZ)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- TAS 202-94

TAS 203-94

ASTM E8-16
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X MEMBERS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. ALUMINUM SIDING MEETS THE REQUIREMENTS OF THE CURRENT FBC. APPLICATION OF ALUMINUM SIDING SHALL MEET REQUIREMENTS OF THE CURRENT FBC.
6. ALUMINUM SIDING SPECIFICATIONS:
- MATERIAL: 6063-T5

MINIMUM THICKNESS: 0.0358"
7. INSTALLATION OF SIDING ACCESSORIES SUCH AS TRIM COMPONENTS SHALL BE DONE IN ACCORDANCE WITH THE FLORIDA BUILDING CODE AND THE MANUFACTURER'S INSTRUCTIONS.

DESIGN PRESSURE TABLE						
HORIZONTAL O.C. SPACING (IN)		ALLOWABLE DESIGN PRESSURE (PSF)				
		WOOD	STEEL	ALUM.	CONCRETE	MASONRY
6" SINGLE BEVEL SIDING PLANK	8	120.0	120.0	120.0	120.0	120.0
	12	120.0	120.0	120.0	120.0	120.0
	16	120.0	120.0	120.0	120.0	93.0

DESIGN PRESSURE TABLE						
HORIZONTAL O.C. SPACING (IN)		ALLOWABLE DESIGN PRESSURE (PSF)				
		WOOD	STEEL	ALUM.	CONCRETE	MASONRY
6" TRIPLE BEVEL SIDING PLANK	8	120.0	120.0	120.0	120.0	120.0
	12	120.0	120.0	120.0	120.0	120.0
	16	120.0	120.0	120.0	120.0	93.0

DESIGN PRESSURE TABLE						
HORIZONTAL O.C. SPACING (IN)		ALLOWABLE DESIGN PRESSURE (PSF)				
		WOOD	STEEL	ALUM.	CONCRETE	MASONRY
8" CASTELLATION SIDING PLANK	8	120.0	120.0	120.0	120.0	120.0
	12	120.0	120.0	120.0	120.0	93.0
	16	120.0	120.0	120.0	120.0	69.8

DESIGN PRESSURE TABLE						
HORIZONTAL O.C. SPACING (IN)		ALLOWABLE DESIGN PRESSURE (PSF)				
		WOOD	STEEL	ALUM.	CONCRETE	MASONRY
4" CASTELLATION SIDING PLANK	8	120.0	120.0	120.0	120.0	120.0
	12	120.0	120.0	120.0	120.0	120.0
	16	120.0	120.0	120.0	120.0	120.0

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND DESIGN PRESSURE TABLES
2	ELEVATION AND ANCHOR LAYOUT
3	ELEVATION AND ANCHOR LAYOUT
4	ELEVATION AND ANCHOR LAYOUT
5	ELEVATION AND ANCHOR LAYOUT
6	VERTICAL SECTIONS
7	VERTICAL SECTIONS
8	HORIZONTAL SECTIONS
9	HORIZONTAL SECTIONS
10	BILL OF MATERIALS, COMPONENTS, & ANCHOR SCHEDULE
11	INSTALLATION NOTES



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)

GENERAL NOTES &
DESIGN PRESSURE TABLES

PREPARED BY:


BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.10.11 16:45:00 -0400

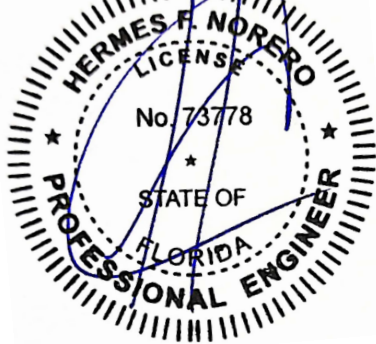

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL41934

DATE:

09.02.25

DWG. BY:

HJ

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

LBD007


SHEET:

1


REV.

A

c:\users\danielbuitrago\building drops, inc.\building drops\trapez\2026 code change projects\longboard architectural products\cc-26-0234.3 - 2026 code change - 1711\dwgs\l41934-r4\lbd007-a.dwg 10/8/2026 1:19 PM

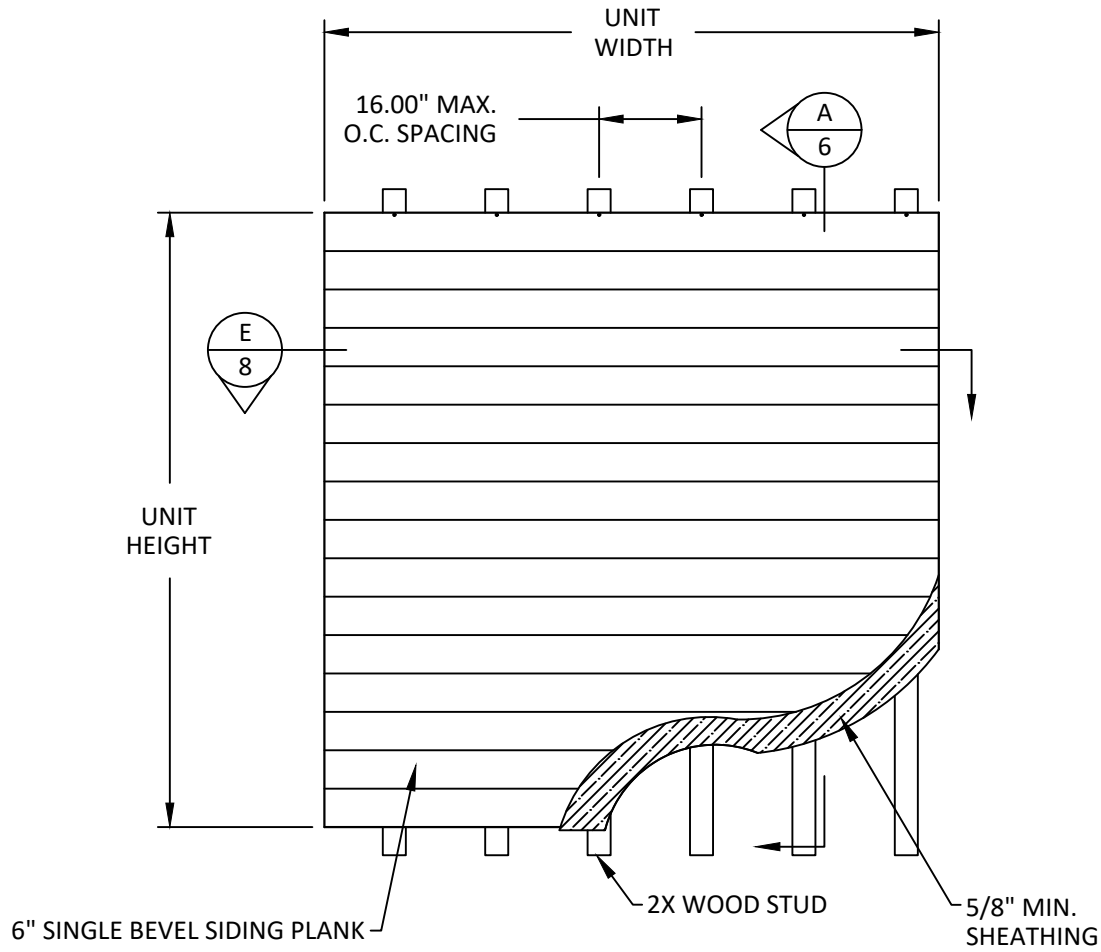

SINGLE BEVEL SIDING PLANK ELEVATION

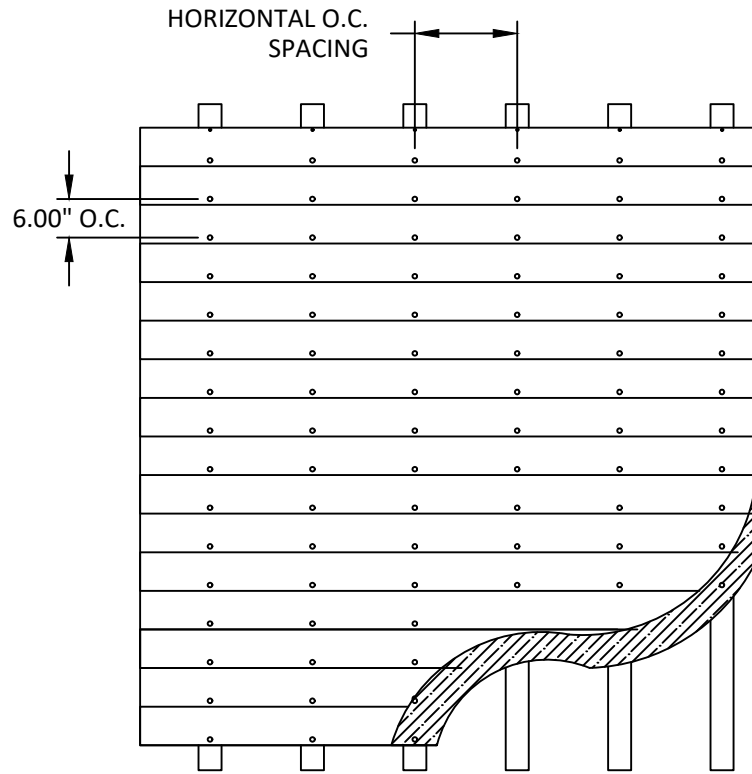

SINGLE BEVEL SIDING PLANK ANCHOR LAYOUT

NOTE: SEE DESIGN PRESSURE TABLE ON SHEET 1 FOR HORIZONTAL O.C. SPACING



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)

ELEVATION AND ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

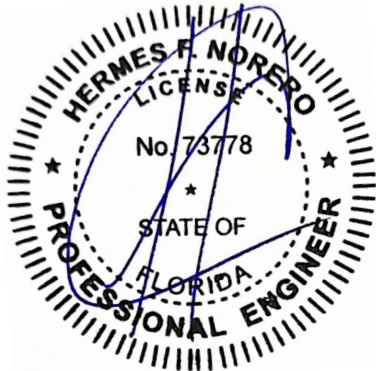


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL41934	
DATE:	09.02.25	
DWG. BY:	HJ	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	LBD007	
SHEET:	2	
REV.	A	

c:\users\danielbu\trago\building drops, inc.\building drops\landing - common\projects\2026 code change projects\longboard architectural products\cc-26-0234.3 - 2026 code change - 1711\dwgs\141934-r4\lbd007-a.dwg

10/8/2026 1:19 PM

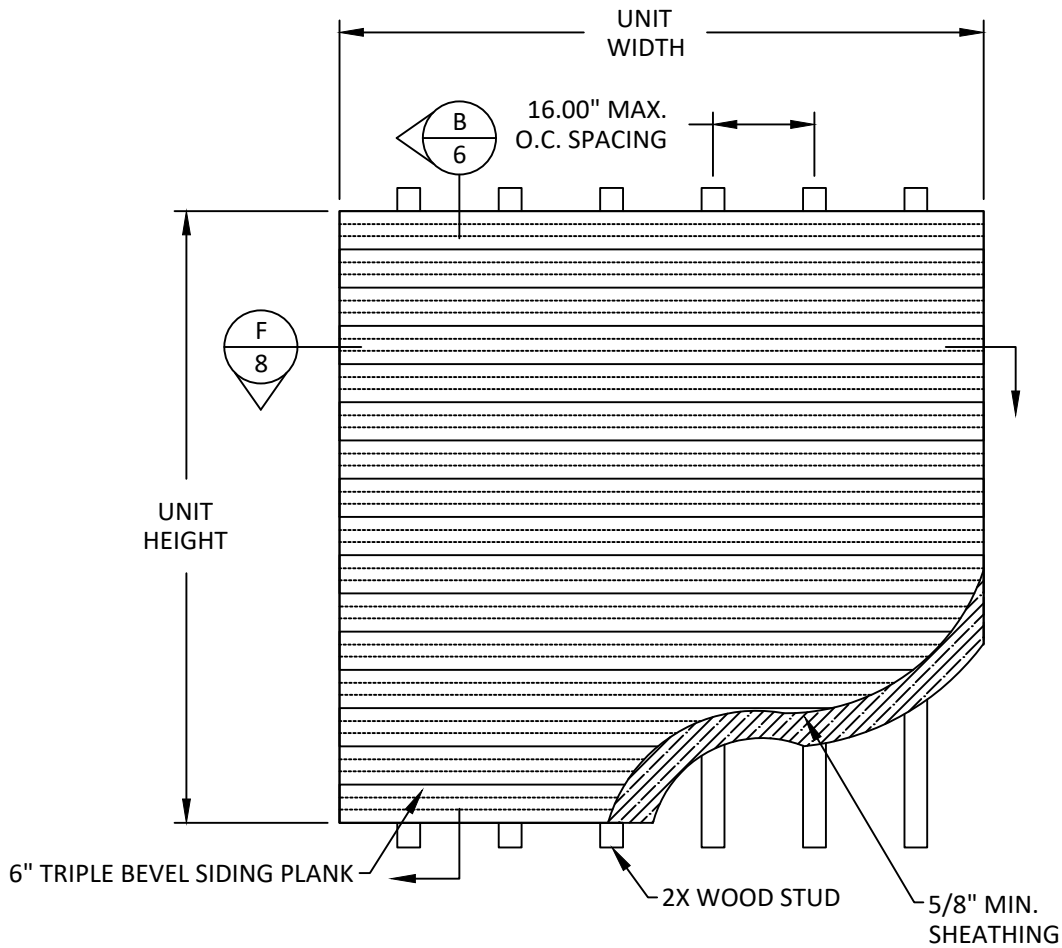

6" TRIPLE BEVEL SIDING PLANK ELEVATION

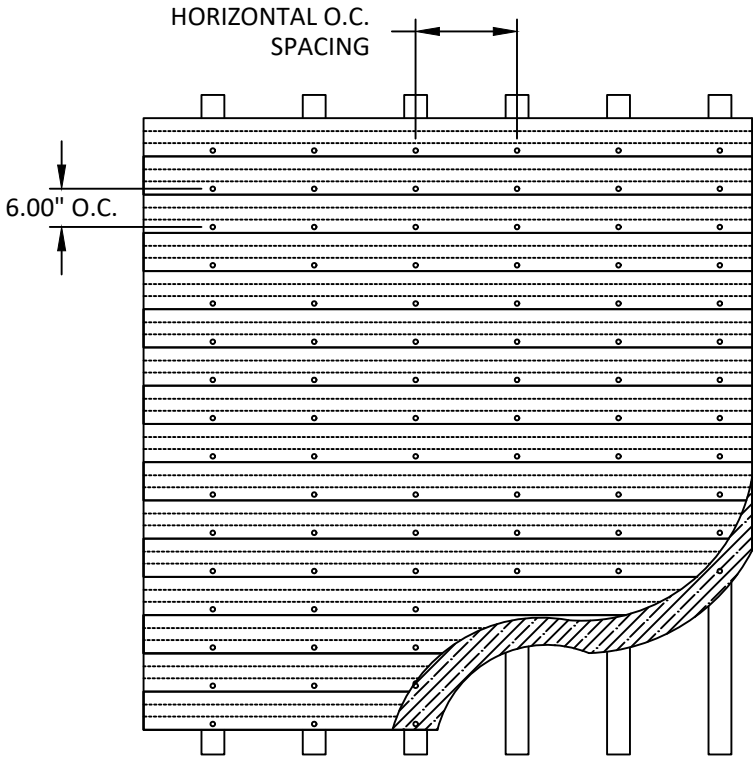

6" TRIPLE BEVEL SIDING PLANK ANCHOR LAYOUT

NOTE: SEE DESIGN PRESSURE TABLE ON SHEET 1 FOR HORIZONTAL O.C. SPACING



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)

ELEVATION AND ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

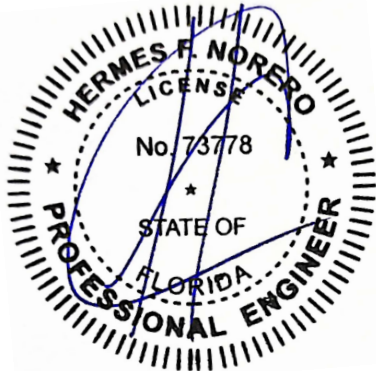

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: FL41934

DATE: 09.02.25

DWG. BY:
HJ

CHK. BY:
HFN

SCALE: NTS

DWG. #: LBD007


SHEET:

3


REV.

A

c:\users\danielbuitrago\building drops, inc.\building drops\projects\2026 code change projects\longboard architectural products\cc-26-0234.3 - 2026 code change - 1711\dwgs\l41934-r4\lbd007-a.dwg 10/8/2026 1:19 PM

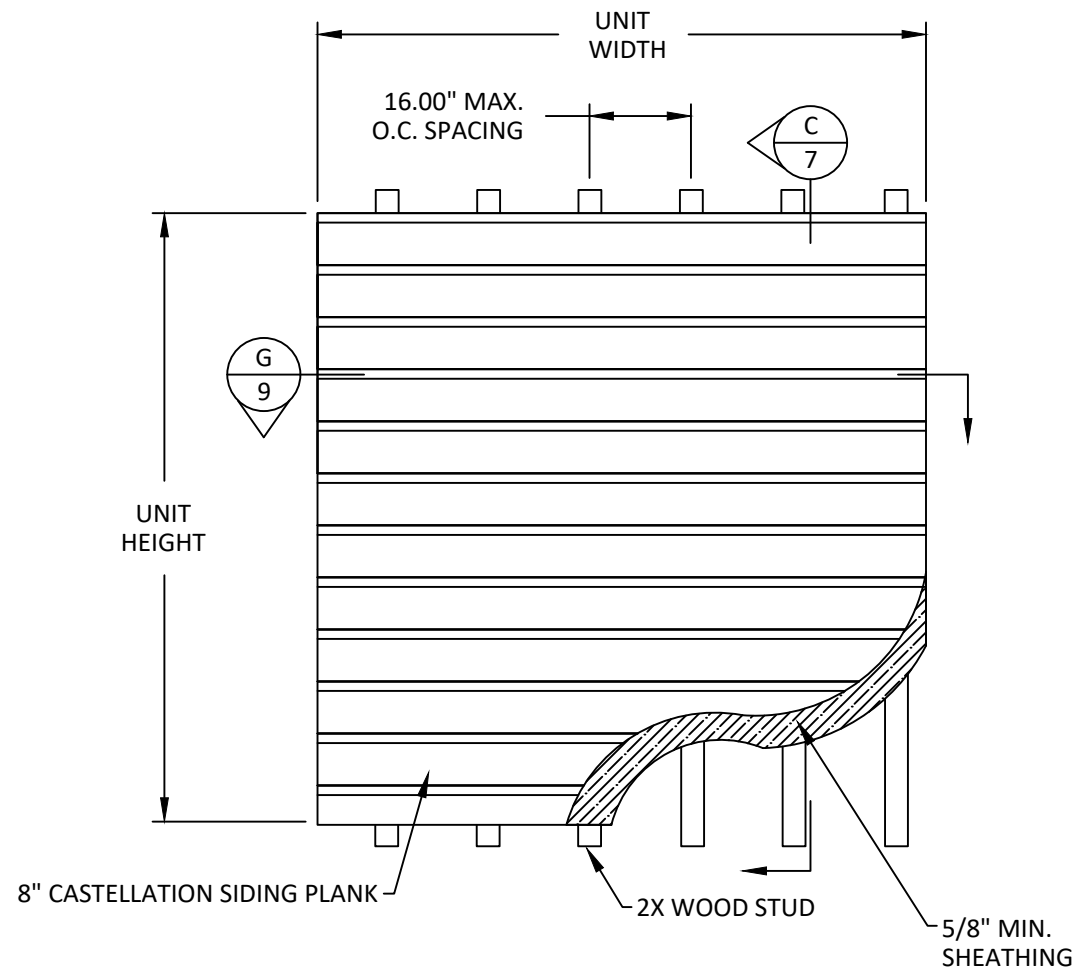

8" CASTELLATION SIDING PLANK ELEVATION

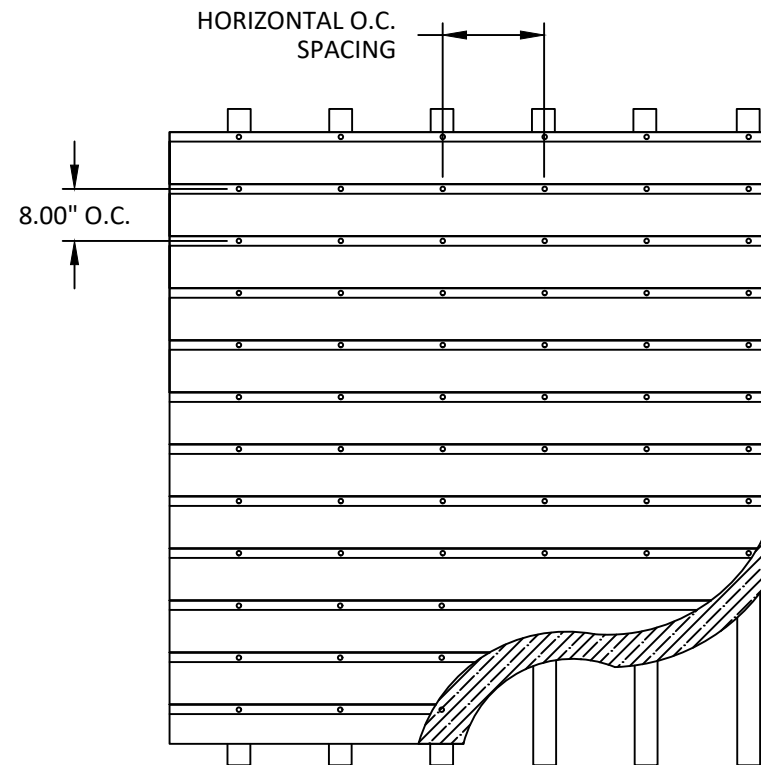

8" CASTELLATION SIDING PLANK ANCHOR LAYOUT

NOTE: SEE DESIGN PRESSURE TABLE ON SHEET 1 FOR HORIZONTAL O.C. SPACING



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)

ELEVATION AND ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

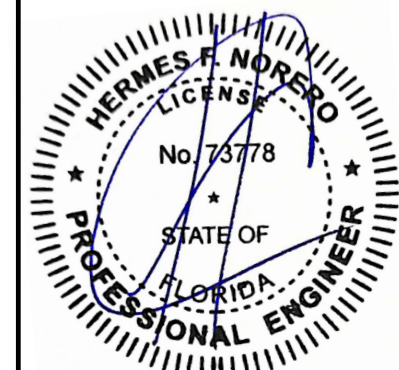


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL41934	
DATE:	09.02.25	
DWG. BY:	HJ	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	LBD007	
SHEET:	4	REV. A

c:\users\danielbultrago\building drops, inc.\building drops\landing - common\projects\2026 code change projects\longboard architectural products\cc-26-0234.3 - 2026 code change - 1711\dwgs\141934-r4\lbd007-a.dwg

10/8/2026 1:19 PM

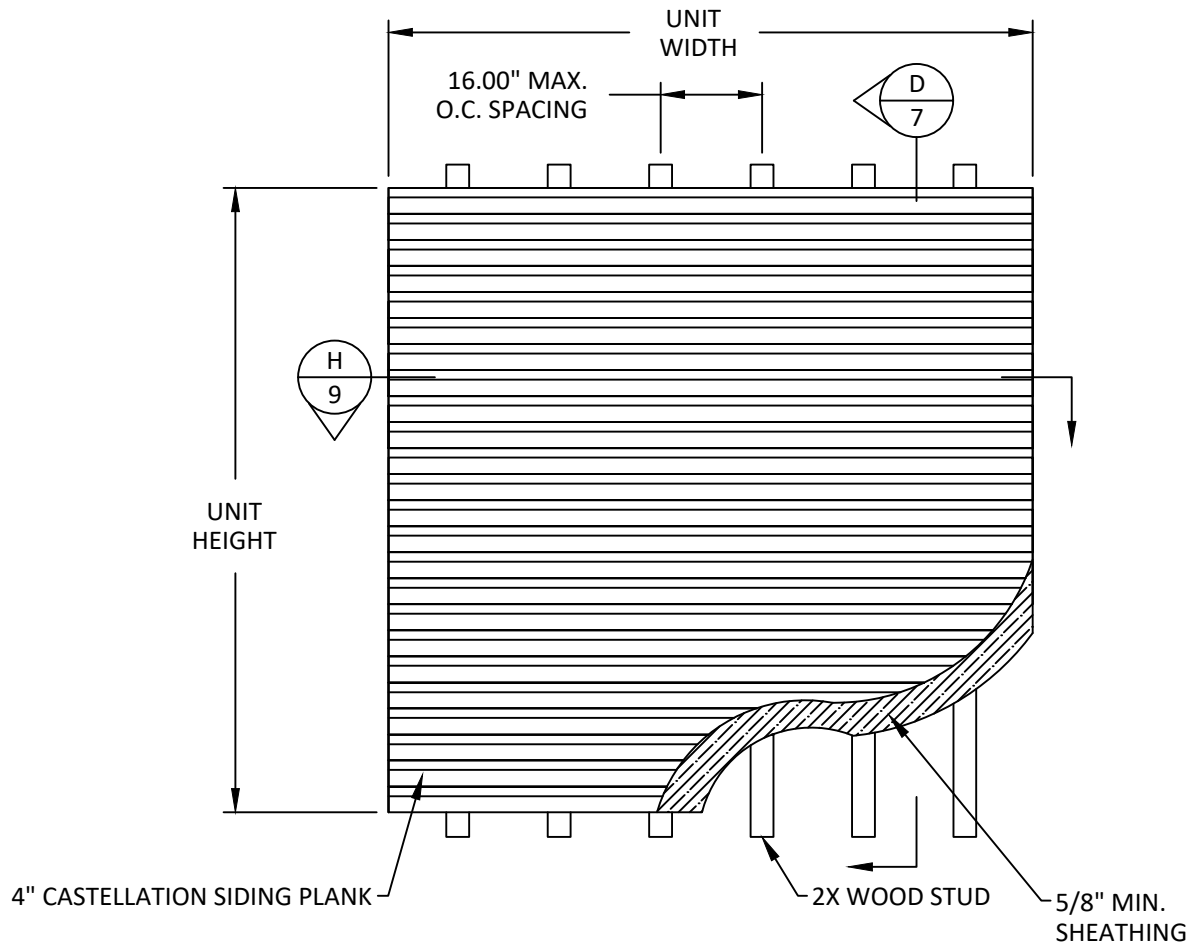

4" CASTELLATION SIDING PLANK ELEVATION

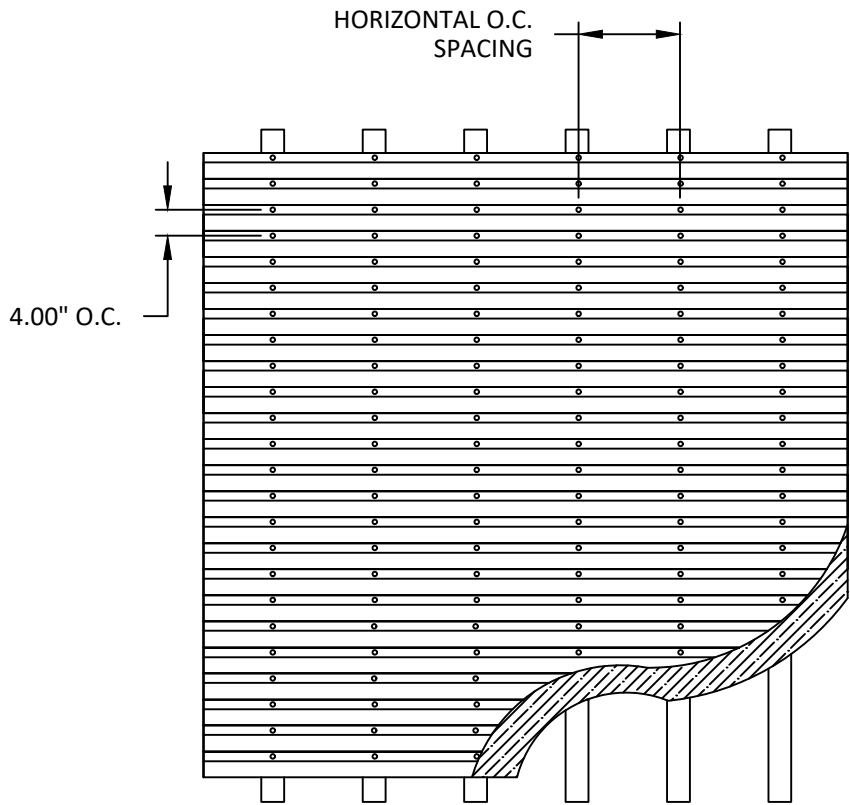

4" CASTELLATION SIDING PLANK ANCHOR LAYOUT

NOTE: SEE DESIGN PRESSURE TABLE ON SHEET 1 FOR HORIZONTAL O.C. SPACING



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)

ELEVATION AND ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

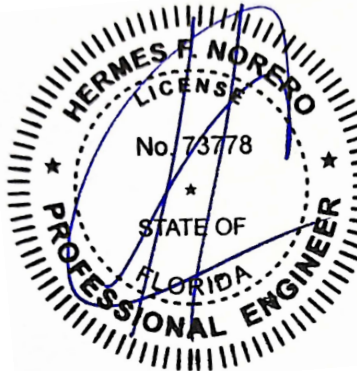

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: FL41934

DATE: 09.02.25

DWG. BY:
HJ

CHK. BY:
HFN

SCALE: NTS

DWG. #: LBD007

SHEET:


5

REV.


A

c:\users\danielb\trago\building drops, inc.\building drops landing - common\projects\2026 code change projects\longboard architectural products\cc-26-0234.3 - 2026 code change - 1711\dwgs\l41934-r4\lbd007-a.dwg

10/8/2026 1:19 PM

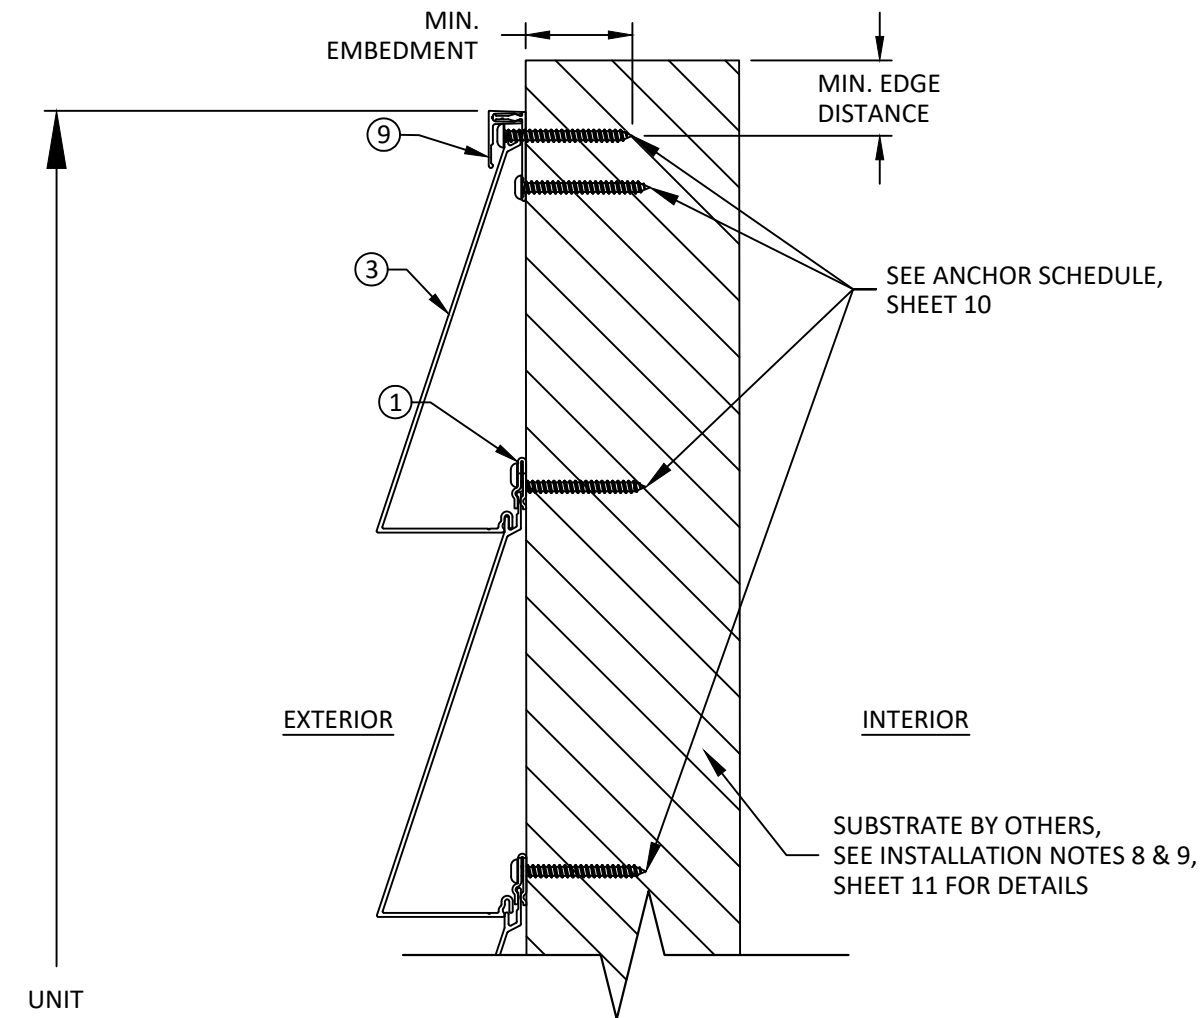

A
6
VERTICAL SECTION
6" SINGLE BEVEL SIDING PLANK

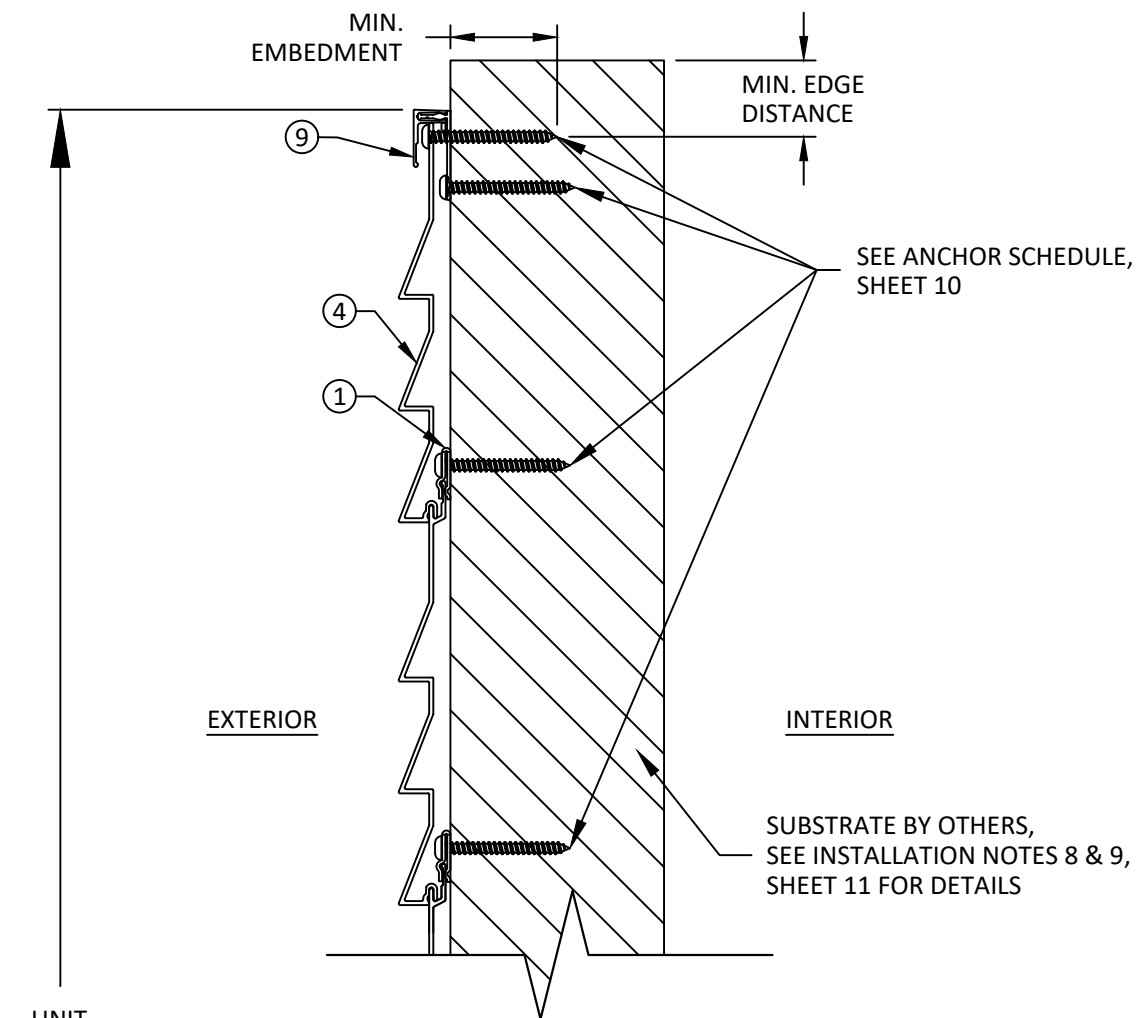

B
6
VERTICAL SECTION
6" TRIPLE BEVEL SIDING PLANK



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (554)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

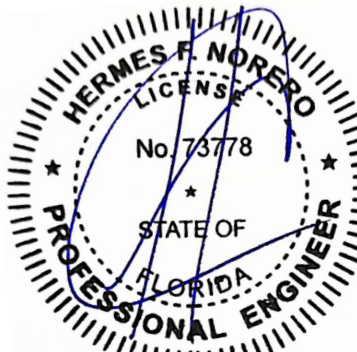


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL41934	
DATE:	09.02.25	
DWG. BY:	HJ	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	LBD007	
SHEET:	6	REV. A

c:\users\danielb\trago\building drops, inc.\building drops landing - common\projects\2026 code change projects\longboard architectural products\cc-26-0234.3 - 2026 code change - 1711\dwgs\l41934-r4\lbd007-a.dwg

10/8/2026 1:19 PM

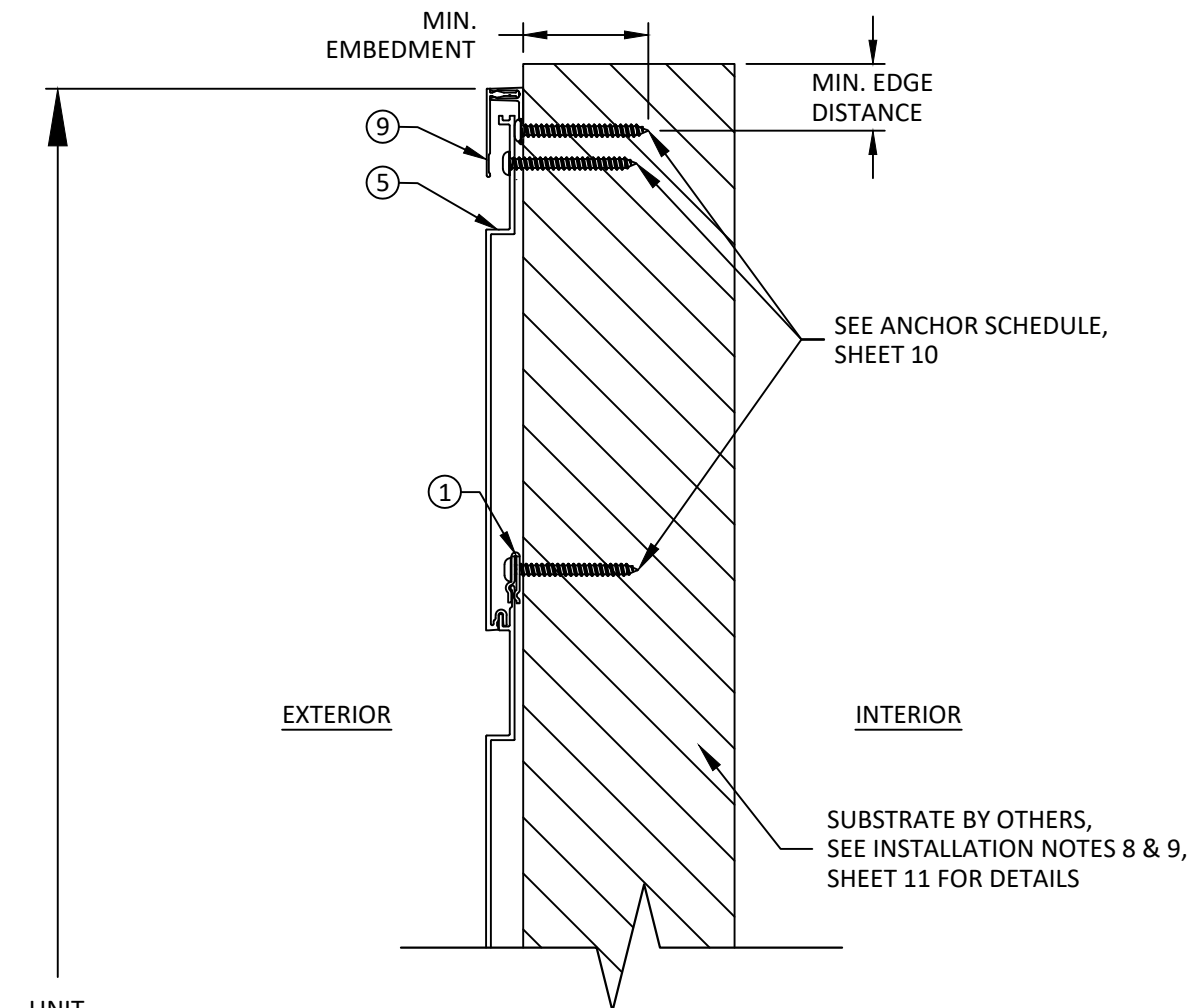

C
7 VERTICAL SECTION
8" CASTELLATION SIDING PLANK

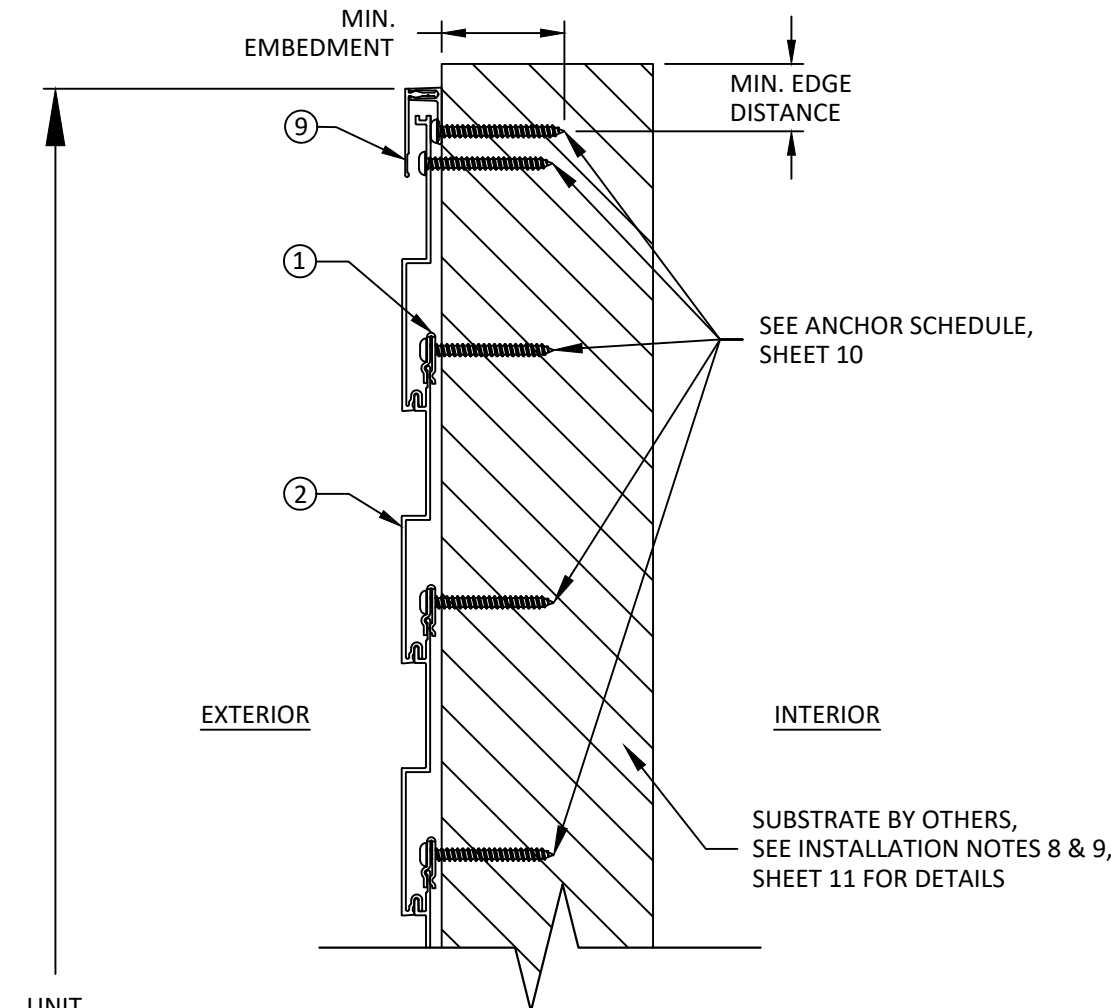

D
7 VERTICAL SECTION
4" CASTELLATION SIDING PLANK



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (554)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

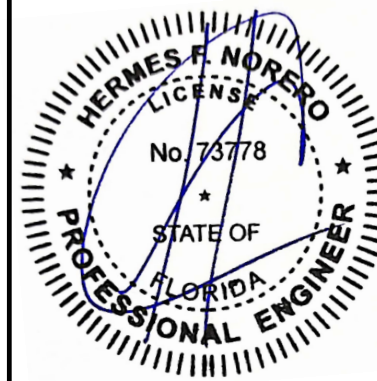


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578



FL #:	FL41934
DATE:	09.02.25
DWG. BY:	CHK. BY:
HJ	HFN
SCALE:	NTS
DWG. #:	LBD007
SHEET:	REV.
7	A

c:\users\danielbultrago\building drops, inc.\building drops\landing - common\projects\2026 code change projects\longboard architectural products\cc-26-0234.3 - 2026 code change - 1711\dwgs\141934-r4\lbd007-a.dwg


10/8/2026 1:19 PM

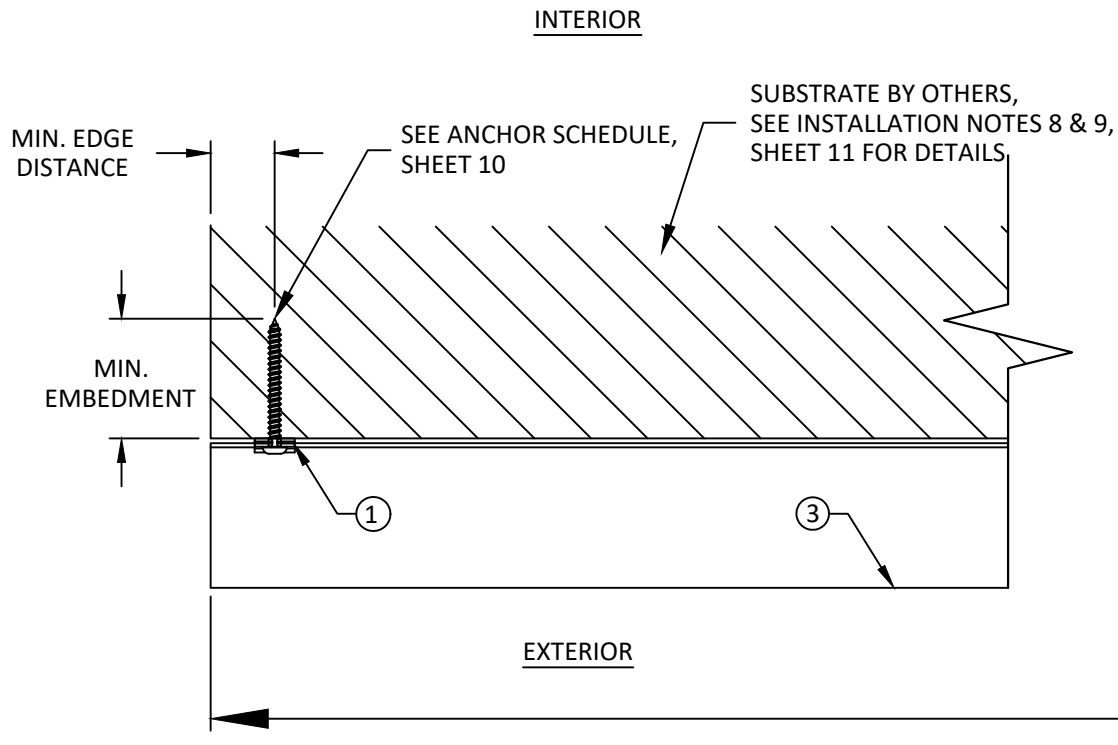

E
8 **HORIZONTAL SECTION**
6" SINGLE BEVEL SIDING PLANK

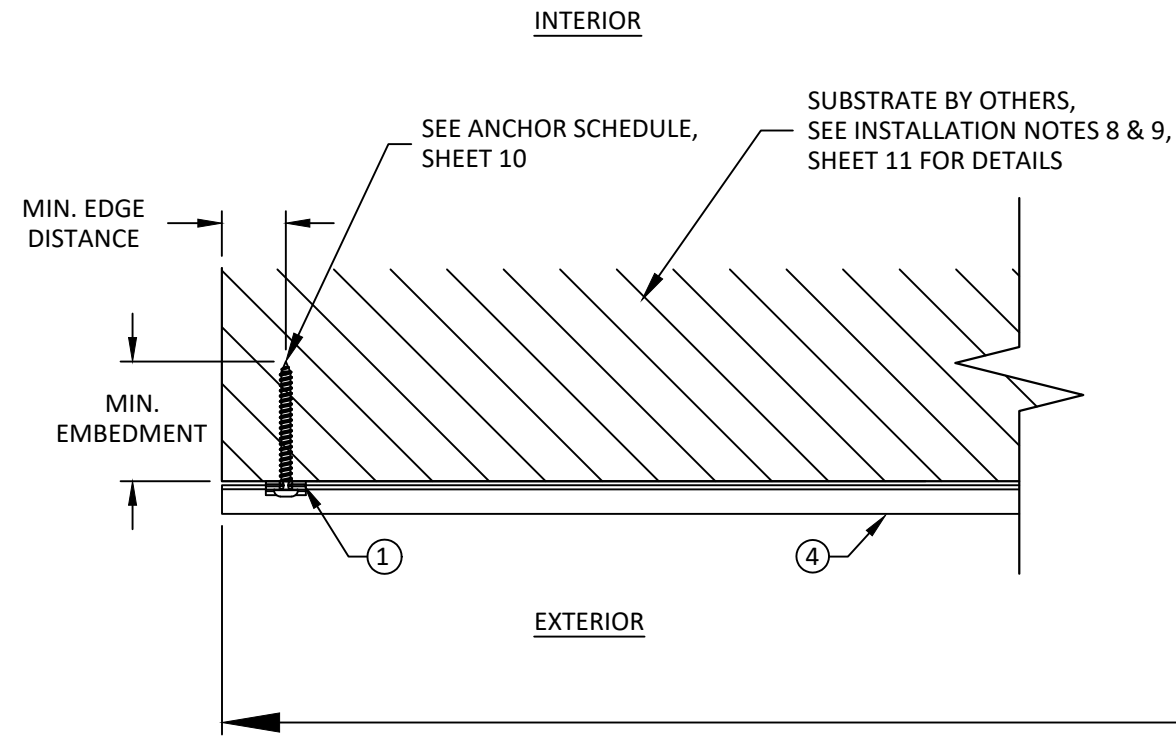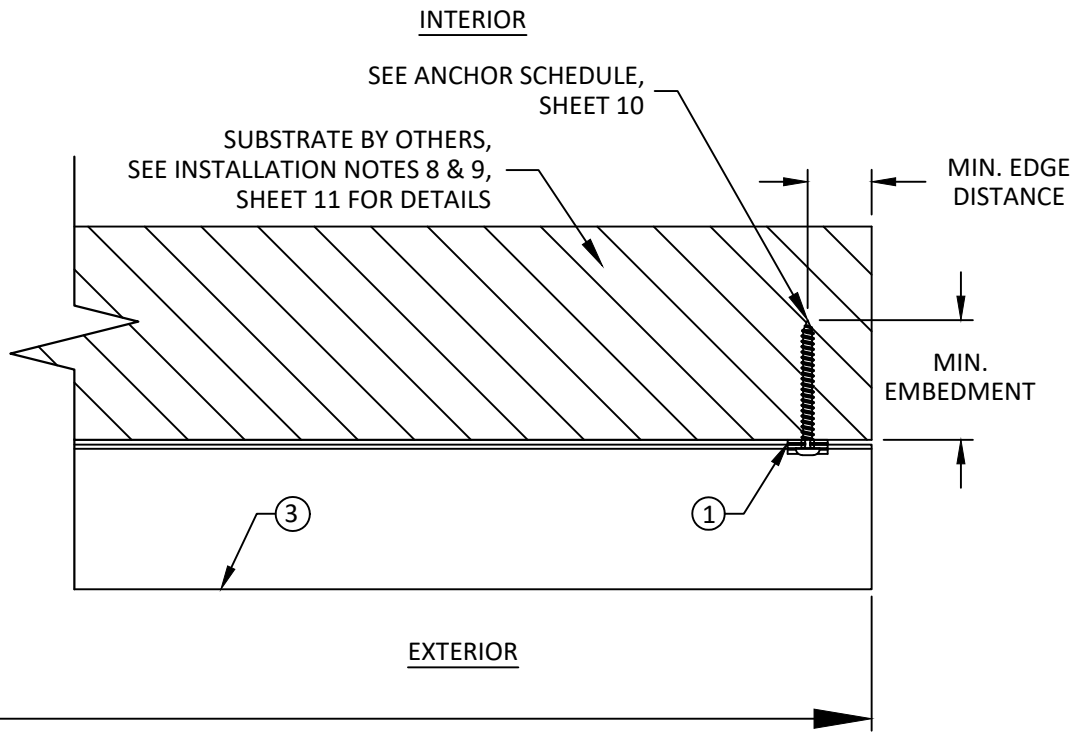

F
8 **HORIZONTAL SECTION**
6" TRIPLE BEVEL SIDING PLANK

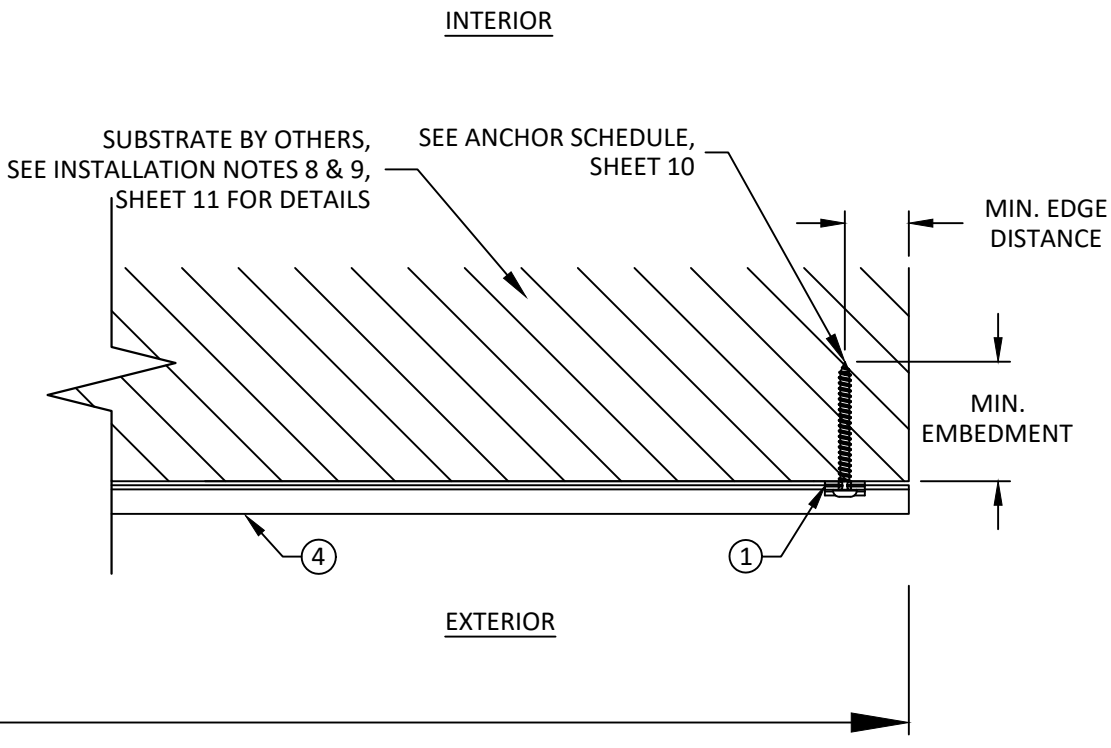

1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)


HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (305) 399-8478
FAX: (305) 399-8478
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

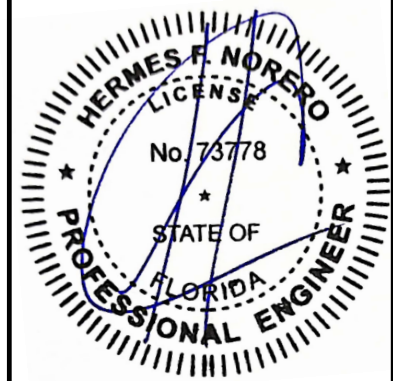



HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL41934
DATE:	09.02.25
DWG. BY:	CHK. BY:
HJ	HFN
SCALE:	NTS
DWG. #:	LBD007
SHEET:	REV. A



8

c:\users\danielb\trago\building drops, inc.\building drops landing - common\projects\2026 code change projects\longboard architectural products\cc-26-0234.3 - 2026 code change - 1711\dwgs\141934-r4\lbd007-a.dwg

10/8/2026 1:19 PM

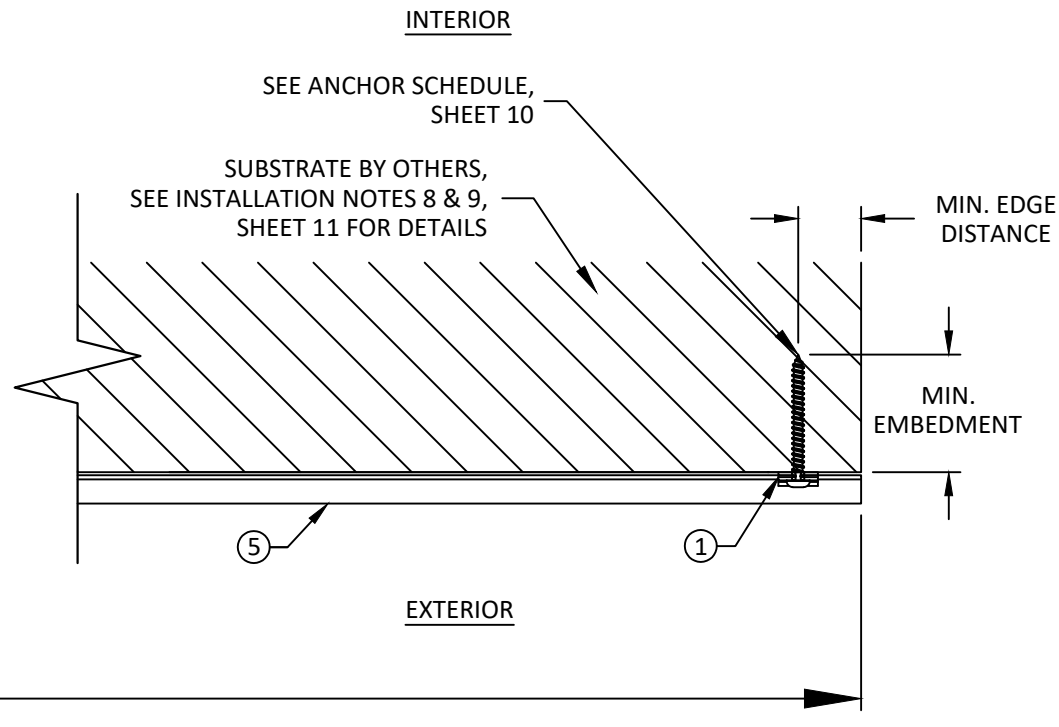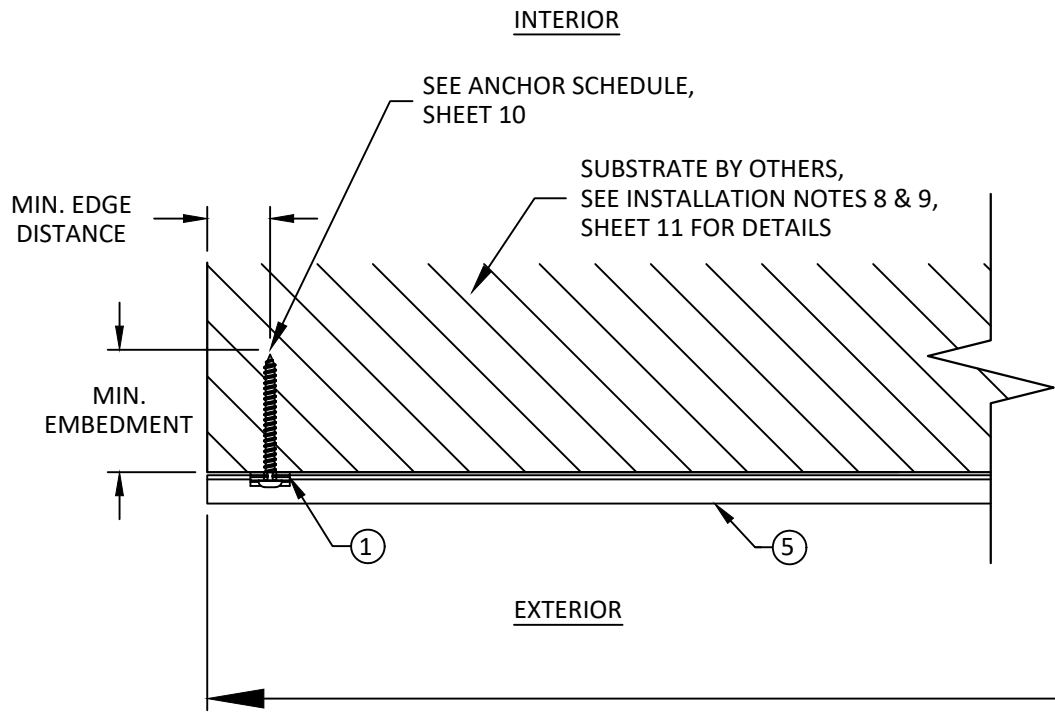

G
9 HORIZONTAL SECTION
8" CASTELLATION SIDING PLANK

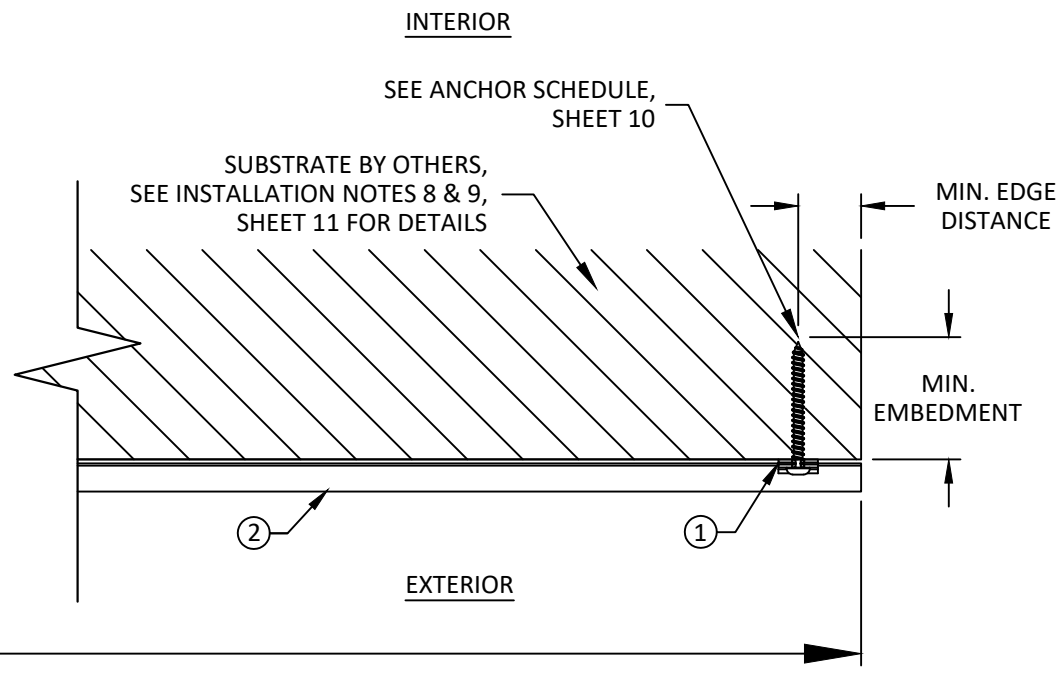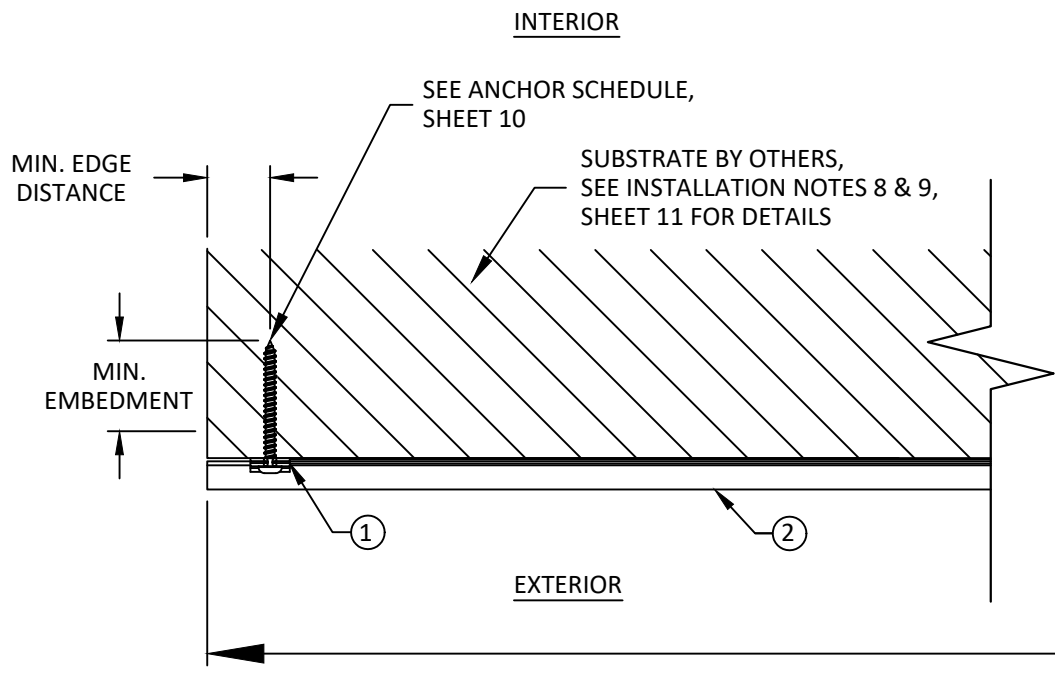

H
9 HORIZONTAL SECTION
4" CASTELLATION SIDING PLANK



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)

HORIZONTAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (305) 399-8478
FAX: (305) 417-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



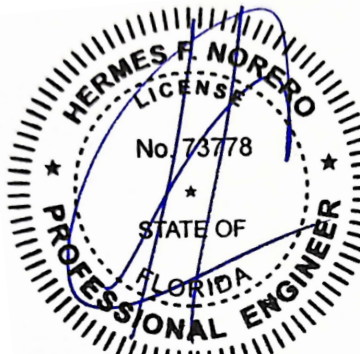


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL41934
DATE:	09.02.25
DWG. BY:	HJ
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	LBD007
SHEET:	9
REV.	A

BILL OF MATERIALS		
PART NO.	DESCRIPTION	MATERIAL
1	QUICK-SCREEN CLIP	316 STAINLESS STEEL
2	4" CASTELLATION PLANK	ALUMINUM 6063-T5
3	6" SINGLE BEVEL PLANK	ALUMINUM 6063-T5
4	6" TRIPLE BEVEL PLANK	ALUMINUM 6063-T5
5	8" CASTELLATION PLANK	ALUMINUM 6063-T5
6	TRADITIONAL CORNER SET	ALUMINUM 6063-T5
7	TRADITIONAL STARTER STRIP	ALUMINUM 6063-T5
8	CRAFTSMAN J-TRACK	ALUMINUM 6063-T5
9	TRADITIONAL TWO PIECE J-TRACK (1-3/8")	ALUMINUM 6063-T5

ANCHOR SCHEDULE			
SUBSTRATE	ANCHOR DESCRIPTION	MIN. EMBEDMENT	MIN. EDGE DISTANCE
WOOD: MIN. S.G. = 0.55	#10 WOOD PAN HEAD SCREW OR #10 GRK R4 SS SCREW*	1.50"	0.50"
WOOD: MIN. 5/8" C/D GRADE PLYWOOD		0.25" PAST PLYWOOD STRUCTURE	1"
STEEL: MIN. 18 GA., MIN. Fy=36 KSI	#10 SELF-DRILLING/TAPPING PAN HEAD SCREW OR #10 DEWALT BIFLEX SS SCREW*	3 THREADS PENETRATION PAST METAL STRUCTURE	0.75"
ALUM.: MIN. 1/8", MIN. 6063-T5			
CONCRETE: MIN. F'C = 3000 PSI	3/16" HEX HEAD ITW TAPCON OR	1"	1.875"
HOLLOW / GROUT-FILLED BLOCK PER C-90: MIN. F'C = 2000 PSI	3/16" CRETE-FLEX SS SCREW*	1"	2"

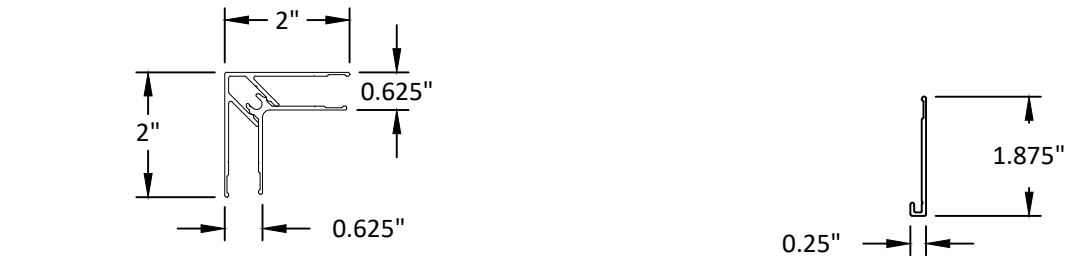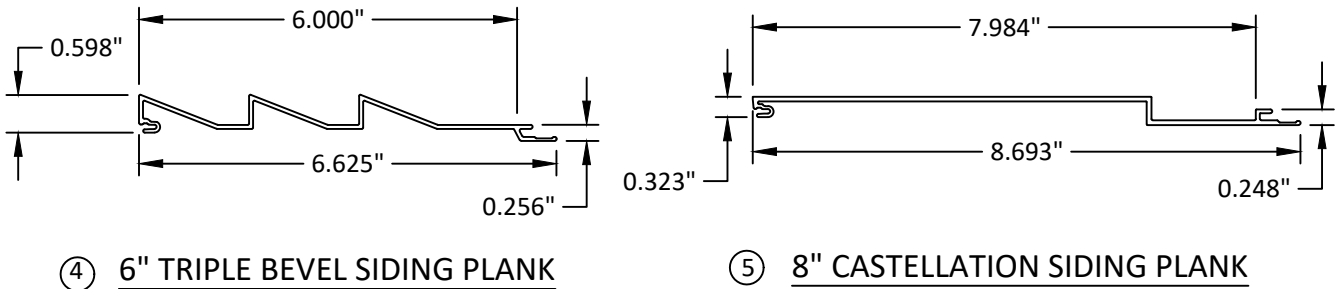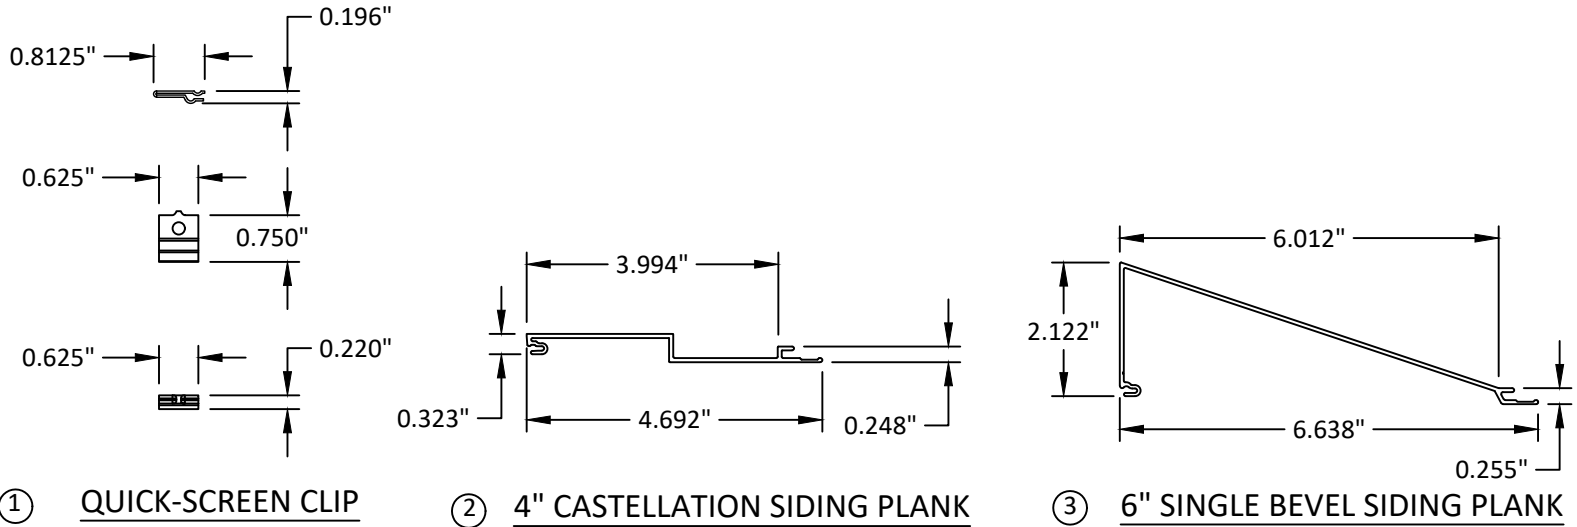

1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)


BILL OF MATERIALS, COMPONENTS, &
ANCHOR SCHEDULE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (354)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

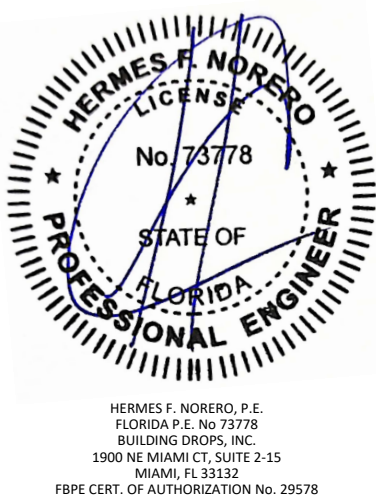

FL #: **FL41934**

DATE: **09.02.25**

DWG. BY: **HJ** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **LBD007**

SHEET: **10** REV. **A**

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, SHEATHING AND SIDING.
5. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

5.1. FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

5.2. *FASTENERS INSTALLED WITHIN 300 FEET OF A SALTWATER COASTLINE IN EXTERIOR-PARTIALLY SHELTERED OR EXTERIOR-OPEN EXPOSED SPACES SHALL BE STAINLESS STEEL PER SECTION 1711.1.1.1 (ASTM A240 TYPE 304, A305, 316, OR 410).

5.3. CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED UNVENTED SPACES SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).

5.4. CONNECTORS AND METAL PLATES USED BETWEEN 300 AND 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED VENTED SPACES, EXTERIOR-PARTIALLY SHELTERED OR EXTERIOR-OPEN EXPOSED SPACES SHALL BE ENHANCED GALVANIZED PER SECTION 1711.1.2.2 (ASTM A653 G185, ASTM A123 AT 2.0 OZ/SF MIN, OR TPI 1 COATING).

5.5. *CONNECTORS AND METAL PLATES USED WITHIN 300 FEET OF A SALTWATER COASTLINE IN EXTERIOR-PARTIALLY SHELTERED OR EXTERIOR-OPEN EXPOSED SPACES SHALL BE STAINLESS STEEL PER SECTION 1711.1.2.1 (ASTM A240 TYPE 316).

5.6. FASTENERS USED WITH CONNECTORS OR METAL PLATES SHALL HAVE A CORROSION-RESISTANT COATING OR COMPOSITION COMPATIBLE WITH THAT OF THE CONNECTOR/PLATE TO PREVENT GALVANIC CORROSION BETWEEN DISSIMILAR MATERIALS (SECTION 1711.1.1.3). EXCEPTION: FASTENERS AND CONNECTORS FULLY EMBEDDED IN CONCRETE OR MORTAR ARE EXEMPT FROM NOTES 4 AND 5 (SECTION 1711.1).
6. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
7. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
8. PRODUCT SHALL BE INSTALLED IN FRONT OF CONSTRUCTION THAT COMPLIES WITH SECTION 1626.4 OF THE FLORIDA BUILDING CODE.
9. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. WOOD- MINIMUM 5/8" C/D GRADE PLYWOOD.

C. STEEL - MINIMUM YIELD STRENGTH OF 36 KSI. MINIMUM 18 GA. WALL THICKNESS.

D. ALUMINUM - MINIMUM 1/8 INCH THICK 6063-T5 ALUMINUM.

E. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

F. MASONRY - CMU UNIT STRENGTH CONFORMS TO ASTM C-90, WITH MIN. COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MIN. GROUT COMPRESSIVE STRENGTH OF 2000 PSI.



1777 CLEARBROOK RD #120
ABBOTSFORD, BC V2T 5X5, CANADA
PH: (800) 604-0343

TITLE: TEXTURED PLANK WALL
CLADDING SYSTEM
(HVHZ)

INSTALLATION NOTES


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	07/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

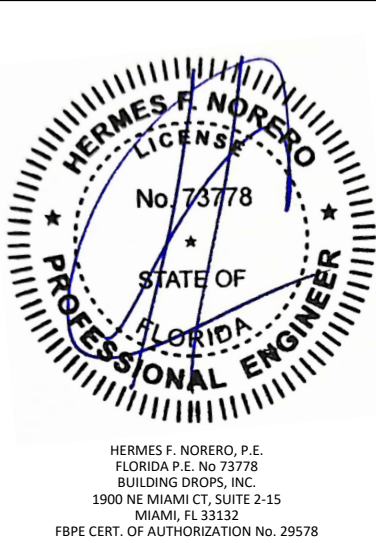

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: FL41934

DATE: 09.02.25

DWG. BY: HJCHK. BY: HFN

SCALE: NTS

DWG. #: LBD007

SHEET: 11REV. A

OF 11