

W & W GLASS, LLC

W & W GLASS FIN SYSTEM

(NON-HVHZ) (NON-IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) **EXCLUDING** HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA 501-15
 - ASTM E283-19
 - ASTM E330-14
 - ASTM E331-00(16)
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. FRAME MATERIAL: ALUMINUM 6063-T5
7. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 4 & 5 FOR GLAZING DETAILS.

INSTALLATION NOTES:

1. SEE SHEETS 9-13 FOR ANCHOR TYPE REQUIREMENTS, MINIMUM EMBEDMENTS, AND MINIMUM EDGE DISTANCES. ALL ANCHOR REQUIREMENTS MUST BE ADHERED TO. ANY DEVIATIONS FROM ANCHOR REQUIREMENTS REQUIRES SEPARATE EVALUATION AND APPROVAL.
2. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
3. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK IS SHOWN ON INSTALLATION DETAILS PAGE 9-13. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, INSTALLATION NOTES, & DESIGN PRESSURE TABLE
2	ELEVATION & ANCHOR LAYOUT
3	ELEVATION & ANCHOR LAYOUT
4	GLAZING DETAILS
5	GLAZING DETAILS
6	VERTICAL SECTIONS
7	VERTICAL SECTIONS
8	HORIZONTAL SECTIONS
9	INSTALLATION DETAILS
10	INSTALLATION DETAILS
11	INSTALLATION DETAILS
12	INSTALLATION DETAILS
13	INSTALLATION DETAILS
14	BILL OF MATERIALS & COMPONENTS

DESIGN PRESSURE	WATER TEST PRESSURE	MISSILE IMPACT RATING
SEE SHEET 2 & 3	15 PSF	NON-IMPACT



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)
GENERAL & INSTALLATION NOTES,
DESIGN PRESSURE TABLE


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.02.12 19:51:55 -05'00'

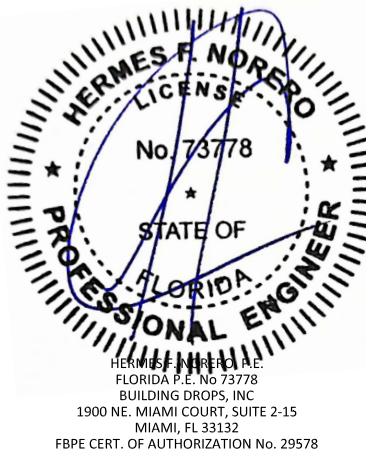

FL #:
FL42023

DATE:
2023.11.21

DWG. BY:
DI


CHK. BY:
HFN

SCALE:
NTS

DWG. #:
WWG002

SHEET:
1

DESIGN PRESSURE TABLE					
FRAME HEIGHT (in)	D.L.O. WIDTH (in)	D.L.O. HEIGHT (in)	CORNER D.L.O. TRIBUTARY WIDTH (in)	CORNER D.L.O. HEIGHT (in)	DESIGN PRESSURE (PSF)
694.75	65.375	157.08	48.8575	157.08	+/- 30

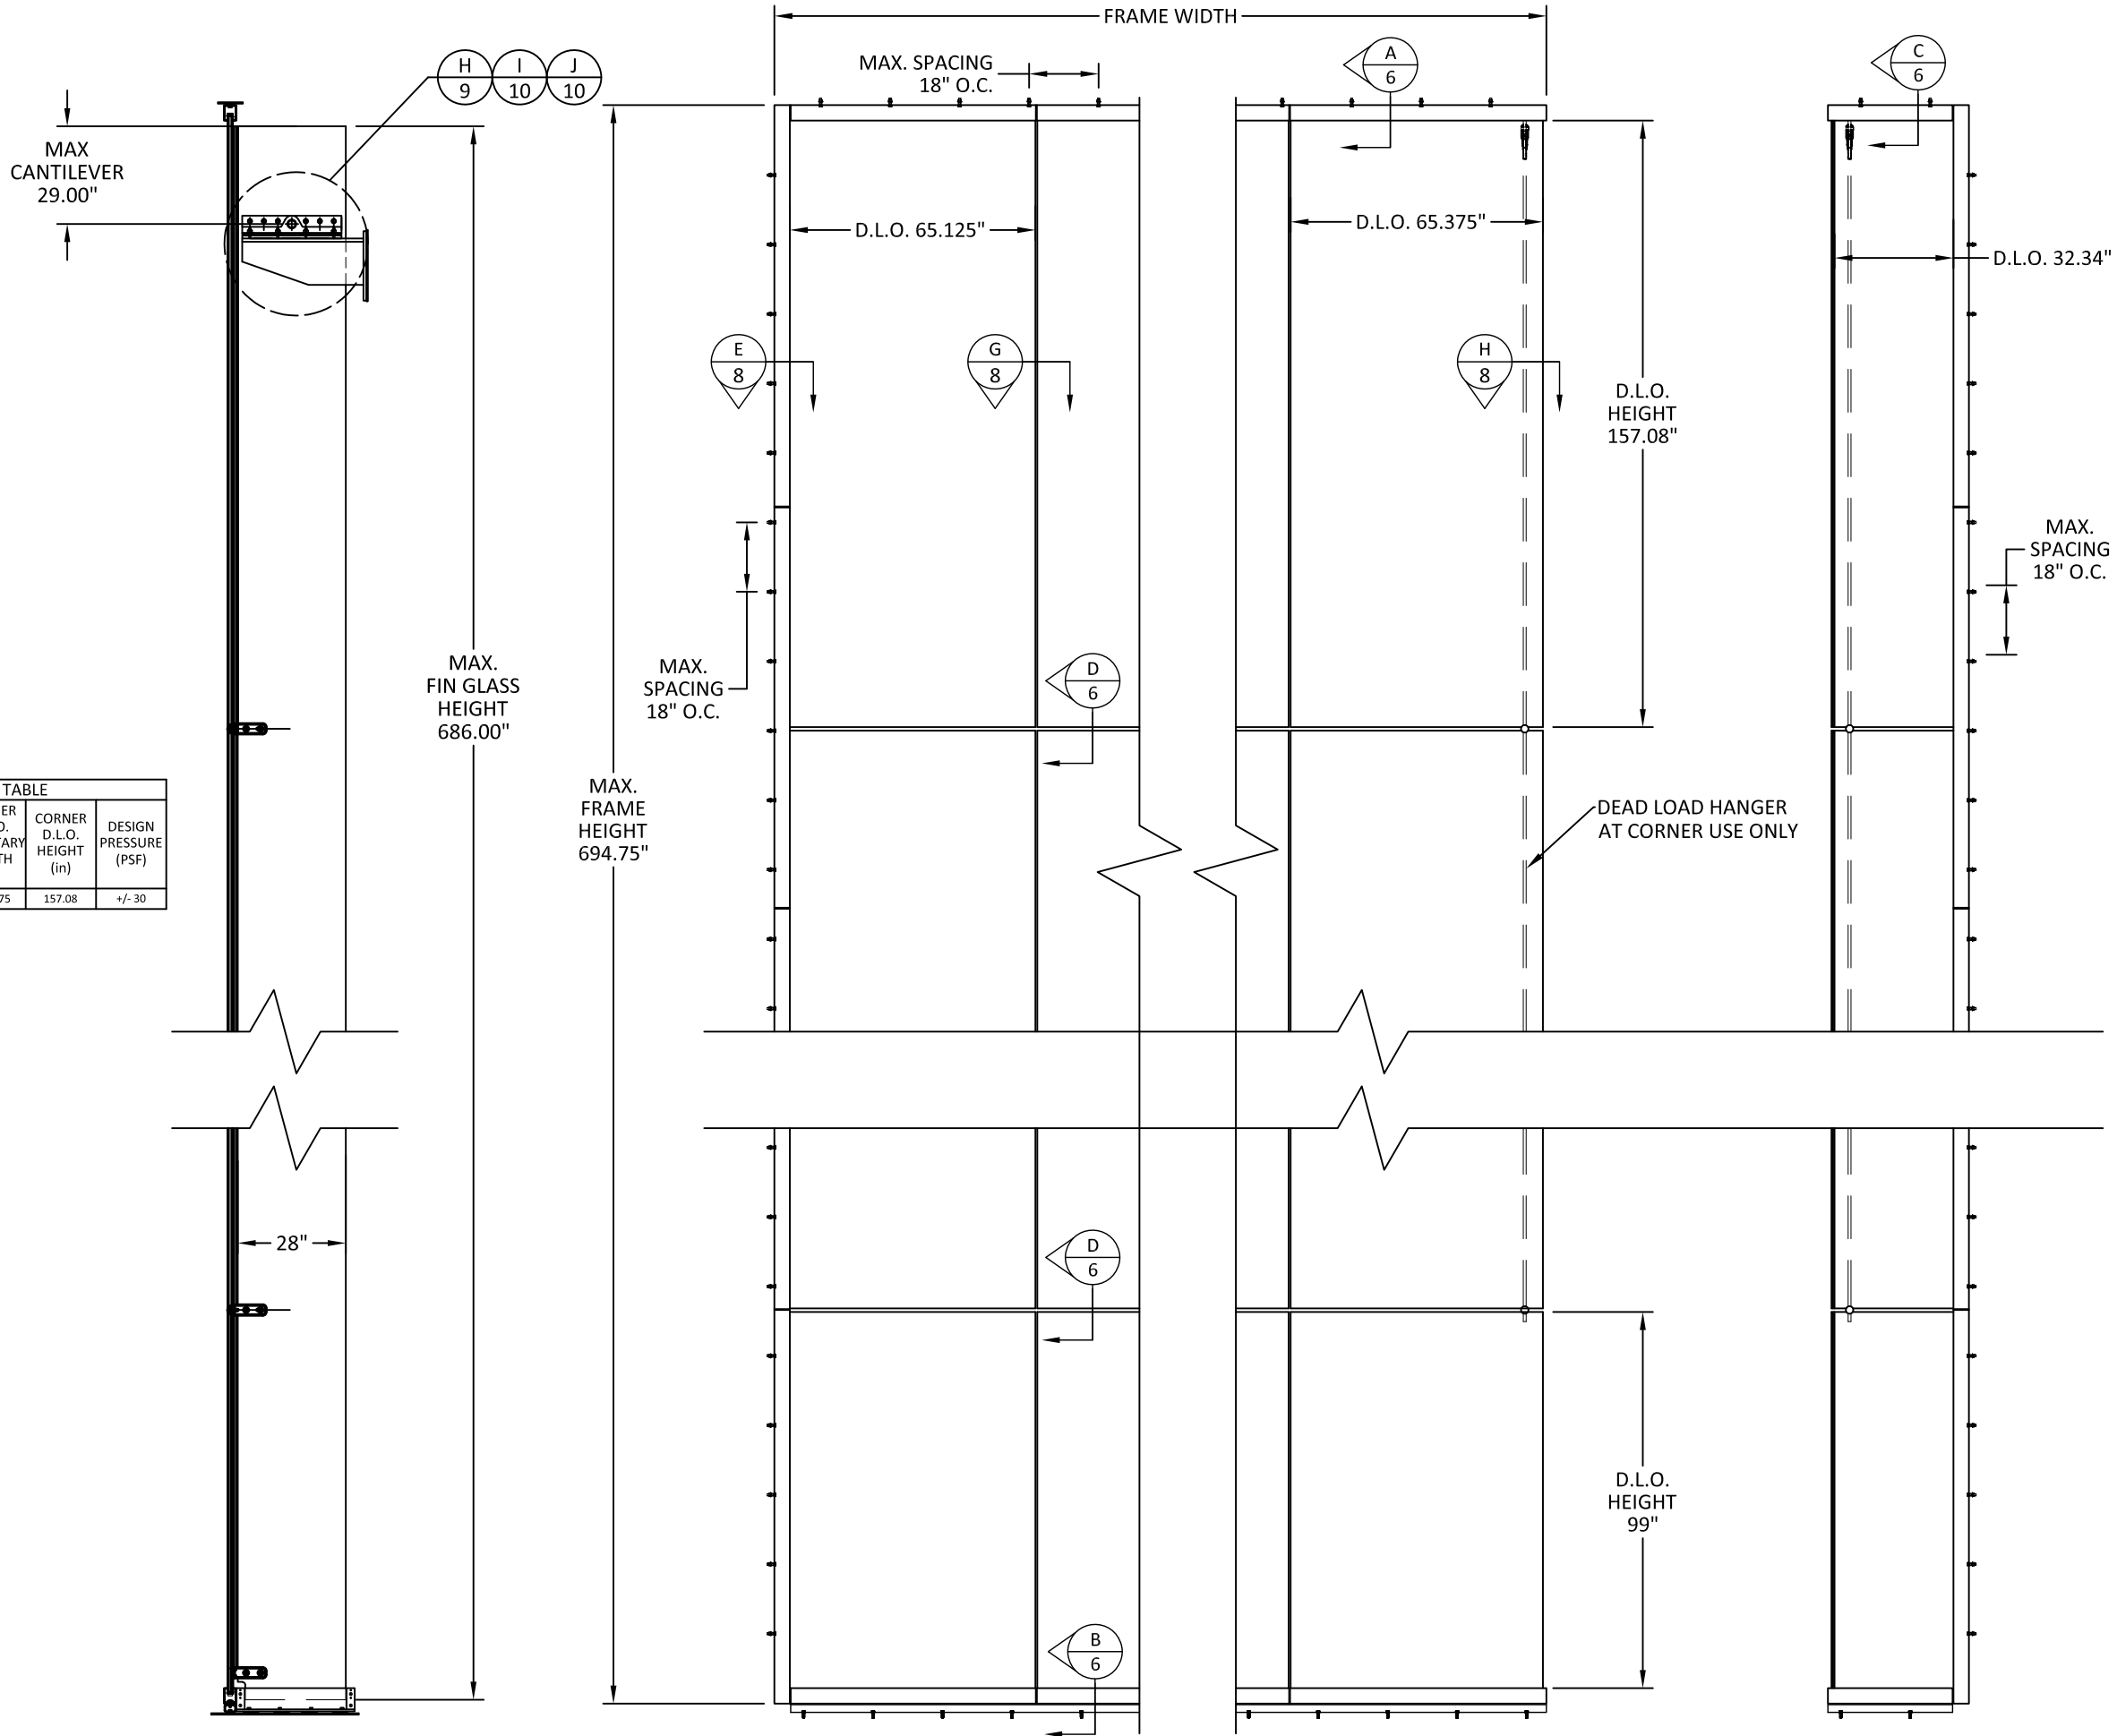

TYPICAL ELEVATION



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

ELEVATION & ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com





REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

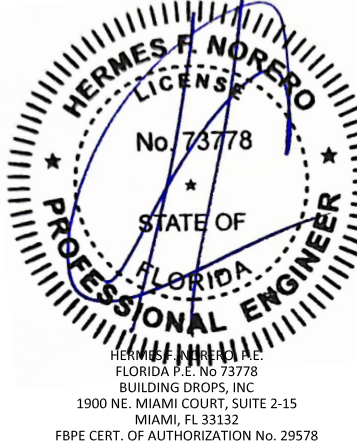

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	2

DESIGN PRESSURE TABLE					
FRAME HEIGHT (in)	D.L.O. WIDTH (in)	D.L.O. HEIGHT (in)	CORNER D.L.O. TRIBUTARY WIDTH (in)	CORNER D.L.O. HEIGHT (in)	DESIGN PRESSURE (PSF)
728.75	72.000	180.00	48.8575	157.08	+/- 45

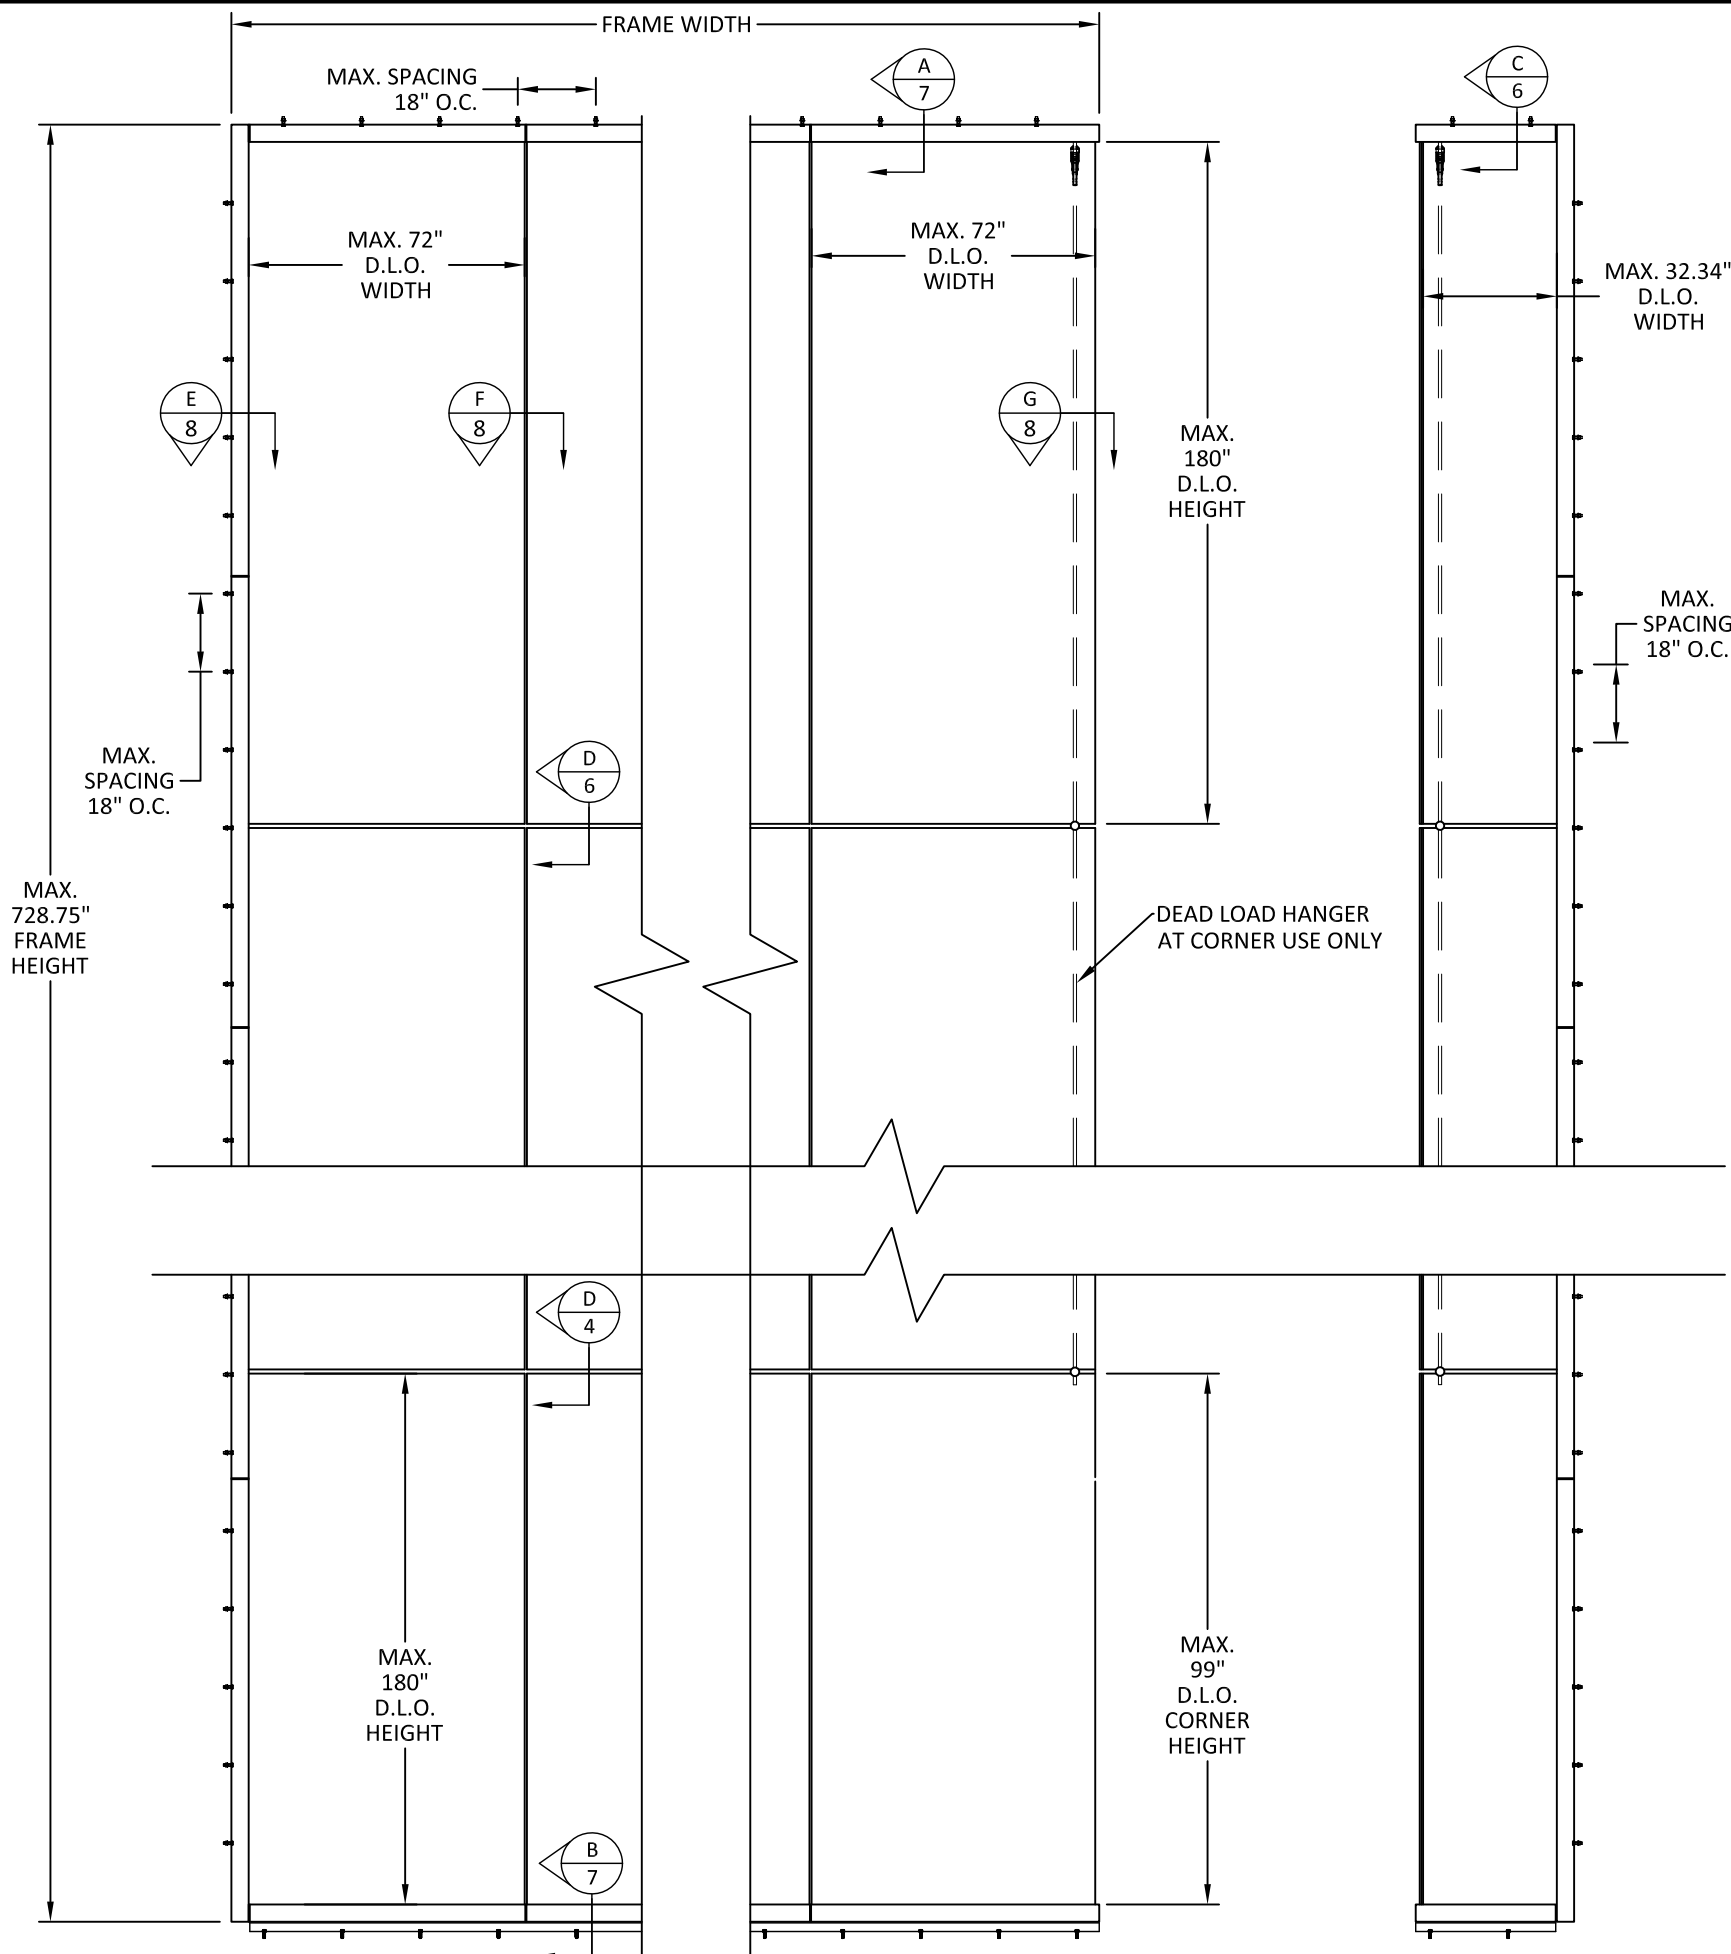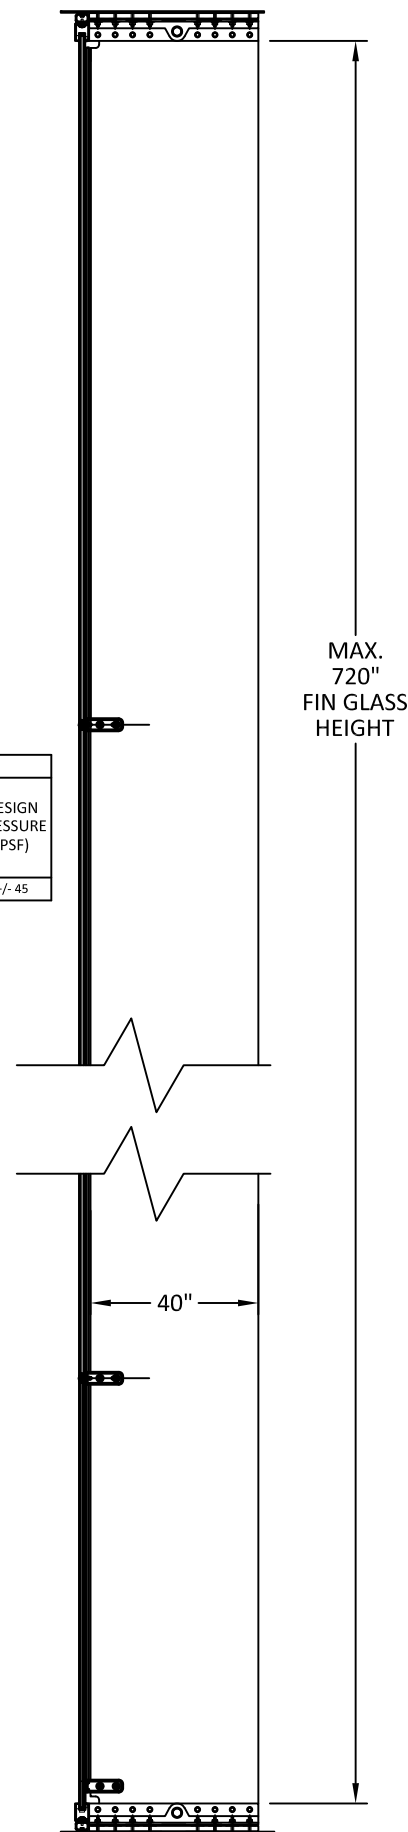

TYPICAL ELEVATION



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE: W & W GLASS FIN SYSTEM (NON-HVHZ) (NON-IMPACT)


ELEVATION & ANCHOR LAYOUT

PREPARED BY:



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC PROJECT SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

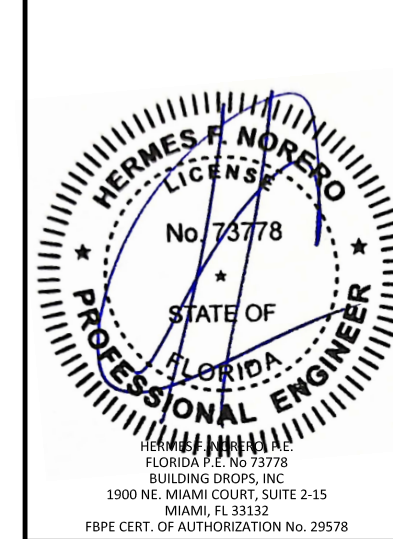

FL #: **FL42023**


DATE: 2023.11.21

DWG. BY: DI	CHK. BY: HFN
-----------------------	------------------------


SCALE: **NTS**

DWG. #: **WWG002**


SHEET:

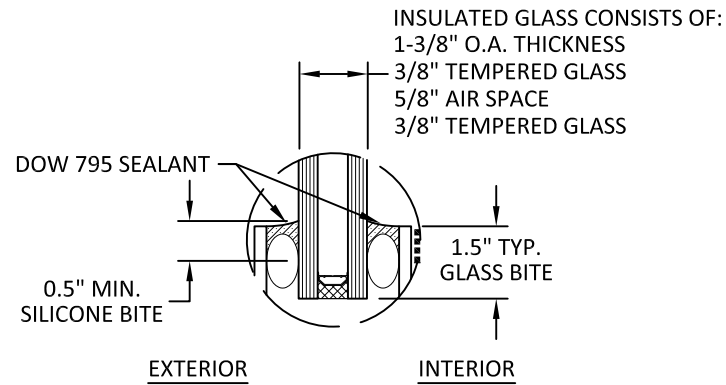


GLAZING DETAIL 1
JAMB - FACE GLASS

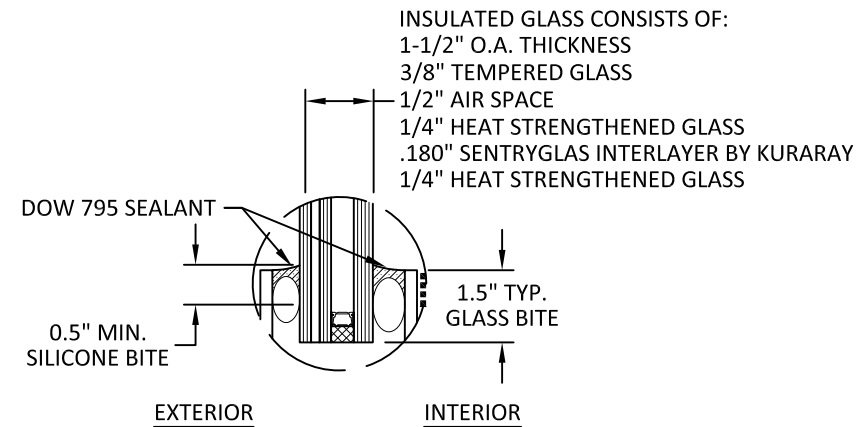


GLAZING DETAIL 4
JAMB - FACE GLASS

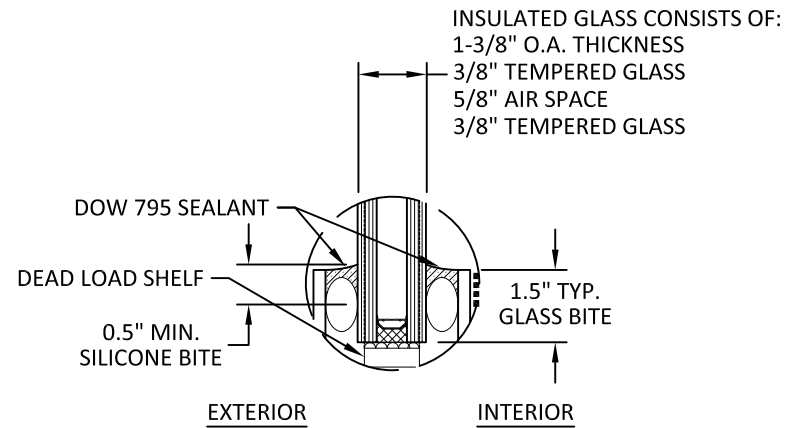


GLAZING DETAIL 2
SILL - FACE GLASS

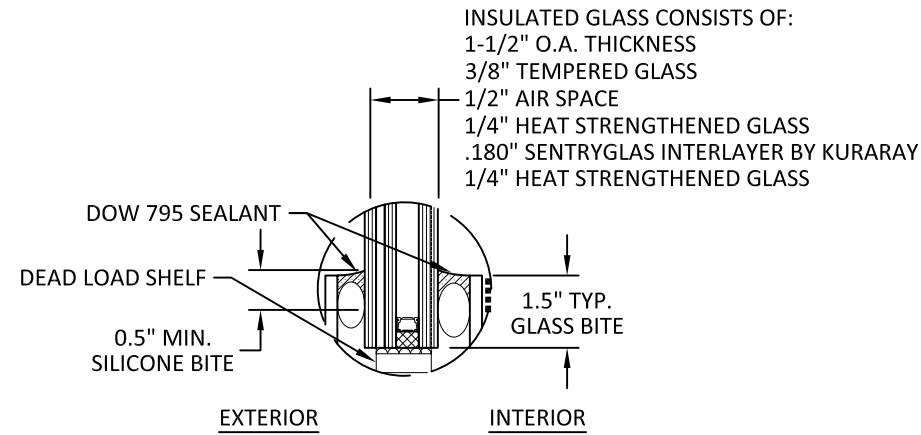

GLAZING DETAIL 5
SILL - FACE GLASS

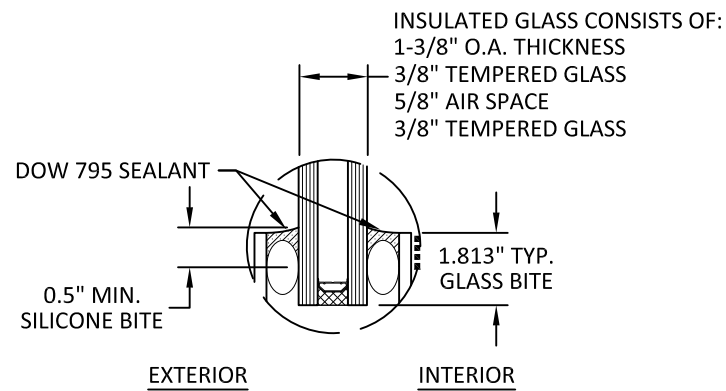

GLAZING DETAIL 3
HEAD - FACE GLASS

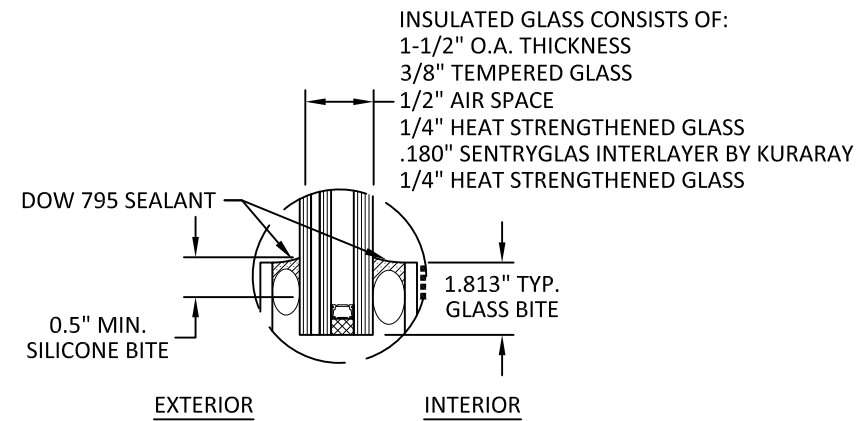

GLAZING DETAIL 6
HEAD - FACE GLASS

GLAZING NOTES:

- GLASS TYPE & THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 85 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN ON SHEET 1.



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

GLAZING DETAILS


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132

PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

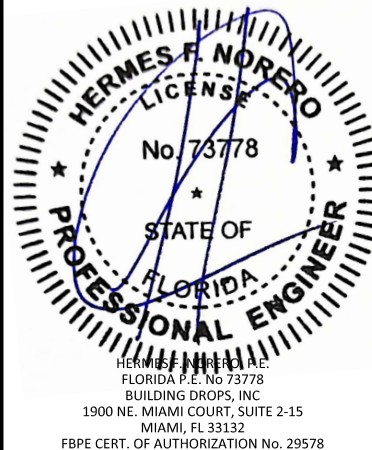

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	4



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

GLAZING DETAILS

PREPARED BY:

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

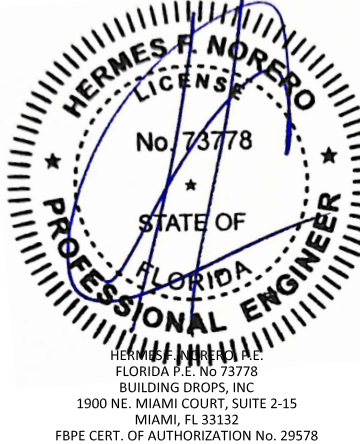

FL #: **FL42023**

DATE: **2023.11.21**

DWG. BY: DI	CHK. BY: HFN
-----------------------	------------------------







SCALE: **NTS**

DWG. #: **WWG002**


SHEET:

5


OF 14

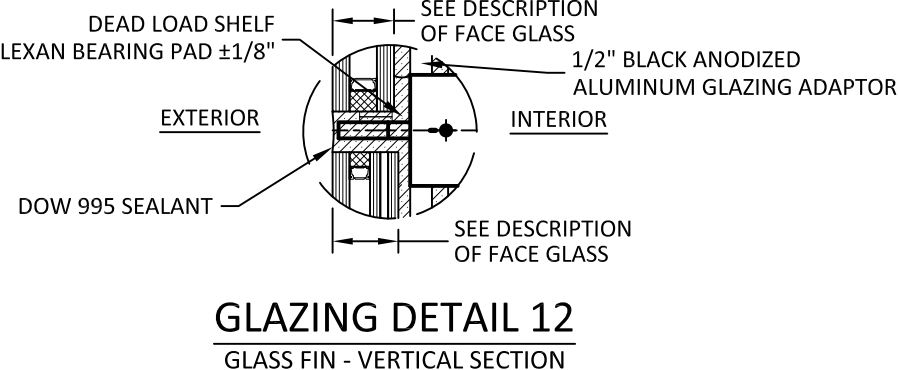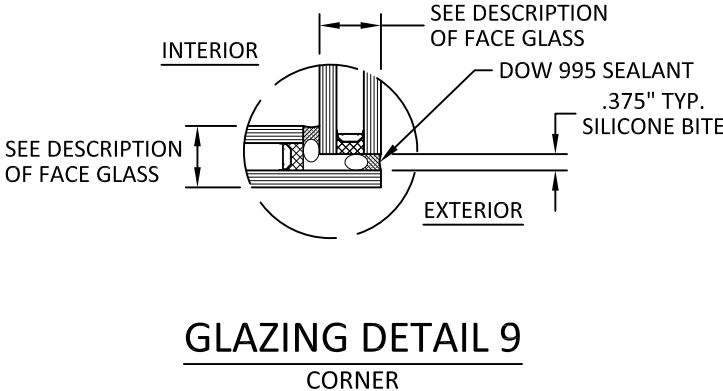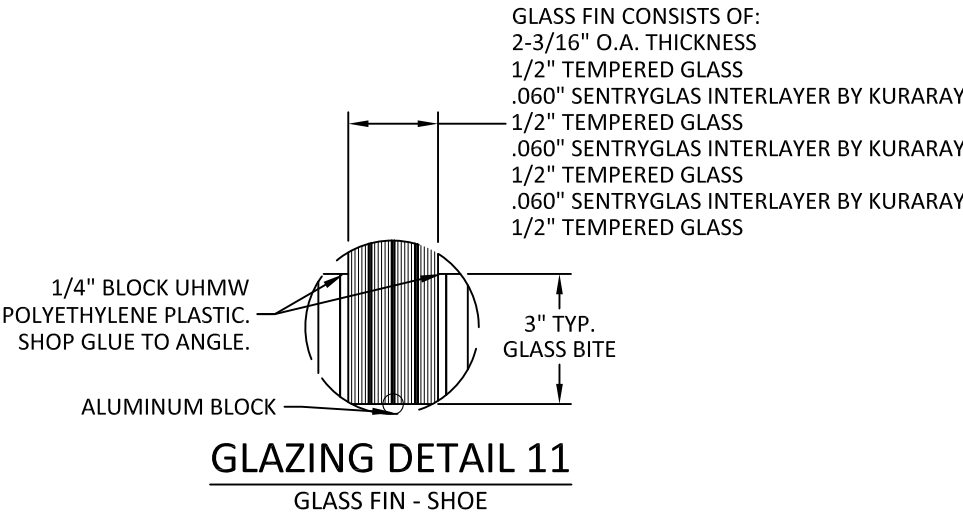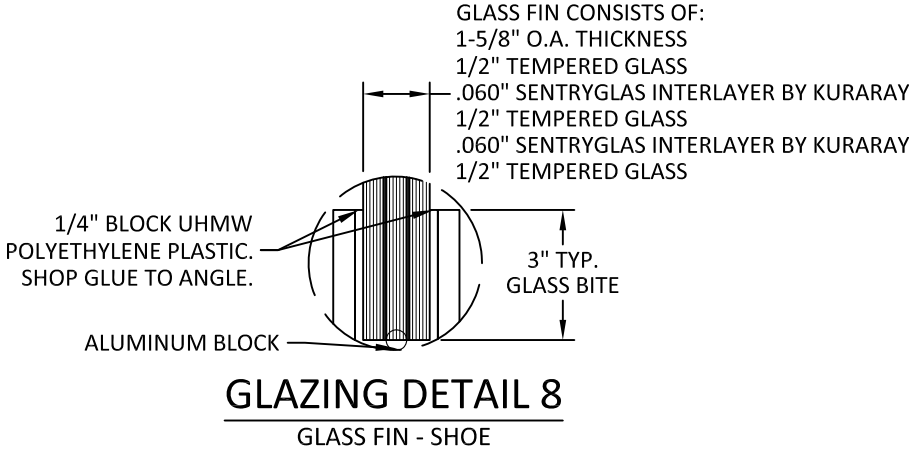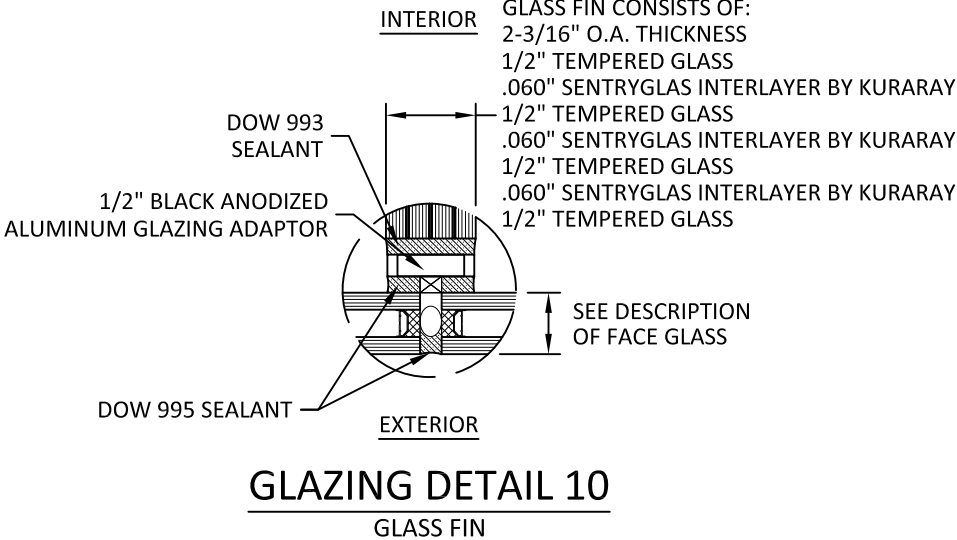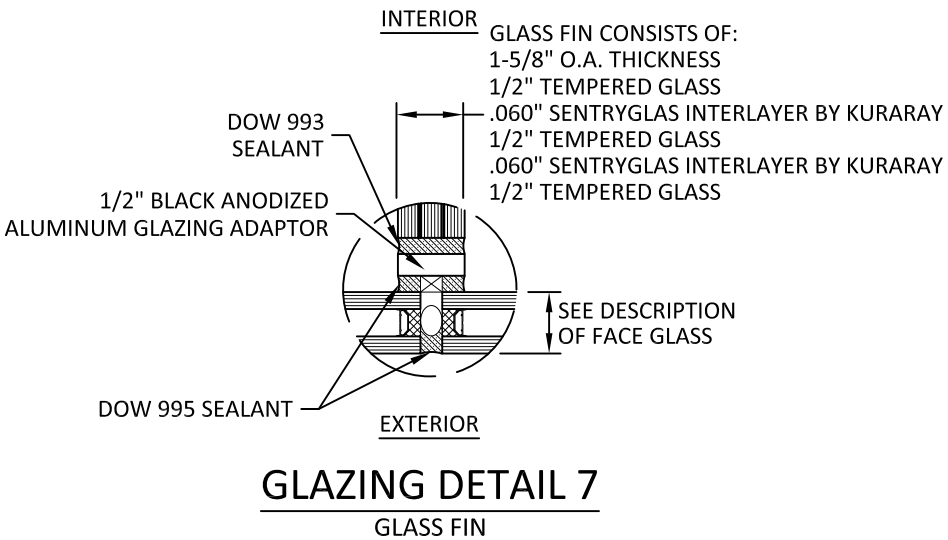


- GLAZING NOTES:
- GLASS TYPE & THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 85 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN ON SHEET 1.

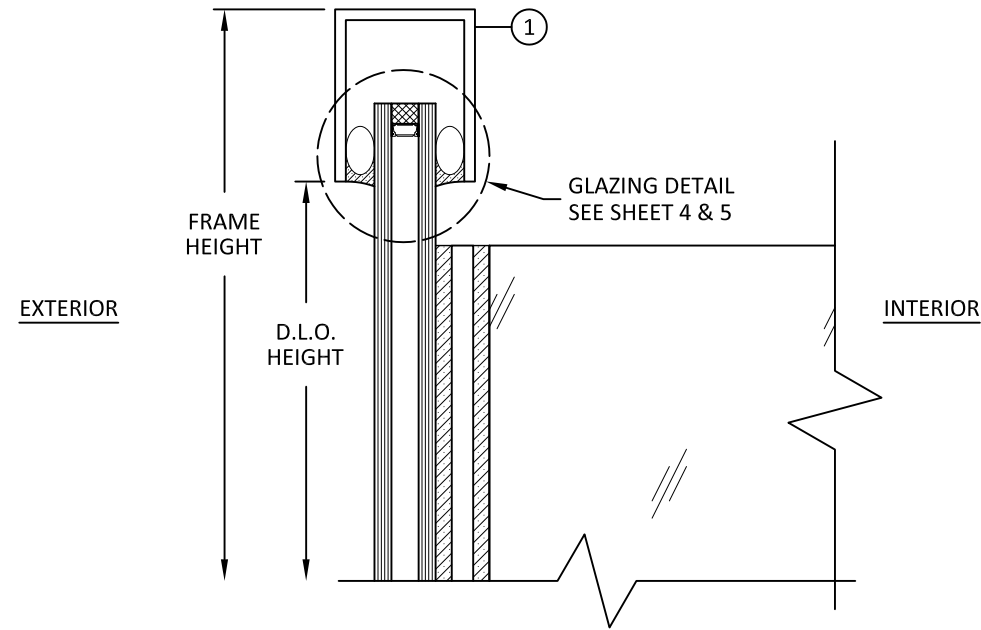


A
6 VERTICAL SECTION
HEAD AT GLASS FIN

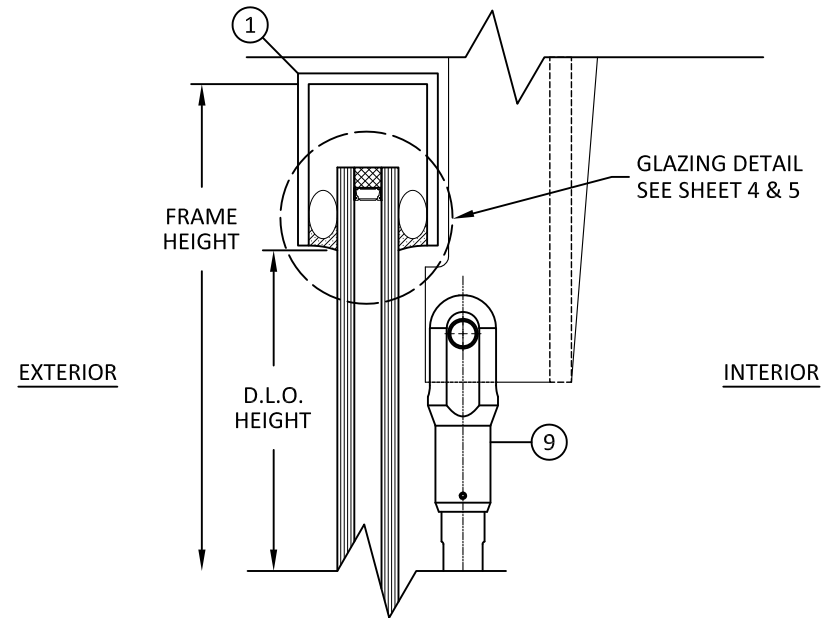

C
6 VERTICAL SECTION
HEAD AT CORNER

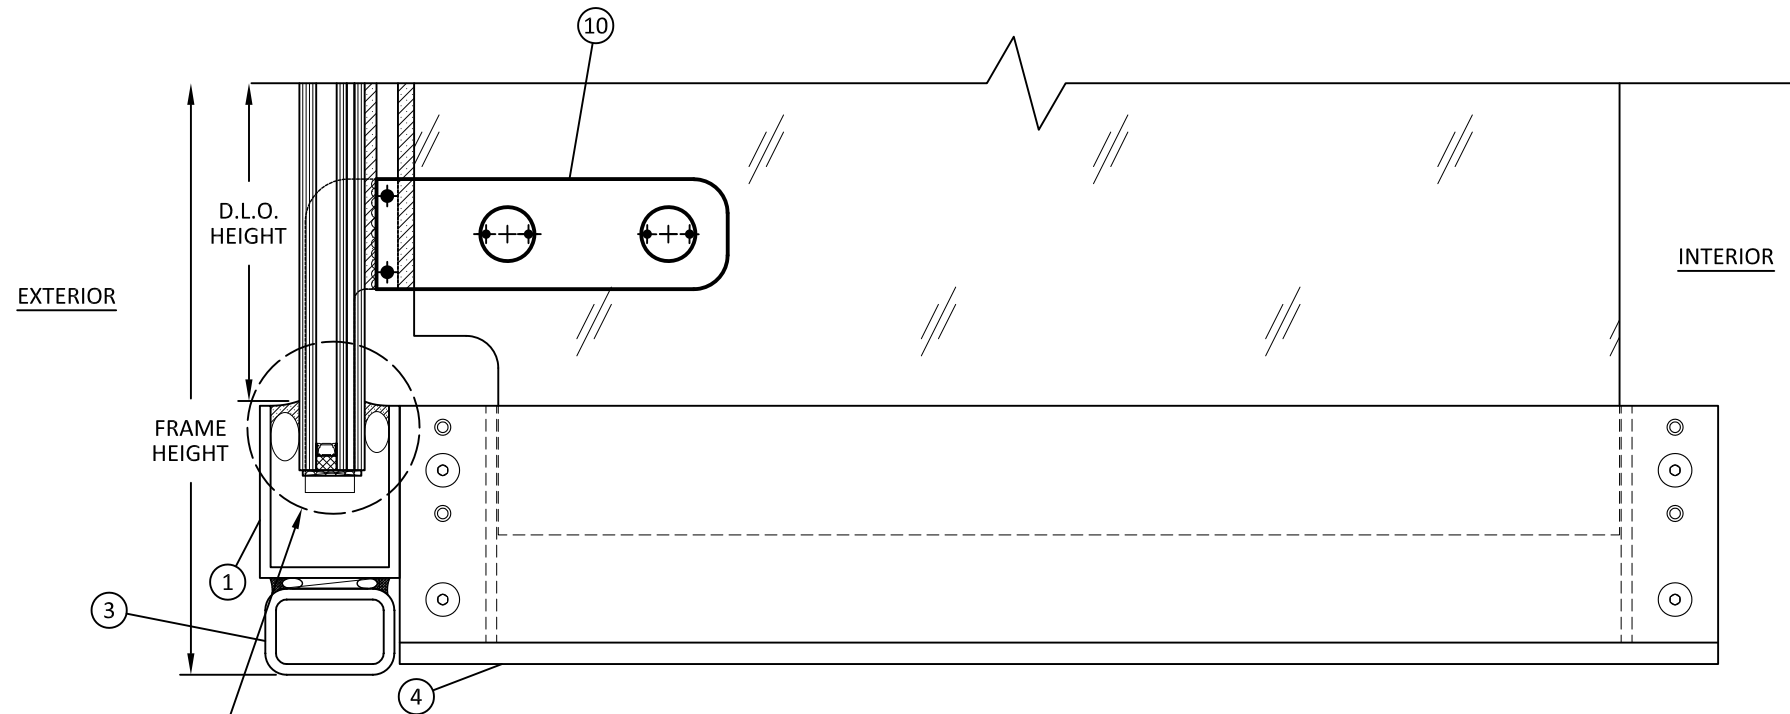

B
6 VERTICAL SECTION
SILL

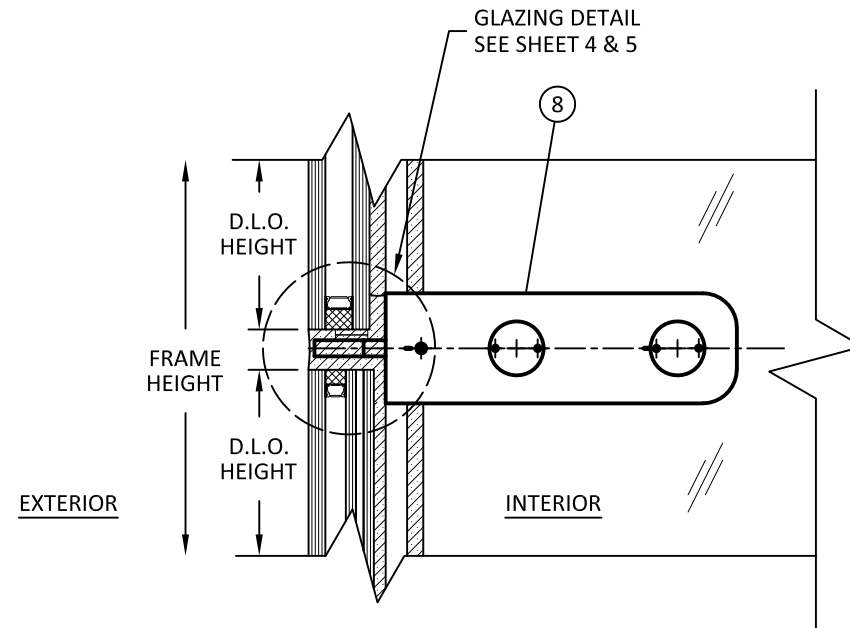

D
6 VERTICAL SECTION
INTERSECTION



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954


TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

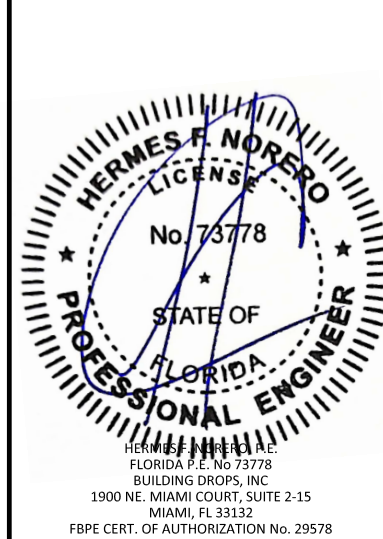

FL #: **FL42023**


DATE: **2023.11.21**

DWG. BY: **DI** **CHK. BY:** **HFN**


SCALE: **NTS**

DWG. #: **WWG002**

SHEET:
6
OF 14

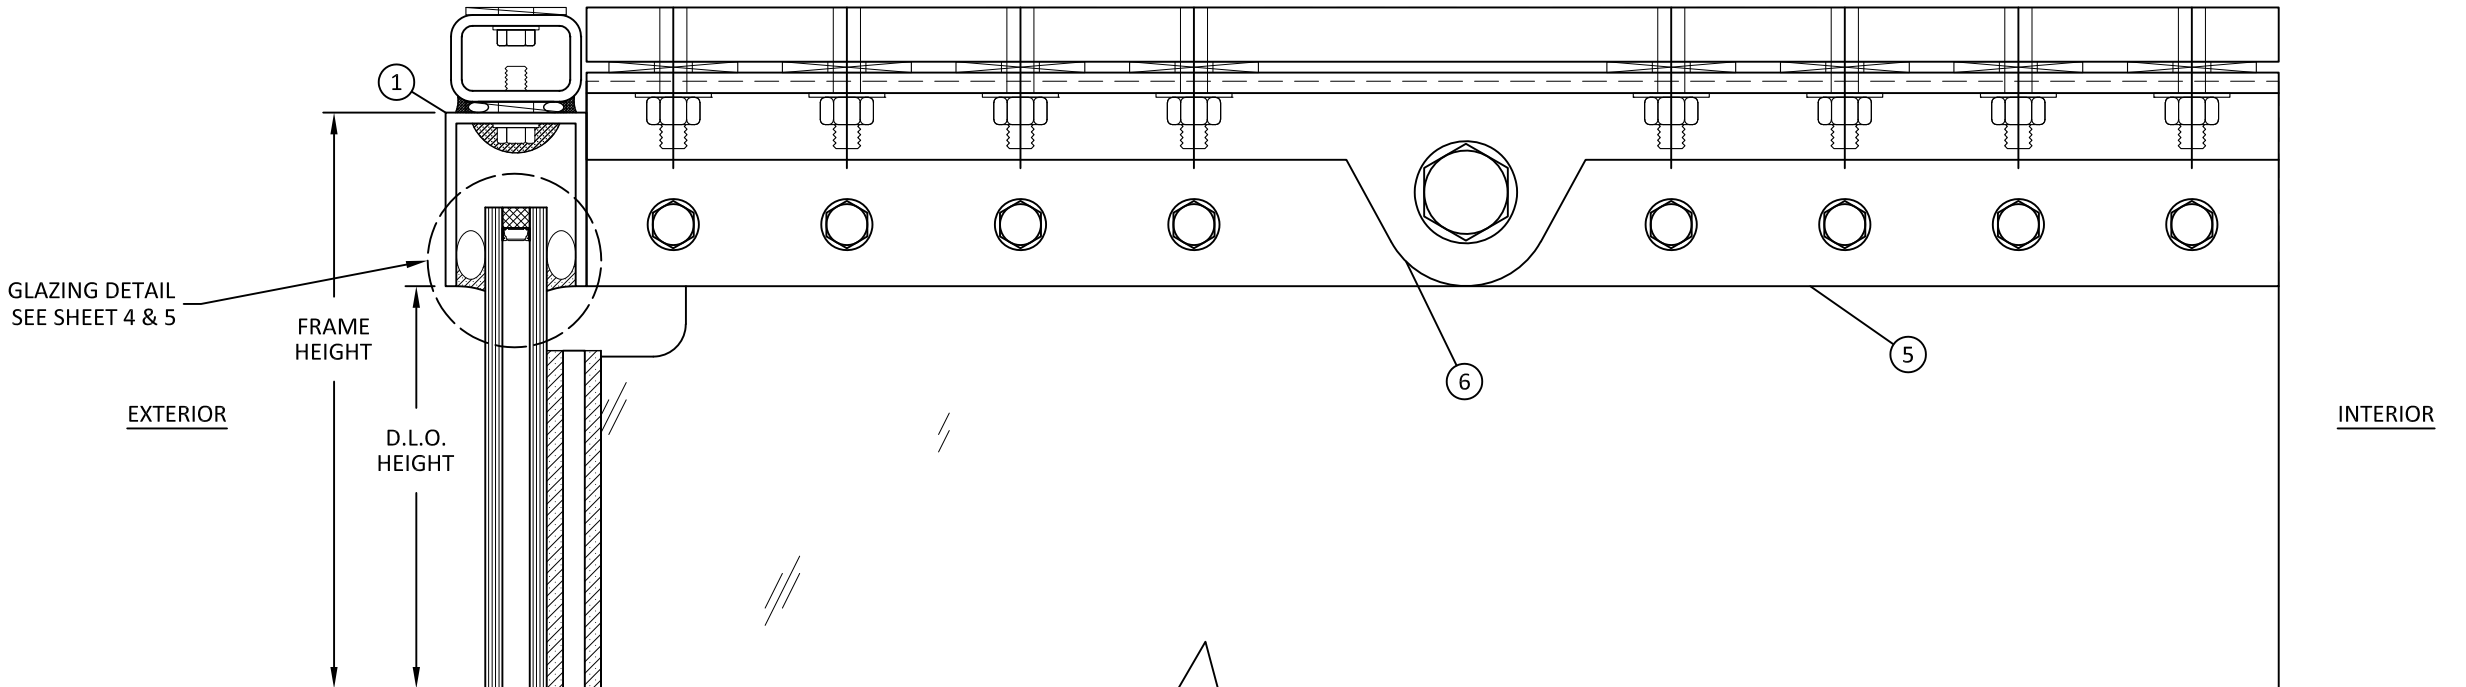

A
7 VERTICAL SECTION
HEAD AT GLASS FIN

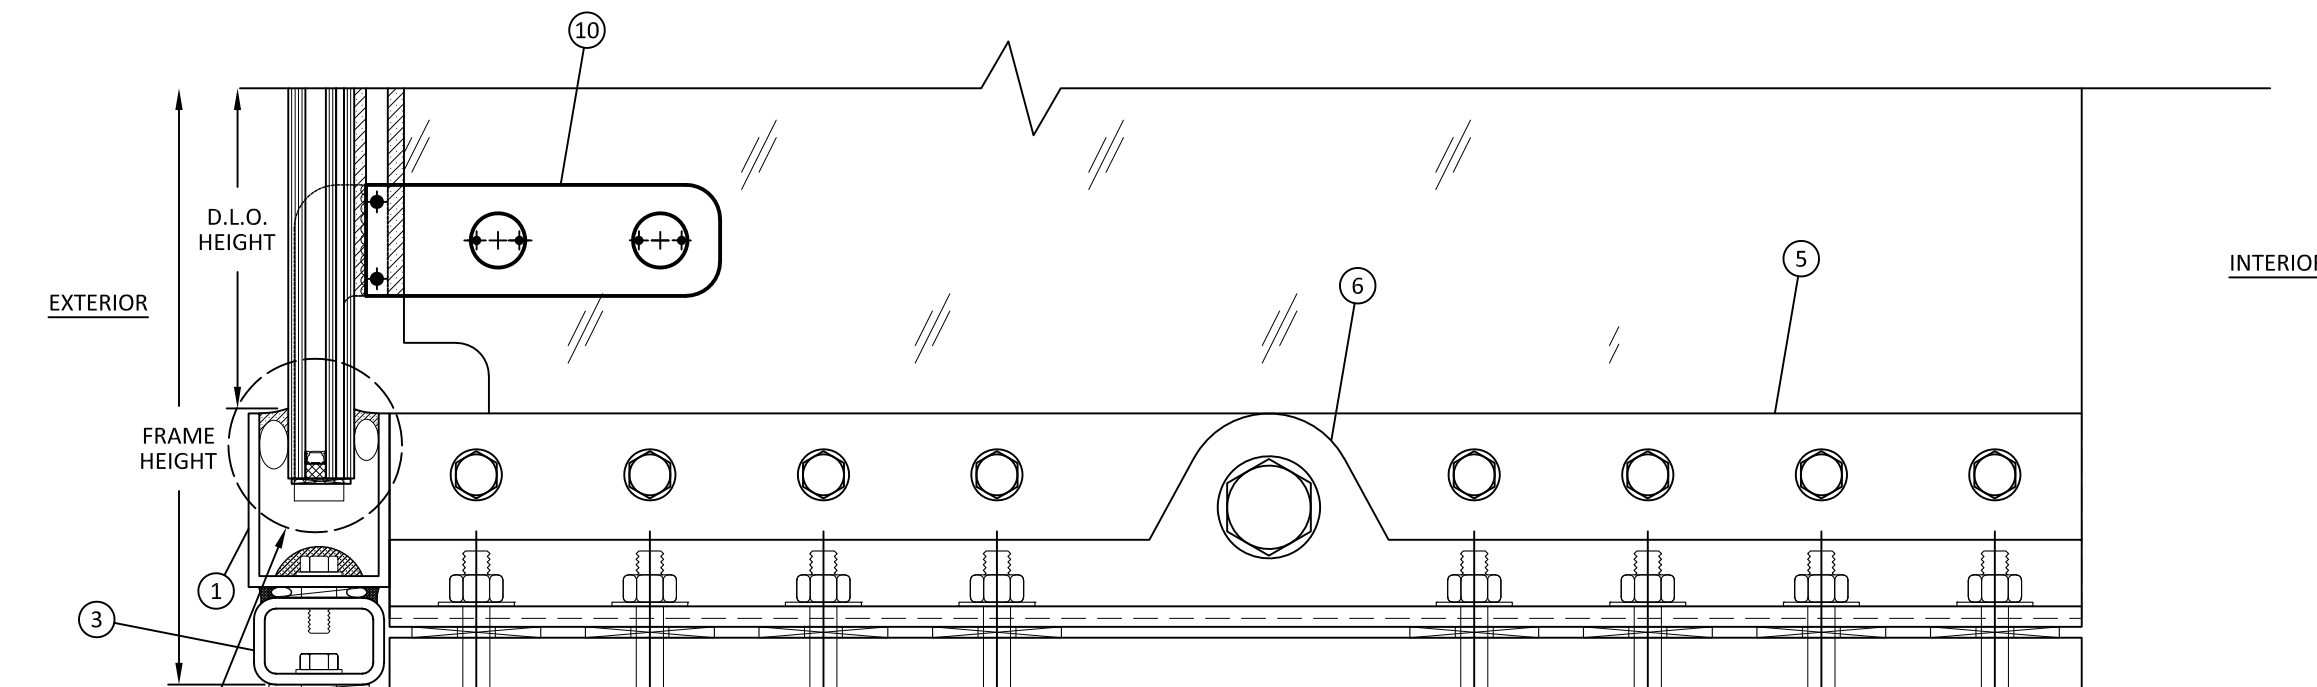

B
7 VERTICAL SECTION
SILL



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954


TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (554)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

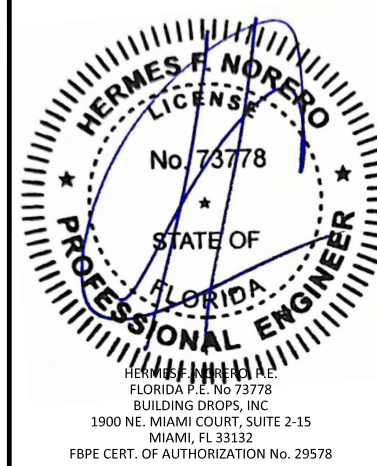

FL #: **FL42023**

DATE: **2023.11.21**


DWG. BY: **DI** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WWG002**

SHEET: **7**

OF 14

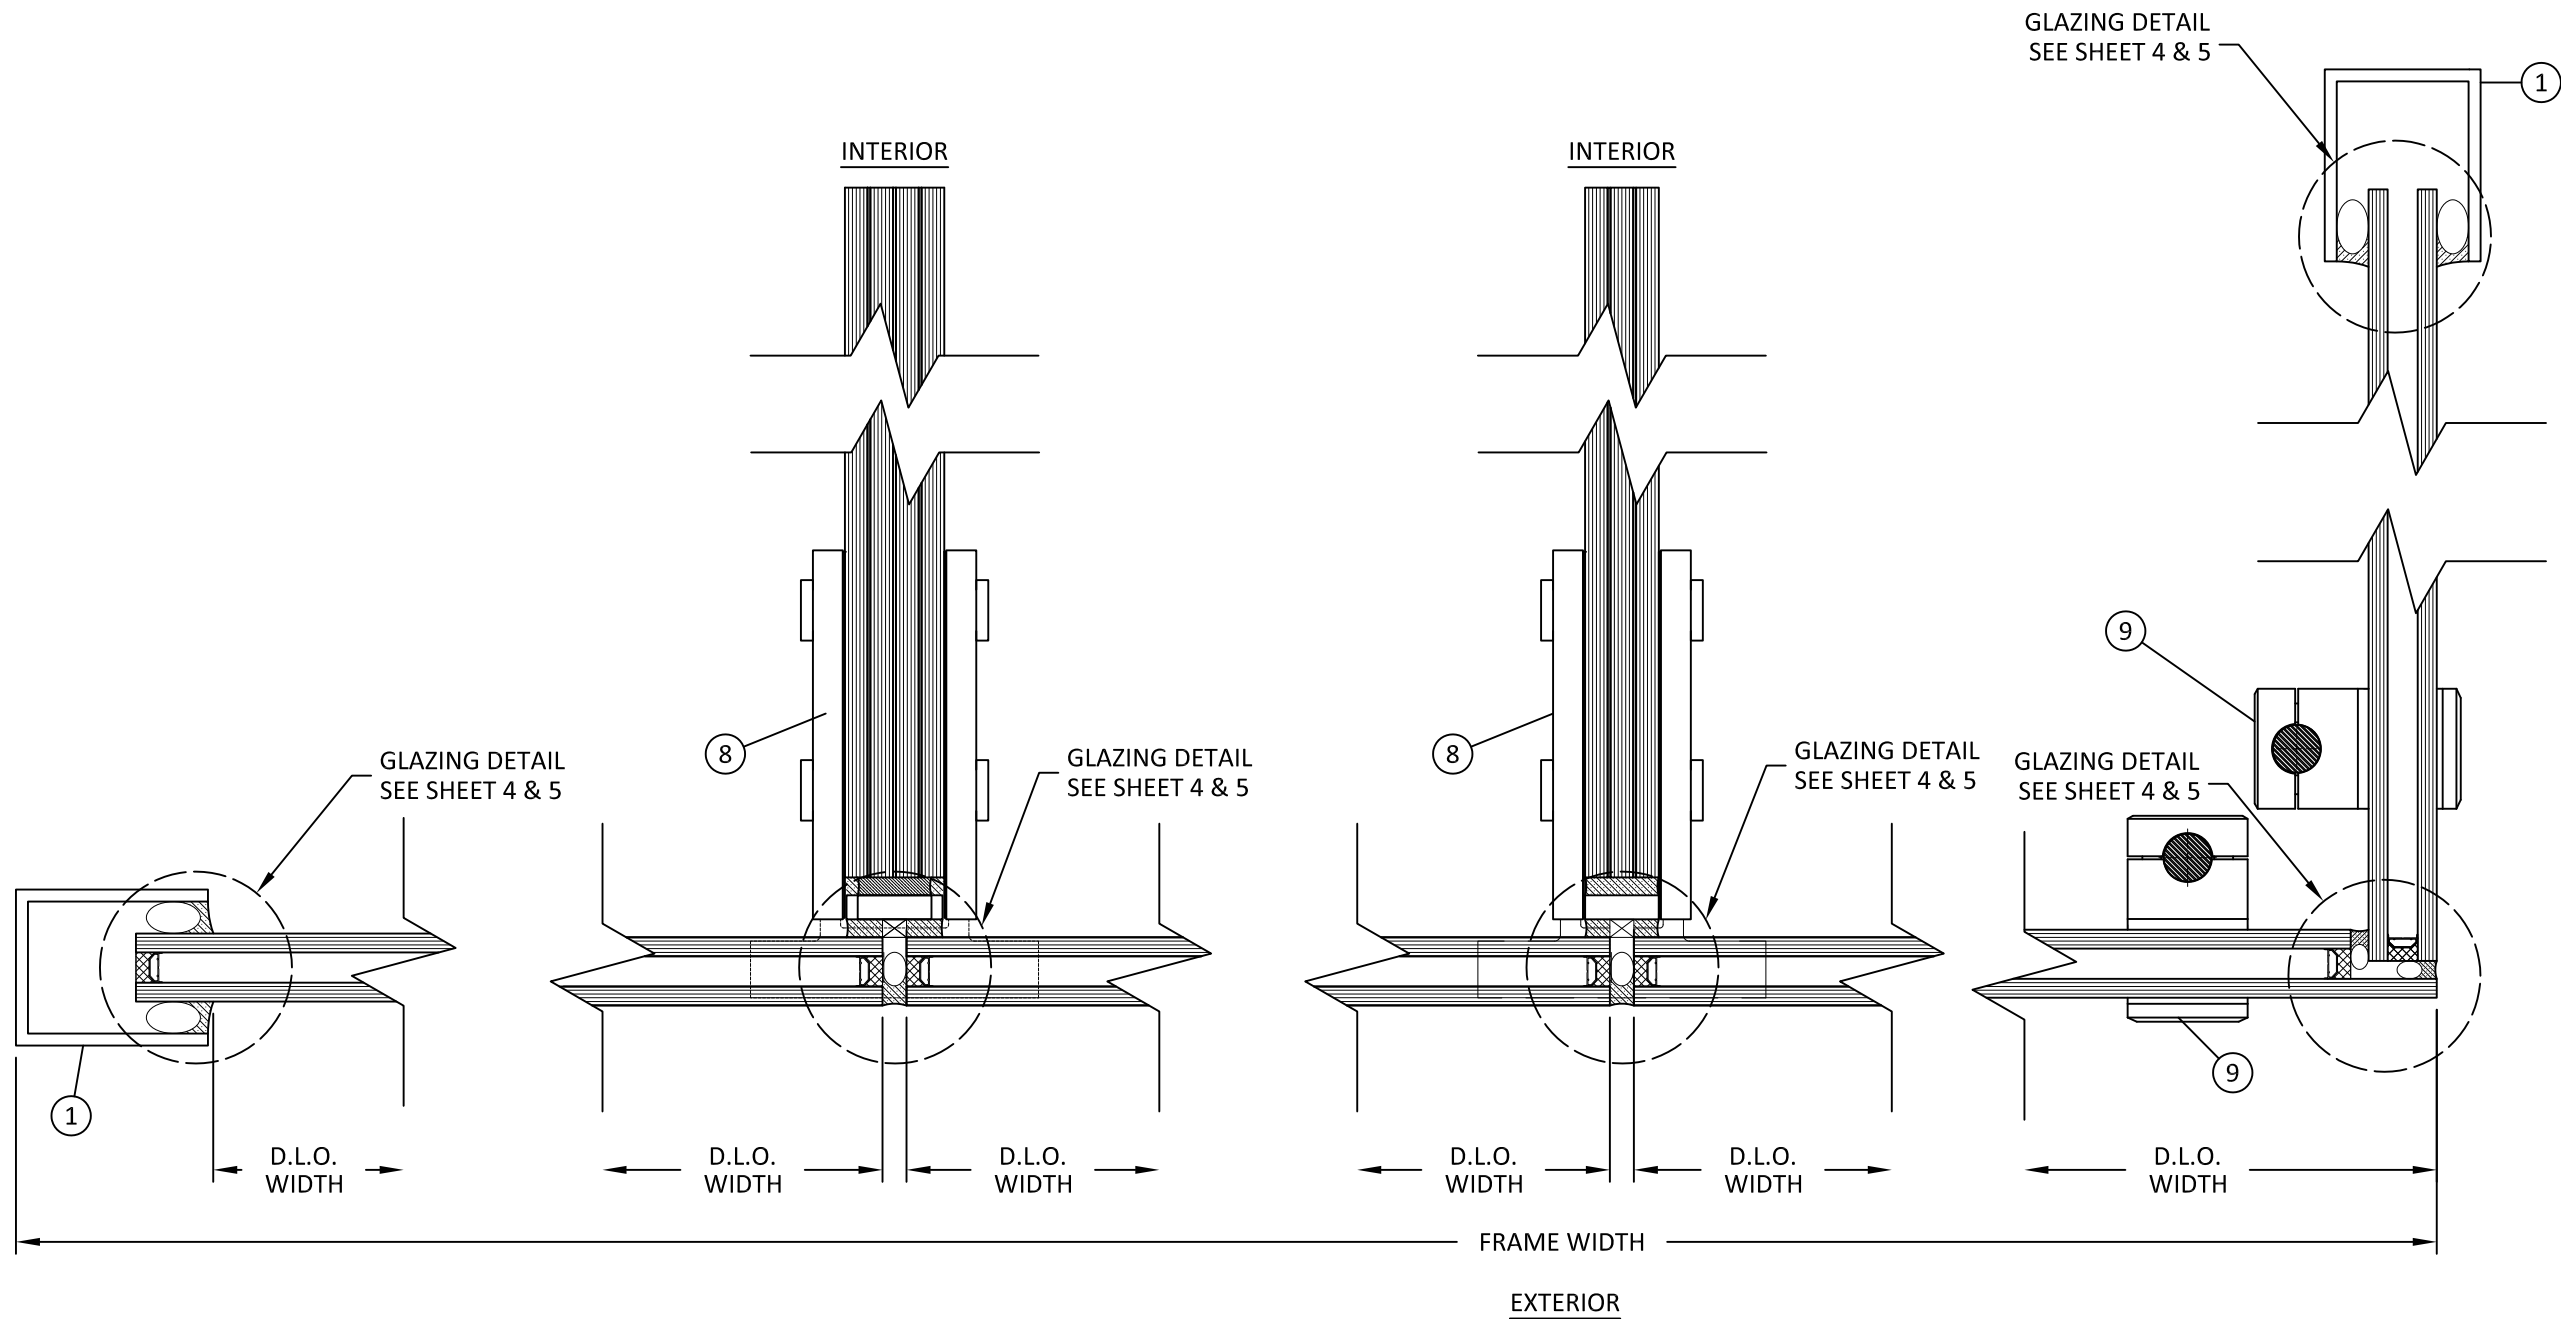

E HORIZONTAL SECTION
8 JAMB

F HORIZONTAL SECTION
8 GLASS FIN W/ DEADLOAD SHELF

G HORIZONTAL SECTION
8 GLASS FIN W/ DEADLOAD SHELF

H HORIZONTAL SECTION
8 CORNER



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954


TITLE: W & W GLASS FIN SYSTEM (NON-HVHZ) (NON-IMPACT)
HORIZONTAL SECTIONS
PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: FL42023
DATE: 2023.11.21
DWG. BY: DI
CHK. BY: HFN
SCALE: NTS
DWG. #: WWG002
SHEET: 8

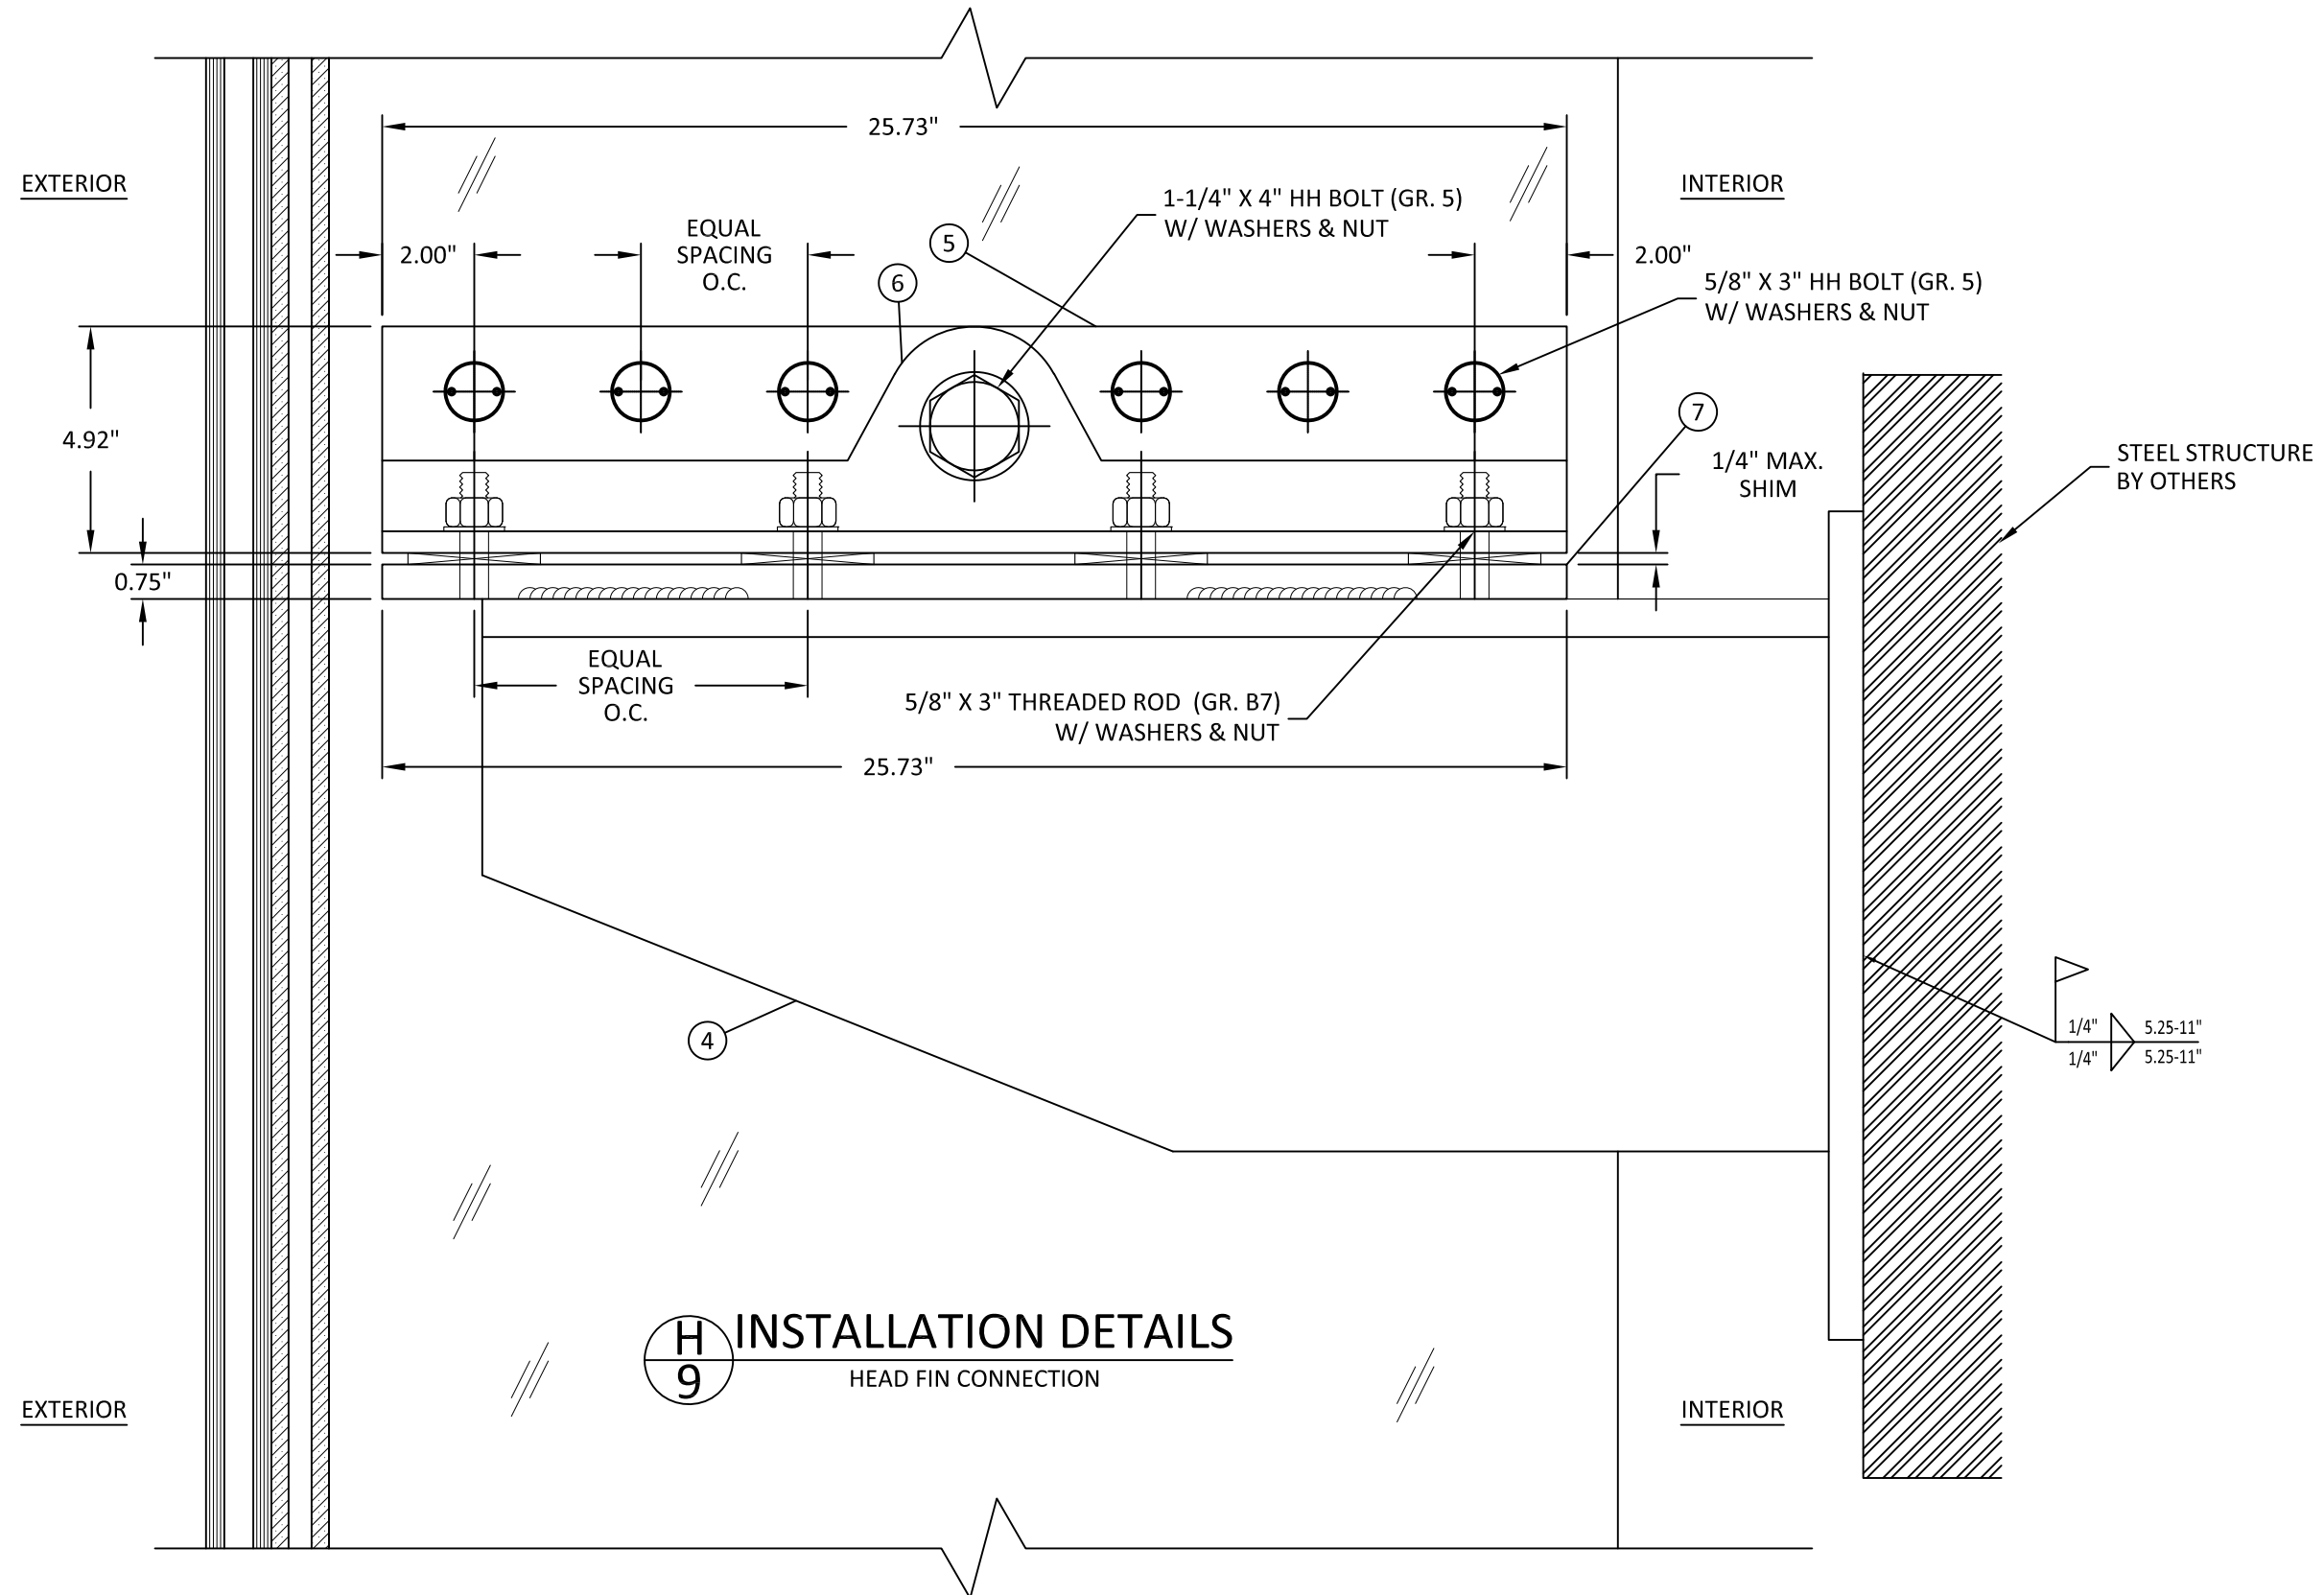

H
9

INSTALLATION DETAILS
HEAD FIN CONNECTION



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)


INSTALLATION DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

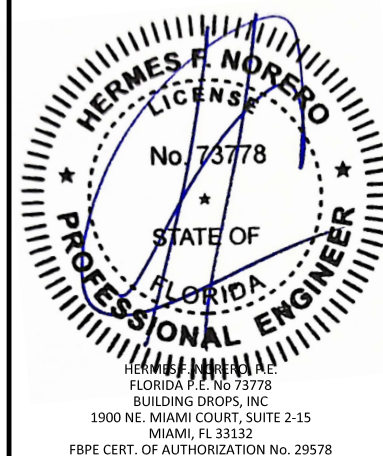

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL42023**


DATE: **2023.11.21**

DWG. BY: **DI** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWG002**

SHEET:
9

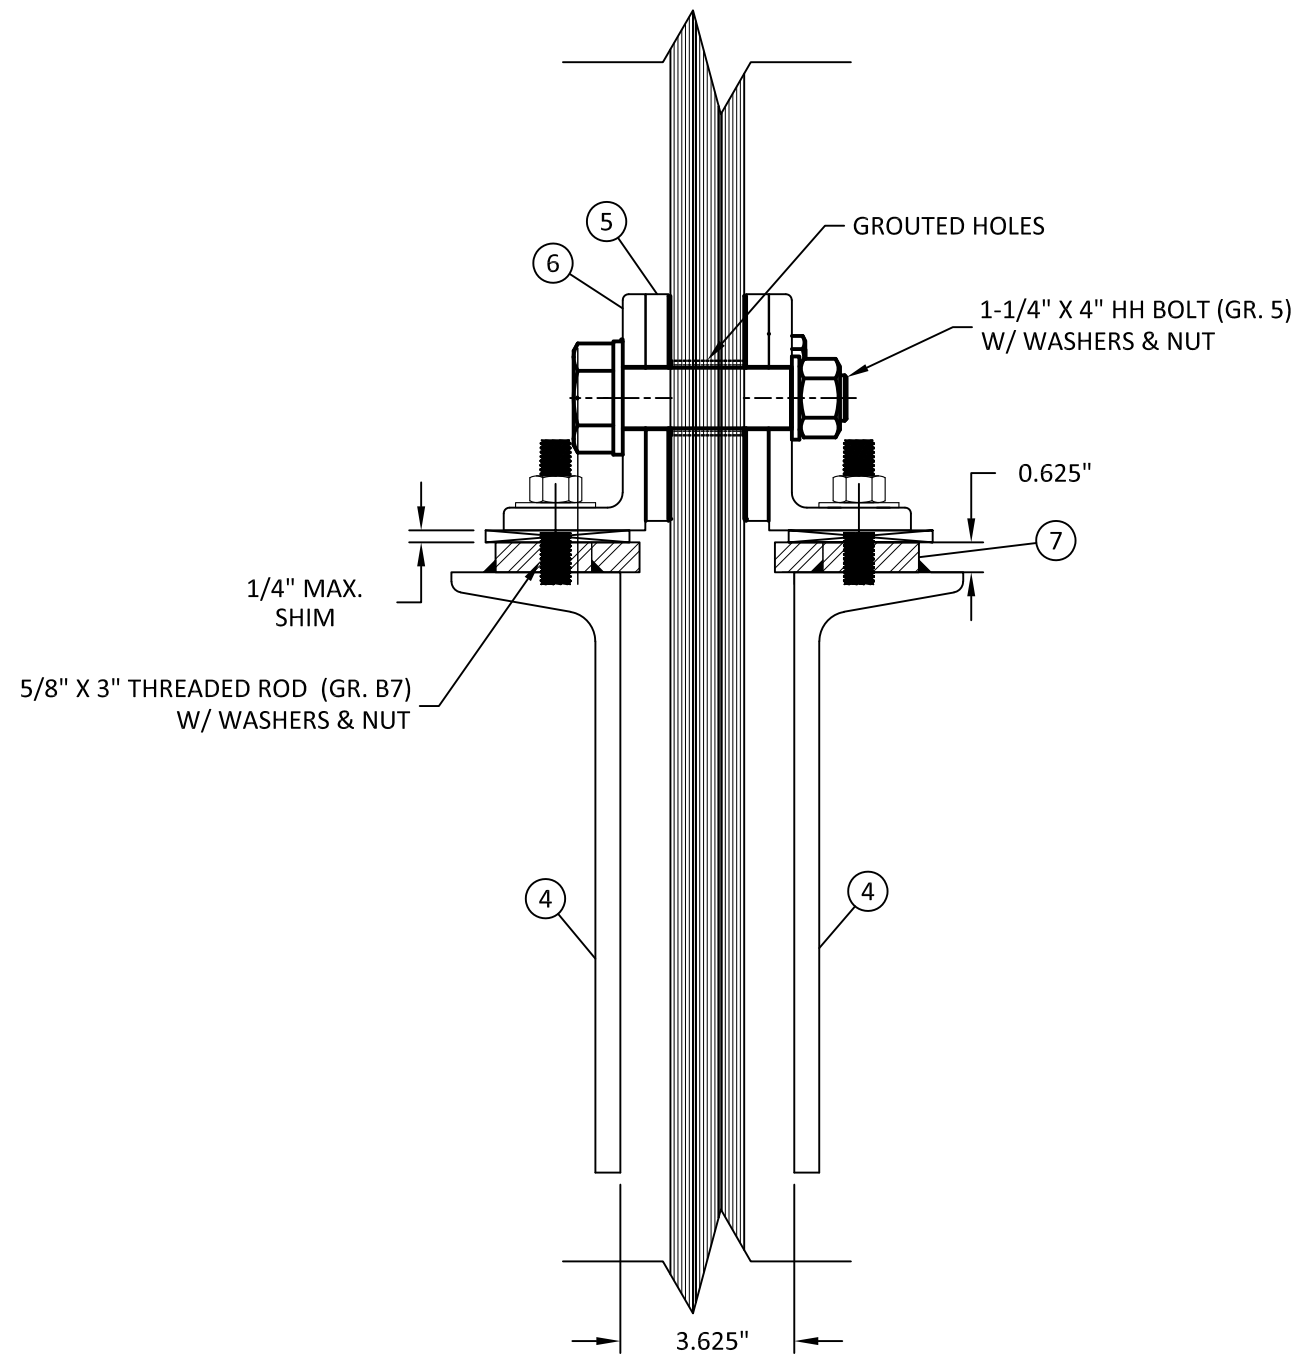

I
10 **INSTALLATION DETAILS**
HEAD FIN CONNECTION
VERTICAL SECTION AT M32 SHOULDER BOLT

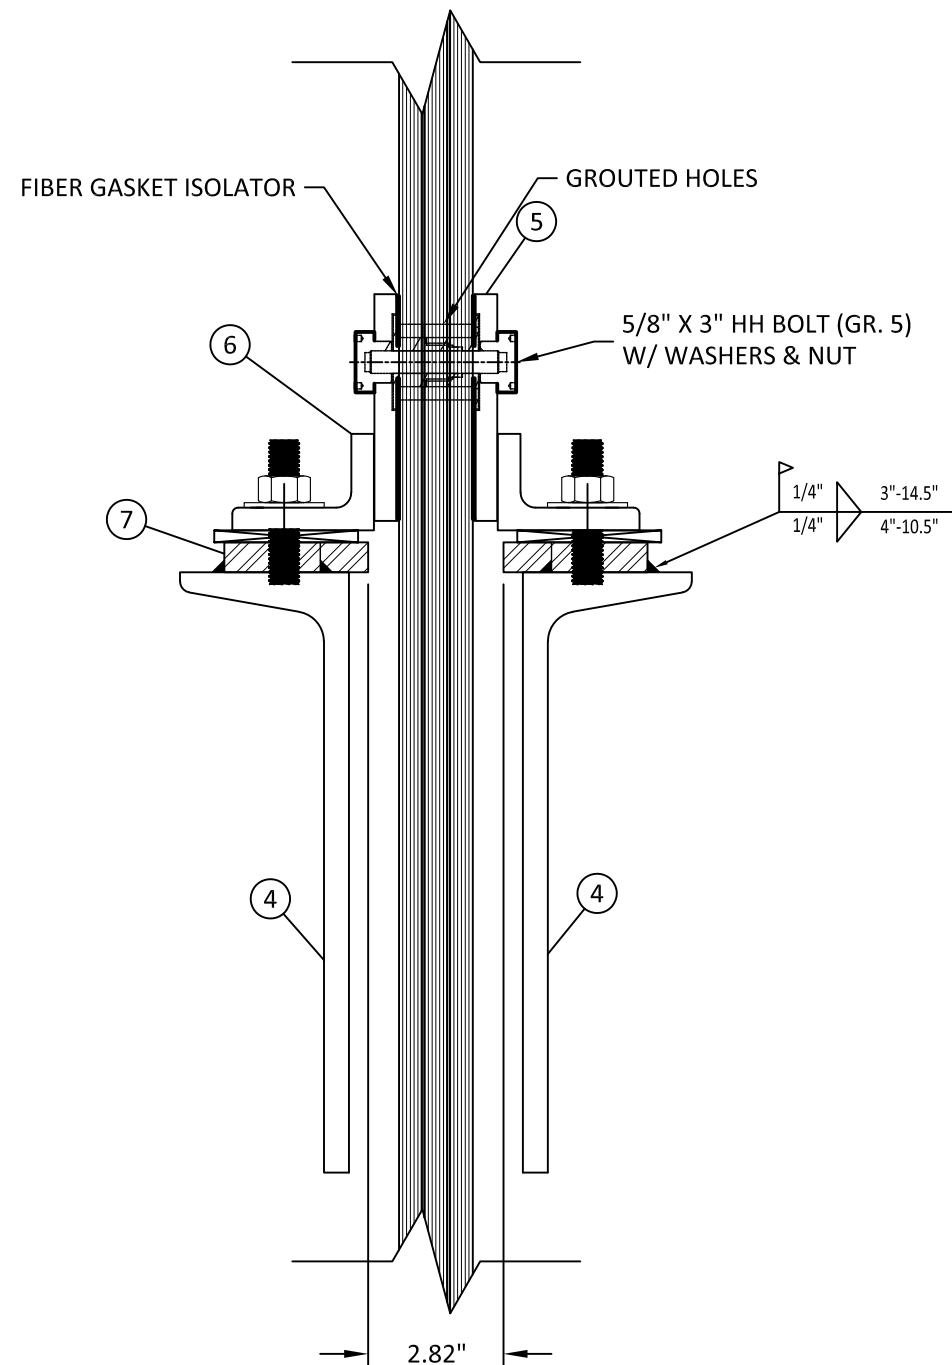

J
10 **INSTALLATION DETAILS**
HEAD FIN CONNECTION
VERTICAL SECTION AT M16 BOLTS




W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE: W & W GLASS FIN SYSTEM (NON-HVHZ) (NON-IMPACT)	INSTALLATION DETAILS	
	PREPARED BY:	BUILDING DROPS, INC. 1900 NE MIAMI COURT, SUITE 2-15 MIAMI, FL 33132 PH: (954)399-8478 FAX: (954)744-4738 WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

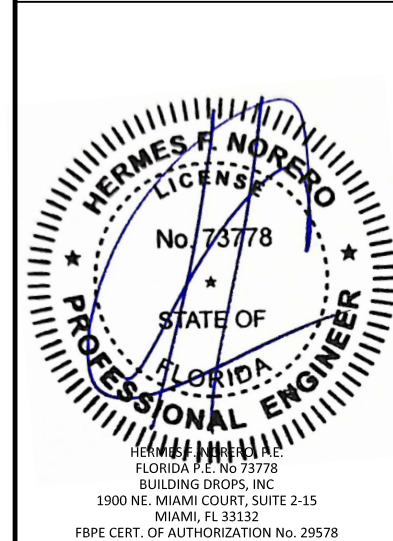

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002

SHEET:
10
OF 14



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954


TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

INSTALLATION DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

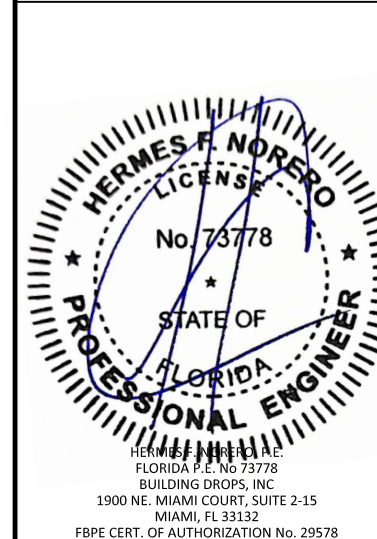

FL #: **FL42023**

DATE: **2023.11.21**

DWG. BY: **DI** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWG002**


SHEET:

11


OF 14

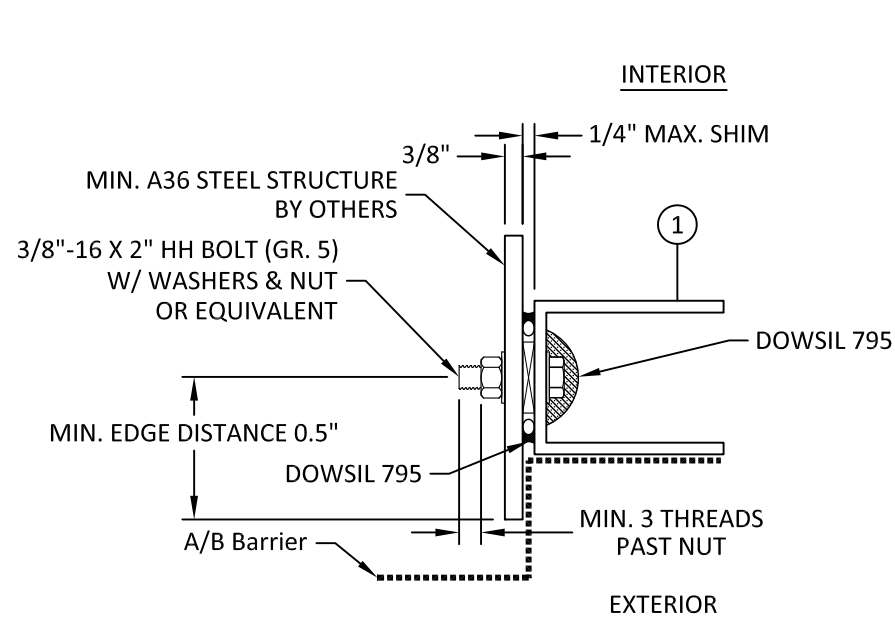


K
11 INSTALLATION DETAILS
JAMB

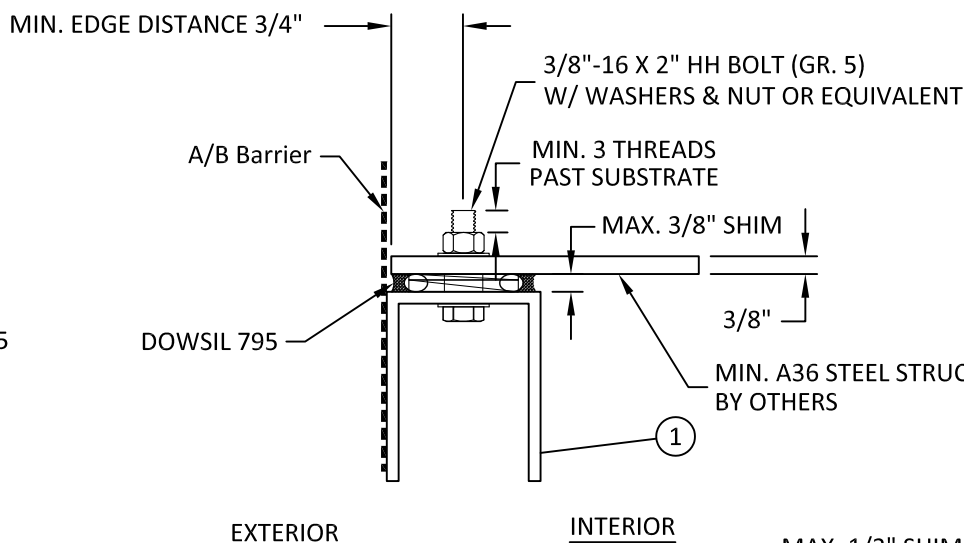

L
11 INSTALLATION DETAILS
HEAD

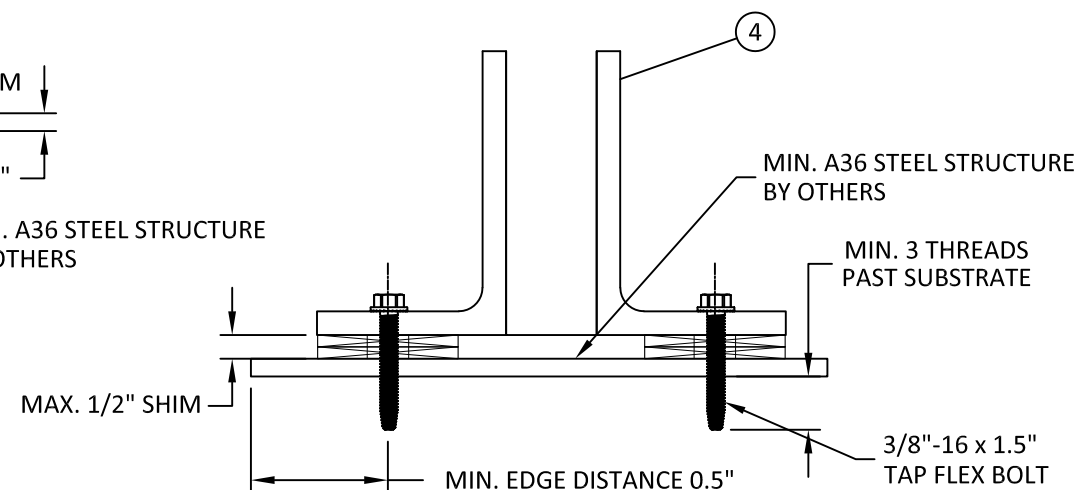

M
11 INSTALLATION DETAILS
FIN - SILL

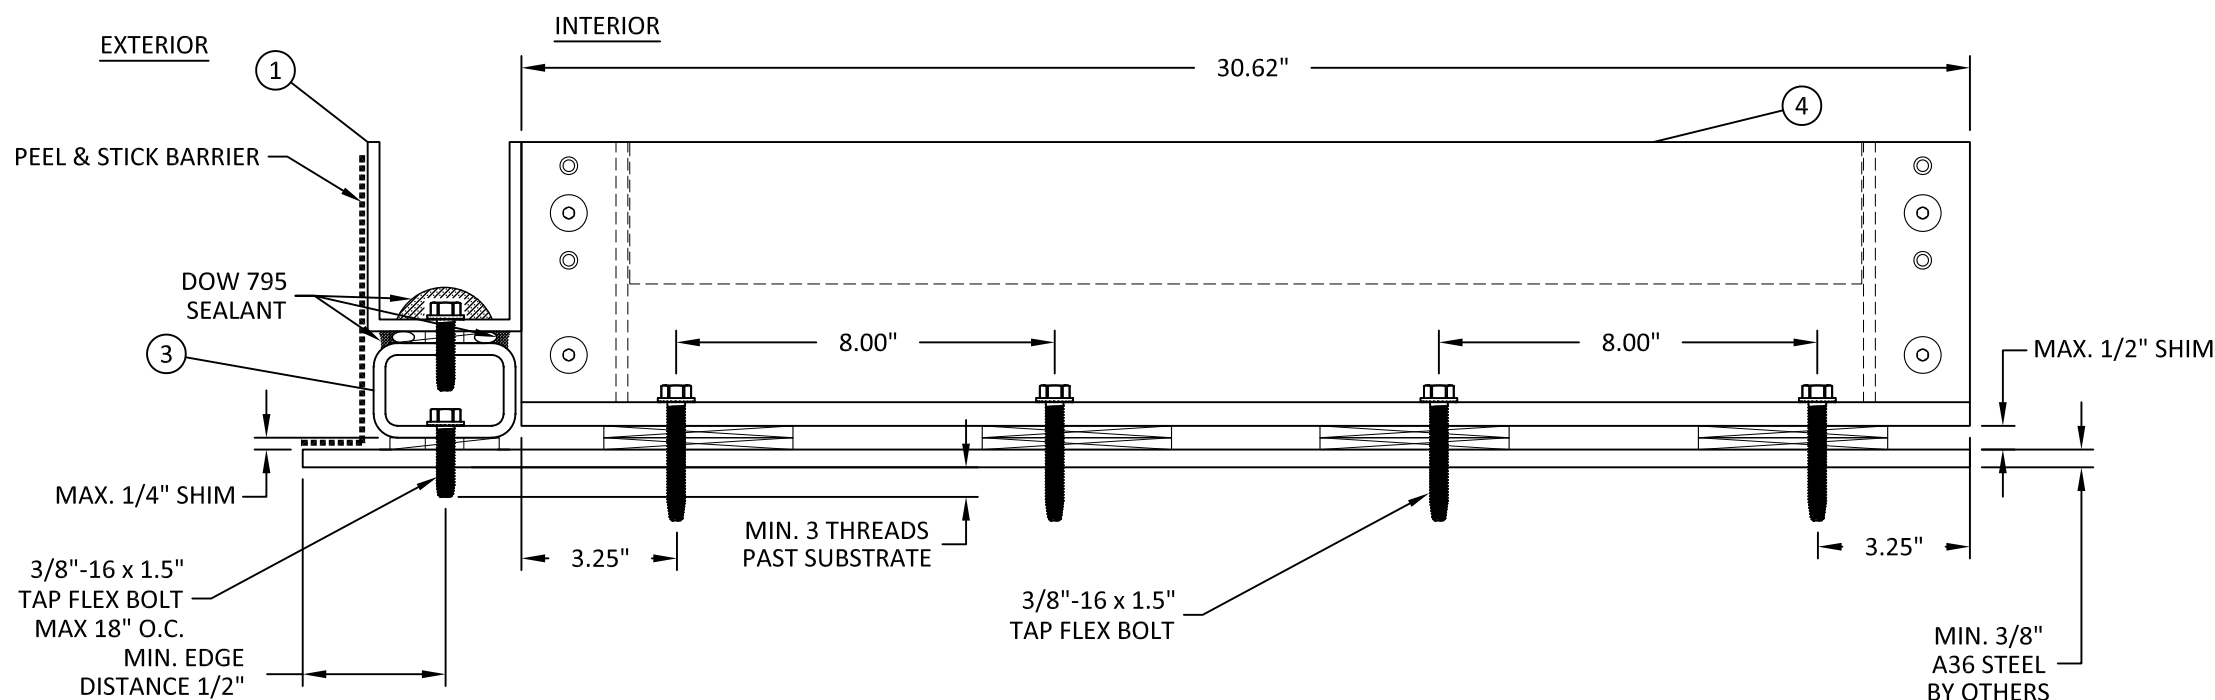

N
11 INSTALLATION DETAILS
SILL



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)


INSTALLATION DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

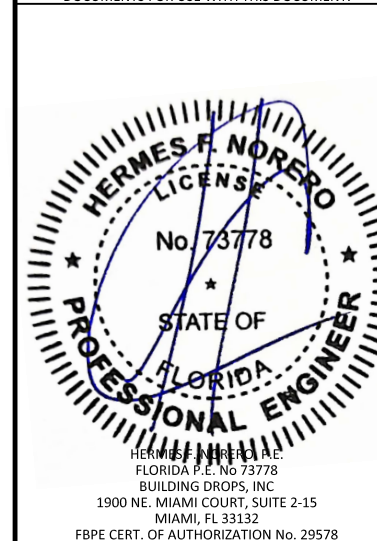

FL #: **FL42023**


DATE: **2023.11.21**

DWG. BY: **DI** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **WWG002**


SHEET:

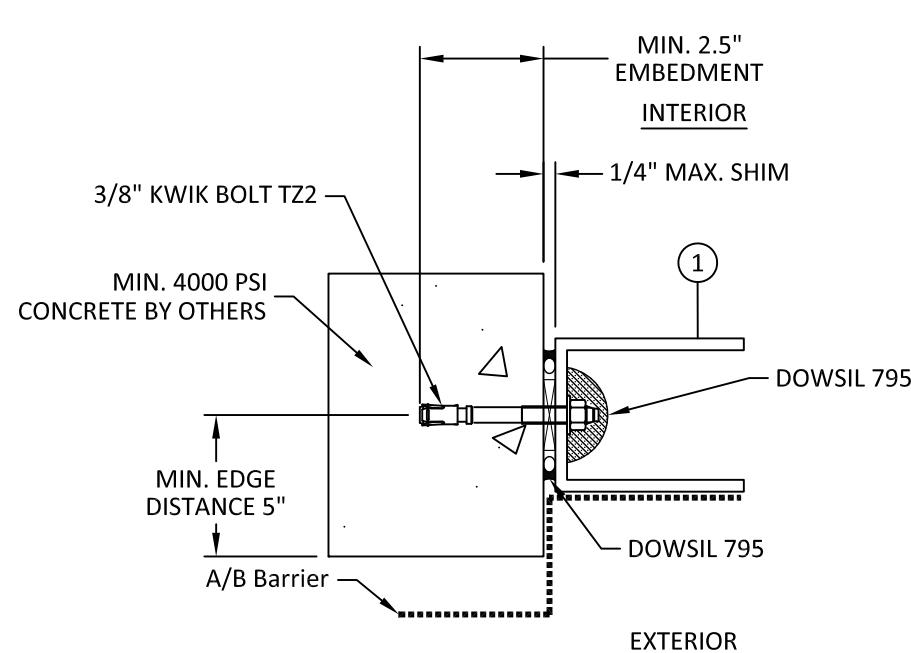


K INSTALLATION DETAILS
12 JAMB

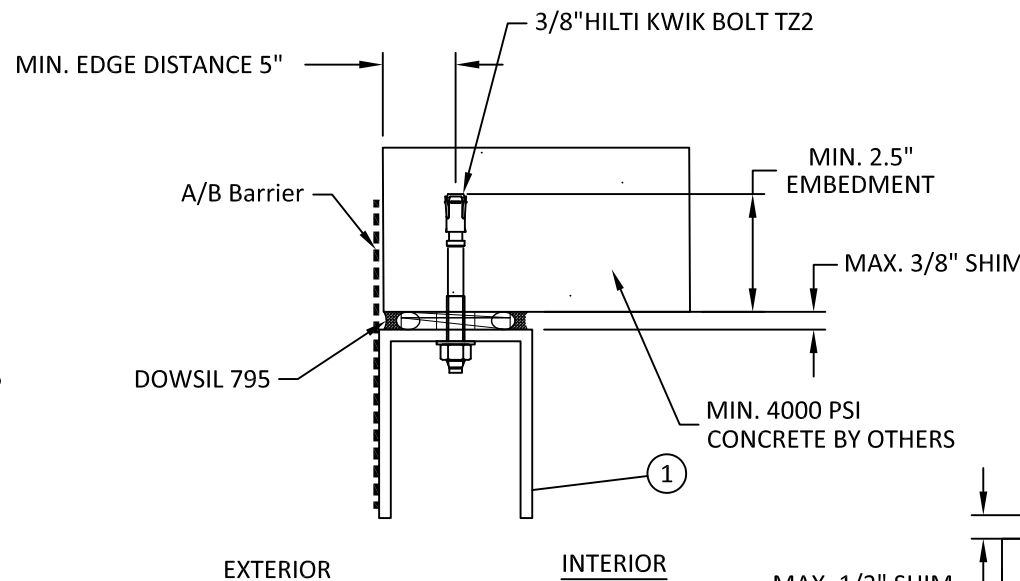

L INSTALLATION DETAILS
12 HEAD

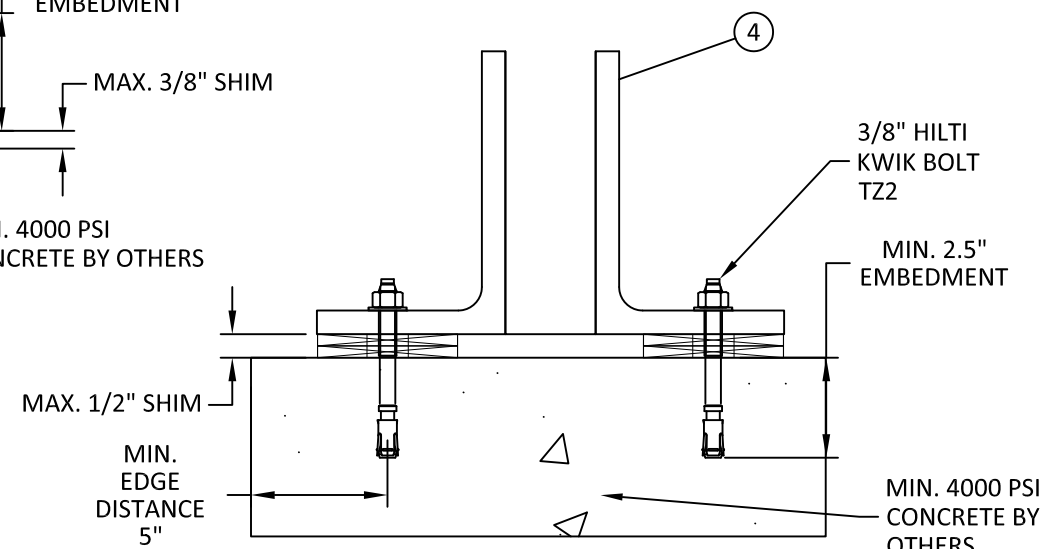

M INSTALLATION DETAILS
12 FIN - SILL

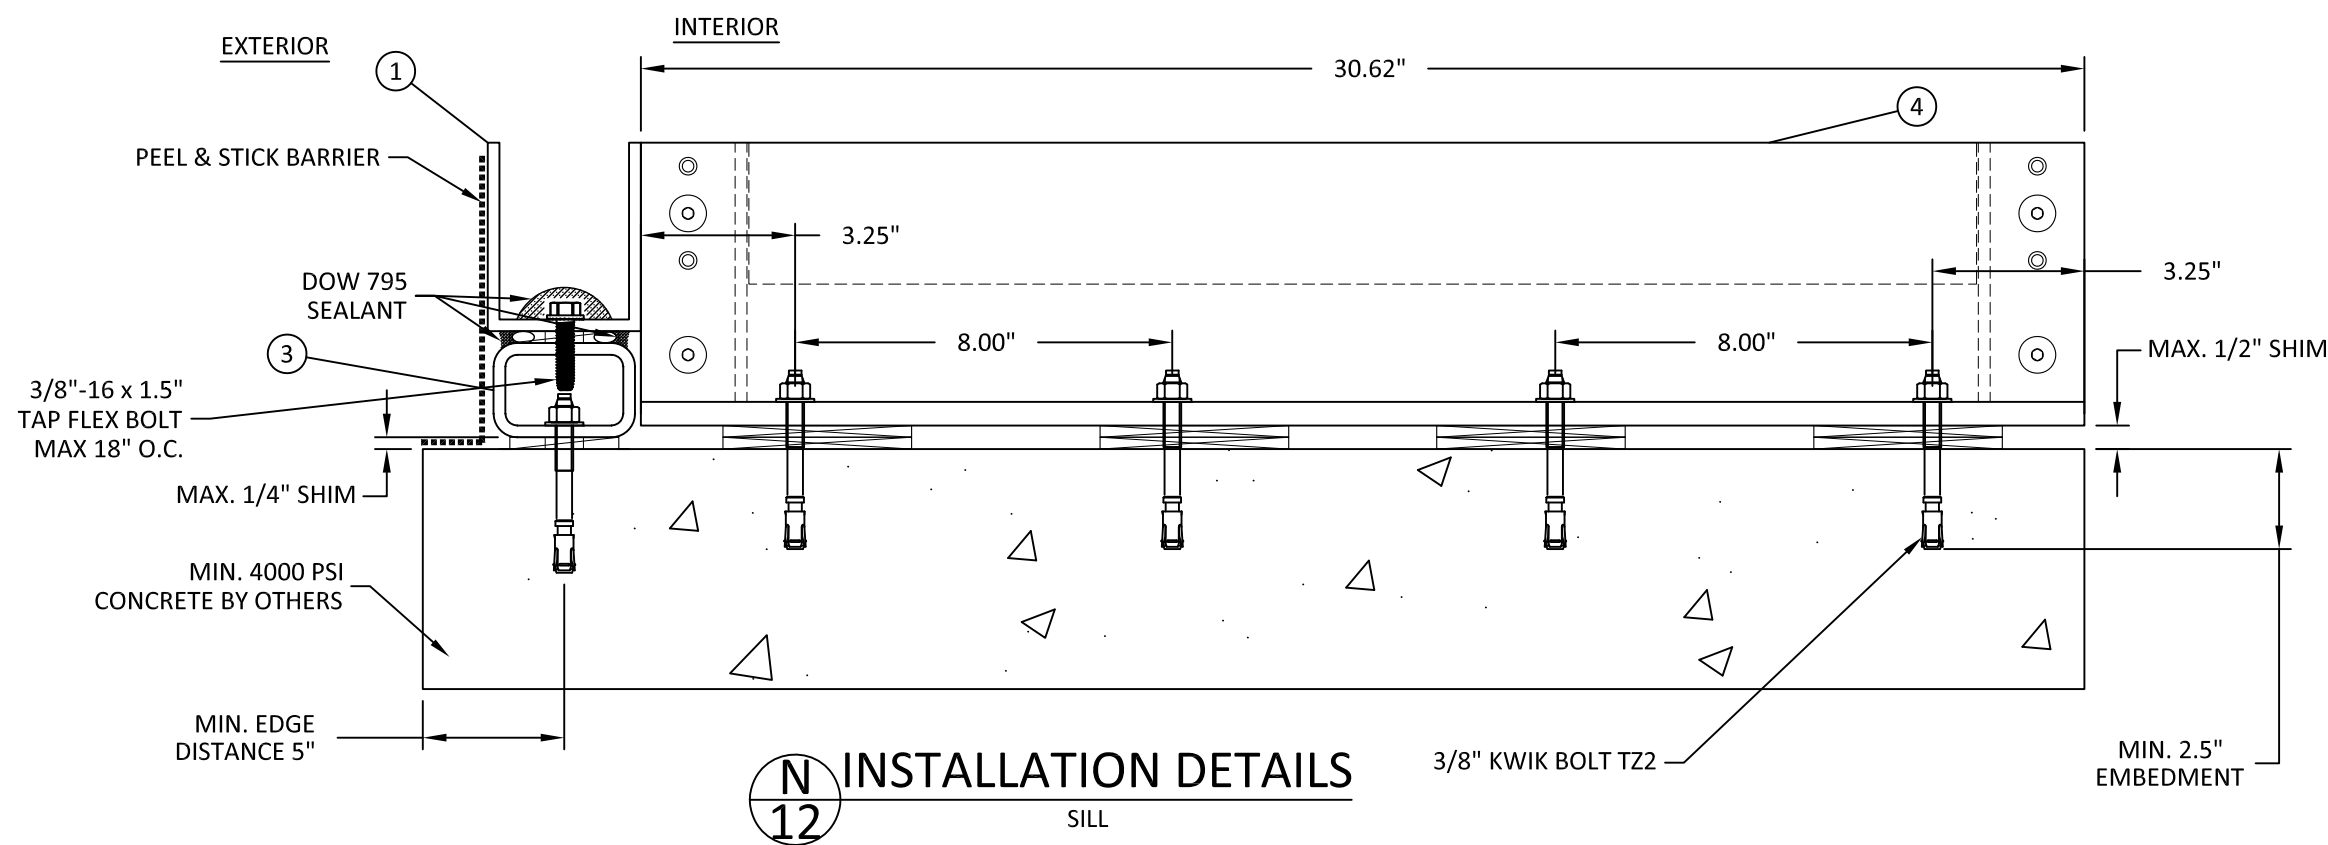

N INSTALLATION DETAILS
12 SILL



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

INSTALLATION DETAILS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

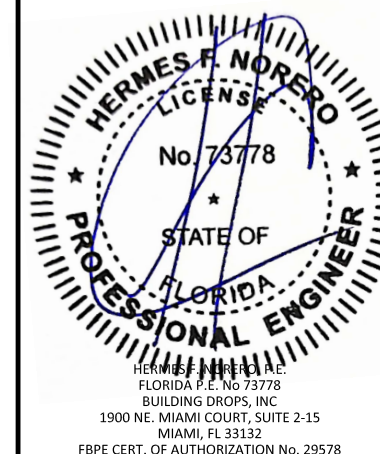

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	13

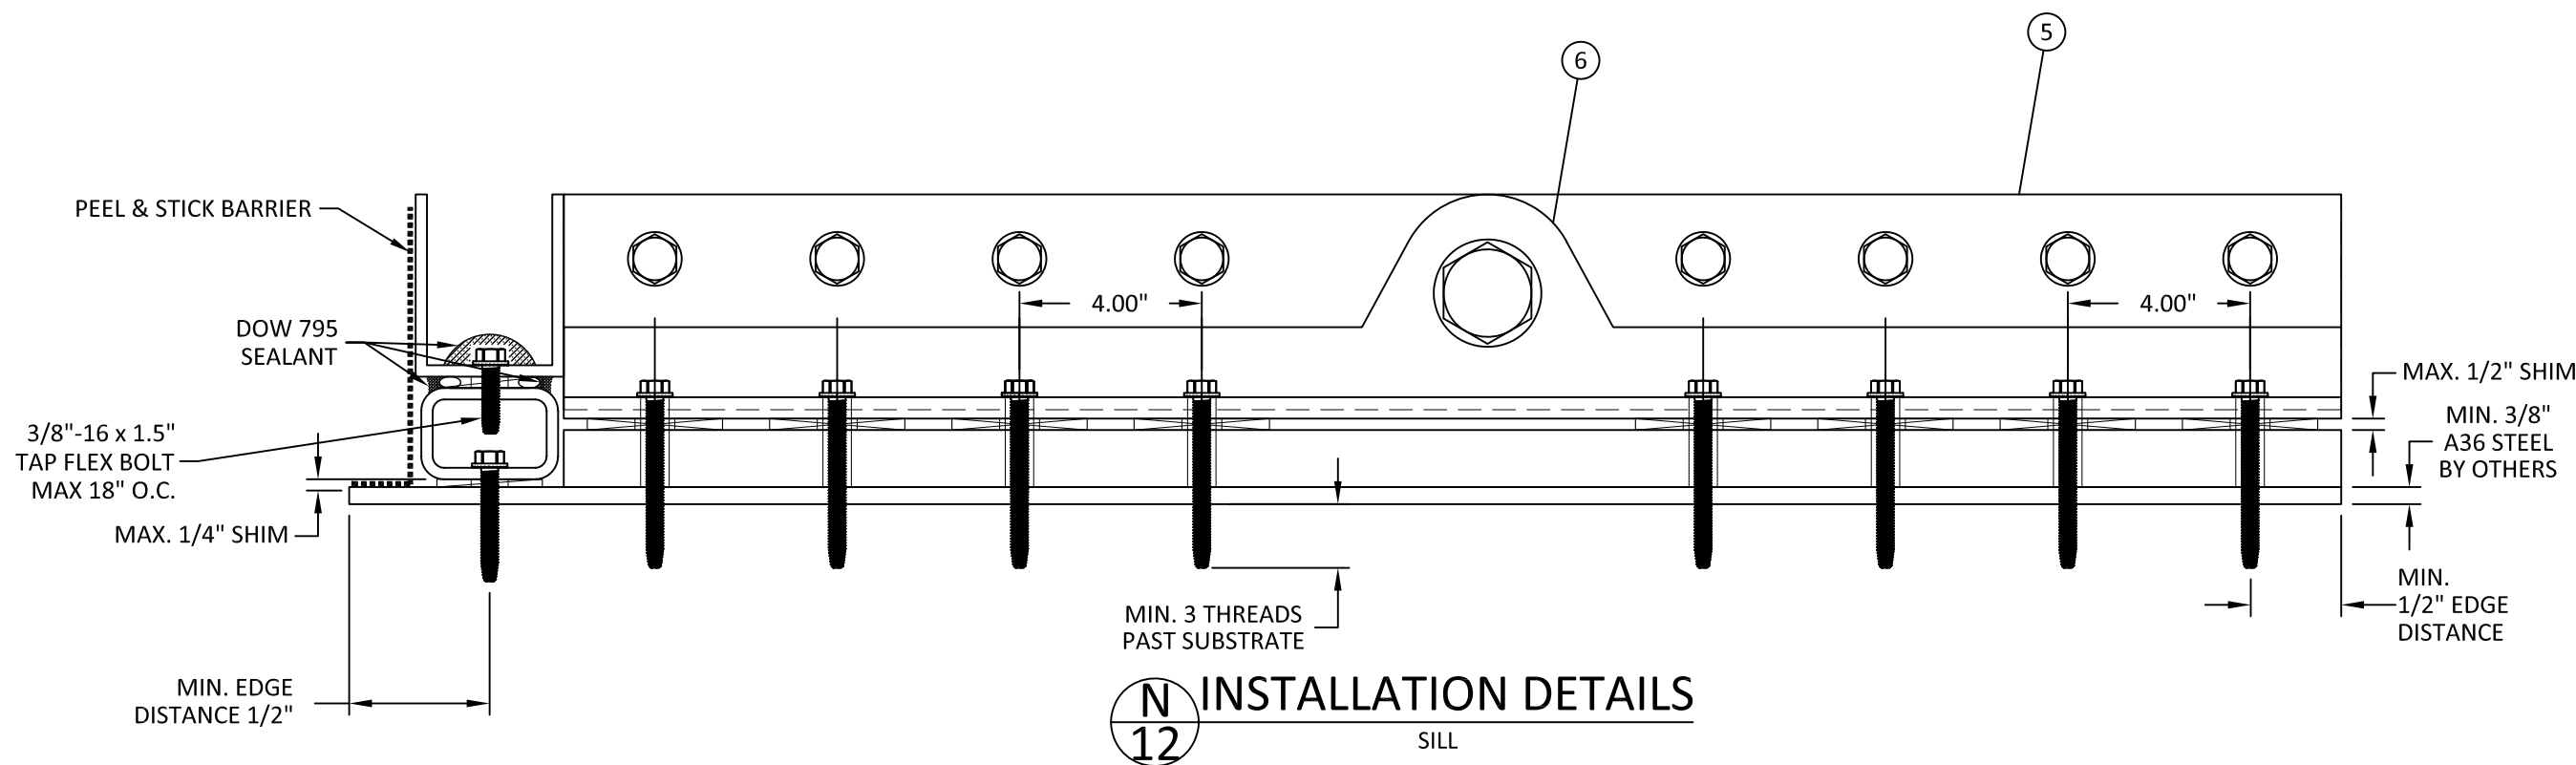


NOTE: SILL SHOWN, HEAD SIMILAR

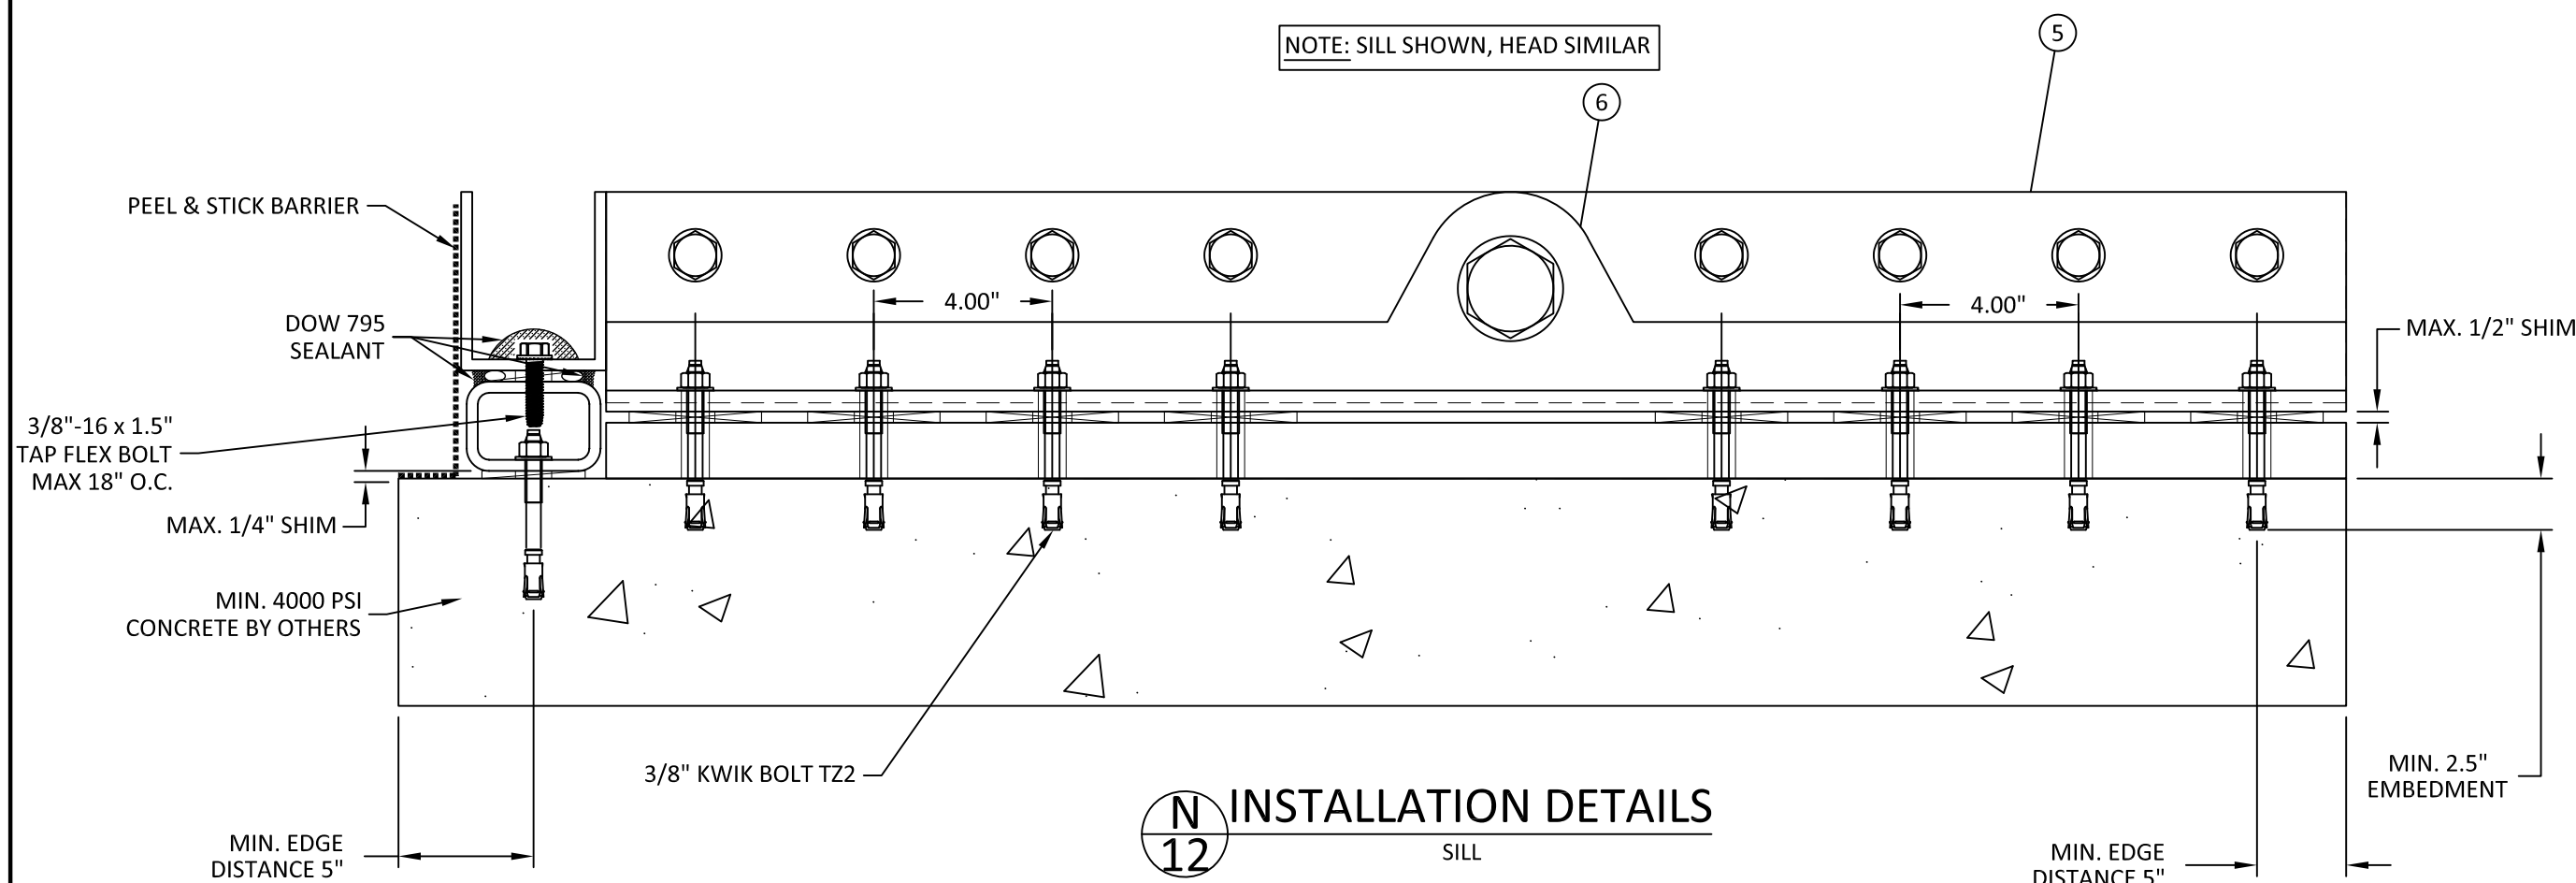


BILL OF MATERIALS		
NO.	DESCRIPTION	MATERIAL
1	GLAZING CHANNEL	ALUM. 6063-T5
2	FIN SILL	ALUM. 6063-T5
3	3" X 2" X 1/4" HSS	A-36 MIN. STEEL
4	FIN PIN JOINT ANGLE	STEEL
5	FIN PIN JOINT PLATE	STEEL
6	FIN PIN JOINT ANGLE	STEEL
7	STARTER PLATE	STEEL
8	DEAD LOAD SHELF	ALUM. 6063-T5
9	CORNER DEAD LOAD HANGER	ALUM. 6063-T5
10	SILL DEAD LOAD SHELF	ALUM. 6063-T5


1 GLAZING CHANNEL

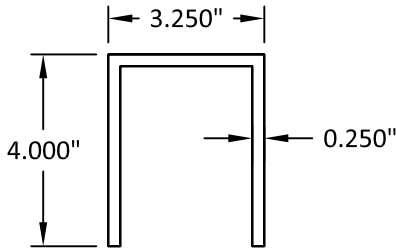



2 FIN SILL

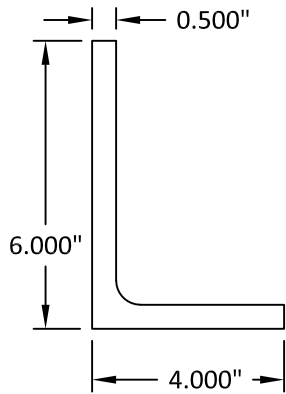


3 3" x 2" x 1/4" HSS

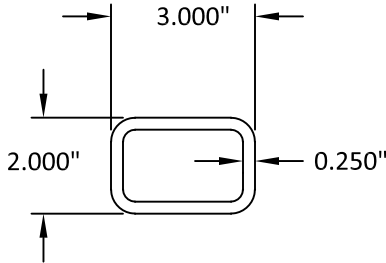


6 FIN PIN JOINT ANGLE

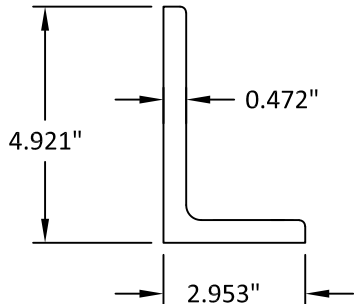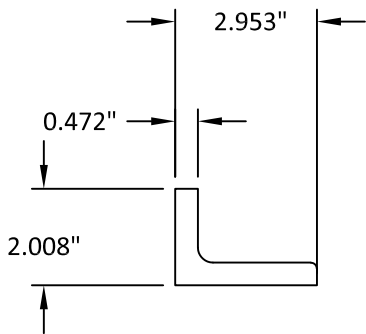


4 FIN PIN JOINT ANGLE

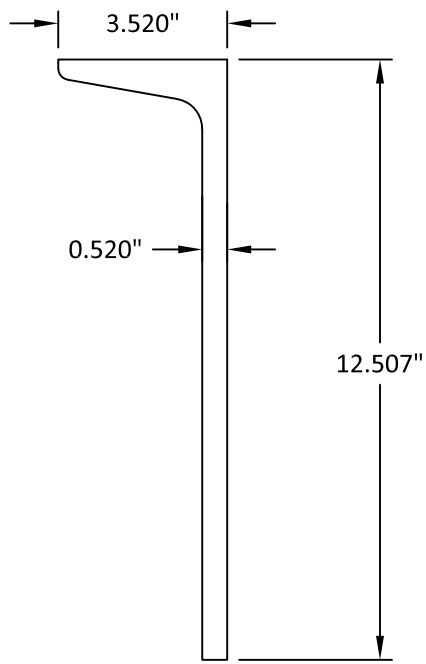

5 FIN PIN JOINT PLATE



8 STARTER PLATE
FIN PIN JOINT SELECTION

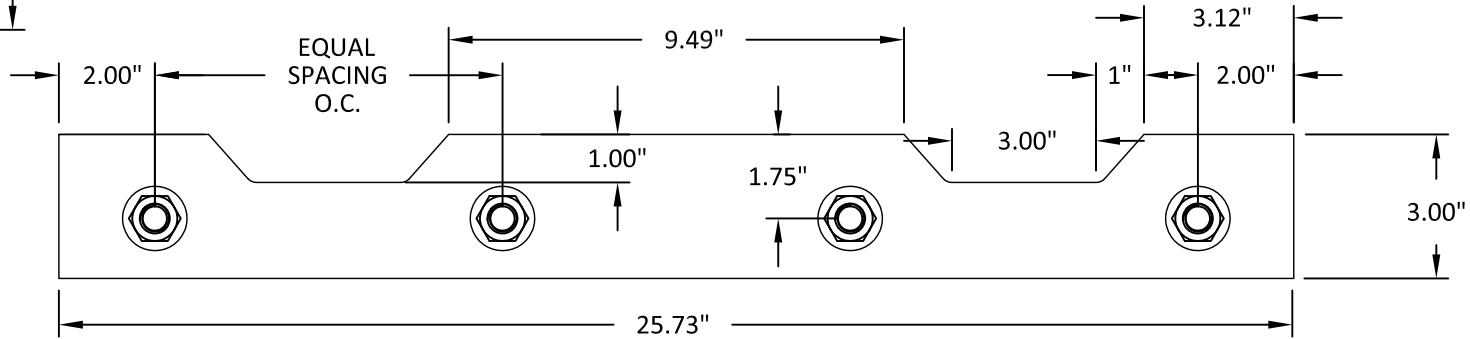

W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)


BILL OF MATERIALS & COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

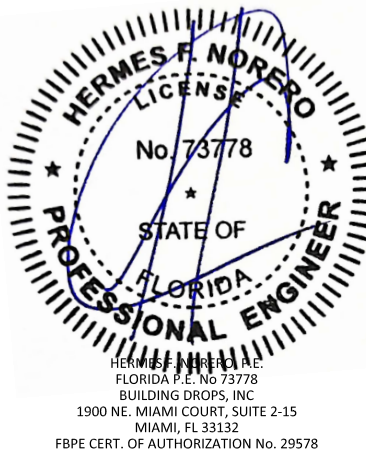

FL #: **FL42023**

DATE: **2023.11.21**

DWG. BY: **DI** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WWG002**

SHEET: **14** OF 14