

W & W GLASS, LLC

W & W GLASS FIN SYSTEM

(NON-HVHZ) (NON-IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) **EXCLUDING** HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA 501-24
 - ASTM E283-19
 - ASTM E330-14
 - ASTM E331-00(23)
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. FRAME MATERIAL: ALUMINUM 6063-T5
7. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 4 & 5 FOR GLAZING DETAILS.

INSTALLATION NOTES:

1. SEE SHEETS 9-13 FOR ANCHOR TYPE REQUIREMENTS, MINIMUM EMBEDMENTS, AND MINIMUM EDGE DISTANCES. ALL ANCHOR REQUIREMENTS MUST BE ADHERED TO. ANY DEVIATIONS FROM ANCHOR REQUIREMENTS REQUIRES SEPARATE EVALUATION AND APPROVAL.
2. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
3. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK IS SHOWN ON INSTALLATION DETAILS PAGE 9-13. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, INSTALLATION NOTES, & DESIGN PRESSURE TABLE
2	ELEVATION & ANCHOR LAYOUT
3	ELEVATION & ANCHOR LAYOUT
4	GLAZING DETAILS
5	GLAZING DETAILS
6	VERTICAL SECTIONS
7	VERTICAL SECTIONS
8	HORIZONTAL SECTIONS
9	INSTALLATION DETAILS
10	INSTALLATION DETAILS
11	INSTALLATION DETAILS
12	INSTALLATION DETAILS
13	INSTALLATION DETAILS
14	BILL OF MATERIALS & COMPONENTS

DESIGN PRESSURE	WATER TEST PRESSURE	MISSILE IMPACT RATING
SEE SHEET 2 & 3	15 PSF	NON-IMPACT



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)
GENERAL & INSTALLATION NOTES,
DESIGN PRESSURE TABLE


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.02 10:17:17 -0400

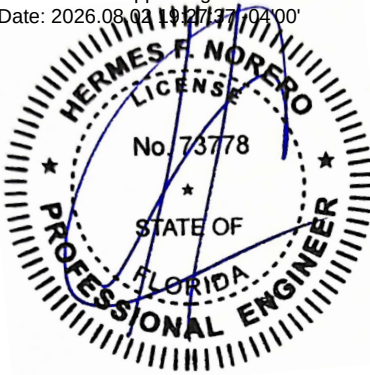

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL42023

DATE:
2023.11.21

DWG. BY:
DI

CHK. BY:
HFN

SCALE:
NTS


DWG. #:
WWG002

SHEET:
1

REV.
A

OF 14

DESIGN PRESSURE TABLE					
FRAME HEIGHT (in)	D.L.O. WIDTH (in)	D.L.O. HEIGHT (in)	CORNER D.L.O. TRIBUTARY WIDTH (in)	CORNER D.L.O. HEIGHT (in)	DESIGN PRESSURE (PSF)
694.75	65.375	157.08	48.8575	157.08	+/- 30

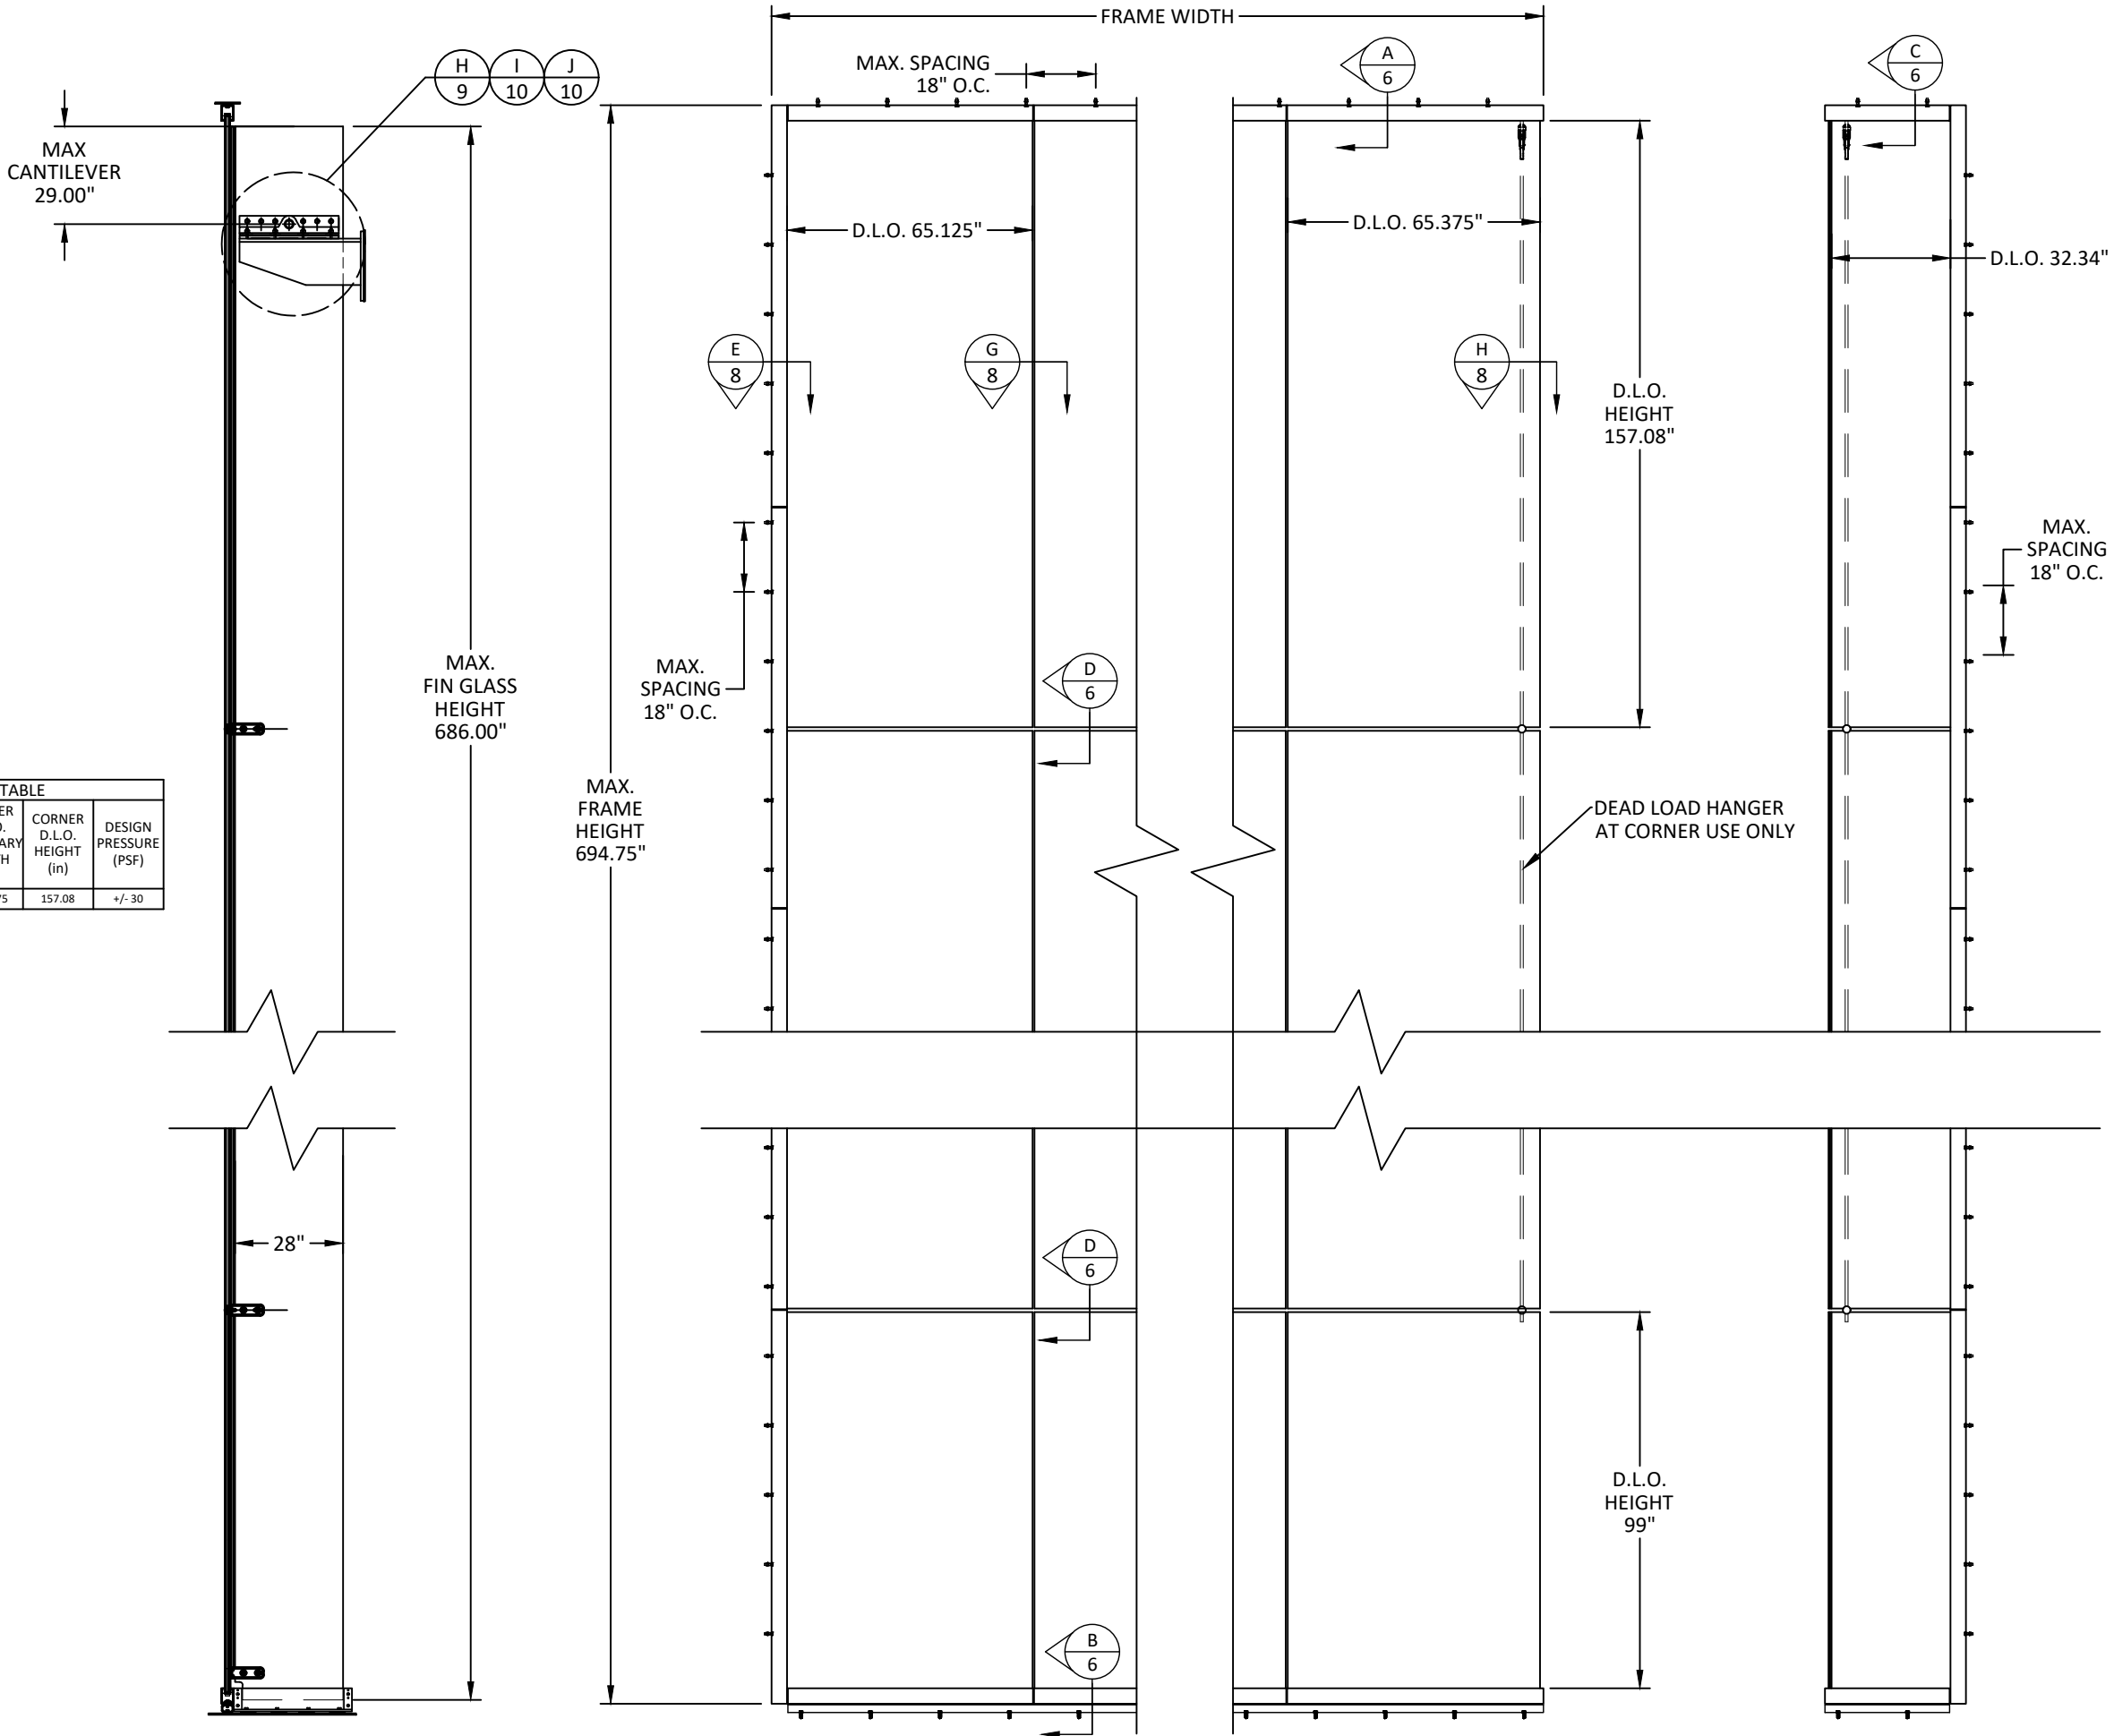

TYPICAL ELEVATION



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

ELEVATION & ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

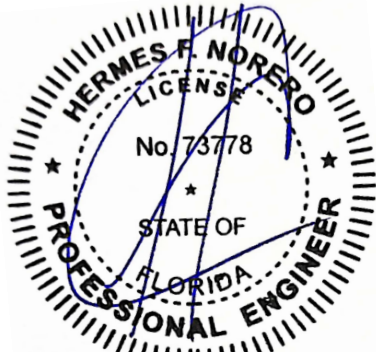

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	2
REV.	A

DESIGN PRESSURE TABLE					
FRAME HEIGHT (in)	D.L.O. WIDTH (in)	D.L.O. HEIGHT (in)	CORNER D.L.O. TRIBUTARY WIDTH (in)	CORNER D.L.O. HEIGHT (in)	DESIGN PRESSURE (PSF)
728.75	72.000	180.00	48.8575	157.08	+/- 45

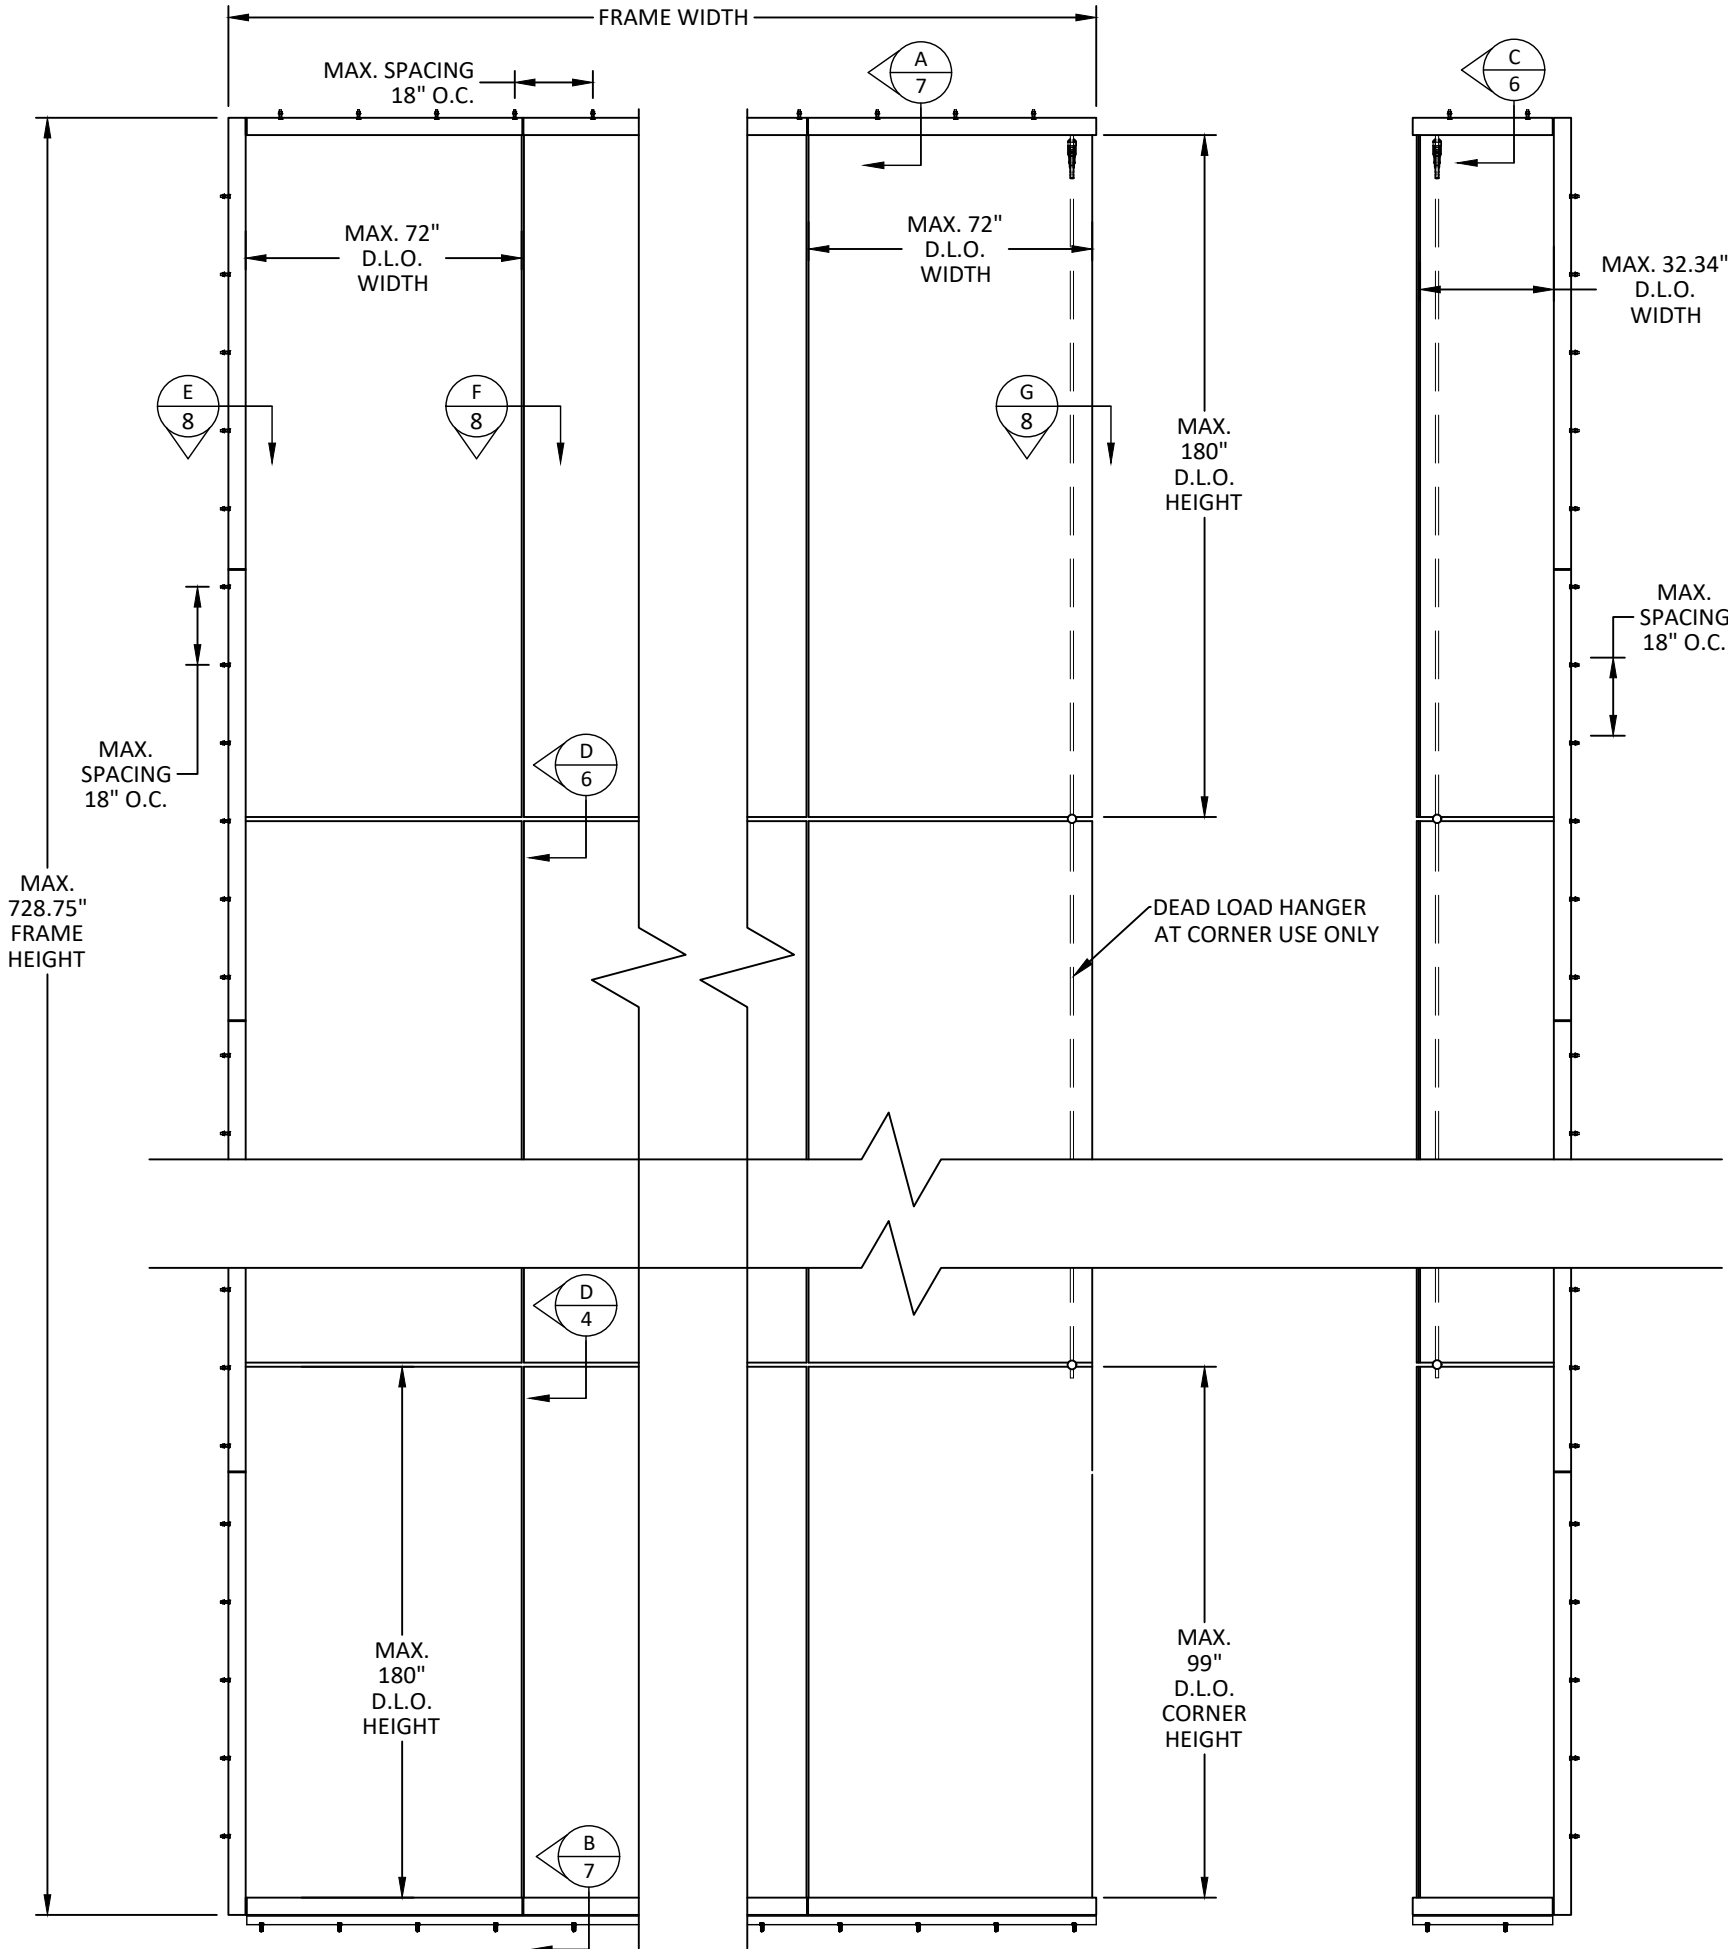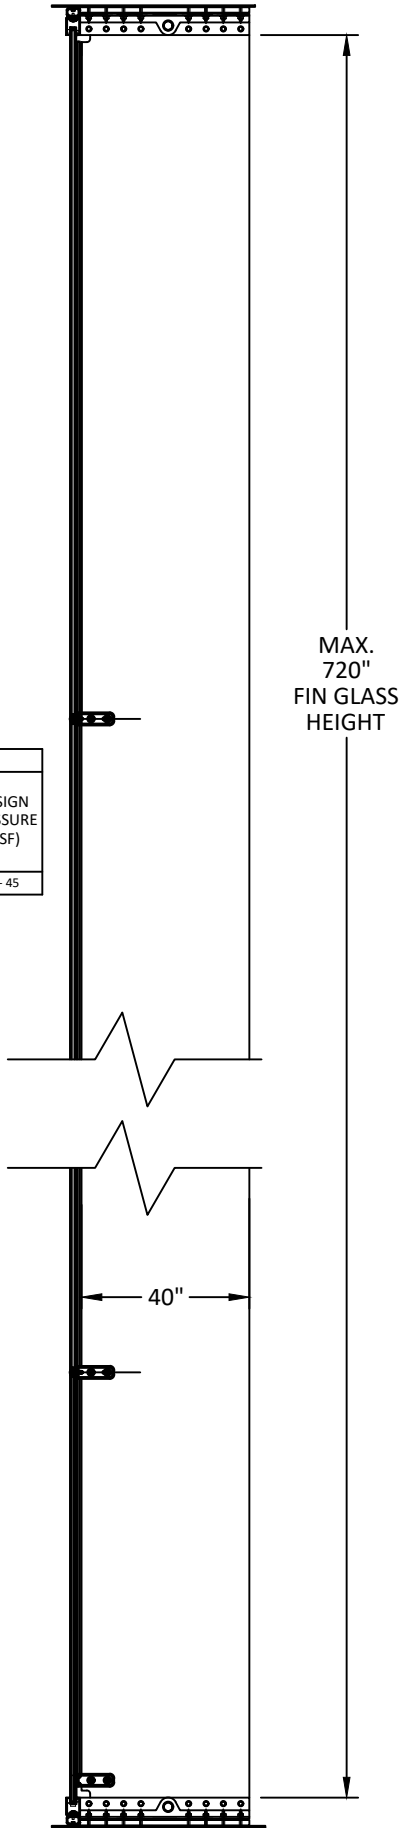

TYPICAL ELEVATION



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

ELEVATION & ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

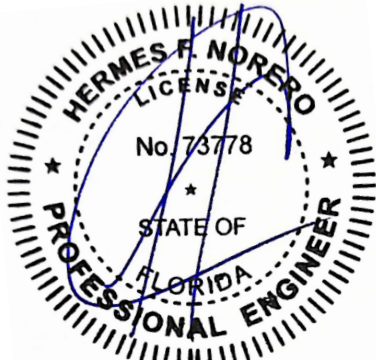


HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL42023	
DATE:	2023.11.21	
DWG. BY:	DI	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	WWG002	
SHEET:	3	REV. A

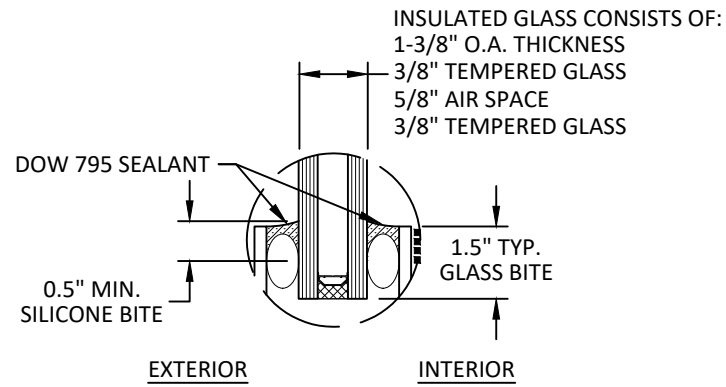


GLAZING DETAIL 1
JAMB - FACE GLASS

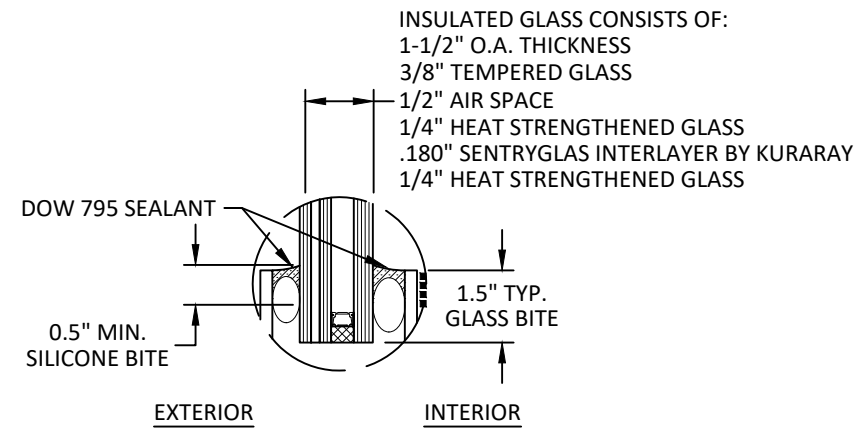


GLAZING DETAIL 4
JAMB - FACE GLASS

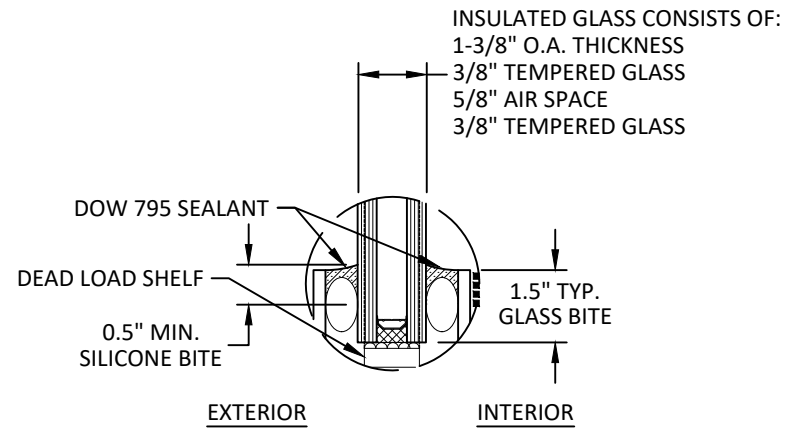


GLAZING DETAIL 2
SILL - FACE GLASS

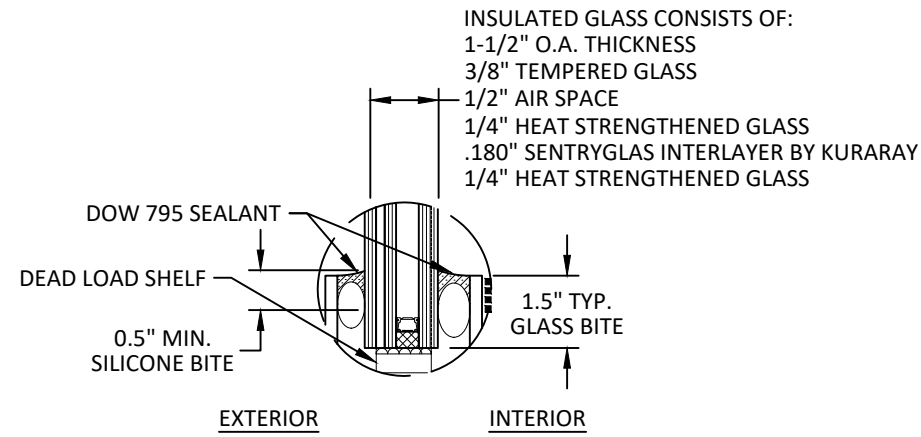

GLAZING DETAIL 5
SILL - FACE GLASS

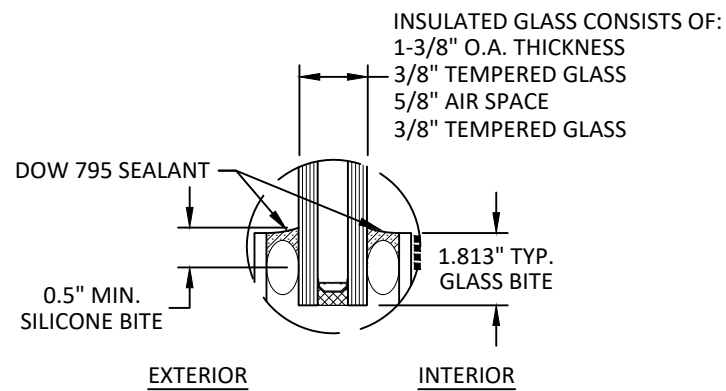

GLAZING DETAIL 3
HEAD - FACE GLASS

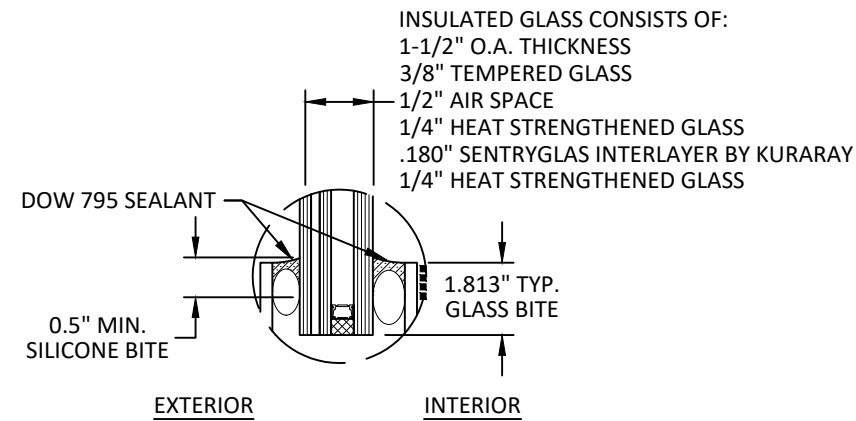

GLAZING DETAIL 6
HEAD - FACE GLASS

GLAZING NOTES:

- GLASS TYPE & THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 85 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN ON SHEET 1.



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

GLAZING DETAILS


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132

PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

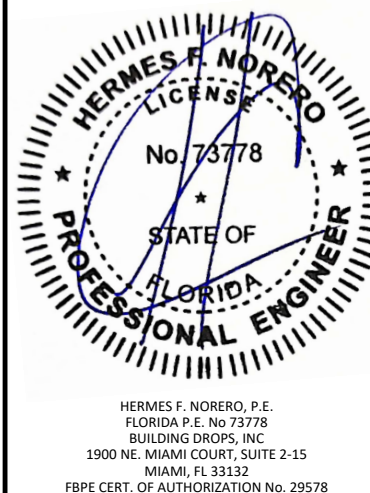

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL42023	
DATE:	2023.11.21	
DWG. BY:	DI	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	WWG002	
SHEET:	4	REV. A



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

GLAZING DETAILS

PREPARED BY:







REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

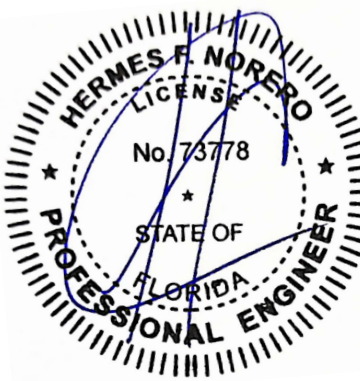


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	5
REV.	A

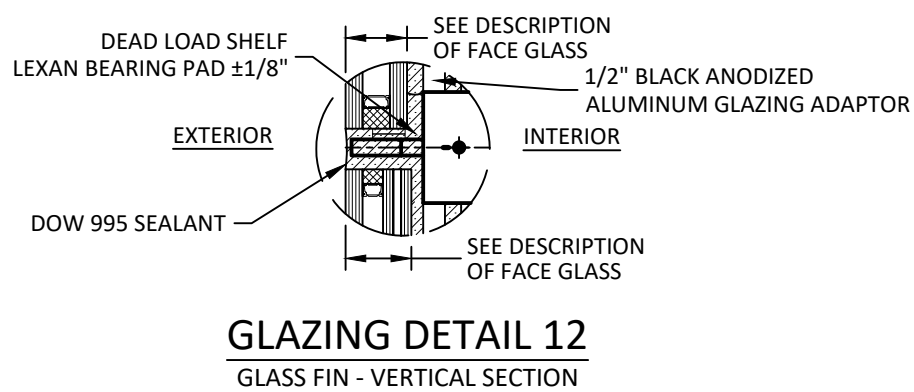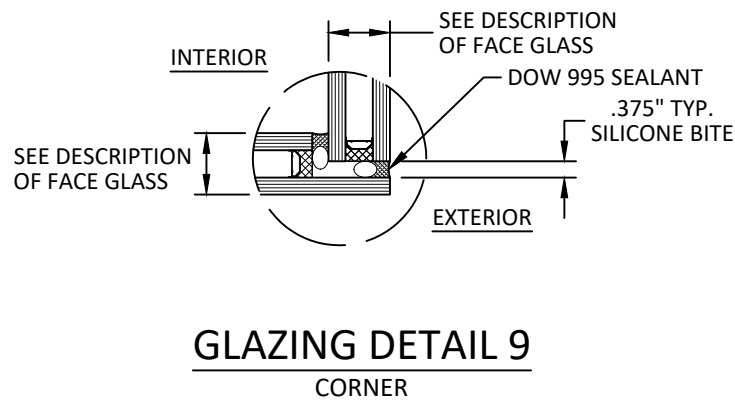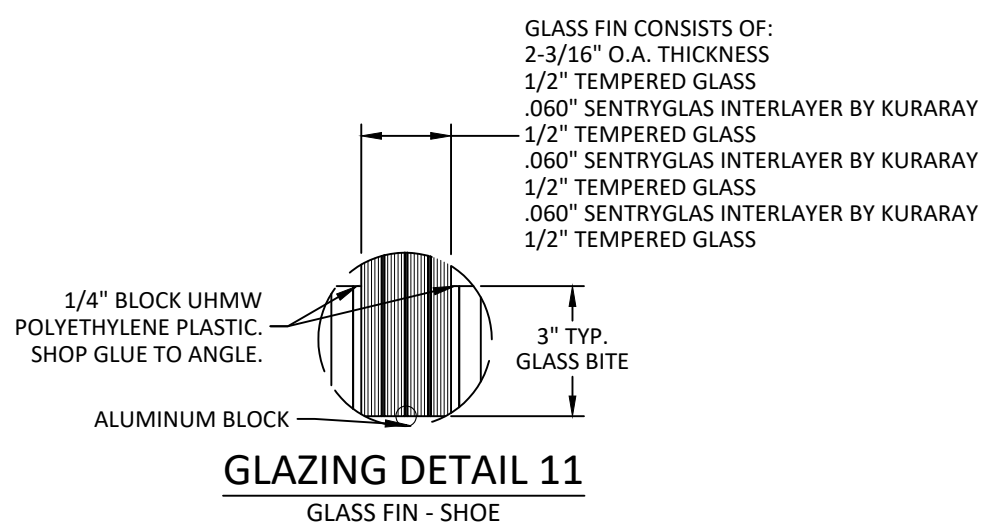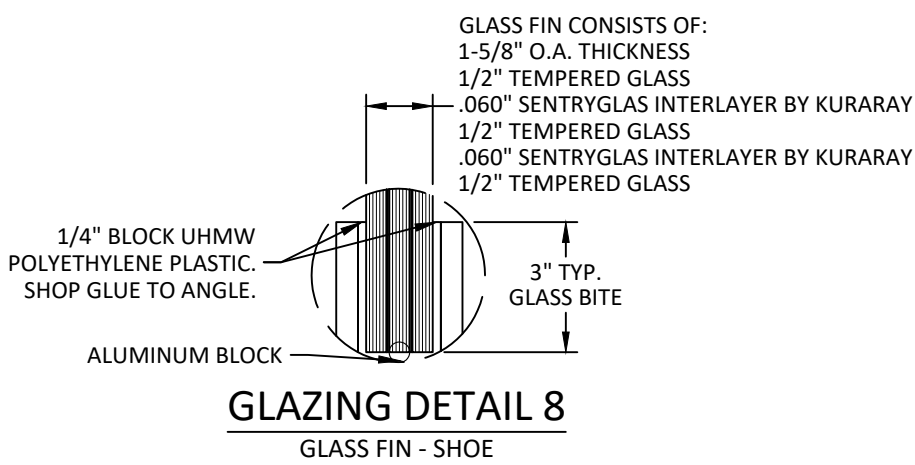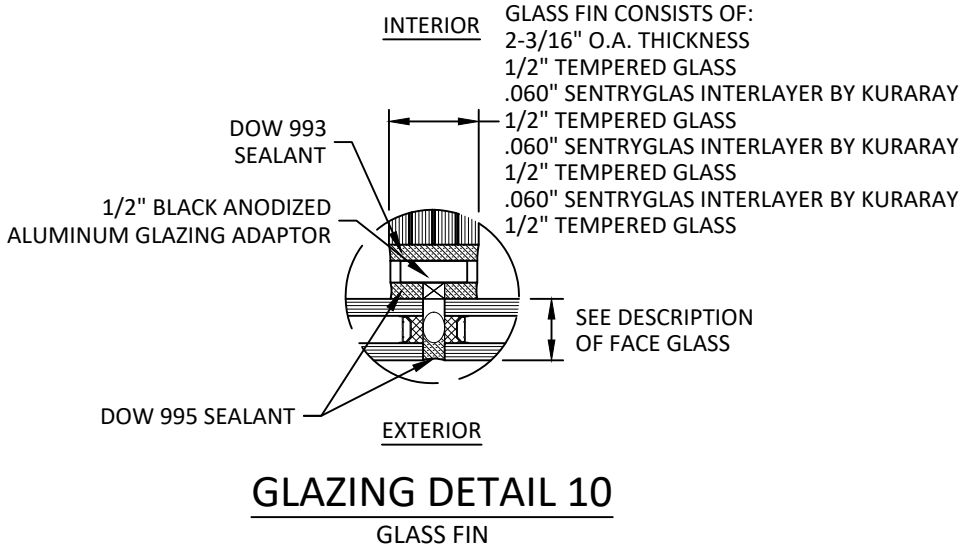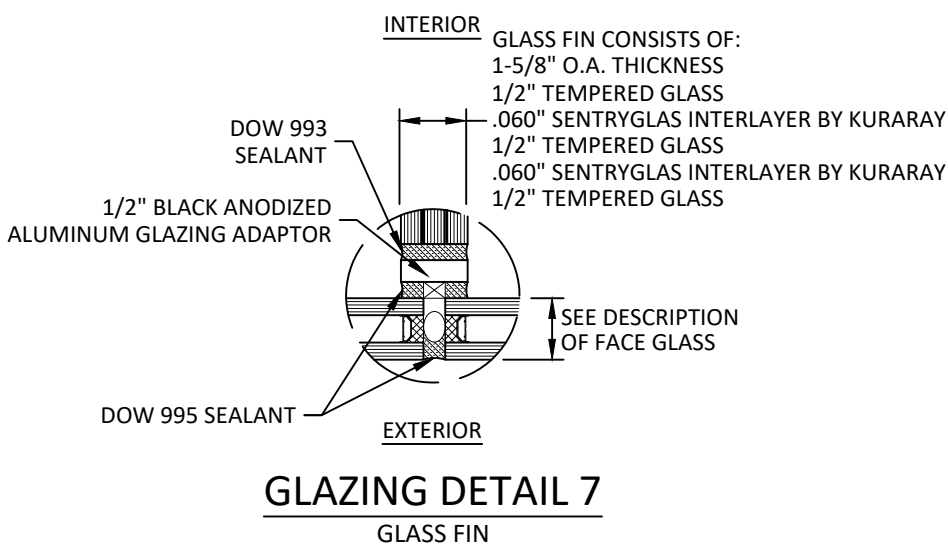


- GLAZING NOTES:
- GLASS TYPE & THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 85 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN ON SHEET 1.

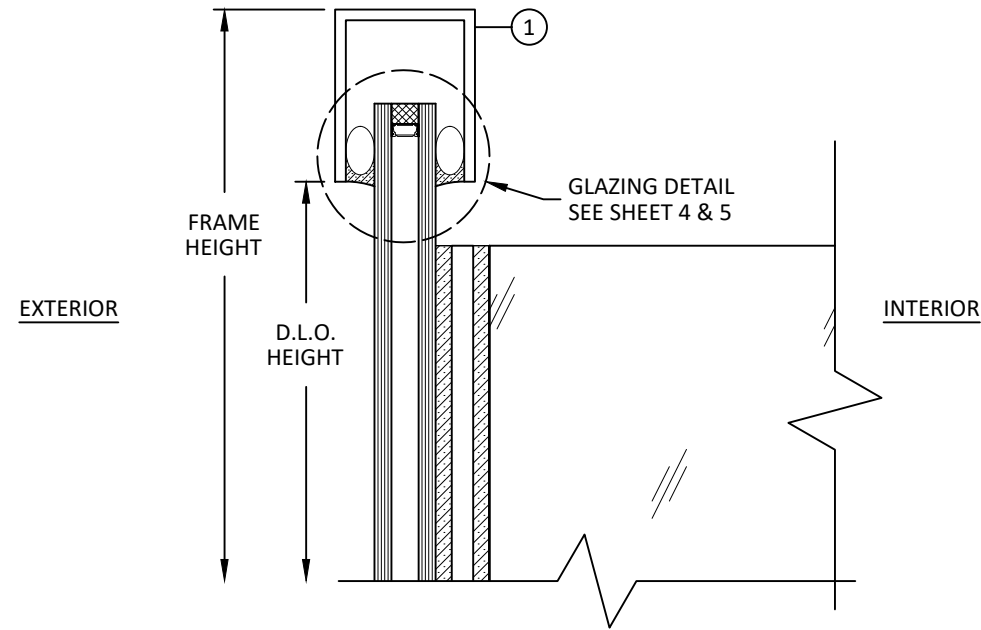


A
6 VERTICAL SECTION
HEAD AT GLASS FIN

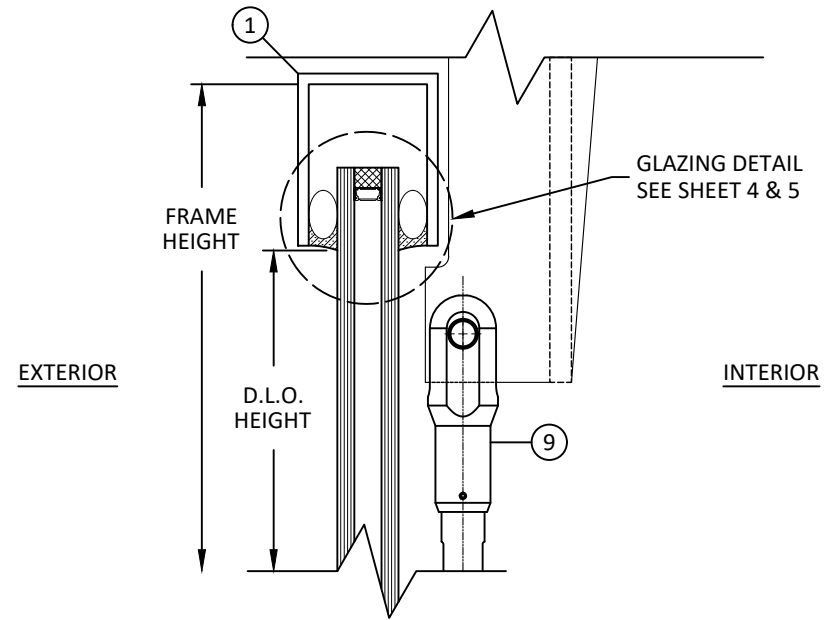

C
6 VERTICAL SECTION
HEAD AT CORNER

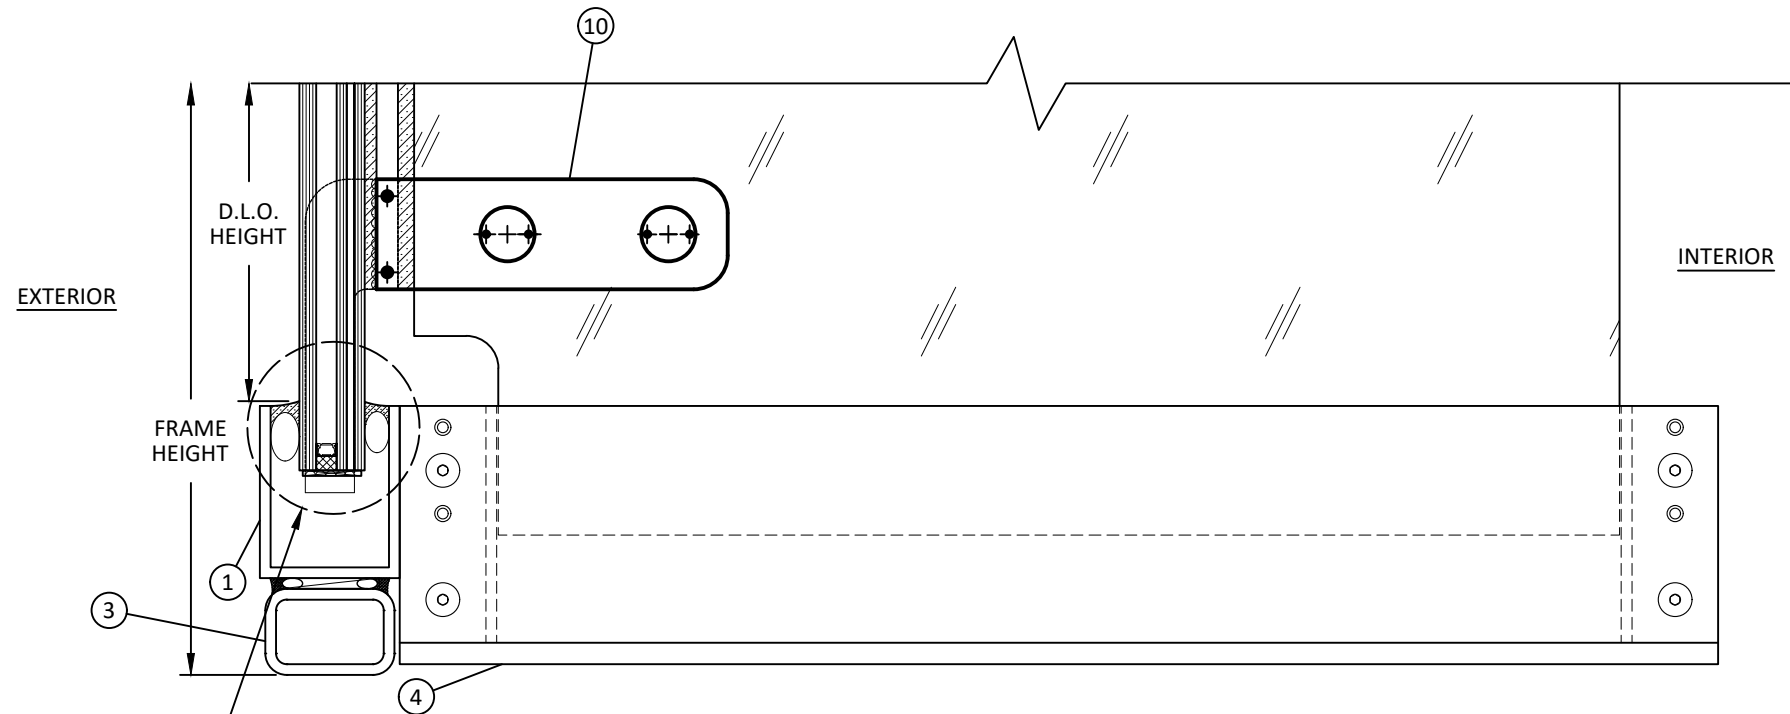

B
6 VERTICAL SECTION
SILL

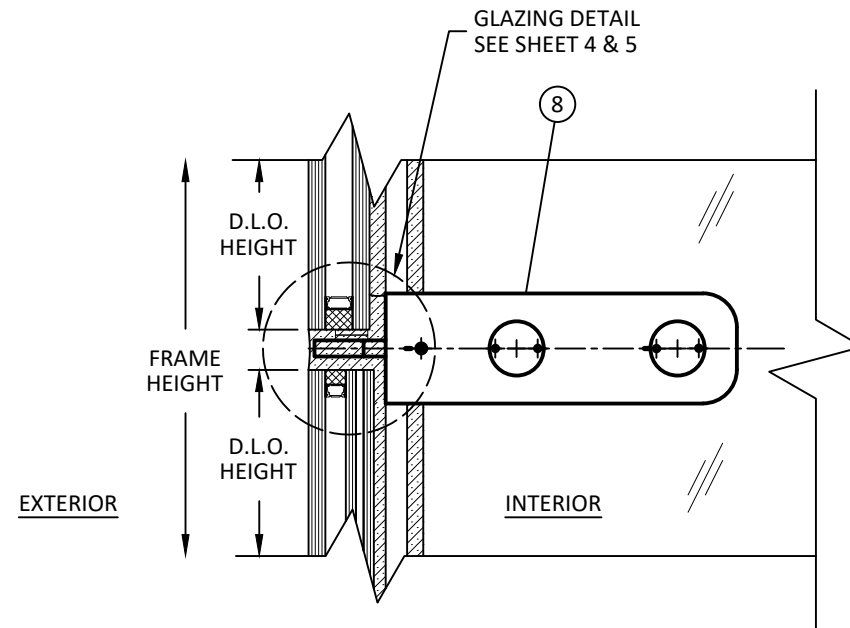

D
6 VERTICAL SECTION
INTERSECTION



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

VERTICAL SECTIONS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (554)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

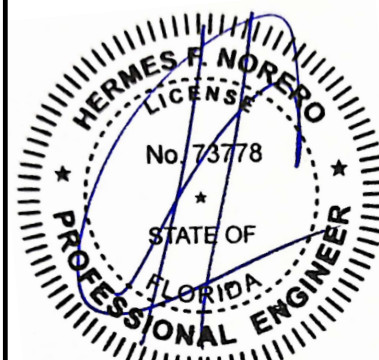

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	6
REV.	A

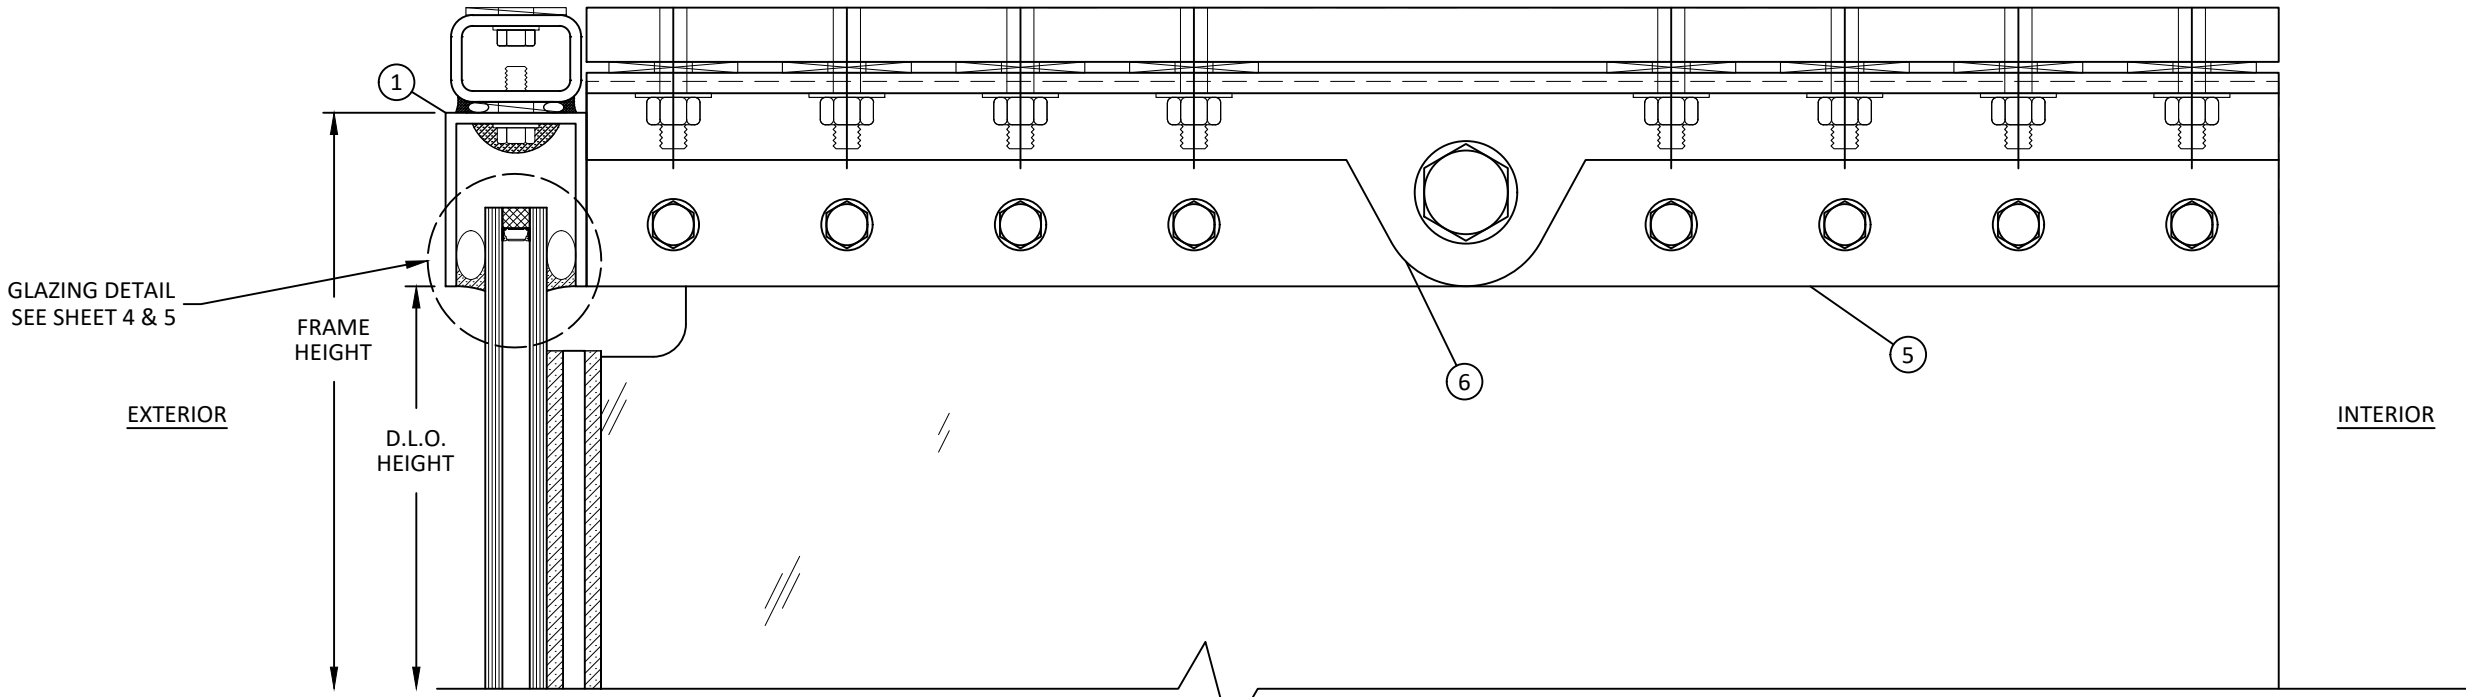

A
7

VERTICAL SECTION

HEAD AT GLASS FIN

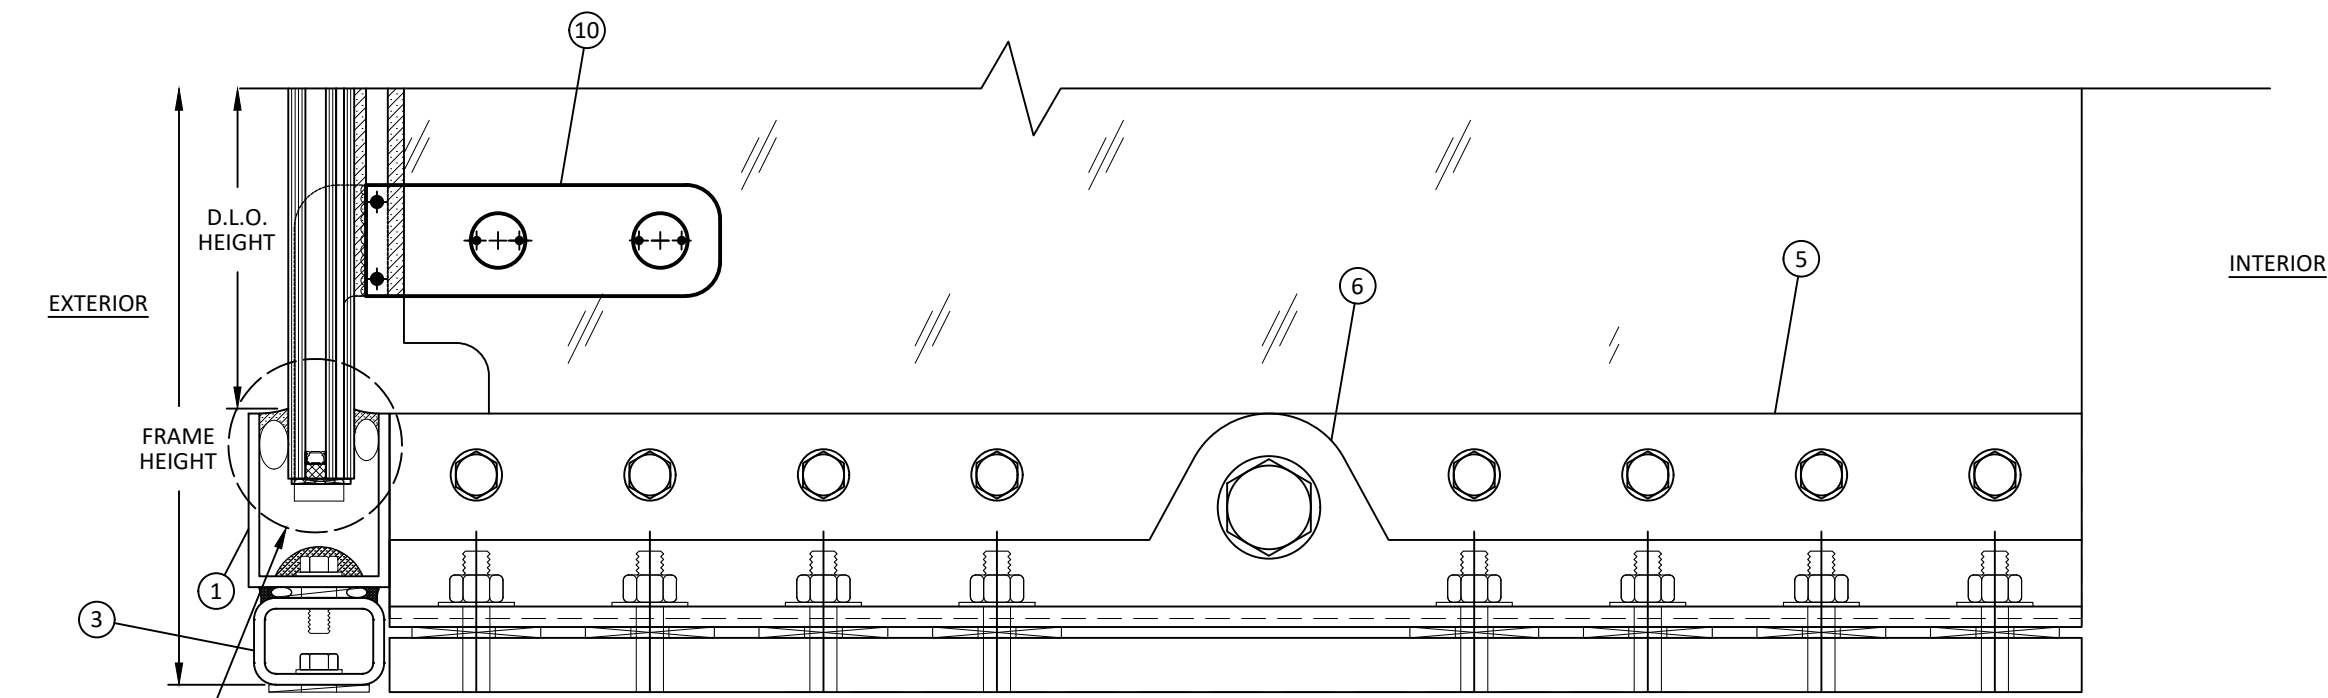

B
7

VERTICAL SECTION

SILL



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)


VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

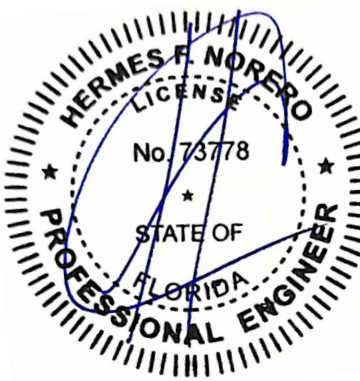

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE. MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	7
REV.	A

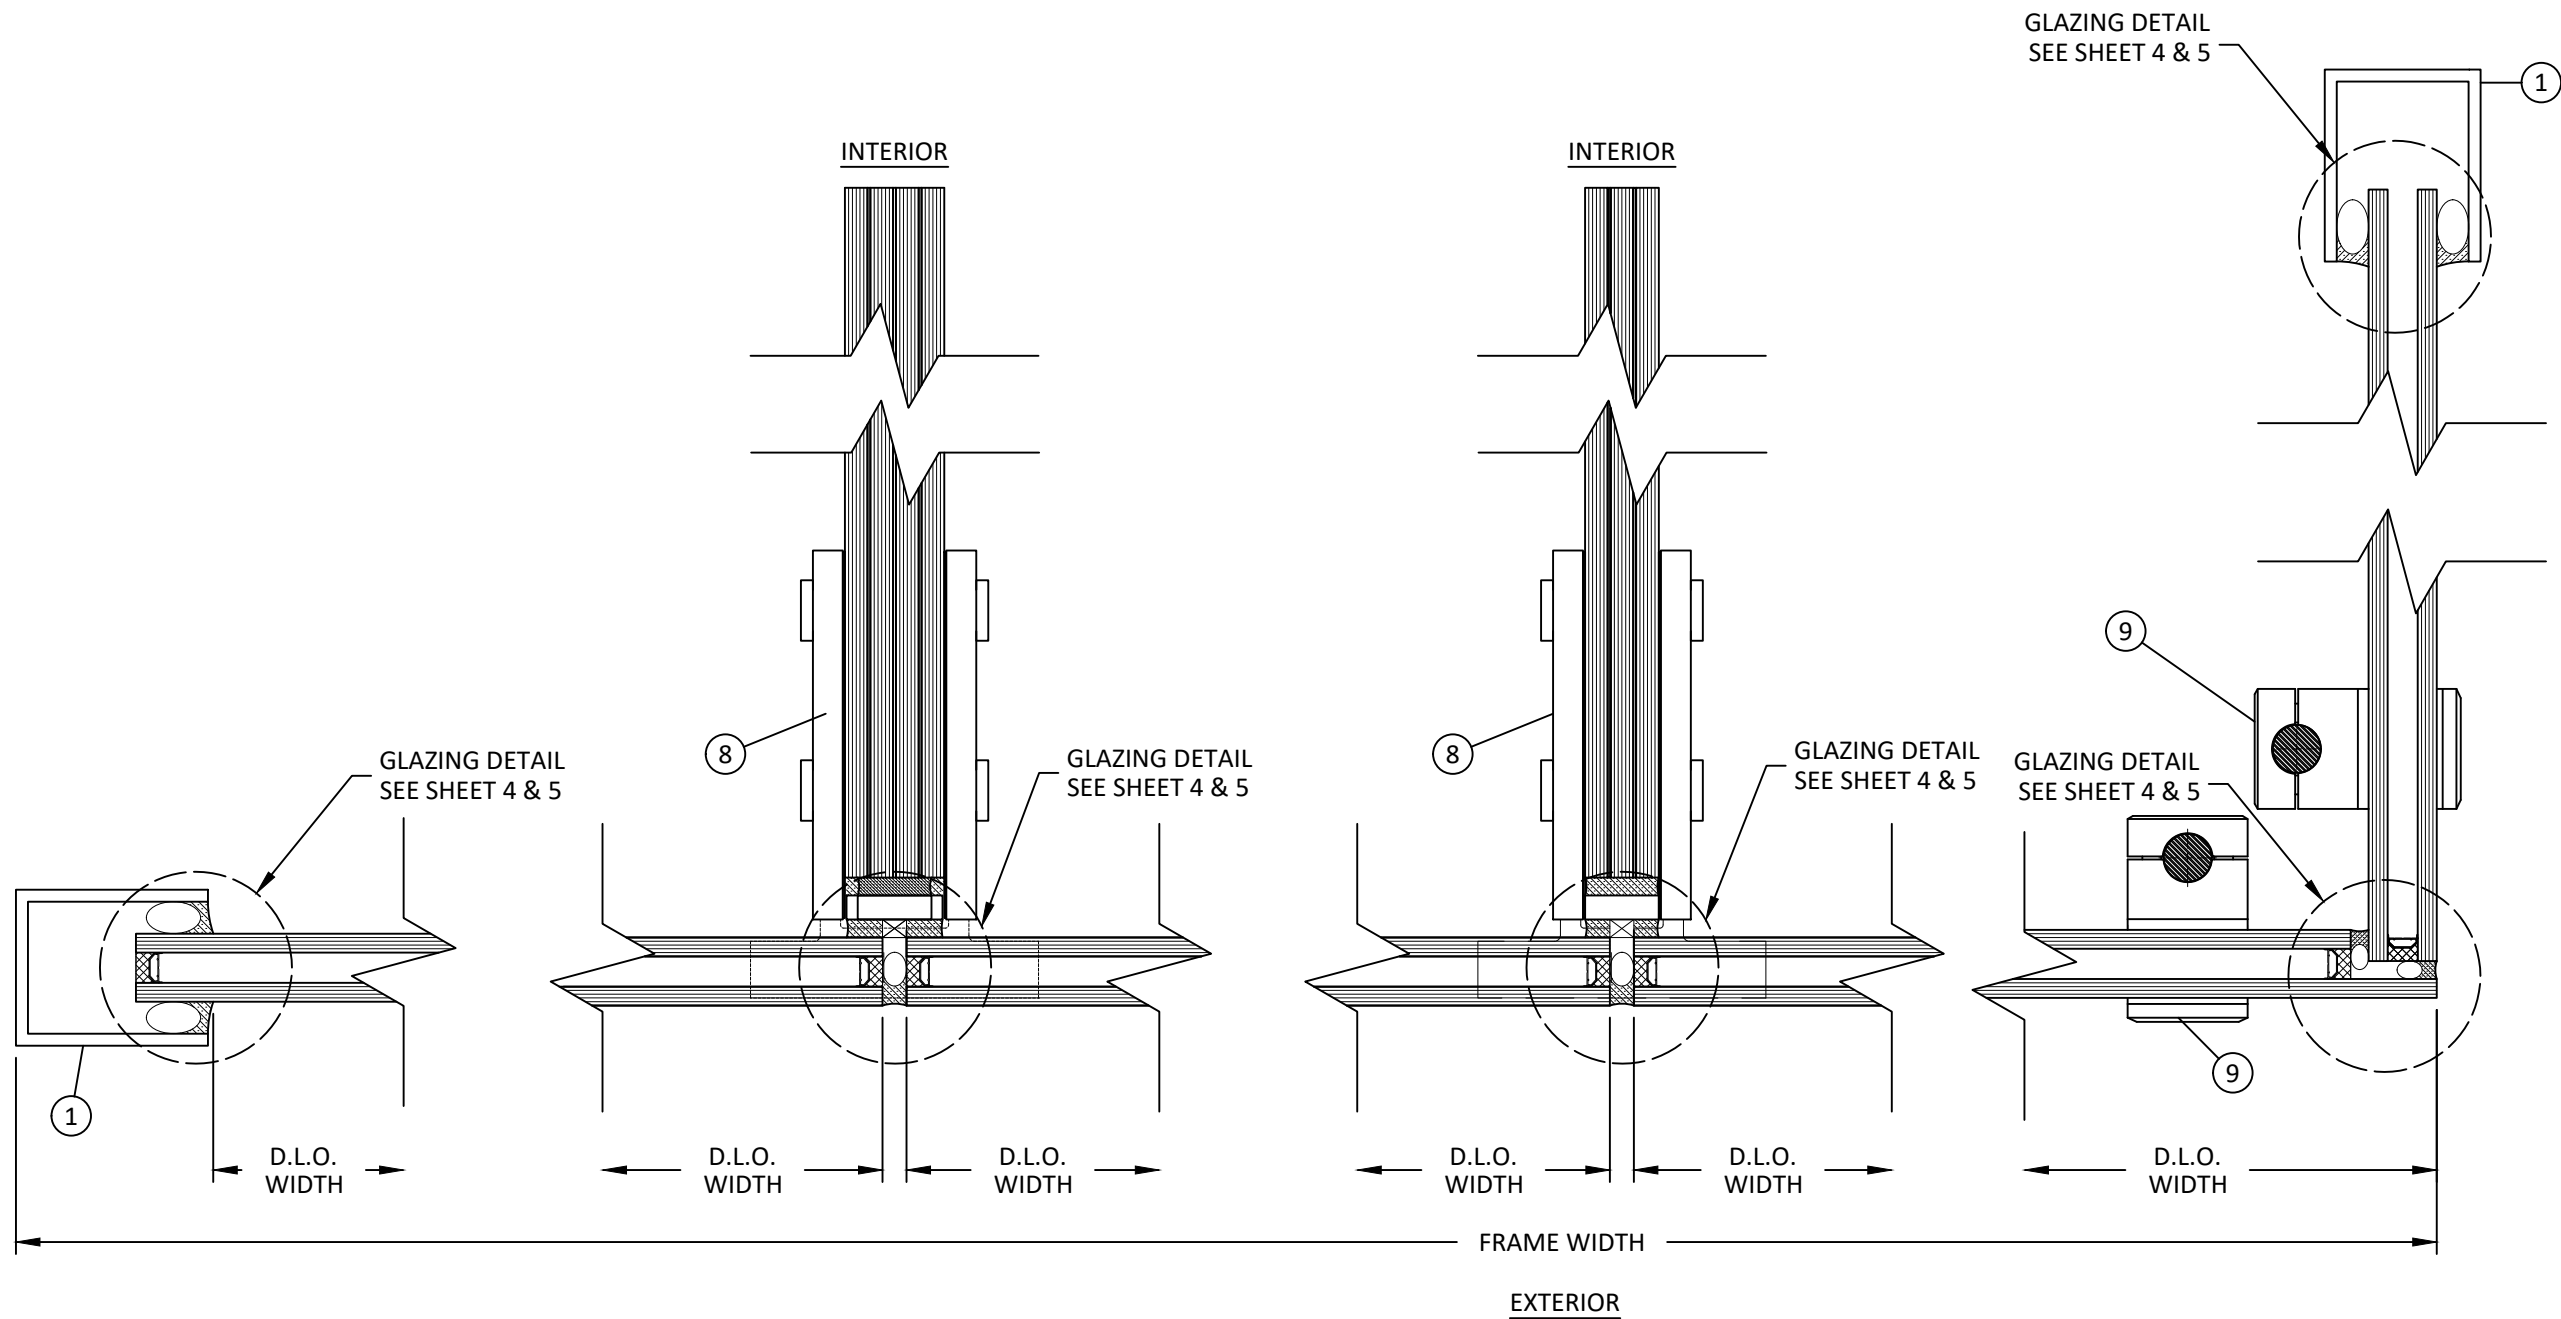

E HORIZONTAL SECTION
8 JAMB

F HORIZONTAL SECTION
8 GLASS FIN W/ DEADLOAD SHELF

G HORIZONTAL SECTION
8 GLASS FIN W/ DEADLOAD SHELF

H HORIZONTAL SECTION
8 CORNER




W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954


TITLE: W & W GLASS FIN SYSTEM (NON-HVHZ) (NON-IMPACT)
HORIZONTAL SECTIONS
PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

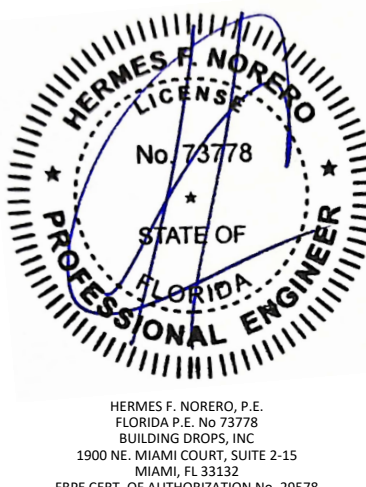

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	8
REV.	A

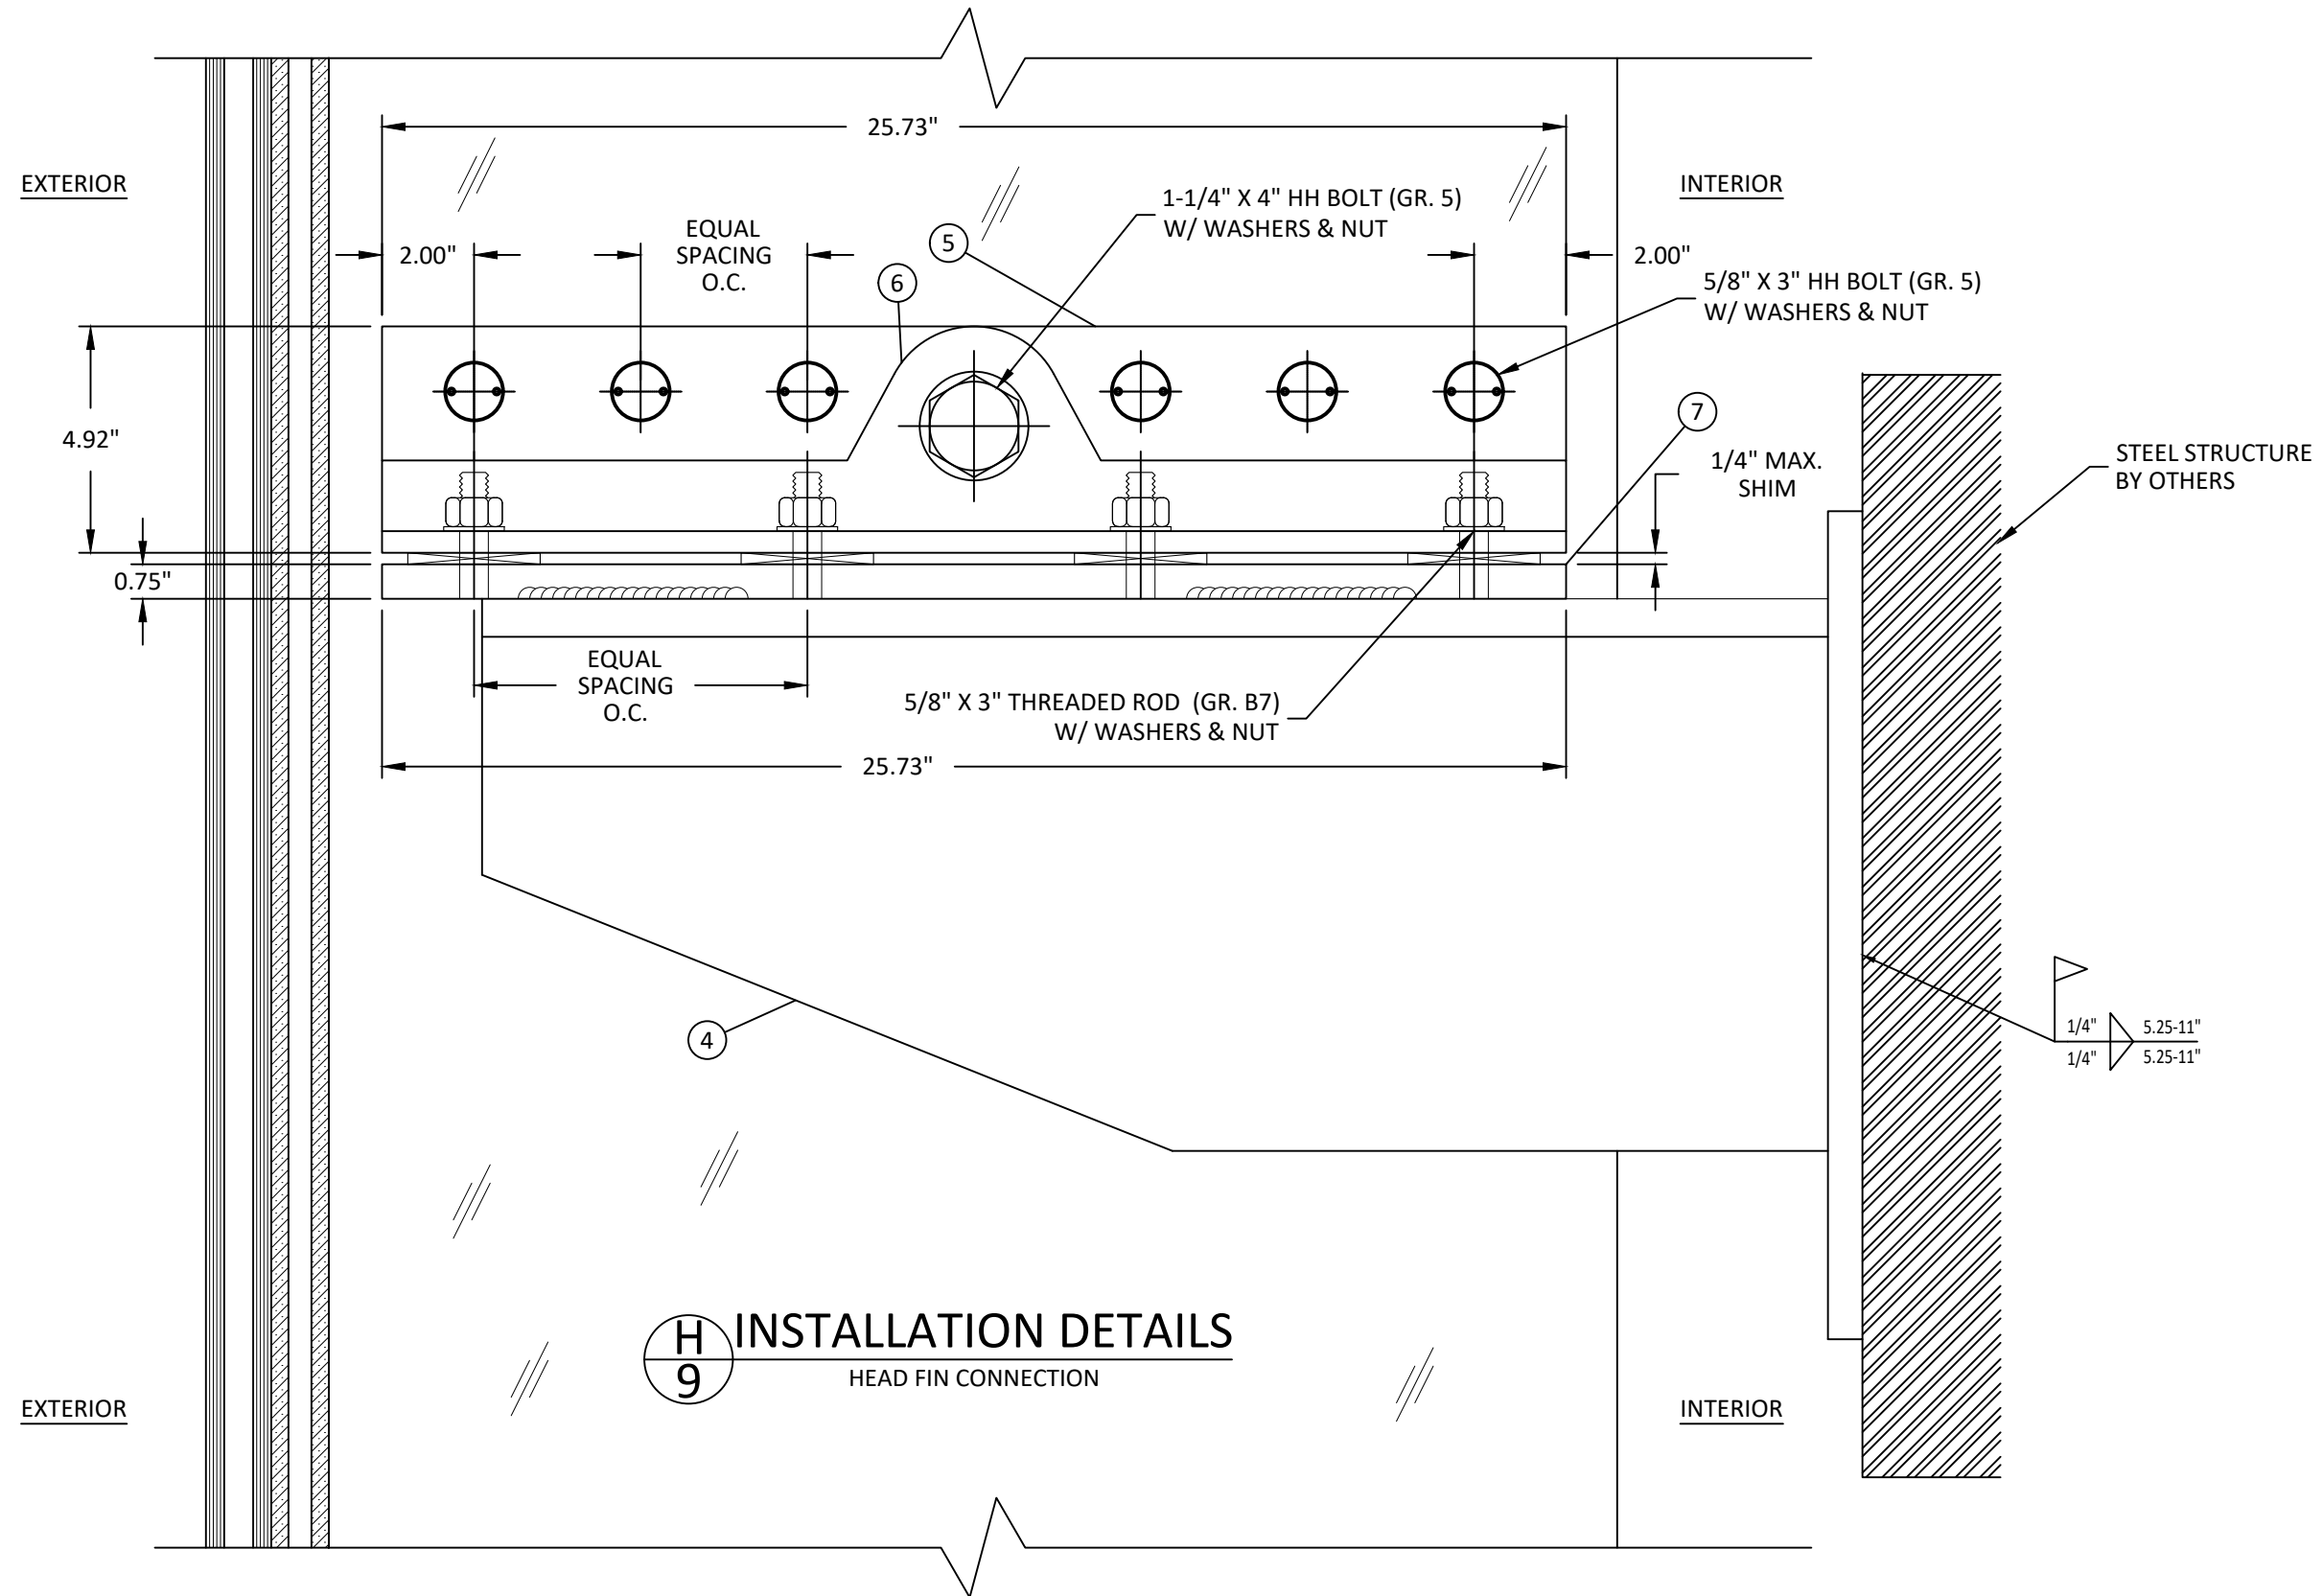

W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)


INSTALLATION DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

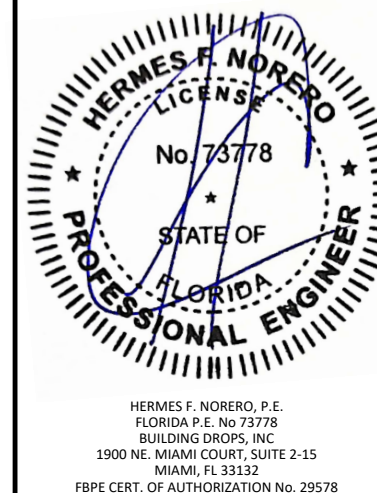

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	9
REV.	A

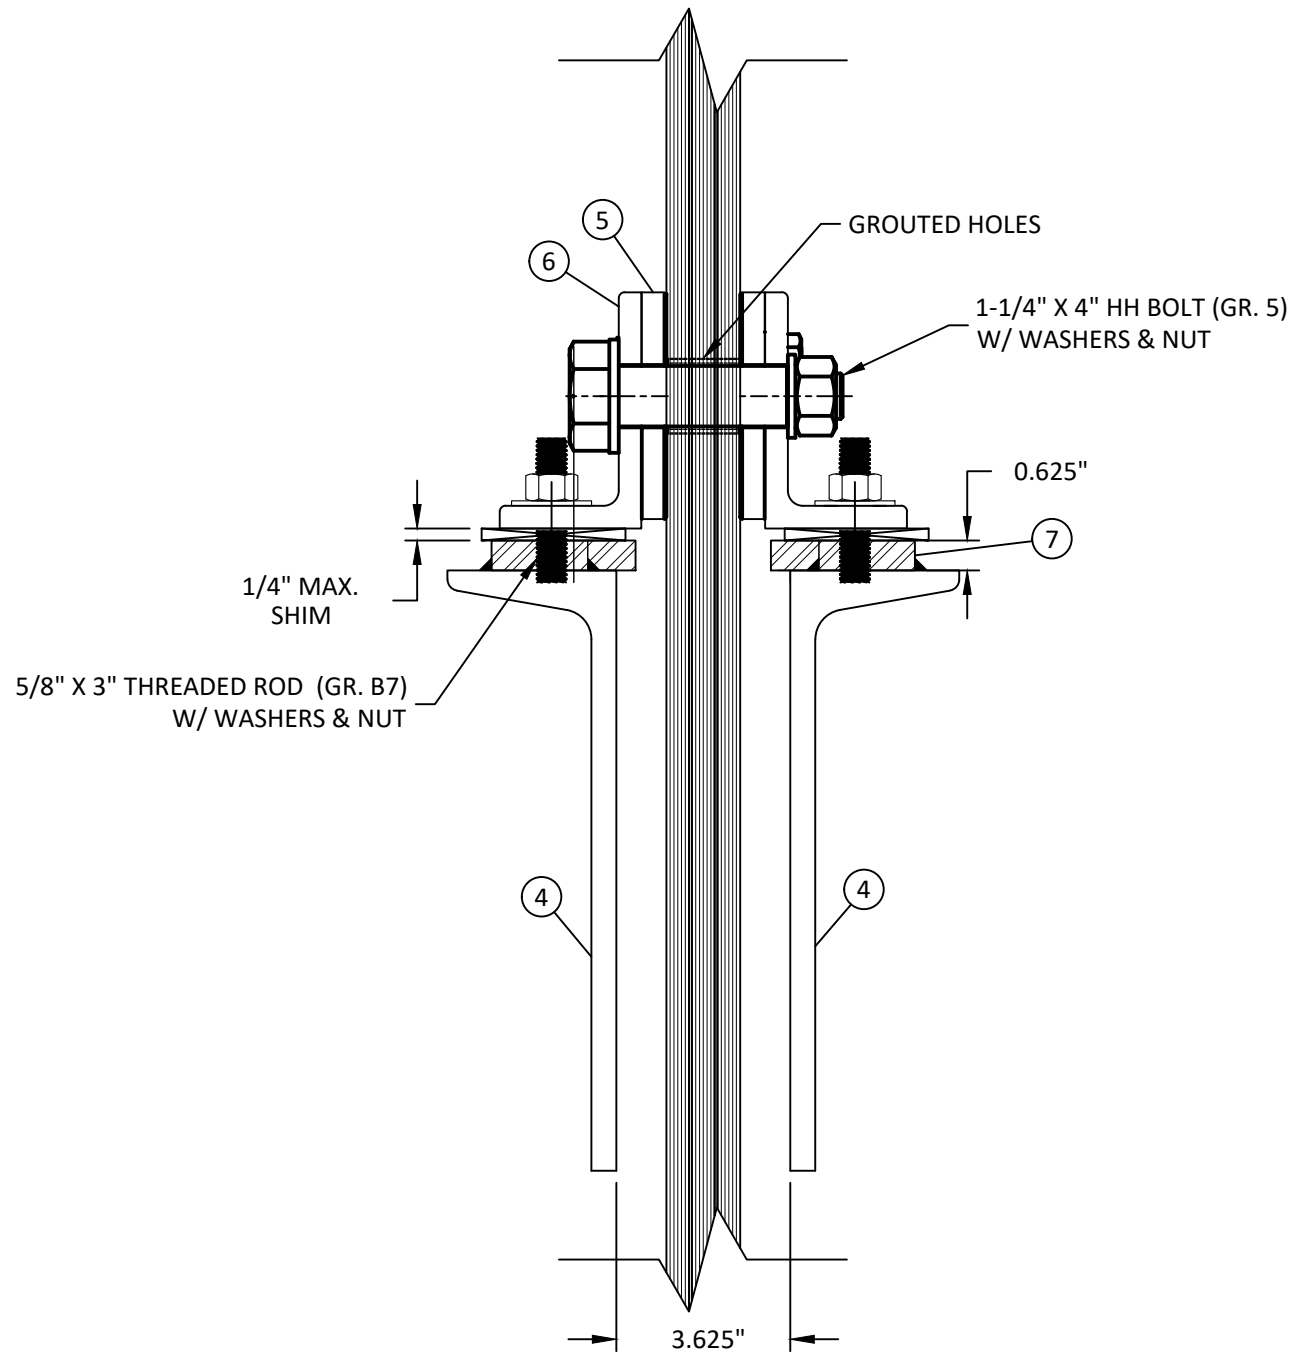

I
10 **INSTALLATION DETAILS**
HEAD FIN CONNECTION
VERTICAL SECTION AT M32 SHOULDER BOLT

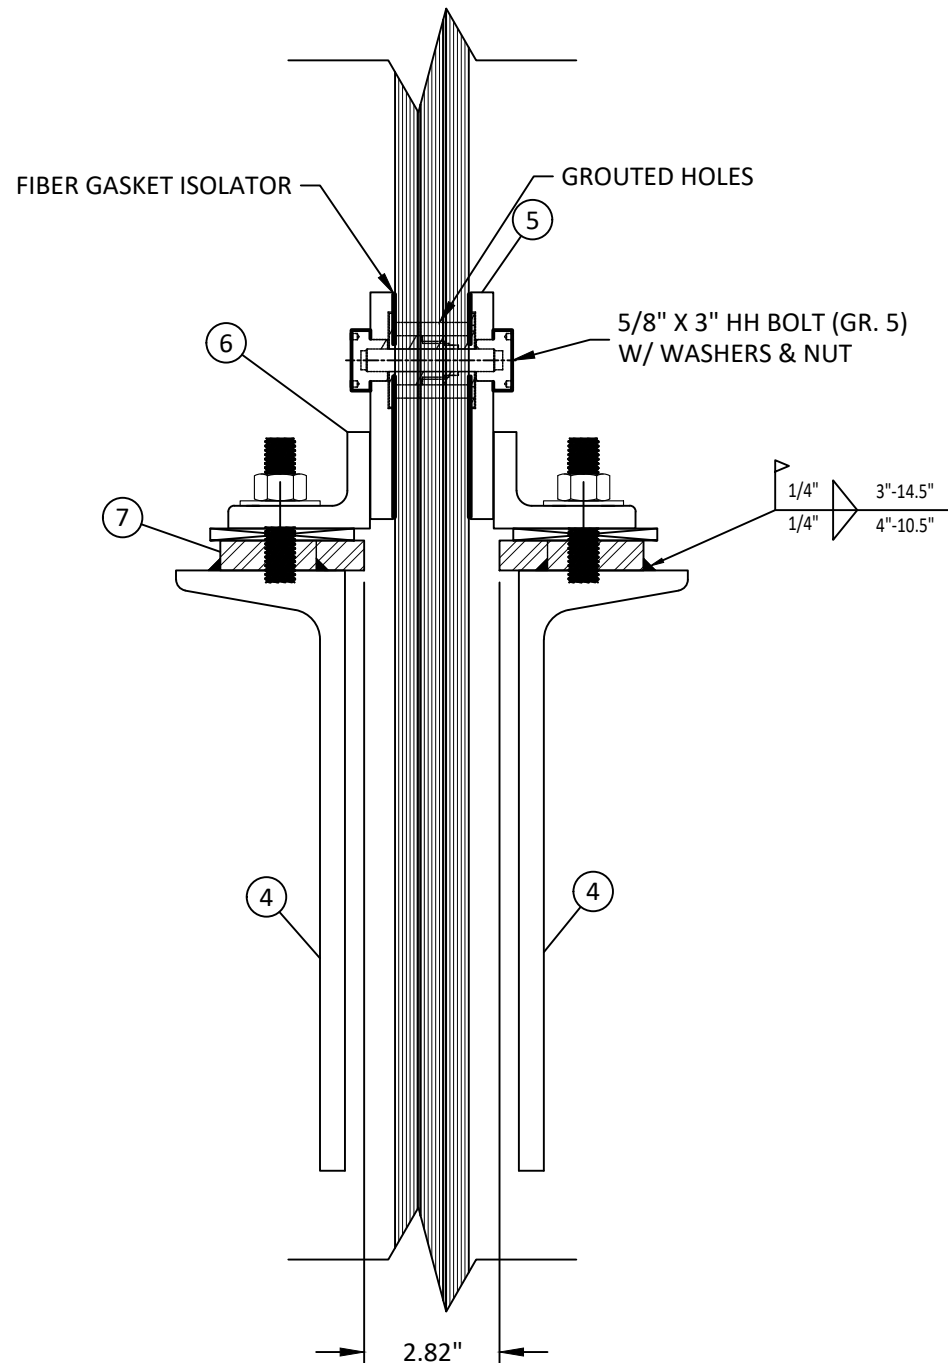

J
10 **INSTALLATION DETAILS**
HEAD FIN CONNECTION
VERTICAL SECTION AT M16 BOLTS



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

INSTALLATION DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com


BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL42023	
DATE:	2023.11.21	
DWG. BY:	DI	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	WWG002	
SHEET:	10	REV. A
OF 14		



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

INSTALLATION DETAILS


BUILDING DROPS, INC.

PH: (954)399-8478
FAX: (954)744.4738

FAX: (954) 44.4/38
WEB: www.buildingdrops.com



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC PROJECT OR SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC INSTALLATION DOCUMENTS FOR USE WITH THIS DOCUMENT.



1

OF 14





W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

INSTALLATION DETAILS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

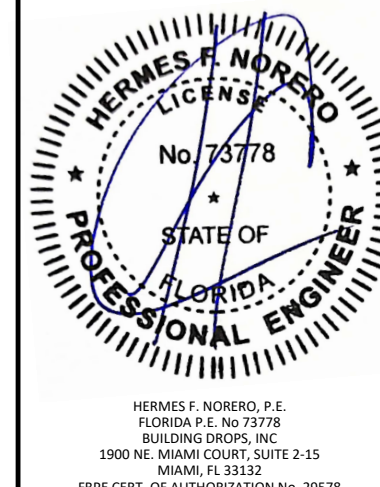


FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	12
REV.	A
	OF 14

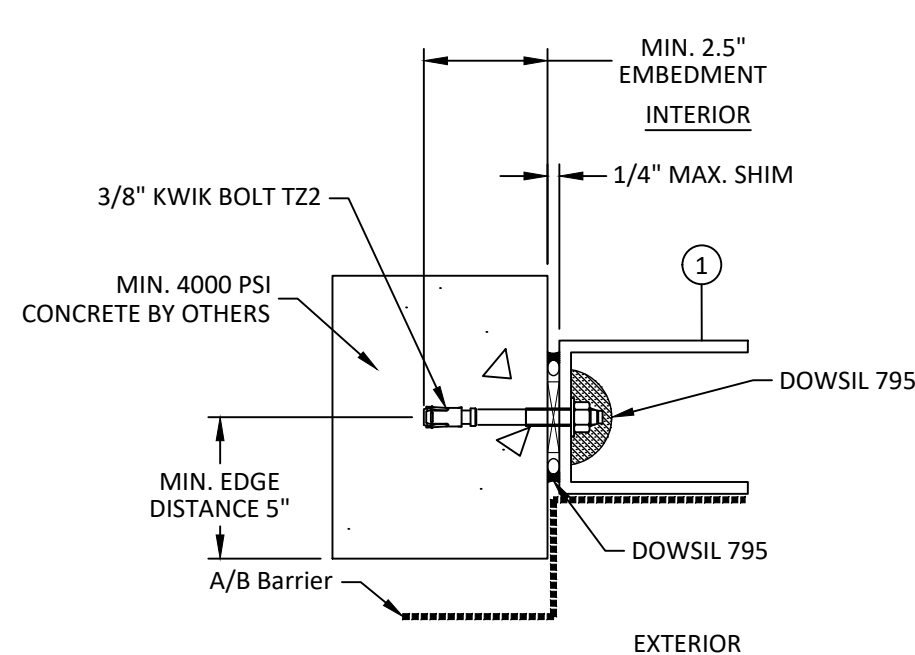


K INSTALLATION DETAILS
12 JAMB

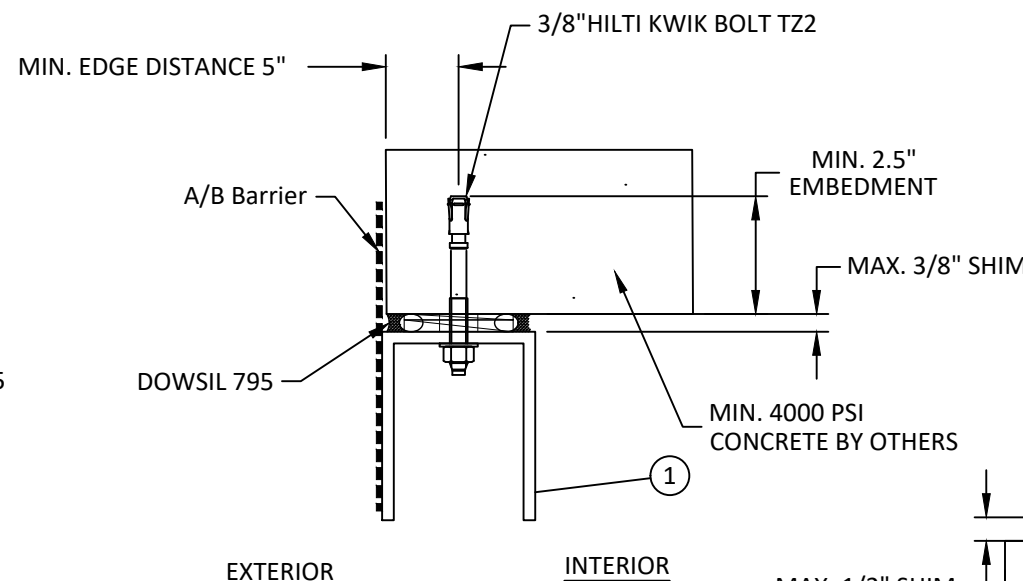

L INSTALLATION DETAILS
12 HEAD

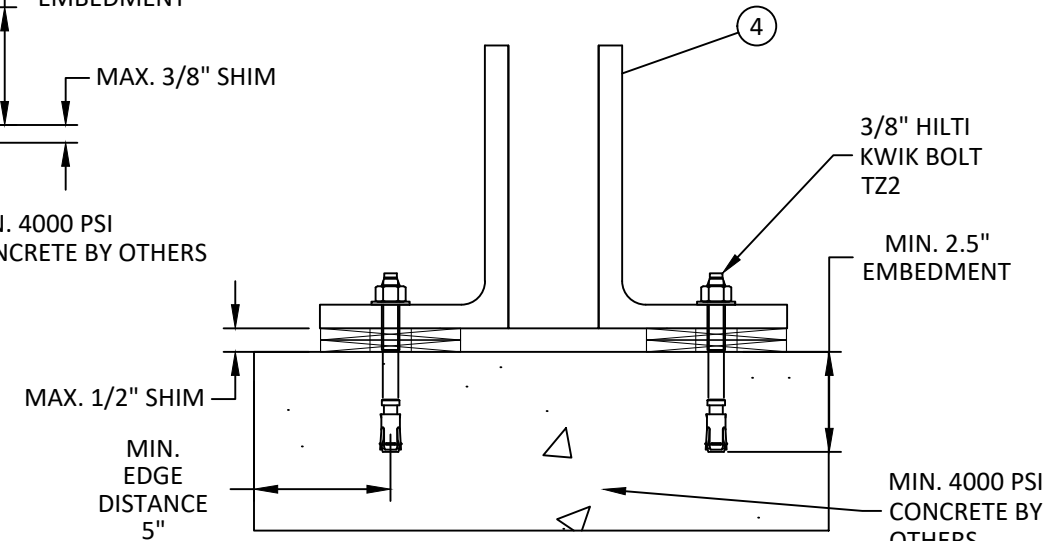

M INSTALLATION DETAILS
12 FIN - SILL

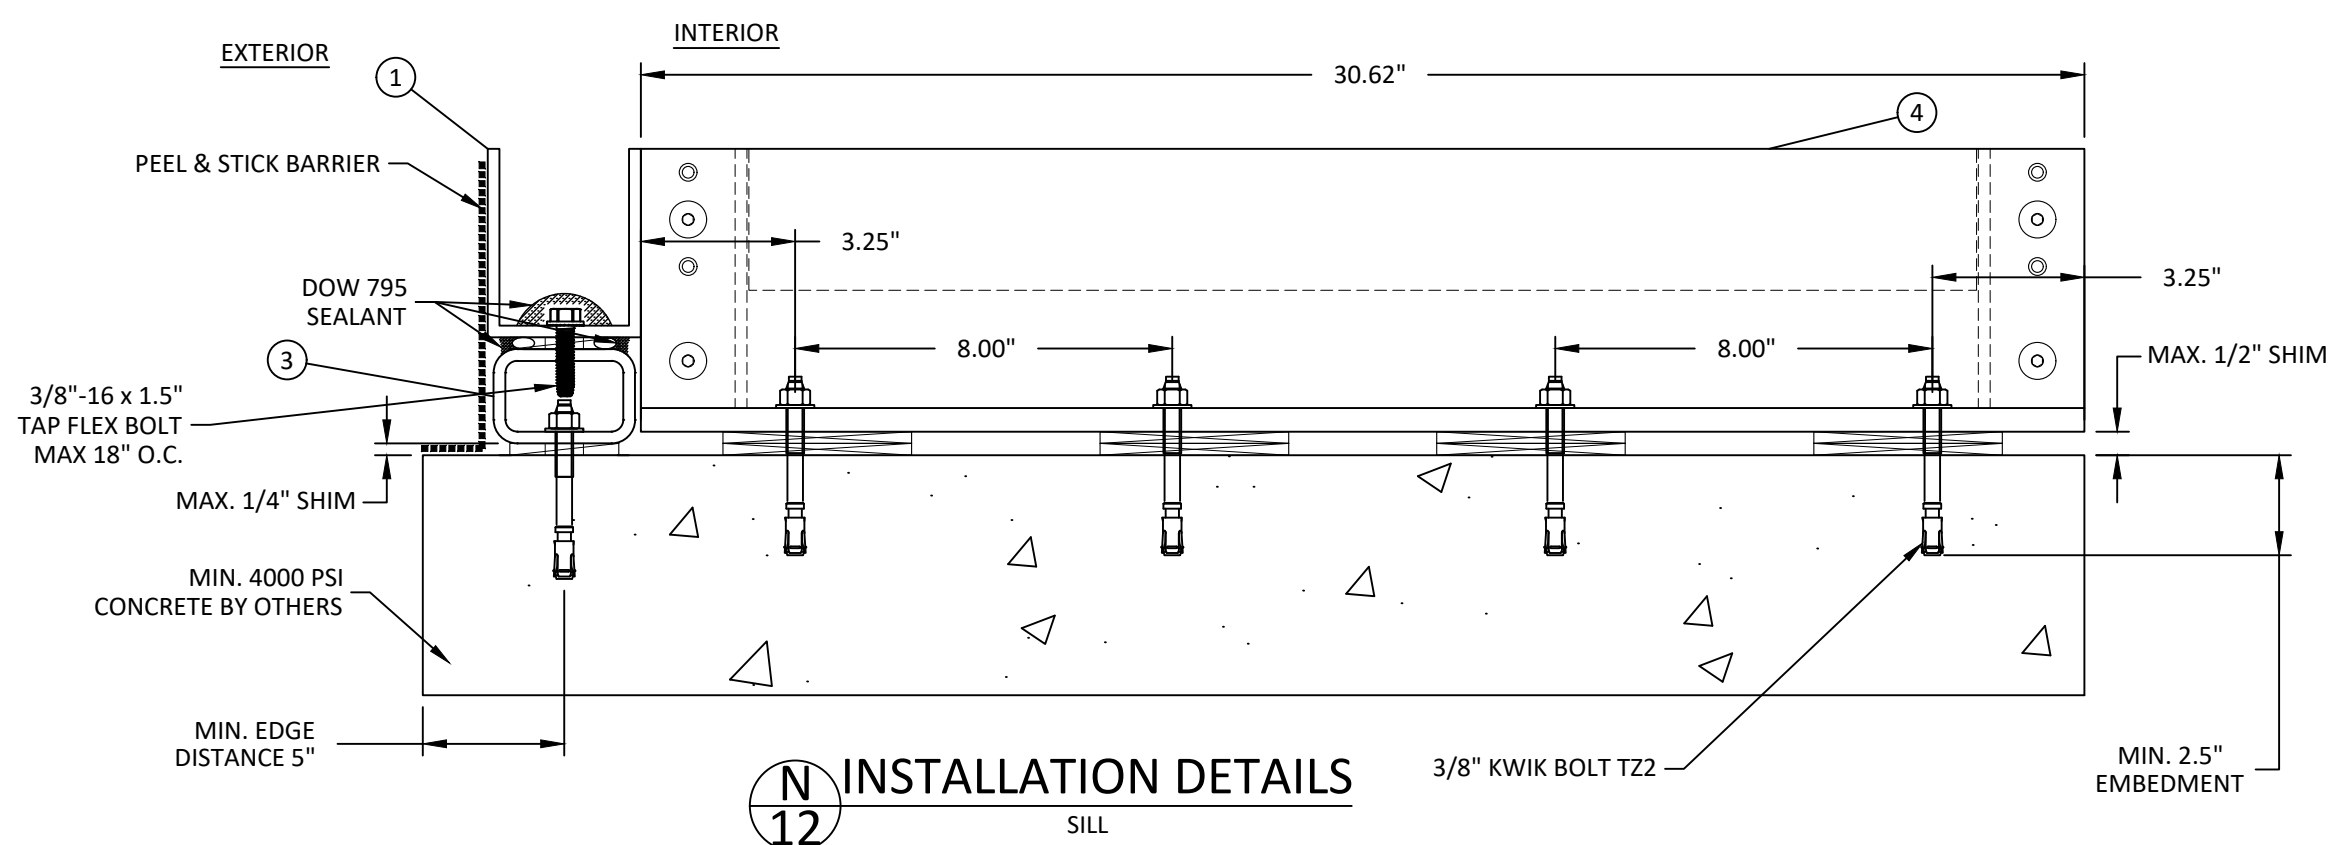

N INSTALLATION DETAILS
12 SILL



W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

INSTALLATION DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, SUITE 2-15

MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

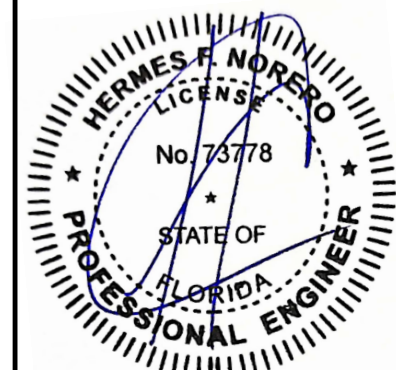


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	13
REV.	A

OF 14

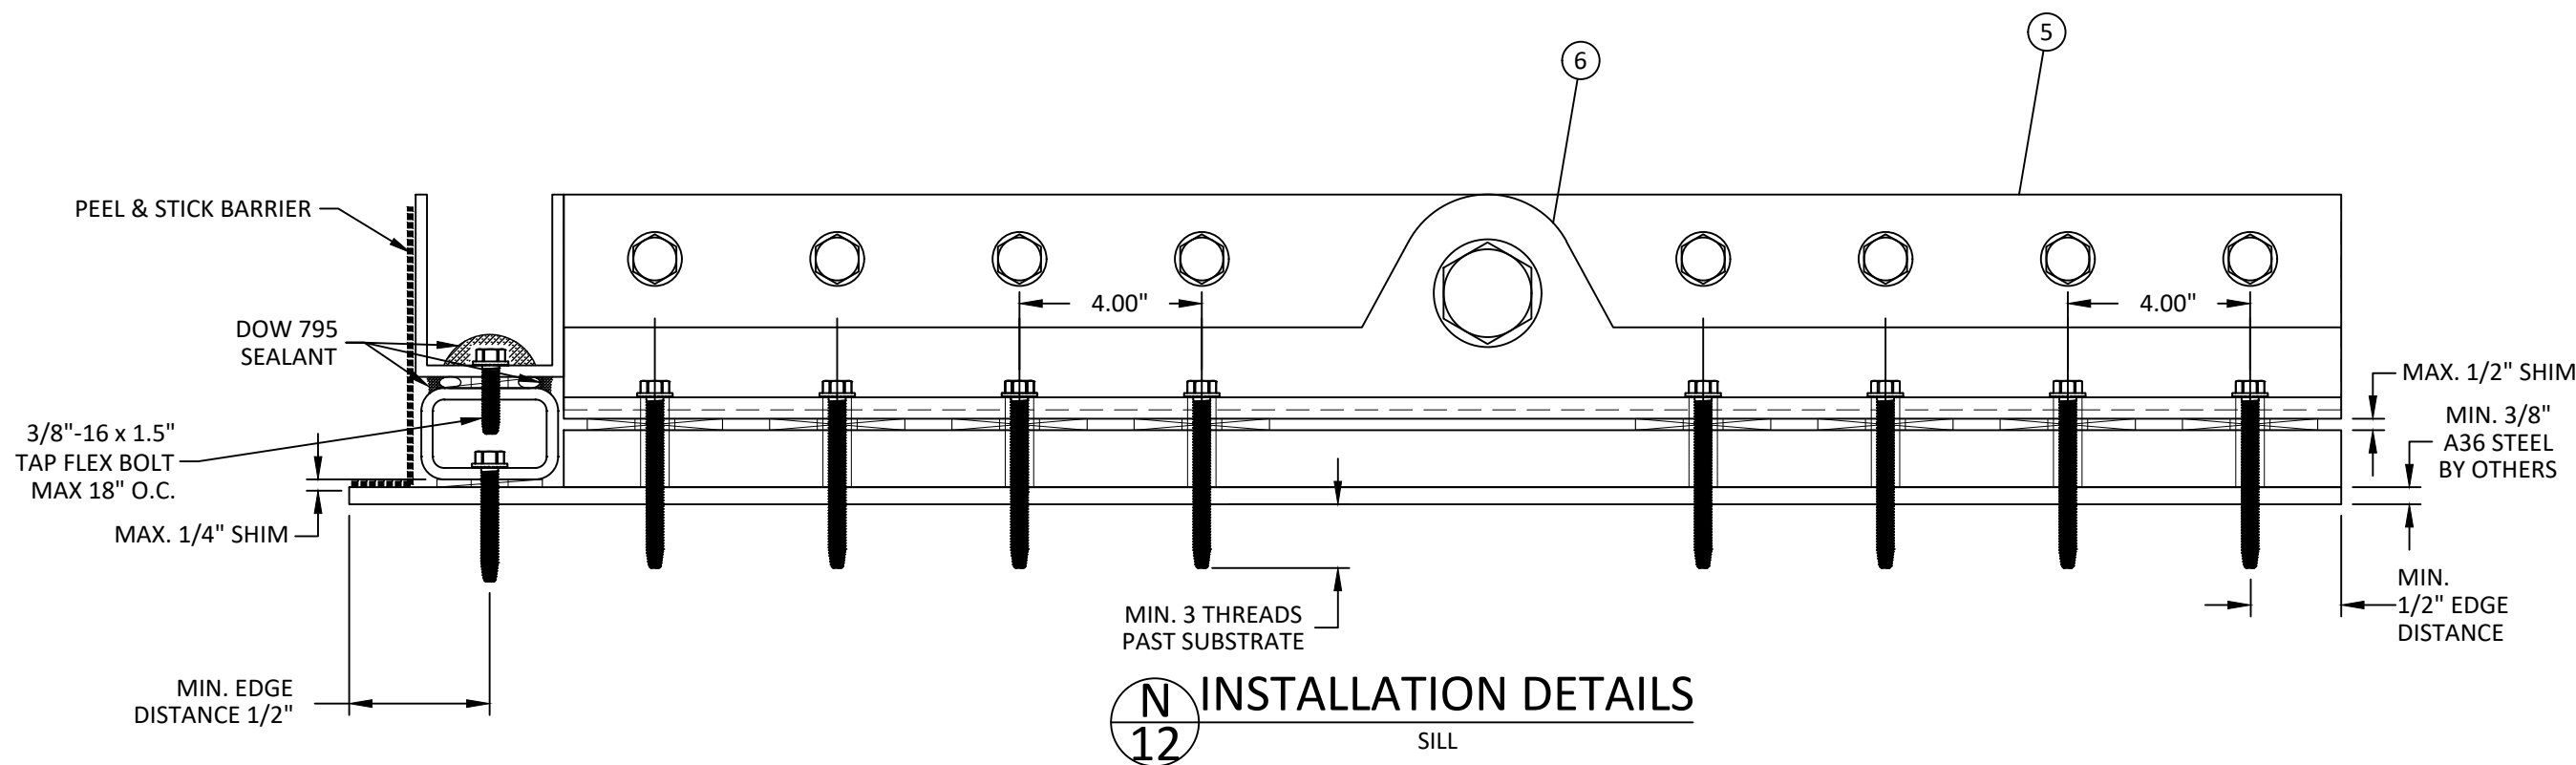


NOTE: SILL SHOWN, HEAD SIMILAR

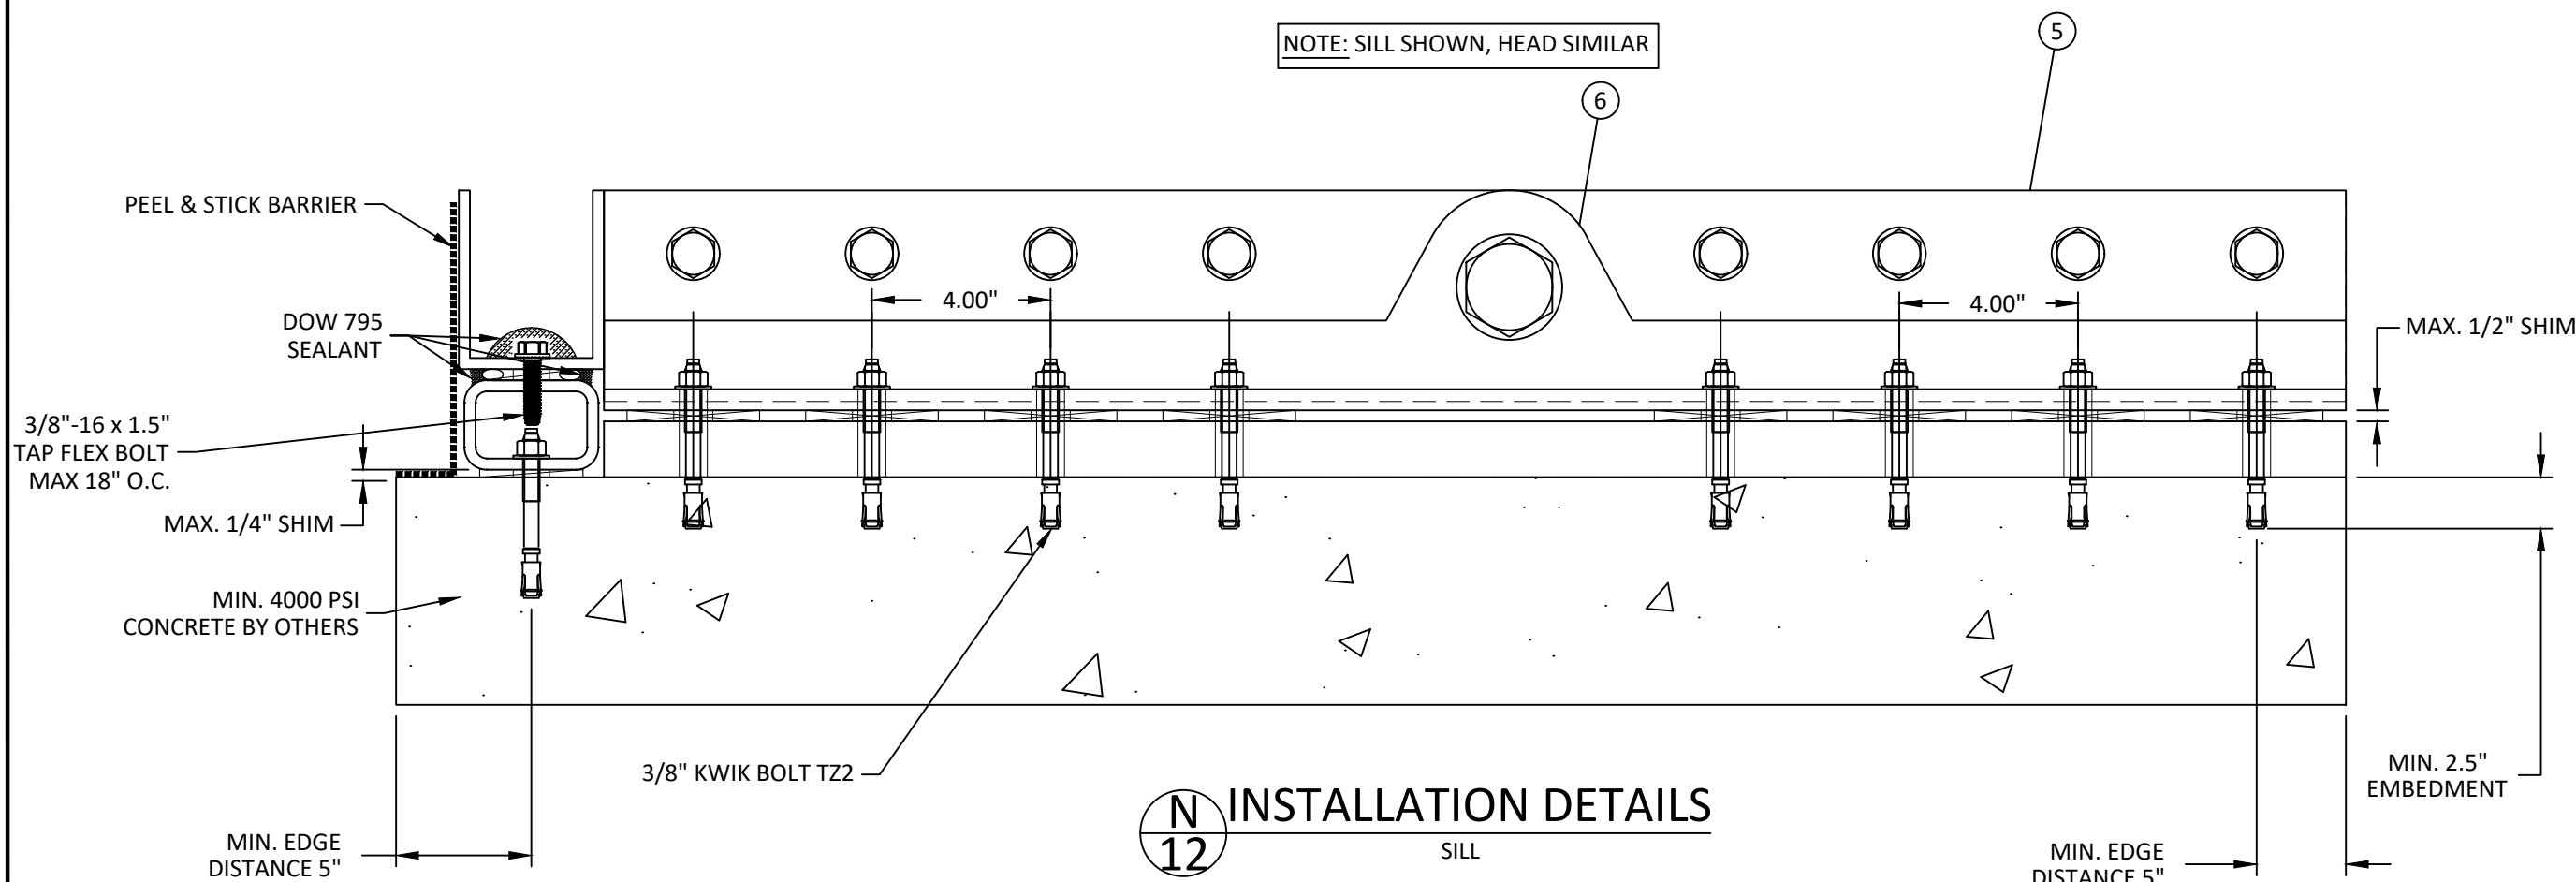


BILL OF MATERIALS		
NO.	DESCRIPTION	MATERIAL
1	GLAZING CHANNEL	ALUM. 6063-T5
2	FIN SILL	ALUM. 6063-T5
3	3" X 2" X 1/4" HSS	A-36 MIN. STEEL
4	FIN PIN JOINT ANGLE	STEEL
5	FIN PIN JOINT PLATE	STEEL
6	FIN PIN JOINT ANGLE	STEEL
7	STARTER PLATE	STEEL
8	DEAD LOAD SHELF	ALUM. 6063-T5
9	CORNER DEAD LOAD HANGER	ALUM. 6063-T5
10	SILL DEAD LOAD SHELF	ALUM. 6063-T5


1 GLAZING CHANNEL

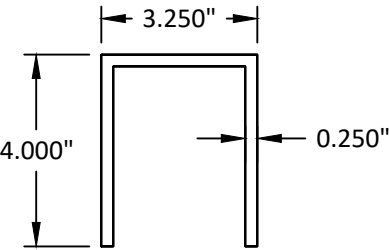



2 FIN SILL

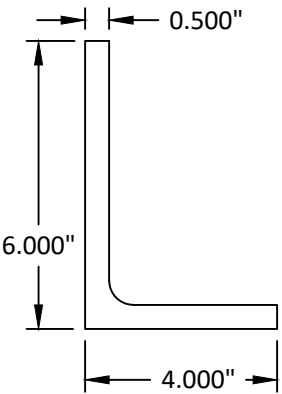


3 3" x 2" x 1/4" HSS

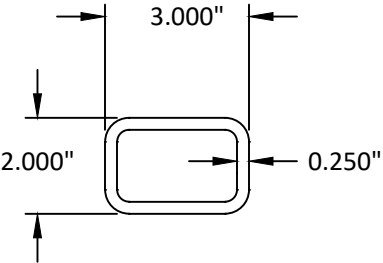


6 FIN PIN JOINT ANGLE

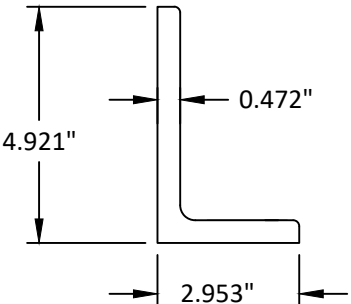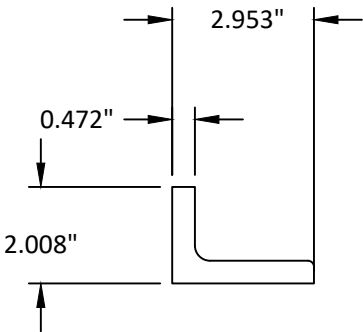


4 FIN PIN JOINT ANGLE

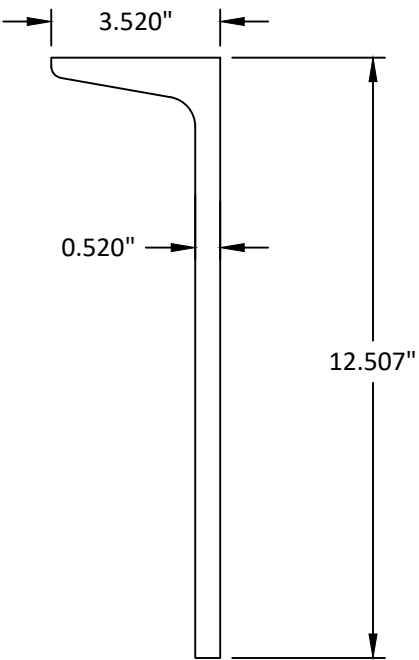

5 FIN PIN JOINT PLATE



8 STARTER PLATE
FIN PIN JOINT SELECTION

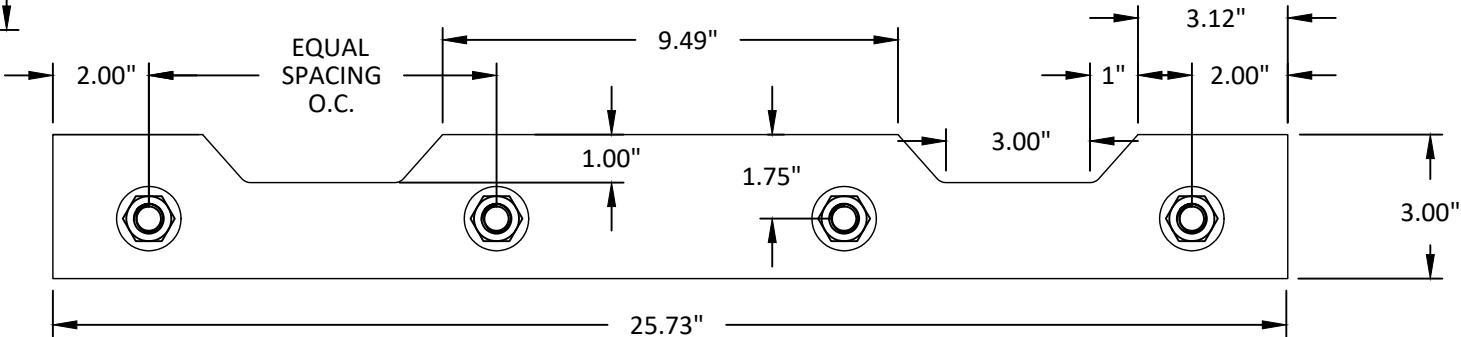

W & W GLASS, LLC
302 AIRPORT EXECUTIVE PARK
NANUET, NY 10954

TITLE:
W & W GLASS FIN SYSTEM
(NON-HVHZ) (NON-IMPACT)

BILL OF MATERIALS & COMPONENTS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

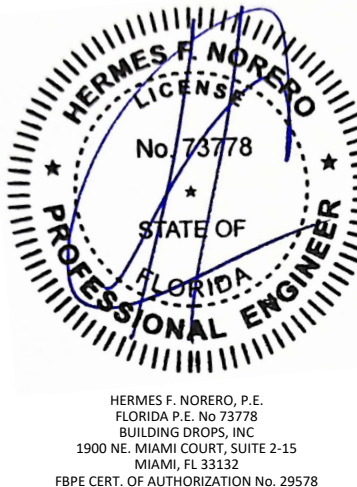

FL #:	FL42023
DATE:	2023.11.21
DWG. BY:	DI
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WWG002
SHEET:	14
REV.	A
OF 14	