

1. Gavita IMPACT PROTECTIVE SYSTEM WITH GV-60 END RETENTION SLAT SHOW ON THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) HAS BEEN VERIFIED FOR COMPLIANCE IN ACCORDANCE WITH THE 2026 (9th EDITION) OF THE FLORIDA BUILDING CODE.

2. THIS PRODUCT MAY BE INSTALLED AT HIGH VELOCITY HURRICANE ZONES. DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTION 1620 OF THE ABOVE MENTIONED CODE USING **ASCE 7-22** AND SHALL NOT EXCEED THE MAXIMUM (A.S.D.) DESIGN PRESSURE RATINGS INDICATED BELOW.
IN ORDER TO VERIFY THE ABOVE CONDITION , ULTIMATE DESIGN WIND LOADS DETERMINED PER **ASCE 7-22** SHALL BE FIRST REDUCED TO A.S.D. DESIGN WIND LOADS BY MULTIPLYING THEM BY 0.6 IN ORDER TO COMPARE THESE W/MAX. (A.S.D.) DESIGN PRESSURE RATINGS INDICATED BELOW AND ON SHEETS 8 THRU 11, 13 THRU 15, 17, 18 AND 19 THRU 21.

MAXIMUM A.S.D. DESIGN PRESSURE RATING + 60.0 psf, -60.0 psf, 9Lb, 2"X4" 50ft/Sec MISSILE.

IN ORDER TO VERIFY THAT COMPONENTS AND ANCHORS ON THIS P.E.D. AS TESTED WERE NOT OVER STRESSED, A 33% INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS **NOT** USED IN THEIR ANALYSIS. FASTENERS SPACING TO WOOD HAVE BEEN DETERMINED IN ACCORDANCE WITH ANSI/AWC NDS-2024. THIS PRODUCT ADEQUACY FOR IMPACT AND WIND RESISTANCE HAS BEEN VERIFIED IN ACCORDANCE WITH SECTION 1626 OF THE ABOVE MENTIONED CODE AS PER BLACKWATER TEST LAB. REPORT # BT-GIO-22-001 AS PER TAS-201, TAS-202 AND TAS-203 PROTOCOLS.

3. ALL ALUMINUM EXTRUSIONS SHALL BE AS INDICATED ON SHEET 2.

4. ALL ALUMINUM EXTRUSIONS IN CONTACT WITH DISSIMILAR MATERIALS SHALL COMPLY WITH SECTION III-6 OF THE 2020 ALUMINUM DESIGN MANUAL.

5. ALL SCREWS (EXCEPT WIND LOCK SCREW) TO BE STAINLESS STEEL 304 OR 316 SERIES WITH 50 Ksi YIELD STRENGTH AND 90 Ksi TENSILE STRENGTH. ALL S.D.S. ARE TEK SCREWS MANUFACTURED BY ITW BUILDEX W/ SILVER CLIMASEAL & SHALL COMPLY W/ FLORIDA BUILDING CODE SECTIONS 2411.3.3.4 & 1711.

6. BOLTS TO BE ASTM-307, GALVANIZED OR AISI 304 OR 316 SERIES STAINLESS STEEL WITH 36 Ksi MINIMUM YIELD STRENGTH.

7. ANCHORS TO WALL FOR ☺ SIDE RAIL SHALL BE AS FOLLOWS:*

A) TO EXISTING POURED CONCRETE: MIN. 3000 p.s.i. COMPRESSIVE STRENGTH.
-5/16" Ø TAPCON XL W/ SILVER CLIMASEAL ANCHORS OR 5/16" ULTRACONS AS MANUFACTURED BY ITW BUILDEX, INC. AND DEWALT, RESPECTIVELY.
-3/8" Ø S.S. KIWIK BOLT 3 ANCHORS AS MANUFACTURED BY HILTI, INC

A.1) MINIMUM EMBEDMENT INTO POURED CONCRETE SHALL BE:
2 1/4" FOR 5/16" Ø TAPCON XL OR ULTRAICON ANCHORS FOR 3/8" Ø KIWIK BOLT 3 ANCHORS. NO EMBEDMENT INTO STUCCO SHALL BE CONSIDERED AS PART OF THE REQUIRED EMBEDMENT.

A.2) MINIMUM EDGE DISTANCE (E.D.) INTO POURED CONCRETE SHALL BE:
3" FOR 5/16" Ø TAPCON XL & ULTRACONS, 4" FOR 3/8" Ø KIWIK BOLT3. EDGE DISTANCE IS BEYOND ANY FINISH MATERIAL.

A.3) IN CASE THAT PRECAST STONE, PRECAST CONCRETE OR BRICK PANELS, VENEER OR PAVERS BE FOUND ON THE EXISTING WALL, ANCHORS SHALL BE LONG ENOUGH TO REACH THE MAIN STRUCTURE BEHIND SUCH PANELS.

B) TO EXISTING MIN. f'c=2 Ksi GROUT FILLED CELL CONCRETE BLOCK WALL: ASTM C-90
-5/16" Ø TAPCON XL W/ SILVER CLIMASEAL OR 5/16" Ø ULTRAICON ANCHORS, AS MANUFACTURED BY ITW BUILDEX, INC. AND DEWALT, RESPECTIVELY.
-3/8" Ø S.S. KIWIK BOLT 3 ANCHORS AS MANUFACTURED BY HILTI INC.

B.1) MINIMUM EMBEDMENT OF 5/16"Ø TAPCON XL OR ULTRACONS INTO GROUT FILLED CELL CONCRETE BLOCK UNIT SHALL BE 2 1/4" & 2 1/2" FOR HILTI BOLT 3.
NO EMBEDMENT INTO STUCCO SHALL BE CONSIDERED AS PART OF THE REQUIRED EMBEDMENT.

B.2) MINIMUM EDGE DISTANCE (E.D.) OF 5/16"Ø TAPCON XL OR ULTRAICON ANCHORS & KIWIK BOLT 3 INTO GROUT FILLED CELL CONCRETE BLOCK SHALL BE 4". EDGE DISTANCE IS BEYOND ANY FINISH MATERIAL.

B.3) IN CASE THAT PRECAST STONE, PRECAST CONCRETE OR BRICKS PANELS, VENEER OR PAVERS BE FOUND ON THE EXISTING WALL ANCHORS SHALL BE LONG ENOUGH TO REACH THE MAIN STRUCTURE BEHIND SUCH PANELS.

C) TO EXISTING WOOD FRAME BUILDING: SPRUCE PINE -FIR-SOUTH (G-036). DOUGLAS-FIR-SOUTH (G=0.46) OR SOUTHERN PINE # 2 (G=0.55) MIN.
-5/16" Ø TAPCON XL W/ SILVER CLIMASEAL OR MAXISET W/ SILVER CLIMASEAL ANCHORS, AS MANUFACTURED BY ITW BUILDEX, INC. OR
-5/16" Ø DEWALT ULTRAICON OR 5/16" Ø STAINLESS STEEL WOOD SCREWS.

C.1) MINIMUM EMBEDMENT INTO THE WOOD FRAME UNIT SHALL BE 1 1/2" PHYSICAL THREADED PENETRATION. NO EMBEDMENT INTO FINISH MATERIAL SHALL BE CONSIDERED AS PART OF THE REQUIRED EMBEDMENT.

C.2) MINIMUM EDGE DISTANT (E.D.) OF ANCHORS INTO WOOD SHALL BE 2 1/4". EDGE DISTANCE IS BEYOND ANY FINISH MATERIAL.

C.3) IN CASE THAT PRECAST STONE, PRECAST CONCRETE OR BRICK PANELS, VENEER OR PAVERS BE FOUND ON THE EXISTING WALL, ANCHORS SHALL BE LONG ENOUGH TO REACH THE MAIN STRUCTURE BEHIND SUCH PANELS.

8. ANCHORS SHALL BE INSTALLED FOLLOWING ALL THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHOR'S MANUFACTURER.

9. ANCHORS REQUIRED FOR MULLION CONNECTIONS* TO CONCRETE SHALL BE AS SPECIFIED ON APPLICABLE SECTIONS SHOWN ON SHEETS 8, 9, 10 & 11.

- S.S. KWIK BOLT 3 S.S. EXPANSION ANCHOR MANUFACTURED BY HILTI, INC.
- CONFLX SCREW ANCHOR MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS.

ANCHOR	EDGE DISTANCE @ 100%	EMBEDMENT @ 100% CONCRETE	REQ'. MIN. THICKNESS FOR SUBSTRATE
1/2"Ø KWIK BOLT 3	8"	3 1/2" (3000 PSI)	6"
3/8"Ø KWIK BOLT 3	4 1/2"	2 3/8" (3000 PSI)	6"
3/8"Ø CONFLEX SCREW	4"	2 5/8" (3000 PSI)	6"
1/2"Ø CONFLEX	6"	3 1/2" (3000 PSI)	6"
5/8"Ø KWIK BOLT 3	7"	3 1/2" (3000 PSI)	6"

10. THE INSTALLATION CONTRACTOR IS TO SEAL/CAULK ALL PRODUCT EDGES WHICH REMAIN IN CONTINUOUS CONTACT WITH THE BUILDING TO PREVENT WIND/RAIN INTRUSION. CAULK AND SEAL PRODUCT TRACKS ALL AROUND FULL LENGTH.
11. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THE SOUNDNESS OF THE STRUCTURE WHERE PRODUCT IS TO BE ATTACHED TO INSURE PROPER ANCHORAGE. THIS PRODUCT SHALL ONLY BE ATTACHED TO CONCRETE, GROUTED CONCRETE BLOCK OR WOOD FRAME BUILDINGS.
12. THIS PRODUCT'S INSTALLATION SHALL COMPLY WITH ALL SPECS INDICATED IN THIS DRAWING PLUS ANY BUILDING AND ZONING REGULATIONS PROVIDED BY THE JURISDICTION.
13. LIFTING MECHANISM IS NOT PART OF THIS APPROVAL.
14. a) THIS P.E.D. PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT: ie. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.E.D.

b) CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT, BASED ON THIS P.E.D. PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT SITE IS THE CONTRACTORS' RESPONSIBILITY.

c) THIS P.E.D. WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.


d) SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.

e) THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.
15. PRODUCT MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION AT PRODUCT IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
ONE LABEL SHALL BE PLACED FOR EVERY OPENING. LABELING TO COMPLY WITH SECTION 1709.9.2 OF THE FLORIDA BUILDING CODE.

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
12/10/06


P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)						
©2026 TILTECO, INC.		IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I				W.H. DRAWN BY:
 TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 - Fax : (305)871-1531 CA--0006719 WALTER A. TILLIT JR. P.E. FLORIDA Lic. # 44167		gaviota The Sun & Shutter Specialists Cerrada de Acolfoneo 237, Bodega 48, Colonia San Sebastian, P.I. Pical Panfaco Ciudad de Mexico-02510				6/19/2026 DATE:
						26-044 DRAWING No.
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	SHEET 1 OF 21
1	OLD 23-190	6/19/26	3	-	-	
2	-	-	4	-	-	

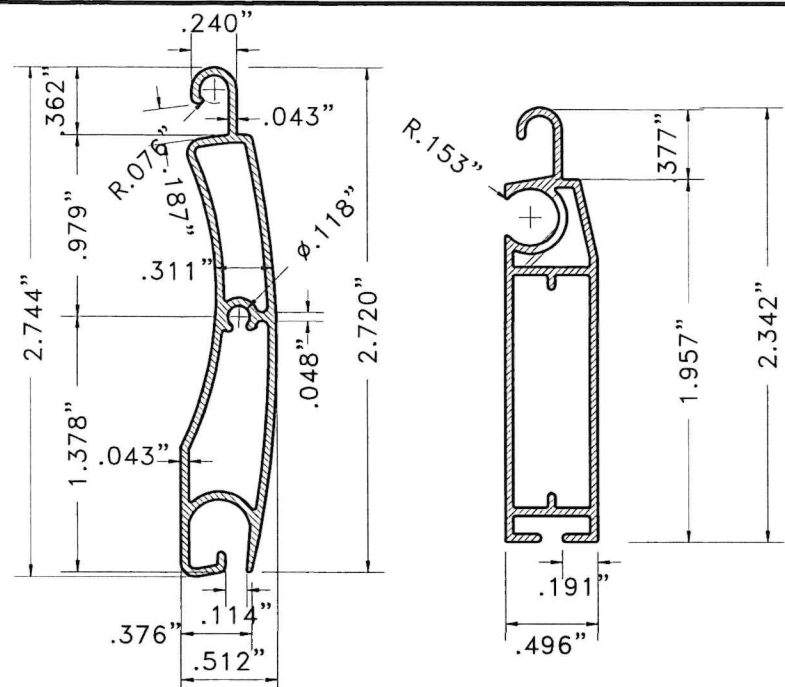


A GV-60 SLAT
6063-T5 ALUMINUM
ALLOY TEMPER


B BOTTOM SLAT
6063-T5 ALUMINUM
ALLOY TEMPER

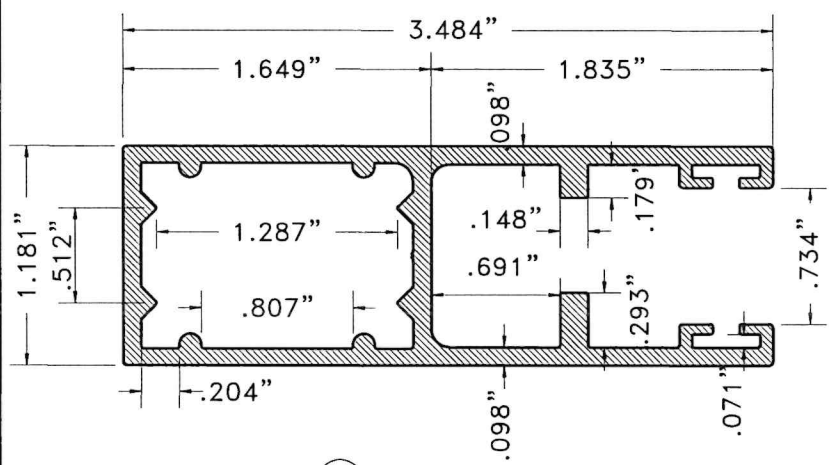


C SIDE RAIL
6063-T5 ALUMINUM
ALLOY TEMPER

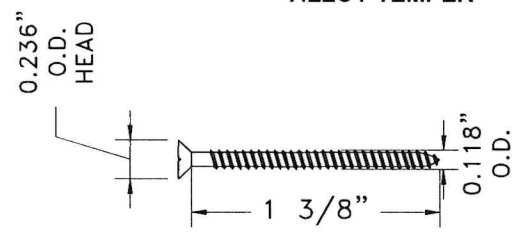


G END RETENTION SCREW AT EACH D
0.118" O.D. x 1 3/8" AISI 304
STAINLESS STEEL W/
XYLAN COATING

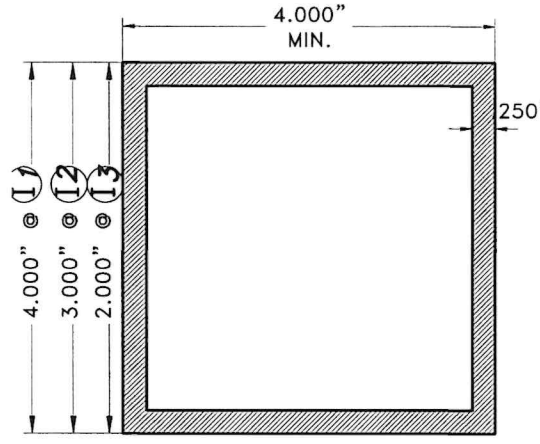


**I₁, I₂, I₃ BUILD-OUT
MOUNTED TUBE (MASONRY)**
6061-T6 ALUMINUM
ALLOY TEMPER

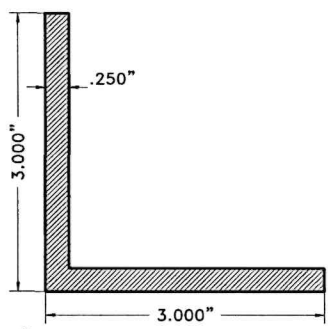


F TRAPPED ANGLE
6063-T6 ALUMINUM
ALLOY TEMPER




**H 1/4"Øx1" ITW/BUILDTEX
TEK SCREW**
410 STAINLESS STEEL

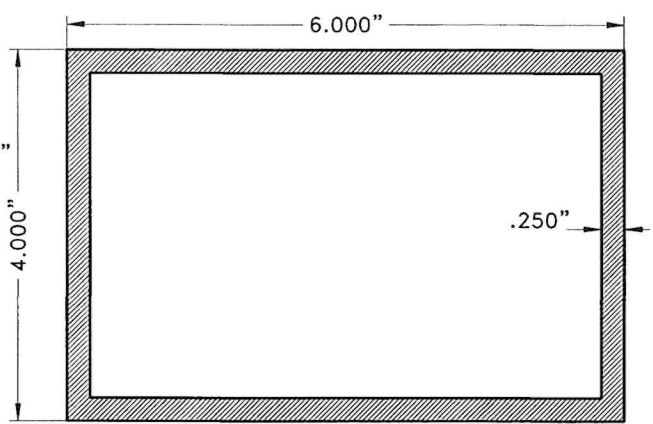


J 4" x 6" MULLION
6061-T6 ALUMINUM
ALLOY TEMPER

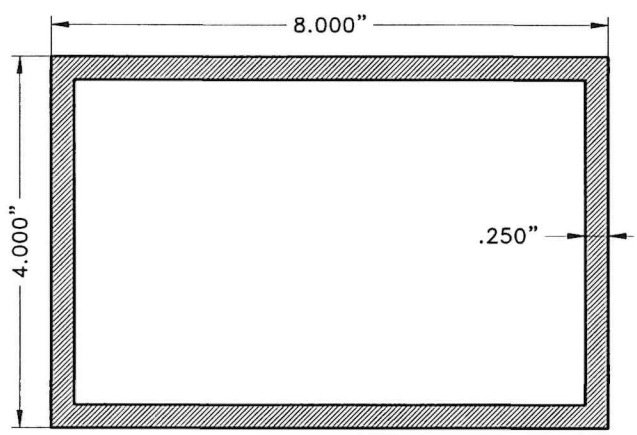


K 4" x 8" MULLION
6061-T6 ALUMINUM
ALLOY TEMPER

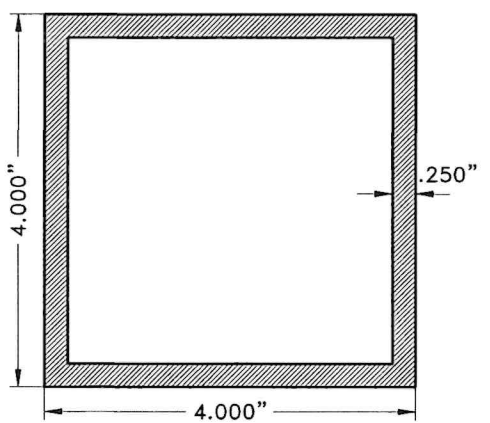


L 4" x 4" MULLION
6061-T6 ALUMINUM
ALLOY TEMPER

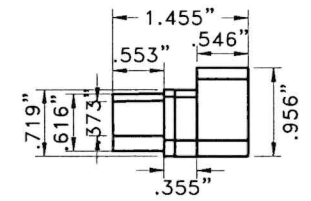


PLAN VIEW




ISOMETRIC VIEW

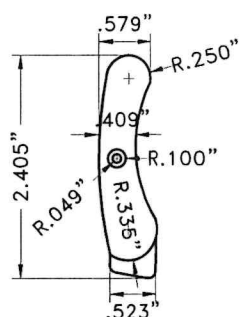


FRONT VIEW

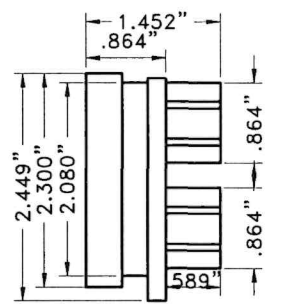

LEFT VIEW

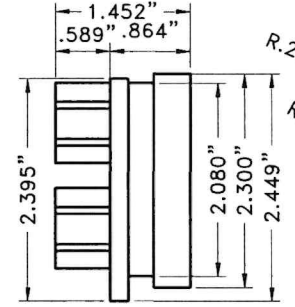


RIGHT VIEW

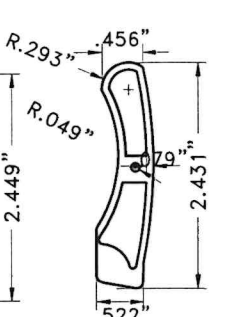


REAR VIEW

D SLAT LOCK GUIDE @ EVERY SLAT
FOR END RETENTION SYSTEM
AKULON 6-D PA6 POLYAMIDE
9400 psi Yield Stress

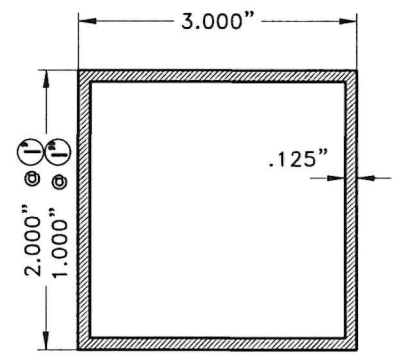

**I' & I'' BUILD-OUT
MOUNTED TUBE (WOOD)**
6063-T6 ALUMINUM
ALLOY TEMPER

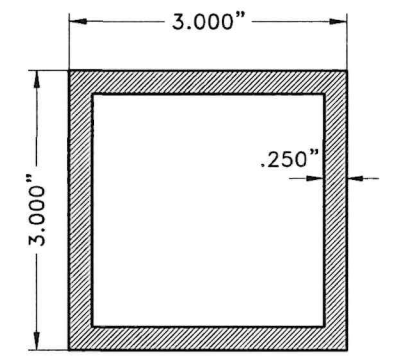



**I TRAPPED MOUNTED
TUBE (OPTION TO F)**
6063-T6 ALUMINUM
ALLOY TEMPER

COMPONENTS

N.T.S.

WALTER A. TILLIT JR.
LICENSED PROFESSIONAL ENGINEER
No. 44167
STATE OF FLORIDA
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I		
TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167			gaviota The Sun & Shutter Specialists Cerrada de Acolofenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
2	-	-	4	-	-
			W.H. DRAWN BY: 6/19/2026 DATE: 26-044 DRAWING No. SHEET 2 OF 21		

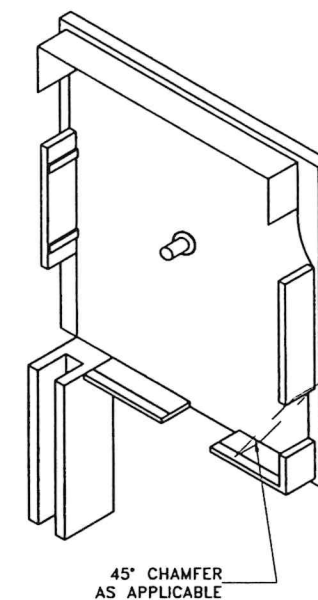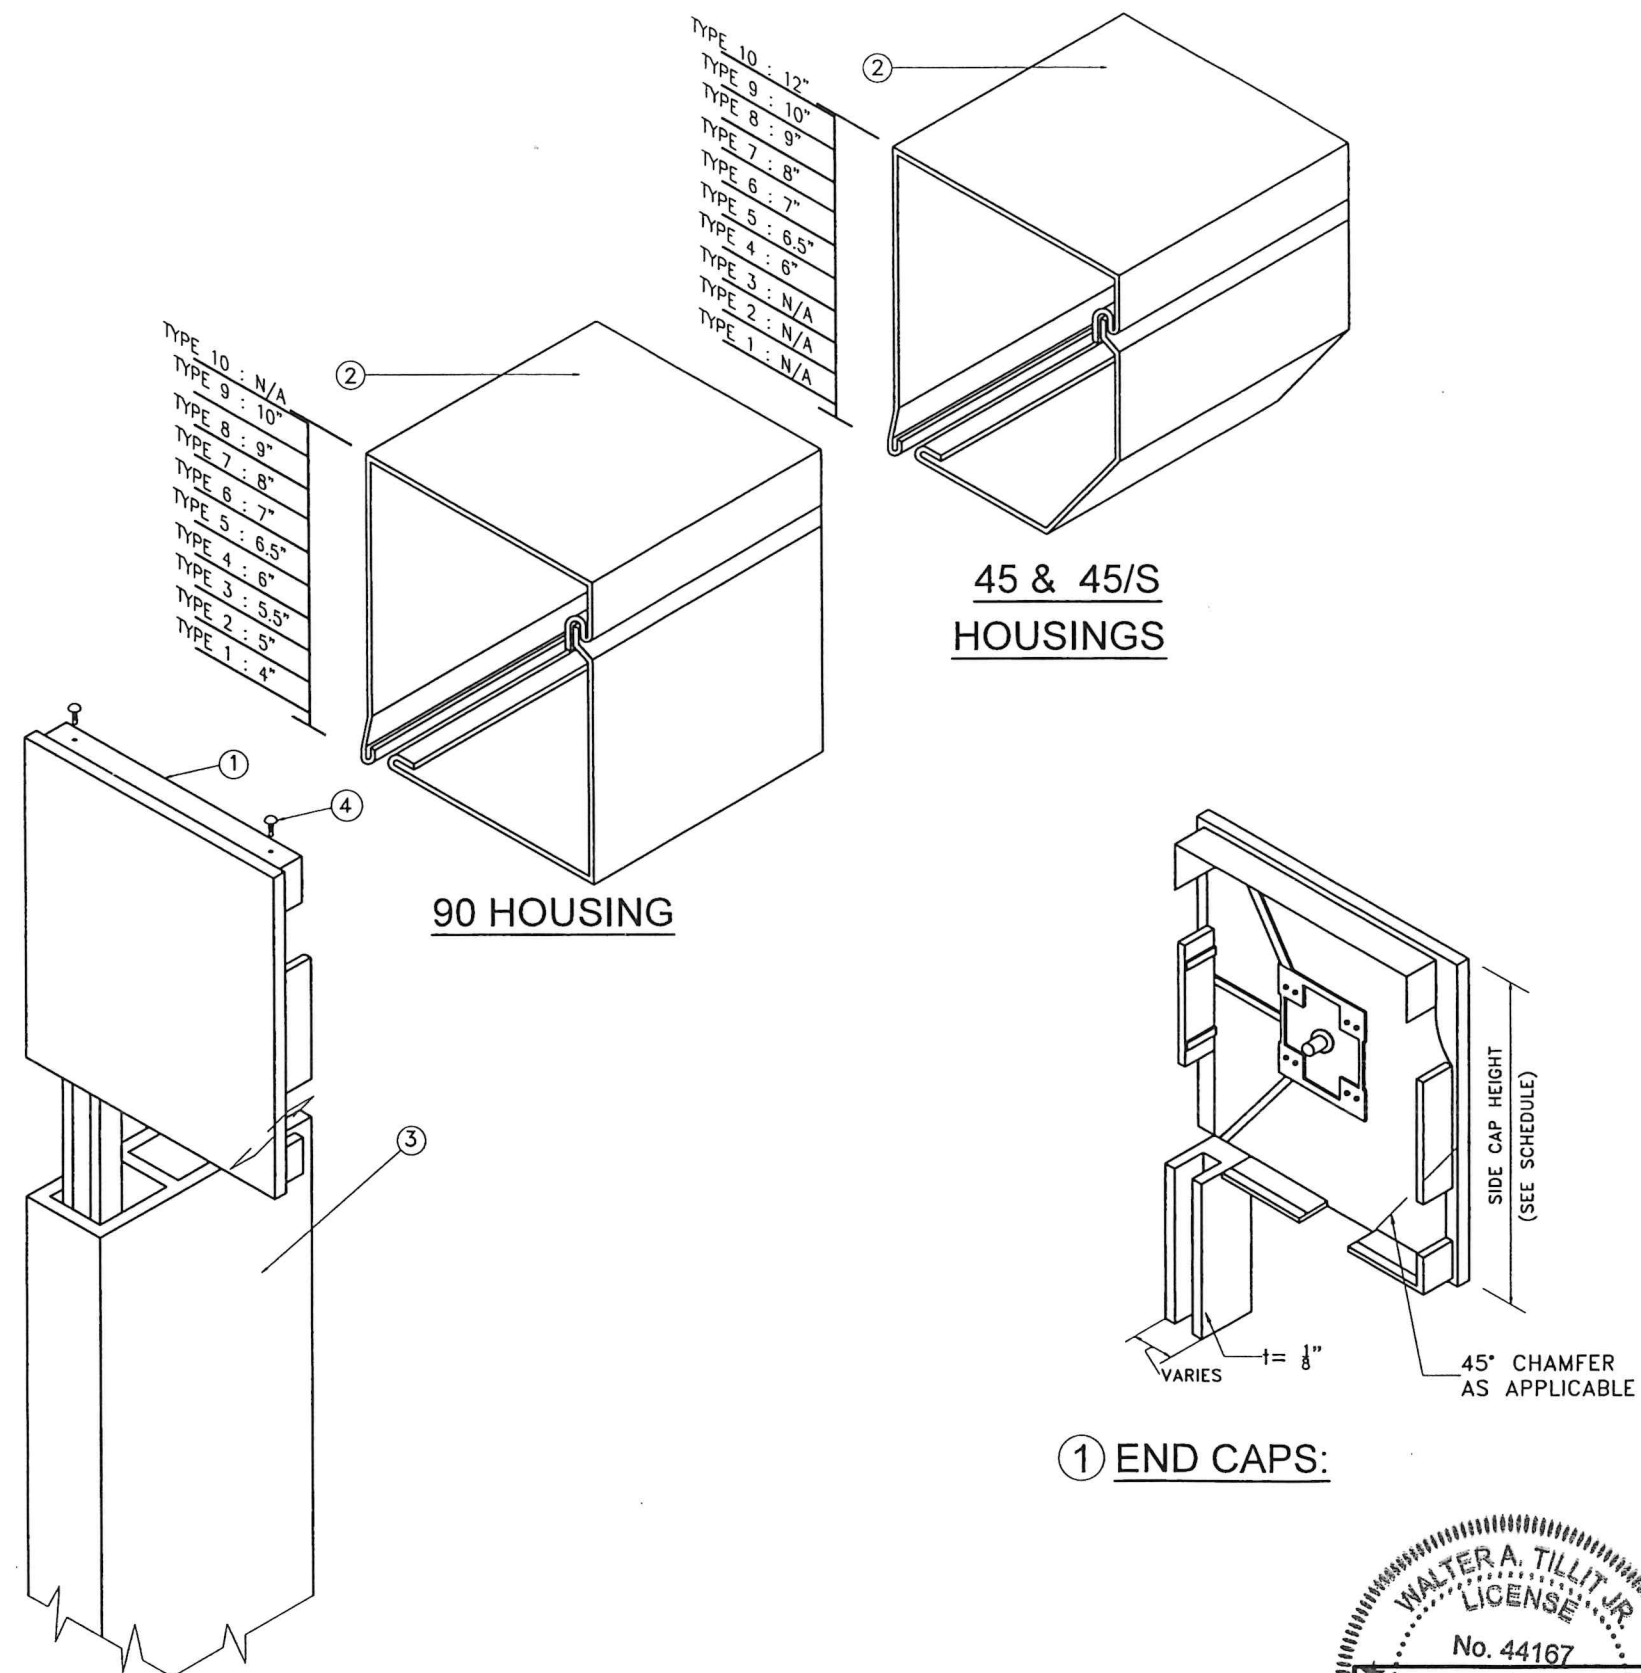

STRUCTURAL COMPONENTS FOR OPERATING SYSTEM

- ① - SIDE/END CAP (CAST ALUMINUM) *
② - HOUSING, 0.040" THICK SHEET METAL
(3105-H14 OR STRONGER)
③ - SIDE RAIL


FASTENERS

- ④ - 3/16" ALUMINUM POP RIVETS(6 REQ'D EA. SIDE CAP) : 2 @ TOP, 2 @ REAR, 2@ BOTTOM

* SHALL BE CAPABLE TO SUSTAIN SLAT'S WEIGHT AND ASSURE LIFTING MECHANISM (SEE NOTE 13/1)

① END CAPS:

BOX STRUCTURAL COMPONENTS AND ASSEMBLY DETAIL

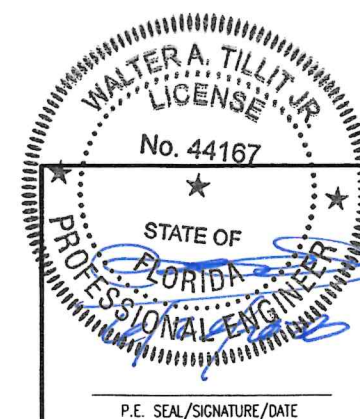

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2026 TILTECO, INC.

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33153
Phone : (305)871-1530 . Fax : (305)871-1531
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**IMPACT PROTECTIVE ROLLING SYSTEM
W/ GV-60 END RETENTION SLAT L.M.I**

gaviota

Cerrada de Acolotenco 237, Bodega 48,
Colonia San Sebastian, P.I. Pical Pantaca
Ciudad de Mexico-02510

W.H.
DRAWN BY:


6/19/2026
DATE:

26-044

DRAWING No.


SHEET 3 OF 21

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
			4		

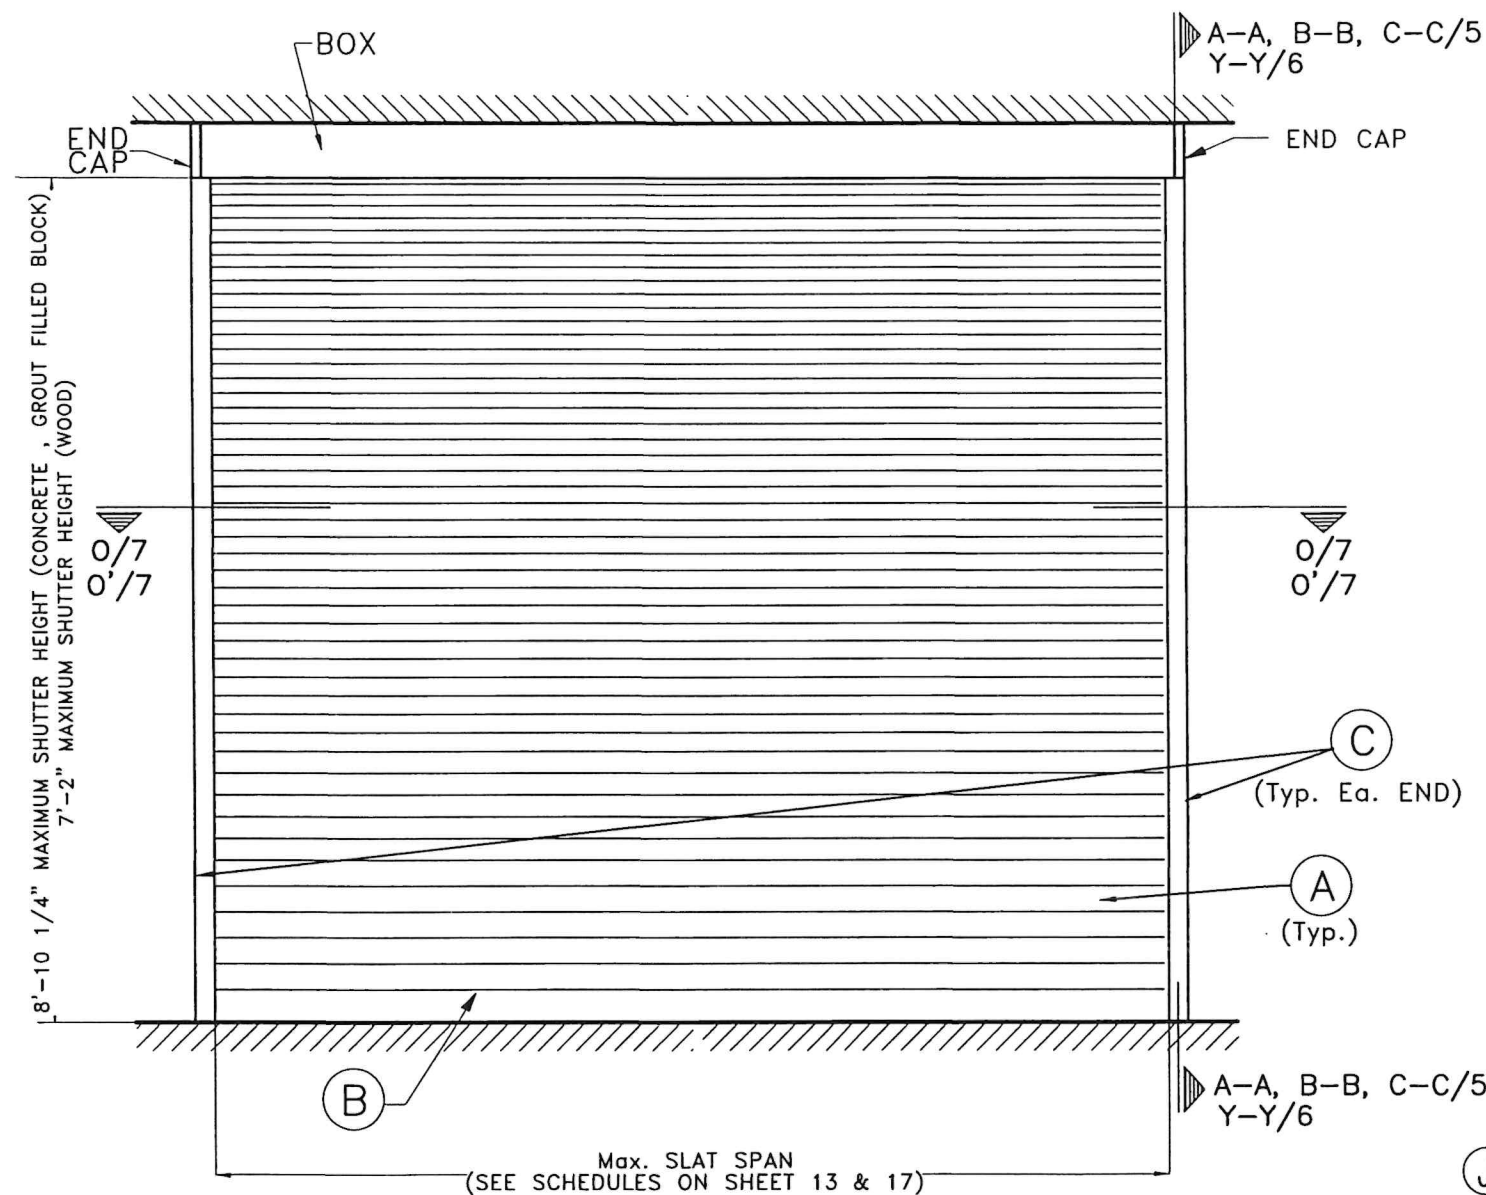


TYPICAL SINGLE UNIT ELEVATION
(CONCRETE, GROUTED BLOCK OR WOOD)

NOTE: SEE SHEETS 2 & 3 FOR COMPONENTS NOMENCLATURE.
 N.T.S.

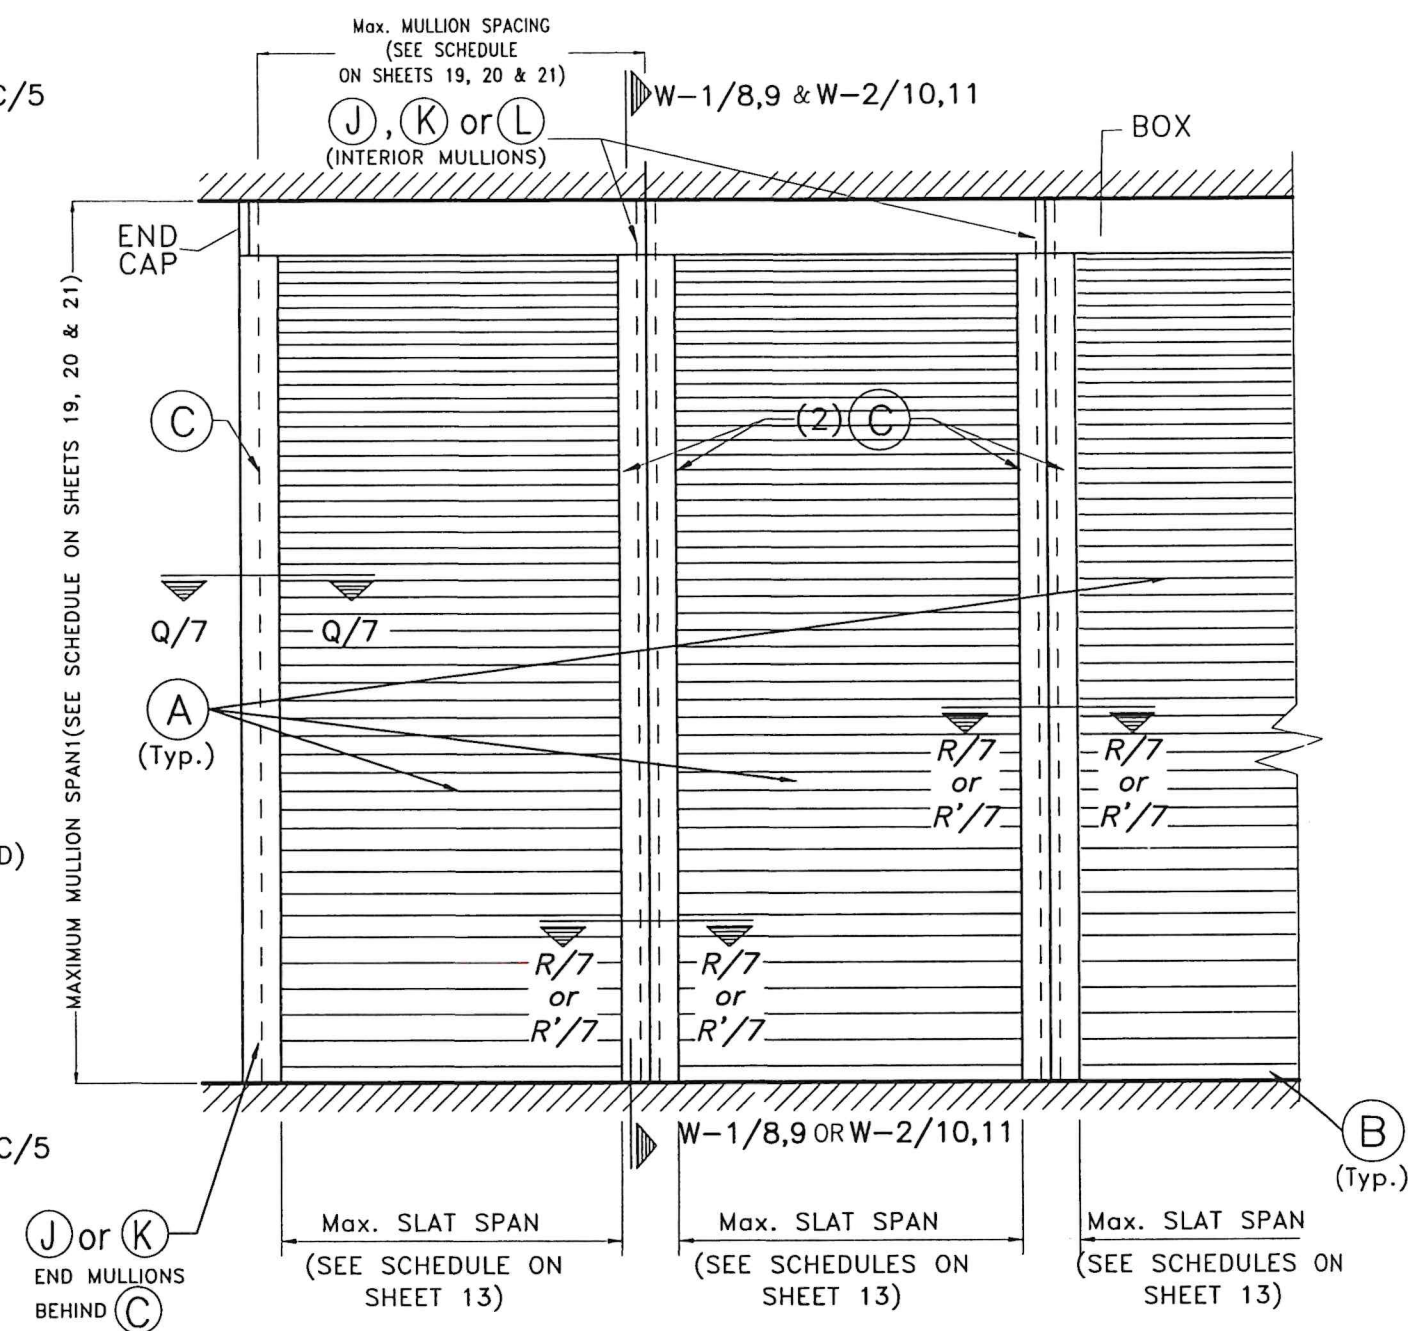


TYPICAL CONSECUTIVE SINGLE UNIT ELEVATION
W/ MULLION INTO POURED CONCRETE

NOTE: SEE SHEETS 2 & 3 FOR COMPONENTS NOMENCLATURE.
 N.T.S.

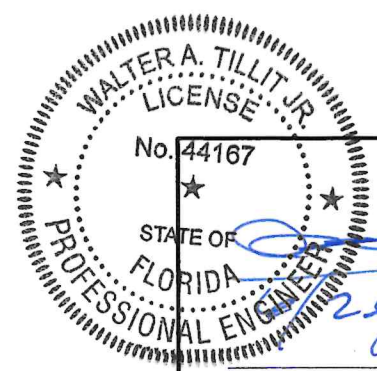


P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC. TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167			IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I gaviota The Sun & Shutter Specialists Cerrada de Acolotenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
2	-	-	4	-	-
			W.H. DRAWN BY: 6/19/2026 DATE: 26-044 DRAWING No. SHEET 4 OF 21		

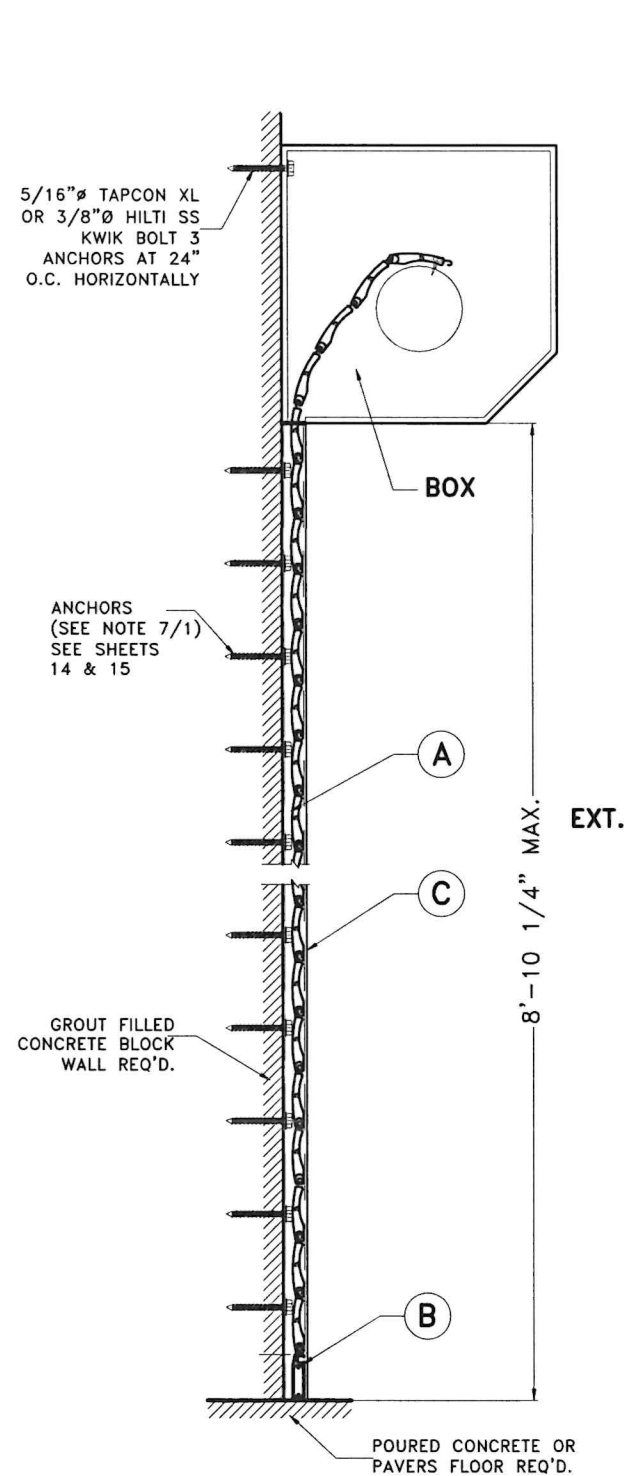


**SECTION A-A
(WALL MOUNTED)**
SCALE 1/8"=1"

**INSTALLATION DETAILS ON EXISTING
POURED CONCRETE OR GROUT FILLED
CONCRETE BLOCK WALL BUILDINGS**

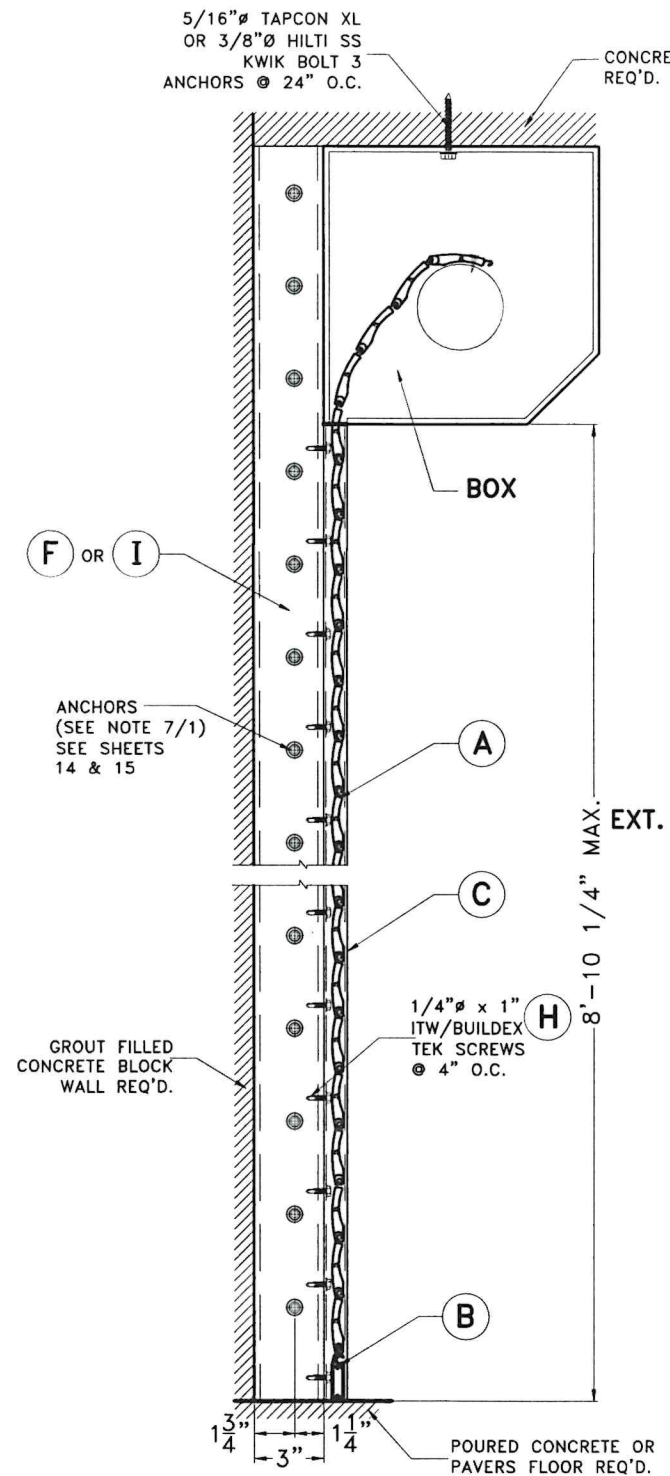


**SECTION B-B
(TRAPPED MOUNTED)**
SCALE 1/8"=1"

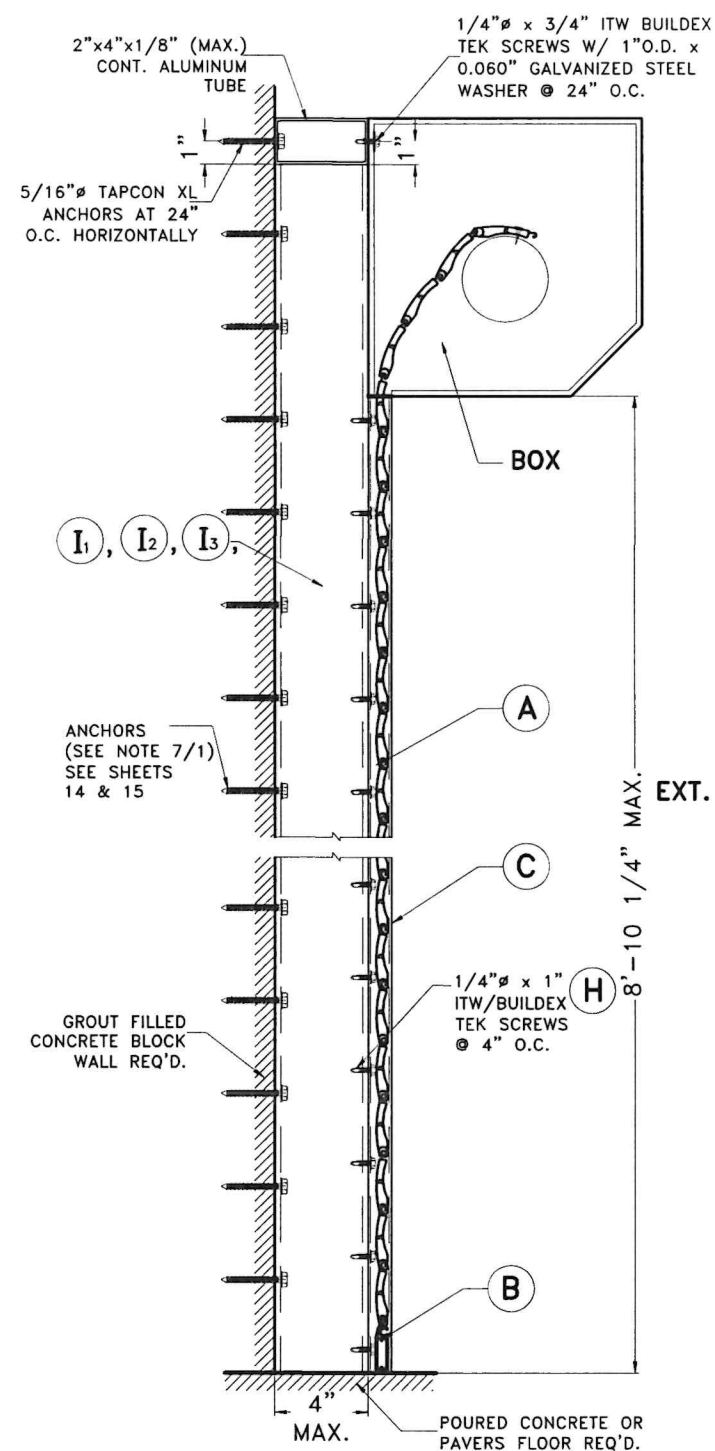

**SECTION C-C
(BUILD OUT)**
SCALE 1/8"=1"

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I		
TILTECO INC.			gaviota		
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 • Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167			The Sun & Shutter Specialists Carrada de Acolotenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
2	-	-	4	-	-
			W.H. DRAWN BY: 6/19/2026 DATE: 26-044 DRAWING No. SHEET 5 OF 21		

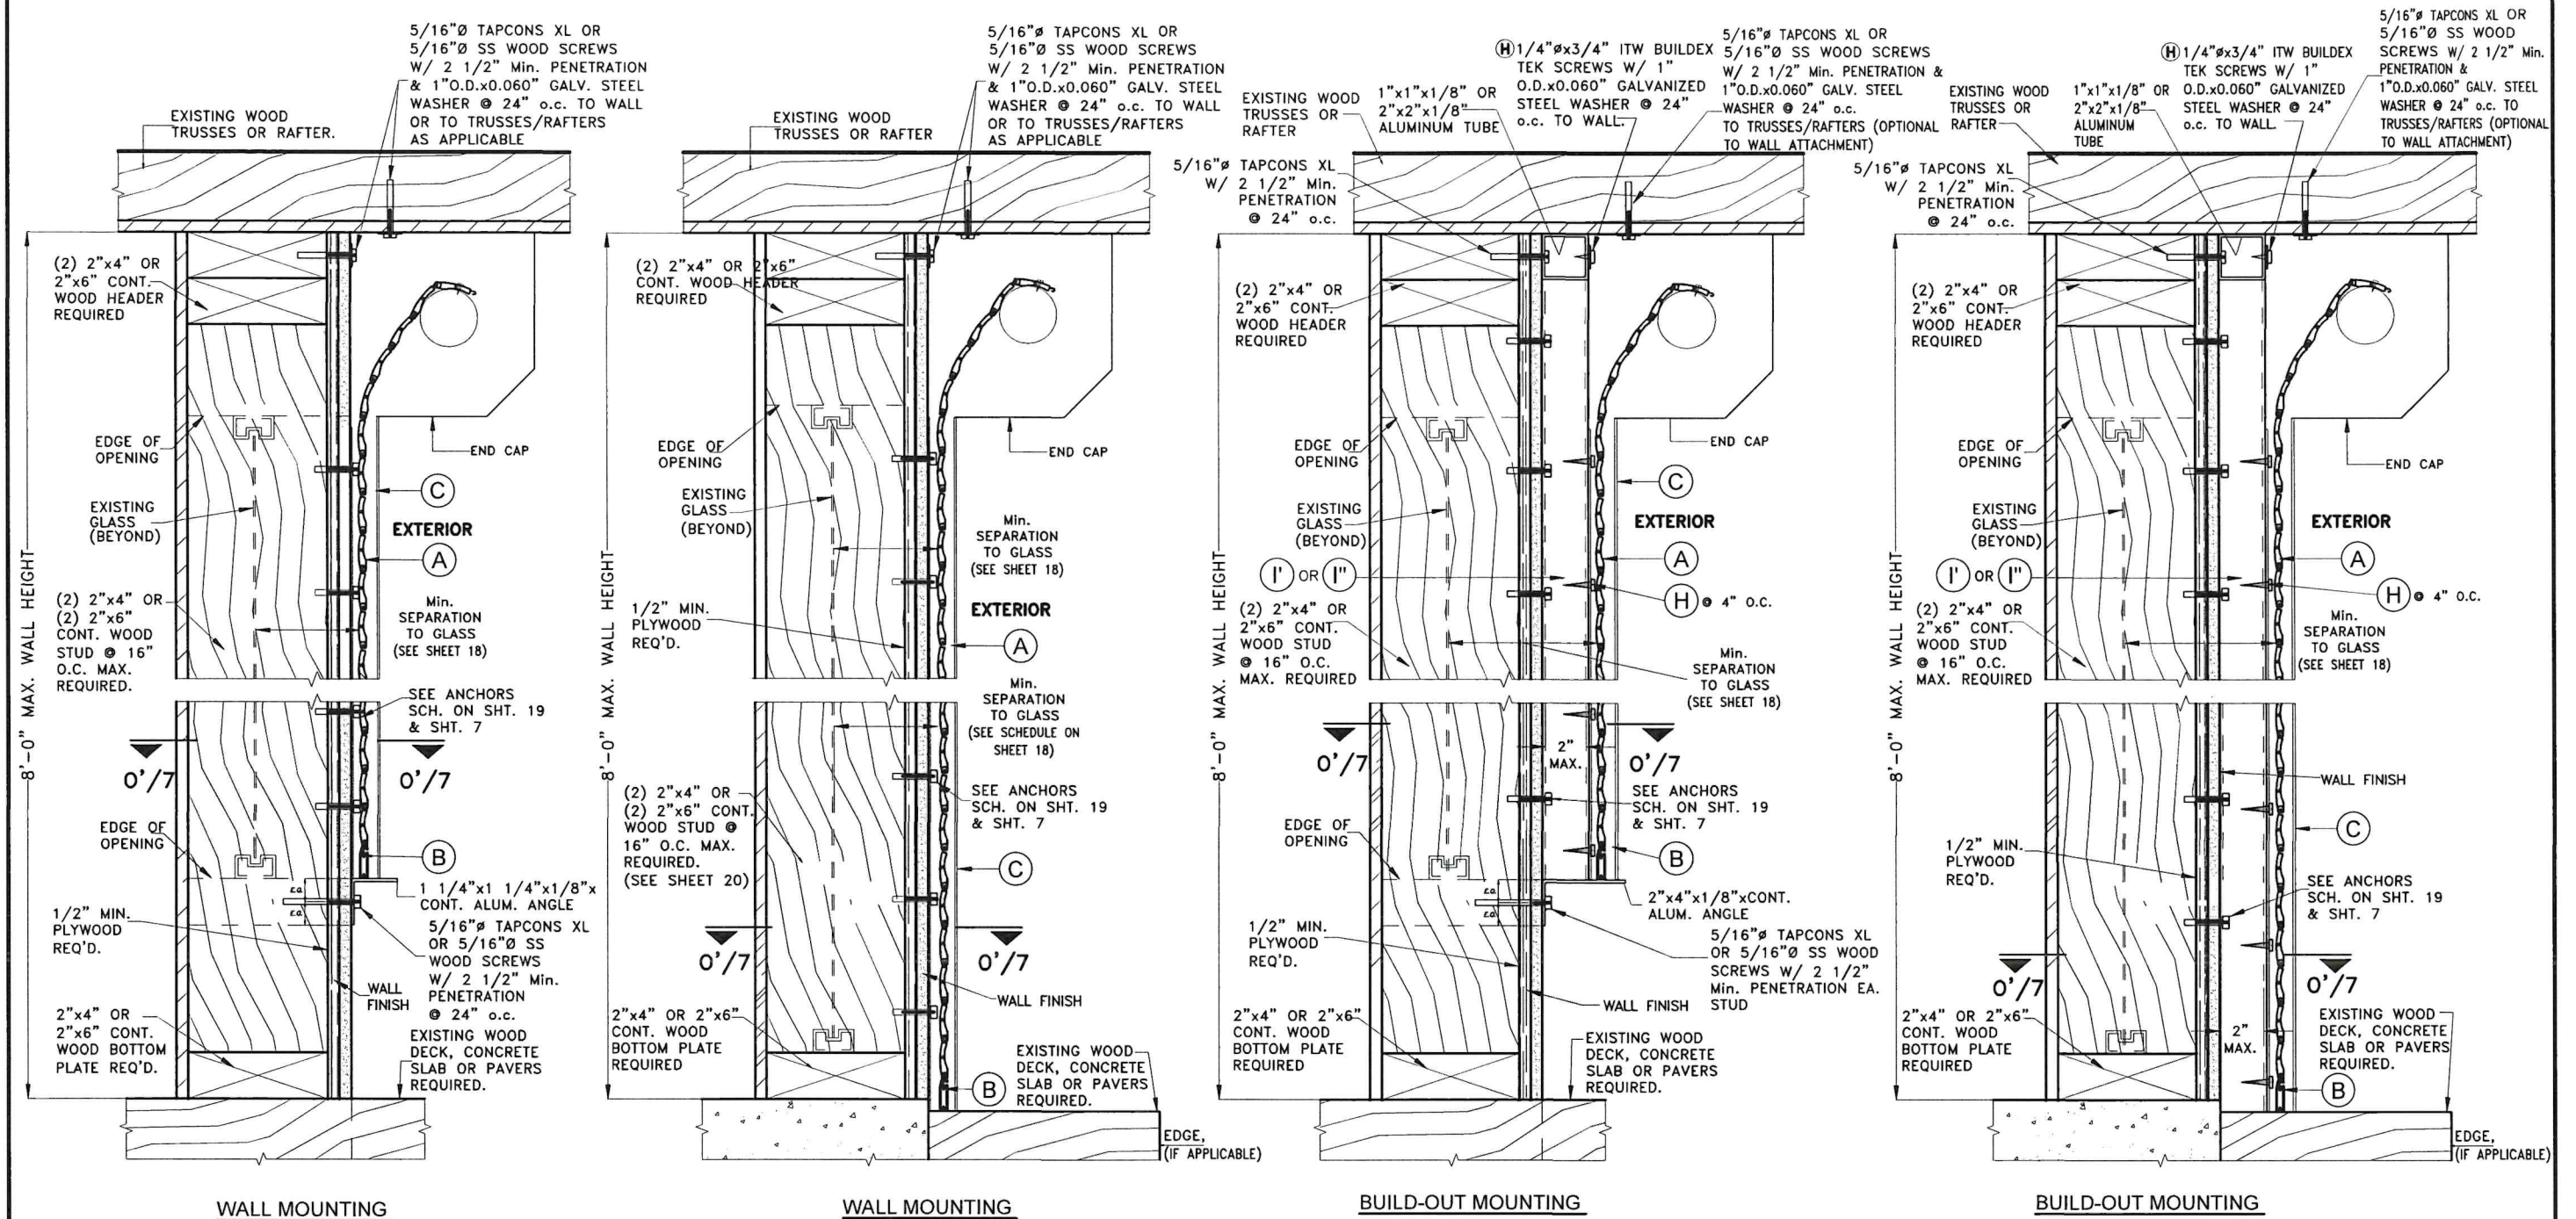


SECTIONS Y-Y




INSTALLATION DETAILS ON EXISTING WOOD BUILDINGS *

* SEE SHEETS 17 & 18 FOR LIMITATIONS AND ANCHOR SPACING REQUIREMENTS

N.T.S.

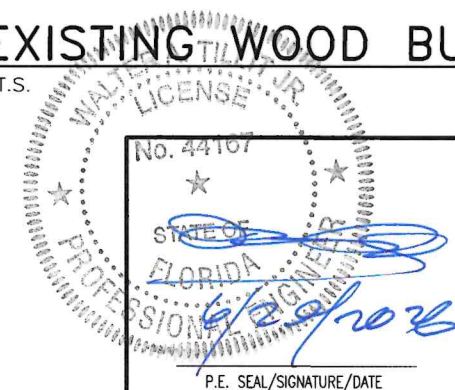


FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I.		
TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 • Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT JR. P.E. FLORIDA Lic. # 44167			gaviota The Sun & Shutter Specialists Cerrada de Acolotenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Panteco Ciudad de Mexico-02510		
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
2	-	-	4	-	-
W.H. DRAWN BY:			6/19/2026 DATE:		
26-044 DRAWING No.			SHEET 6 OF 21		

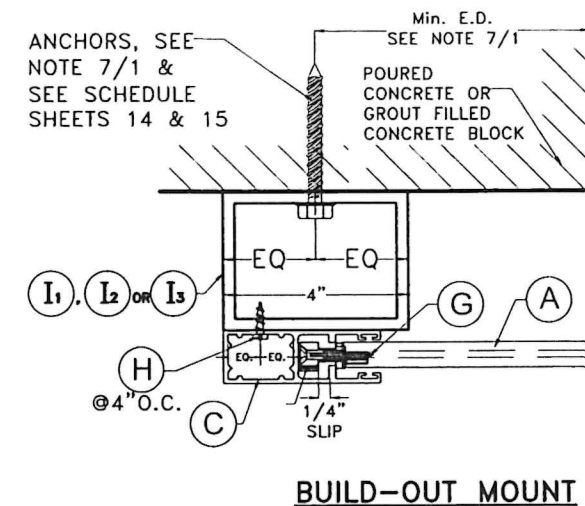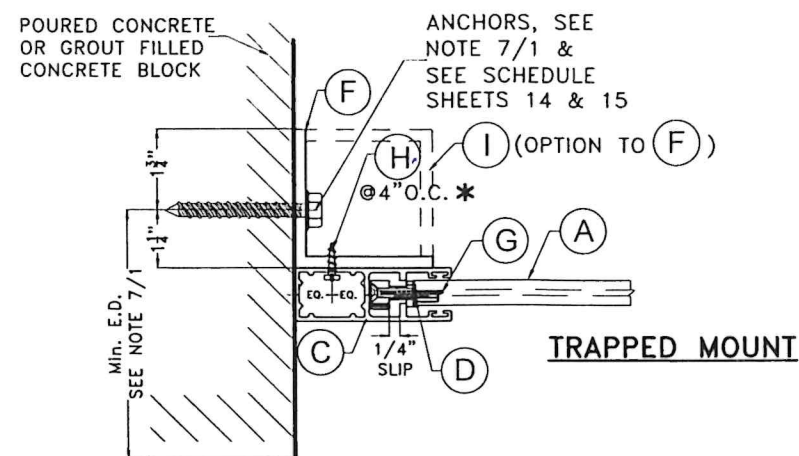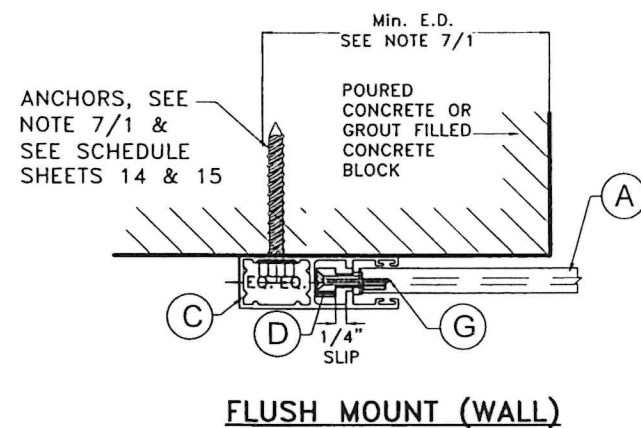


SECTIONS O-O (PLAN)


INSTALLATION DETAILS INTO EXISTING POURED CONCRETE OR GROUT FILLED CONCRETE BLOCK BUILDINGS

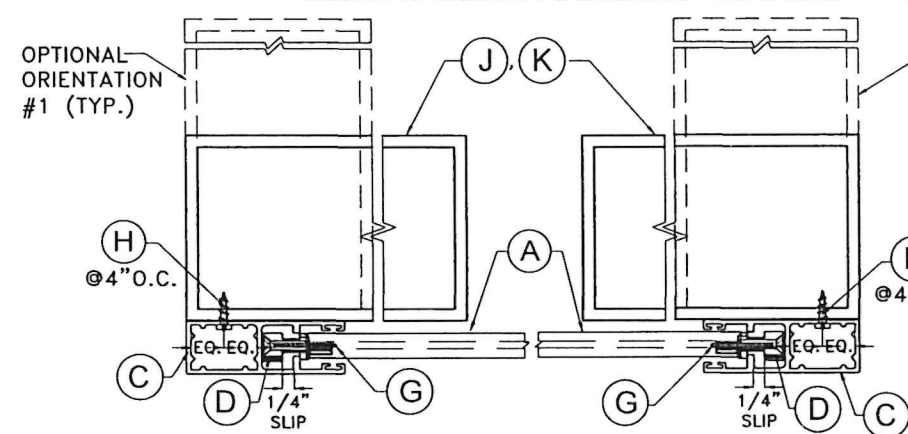


SECTION Q-Q (PLAN)
ORIENTATION #1 & #2
WALL MOUNT END MULLION

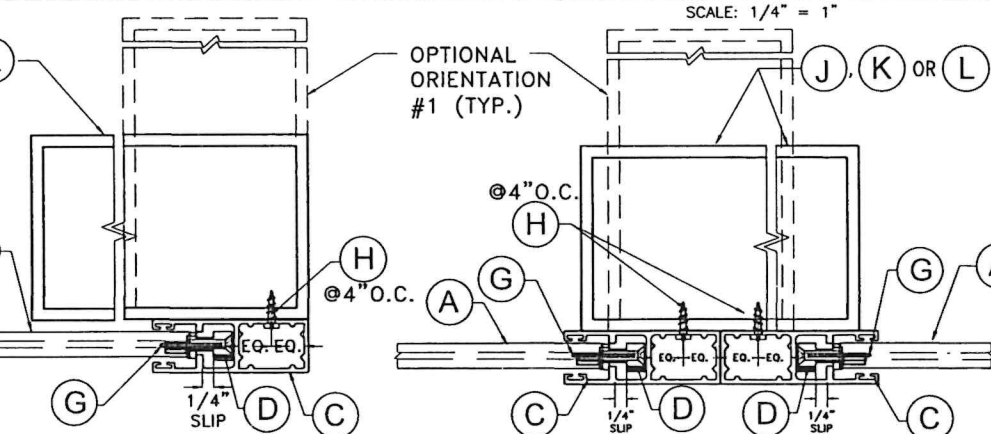

SECTION Q-Q (PLAN)
ORIENTATION #1 & #2
WALL MOUNT END MULLION

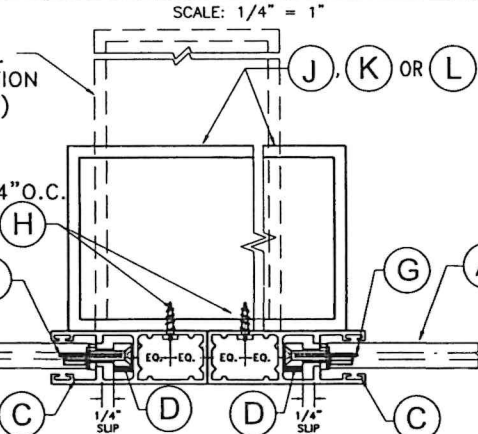


SECTION R-R (PLAN)
ORIENTATIONS #1 & #2
WALL MOUNT INTERIOR MULLION

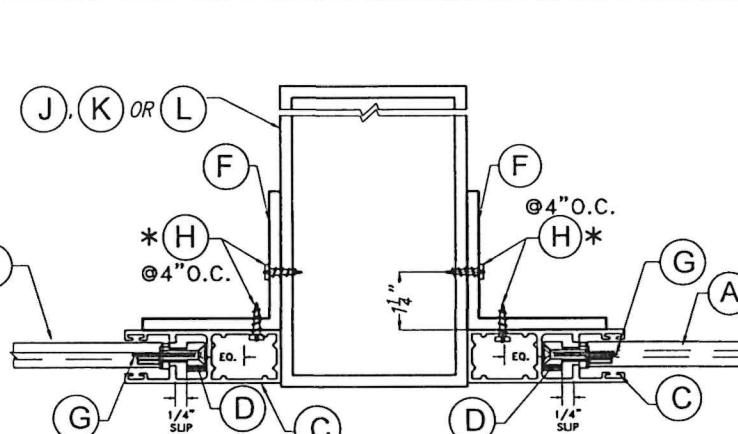


SECTION R'-R' (PLAN)
ORIENTATION #1
TRAPPED MOUNT INTERIOR MULLION

INSTALLATION DETAILS INTO MULLIONS J, K, L

SCALE: 1/4" = 1"

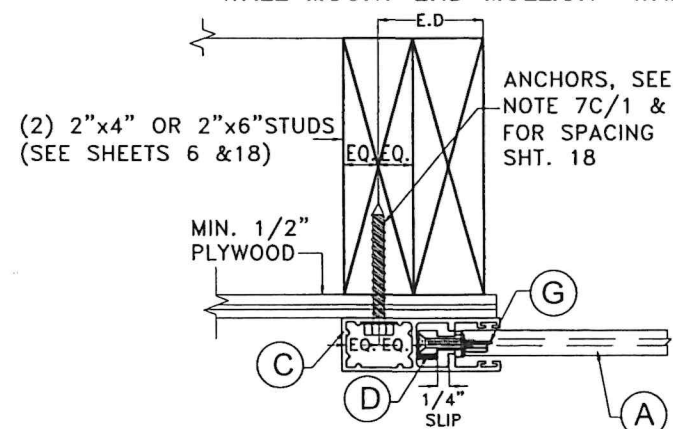

FLUSH MOUNT (WALL)

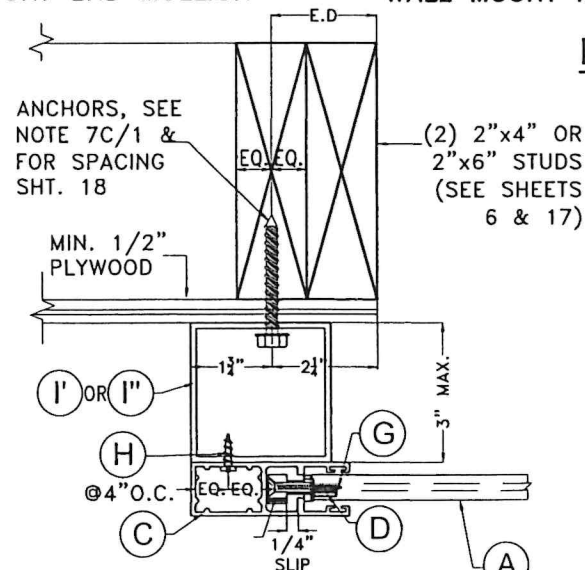


BUILD-OUT MOUNT

* ALTERNATIVELY TO (H), A 1/4"Ø-20x1" S.S. M.S. W/NUT MAY BE USED FOR THIS CONNECTION


SECTIONS O'-O' (PLAN)

INSTALLATION DETAILS INTO EXISTING WOOD BUILDINGS

SCALE: 1/4" = 1"

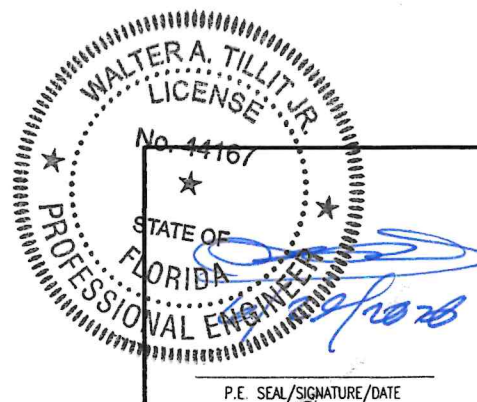

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I		W.H. DRAWN BY:
TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone: (305)871-1530 Fax: (305)871-1531 CA-0006719 WALTER A. TILLIT JR. P.E. FLORIDA Lic. # 44167			gaviota The Sun & Shutter Specialists Cerrada de Acolotenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510		6/19/2026 DATE:
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
2	-	-	4	-	-
26-044 DRAWING No.					SHEET 7 OF 21

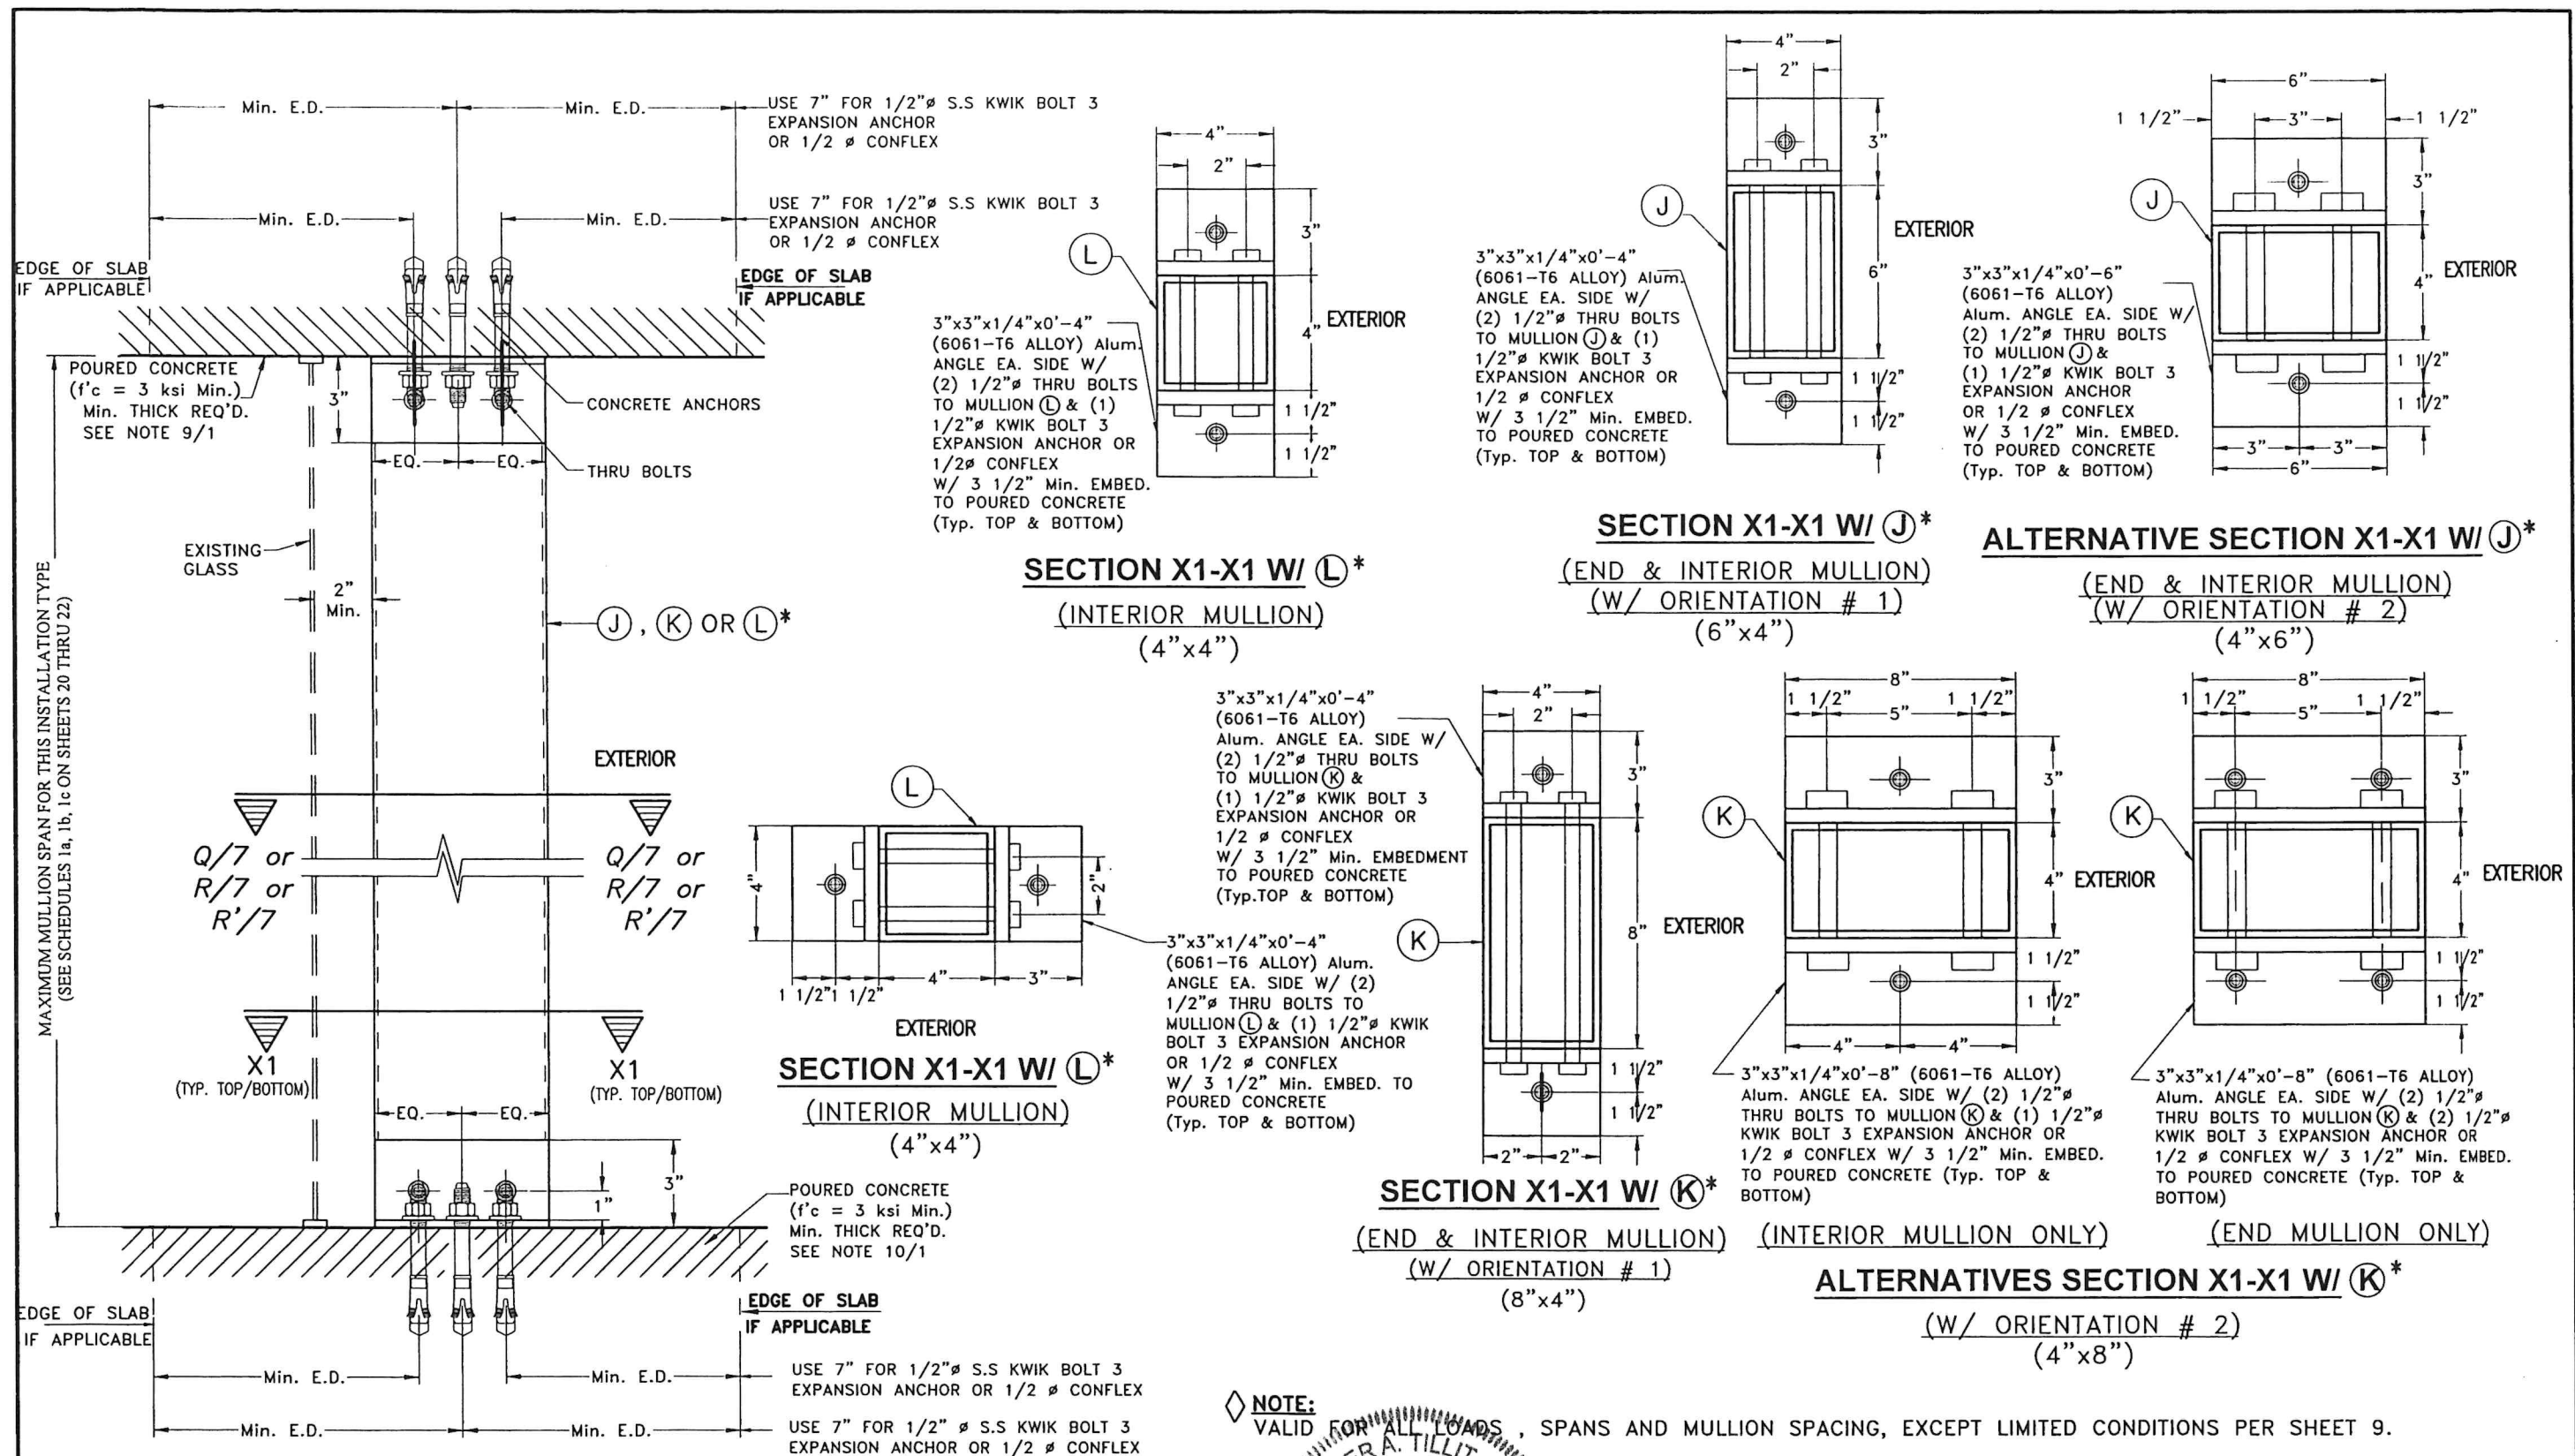

END & INTERIOR TRAPPED MOUNTED MULLION INSTALLATION


(TO BE USED W/ SCHEDULES 1a, 1b, 1c SHEETS 19, 20 & 21)

SCALE: 1/8" = 1"


* SIDE RAIL (C) AND BOX NOT SHOWN FOR CLARITY.

NOTE:

VALID FOR ALL LOADS, SPANS AND MULLION SPACING, EXCEPT LIMITED CONDITIONS PER SHEET 9.

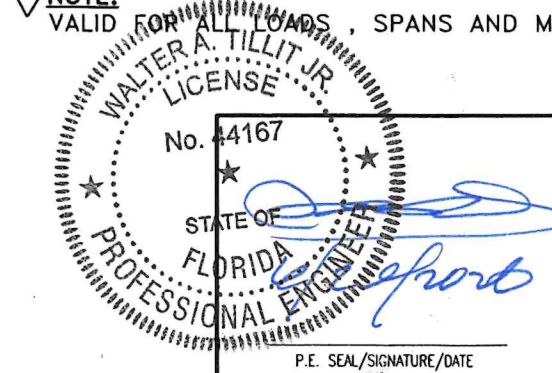

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I.		
TILLIT TESTING & ENGINEERING COMPANY 8355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone: (305) 871-1530 Fax: (305) 871-1531 CA-0006719 WALTER A. TILLIT JR. P.E. FLORIDA Lic. # 44167			gaviota The Sun & Shutter Specialists Carrada de Acolotenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	5/13/28	3	-	-
2	-	-	4	-	-
DRAWING No.					26-044
SHEET 8 OF 21					

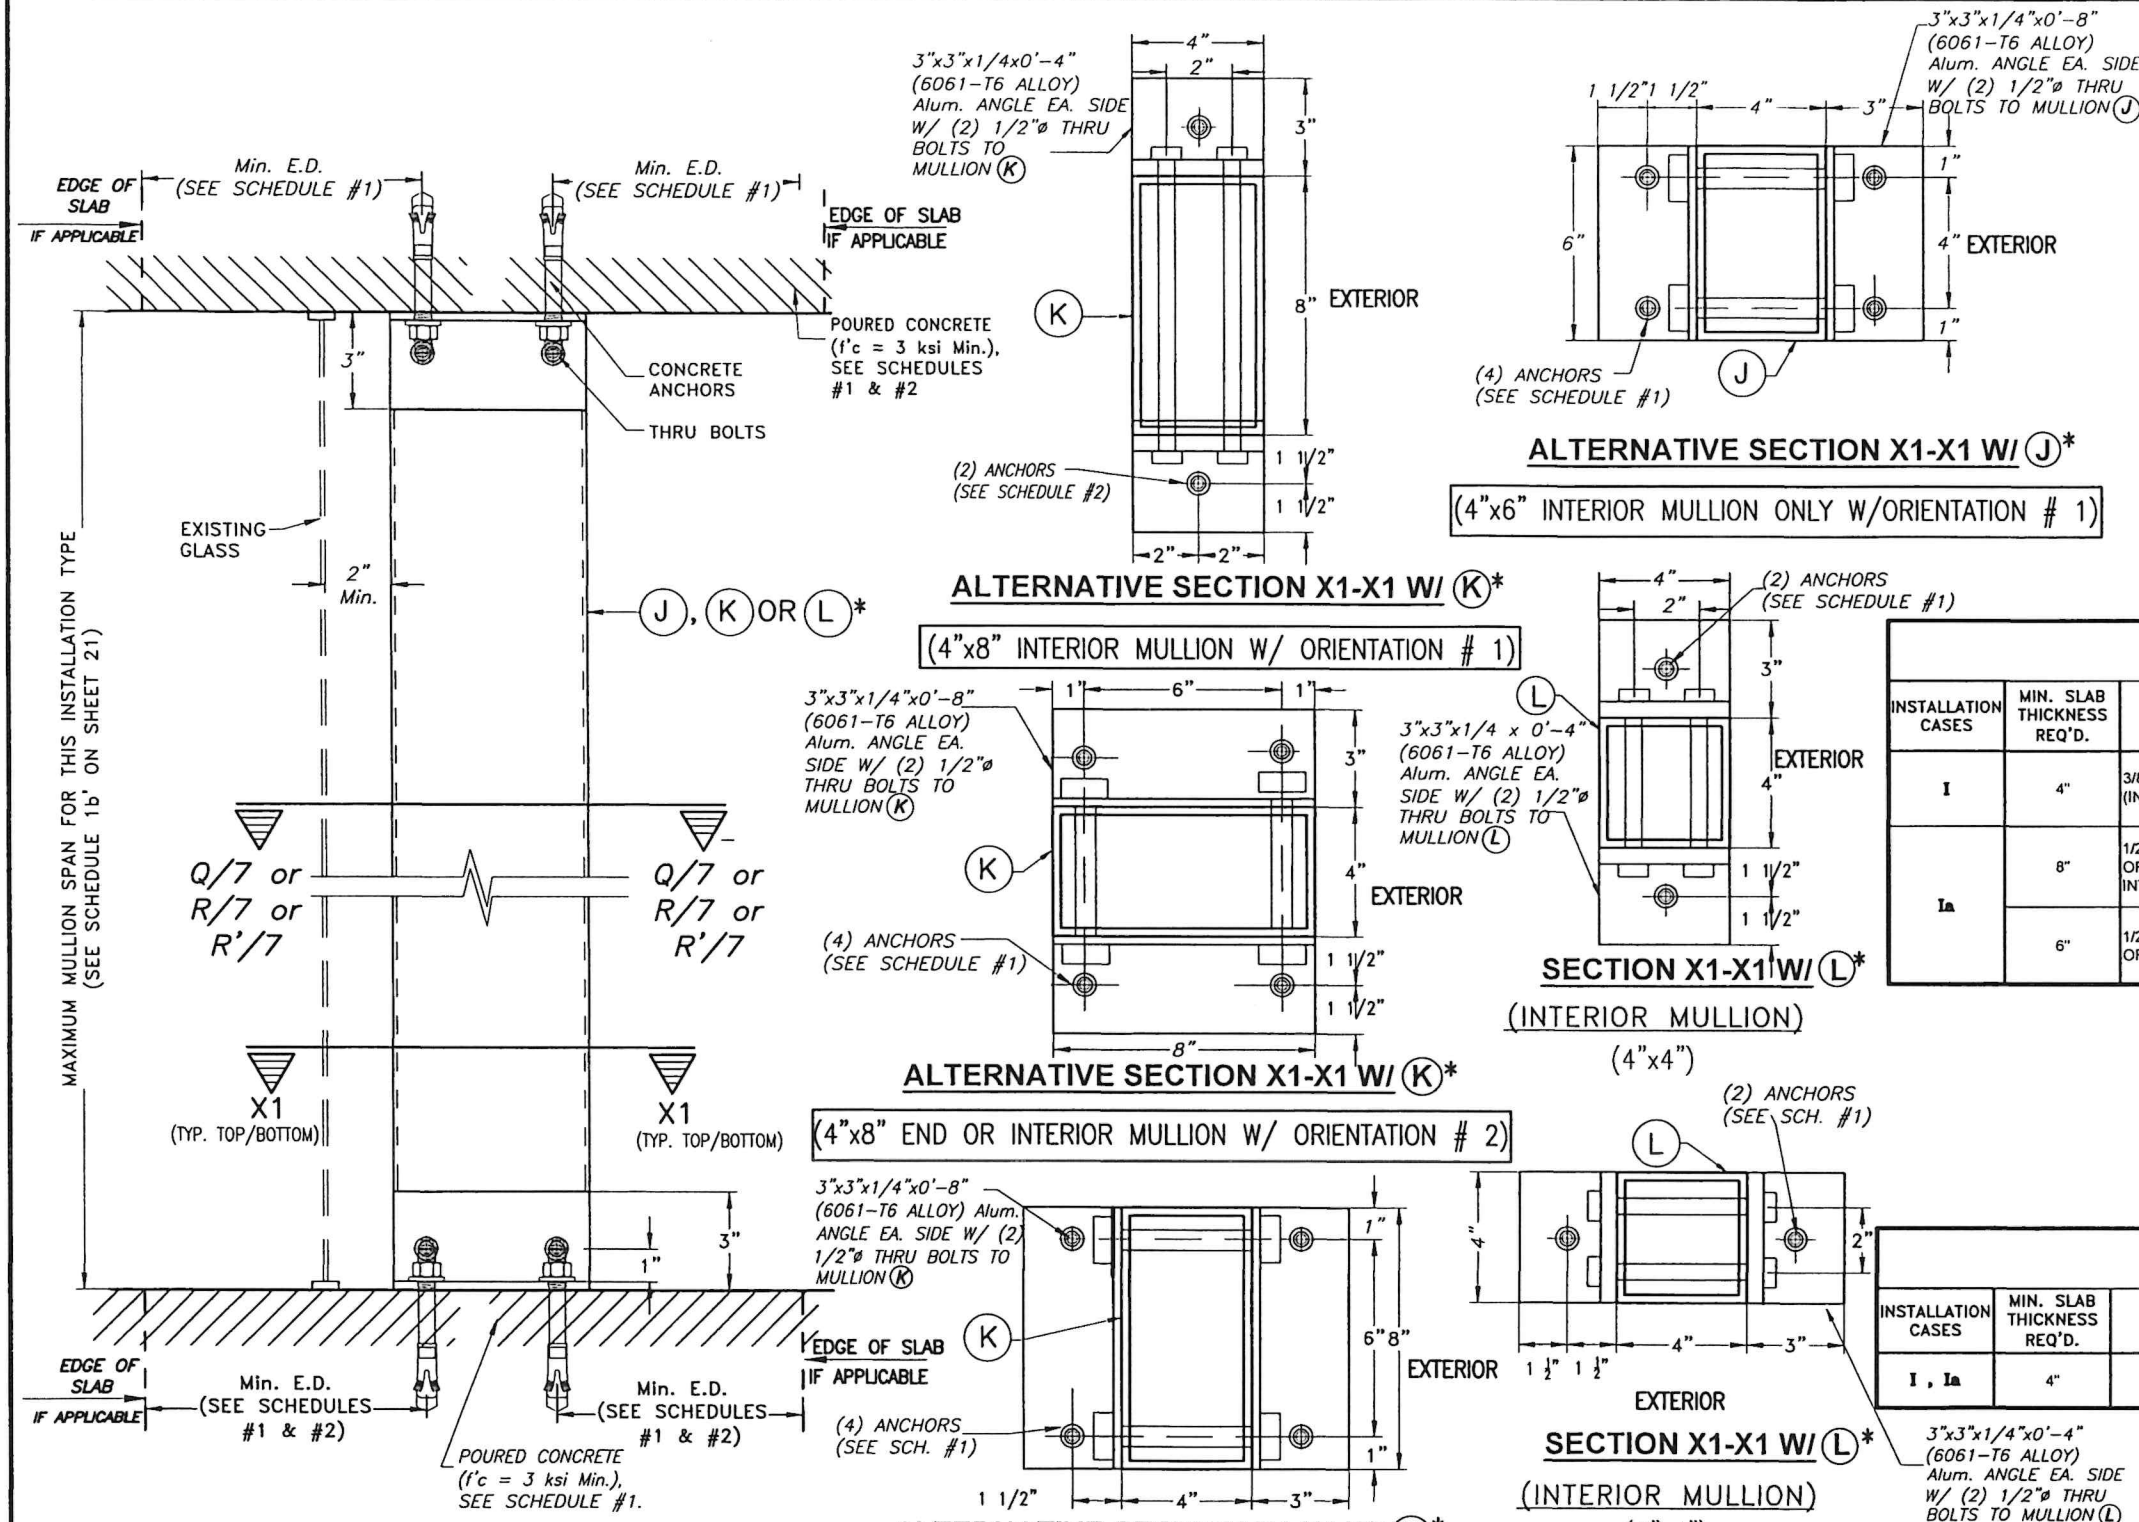

SEE MAXIMUM (J) (INTERIOR) & (K) (END & INTERIOR) TRAPPED MOUNTED MULLIONS SPAN COVERED BY SCHEDULE 1b' FOR INSTALLATION CASES I, Ia ON SHEET 21. (LIMITED LOAD, MULLION SPACING AND SPAN INSTALLATION):

INSTALLATION CASE I - RESIDENTIAL AND COMMERCIAL APPLICATIONS WITH ± 60.0 p.s.f. MAXIMUM A.S.D. DESIGN PRESSURE RATING, 12'-0" MAXIMUM MULLION SPACING. SEE SCHEDULES #1 & #2 BELOW FOR ADDITIONAL SPECS.

INSTALLATION CASE Ia - RESIDENTIAL AND COMMERCIAL APPLICATION W/ ± 60.0 p.s.f. MAXIMUM A.S.D. DESIGN PRESSURE RATING, 8'-0" MAXIMUM MULLION SPACING. SEE SCHEDULES #1 & #2 BELOW FOR ADDITIONAL SPECS.

SCHEDULE #1				
INSTALLATION CASES	MIN. SLAB THICKNESS REQ'D.	ANCHOR TYPE & SIZE (TYP. TOP & BOTTOM)	MIN. ANCHOR EMBEDMENT	MIN. EDGE DISTANCE FOR ANCHOR
I	4"	3/8" HILTI INC KWIK BOLT 3 & 3/8" CONFLUX ANCHOR FOR (J) & (K) (INTERIOR) MULLIONS W/ ORIENTATION #2, OR INTERIOR MULLION (L)	2 3/8"	4 1/2"
Ia	8"	1/2" HILTI INC KWIK BOLT 3 ONLY FOR (J) & (K) (INTERIOR) MULLIONS W/ ORIENTATION #2 & (L) (END MULLION W/ ORIENTATION #1), OR INTERIOR MULLION (L)	3 1/2"	7"
	6"	1/2" CONFLUX SCREW FOR (J) & (K) (END OR INTERIOR MULLION) W/ ORIENTATIONS #1 OR #2 OR INTERIOR MULLION (L)	3 1/2"	6"

SCHEDULE #2				
INSTALLATION CASES	MIN. SLAB THICKNESS REQ'D.	ANCHOR TYPE & SIZE (TYP. TOP & BOTTOM)	MIN. ANCHOR EMBEDMENT	MIN. EDGE DISTANCE FOR ANCHOR
I, Ia	4"	5/8" KWIK BOLT 3	2 1/2"	7 1/2"

END & INTERIOR TRAPPED MOUNTED MULLION INSTALLATION
APPLICABLE TO A LIMITED LOAD, LIMITED MULLION SPAN AND LIMITED MULLION SPACING

(TO BE USED W/ SCHEDULE 1b' ON SHEET 20)
 SCALE: 1/8" = 1"

* SIDE RAIL (C) AND BOX NOT SHOWN FOR CLARITY

WALTER A. TILLIT JR.
 LICENSE
 No. 44167
 STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2026 TILTECO, INC.


TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone: (305) 871-1530, Fax: (305) 871-1531
 CA-0006719
 WALTER A. TILLIT Jr. P.E.
 FLORIDA Lic. # 44167

IMPACT PROTECTIVE ROLLING SYSTEM
 W/ GV-60 END RETENTION SLAT L.M.I

gaviota
 The Sun & Shutter Specialists
 Carrada de Acolofencia 237, Bodaga 48,
 Colonia San Sebastian, P.I. Pical Panfaco
 Ciudad de Mexico-02510


W.H.
 DRAWN BY:
 6/19/2026
 DATE:
26-044
 DRAWING No.
 SHEET 9 OF 21

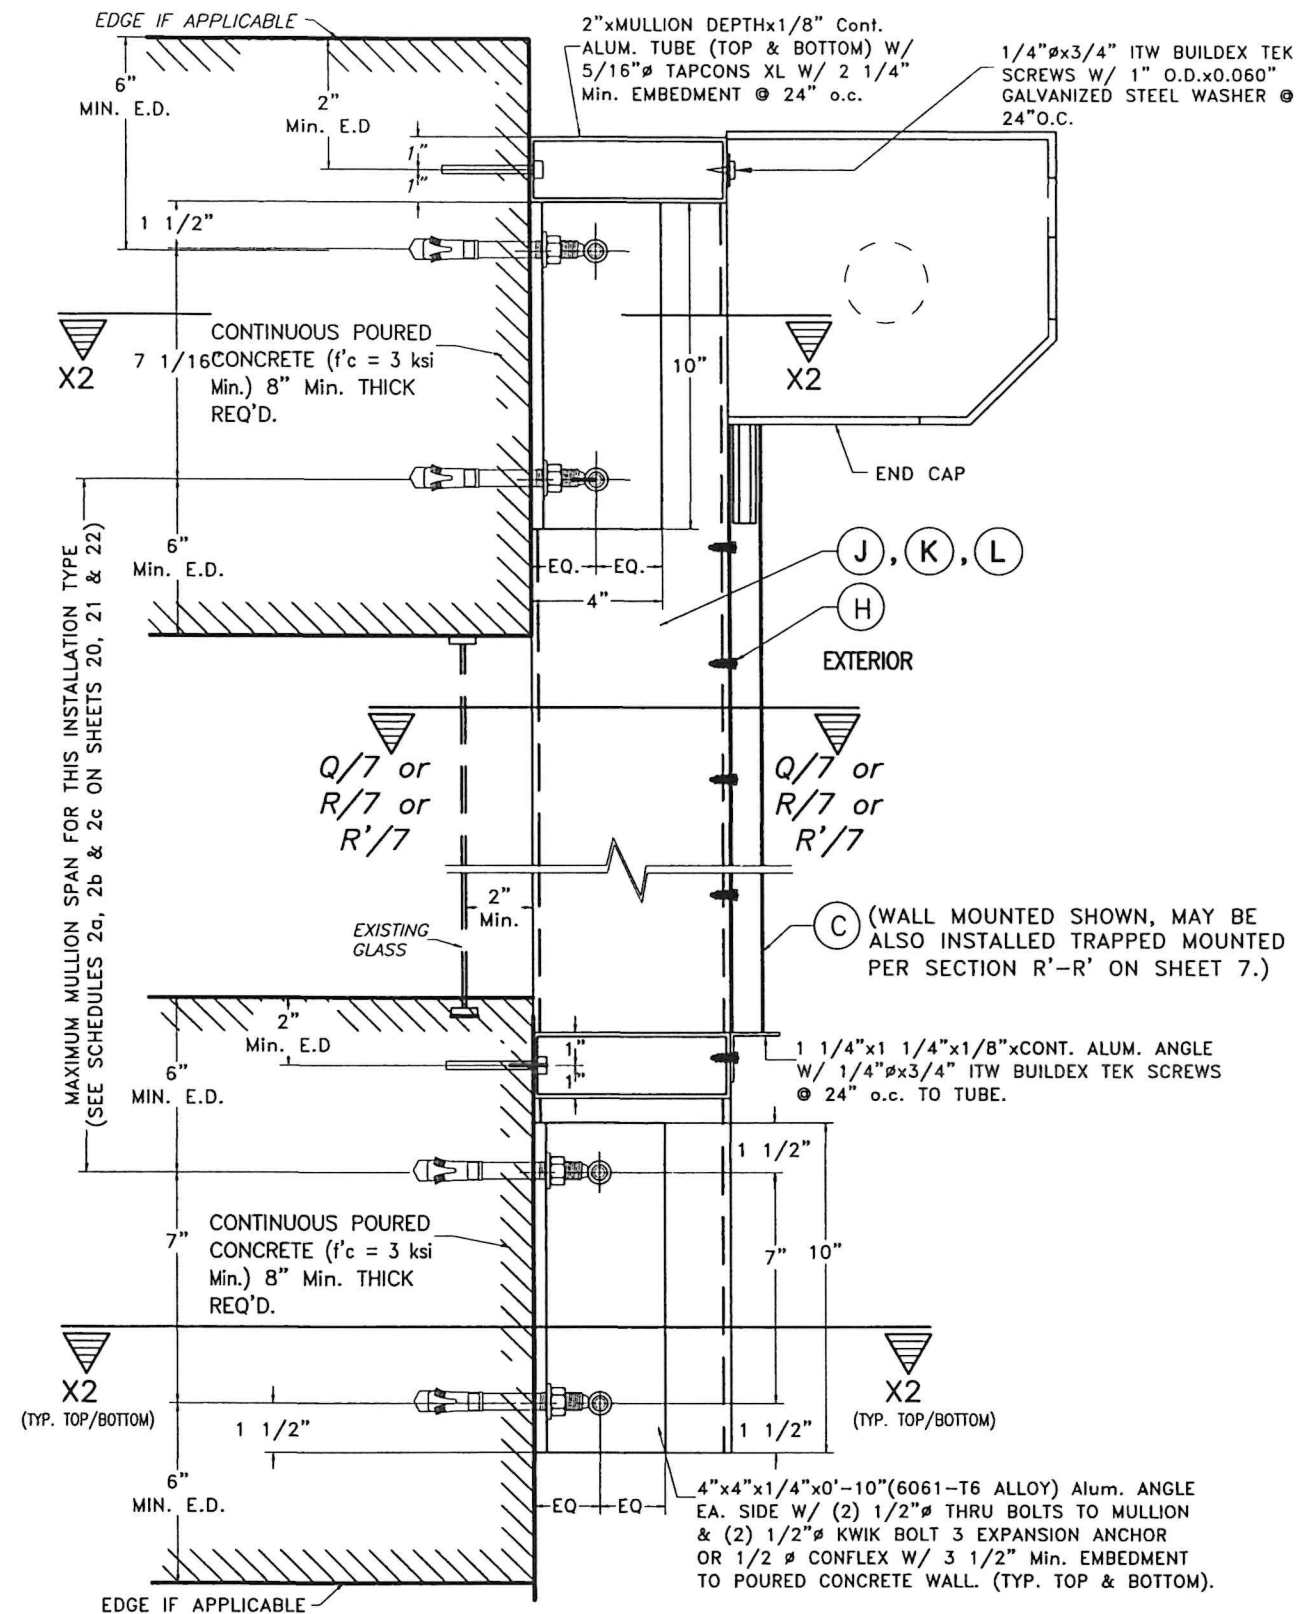

SECTION W-2 END & INTERIOR WALL MOUNTED MULLION INSTALLATION


(TO BE USED W/ SCHEDULES 2a, 2b, 2c ON SHEETS 19, 20 & 21)

SCALE: 1/8" = 1"

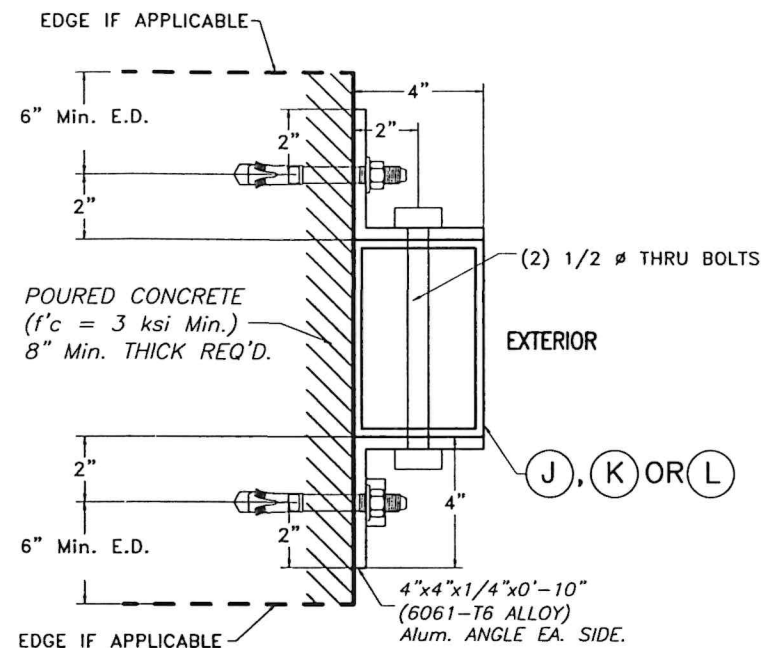


SECTION X2-X2 W/ J, K or L* (END & INTERIOR MULLION J, K or INTERIOR MULLION L) (W/ ORIENTATION # 2) (6"x4", 8"x4" or 4"x4")

* SIDE RAIL C NOT SHOWN FOR CLARITY

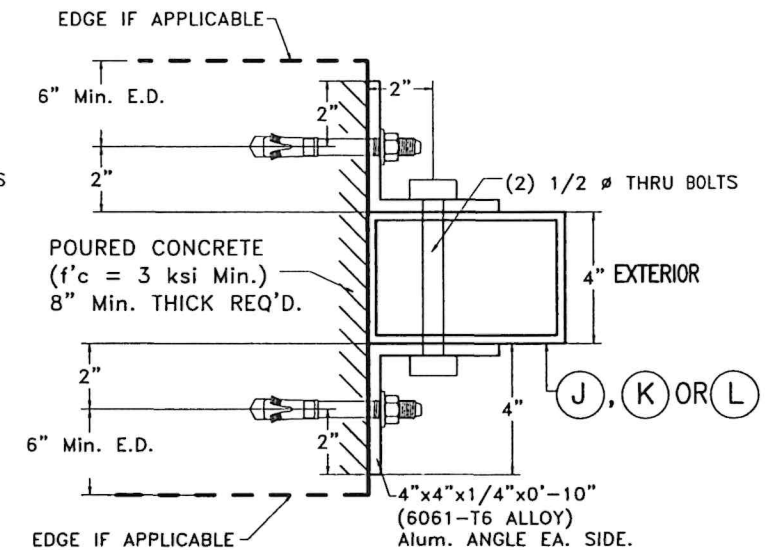


ALTERNATIVE SECTION X2-X2 W/ J, K or L* (END & INTERIOR MULLION J, K or INTERIOR MULLION L) (W/ ORIENTATION # 1) (4"x6", 4"x8" or 4"x4")

NOTE: VALID FOR ALL LOADS, SPANS AND MULLION SPACING EXCEPT LIMITED CONDITIONS PER SHEET 11

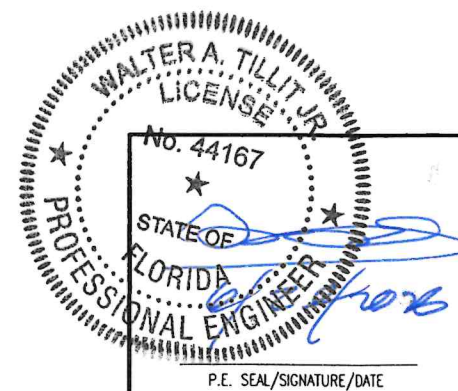



FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I		
TILTECO INC.			gaviota		
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone: (305)871-1530 Fax: (305)871-1531 CA-0006719 WALTER A. TILLIT Jr., P.E. FLORIDA Lic. # 44167			The Sun & Shutter Specialists Cerrada de Acolotlanco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510		
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 23-190	5/19/26	3	-	-
2	-	-	4	-	-
W.H. DRAWN BY: 6/19/2026 DATE: 26-044			DRAWING No. SHEET 10 OF 21		

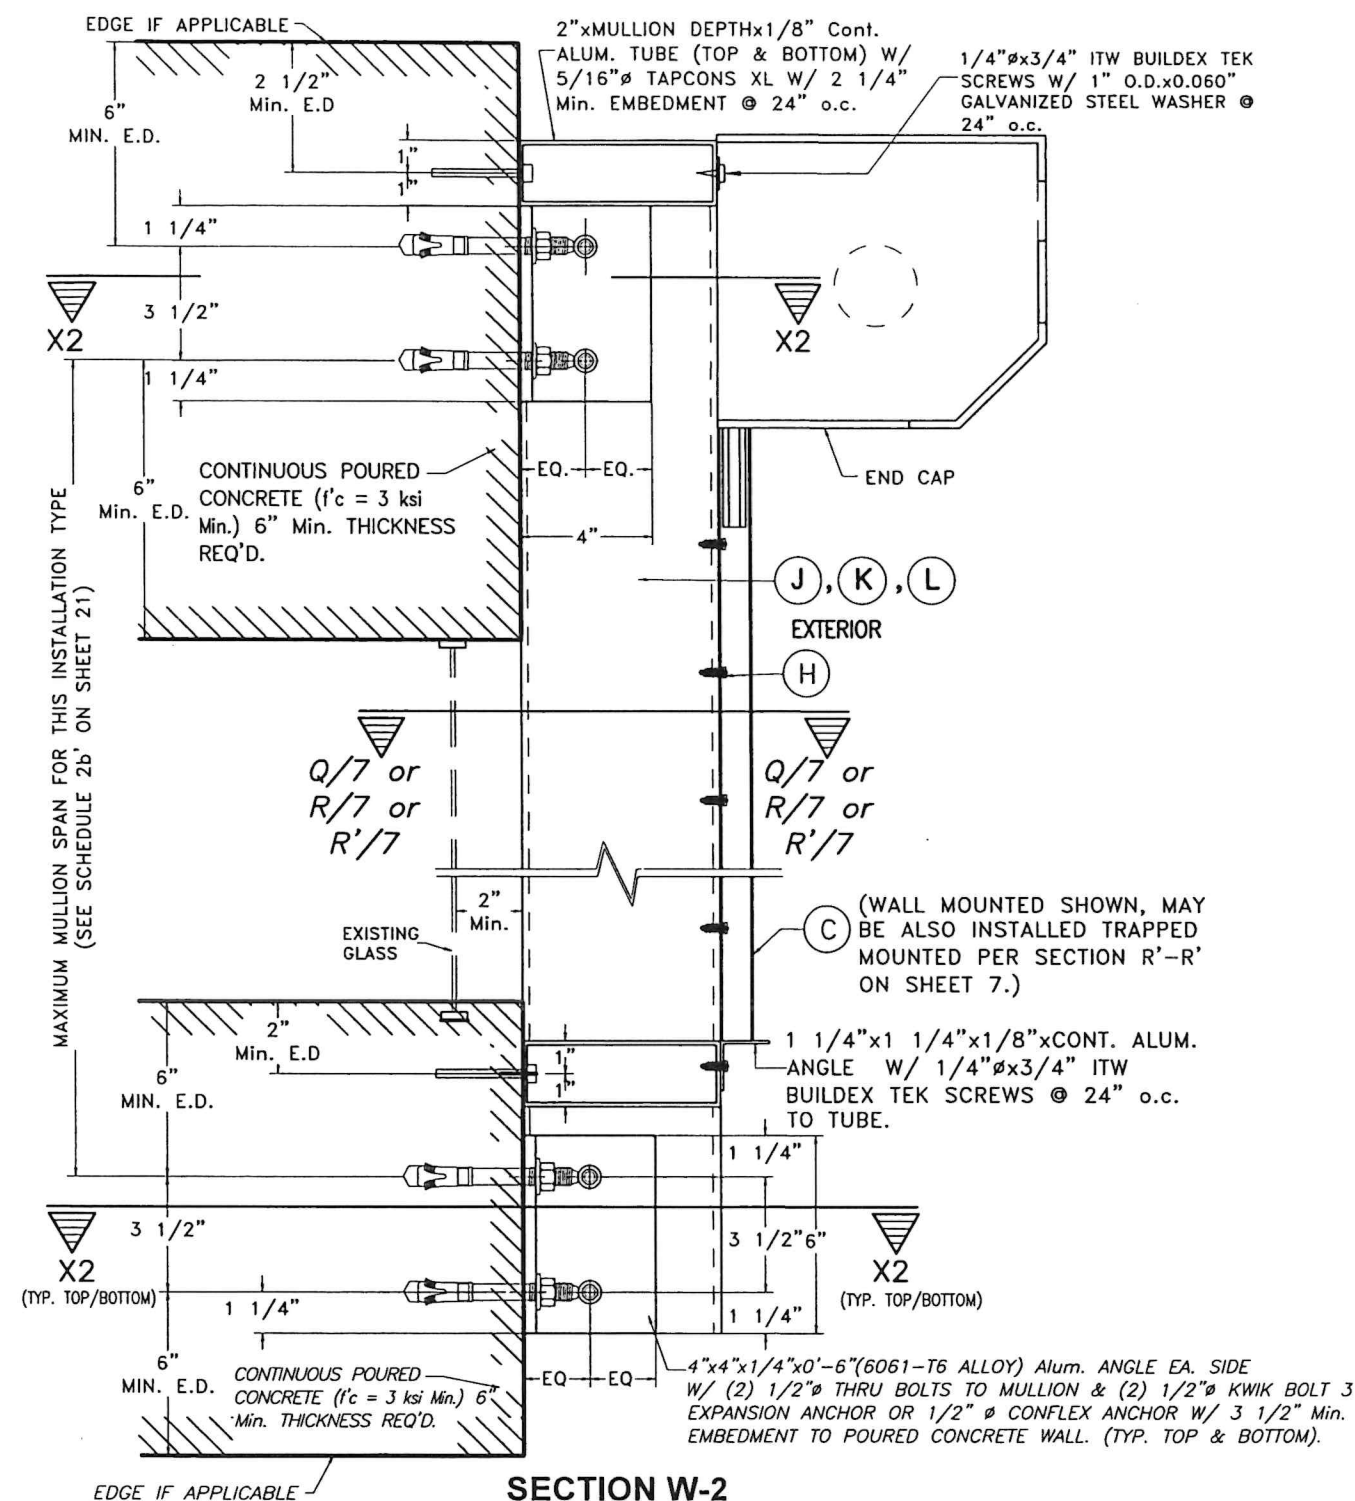

SECTION W-2
WALL MOUNTING MULLIONS (J, K or L)
POURED CONCRETE WALL

END & INTERIOR WALL MOUNTED MULLION INSTALLATION ♦
APPLICABLE TO A LIMITED LOAD, LIMITED MULLION SPAN AND
LIMITED MULLION SPACING
(TO BE USED W/ SCHEDULE 2b' ON SHEET 20)


SCALE: 1/8" = 1"

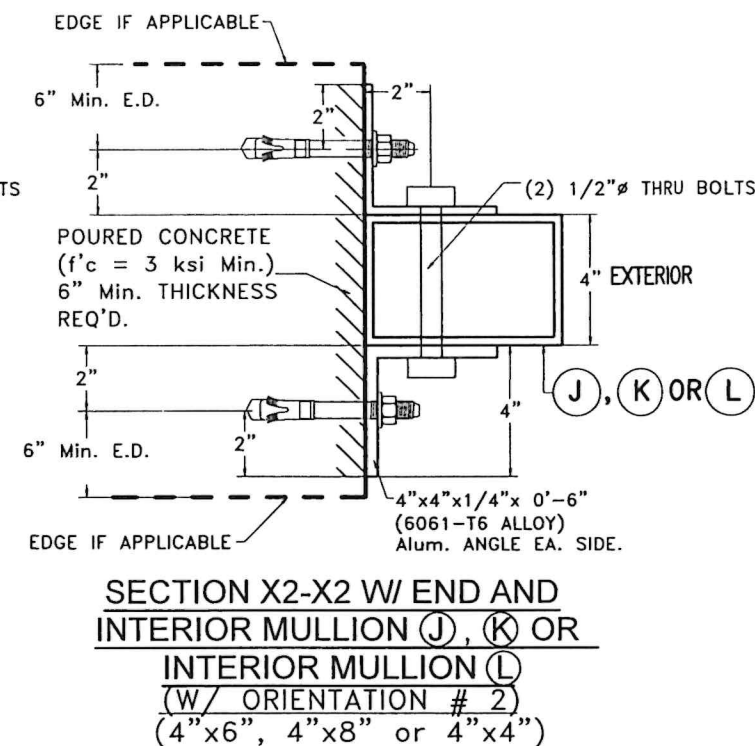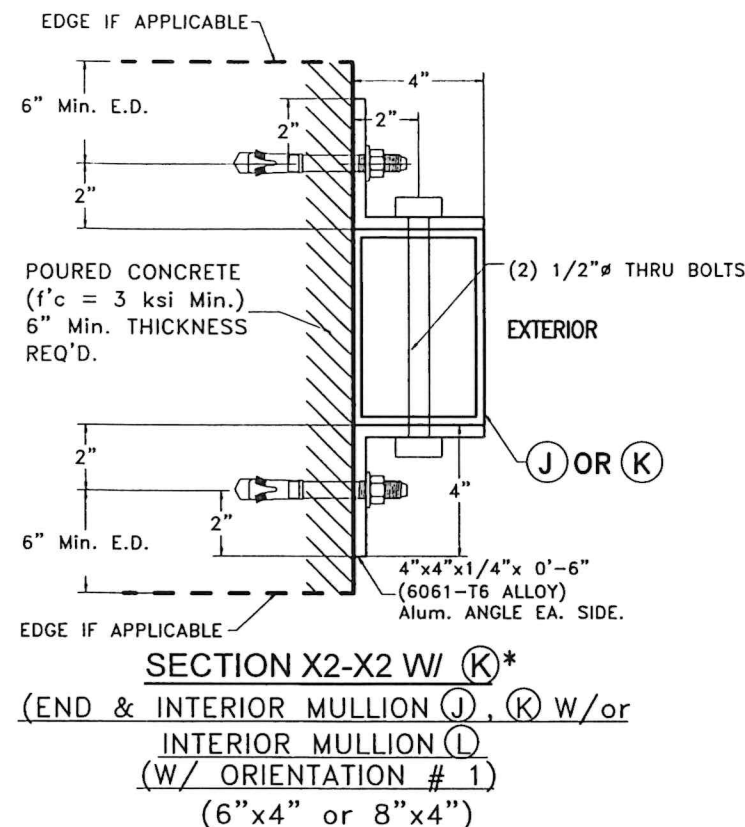

♦ SEE MAXIMUM (L) (INTERIOR) & (J) (K) (END & INTERIOR) WALL MOUNTED MULLIONS SPAN COVERED BY SCHEDULE 2b' FOR INSTALLATION CASES I' & II' DEFINED BELOW ON SHEET 21. (LIMITED LOAD, LIMITED MULLION SPACING AND LIMITED SPAN INSTALLATION):

INSTALLATION CASE I' - RESIDENTIAL AND COMMERCIAL APPLICATIONS WITH ±60.0 p.s.f. MAXIMUM A.S.D. DESIGN PRESSURE RATING, 12'-0" MAXIMUM MULLION SPACING. VALID FOR CONNECTION TO CONCRETE W/ 1/2" Ø S.S. KWIK BOLT 3 OR 1/2" Ø CONFLEX ANCHOR.

INSTALLATION CASE II' - COMMERCIAL APPLICATION FOR ±60.0 p.s.f. MAXIMUM A.S.D. DESIGN PRESSURE RATING, 8'-0" MAXIMUM MULLION SPACING. VALID FOR CONNECTION TO CONCRETE W/ 1/2" Ø S.S. HILTI INC KWIK BOLT 3 OR 1/2" Ø CONFLEX ANCHOR.

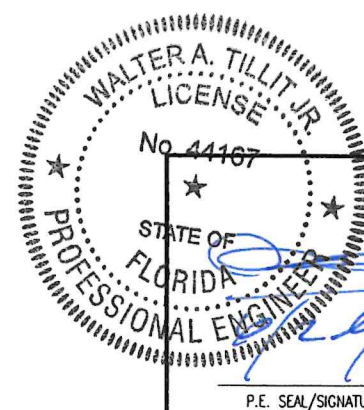

©2026 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone: (305) 871-1530, Fax: (305) 871-1531
 CA-0006719
 WALTER A. TILLIT Jr., P.E.
 FLORIDA Lic. # 44167

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

IMPACT PROTECTIVE ROLLING SYSTEM
 W/ GV-60 END RETENTION SLAT L.M.I

gaviota
 The Sun & Shutter Specialists

Cerrada de Acolotenco 237, Bodega 48,
 Colonia San Sebastian, P.I. Pical Pantaco
 Ciudad de Mexico-02510

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
2	-	-	4	-	-

W.H.
 DRAWN BY:
 6/19/2026
 DATE:
26-044
 DRAWING No.
 SHEET 11 OF 21

TYPICAL MANDATORY PROCEDURE FOR VERIFYING PRODUCT CODE COMPLIANCE RELATED TO ITS INSTALLATION INTO EXISTING POURED CONCRETE OR GROUT FILLED CELL CONCRETE BLOCK STRUCTURES (*)

STEP 1: OBTAIN JOB SITE'S A.S.D. DESIGN PRESSURE RATING (p.s.f.) FOR THE OPENING AND DESIRED SLAT SPAN "L" (ft) TO PROTECT IT (SEE GENERAL NOTE #2, SHEET 1).

STEP 2: ENTER TO CHARTS Ia, Ib, Ic & Id ON SHEET 13 TO DETERMINE, BASED ON AN 1/4" SLAT SLIP (in), ANCHOR TYPE AT SIDE RAILS AND A.S.D. DESIGN PRESSURE RATING (p.s.f.) THE REQUIRED MAX SLAT SPAN "L" ft .

THE FOLLOWING INFORMATION IS PROVIDED AT CHARTS I THRU Id TO PROCEED WITH PRODUCT INSTALLATION VERIFICATION:

- ENTER A.S.D. DESIGN PRESSURE RATING: SEE STEP (1) ABOVE.
- FOR A SPECIFIC PRODUCT MOUNTING INSTALLATION TYPE, INCLUDING ANCHOR TYPE, THE FOLLOWING DEFINITION FOR SLAT SPAN SHALL BE CONSIDERED:

Lmax: THIS IS THE MAXIMUM ALLOWABLE SLAT SPAN FOR WHICH A GIVEN 1/4" SLAT SLIP MAY BE USED, FOR A GIVEN A.S.D. DESIGN PRESSURE RATING, AND MOUNTING TYPE.
- MINIMUM REQUIRED SEPARATION TO GLASS IS PROVIDED ON CHART Id


STEP 3: OBTAIN INFORMATION ON PRODUCT'S SIDE RAIL ANCHOR SPACING REQUIREMENTS FOR CONNECTION TO EXISTING STRUCTURE FROM ANCHOR SCHEDULES Va, Vb & Vc ON SHEETS 14 THRU 16. ENTER SCHEDULES WITH ANCHOR TYPE, SUBSTRATE, MOUNTING TYPE, A.S.D. DESIGN PRESSURE RATING & SLAT SPAN AND OBTAIN MAXIMUM ANCHOR SPACING (INCHES ON CENTERS). SEE GENERAL NOTE 7 ON SHEET 1 FOR ANCHOR SPECS.

STEP 4: IF PRODUCT INSTALLATION INCLUDES MULLIONS, THE FOLLOWING MANDATORY ADDITIONAL PROCEDURE IS APPLICABLE.

1. MINIMUM SEPARATION TO GLASS FOR SLATS IF MULLIONS ARE USED SHALL BE BASED ON CHART Id ON SHEET 13. IT SHALL BE MEASURED FROM BACK OF SLATS TO GLASS.
2. ENTER SCHEDULES 1a THRU 2c ON SHEETS 19, 20 & 21 W/ A.S.D. DESIGN LOAD; MAXIMUM MULLION SPACING (MAX., 12', 8' OR 7'), AND DETERMINE MAXIMUM MULLIONS SPAN (HEIGHT) W/ ALLOWABLE INTERPOLATION IN BETWEEN SPACING'S FOR A GIVEN(J, K & L), MULLION TYPE & MULLION ORIENTATION.

3. SEE SHEETS 8, 9 FOR TRAPPED MOUNTED MULLIONS AND SHEETS 10 & 11 FOR WALL MOUNTED MULLION CONNECTION DETAILS AT TOP & BOTTOM FOR FLOOR TO CEILING (TRAPPED) OR WALL MOUNTINGS OF MULLIONS INTO CONCRETE FOR A GIVEN MULLION TYPE (J, K, & L).

* PROCEDURE PER STEPS 1 THRU 3 IS SIMILAR FOR INSTALLATIONS INTO WOOD FRAME STRUCTURES. SEE SHEETS 17 & 18 FOR LIMITATIONS APPLICABLE TO INSTALLATIONS INTO WOOD FRAME STRUCTURES. (NO MULLIONS ALLOWED, NO TRAPPED MOUNT SHUTTER ALLOWED).

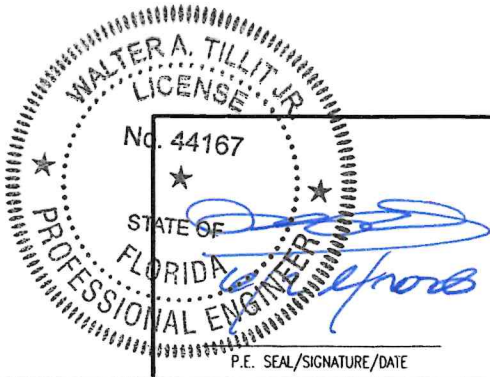

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)						
©2026 TILTECO, INC.  TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 • Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167		IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I			W.H. DRAWN BY:	
		gaviota The Sun & Shutter Specialists Cerrada de Acololanco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510			6/19/2026 DATE:	
					26-044 DRAWING No.	
					SHEET 12 OF 21	
</						


SLAT PERFORMANCE CHARTS Ia, Ib, Ic & Id: (ONLY VALID FOR 1/4" SLIP). SEE SHT. 18 FOR WOOD SUBSTRATE

FOR A GIVEN A.S.D. DESIGN PRESSURE RATING (p.s.f), PRODUCT MOUNT CONDITION INCLUDING ANCHOR TYPE

MAX. A.S.D. DESIGN PRESSURE RATING (psf)	CHART Ia				CHART Ib				CHART Ic				CHART Id			
	3/8"Ø KWIK BOLT 3 ANCHOR TO POURED CONCRETE				5/16"Ø TAPCON XL or 5/16" Ø DEWALT ULTRACON ANCHOR TO POURED CONCRETE				5/16" Ø TAPCON XL , 5/16" Ø DEWALT ULTRACON ANCHOR TO GROUT FILLED CELL CONCRETE BLOCK				3/8 " Ø KWIK BOLT 3 TO GROUT FILLED CELL CONCRETE BLOCK			
	MAX. SLAT SPAN "Lmax." (FT)				MAX. SLAT SPAN "Lmax." (FT)				MAX. SLAT SPAN "Lmax." (FT)				MAX. SLAT SPAN "Lmax." (FT)			
	WALL MOUNT SEE NOTES *	TRAPPED MOUNT SEE NOTES *	BUILD-OUT MOUNT W/ ① & ② SEE NOTES *	BUILD-OUT MOUNT W/ ③ SEE NOTES *	WALL MOUNT SEE NOTES *	TRAPPED MOUNT SEE NOTES *	BUILD-OUT MOUNT W/ ① & ② SEE NOTES *	BUILD-OUT MOUNT W/ ③ SEE NOTES *	WALL MOUNT SEE NOTES *	TRAPPED MOUNT SEE NOTES *	BUILD-OUT MOUNT W/ ① & ② SEE NOTES *	BUILD-OUT MOUNT W/ ③ SEE NOTES *	WALL MOUNT SEE NOTES *	TRAPPED MOUNT SEE NOTES *	BUILD-OUT MOUNT W/ ① & ② SEE NOTES *	BUILD-OUT MOUNT W/ ③ SEE NOTES *
60.0 or LESS	14'-2 3/16"	14'-2 3/16"	9'-0"	11'-0"	13'-0"	11'-0"	7'-6"	8'-6"	9'-3"	8'-6"	7'-0"	7'-6"	13'-3"	13'-3"	8'-0"	10'-0"

* NOTES:

1. ABOVE INDICATED MAX. SLAT SPANS MAY BE USED AS LONG AS ANCHOR SPACING SCHEDULES ON SHEETS 14, 15 & 16 INDICATE THAT AN ANCHOR SPACING IS AVAILABLE FOR THE CORRESPONDING SLAT SPAN AND A.S.D. DESIGN PRESSURE RATING.
2. REQUIRES SIDE RAILS FASTENED TO EXISTING STRUCTURE WITH 3/8"Ø KWIK BOLT 3 ANCHOR , 5/16"Ø TAPCON XL OR 5/16"Ø DEWALT ULTRACON ANCHOR, INTO POURED CONCRETE OR GROUT FILLED CELL CONCRETE BLOCK, OR WITH ③ AT MULLIONS CONNECTION. VALID FOR WALL MOUNTED, TRAPPED MOUNTED, AND BUILD-OUT MOUNTED SLATS.
3. MAXIMUM SLAT SPANS FOR INTERMEDIATE LOADS MAY BE DETERMINED BY LINEAR INTERPOLATION BETWEEN END VALUES.

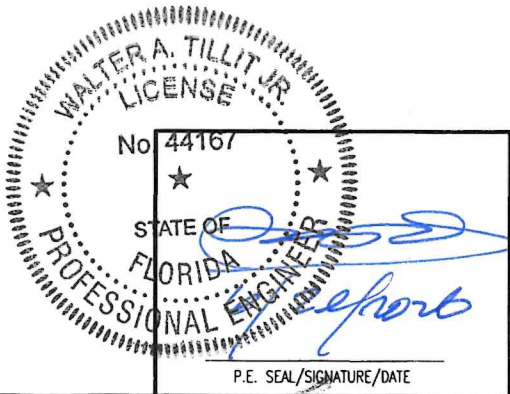

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)									
©2026 TILTECO, INC.					IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I				
TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 • Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167					gaviota The Sun & Shutter Specialists Cerrada de Acolafenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510				
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	W.H. DRAWN BY: 6/19/2026 DATE: 26-044 DRAWING No.			
1	OLD 23-190	5/19/28	3	-	-	SHEET 13 OF 21			
2	-	-	4	-	-				

MAX. ANCHOR'S SPACING SCHEDULE V_a
FOR A GIVEN PRODUCT MOUNTING TYPE, W/ 3/8"Ø KWIK BOLT 3 , 5/16"Ø TAPCON XL & 5/16"Ø ULTRACON ANCHORS TO POURED CONCRETE WALL,
A.S.D. DESIGN PRESSURE RATING & SLAT SPAN RANGE †

WALL MOUNT

MAX. A.S.D. DESIGN PRESSURE RATING RANGE (p.s.f)	SLAT SPAN RANGE						
	0'-4' †	> 4'-5' †	> 5'-6' †	> 6'-7' †	> 7'-9' †	> 9'-12' †	> 12'-(14'-2 3/8")†
≤ 30.0	6"	6"	6"	6"	4"	4"	4"
>31-40	6"	6"	6"	4"	4"	4"	4"
>41-60	6"	6"	6"	4"	4"	4"	4"



SLAT SPAN DEFINITION

† NOTE:
MAX. SLAT SPAN FOR A GIVEN A.S.D. DESIGN PRESSURE RATING SHALL NEVER EXCEED MAX. SLAT SPAN INDICATED ON SLAT PERFORMANCE CHART ON SHEET 13.

TRAPPED MOUNT

MAX. A.S.D. DESIGN PRESSURE RATING RANGE (p.s.f)	SLAT SPAN RANGE						
	0'-4' †	> 4'-5' †	> 5'-6' †	> 6'-7' †	> 7'-9' †	> 9'-12' †	> 12'-(14'-2 3/8")†
≤ 30.0	6"	6"	6"	6"	4"	4"	4"
>31-40	6"	6"	6"	4"	4"	4"	4"
>41-60	6"	6"	6"	4"	4"	4"	4"

BUILD-OUT MOUNT

MAX. A.S.D. DESIGN PRESSURE RATING RANGE (p.s.f)	SLAT SPAN RANGE																				
	0'-4' †			> 4'-5' †			> 5'-6' †			> 6'-7' †			> 7'-9' †			> 9'-12' †			> 12' - (14'-2 3/8")†		
	(I ₁)	(I ₂)	(I ₃)	(I ₁)	(I ₂)	(I ₃)	(I ₁)	(I ₂)	(I ₃)	(I ₁)	(I ₂)	(I ₃)	(I ₁)	(I ₂)	(I ₃)	(I ₁)	(I ₂)	(I ₃)	(I ₁)	(I ₂)	(I ₃)
≤ 30.0	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	4"	4"	4"	4"	4"	4"	4"	4"	4"
>31-40	6"	6"	6"	6"	6"	6"	6"	6"	6"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"
>41-60	6"	6"	6"	6"	6"	6"	6"	6"	6"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"



FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)											
©2026 TILTECO, INC.					IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I					W.H. DRAWN BY:	
TILTECO INC.					gaviota The Sun & Shutter Specialists					6/19/2026 DATE:	
TILLIT TESTING & ENGINEERING COMPANY 8355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr., P.E. FLORIDA Lic. # 44167					Carrada de Acolotenco 237, Bodega 48, Colonía San Sebastián, P.I. Pical Pantaco Ciudad de México-02510					26-044 DRAWING No.	
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	SHEET 14 OF 21					
1	OLD 23-190	5/19/26	3	-	-						
2	-	-	4	-	-						

MAX. ANCHOR'S SPACING SCHEDULE V_C FOR A GIVEN PRODUCT MOUNTING TYPE, W/ 5/16"Ø TAPCON XL ,
5/16"Ø DEWALT ULTRACON OR 3/8 " Ø KWIK BOLT 3 ANCHORS TO GROUT FILLED CELL CONCRETE BLOCK WALL,
A.S.D. DESIGN PRESSURE RATING & SLAT SPAN RANGE †

MAX. A.S.D. DESIGN PRESSURE RATING RANGE (p.s.f.)	WALL MOUNT SLAT SPAN RANGE						
	0'-4' †	> 4'-5' †	> 5'-6' †	> 6'-7' †	> 7'-9' †	> 9'-12' †	>12'-(14'-2 1/8") †
≤ 30.0	6"	6"	6"	6"	4"	4"	4"
>31-40	6"	6"	6"	4"	4"	4"	4"
>41-60	6"	6"	6"	4"	4"	4"	4"




SLAT SPAN DEFINITION

† NOTE:
MAX. SLAT SPAN FOR A
GIVEN A.S.D. DESIGN
PRESSURE RATING SHALL
NEVER EXCEED MAX. SLAT
SPAN INDICATED ON SLAT
PERFORMANCE CHART ON
SHEET 13.

MAX. A.S.D. DESIGN PRESSURE RATING RANGE (p.s.f.)	TRAPPED MOUNT SLAT SPAN RANGE						
	0'-4' †	> 4'-5' †	> 5'-6' †	> 6'-7' †	> 7'-9' †	> 9'-12' †	>12'-(14'-2 1/8") †
≤ 30.0	6"	6"	6"	6"	4"	4"	4"
>31-40	6"	6"	6"	4"	4"	4"	4"
>41-60	6"	6"	6"	4"	4"	4"	4"

MAX. A.S.D. DESIGN PRESSURE RATING RANGE (p.s.f.)	BUILD-OUT MOUNT																				
	SLAT SPAN RANGE																				
	0'-4' †			> 4'-5' †			> 5'-6' †			> 6'-7' †			> 7'-9' †			> 9'-12' †			>12'-(14'-2 1/8") †		
	⑪	⑫	⑬	⑪	⑫	⑬	⑪	⑫	⑬	⑪	⑫	⑬	⑪	⑫	⑬	⑪	⑫	⑬	⑪	⑫	⑬
≤ 30.0	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	4"	4"	4"	4"	4"	4"	4"	4"	4"
>31-40	6"	6"	6"	6"	6"	6"	6"	6"	6"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"
>41-60	6"	6"	6"	6"	6"	6"	6"	6"	6"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"	4"

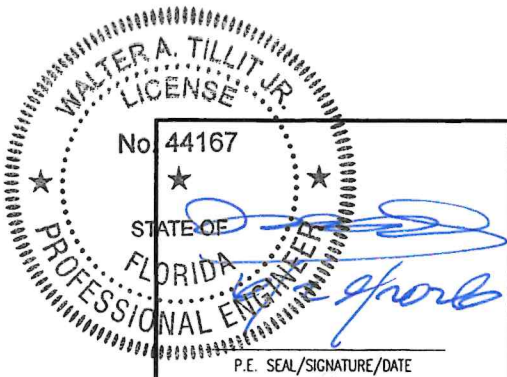

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)									
©2026 TILTECO, INC.					IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I				
TILTECO inc. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167					gaviota The Sun & Shutter Specialists Cerrado de Acololenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantlaco Ciudad de Mexico-02510				
W.H. DRAWN BY:					6/19/2026 DATE:				
26-044 DRAWING No.					SHEET 15 OF 21				
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE				
1	OLD 23-190	6/19/26	3	-	-				
2	-	-	4	-	-				

SCHEDULE V_C:
V_x FORCES (Lb/FT) & V_y FORCES (Lb/FT) ACTING AT JAMBS FOR AN A.S.D. DESIGN LOAD RANGE, SLAT SPAN
RANGE FOR POURED CONCRETE OR GROUT FILLED CELL CONCRETE BLOCK WALL BUILDINGS *
(USE MAXIMUM VALUE BETWEEN POSITIVE AND NEGATIVE A.S.D. LOAD)

MAXIMUM A.S.D. DESIGN PRESSURE RATING (psf)	SLAT SPAN RANGE													
	0'-4'		> 4'-5'		> 5'-6'		> 6'-7'		> 7'-9'		> 9'-12'		> 12'-(14'-2 3/16")	
	V _x	V _y	V _x	V _y	V _x	V _y	V _x	V _y	V _x	V _y	V _x	V _y	V _x	V _y
≤ 30.0	0	60	0	75	20	90	181	105	427	135	739	180	1134	240
> 31-40	0	80	0	100	127	120	307	140	599	180	986	240	1485	320
> 41-60	0	120	55	150	330	180	551	210	932	270	1461	360	1722	405



SLAT SPAN DEFINITION

* NOTE:
IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR OR PERMIT HOLDER TO VERIFY THAT EXISTING STRUCTURE IS DESIGNED TO SUPPORT V_x AND V_y FORCES IN POUNDS PER UNIT FOOT OF PRODUCT HEIGHT AT BOTH JAMBS. SEE THIS SHEET FOR V_x & V_y VALUES.

SIDE RAIL

V_y

V_x

V_y

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

P.E. SEAL/SIGNATURE/DATE

©2026 TILTECO, INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 • Fax : (305)871-1531
CA-0006719
WALTER A. TILLIT Jr., P.E.
FLORIDA Lic. # 44167

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

IMPACT PROTECTIVE ROLLING SYSTEM
W/ GV-60 END RETENTION SLAT L.M.I

The Sun & Shutter Specialists
Cerrada de Acolotenco 237, Bodega 48,
Colonia San Sebastian, P.I. Pical Pantaco
Ciudad de Mexico-02510

W.H.
DRAWN BY:
6/19/2026
DATE:
26-044
DRAWING No.


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	5/19/26	3	-	-
2	-	-	4	-	-

SHEET 16 OF 21

SLAT PERFORMANCE CHART Ib1 & Ic1

FOR A GIVEN MAXIMUM A.S.D. DESIGN PRESSURE RATING (p.s.f) AND SHUTTER MOUNT
CONDITION FOR INSTALLATIONS PER DETAIL 1

CHART Ib1				CHART Ic1
USE MAXIMUM VALUE BETWEEN POSITIVE AND NEGATIVE A.S.D. LOAD				USE MAXIMUM POSITIVE A.S.D. LOAD VALUE
<u>5/16"Ø TAPCON XL OR 5/16"</u> <u>DEWALT ULTRACON ANCHOR</u>				
MAXIMUM A.S.D. DESIGN PRESSURE RATING (psf)	MAX. SLAT SPAN "L _{MAX.} " (ft)			REQUIRED MIN. SEPARATION TO GLASS MEASURED TO BACK OF SLAT (in)
	WALL MOUNT (SEE NOTES Δ)	BUILD-OUT MOUNT W/ 1" (SEE NOTES) Δ	BUILD-OUT MOUNT W/ 1" (SEE NOTES Δ)	
30.0 *	12'-0"	10'-0"	11'-0"	9-1/2"
35.0 **	12'-0"	10'-0"	11'-0"	9-1/2"
40.0 **	11'-0"	9'-0"	10'-0"	9-1/2"
45.0 ***	11'-0"	9'-0"	10'-0"	9-1/2"
50.0 ***	11'-0"	9'-0"	10'-0"	9-1/2"
55.0 ***	10'-0"	8'-0"	9'-0"	9-1/2"
60.0 ***	10'-0"	8'-0"	9'-0"	9-1/2"

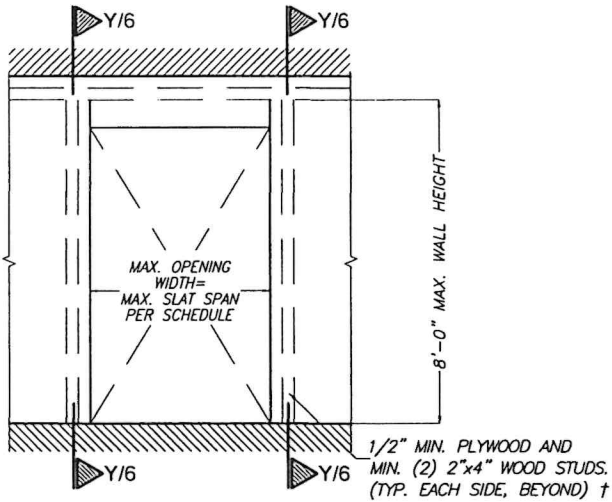

DETAIL 1 (ELEVATION)



SLAT SPAN "L" DEFINITION


Δ NOTES:

1. ABOVE INDICATED MAX. SLAT SPANS MAY BE USED AS LONG AS ANCHOR SPACING SCHEDULES ON SHEET 19 INDICATE THAT A SPACING IS AVAILABLE FOR THE CORRESPONDING SLAT SPAN AND A.S.D. DESIGN LOAD.

† : WOOD FRAME WALL TO BE BUILT STRICTLY IN ACCORDANCE WITH SPECS GIVEN ON SHEET 6 AND PROVISIONS FROM CHAPTER 23 OF THE FLORIDA BUILDING CODE. MINIMUM LENGTH OF WALL AT EITHER SIDE OF OPENING SHALL BE 33".

MAXIMUM A.S.D. DESIGN LOAD VS WOOD GRADE SCHEDULE:	
* VALID FOR DOUGLAS-FIR-SOUTH (G=0.46) SOUTHERN PINE #2 (G=0.55) SPRUCE PINE-FIR-SITH (G=0.36)	
**VALID FOR DOUGLAS-FIR-SOUTH (G=0.46) SOUTHERN PINE #2 (G=0.55)	
***VALID FOR SOUTHERN PINE #2 (G=0.55)	

INSTALLATIONS INTO WOOD FRAME BUILDINGS

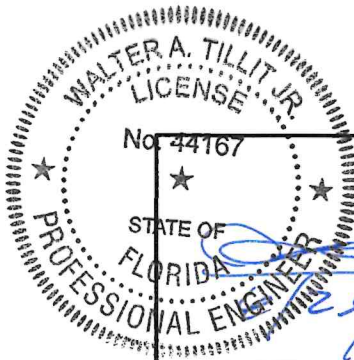

P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I		
TILTECO INC.			gaviota		
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 · Fax : (305)871-1531 CA-0006719			Cerrada de Acolotenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510		
WALTER A. TILLIT Jr., P.E. FLORIDA Lic. # 44167			W.H. DRAWN BY: 6/19/2026 DATE: 26-044 DRAWING No.		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
2	-	-	4	-	-

MAX. ANCHOR'S SPACING SCHEDULE VI FOR A GIVEN SHUTTER MOUNTING TYPE, WOOD GRADE, A.S.D.
DESIGN LOAD (psf) AND SLAT SPAN RANGE FOR INSTALLATIONS INTO WOOD BUILDINGS;
(SEE SHT. 7, SECTION O'-O' FOR ANCHOR SPEC'S & GENERAL NOTE 7C ON SHT. 1)


WALL MOUNT TO MIN. 2"x4" WOOD STUD WITH MINIMUM 1/2" PLYWOOD
(SEE DETAIL 1 ON SHEET 17)

WOOD GRADE	MAXIMUM A.S.D. DESIGN PRESSURE RATING RANGE (psf)	SLAT SPAN RANGE						
		0' to 4' *	> 4' to 5' *	> 5' to 6' *	> 6' to 7' *	> 7' to 8' *	> 8' to 10' *	> 10' to 12' *
SOUTHERN PINE #2 (G=0.55)	≤ 30.0	6"	6"	6"	6"	6"	6"	6"
	40	6"	6"	6"	6"	6"	4 3/4"	4 1/2"
	50	6"	6"	6"	6"	4 3/4"	3 1/2"	3"
	60	6"	6"	5 3/4"	5 1/4"	3 3/4"	3"	3"
DOUGLAS-FIR-SOUTH (G=0.46)	≤ 30.0	6"	6"	6"	6"	6"	6"	6"
	40	6"	6"	6"	5 1/4"	5 1/4"	4 1/4"	3"
SPRUCE PINE-FIR-SOUTH (G=0.36)	≤ 30.0	6"	6"	6"	6"	6"	5 1/4"	4 1/2"

BUILD-OUT MOUNT TO MIN. 2"x4" WOOD STUD WITH MINIMUM 1/2" PLYWOOD
(SEE DETAIL 1 ON SHEET 17)

WOOD GRADE	MAXIMUM A.S.D. DESIGN PRESSURE RATING RANGE (psf)	SLAT SPAN RANGE													
		0'-4' *		> 4'-5' *		> 5'-6' *		> 6'-7' *		> 7'-9' *		> 9'-10' *		> 10' to 12' *	
		BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)	BUILD-OUT MOUNT W/ (P)
SOUTHERN PINE #2 (G=0.55)	≤ 30.0	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"
	40	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	5 1/4"	5 1/4"	5 1/4"	5 1/4"
	50	6"	6"	6"	6"	6"	6"	6"	6"	5 1/4"	5 1/4"	4"	4"	4"	4"
	60	6"	6"	6"	6"	6"	6"	5 3/4"	5 3/4"	4"	4"	3"	3"	3"	3"
DOUGLAS-FIR-SOUTH (G=0.46)	≤ 30.0	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"
	40	6"	6"	6"	6"	6"	6"	5 1/2"	5 1/2"	5 1/2"	5 1/2"	4 1/2"	4 1/2"	4 1/2"	4 1/2"
SPRUCE PINE-FIR-SOUTH (G=0.36)	≤ 30.0	6"	6"	6"	6"	6"	6"	6"	6"	6"	6"	5 1/4"	5"	5 1/4"	5"

* NOTE:
MAX. SPAN FOR SLAT FOR A
GIVEN A.S.D. DESIGN LOAD
SHALL NEVER EXCEED MAX.
SLAT SPAN INDICATED ON
SLAT PERFORMANCE CHARTS
ON SHEET 17.

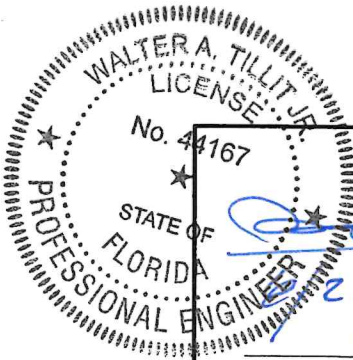

P.E. SEAL/SIGNATURE/DATE


FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)												
©2026 TILTECO, INC.					IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I					W.H. DRAWN BY:		
TILTECO INC.					gaviota The Sun & Shutter Specialists					6/19/2026 DATE:		
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone: (305)871-1530 • Fax: (305)871-1531 CA-0006719					Carrada de Acolotenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Panloco Ciudad de Mexico-02510					26-044 DRAWING No.		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE						SHEET 18 OF 21	
1	OLD 23-190	5/19/26	3	-	-							
2	-	-	4	-	-							

SCHEDULE 1a
FLOOR TO CEILING (TRAPPED) MOUNTING
MAX. SPAN (ft) FOR END AND INTERIOR MULLIONS FOR A GIVEN A.S.D.
DESIGN PRESSURE RATING (p.s.f.), & A MAX. MULLION SPACING (ft) *

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	MAXIMUM MULLION SPACING (ft) *	MAXIMUM MULLION SPAN (FT)								
		ⓐ 4"x6"x1/4" MULLION				Ⓚ 4"x8"x1/4" MULLION				Ⓛ 4"x4"x1/4" MULLION
		ORIENTATION #2 (⇐) †		ORIENTATION #1 (⇐) †		ORIENTATION #2 (⇐) †		ORIENTATION #1 (⇐) †		
		END	INTERIOR	END	INTERIOR	END	INTERIOR	END	INTERIOR	
30.0	14'-2 3/16"	—	8'-2"	—	10'-0"	9'-4"	8'-11"	—	10'-0"	—
35.0	14'-2 3/16"	—	8'-2"	—	10'-0"	9'-4"	8'-11"	—	10'-0"	—
40.0	14'-2 3/16"	—	8'-0"	—	10'-0"	9'-4"	8'-10"	—	10'-0"	—
45.0	14'-2 3/16"	—	8'-0"	—	9'-10"	9'-4"	8'-8"	—	10'-0"	—
50.0	14'-2 3/16"	—	—	—	9'-9"	9'-4"	8'-7"	—	10'-0"	—
55.0	14'-2 3/16"	—	—	—	9'-8"	9'-4"	8'-6"	—	10'-0"	—
60.0	14'-2 3/16"	—	—	—	9'-8"	9'-4"	8'-5"	—	10'-0"	—


SCHEDULE 2a
WALL MOUNTING
MAX. SPAN (FT) FOR END AND INTERIOR MULLIONS FOR A GIVEN A.S.D. DESIGN
PRESSURE RATING (P.S.F.), & A MAX. MULLION SPACING (FT) *

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	MAXIMUM MULLION SPACING (ft) *	MAXIMUM MULLION SPAN (FT)								
		ⓐ 4"x6"x1/4" MULLION				Ⓚ 4"x8"x1/4" MULLION				Ⓛ 4"x4"x1/4" MULLION
		ORIENTATION #2 (⇐) †		ORIENTATION #1 (⇐) †		ORIENTATION #2 (⇐) †		ORIENTATION #1 (⇐) †		
		END	INTERIOR	END	INTERIOR	END	INTERIOR	END	INTERIOR	
30.0	14'-2 3/16"	7'-10"	9'-0"	6'-6"	10'-6"	9'-4"	8'-11"	7'-0"	12'-0"	7'-4"
35.0	14'-2 3/16"	7'-7"	8'-4"	6'-3"	10'-3"	9'-4"	8'-11"	6'-9"	12'-0"	7'-3"
40.0	14'-2 3/16"	7'-6"	8'-0"	6'-2"	10'-0"	9'-4"	8'-10"	6'-9"	12'-0"	7'-2"
45.0	14'-2 3/16"	7'-6"	8'-0"	6'-1"	9'-10"	9'-4"	8'-8"	6'-8"	12'-0"	7'-1"
50.0	14'-2 3/16"	7'-6"	7'-10"	6'-1"	9'-9"	9'-4"	8'-7"	6'-8"	12'-0"	7'-1"
55.0	14'-2 3/16"	7'-6"	7'-10"	6'-0"	9'-9"	9'-4"	8'-6"	6'-7"	12'-0"	7'-0"
60.0	14'-2 3/16"	7'-6"	7'-10"	6'-0"	9'-9"	9'-4"	8'-5"	6'-7"	12'-0"	7'-0"

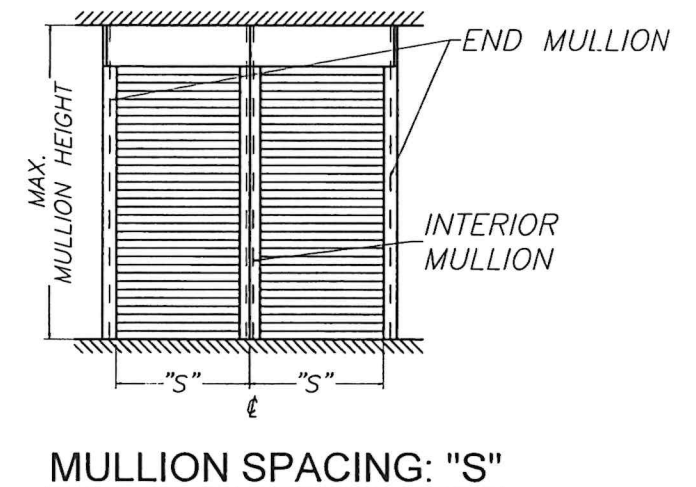

* MAXIMUM MULLION SPACING SHALL BE SUCH THAT MAX. ALLOWABLE WALL MOUNTED SLAT SPAN FOR THAT A.S.D. DESIGN PRESSURE RATING SHALL NOT BE EXCEEDED.

† MULLION ORIENTATION IS AS SEEN FROM THE OUTSIDE (EXTERIOR) OF PRODUCT.

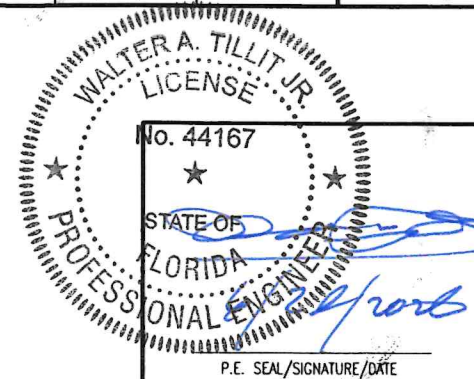

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I		
TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 • Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT JR., P.E. FLORIDA Lic. # 44167			gaviota The Sun & Shutter Specialists Cerrada de Acolotenco 237, Bodega 4B, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510		W.H. DRAWN BY:
			6/19/2026 DATE:		
			26-044		DRAWING No.
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
2	-	-	4	-	-
					SHEET 19 OF 21

SCHEDULE 1b
FLOOR TO CEILING (TRAPPED) MOUNTING MAX. SPAN (ft) FOR END AND INTERIOR MULLIONS FOR A GIVEN
A.S.D. DESIGN PRESSURE RATING (p.s.f.), & A 12'-0" MAX. MULLION SPACING (ft) *


MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	MAXIMUM MULLION SPACING (ft) *	MAXIMUM MULLION SPAN (FT)									
		J 4"x6"x1/4" MULLION					K 4"x8"x1/4" MULLION				
		ORIENTATION #2 (⇌)†		ORIENTATION #1 (⌈)†			ORIENTATION #2 (⇌)†		ORIENTATION #1 (⌈)†		
		END	INTERIOR	END	INTERIOR		END	INTERIOR	END	INTERIOR	
30.0	12'-0"	10'-0"	10'-0"	8'-2"	10'-0"		10'-0"	10'-0"	8'-11"	10'-0"	9'-0"
35.0	12'-0"	9'-7"	9'-6"	8'-0"	10'-0"		10'-0"	10'-0"	8'-5"	10'-0"	8'-6"
40.0	12'-0"	9'-1"	9'-1"	8'-0"	10'-0"		10'-0"	10'-0"	8'-0"	10'-0"	8'-2"
45.0	12'-0"	8'-9"	8'-9"	-	10'-0"		10'-0"	9'-6"	-	10'-0"	-
50.0	12'-0"	8'-4"	8'-6"	-	10'-0"		10'-0"	9'-2"	-	10'-0"	-
55.0	12'-0"	8'-1"	8'-2"	-	9'-7"		10'-0"	8'-11"	-	10'-0"	-
60.0	12'-0"	-	8'-2"	-	9'-7"		10'-0"	8'-8"	-	10'-0"	-

SCHEDULE 2b
WALL MOUNTING MAX. SPAN (FT) FOR END AND INTERIOR MULLIONS FOR A GIVEN A.S.D.
DESIGN PRESSURE RATING (P.S.F.), & A 12'-0" MAX. MULLION SPACING (FT) *

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	MAXIMUM MULLION SPACING (ft) *	MAXIMUM MULLION SPAN (FT)									
		J 4"x6"x1/4" MULLION					K 4"x8"x1/4" MULLION				
		ORIENTATION #2 (⇌)†		ORIENTATION #1 (⌈)†			ORIENTATION #2 (⇌)†		ORIENTATION #1 (⌈)†		
		END	INTERIOR	END	INTERIOR		END	INTERIOR	END	INTERIOR	
30.0	12'-0"	9'-9"	11'-6"	9'-9"	12'-0"		12'-0"	12'-0"	10'-7"	12'-0"	9'-0"
35.0	12'-0"	9'-2"	10'-11"	9'-2"	12'-0"		12'-0"	11'-11"	10'-0"	12'-0"	8'-6"
40.0	12'-0"	8'-9"	10'-5"	8'-9"	12'-0"		11'-8"	11'-4"	9'-6"	12'-0"	8'-2"
45.0	12'-0"	8'-4"	10'-1"	8'-4"	12'-0"		10'-11"	10'-11"	9'-1"	12'-0"	7'-10"
50.0	12'-0"	8'-1"	9'-8"	8'-1"	12'-0"		10'-7"	10'-7"	8'-9"	12'-0"	7'-5"
55.0	12'-0"	7'-10"	9'-5"	7'-10"	11'-8"		9'-10"	10'-3"	8'-6"	12'-0"	7'-4"
60.0	12'-0"	7'-6"	9'-2"	7'-6"	11'-4"		9'-5"	9'-11"	8'-3"	12'-0"	7'-2"

SCHEDULE 1b' (LIMITED LOAD, MULLION SPACING & SPAN INSTALLATION)
FLOOR TO CEILING (TRAPPED) MOUNTED MAX. SPAN (ft) FOR END & INTERIOR MULLIONS FOR A GIVEN
A.S.D. DESIGN PRESSURE (p.s.f.), AND FOR 12'-0" (CASE I) & 8'-0" (CASE Ia) MAX. MULLION SPACING (ft) *

INSTALLATION CASES	MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	MAXIMUM MULLION SPACING (ft) *	MAXIMUM MULLION SPAN (FT)						
			J 4"x6"x1/4" MULLION		K 4"x8"x1/4" MULLION			L 4"x4"x1/4" MULLION	
			ORIENTATION #2 (⇌)†	ORIENTATION #1 (⌈)†	ORIENTATION #2 (⇌)†	ORIENTATION #2 (⇌)†	ORIENTATION #1 (⌈)†		
			END	INTERIOR	END	INTERIOR	INTERIOR	INTERIOR	
CASE I	30.0	12'-0"	-	10'-0"	10'-0"	10'-0"	10'-0"	9'-0"	
	35.0	12'-0"	-	10'-0"	10'-0"	10'-0"	10'-0"	8'-6"	
	40.0	12'-0"	-	10'-0"	10'-0"	10'-0"	10'-0"	8'-2"	
	45.0	12'-0"	-	10'-0"	10'-0"	9'-6"	10'-0"	-	
	50.0	12'-0"	-	10'-0"	10'-0"	9'-2"	10'-0"	-	
	55.0	12'-0"	-	9'-7"	10'-0"	8'-11"	10'-0"	-	
CASE Ia	60.0	12'-0"	-	9'-7"	10'-0"	8'-8"	10'-0"	-	
	30.0	8'-0"	-	9'-0" **	9'-0" **	9'-0" **	9'-0" **	10'-0"	
	35.0	8'-0"	-	9'-0" **	9'-0" **	9'-0" **	9'-0" **	9'-9"	
	40.0	8'-0"	-	9'-0" **	9'-0" **	9'-0" **	9'-0" **	9'-4"	
	45.0	8'-0"	-	9'-0" **	9'-0" **	9'-0" **	9'-0" **	9'-0"	
	50.0	8'-0"	-	9'-0" **	9'-0" **	9'-0" **	9'-0" **	8'-7"	
	55.0	8'-0"	-	9'-0" **	9'-0" **	9'-0" **	9'-0" **	8'-5"	
	60.0	8'-0"	-	9'-0" **	9'-0" **	9'-0" **	9'-0" **	8'-2"	

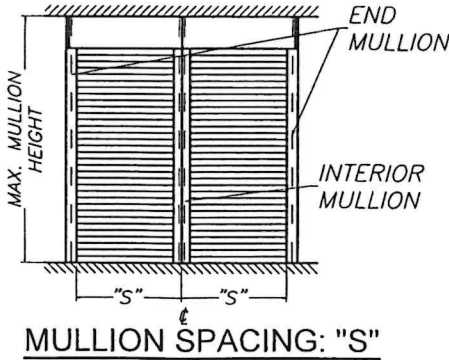

* MAXIMUM MULLION SPACING SHALL BE SUCH THAT
MAX. ALLOWABLE WALL MOUNTED SLAT SPAN FOR
THAT DESIGN LOAD SHALL NOT BE EXCEEDED.

† MULLION ORIENTATION IS AS SEEN FROM THE
OUTSIDE (EXTERIOR) OF PRODUCT.

SCHEDULE 2b' (LIMITED LOAD, MULLION SPACING & SPAN INSTALLATION)
WALL MOUNTED MAX. SPAN (ft) FOR END & INTERIOR MULLIONS FOR A GIVEN A.S.D. DESIGN
PRESSURE RATING (p.s.f.), AND FOR 12'-0" (CASE I) & 8'-0" (CASE II) MAX. MULLION SPACING (ft) *

INSTALLATION CASES	MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	MAXIMUM MULLION SPACING (ft) *	MAXIMUM MULLION SPAN (FT)						
			J 4"x6"x1/4" MULLION		K 4"x8"x1/4" MULLION			L 4"x4"x1/4" MULLION	
			ORIENTATION #2 (⇌)†	ORIENTATION #1 (⌈)†	ORIENTATION #2 (⇌)†	ORIENTATION #2 (⇌)†	ORIENTATION #1 (⌈)†		
			END	INTERIOR	END	INTERIOR	INTERIOR	INTERIOR	
CASE I'	30.0	12'-0"	-	10'-0"	10'-0"	10'-0"	10'-0"	9'-0"	
	35.0	12'-0"	-	10'-0"	10'-0"	10'-0"	10'-0"	8'-6"	
	40.0	12'-0"	-	10'-0"	10'-0"	10'-0"	10'-0"	8'-2"	
	45.0	12'-0"	-	10'-0"	10'-0"	9'-6"	10'-0"	7'-10"	
	50.0	12'-0"	-	10'-0"	10'-0"	9'-2"	10'-0"	7'-5"	
	55.0	12'-0"	-	9'-7"	10'-0"	8'-11"	10'-0"	7'-4"	
CASE II'	60.0	12'-0"	-	9'-7"	10'-0"	8'-8"	10'-0"	7'-2"	
	30.0	8'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	10'-0"	
	35.0	8'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-9"	
	40.0	8'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-4"	
	45.0	8'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	
	50.0	8'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	8'-7"	
	55.0	8'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	8'-5"	
	60.0	8'-0"	9'-0"	9'-0"	9'-0"	9'-0"	9'-0"	8'-2"	

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE


FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)									
©2026 TILTECO, INC.					IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I				
TILTECO INC.					gaviota				
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 - Fax : (305)871-1531 CA-0006719					The Sun & Shutter Specialists Carrada de Acolofencia 237, Bodega 48, Colonia San Sebastian, P.I. Pical Pantaco Ciudad de Mexico-02510				
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	W.H. DRAWN BY: 6/19/2026 DATE: 26-044 DRAWING No.			
1	OLD 23-190	5/19/26	3	-	-	SHEET 20 OF 21			
2	-	-	4	-	-				

SCHEDULE 1c
FLOOR TO CEILING (TRAPPED) MOUNTING
MAX. SPAN (ft) FOR END AND INTERIOR MULLIONS FOR A GIVEN A.S.D.
DESIGN PRESSURE RATING (p.s.f.), & A 7'-0" MAX. MULLION SPACING (ft) *

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	MAXIMUM MULLION SPACING (ft) *	MAXIMUM MULLION SPAN (FT)									
		ⓐ 4"x6"x1/4" MULLION				ⓑ 4"x8"x1/4" MULLION				ⓓ 4"x4"x1/4" MULLION	
		ORIENTATION #2 (⇐) †		ORIENTATION #1 (□) †		ORIENTATION #2 (⇐) †		ORIENTATION #1 (□) †			
		END	INTERIOR	END	INTERIOR	END	INTERIOR	END	INTERIOR	INTERIOR	
30.0	7'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	
35.0	7'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	
40.0	7'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	9'-9"	
45.0	7'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	9'-4"	
50.0	7'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	9'-1"	
55.0	7'-0"	10'-0"	9'-10"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	8'-9"	
60.0	7'-0"	10'-0"	9'-10"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	10'-0"	8'-6"	


SCHEDULE 2c
WALL MOUNTING
MAX. SPAN (FT) FOR END AND INTERIOR MULLIONS FOR A GIVEN A.S.D.
DESIGN PRESSURE RATING (P.S.F.), & AND 7'-0" MAX. MULLION SPACING (FT)

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	MAXIMUM MULLION SPACING (ft) *	MAXIMUM MULLION SPAN (FT)									
		ⓐ 4"x6"x1/4" MULLION				ⓑ 4"x8"x1/4" MULLION				ⓓ 4"x4"x1/4" MULLION	
		ORIENTATION #2 (⇐) †		ORIENTATION #1 (□) †		ORIENTATION #2 (⇐) †		ORIENTATION #1 (□) †			
		END	INTERIOR	END	INTERIOR	END	INTERIOR	END	INTERIOR	INTERIOR	
30.0	7'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	10'-0"	
35.0	7'-0"	12'-0"	11'-5"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	12'-0"	10'-0"	
40.0	7'-0"	12'-0"	10'-11"	12'-0"	12'-0"	12'-0"	11'-10"	12'-0"	12'-0"	9'-9"	
45.0	7'-0"	12'-0"	10'-6"	12'-0"	12'-0"	12'-0"	11'-5"	12'-0"	12'-0"	9'-4"	
50.0	7'-0"	12'-0"	10'-2"	12'-0"	12'-0"	12'-0"	11'-0"	12'-0"	12'-0"	9'-1"	
55.0	7'-0"	12'-0"	9'-10"	12'-0"	12'-0"	12'-0"	10'-8"	12'-0"	12'-0"	8'-9"	
60.0	7'-0"	12'-0"	9'-10"	11'-2"	12'-0"	12'-0"	10'-4"	12'-0"	12'-0"	8'-6"	

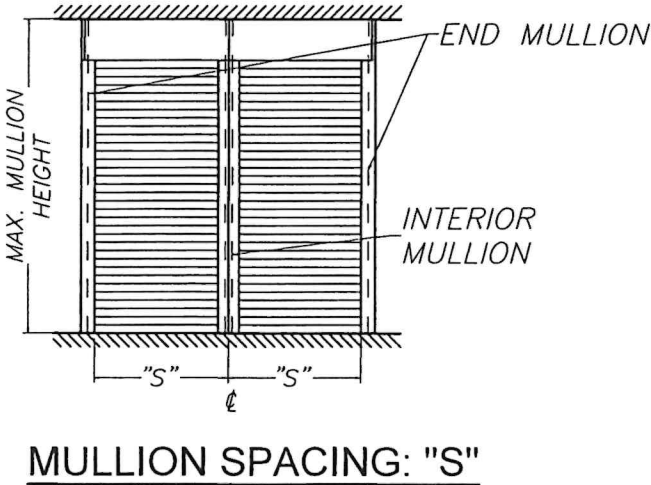

* MAXIMUM MULLION SPACING SHALL BE SUCH THAT MAX. ALLOWABLE WALL MOUNTED SLAT SPAN FOR THAT A.S.D. DESIGN PRESSURE RATING SHALL NOT BE EXCEEDED.

† MULLION ORIENTATION IS AS SEEN FROM THE OUTSIDE (EXTERIOR) OF PRODUCT.

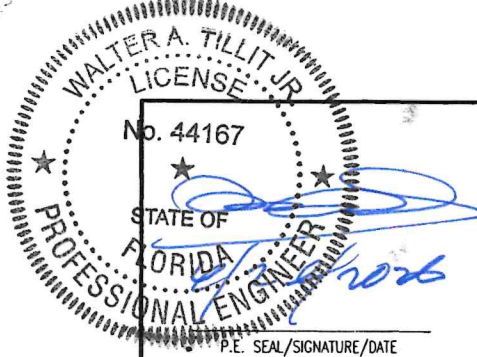

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2026 TILTECO, INC.					
TILTECO INC.					
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone: (305)871-1530 • Fax: (305)871-1531 CA-0006719 WALTER A. TILLIT Jr., P.E. FLORIDA Lic. # 44167					
IMPACT PROTECTIVE ROLLING SYSTEM W/ GV-60 END RETENTION SLAT L.M.I				W.H. DRAWN BY:	
gaviota The Sun & Shutter Specialists Carrada de Acolotenco 237, Bodega 48, Colonia San Sebastian, P.I. Pical Panfaco Ciudad de Mexico-02510				6/19/2026 DATE:	
				26-044 DRAWING No.	
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-190	6/19/26	3	-	-
2	-	-	4	-	-
SHEET 21 OF 21					