


*** USE OF THIS PRODUCT REQUIRES WRITTEN AUTHORIZATION BY PAGEN SP TO THE BUILDING DEPARTMENT WHEN APPLYING FOR A PERMIT ***

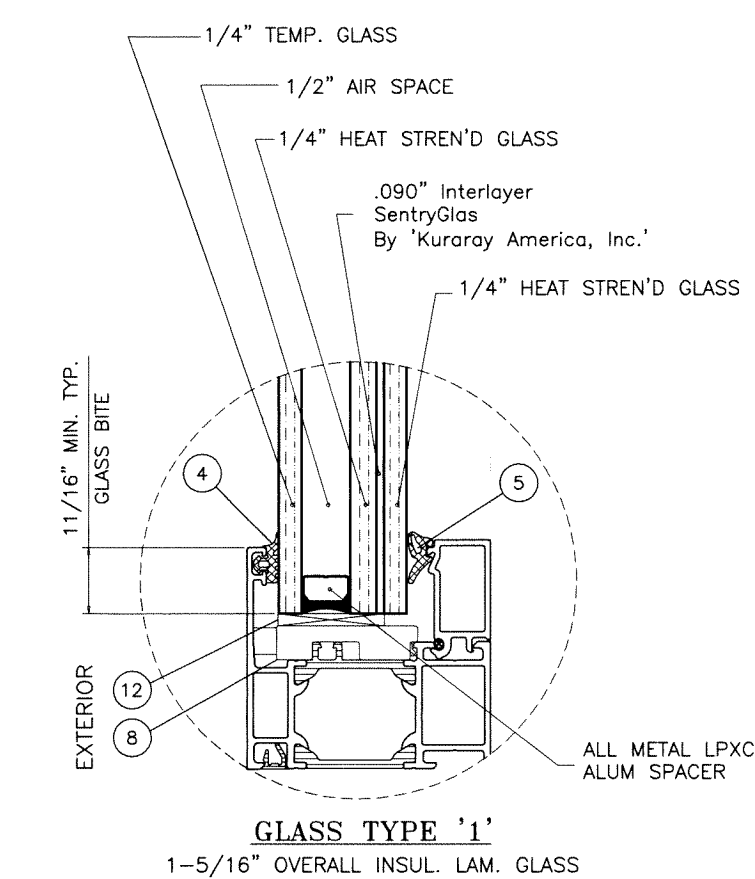

FIXED WINDOW IS RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

SERIES AWS 65/70.HI/75.SI+/90.SI+ FIXED WINDOW SYSTEM

APPROVAL APPLIES TO SINGLE UNITS
CODE REQUIREMENTS FOR SAFEGUARDS MUST BE OBSERVED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2020 (7TH EDITION)/2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2020/2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.


THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

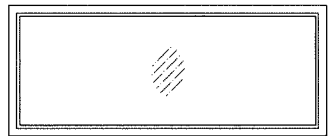

NOTE:
WIDTH AND HEIGHT DIMENSIONS CAN BE ORIENTED VERTICALLY OR HORIZONTALLY AS SHOWN ABOVE.

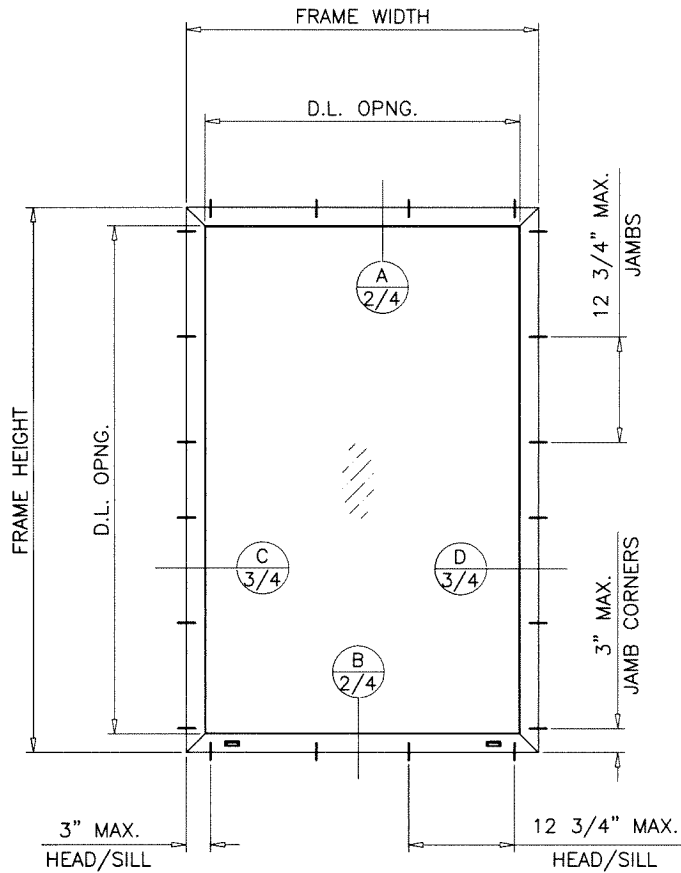

TYPICAL ELEVATION
TESTED UNIT

NOTE:
FOR ADDITIONAL APPROVED SIZES AND GLAZING DETAILS FOR THIS PRODUCT AS A STANDALONE FIXED WINDOW SEE FL# 26357.

DESIGN LOAD CAPACITY - PSF		
WINDOW DIMS.		GLASS TYPE '1'
HEIGHT	WIDTH	EXT.(+) INT.(-)
30"	30"	70.0
	36"	70.0
	42"	70.0
	48"	70.0
	54"	70.0
	60"	70.0
	66"	70.0
	72"	70.0
	78"	70.0
	84"	70.0
36"	90"	70.0
	96"	70.0
	36"	70.0
	42"	70.0
	48"	70.0
	54"	70.0
	60"	70.0
48"	66"	70.0
	72"	70.0
	78"	70.0
	42"	70.0
60"	44 3/16"	70.0
	54"	64.5
	60"	64.5
68 3/16"	42"	70.0
	44 3/16"	70.0

DAYLITE OPENINGS:

AWS 65, 70.HI & 75.SI+:
FRAME WIDTH/ HEIGHT - 4.646"


AWS 90.SI+:
FRAME WIDTH/ HEIGHT - 5.040"

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-09 (3 SEC. GUSTS).

Sealed: 8/11/2023

INSUL. LAM. GLASS
LARGE MISSILE IMPACT

FL # 42037

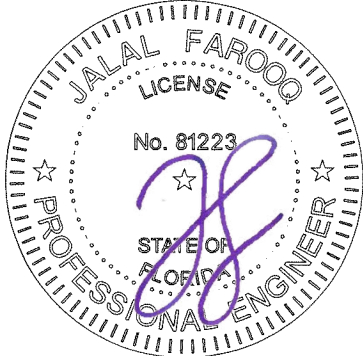

- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES AWS 65/70/75/90 FIXED WINDOW SYSTEM (L.M.I.)





PAGEN Sp. z o.o.
Gnojnik 699
32-864 Gnojnik, Poland
Phone: +48 14 63 93 130
www.pagen.pl/en

revisions:

no	date	by	description
A	08.10.23		UPDATED TO 2023 FBC

date: 04-12-23
scale: 1 : 16
dr. by: MLS
chk. by:

drawing no.
23-21F
sheet 1 of 5

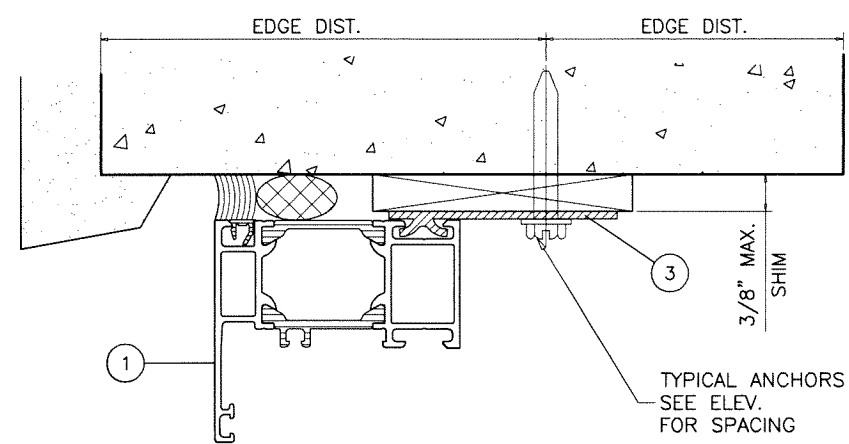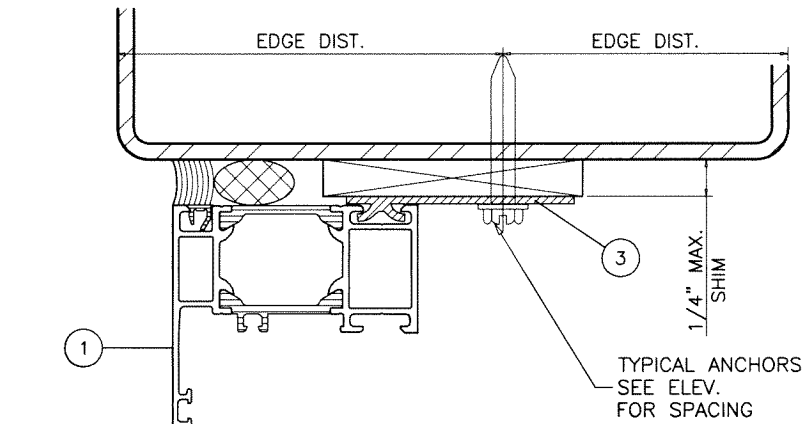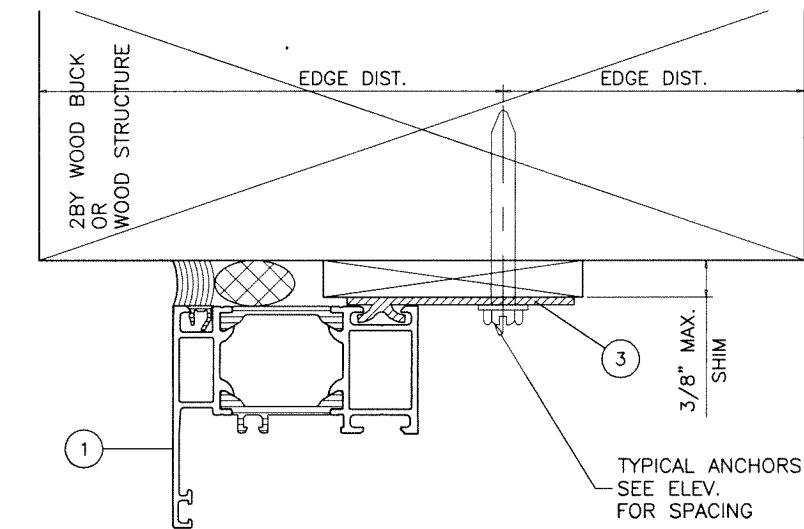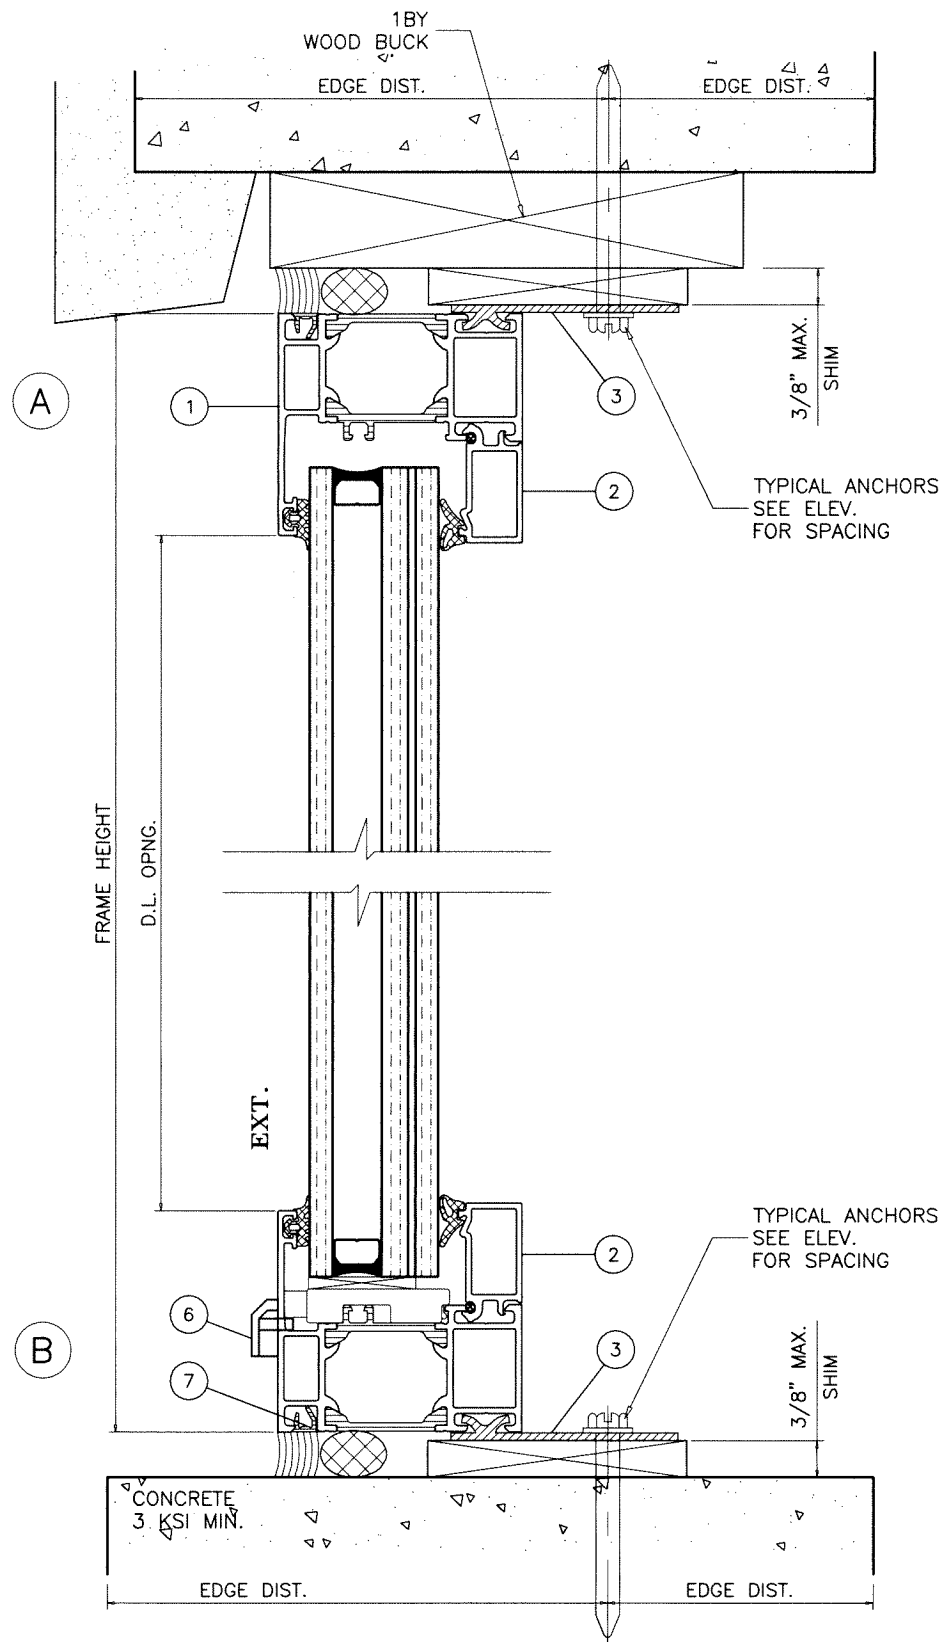

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE A - 1/4" DIA. ULTRACON+ BY 'DEWALT' ($F_u=164$ KSI, $F_y=148$ KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)
 DIRECTLY INTO CONCRETE OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

TYPE B - 1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS
 OR
 INTO METAL STRUCTURES
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. ($F_y = 36$ KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE


INTO CONCRETE = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.
 INTO BLOCK = 2-1/2" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS $f'_c = 3000$ PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS $f'_m = 2000$ PSI MIN.

WOOD BUCKS AND METAL STRUCTURE NOT BY 'PAGEN SP'
 MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
 AND TRANSFER THEM TO THE BUILDING STRUCTURE.

Sealed: 8/11/2023

STRAP ANCHOR INSTALLATION

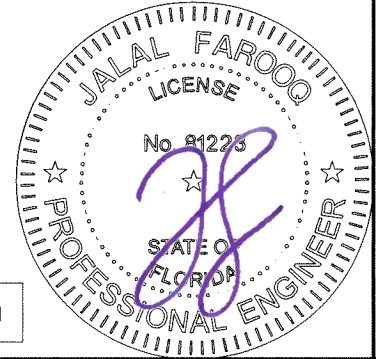

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978




COMP-ANL\23-21F-PSZ

SERIES AWS 65/70/75/90 FIXED WINDOW SYSTEM (L.M.I.)

PAGEN Sp. z o.o.
 Gnojnik 699
 32-864 Gnojnik, Poland
 Phone: +48 14 63 93 130
www.pagen.pl/en


revisions:	
no.	description

date: 04-12-23	scale: 1 : 2	dr. by: M.L.S.	chk. by:	drawing no. 23-21F
				sheet 2 of 5

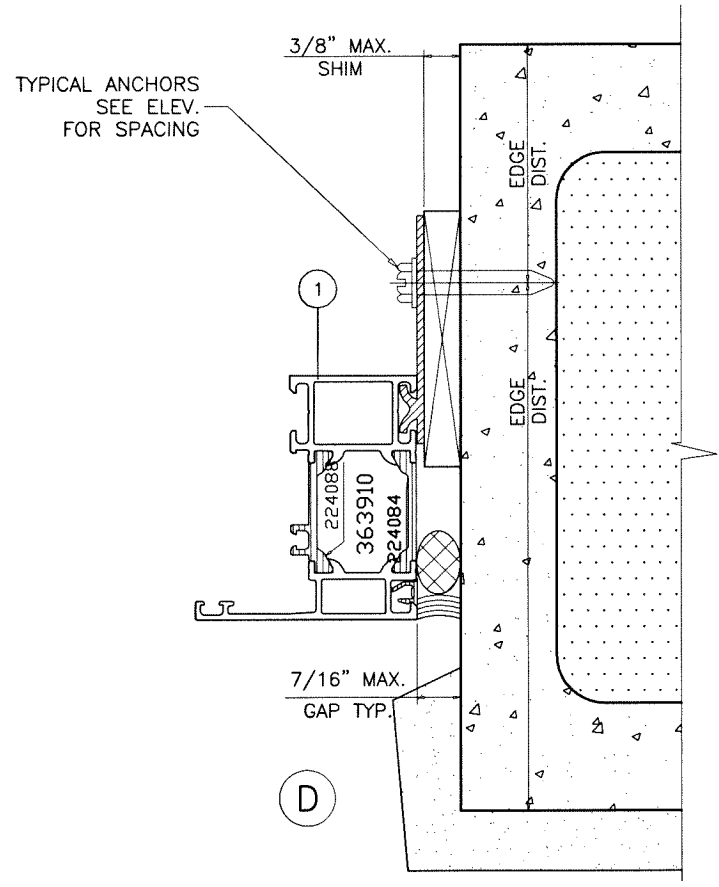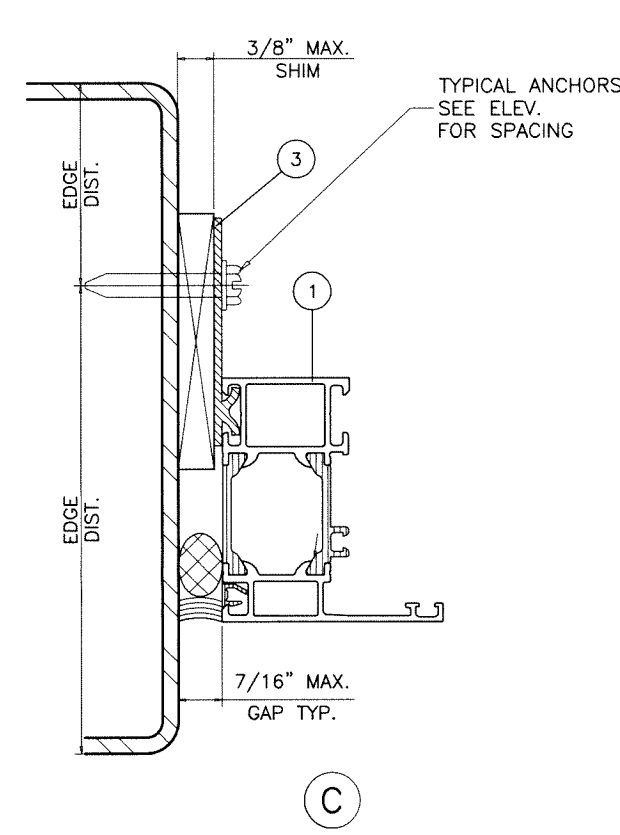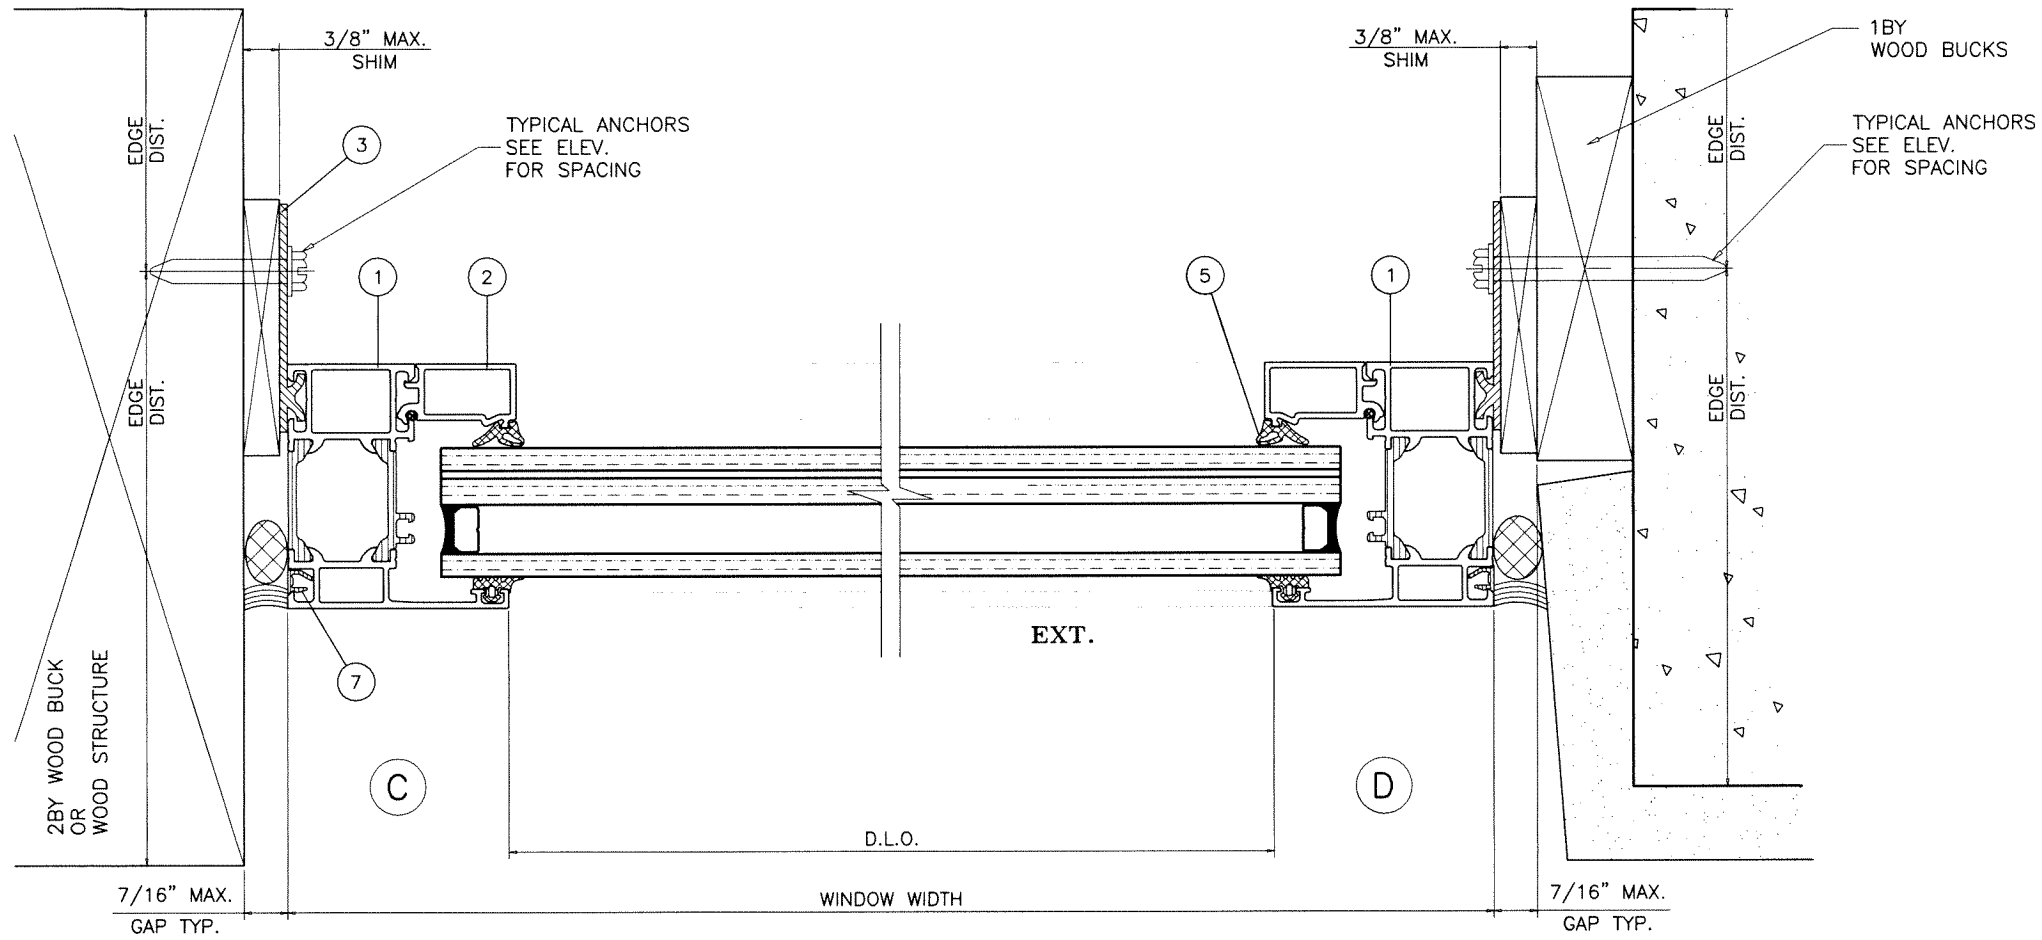

Sealed: 8/11/2023

STRAP ANCHOR INSTALLATION

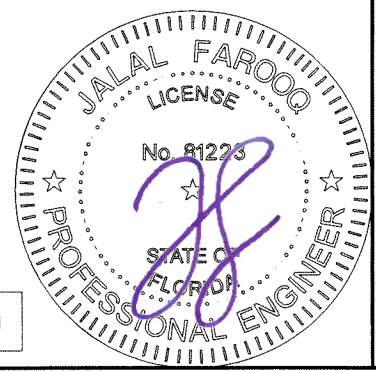

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

af c

COMP-ANL-23-21F-PSZ

SERIES AWS 65/70/75/90 FIXED WINDOW SYSTEM (L.M.I.)

PAGEN Sp. z o.o.
Gnojnik 699
32-864 Gnojnik, Poland
Phone: +48 14 63 93 130

www.pagen.pl/en

revisions:		no		date		by		description	

date: 04-12-23

scale: 1 : 2

dr. by: MLS


chk. by:

FL # 42037


drawing no.
23-21F

sheet **3** of **5**


(A)
ALT.

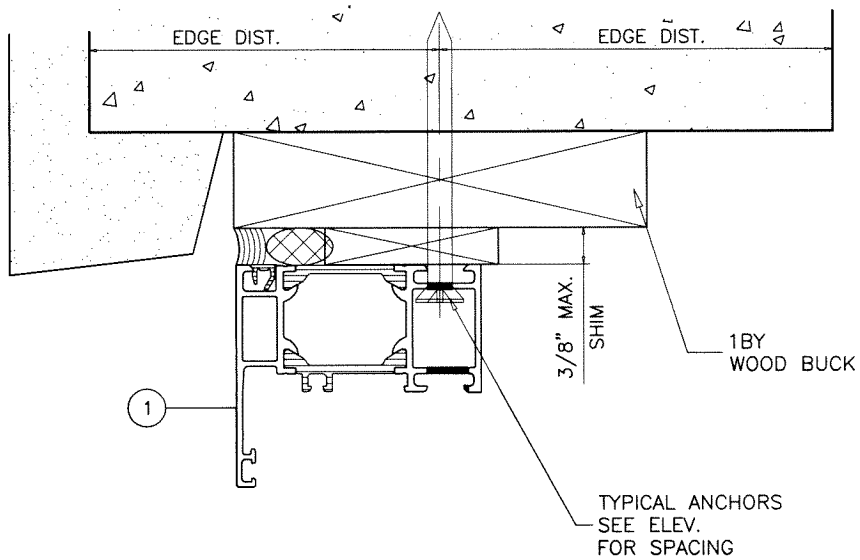

(B)
ALT.

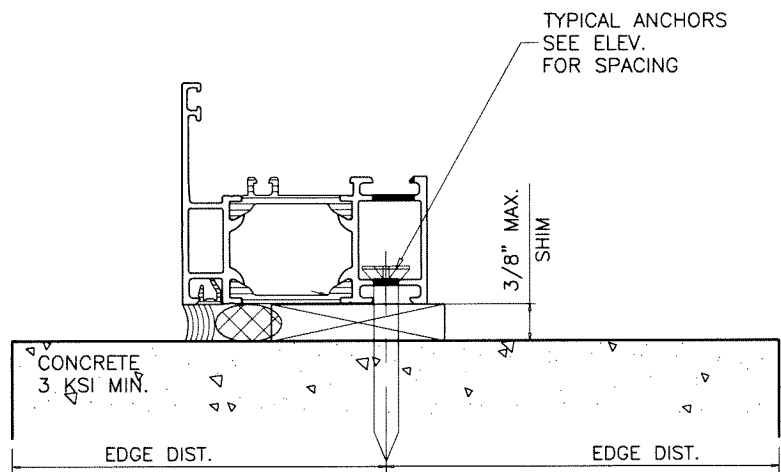

(C)
ALT.

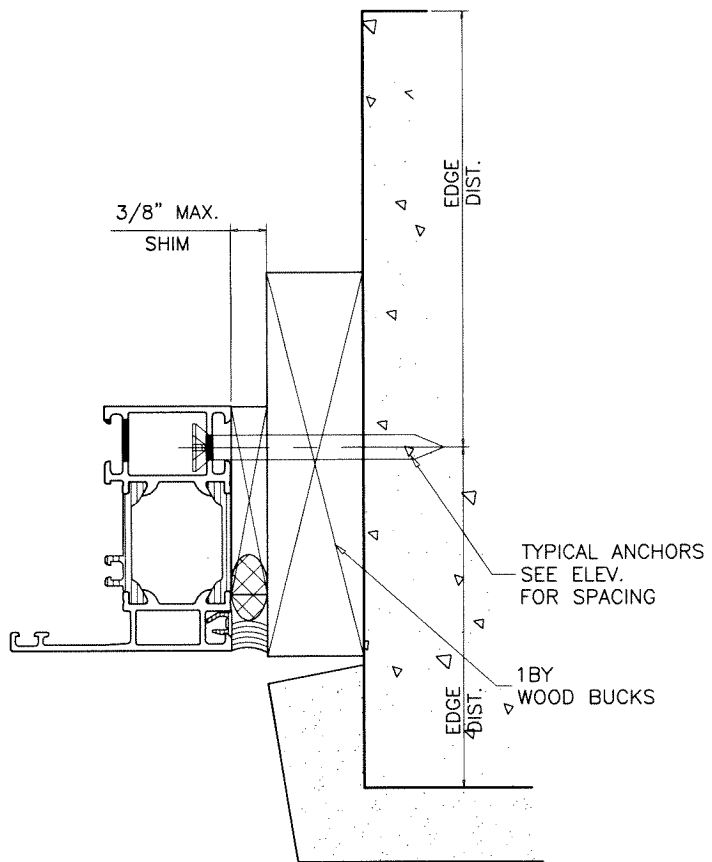

(D)
ALT.

Sealed: 8/11/2023

THROUGH FRAME ANCHOR INSTALLATION

TYPICAL THROUGH FRAME INSTALLATION DETAILS
APPLY TO ALL OTHER SHOWN SUBSTRATES.



FL # 42037

af c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 262-6978 FAX. (305) 262-6978

SERIES AWS 65/70/75/90 FIXED WINDOW SYSTEM (L.M.I.)

PAGEN Sp. z o.o.

Gnojnik 699

32-864 Gnojnik, Poland

Phone: +48 14 63 93 130

www.pagen.pl/en

revisions:		by description	
no	date		

date: 04-12-23

scale: 1 : 2

dr. by: MLS




chk. by:

drawing no.

23-21F

sheet 4 of 5

COMP-ANL\23-21F-PSZ

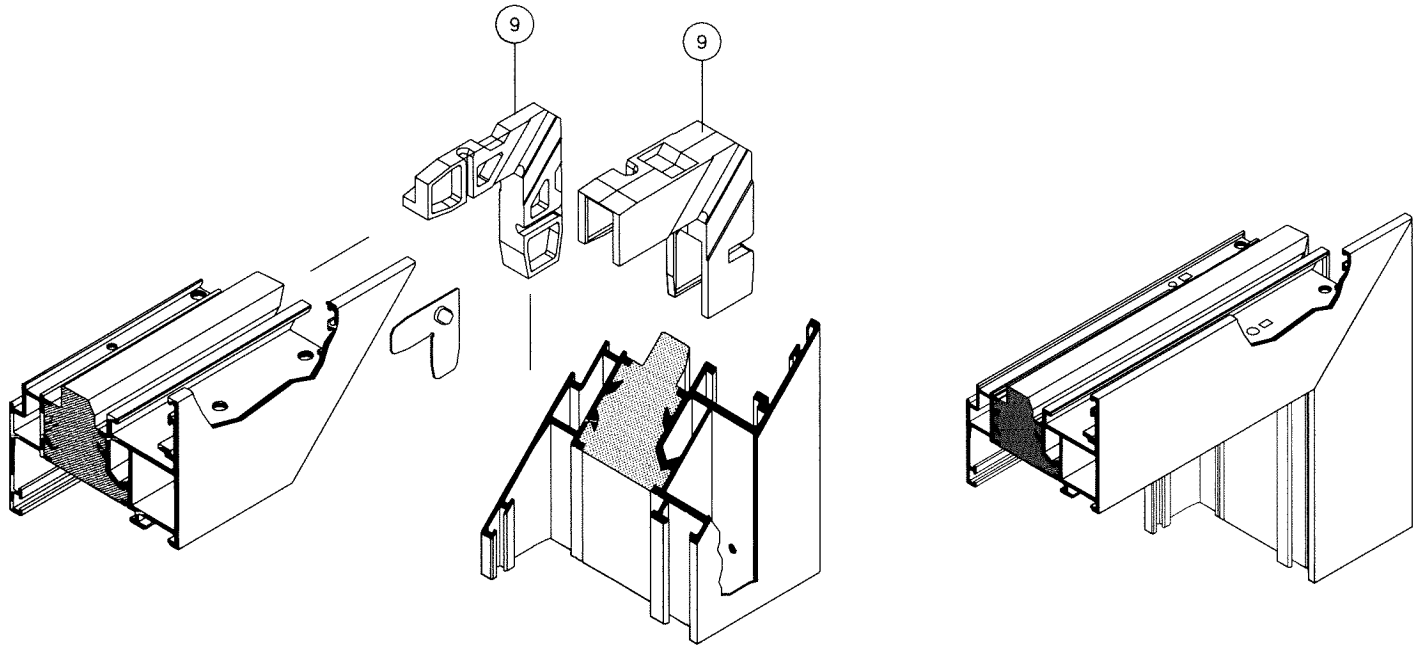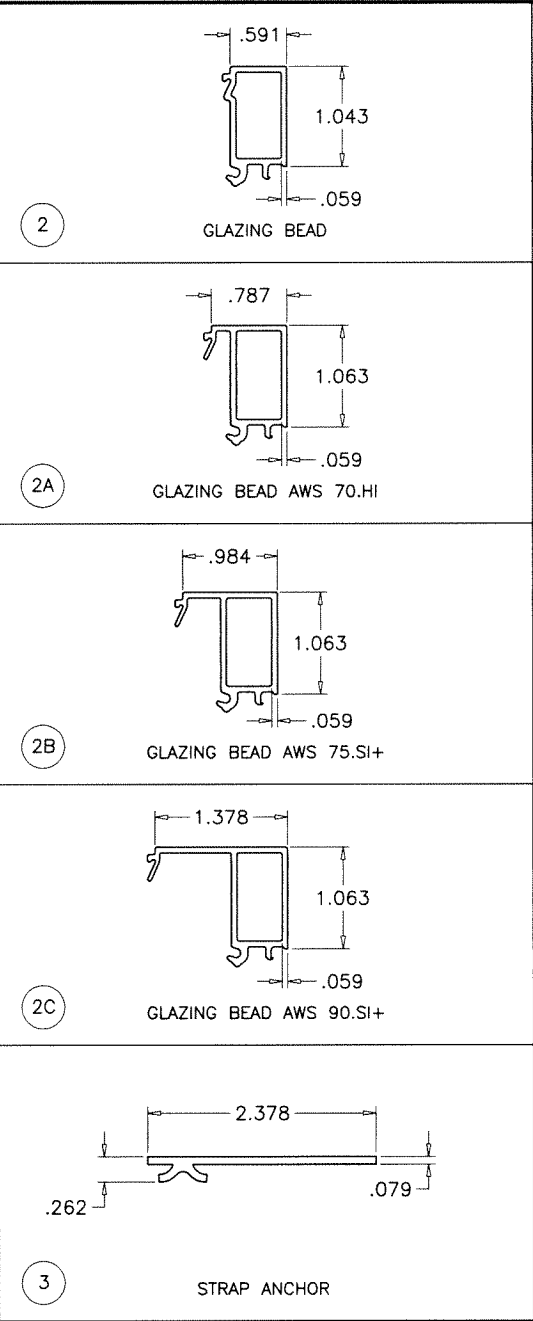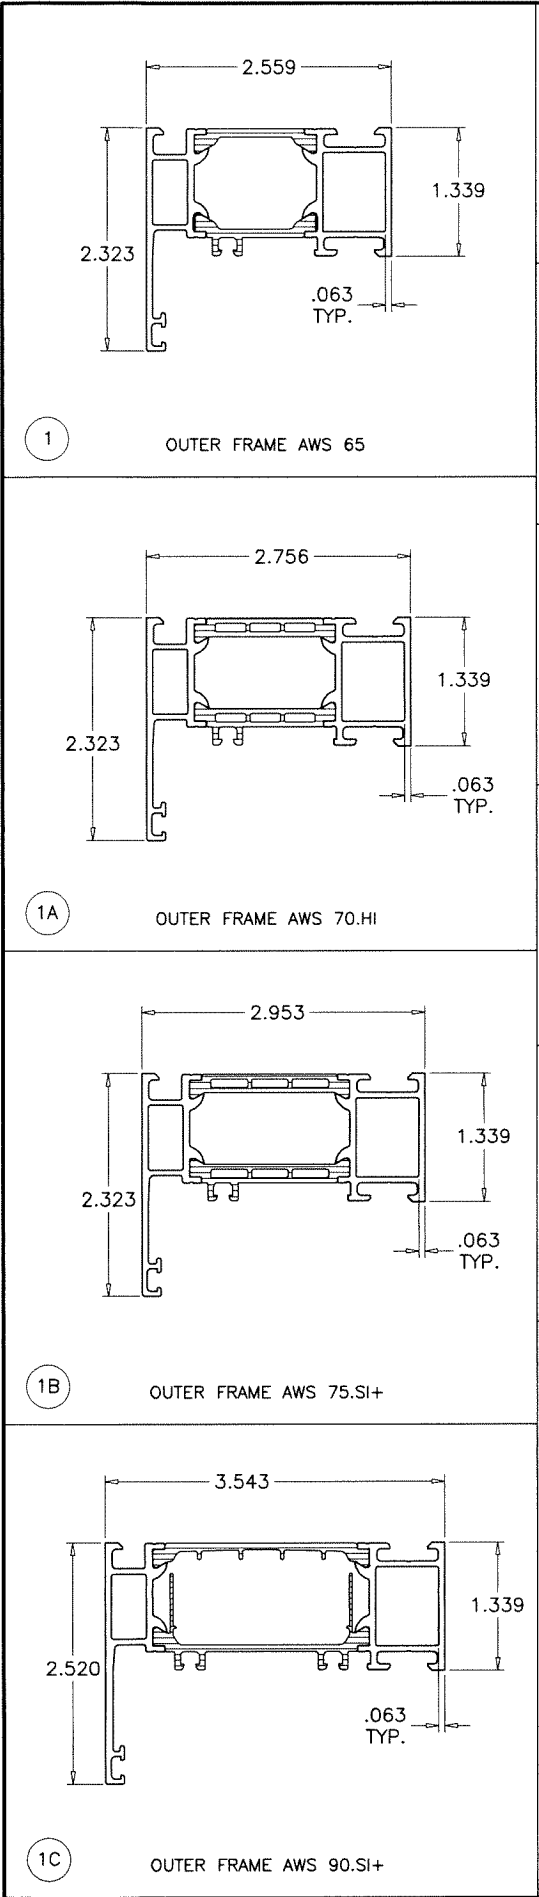

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL
1	363900	4	FRAME AWS 65	6063-T6
1A	358150	AS REQD.	FRAME AWS 70.HI	6063-T6
1B	382130	AS REQD.	FRAME AWS 75.SI+	6063-T6
1C	465070	AS REQD.	FRAME AWS 90.SI+	6063-T6
2	489760	4	GLAZING BEAD EHL 22 (AWS 65)	6063-T6
2A	467770	AS REQD.	FIXED GLAZING BEAD AWS 70.HI	6063-T6
2B	467780	AS REQD.	FIXED GLAZING BEAD AWS 75.SI+	6063-T6
2C	467800	AS REQD.	FIXED GLAZING BEAD AWS 90.SI+	6063-T6
3	207628	AS REQD.	STRAP ANCHOR	50961-Fe/Zn 8 C
4	224063	AS REQD.	GLAZING GASKET 4MM (AWS 65)	
4A	284351	AS REQD.	GLAZING GASKET AWS 70.HI	
4B	284321	AS REQD.	GLAZING GASKET AWS 75.SI+ & 90.SI+	
5	224350	AS REQD.	CONT. O.-IN GASKET 5MM (AWS 65)	
5A	284839	AS REQD.	CONT. O.-IN GASKET AWS 70.HI	
5B	284834	AS REQD.	CONT. O.-IN GASKET AWS 75.SI+	
5C	284837	AS REQD.	CONT. O.-IN GASKET AWS 90.SI+	
6	208694	2	DRAIN COVER CAP BLK.	
7	244516	AS REQD.	PVC-U FILLER PROF SW	
8	288167	2	GLAZING SUPPORT	POLYAMIDE, DUROMETER 80±5 SHORE A
9	236198/236218	4/EA.	CORNER KEY	6063-T6
10	288138	AS REQD.	GLAZ. REBATE INSUL. AWS 75.SI+	
11	288502	AS REQD.	GLAZ. REBATE INSUL. AWS 90.SI+	
12	--	2	SETTING BLOCK	EPDM, DUROMETER 80±5 SHORE A

Sealed: 8/11/2023



af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\23-21F-PSZ

SERIES AWS 65/70/75/90 FIXED WINDOW SYSTEM (L.M.I.)

PAGEN Sp. z o.o.
Gnojnik 699
32-864 Gnojnik, Poland
Phone: +48 14 63 93 130
www.pagen.pl/en

revisions:
no date by description

date: 04-12-23
scale: 1 : 2
dr. by: MLS
chk. by:

drawing no.
23-21F
sheet 5 of 5