

6/2/2023 2:15 PM
z:\projects\la finestra_lla\fb-23-0370 - fb- submital - curved glass fixed window.dwg\lft005.dwg

METALNOVA, LLC

CURVED FIXED WINDOW


(HVHZ)(IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X WOOD & STEEL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT. FOR NON-HVHZ AREA, INSTALLATION TO BE REVIEWED BY AHJ (AUTHORITY HAVING JURISDICTION).
- DEVIATION FROM THIS FLORIDA PRODUCT APPROVAL IN HVHZ AREA REQUIRES A ONE TIME APPROVAL FROM MIAMI-DADE COUNTY RER OR AHJ.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- FRAME MATERIAL: STAINLESS STEEL 316
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.
- DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM COMPONENTS SHALL BE PROTECTED IN ACCORDANCE WITH THE CURRENT FBC REQUIREMENTS CHAPTER 20.
- CUSTOM SIZES AVAILABLE UPON REQUEST.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAIL
2	ELEVATIONS AND ANCHOR LAYOUT
3	VERTICAL SECTIONS AND HORIZONTAL SECTIONS
4	INSTALLATION DETAILS, ANCHOR SCHEDULE AND NOTES

DESIGN PRESSURE RATING				
CONFIGURATION	MAX. O.A. PRODUCT SIZE		DESIGN PRESSURE	MISSILE IMPACT RATING
	WIDTH	HEIGHT		
O	SEE SHEET 2		+60/-65 PSF	SMI/LMI

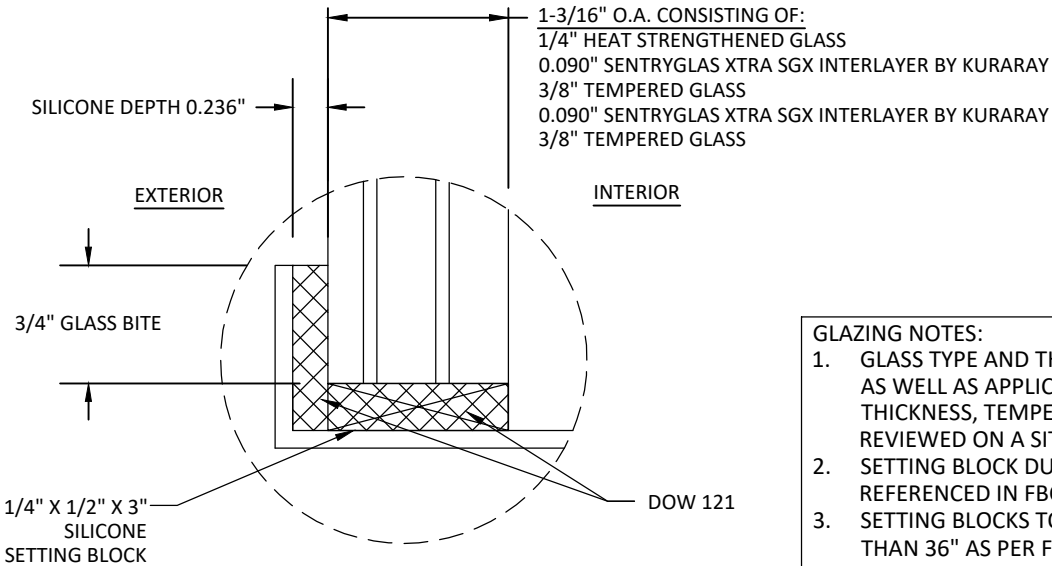

GLAZING DETAIL 1

GLAZING NOTES:

- GLASS TYPE AND THICKNESS COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. THICKNESS, TEMPER, AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/5 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- SIZES AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

METALNOVA, LLC

METALNOVA, LLC
6930 NW 107 PL
DORAL, FL 33178
PH: (305) 599-8093 FX: (305) 592-4671

TITLE: CURVED FIXED WINDOW (HVHZ)(IMPACT)

GENERAL NOTES & GLAZING DETAIL

PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338

DANIA BEACH, FL 33004

PH: (954)399-8478

FAX: (954)744-4738


WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2023.06.11 11:52:39 -04'00'

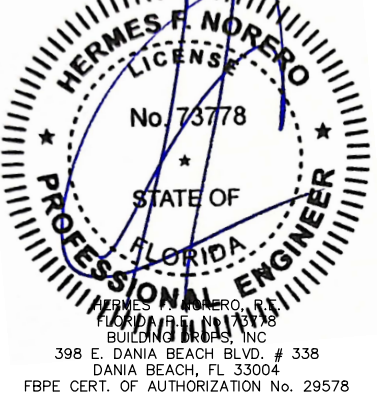

FL #: FL42114

DATE: 05.10.23

DWG. BY: MG

CHK. BY: HFN

SCALE: NTS

DWG. #: LFT005


SHEET:

1


OF 4

6/2/2023 2:15 PM
z:\projects\la finestra, llc\lbc-23-0370 - lbc submittal - curved glass fixed window\dwgs\lft005.dwg

ELEVATION

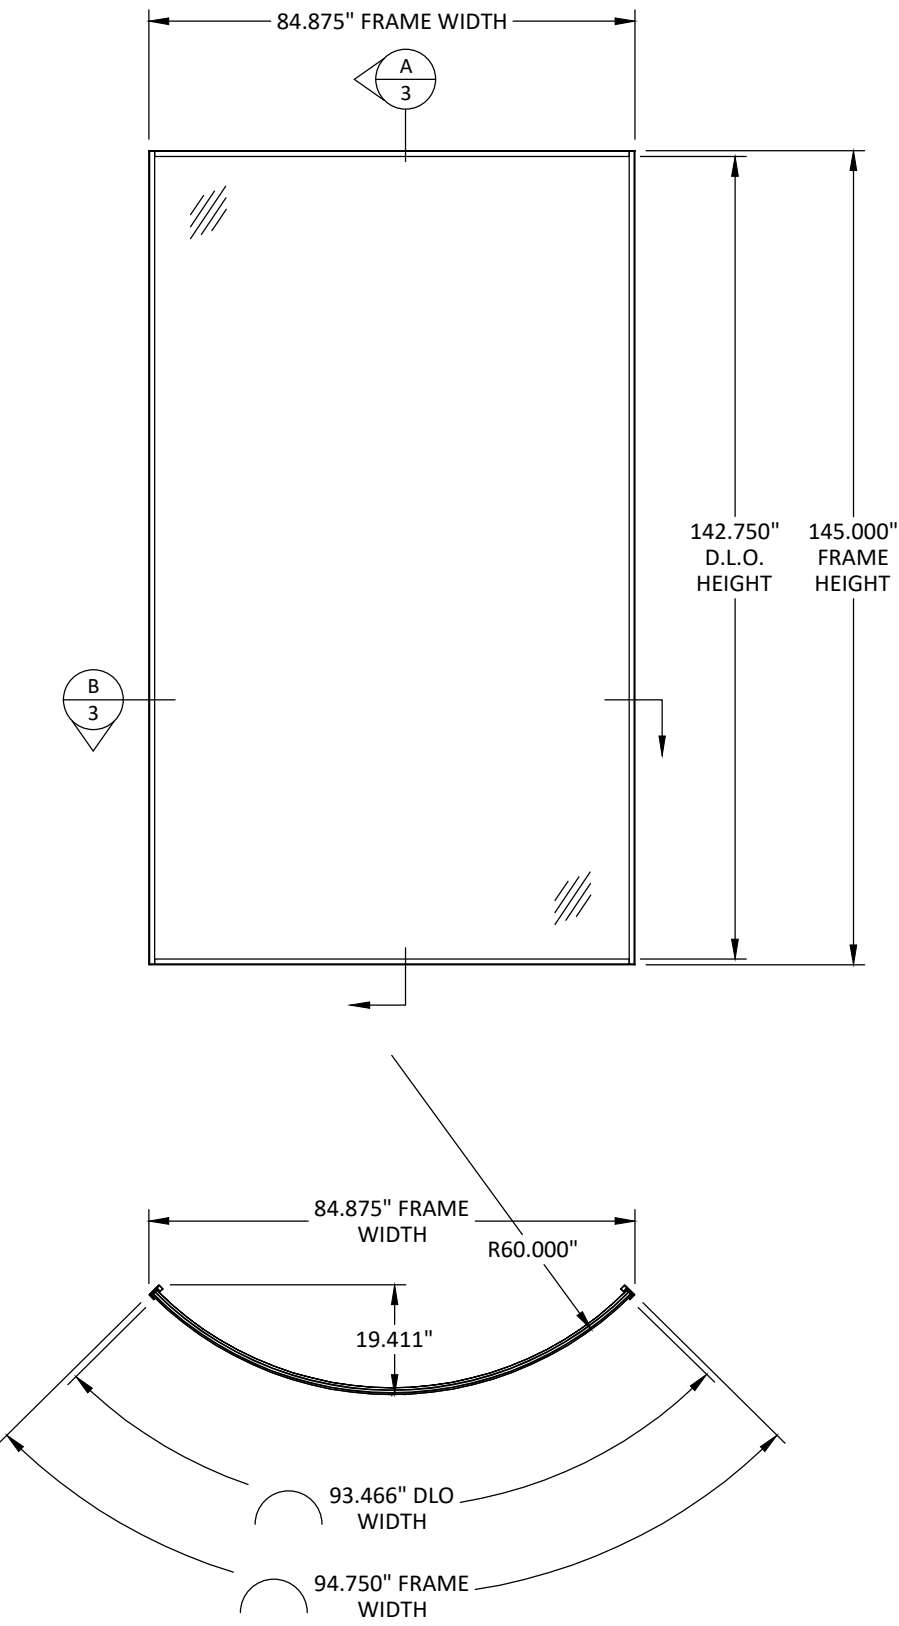

ANCHOR LAYOUT

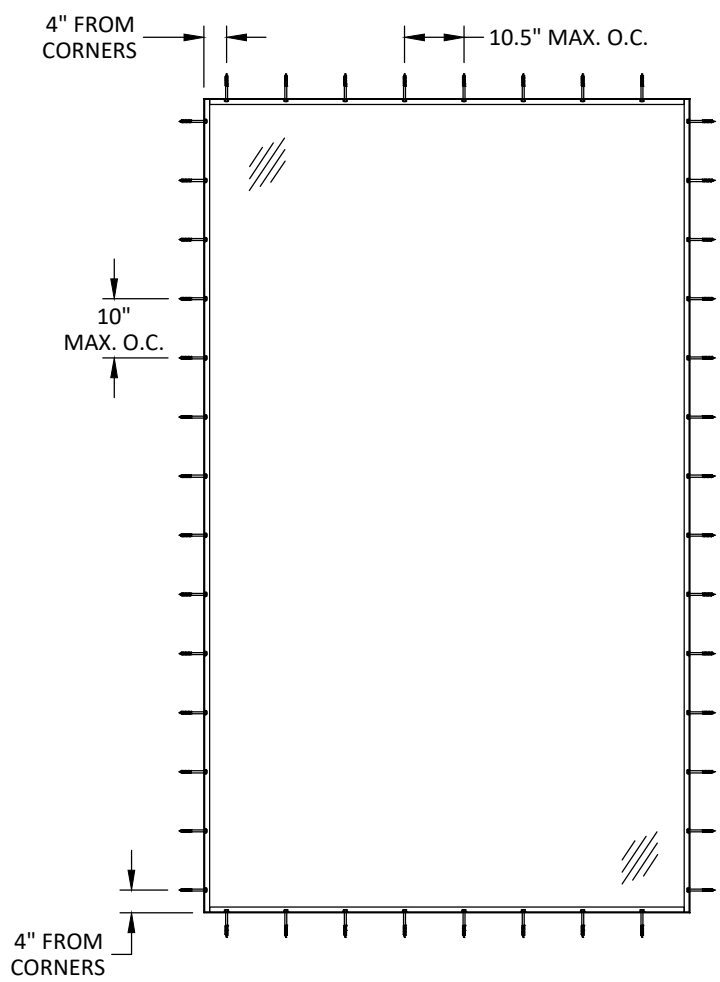

METALNOVA, LLC

METALNOVA, LLC
6930 NW 107 PL
DORAL, FL 33178
PH: (305) 599-8093 FX: (305) 592-4671

TITLE: CURVED FIXED WINDOW (HVHZ)/(IMPACT) ELEVATIONS AND DESIGN PRESSURE TABLE

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
FLORIDA LICENSE NO. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. # 338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL42114**

DATE: **05.10.23**


DWG. BY: MG	CHK. BY: HFN
--------------------	---------------------

SCALE: **NTS**


DWG. #: **LFT005**

SHEET:


6/2/2023 2:15 PM
z:\projects\la finestra, llc\lfb-23-0370 - lfb submittal - curved glass fixed window.dwg\lft005.dwg

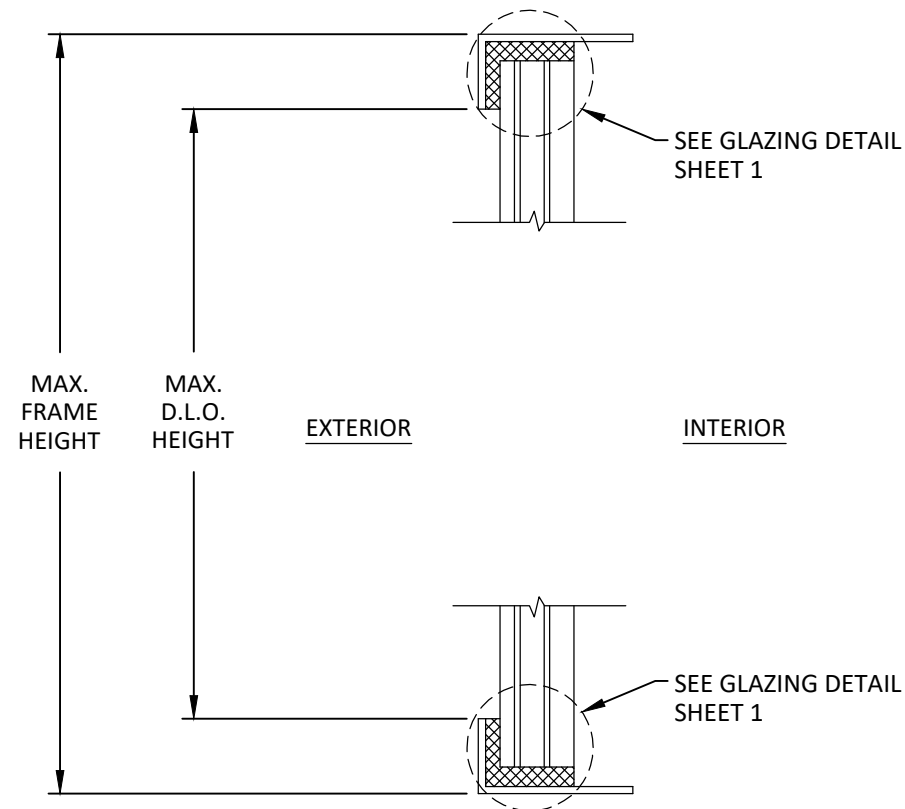

A
3 VERTICAL SECTION

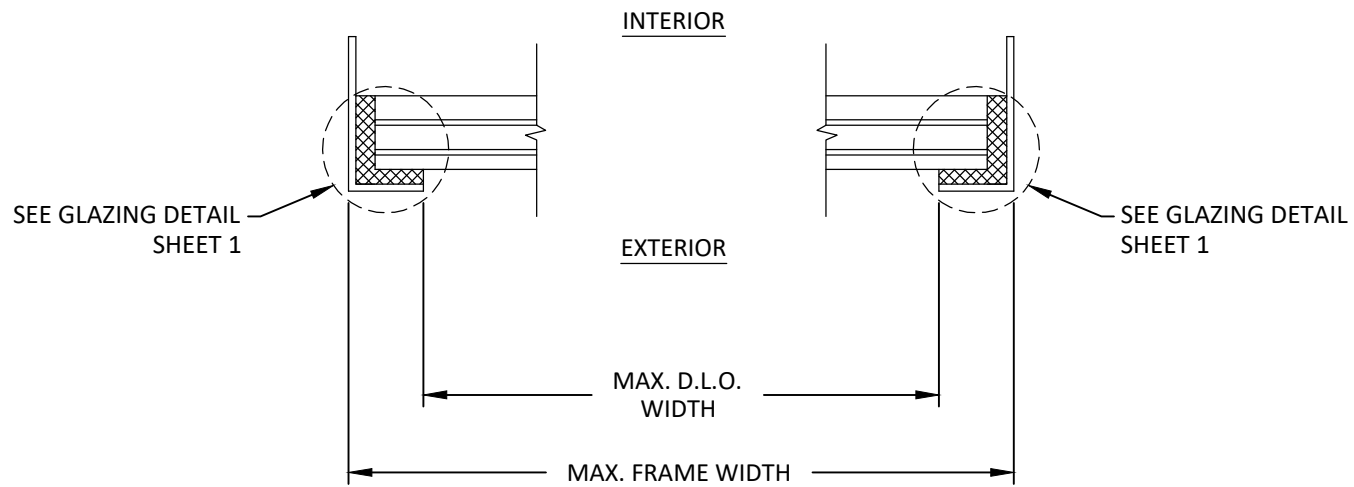

B
3 HORIZONTAL SECTION

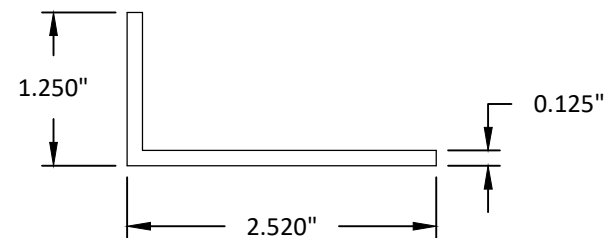

FRAME DETAIL
STAINLESS STEEL 316

- NOTES:
1. FOR LARGE FRAME SIZES, JAMBS MAY BE SPLICED, WITH A 2" X 3.5" STEEL PLATE ON THE OUTSIDE OF THE FRAME, FASTENED TO THE MAIN FRAME PROFILE USING ONE 3/16"X3/8" FHMS ON EACH SIDE.

METALNOVA, LLC

METALNOVA, LLC
6930 NW 107 PL
DORAL, FL 33178
PH: (305) 599-8093 FX: (305) 592-4671


TITLE: CURVED FIXED WINDOW
(HVHZ)/(IMPACT)
VERTICAL SECTIONS &
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

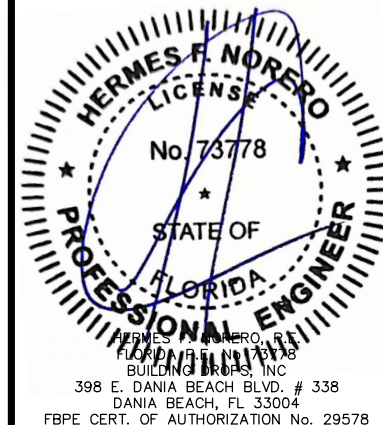

FL #: **FL42114**

DATE: **05.10.23**

DWG. BY: **MG** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **LFT005**

SHEET:

3

OF 4

6/2/2023 2:15 PM
z:\projects\la finestra, llc\lfb-23-0370 - lfb submittal - curved glass fixed window\dwgs\lft005.dwg

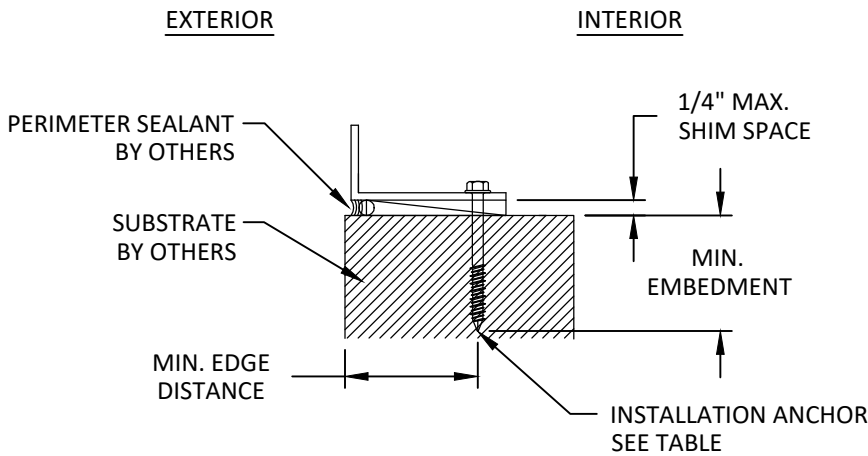

A
4

ANCHOR INSTALLATION

THROUGH FRAME
(SILL SHOWN, HEAD & JAMBS SIMILAR)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN UNLESS OTHERWISE SPECIFIED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- FOR MASONRY OR CONCRETE OPENINGS A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY, HIGH IMPACT, NON-METALIC, NON COMPRESSIBLE, NATURALLY DURABLE & PRESERVATIVE TREATED MATERIALS.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. SG = 0.55	#14 WOOD SCREW	1.50"	1"
	STEEL: MIN. 18 GAUGE, MIN. FY = 36 KSI, OR ALUMINUM MIN 1/8", 6063-T5	1/4" SMS OR SELF DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND METAL	1"
	CONCRETE (MIN. F'C= 2000 PSI) OR CMU (PER ASTM C90)	1/4" ITW TAPCON	1.50"	2.50"

METALNOVA, LLC

METALNOVA, LLC
6930 NW 107 PL
DORAL, FL 33178
PH: (305) 599-8093 FX: (305) 592-4671

TITLE: CURVED FIXED WINDOW
(HVHZ/IMPACT)

INSTALLATION DETAILS, ANCHOR
SCHEDULE AND NOTES

PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338

DANIA BEACH, FL 33004

PH: (954)399-8478

FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL42114**

DATE: **05.10.23**

DWG. BY:
MG

CHK. BY:
HFN

SCALE: **NTS**




DWG. #: **LFT005**

SHEET:

4

OF 4

6/2/2023 2:15 PM
z:\projects\la finestra, llc\lfb-23-0370 - lfb-submittal - curved glass fixed window\dwgs\lft005.dwg

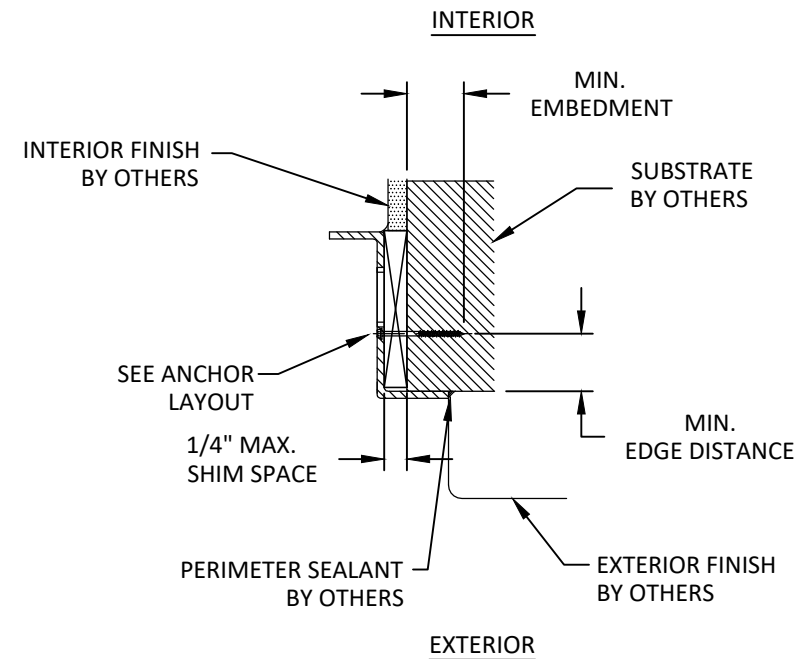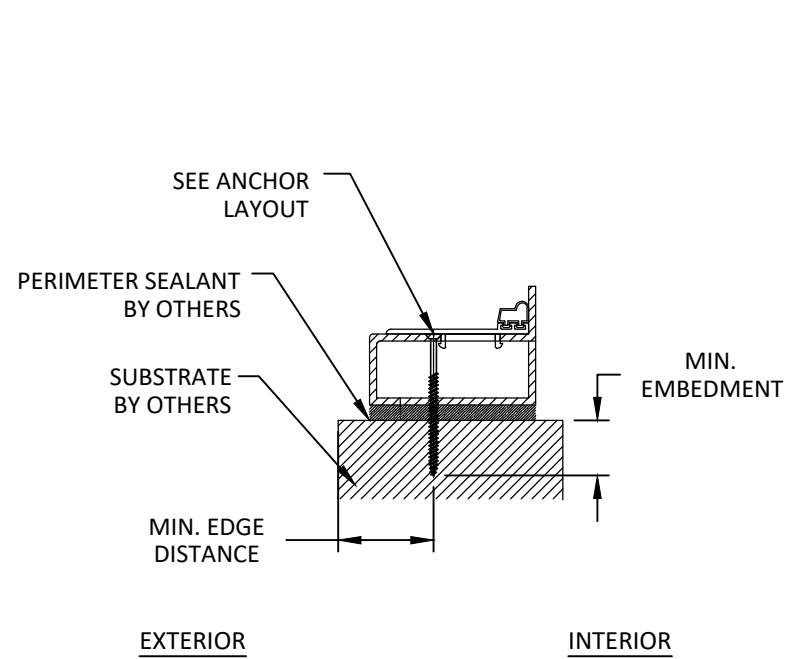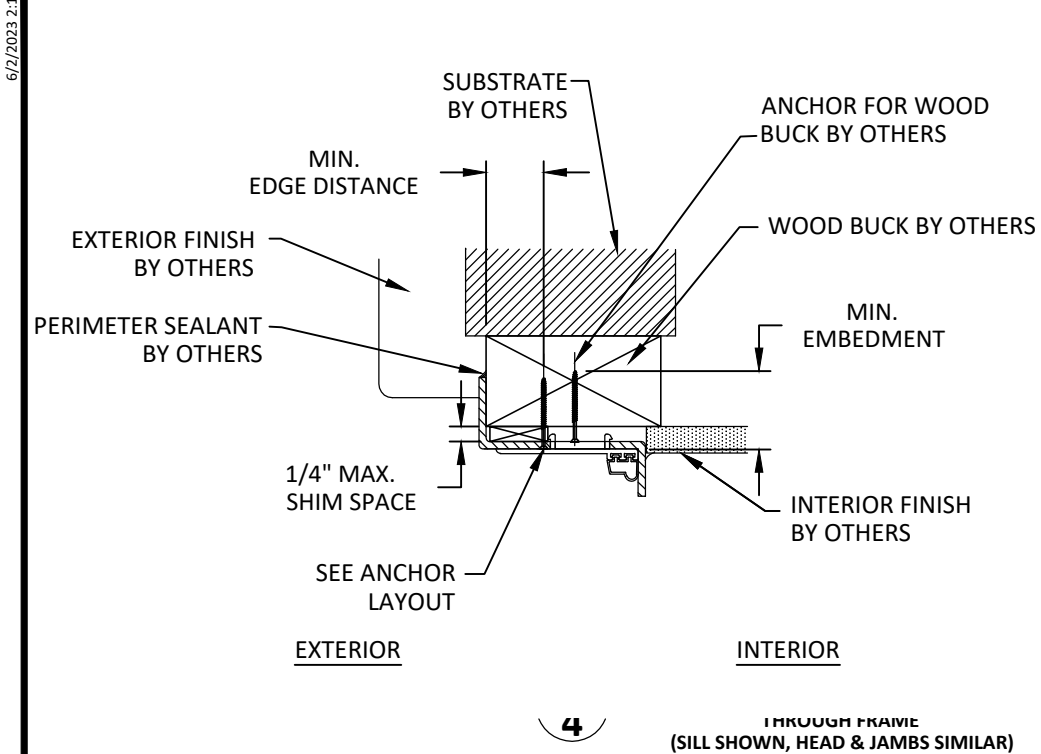

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN UNLESS OTHERWISE SPECIFIED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- FOR MASONRY OR CONCRETE OPENINGS A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY, HIGH IMPACT, NON-METALIC, NON COMPRESSIBLE, NATURALLY DURABLE & PRESERVATIVE TREATED MATERIALS.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

METALNOVA, LLC

METALNOVA, LLC
6930 NW 107 PL
DORAL, FL 33178
PH: (305) 599-8093 FX: (305) 592-4671

TITLE: CURVED FIXED WINDOW
(HVHZ/IMPACT)

INSTALLATION NOTES AND
DETAILS

PREPARED BY:

BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004


PH: (954)399-8478
FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

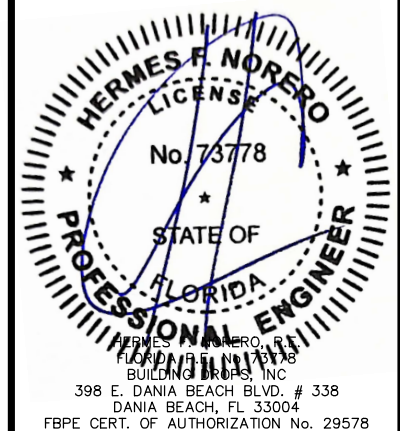

FL #: **FL42114**

DATE: **05.10.23**

DWG. BY: **MG** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **LFT005**

SHEET:

6

6/2/2023 2:15 PM
z:\projects\la finestra, llc\lfb-23-0370 - fbc submittal - curved glass fixed window\dwgs\lft005.dwg

BILL OF MATERIALS						
ITEM	PART No.	QUANTITY	DESCRIPTION	MATERIAL	LOCATION	MANUFACTURER
1	N001	4	FRAME HEAD/JAMB/RESIDENTIAL SILL	S.S.	DOOR FRAME	METALNOVA
2	N002	4	PANEL HEAD/JAMB/SILL	S.S.	DOOR PANEL	METALNOVA
3	N003	1	ASTRAGAL	S.S.	INACTIVE LEAF PANEL JAMB	METALNOVA
4	N004	1	FRAME SILL	S.S.	DOOR FRAME	METALNOVA
5	6009	1	COMMERCIAL THRESHOLD	AL.AL. -6060-T5	FRAME BOTTOM	METALNOVA
6	E055	1	FRAME GUIDE	PVC	FRAME PERIMETER	METALNOVA
7	E056	1	PANEL GUIDE	PVC	PANEL PERIMETER	METALNOVA
8	E001	AS REQ'D.	WEDGE GASKET	EPDM	FRAME JAMB/ASTRAGAL/FRAME PANEL	METALNOVA
9	895/995	CONTINUOUS	STRUCTURAL SILICONE	SILICONE	PERIMETER GLASS TO METAL	PECORA OR DOW CORNING
10	N005	6/VENT	6" BUTTHINGES (3 PAIR)	--	PANEL AND FRAME JAMBS	METALNOVA
11	N/A	2 EA. LITE OF GLASS	1/4" X 1/2" X 3" LG. SETTING BLOCK	EXTRUDED SILICONE	@ 6" FROM ENDS	GENERIC
12	N/A	1/VENT	OPERATING HANDLE	ALUMINUM	EACH PANEL JAMB	PASINI
13	1025	1	TRANSMISSION MOVEMENT DEVISE	ZAMA/S.S.	PANEL JAMB ASTRAGAL SIDE ONLY	GIESSE
14	N/A	1/VENT	3 POINT LOCK SYSTEM	ZINC/IRON/S.S.	PANEL JAMB	GIESSE
15	03	2/VENT	FLUSH BOLT (HEAVY DUTY)	S.S.	PANEL JAMB AT TOP & BOTTOM	METALNOVA
16	N006	2	FLUSHBOLT STRIKE PLATE (4" LONG)	S.S.	FLUSHBOLT STRIKE PLATE	METALNOVA
17	N007	1	STRIKE PLATE FOR LOCK SYSTEM	S.S.	ASTRAGAL	METALNOVA

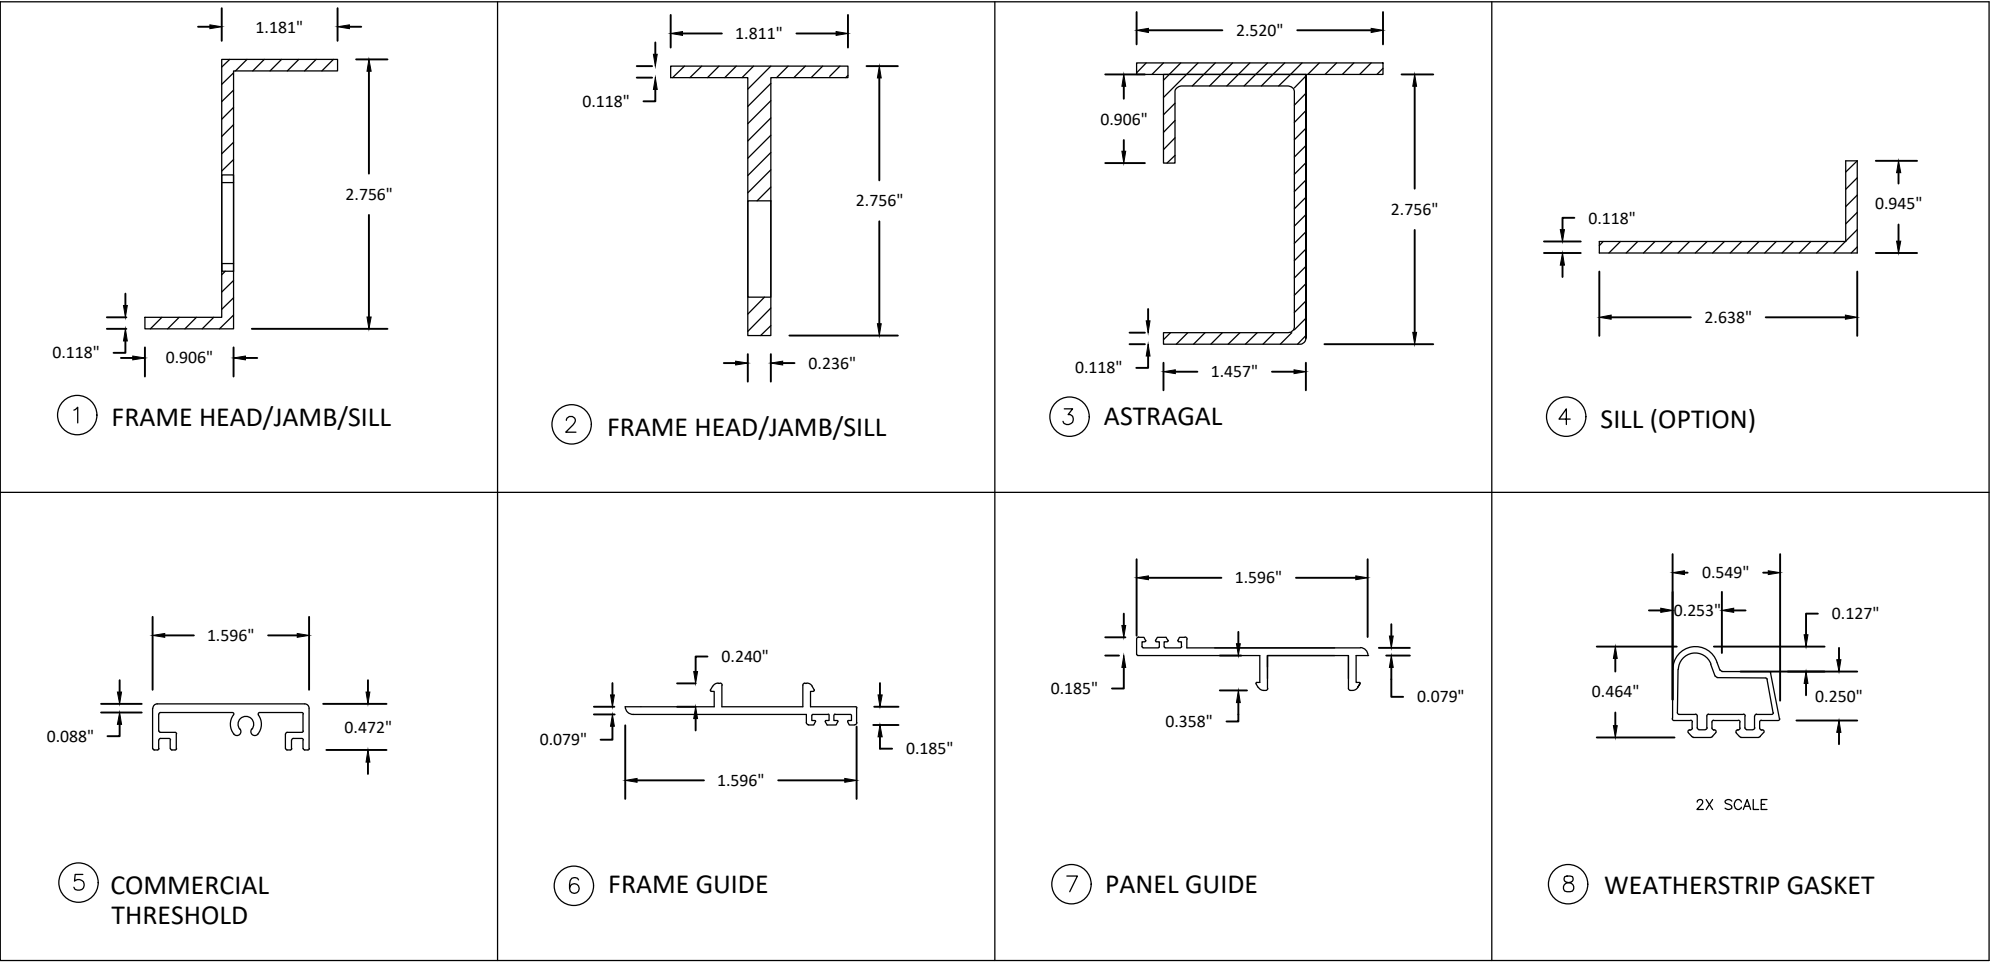

METALNOVA, LLC

METALNOVA, LLC
6930 NW 107 PL
DORAL, FL 33178
PH: (305) 599-8093 FX: (305) 592-4671


TITLE: CURVED FIXED WINDOW
(HVHZ)/(IMPACT)
COMPONENTS AND
BILL OF MATERIALS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

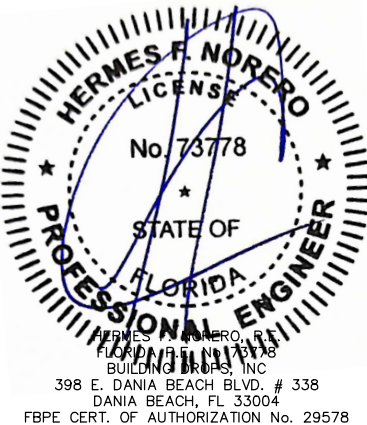

FL #:	FL42114
DATE:	05.10.23
DWG. BY:	CHK. BY:
MG	HFN
SCALE:	NTS
DWG. #:	LFT005
SHEET:	