

ARTISTIC DOORS AND WINDOWS

6300 SERIES DOUBLE HUNG WINDOW

(HVHZ) (IMPACT)


GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) INCLUDING HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT. FOR NON-HVHZ AREA, INSTALLATION TO BE REVIEWED BY AHJ (AUTHORITY HAVING JURISDICTION).
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. FRAME MATERIAL: MAHOGANY
8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, DESIGN PRESSURE TABLE, & GLAZING DETAILS
2	ELEVATION
3	ANCHOR LAYOUT
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	ANCHOR INSTALLATION DETAILS
7	INSTALLATION DETAILS AND NOTES
8	BILL OF MATERIALS AND COMPONENTS

DESIGN PRESSURE RATING		
DESIGN PRESSURE	MAX. FRAME SIZE	CONFIGURATION
+/- 65 PSF	61-5/8" X 96"	X/X

1-1/8" O.A. INSULATING GLASS CONSISTING OF:
3/16" ANNEALED GLASS
0.090" PVB BY EASTMAN
3/16" ANNEALED GLASS
1/2" METAL REINFORCED SPACER
3/16" TEMPERED GLASS

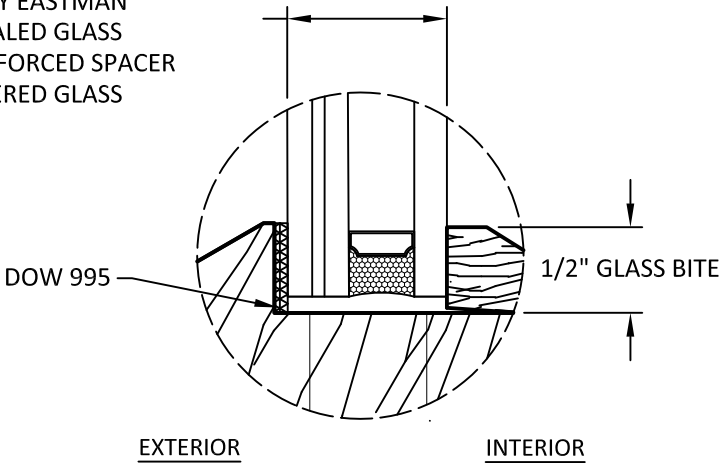

GLAZING DETAIL

- GLAZING NOTES:
1. GLASS TYPE AND THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN DESIGN PRESSURE TABLE AND ELEVATIONS.



ARTISTIC DOORS & WINDOWS
10 SOUTH INMAN AVENUE
AVENEL, NEW JERSEY 07001
PH: (800) 278 - 3667

TITLE:
6300 SERIES DOUBLE HUNG WINDOW
(HVHZ) (IMPACT)

GENERAL NOTES, DESIGN PRESSURE
TABLE, & GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.03.27 11:09:51 -0400

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL42124

DATE:
03.11.25

DWG. BY:
JR

CHK. BY:
HFN


SCALE:
NTS

DWG. #:
ADW012

SHEET:
1

c:\users\d\aniwata\building_drops\inc\building_drops\projects\artistic doors and windows\fbc-25-0106 - fbc submittal - series 6300 spiral balance dh window_series 9000 wood fx_door\dwgs\adw012.dwg

3/26/2025 5:02 PM

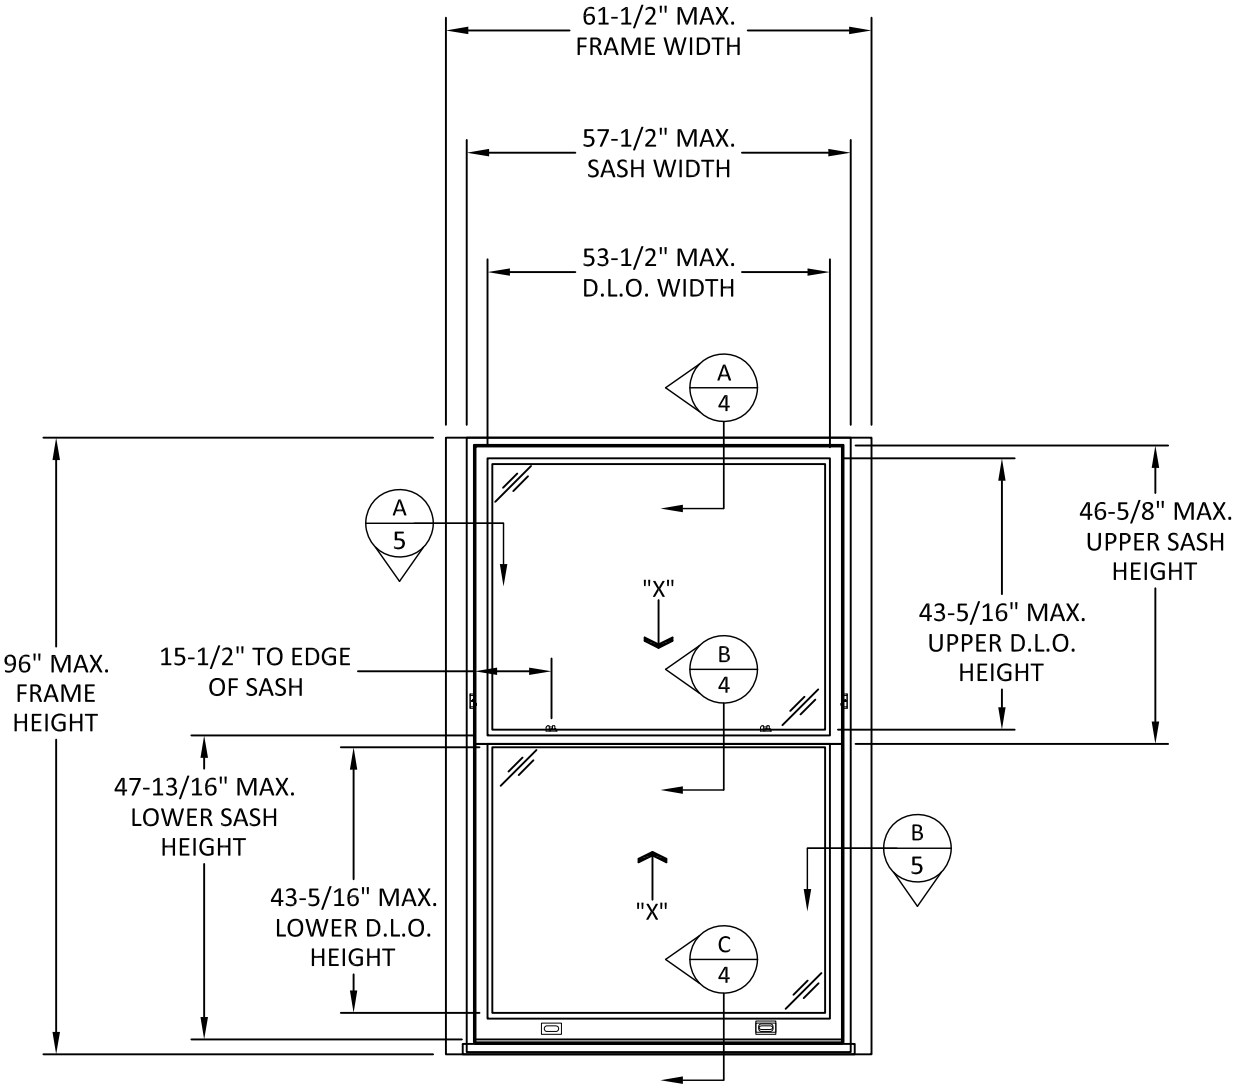

ELEVATION



ARTISTIC DOORS & WINDOWS
10 SOUTH INMAN AVENUE
AVENEL, NEW JERSEY 07001
PH: (800) 278 - 3667

TITLE:
6300 SERIES DOUBLE HUNG WINDOW
(HVHZ) (IMPACT)

ELEVATION


PREPARED BY:

BUILDING DROPS

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

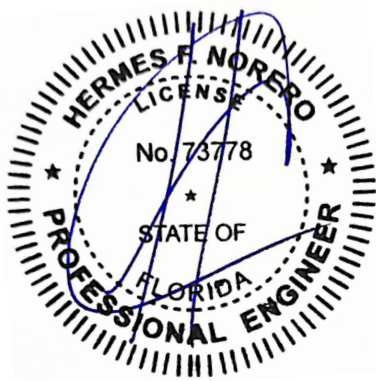

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL42124**

DATE: **03.11.25**

DWG. BY:
JR

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **ADW012**


SHEET:

2


OF 8

c:\users\dwaniwata\building_drops\inc\building_drops\projects\artistic doors and windows\fbc-25-0106 - fbc submittal - series 6300 spiral balance dh window, series 9000 wood fx door\dwgs\adw012.dwg


3/26/2025 5:02 PM

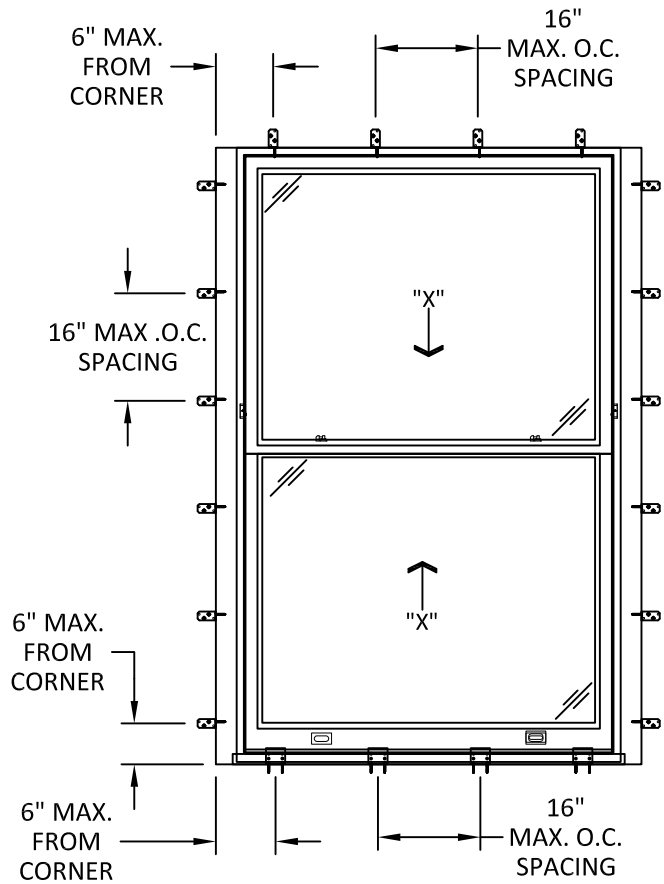

ANCHOR LAYOUT
HRS12 STRAP BENT
AROUND OPENING
INSTALLATION

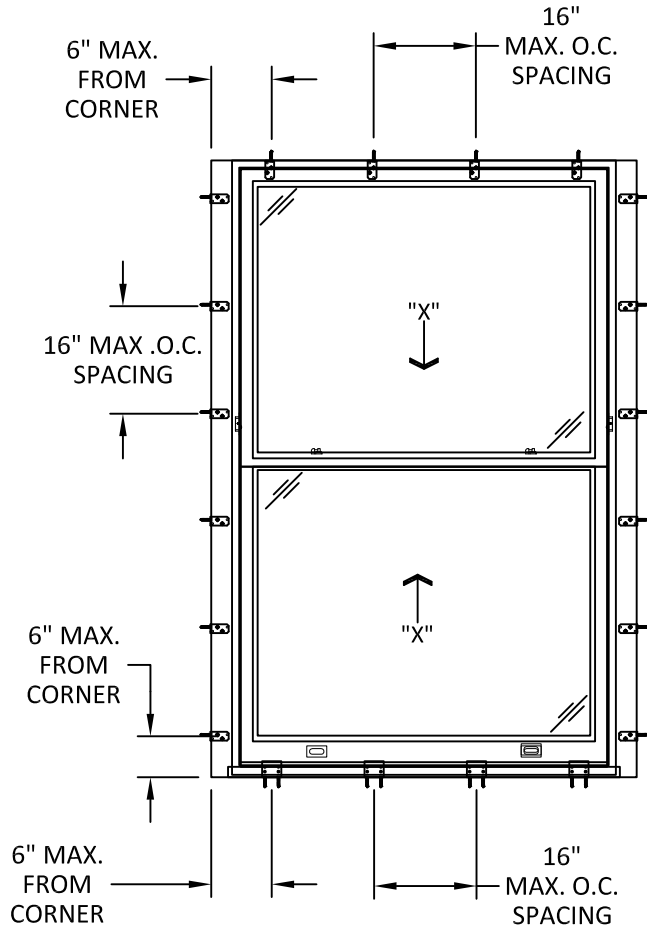

ANCHOR LAYOUT
HRS12 STRAP BENT
AROUND FRAME
INSTALLATION

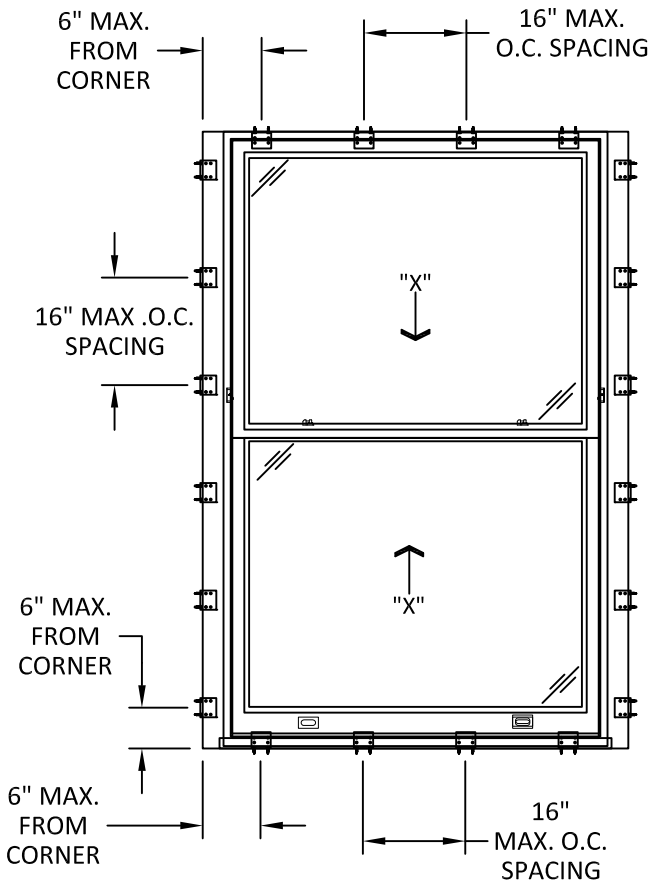

ANCHOR LAYOUT
ALUMINUM ANGLE
INSTALLATION

NOTE:
[Symbol] ALUMINUM ANGLE 1-1/2" X 2-1/2" X 3"
[Symbol] HRS12 STRAP

- NOTE:
1. TWO (2) INSTALLATION ANCHORS PER STRAP AND ANGLE LOCATION.
 2. ALL INSTALLATION OPTIONS USE ALUMINUM ANGLE INSTALLATION METHOD AT SILL.
 3. FOR MORE ANCHOR INFORMATION (INSTALLATION TYPE, SPACING, QUANTITY, ANCHOR TYPE, QUALIFIED SUBSTRATES) SEE SHEET 6 AND 7.



ARTISTIC DOORS & WINDOWS
10 SOUTH INMAN AVENUE
AVENEL, NEW JERSEY 07001
PH: (800) 278 - 3667

TITLE:
6300 SERIES DOUBLE HUNG WINDOW
(HVHZ) (IMPACT)


ANCHOR LAYOUT

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

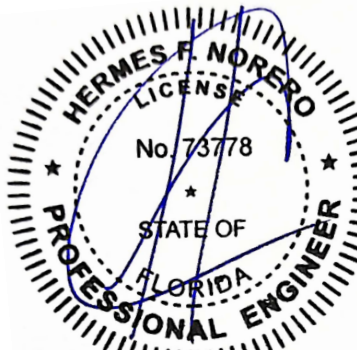

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL42124**

DATE: **03.11.25**

DWG. BY:
JR

CHK. BY:
HFN


SCALE: **NTS**

DWG. #: **ADW012**


SHEET:
3

c:\users\d\aniwata\building_drops_incl\building_drops_projects\artistic doors and windows\fbc-25-0106 - fbc submittal - series 6300 spiral balance dh window_series 9000 wood fx_door\dwgs\adw012.dwg


3/26/2025 5:02 PM

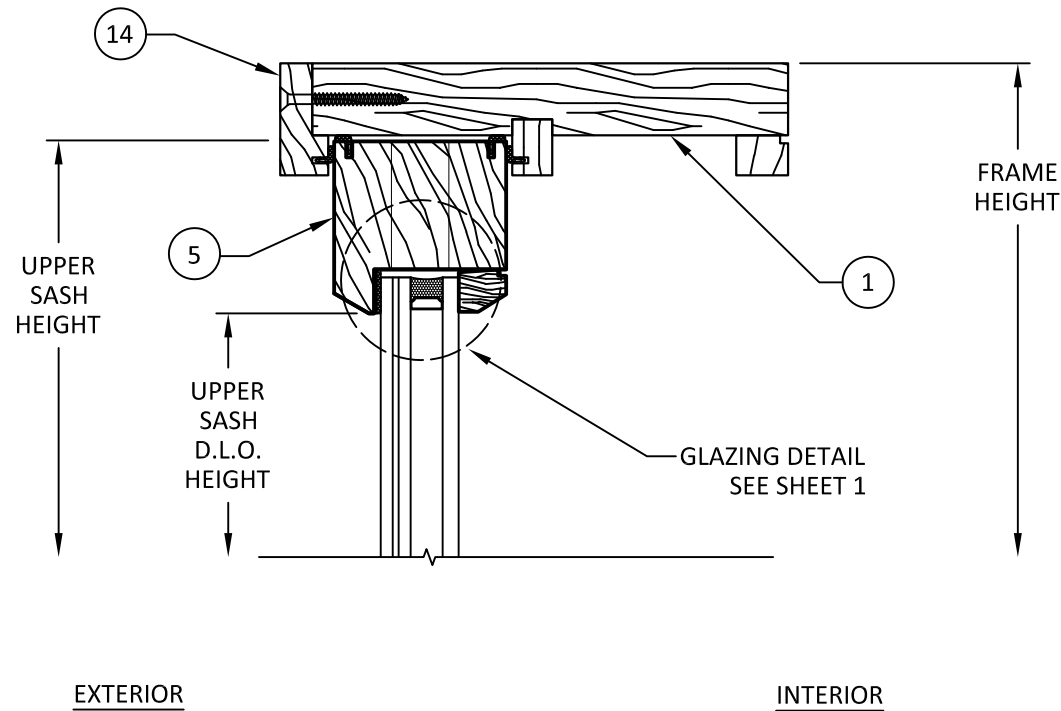

A
4 VERTICAL SECTION
HEAD

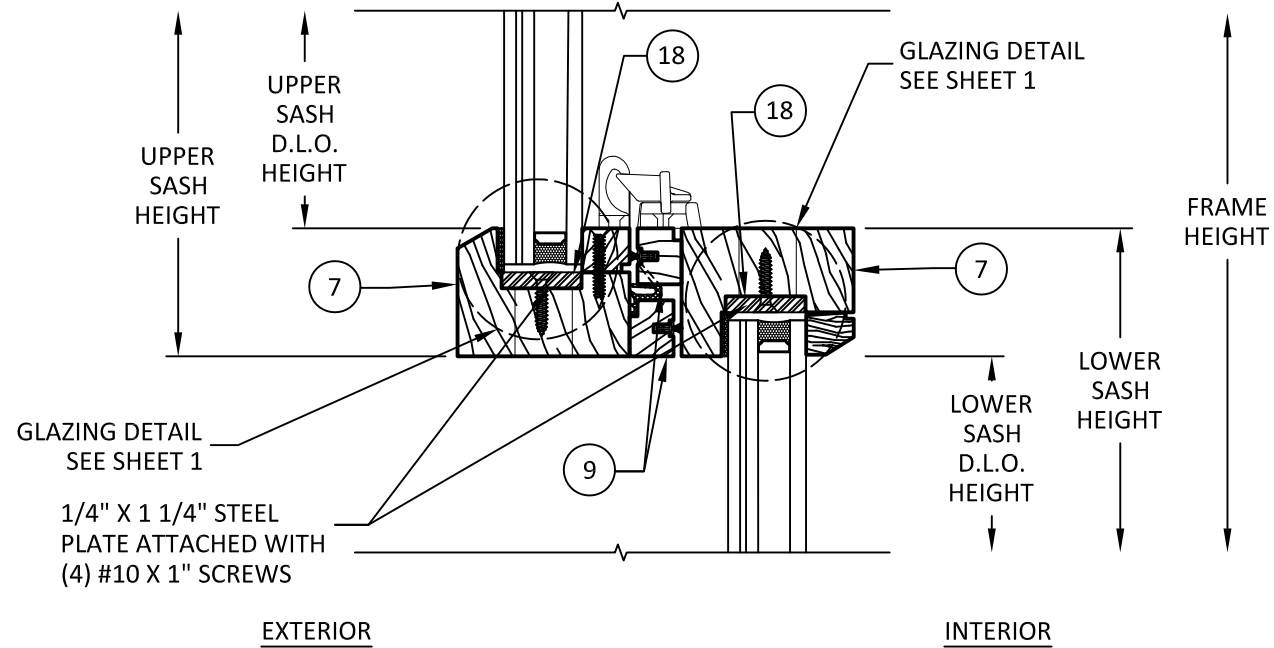

B
4 VERTICAL SECTION
MEETING RAIL

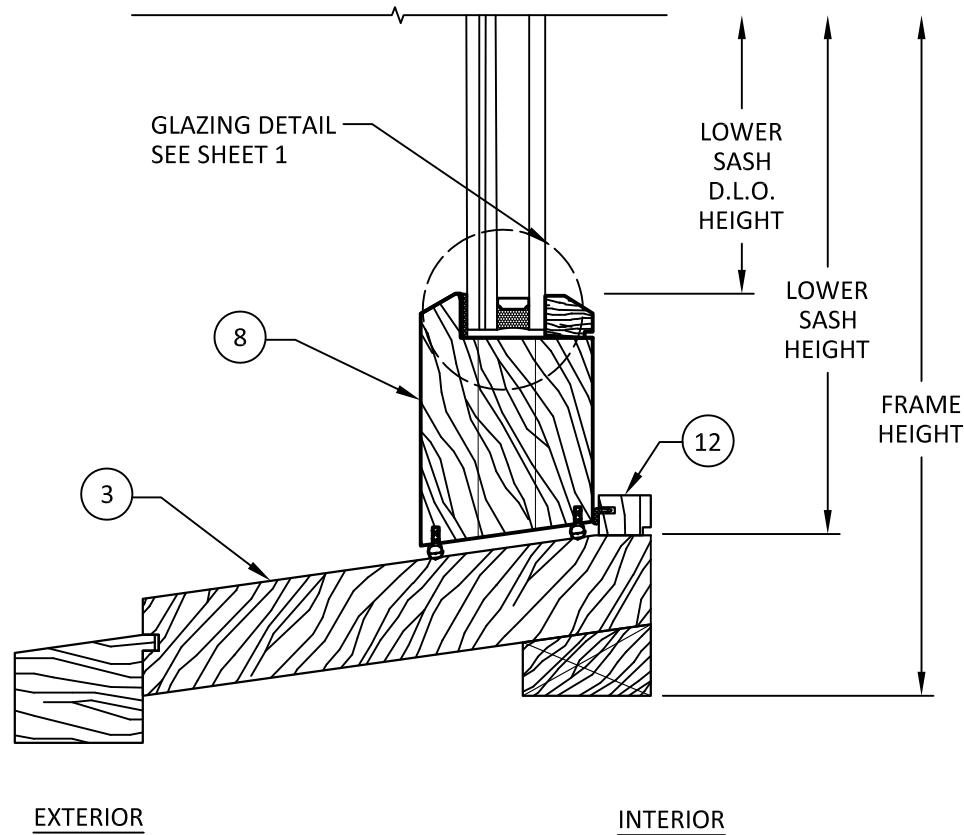

C
4 VERTICAL SECTION
SILL



ARTISTIC DOORS & WINDOWS
10 SOUTH INMAN AVENUE
AVENEL, NEW JERSEY 07001
PH: (800) 278 - 3667

TITLE:
6300 SERIES DOUBLE HUNG WINDOW
(HVHZ) (IMPACT)

VERTICAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

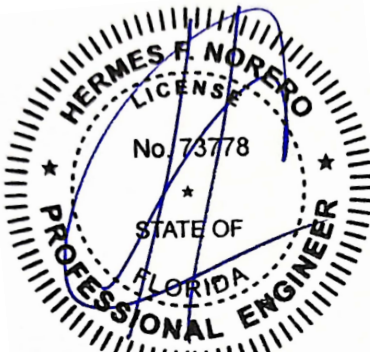

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL42124
DATE:	03.11.25
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	ADW012
SHEET:	4



ARTISTIC DOORS & WINDOWS
10 SOUTH INMAN AVENUE
AVENEL, NEW JERSEY 07001
PH: (800) 278 - 3667

TITLE:
6300 SERIES DOUBLE HUNG WINDOW
(HVHZ) (IMPACT)


HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

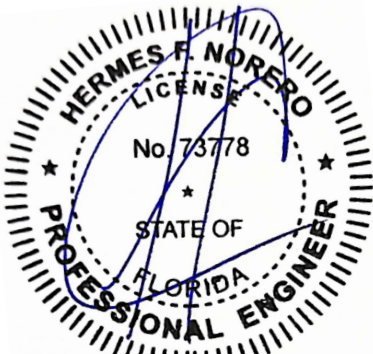

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #:	FL42124	
DATE:	03.11.25	
DWG. BY:	JR	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	ADW012	
SHEET:	5	

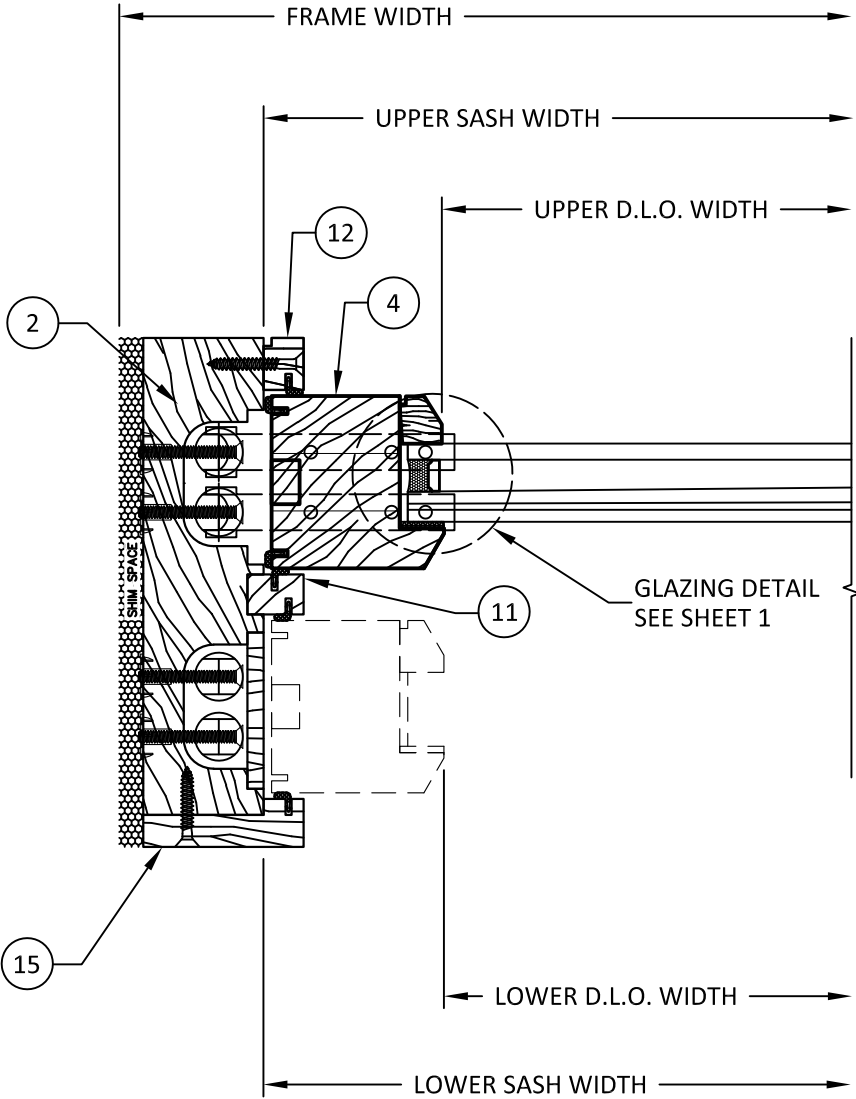

A HORIZONTAL SECTION
5 UPPER SASH

INTERIOR


EXTERIOR

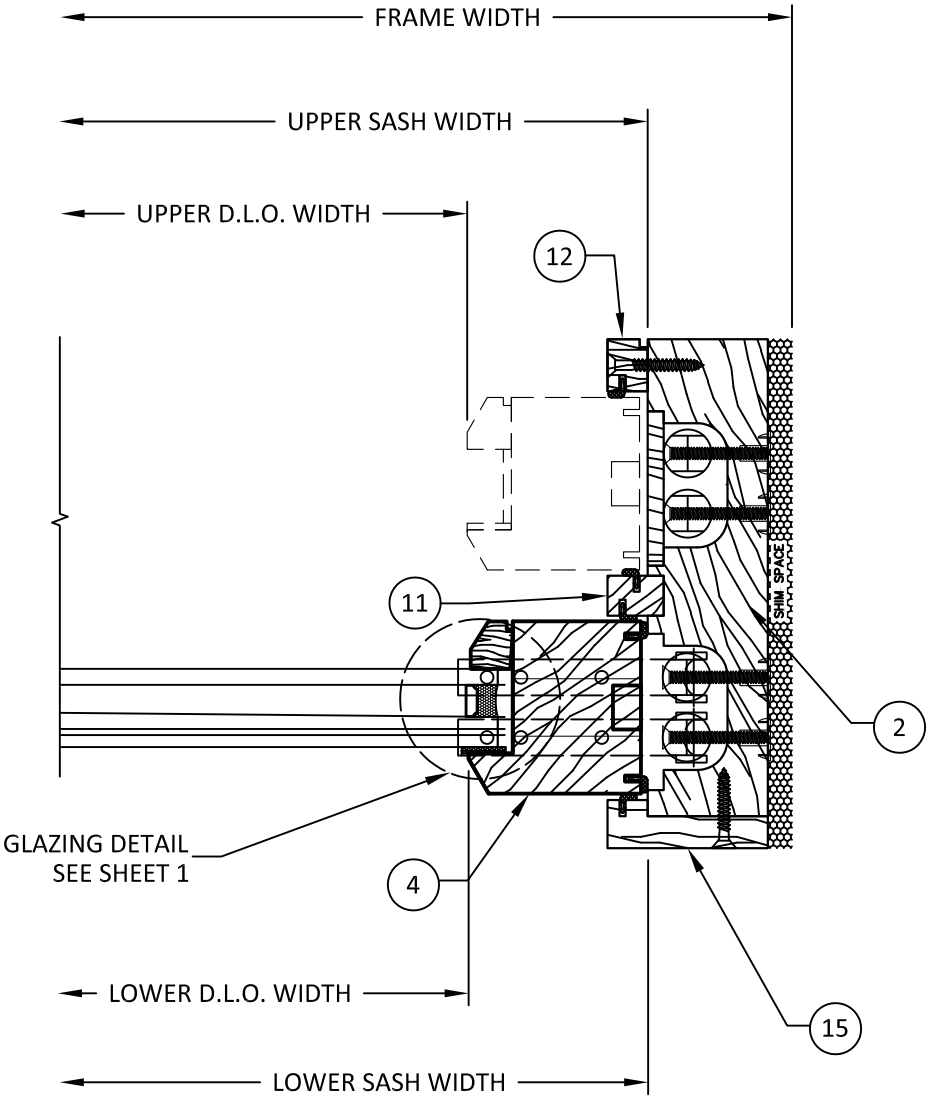

B HORIZONTAL SECTION
5 LOWER SASH


c:\users\daniwata\building drops, inc\building drops, inc\projects\artistic doors and windows\fbc-25-0106 - fbc submittal - series 6300 spiral balance dh window, series 9000 wood fx door\dwgs\adw012.dwg

3/26/2025 5:02 PM

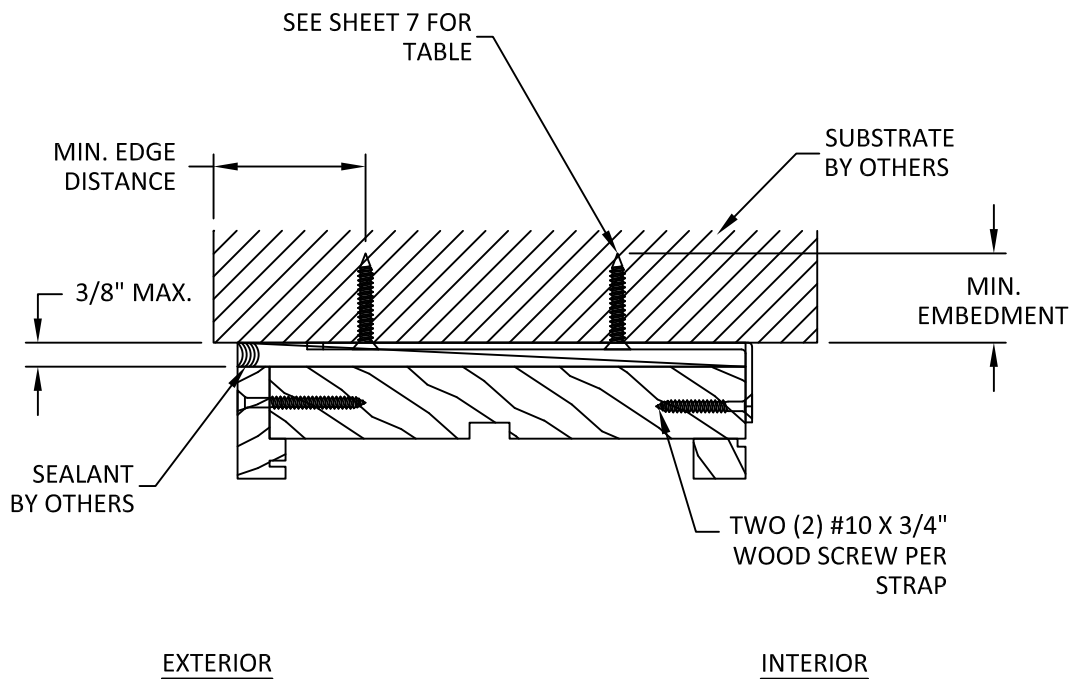


A
6 ANCHOR DETAIL
HRS12 STRAP BENT AROUND FRAME - HEAD

NOTE: JAMB SIMILAR

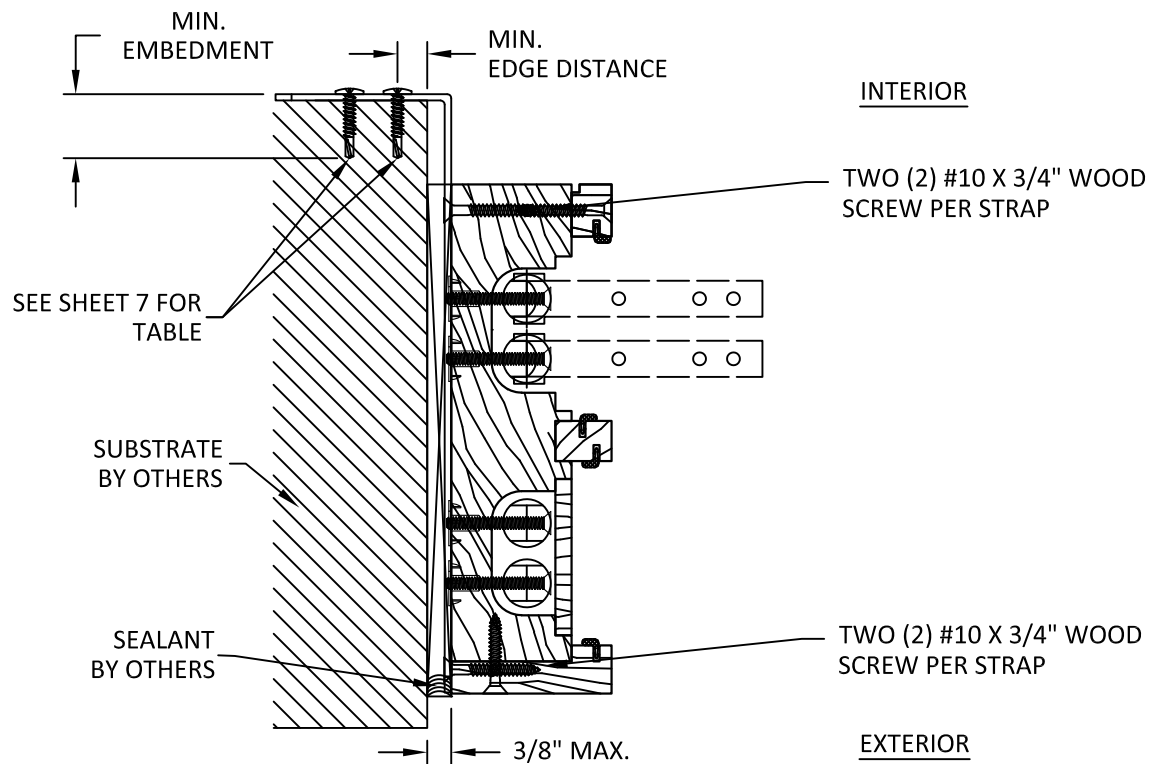


C
6 ANCHOR DETAIL
HRS12 STRAP BENT AROUND OPENING - JAMB

NOTE: HEAD SIMILAR

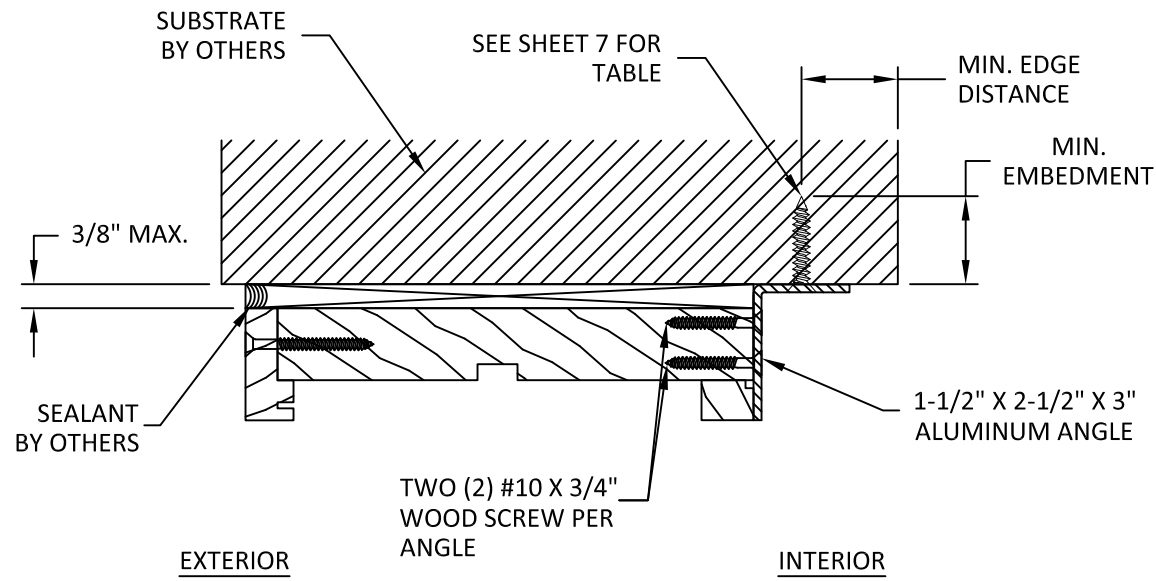

B
6 ANCHOR DETAIL
ALUMINUM ANGLE - HEAD

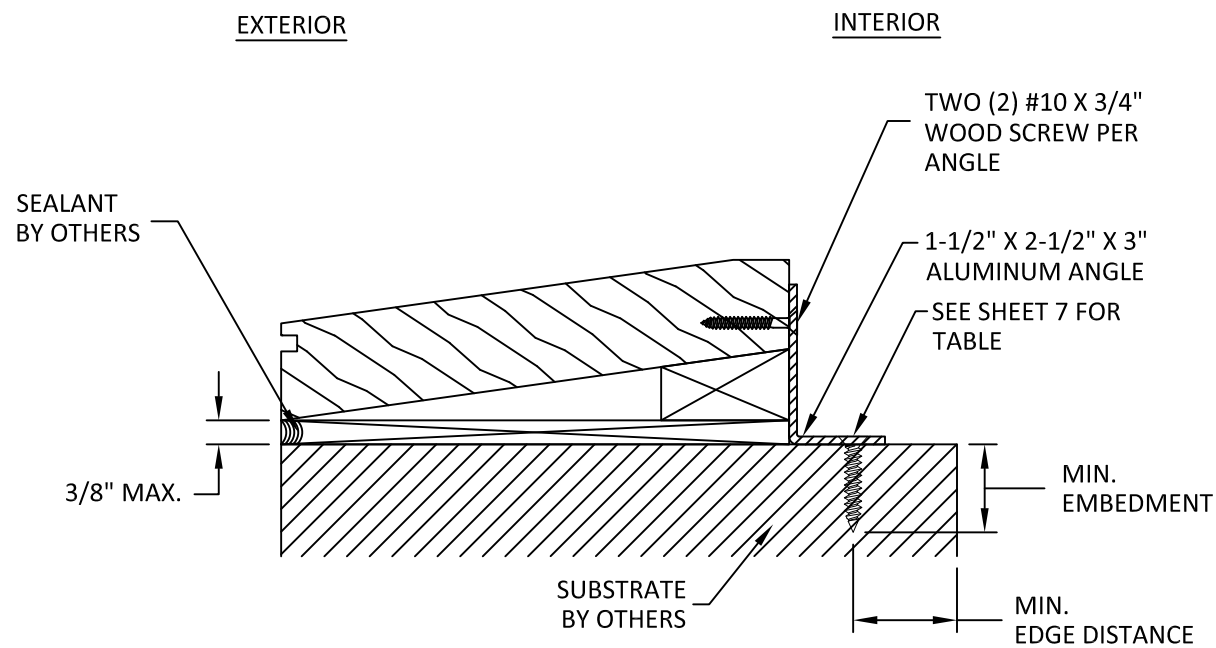

D
6 ANCHOR DETAIL
ALUMINUM ANGLE - SILL

NOTE: JAMB SIMILAR



ARTISTIC DOORS & WINDOWS
10 SOUTH INMAN AVENUE
AVENEL, NEW JERSEY 07001
PH: (800) 278 - 3667


TITLE: 6300 SERIES DOUBLE HUNG WINDOW (HVHZ) (IMPACT) ANCHOR INSTALLATION DETAILS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

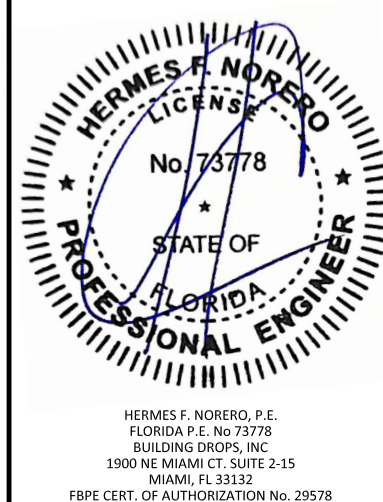

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL42124**

DATE: **03.11.25**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **ADW012**

SHEET: **6**

c:\users\d\aniwata\building_drops_incl\building_drops_projects\artistic doors and windows\series 9000 spiral balance dh window_series 9000 wood fx_door\dwgs\adw012.dwg - fbc submittal - series 6300 spiral balance dh window_series 9000 wood fx_door\dwgs\adw012.dwg 3/26/2025 5:02 PM

INSTALLATION NOTES:

1. TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN ON SHEET 6, UNLESS OTHERWISE STATED ON SHEET 3.
2. ONE (1) INSTALLATION STRAP IS REQUIRED AT EACH LOCATION SHOWN ON SHEET 3.
3. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
6. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
7. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
8. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
9. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
10. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
HRS12 STRAP BENT AROUND FRAME	WOOD: MIN. S.G. = 0.55	#10 WOOD SCREW	1.25"	0.625"
	CONCRETE (MIN. f'c = 3000 PSI) OR CMU (PER ASTM C90)	3/16" ITW TAPCON	1.25"	2"
	STEEL MIN. 18 GA. (MIN. Fy = 36 KSI) ALUM. MIN. 1/8" THK. (MIN. 6063-T5)	#10 SELF-TAPPING OR SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.5"
HRS12 STRAP BENT AROUND OPENING	WOOD: MIN. S.G. = 0.55	#10 WOOD SCREW	1.25"	0.625"
	STEEL MIN. 18 GA. (MIN. Fy = 36 KSI) ALUM. MIN. 1/8" THK. (MIN. 6063-T5)	#10 SELF-TAPPING OR SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.5"
ALUMINUM ANGLE	WOOD: MIN. S.G. = 0.55	#10 WOOD SCREW	1.25"	0.625"
	CONCRETE (MIN. f'c = 3000 PSI) OR CMU (PER ASTM C90)	3/16" ITW TAPCON	1.25"	2"
	STEEL MIN. 18 GA. (MIN. Fy = 36 KSI) ALUM. MIN. 1/8" THK. (MIN. 6063-T5)	#12 SELF-TAPPING OR SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.5"



ARTISTIC DOORS & WINDOWS
10 SOUTH INMAN AVENUE
AVENEL, NEW JERSEY 07001
PH: (800) 278 - 3667

TITLE:
6300 SERIES DOUBLE HUNG WINDOW
(HVHZ) (IMPACT)

INSTALLATION DETAILS AND NOTES


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

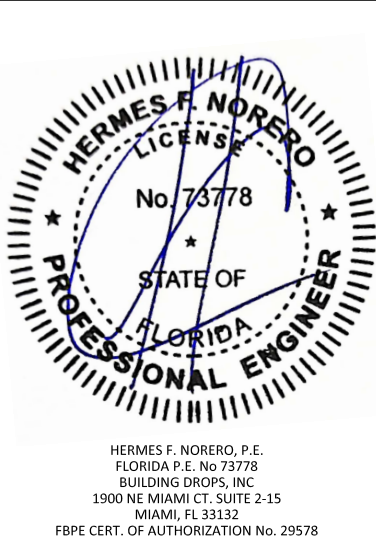

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL42124

DATE:
03.11.25

DWG. BY:
JR

CHK. BY:
HFN


SCALE:
NTS

DWG. #:
ADW012


SHEET:
7

c:\users\daniwata\building drops, inc\building drops\artistic doors and windows\fbc-25-0106 - fbc submittal - series 6300 spiral balance dh window, series 9000 wood fx door\dwgs\adw012.dwg 3/26/2025 5:02 PM


1 FRAME HEAD

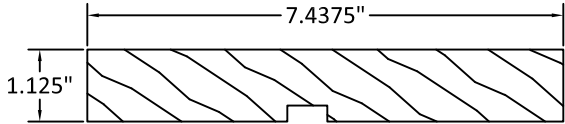


2 JAMB

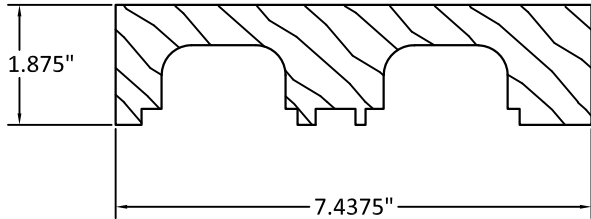


3 SILL

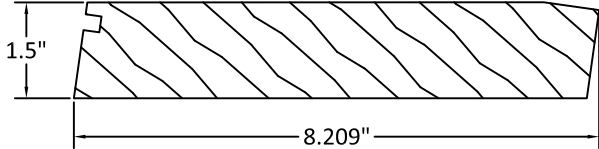


4 STILE




10 SPIRAL BALANCE COVER




6 UPPER CHECK RAIL




7 LOWER CHECK RAIL

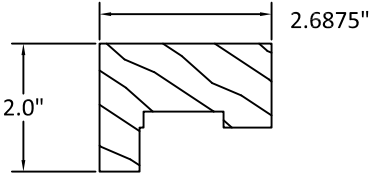


8 BOTTOM RAIL

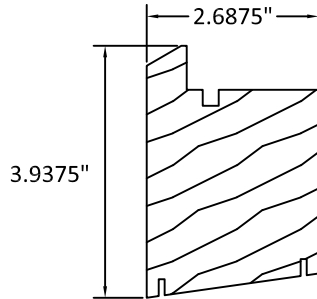


9 APPLIED CHECK RAIL




16 SPIRAL BALANCE

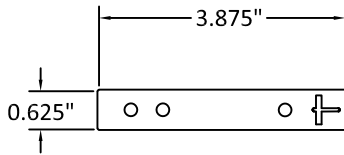


12 SASH STOP




13 GLASS STOP




14 BLIND STOP




15 BLIND STOP




17 SPIRAL BALANCE ATTACHMENT BRACKET




18 REINFORCEMENT PLATE
1/4" X 1-1/4"




11 PARTING STRIP




5 TOP RAIL



19 ALUMINUM ANGLE 1-1/2" X 2-1/2" X 3-1/2

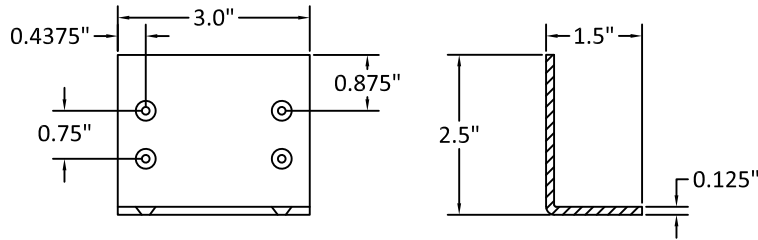

20 HRS12 STRAP

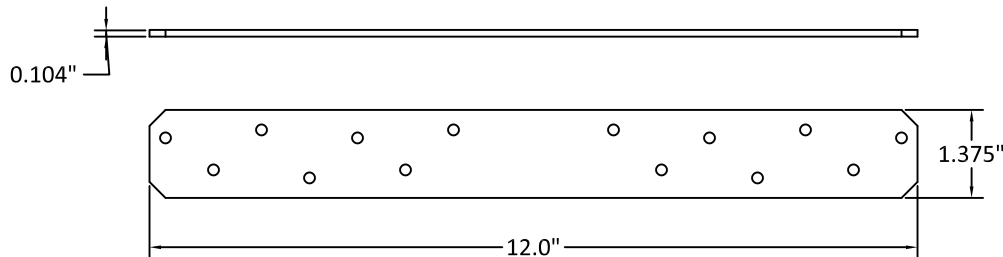

BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
1	FRAME HEAD	MAHOGANY
2	JAMB	MAHOGANY
3	SILL	MAHOGANY
4	STILE	MAHOGANY
5	TOP RAIL	MAHOGANY
6	UPPER CHECK RAIL	MAHOGANY
7	LOWER CHECK RAIL	MAHOGANY
8	BOTTOM RAIL	MAHOGANY
9	APPLIED CHECK RAIL	MAHOGANY
10	SPIRAL BALANCE COVER	MAHOGANY
11	PARTING STRIP	MAHOGANY
12	SASH STOP	MAHOGANY
13	GLASS STOP	MAHOGANY
14	BLIND STOP	MAHOGANY
15	BLIND STOP	MAHOGANY
16	SPIRAL BALANCE	AMESBURYTRUTH
17	SPIRAL BALANCE ATTACHMENT BRACKET	AMESBURYTRUTH
18	REINFORCEMENT STEEL PLATE 1/4" X 1-1/4"	STEEL
19	ALUMINUM ANGLE 1-1/2" X 2-1/2" X 3-1/2"	6063-T5 ALUMINUM
20	HRS12 STRAP	GALVANIZED STEEL



ARTISTIC DOORS & WINDOWS
10 SOUTH INMAN AVENUE
AVENEL, NEW JERSEY 07001
PH: (800) 278 - 3667

TITLE:
6300 SERIES DOUBLE HUNG WINDOW
(HVHZ) (IMPACT)

BILL OF MATERIALS AND
COMPONENTS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

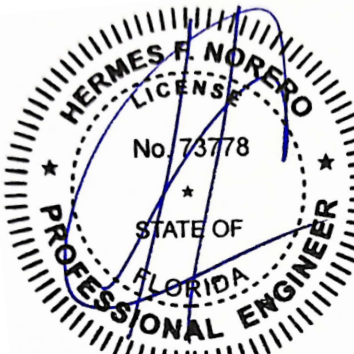

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL42124**

DATE: **03.11.25**

DWG. BY:
JR

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **ADW012**

SHEET:

8