


GENERAL NOTES:


1. IMPACT PROTECTIVE ROLLING SYSTEM WITH END RETENTION 55mm (SLAT) SHOWN ON THIS PRODUCT EVALUATION DOCUMENT (P.E.D.) HAS BEEN VERIFIED FOR COMPLIANCE IN ACCORDANCE WITH THE 2023 (8th EDITION) OF THE FLORIDA BUILDING CODE.
2. THIS PRODUCT MAY BE INSTALLED AT HIGH VELOCITY HURRICANE ZONES. DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTION 1620 OF THE ABOVE MENTIONED CODE, USING ASCE 7-22 AND SHALL NOT EXCEED THE MAXIMUM (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON SHEETS 13 THRU 15 IN ORDER TO VERIFY THE ABOVE CONDITION, ULTIMATE DESIGN WIND LOADS DETERMINED PER ASCE 7-22 SHALL BE FIRST REDUCED TO A.S.D. DESIGN WIND LOADS BY MULTIPLYING THEM BY 0.6 IN ORDER TO COMPARE THESE W/MAX. (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ABOVE.
- IN ORDER TO VERIFY THAT COMPONENTS AND ANCHORS ON THIS P.E.D. AS TESTED WERE NOT OVER STRESSED, A 33% INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS NOT USED IN THEIR ANALYSIS. THIS PRODUCT'S ADEQUACY FOR IMPACT AND WIND RESISTANCE HAS BEEN VERIFIED IN ACCORDANCE WITH SECTION 1626 OF THE ABOVE MENTIONED CODE AS PER FENESTRATION TESTING LAB. REPORTS # 10615, 10616, 5565, 5539, 22-1042 & MED-1066 AS PER TAS-201, TAS-202 AND TAS-203 PROTOCOLS.
3. ALL ALUMINUM EXTRUSIONS SHALL BE AS INDICATED ON SHEETS 2, 3 & 4.
4. ALL SCREWS (EXCEPT WIND LOCK SCREW) TO BE STAINLESS STEEL 304 OR 316 SERIES WITH 50 ksi YIELD STRENGTH AND 90 ksi TENSILE STRENGTH OR CORROSION RESISTANT COATED CARBON STEEL AS PER DIN 50018. ALL S.D.S. ARE TEK SCREWS MANUFACTURED BY ITW BUILDEX & SHALL COMPLY W/FLORIDA BUILDING CODE SECTION 2411.3.3.4.
5. BOLTS TO BE ASTM A-307, GALVANIZED OR AISI 304 OR 316 SERIES STAINLESS STEEL WITH 36 ksi MINIMUM YIELD STRENGTH.
6. ALL ALUMINUM EXTRUSIONS IN CONTACT WITH DISSIMILAR MATERIALS SHALL COMPLY WITH SECTION III-6 OF THE 2020 ALUMINUM DESIGN MANUAL.
7. ANCHORS TO WALL FOR SIDE RAILS SHALL BE AS FOLLOWS:
- (A) TO EXISTING POURED CONCRETE: MIN. 3000 p.s.i. COMPRESSIVE STRENGTH.
- 3/8"Ø CONFLEX ANCHORS, AS MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS, Inc. (CASE I, SHTS. 7, 13).
- 5/16"Ø ULTRACON ANCHORS AS MANUFACTURED BY DEWALT (CASES I, II, III, IV SHTS. 7, 13) OR 5/16"Ø TAPCON XL, MANUFACTURED BY ITW/BUILDEX (CASE I).
- A.1) MINIMUM EMBEDMENT INTO POURED CONCRETE SHALL BE: 3 1/2" FOR 3/8"Ø CONFLEX ANCHORS AND 2 1/4" FOR 5/16"Ø ULTRACON ANCHORS. NO EMBEDMENT INTO STUCCO SHALL BE CONSIDERED AS PART OF THE REQUIRED EMBEDMENT.
- A.2) MINIMUM EDGE DISTANCE (E.D.) INTO POURED CONCRETE SHALL BE: 4" FOR 3/8"Ø CONFLEX ANCHORS AND 3" FOR 5/16"Ø ULTRACONS. EDGE DISTANCE IS BEYOND ANY FINISH MATERIAL.
- A.3) IN CASE THAT PRECAST STONE, PRECAST CONCRETE OR BRICK PANELS, VENEER OR PAVERS BE FOUND ON THE EXISTING WALL, ANCHORS SHALL BE LONG ENOUGH TO REACH THE MAIN STRUCTURE BEHIND SUCH PANELS.
- (B) TO EXISTING MIN. f'c= 2 ksi GROUT FILLED CELL CONCRETE BLOCK WALL: ASTM C-90
- 3/8"Ø KWIK BOLT 3, AS MANUFACTURED BY HILTI, INC. (CASE I, SHT 7, 13)
- 5/16"Ø ULTRACON ANCHORS, AS MANUFACTURED BY DEWALT (CASES I THRU IV, SHTS 7, 13)
- B.1) MINIMUM EMBEDMENT OF 5/16"Ø ULTRACON ANCHORS INTO THE GROUT FILLED CELL CONCRETE BLOCK UNIT SHALL BE 2 1/4" AND 2 1/2" FOR KWIK BOLT 3. NO EMBEDMENT INTO STUCCO SHALL BE CONSIDERED AS PART OF THE REQUIRED EMBEDMENT.
- B.2) MINIMUM EDGE DISTANCE (E.D.) OF ANCHORS INTO GROUT FILLED CELL CONCRETE BLOCK SHALL BE 4". EDGE DISTANCE IS BEYOND ANY FINISH MATERIAL.
- B.3) IN CASE THAT PRECAST STONE, PRECAST CONCRETE OR BRICK PANELS, VENEER OR PAVERS BE FOUND ON THE EXISTING WALL, ANCHORS SHALL BE LONG ENOUGH TO REACH THE MAIN STRUCTURE BEHIND SUCH PANELS.
8. ANCHORS SHALL BE INSTALLED FOLLOWING ALL OF THE RECOMMENDATIONS AND SPECIFICATIONS OF THE ANCHOR'S MANUFACTURER.
9. POLYETHYLENE BLOCKS USED AT SPRING LOADED SYSTEM FOR REMOVABLE STORM BARS SHALL COMPLY WITH THE FOLLOWING SPECIFICATIONS:
- | ASTM DESIGNATION | PROPERTIES | VALUE |
|------------------|-------------------|-------------------------|
| D256 | IMPACT RESISTANCE | 7.95 FT-Lb/In (AVERAGE) |
| D638 | TENSILE CAPACITY | 4243 psi (AVERAGE) |
| D790 | FLEXURAL CAPACITY | 1012 psi (AVERAGE) |
10. ANCHORS REQUIRED FOR STORM BARS SHALL BE AS INDICATED ON SHEET 9.

11. ANCHORS REQUIRED FOR MULLION CONNECTIONS TO CONCRETE SHALL BE AS SPECIFIED ON APPLICABLE SECTIONS SHOWN ON SHEET 11.
- 3/8"Ø GALVANIZED OR S.S KWIK BOLT 3 EXPANSION ANCHOR MANUFACTURED BY HILTI, INC.
- 3/8"Ø CONFLEX SCREW ANCHOR MANUFACTURED BY ELCO CONSTRUCTION PRODUCTS.
- 5/16"Ø ULTRACON ANCHORS, MANUFACTURED BY DEWALT.
- MINIMUM EDGE DISTANCE FOR ABOVE MENTIONED ANCHORS SHALL BE AS INDICATED BELOW. EDGE DISTANCE AND EMBEDMENTS ARE BEYOND ANY FINISH MATERIAL.
- | ANCHOR | EDGE DISTANCE @ 100% | EMBEDMENT @ 100% CONCRETE/GROUTED BLOCK | REQ. MIN. THICKNESS FOR SUBSTRATE |
|---------------------|----------------------|---|-----------------------------------|
| 3/8"Ø KWIK BOLT 3 | 4" | 2 1/2" (3000 PSI) | 6" |
| 3/8"Ø CONFLEX SCREW | 4" | 2 5/8" (3000 PSI) | 6" |
| 5/16"Ø ULTRACONS | 4" | 2 1/4" (3000 PSI) | 4" |
12. THE INSTALLATION CONTRACTOR IS TO SEAL/CAULK ALL PRODUCT COMPONENT EDGES WHICH REMAIN IN CONTINUOUS CONTACT WITH THE BUILDING TO PREVENT WIND/RAIN INTRUSION. CAULK AND SEAL PRODUCT TRACKS ALL AROUND FULL LENGTH.
13. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THE SOUNDNESS OF THE STRUCTURE WHERE PRODUCT IS TO BE ATTACHED TO INSURE PROPER ANCHORAGE. THIS PRODUCT SHALL ONLY BE ATTACHED TO CONCRETE, GROUTED CONCRETE BLOCK OR WOOD FRAME BUILDINGS.
14. THIS PRODUCT'S INSTALLATION SHALL COMPLY WITH ALL SPECS INDICATED IN THIS DRAWING PLUS ANY BUILDING AND ZONING REGULATIONS PROVIDED BY THE JURISDICTION WHERE PERMIT IS APPLIED TO.
15. LIFTING MECHANISM NOT PART OF THIS APPROVAL.
16. (a) THIS P.E.D. PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; i.e. WHERE THE SITE CONDITIONS DEViate FROM THE P.E.D.
- (b) CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT, BASED ON THIS P.E.D. PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT SITE IS THE CONTRACTOR'S RESPONSIBILITY.
- (c) THIS P.E.D. WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- (d) SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER, SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- (e) THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.
17. PRODUCT MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION AT PRODUCT IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. ONE LABEL SHALL BE PLACED FOR EVERY OPENING. LABELING TO COMPLY WITH SECTION 1709.9.2 OF THE FLORIDA BUILDING CODE.

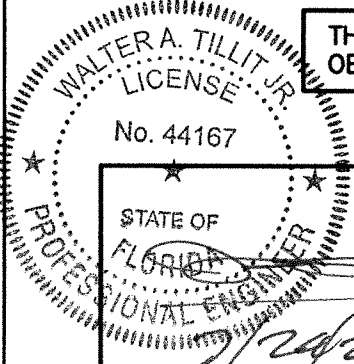


THIS DRAWING SHALL ONLY BE USED TO OBTAIN PERMITS IN THE STATE OF FLORIDA


FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2023 TILTECO, INC. TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33186 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167			IMPACT PROTECTIVE ROLLING SYSTEM WITH END RETENTION 55mm SLAT LARGE MISSILE IMPACT RESISTANT ROLLINGSHIELD Inc. 9875 NW 79th AVE. HIALEAH GARDENS MIAMI, FL 33016		W.H DRAWN BY: 07/24/2023 DATE: 23-119 DRAWING No.
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-

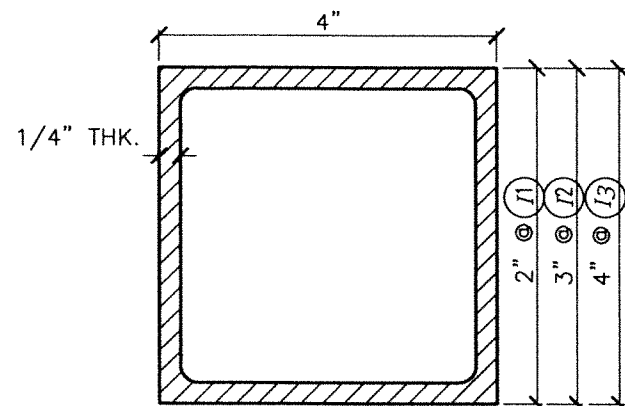


(I1, I2, I3) BUILD-OUT TUBE
ALUMINUM 6061-T6 ALLOY & TEMPER

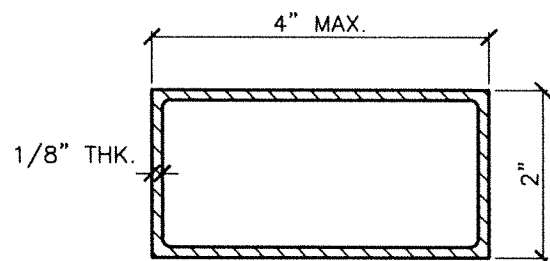


(I4) BUILD-OUT HEADER FOR (G) BOX
ALUMINUM 6063-T5 ALLOY & TEMPER

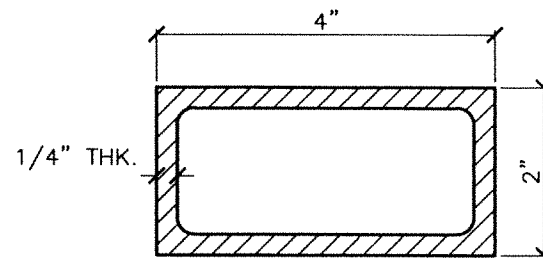


(Y1) 4"X2"X1/4" HEADER
ALUMINUM 6061-T6 ALLOY & TEMPER

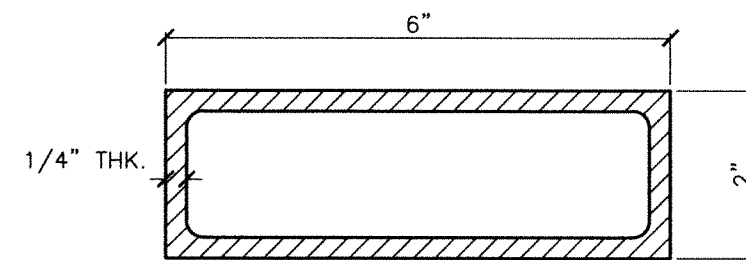


(Y2) 6"X2"X1/4" HEADER
ALUMINUM 6061-T6 ALLOY & TEMPER

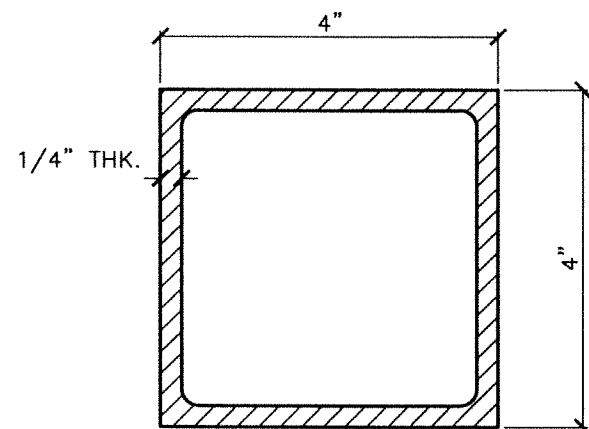


(Z3) 4"X4"X1/4" MULLION
ALUMINUM 6061-T6 ALLOY & TEMPER

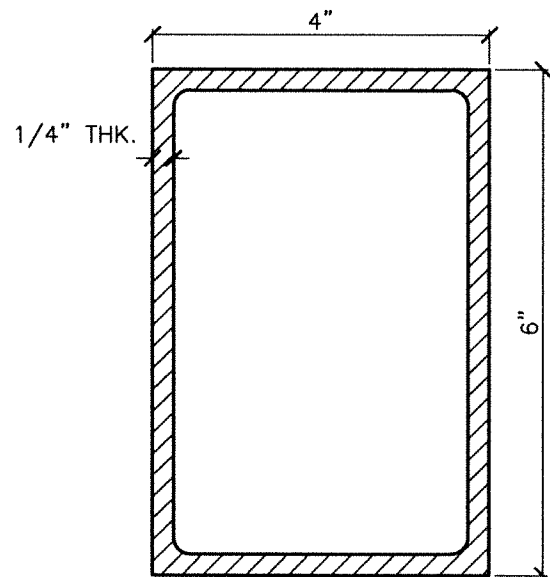

(Z4) 4"X6"X1/4" MULLION
ALUMINUM 6061-T6 ALLOY & TEMPER

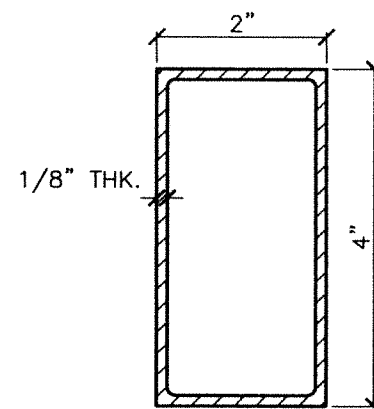

(M1) 4"X2"X1/8" STORM BAR*
ALUMINUM 6063-T6 ALLOY & TEMPER

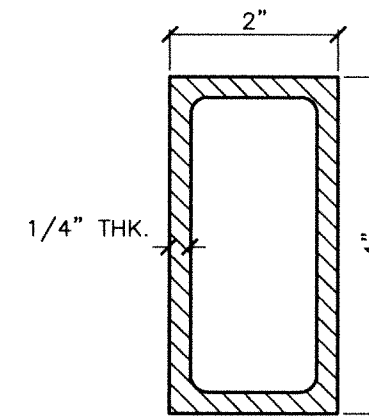


(M2) 4"X2"X1/4" STORM BAR*
ALUMINUM 6061-T6 ALLOY & TEMPER

*SEE SHEET 6 FOR STORM BARS (M3) & (M4) W/ SPRING LOAD SYSTEM.

COMPONENTS

N.T.S

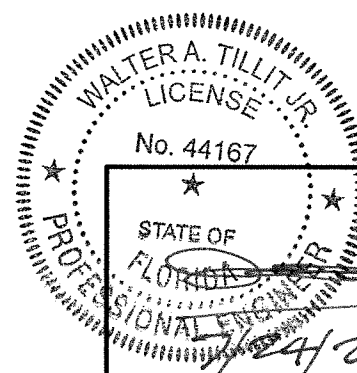

P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

IMPACT PROTECTIVE ROLLING SYSTEM WITH
END RETENTION 55mm SLAT
LARGE MISSILE IMPACT RESISTANT

ROLLINGSHIELD Inc.
9875 NW 79th AVE.
HIALEAH GARDENS MIAMI, FL. 33016


W.H
DRAWN BY:

07/24/2023
DATE:

23-119
DRAWING No.


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-

SHEET 2 OF 15

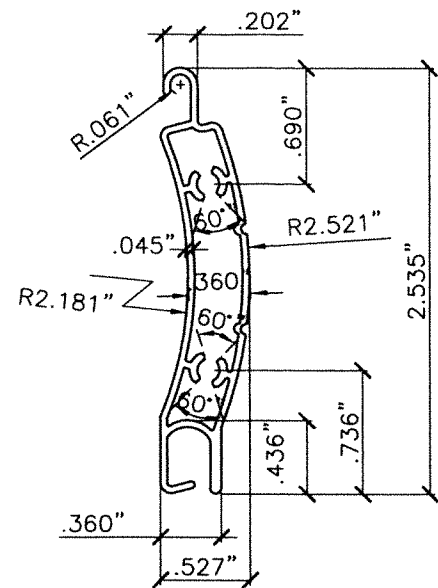


(G) TYPE 3 SLAT

EXTRUDED ALUMINUM: 6063-T6 ALLOY & TEMPER
55mm SLAT

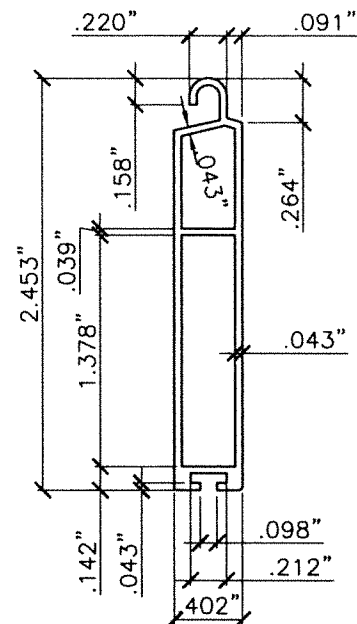


(H) TYPE 3 SLAT:

EXTRUDED ALUMINUM: 6063-T6 ALLOY & TEMPER
BOTTOM 55mm SLAT

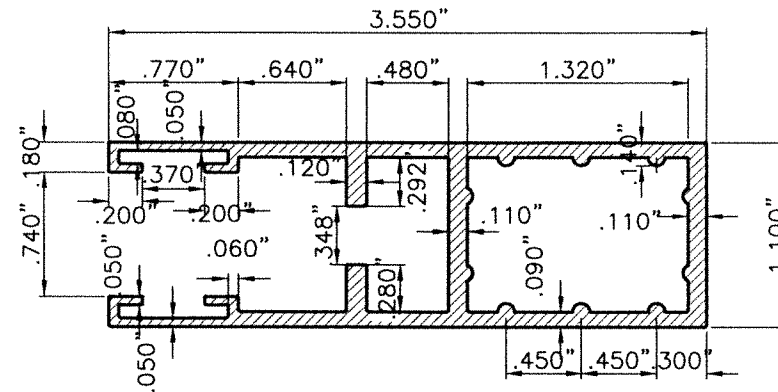


(I) SIDE RAIL TYPE 2

EXTRUDED ALUMINUM:
6063-T6 ALLOY & TEMPER
SIDE RAIL 55mm SLAT

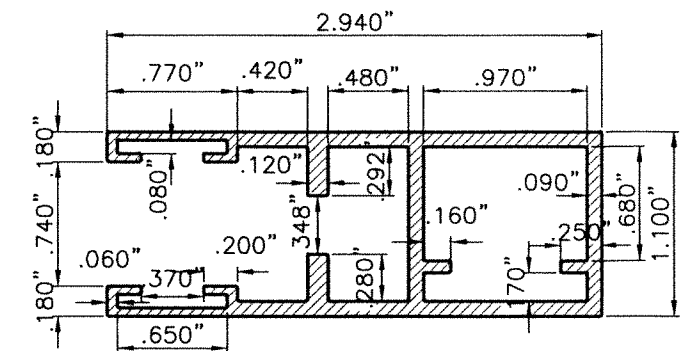




(J) SIDE RAIL TYPE 3

EXTRUDED ALUMINUM:
6063-T6 ALLOY & TEMPER
SIDE RAIL 55mm SLAT

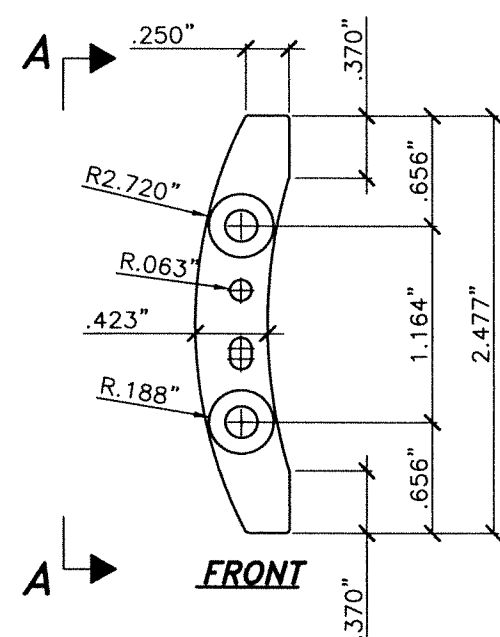


**(K) ACETAL POLYMER
(Fu=9.5Ksl., 110 DUROMETER)
END RETAINER CAP**

TWO ACETAL POLYMER (Fu=9.5Ksl., 110 DUROMETER) RETAINER CLIPS FORMING ONE PIECE. ONE AT EACH END OF EVERY OTHER SLAT, EACH FASTENED WITH TWO No. 6 X 2" PAN HEAD S.S S.D.S FOR 55MM SLAT

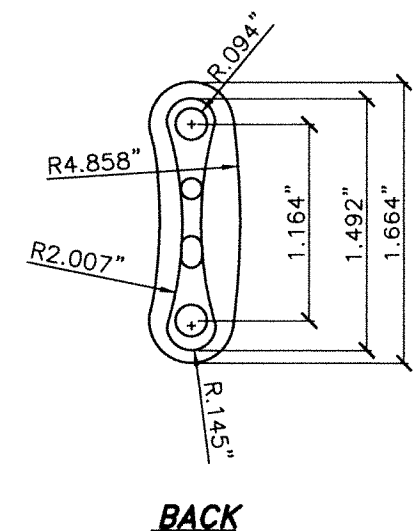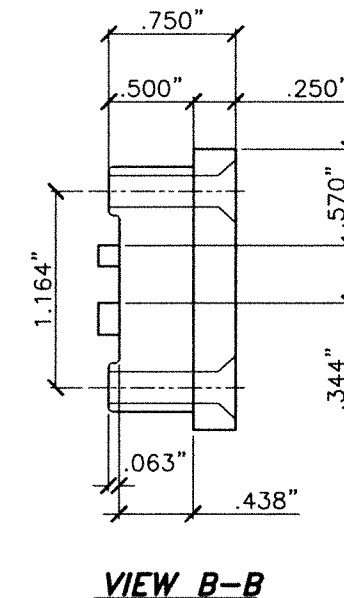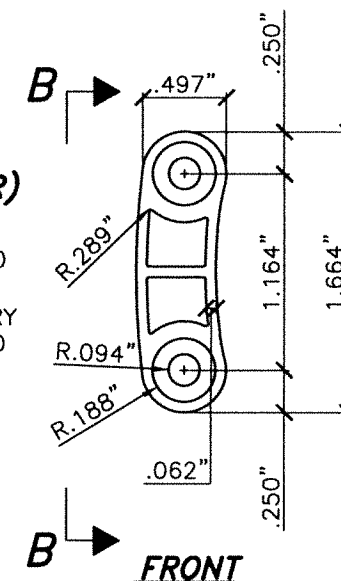

COMPONENTS (CONTINUED)
N.T.S

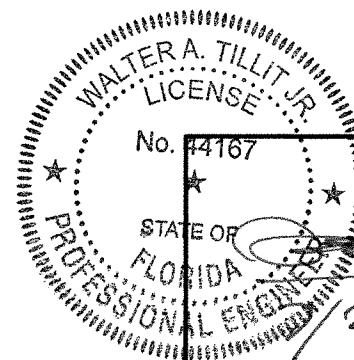

P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
CA-0006719

WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

IMPACT PROTECTIVE ROLLING SYSTEM WITH
END RETENTION 55mm SLAT
LARGE MISSILE IMPACT RESISTANT

ROLLINGSHIELD Inc.

9875 NW 79th AVE.
HIALEAH GARDENS MIAMI, FL 33016

W.H
DRAWN BY:


07/24/2023
DATE:

23-119


DRAWING No.

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-


SHEET 3 OF 15

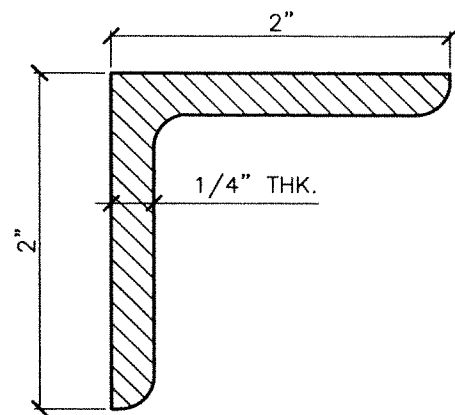


J 2"x2"x1/4" TRAPPED ANGLE
ALUMINUM 6061-T6 ALLOY & TEMPER

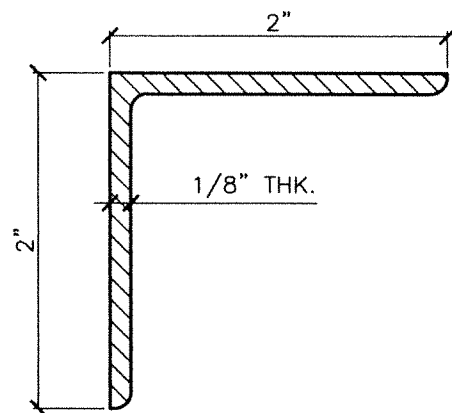


J1 2"x2"x1/8"x0'-4" CLIP ANGLE
ALUMINUM 6061-T6 ALLOY & TEMPER

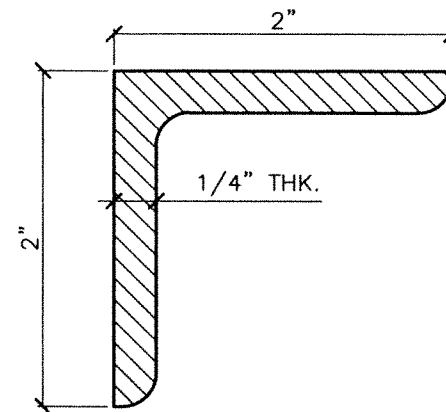


J2 2"x2"x1/4"x0'-6" CLIP ANGLE
ALUMINUM 6061-T6 ALLOY & TEMPER

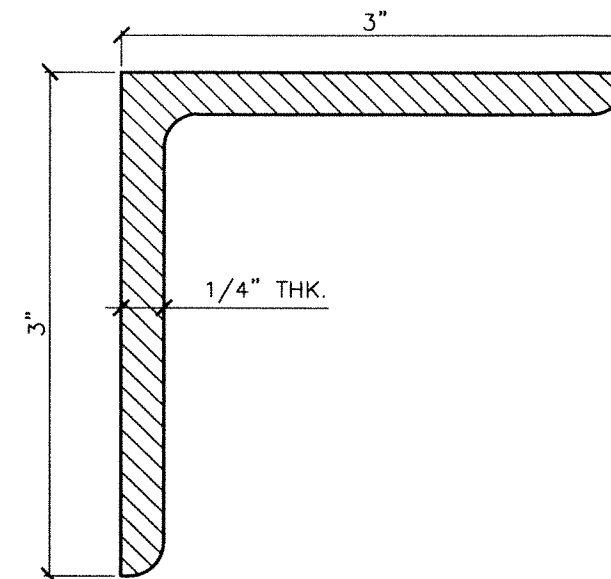

J3 3"x3"x1/4"x0'-4" CLIP ANGLE
ALUMINUM 6061-T6 ALLOY & TEMPER

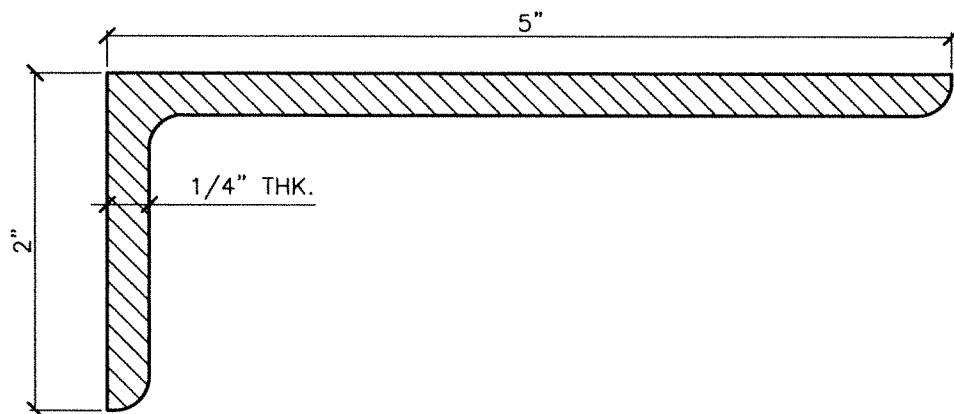


J4 2"x5"x1/4"x0'-6" CLIP ANGLE
ALUMINUM 6061-T6 ALLOY & TEMPER

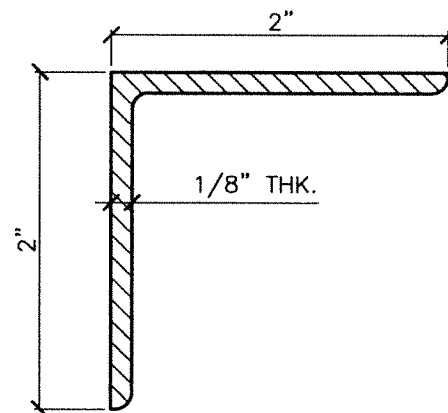

J5 2"x2"x1/8"x0'-2" CLIP ANGLE
ALUMINUM 6061-T6 ALLOY & TEMPER

COMPONENTS (CONTINUED)
N.T.S

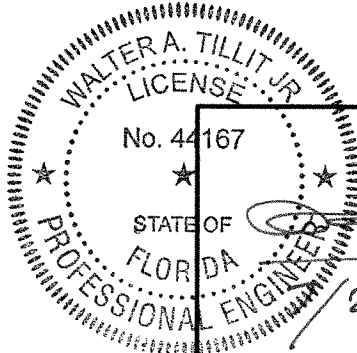

P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY

6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166

Phone : (305)871-1530 : Fax : (305)871-1531

CA-0006719

WALTER A. TILLIT Jr. P.E.

FLORIDA Lic. # 44167

IMPACT PROTECTIVE ROLLING SYSTEM WITH
END RETENTION 55mm SLAT
LARGE MISSILE IMPACT RESISTANT

ROLLINGSHIELD Inc.

9875 NW 79th AVE.

HIALEAH GARDENS MIAMI, FL 33016

W.H
DRAWN BY:



07/24/2023
DATE:

23-119

DRAWING No.


SHEET 4 OF 15

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-

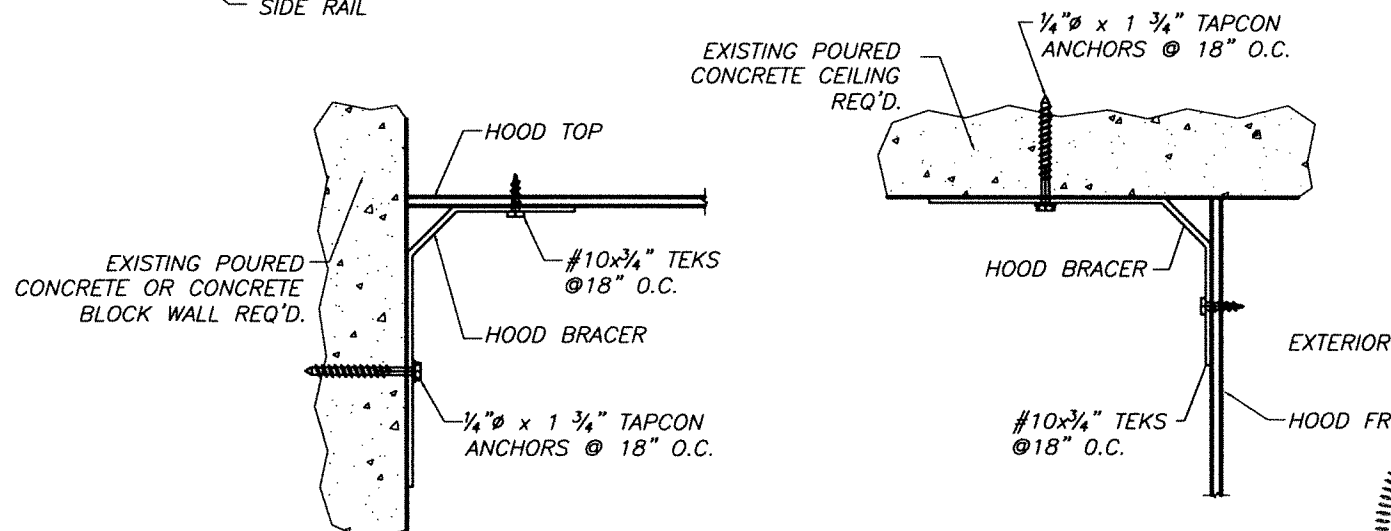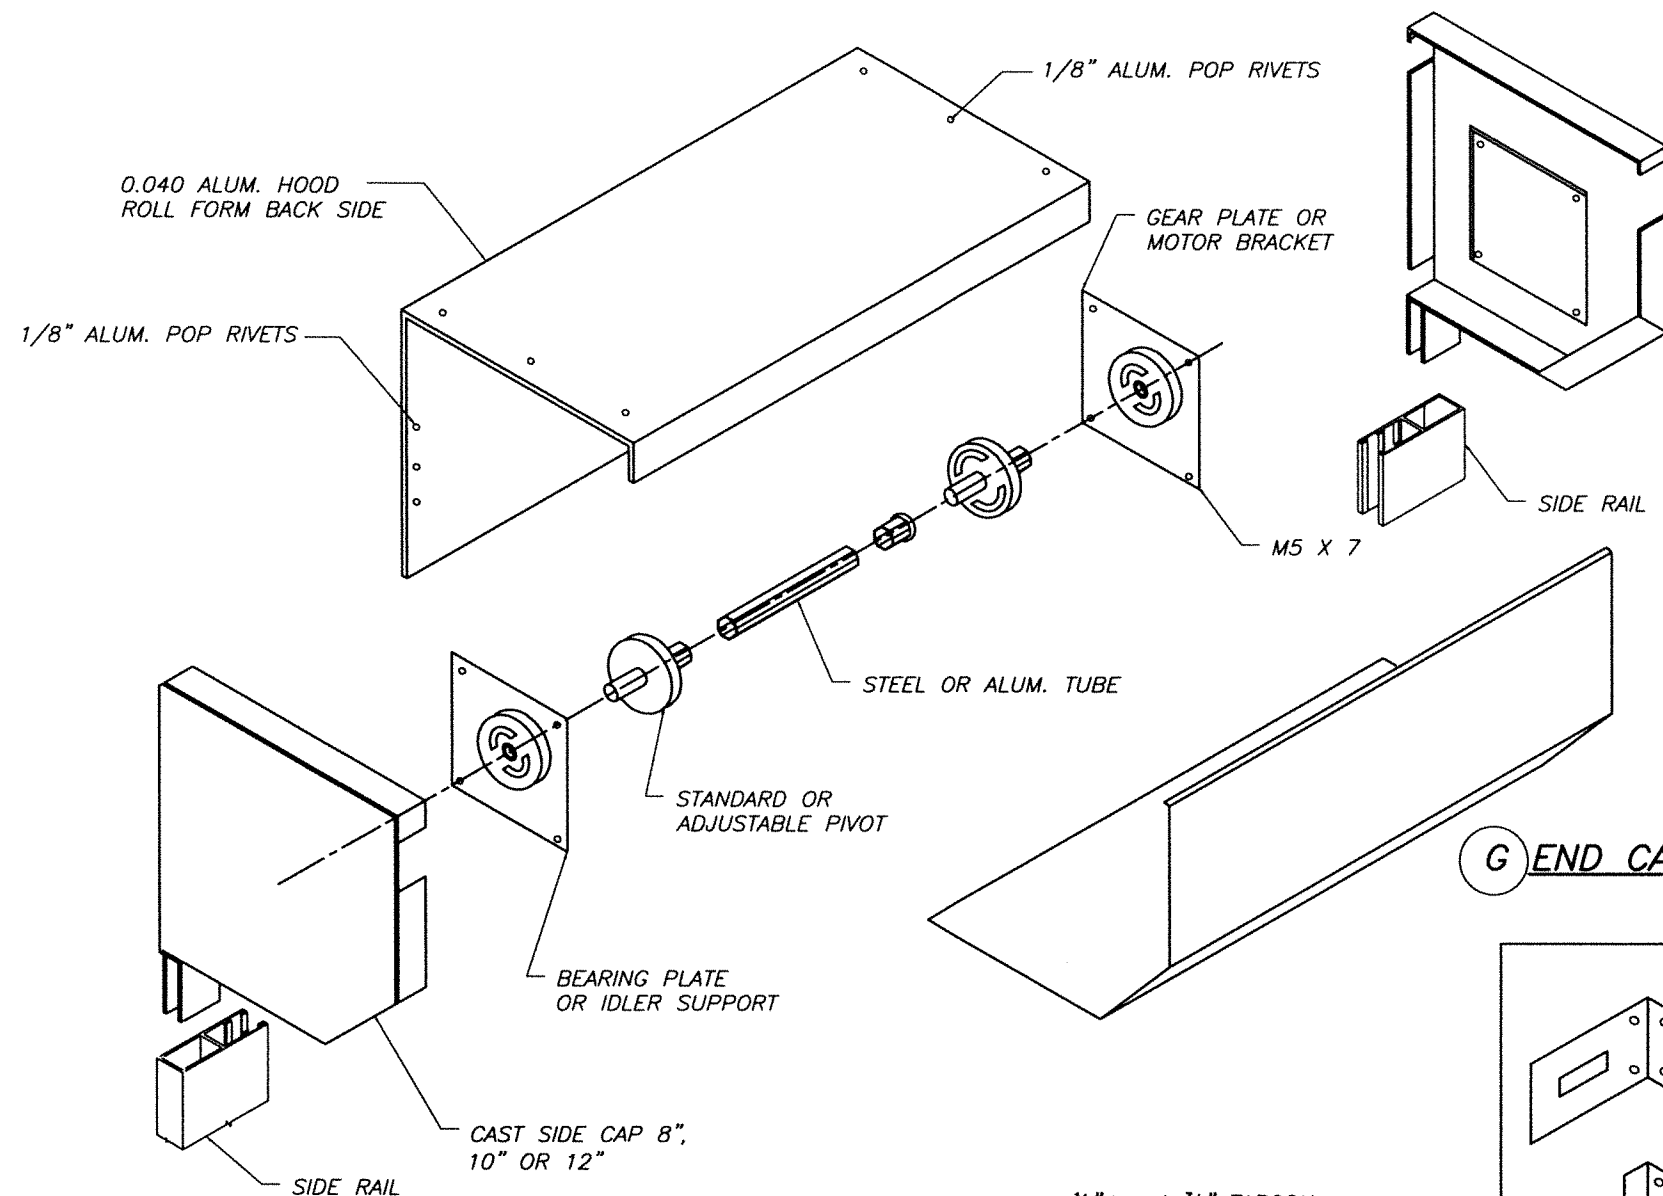

**WALL HOOD ATTACHMENT
(SIDE VIEW)**


CUSTOM HOOD ATTACHMENT DETAIL

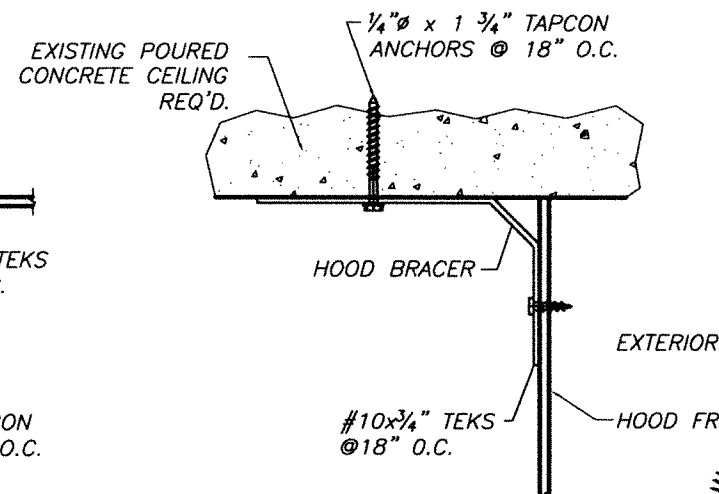


**CEILING HOOD ATTACHMENT
(SIDE VIEW)**

G END CAP SYSTEM FOR 40mm & 55mm


BRACKET SYSTEM




UP TO 100 LBS SHUTTER WEIGHT
MIN. 2 ANCHORS 1/4"Ø x 1 3/4"
TAPCON OR 3 TEKS. 1/4"Ø x 1"



UP TO 200 LBS SHUTTER WEIGHT
MIN. 3 ANCHORS 5/16"Ø x 2 1/4"
TAPCON OR 4 TEKS 1/4"Ø x 1"




UP TO 350 LBS SHUTTER WEIGHT
MIN. 4 ANCHORS 5/16"Ø x 2 1/4"
TAPCON OR 6 TEKS 1/4"Ø x 1"

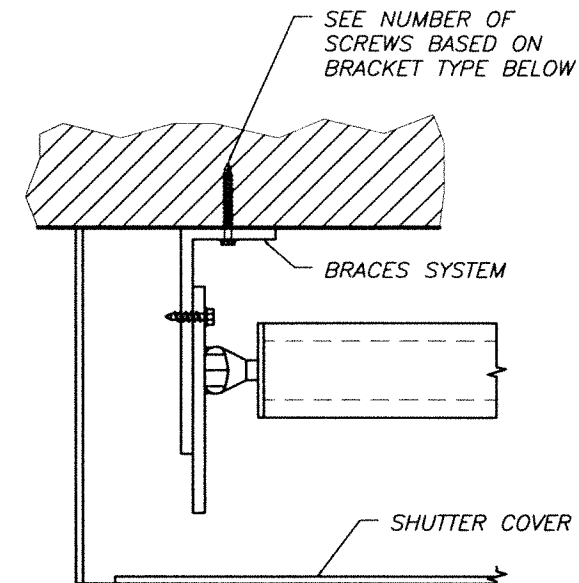


**WALL INSTALLATION
(PLAN)**

MOTORIZED ROLL-UP SHUTTER SYSTEM

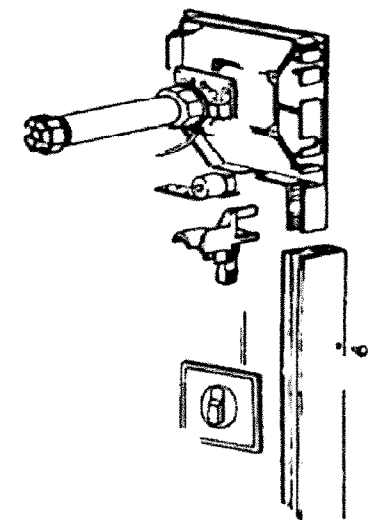


HAND CRANK ROLL-UP SHUTTER SYSTEM

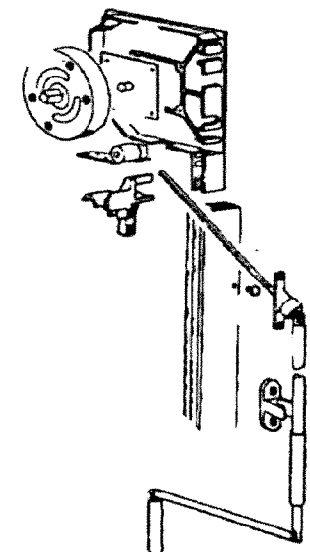

ALTERNATE ROLL-UP SHUTTER LIFTING MECHANISMS

(SEE NOTE 15 ON SHEET 1)

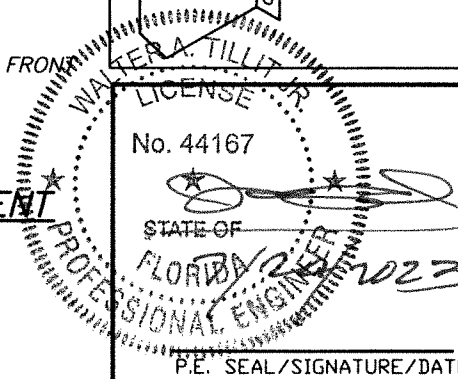

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL. 33166
Phone : (305)871-1530 . Fax : (305)871-1531
CA-0006719

WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

**IMPACT PROTECTIVE ROLLING SYSTEM WITH
END RETENTION 55mm SLAT
LARGE MISSILE IMPACT RESISTANT**

ROLLINGSHIELD Inc.
9875 NW 79th AVE.
HIALEAH GARDENS MIAMI, FL. 33016


W.H
DRAWN BY:

07/24/2023
DATE:


23-119
DRAWING No.

SHEET 5 OF 15


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-

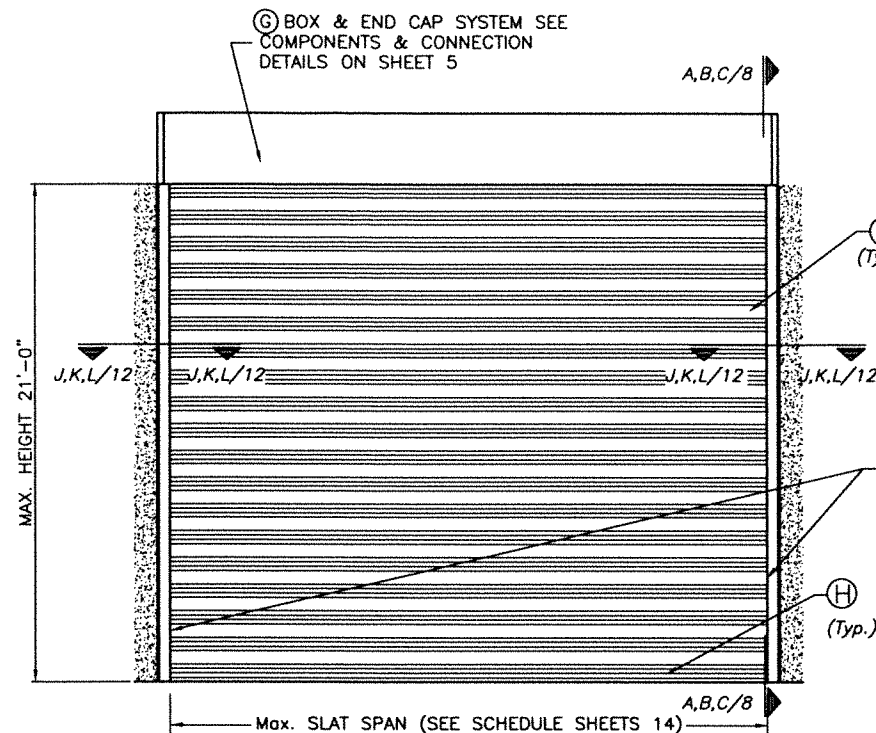


CASE I
END RETENTION SLAT
TYPICAL SINGLE UNIT ELEVATION
WALL TRAPPED AND BUILD-OUT MOUNT
ATTACHED TO EXISTING BUILDING AT ENDS
W/O STORM BARS/HEADERS. NO MULLIONS

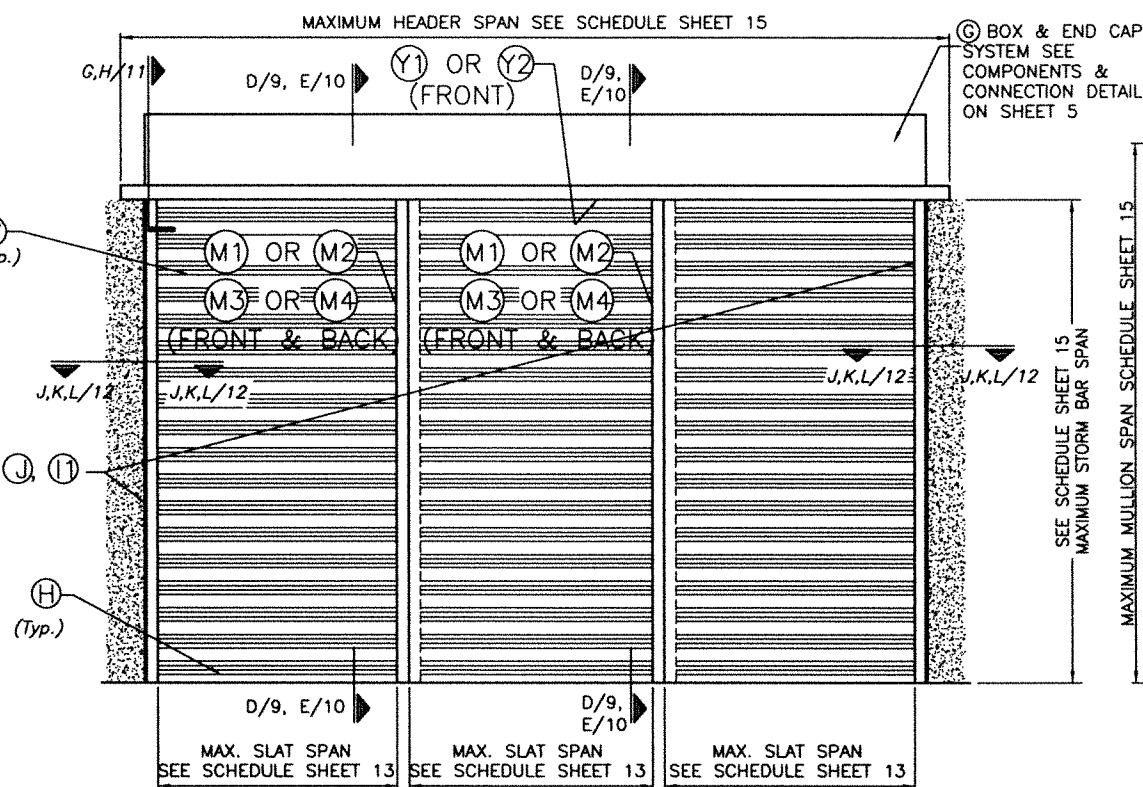


CASE II
TYPICAL SINGLE UNIT ELEVATION (W/ STORM BARS AND HEADER)
ATTACHED TO EXISTING BUILDING AT ENDS. NO MULLIONS

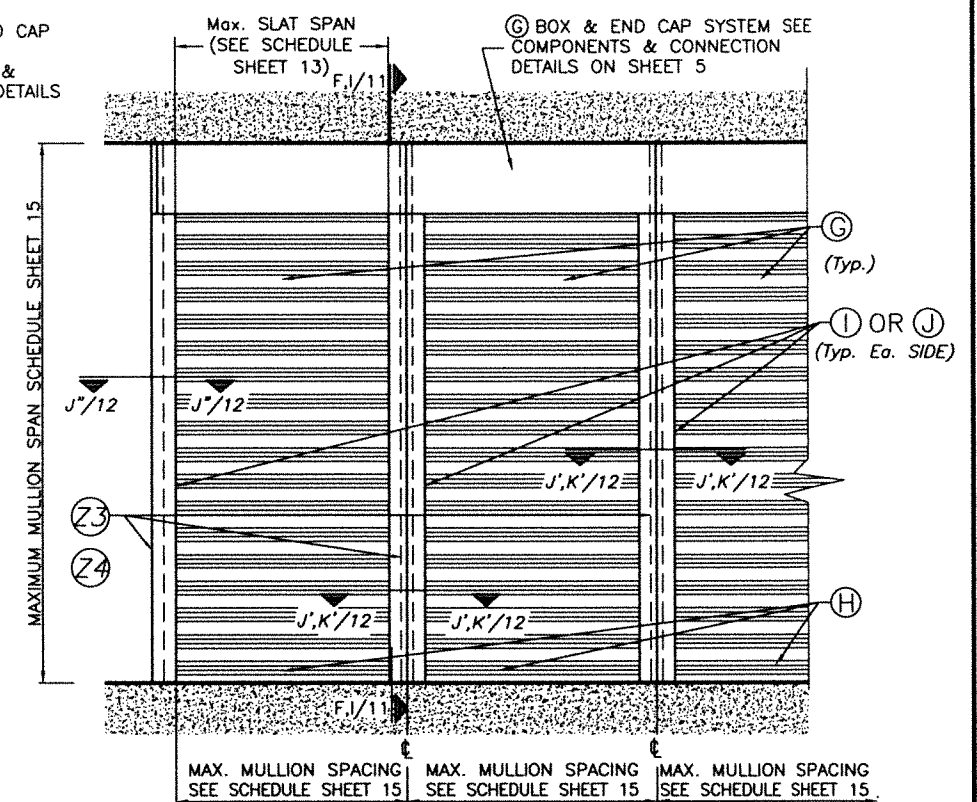

CASE III
TYPICAL MULTIPLE UNIT ELEVATION SINGLE SPAN SLAT
W/MULLIONS BETWEEN UNITS. NO STORM BARS. NO HEADERS

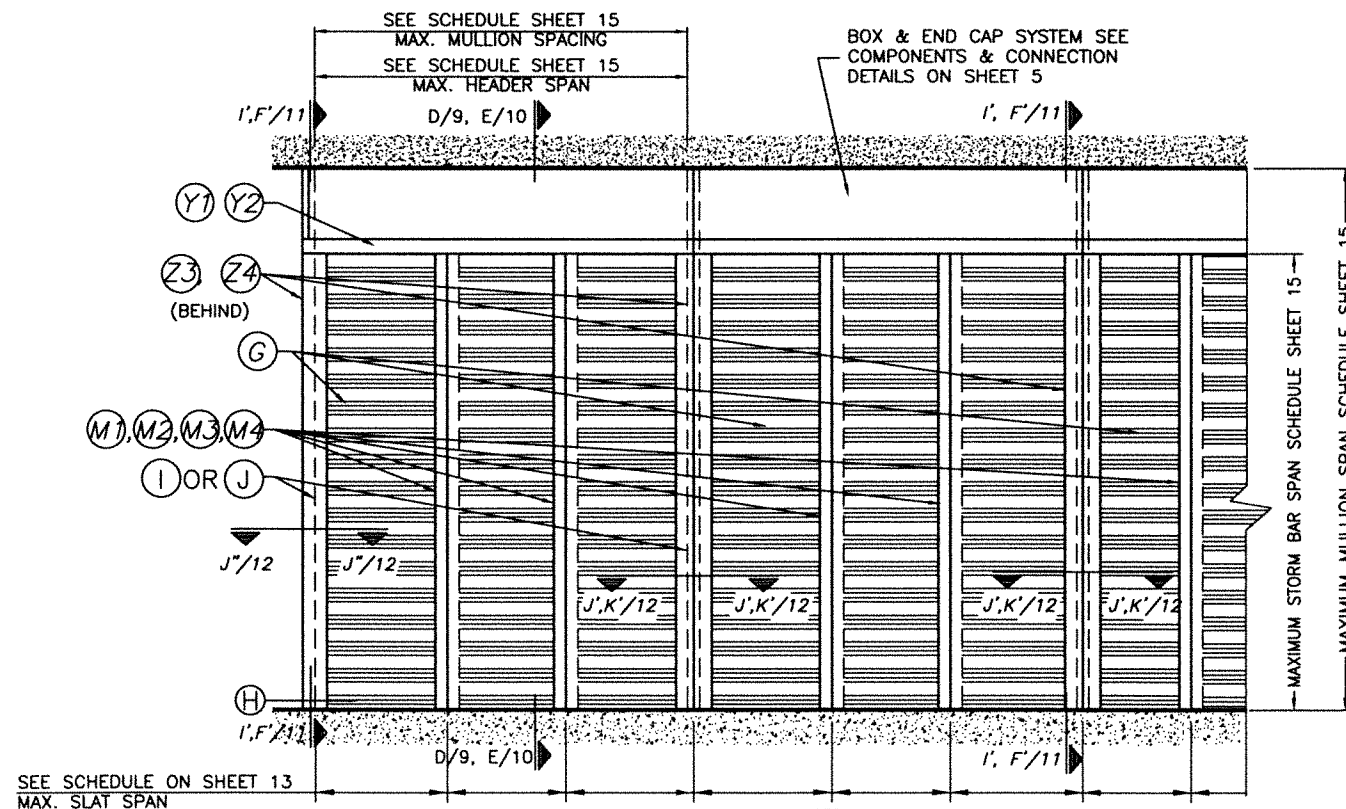

CASE IV
TYPICAL CONSECUTIVE MULTIPLE UNIT ELEVATION (STORM BARS AND HEADER REQUIRED)
AND WITH MULLIONS BETWEEN UNITS

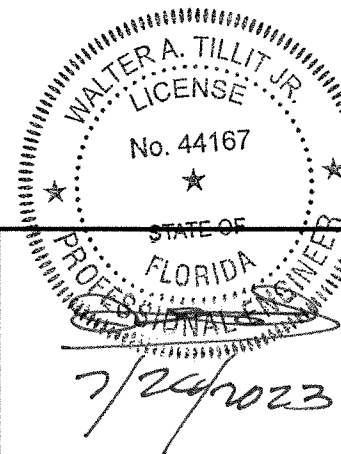

P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

TILTECO Inc.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone : (305)871-1530 . Fax : (305)871-1531
 CA-0006719
 WALTER A. TILLIT Jr. P.E.
 FLORIDA Lic. # 44167

IMPACT PROTECTIVE ROLLING SYSTEM WITH
END RETENTION 55mm SLAT
LARGE MISSILE IMPACT RESISTANT

ROLLINGSHIELD Inc.
 9875 NW 79th AVE.
 HIALEAH GARDENS MIAMI, FL 33016

W.H
 DRAWN BY:


07/24/2023
 DATE:

23-119


DRAWING No.

SHEET 7 OF 15


REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-

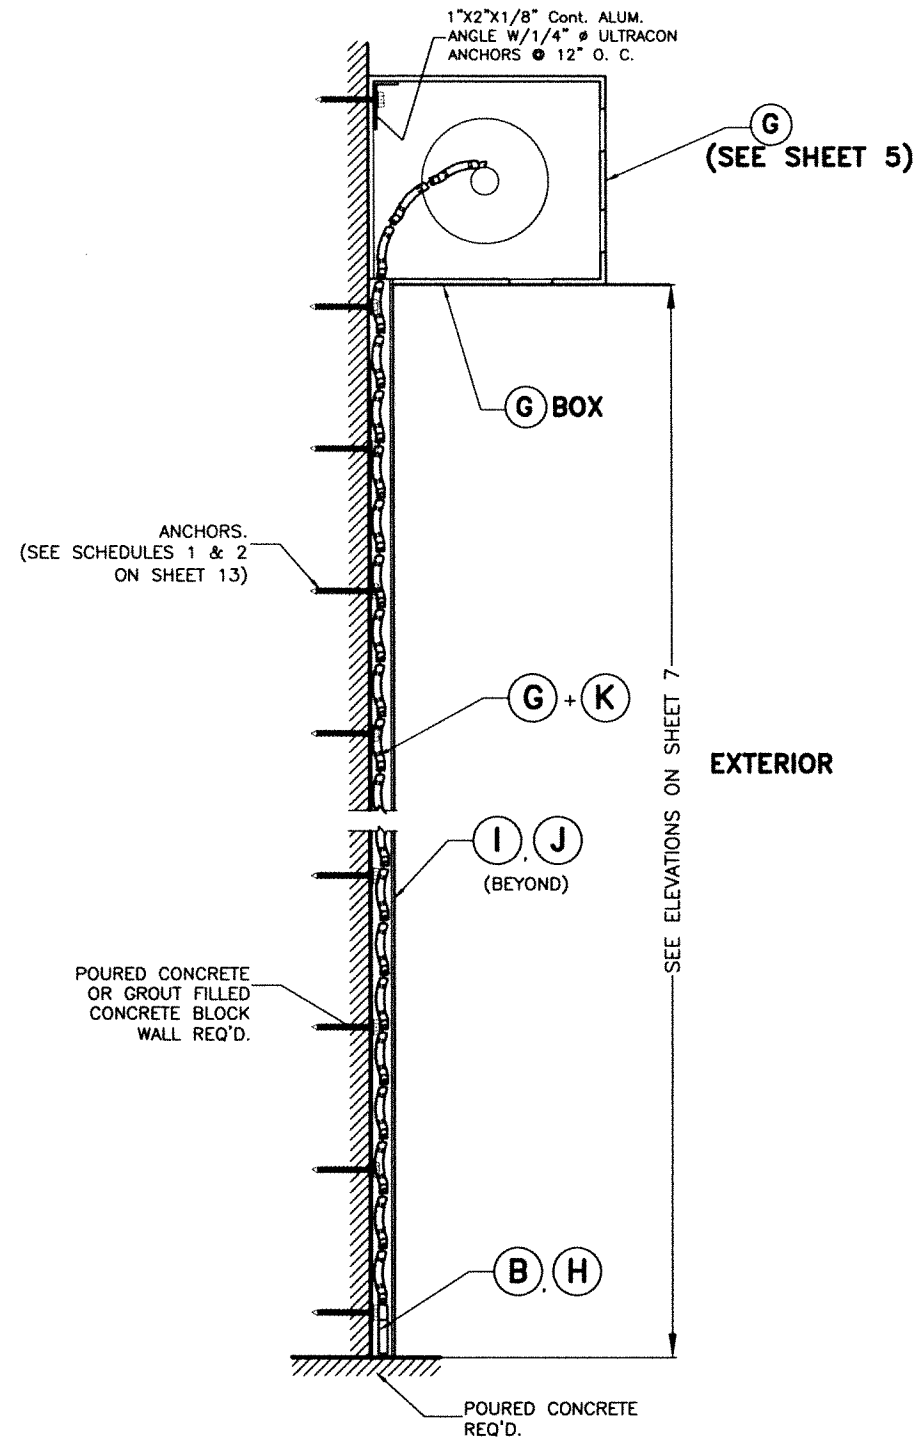

CASES I, II, III & IV
SECTION A-A (WALL MOUNTED)
SCALE 1-1/2"=1"

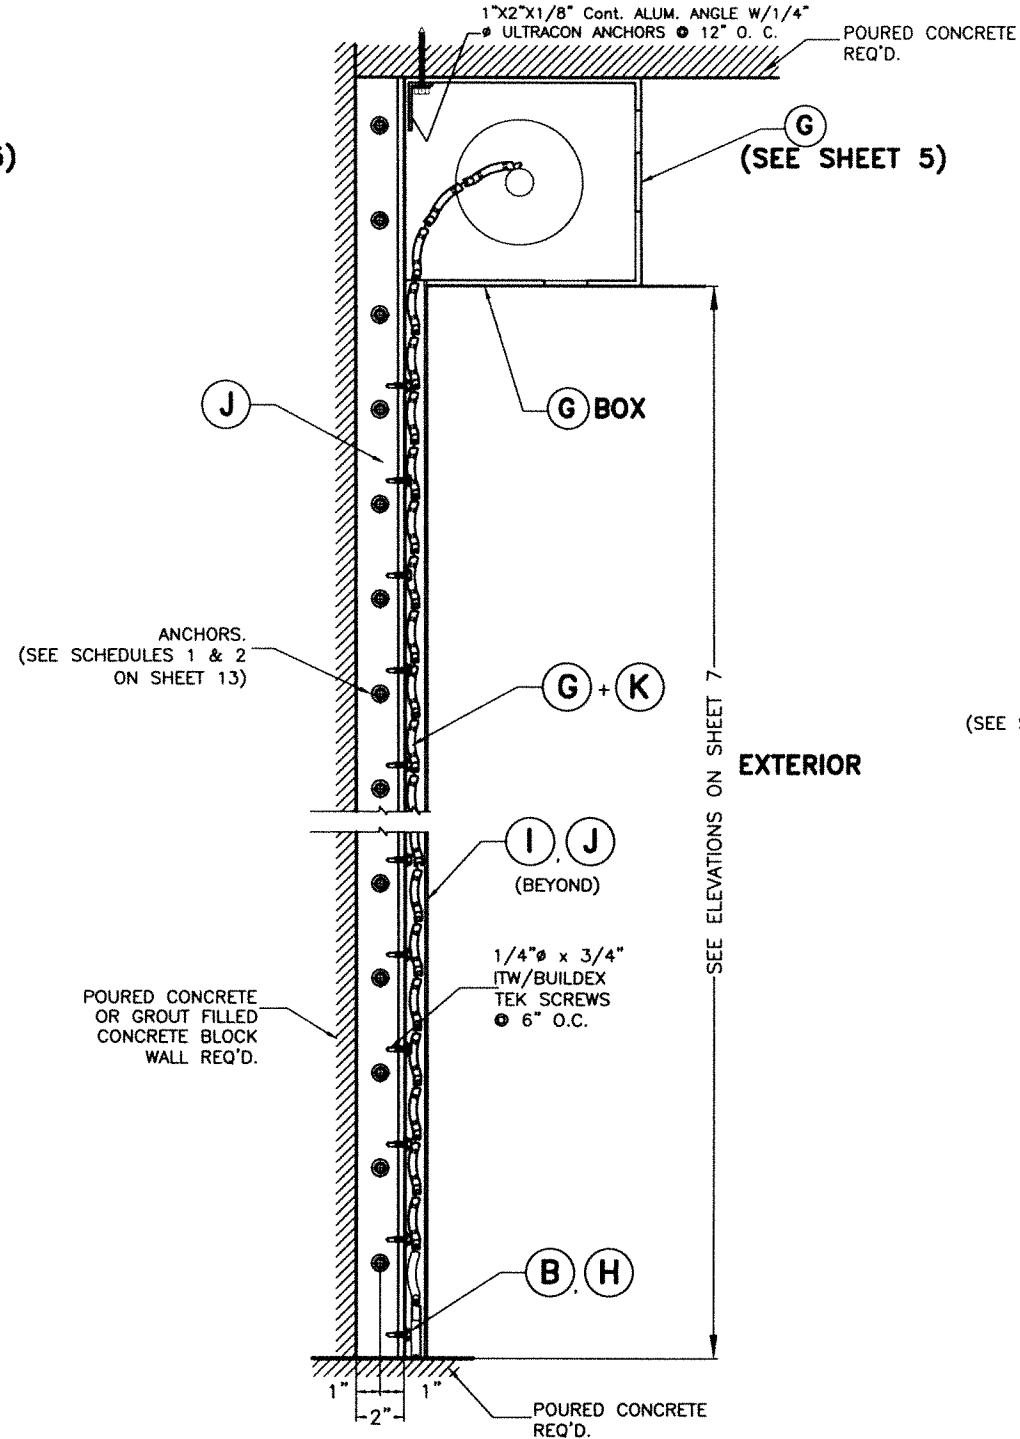

CASES I, II, III & IV
SECTIONS B-B (TRAPPED MOUNTED)
SCALE 1-1/2"=1"

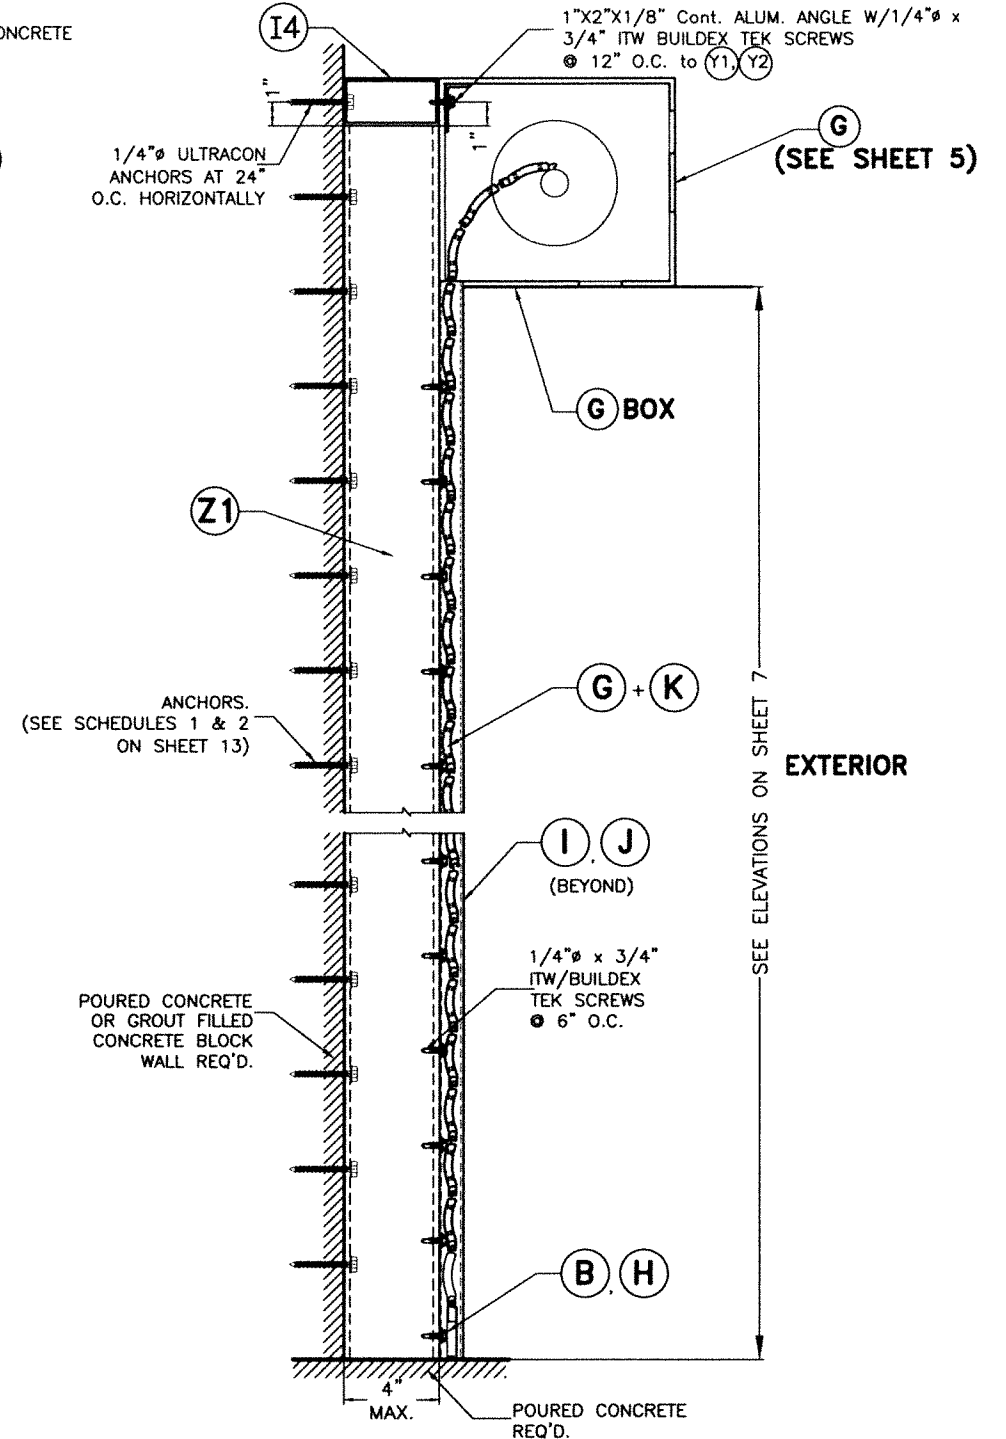

CASES I, II, III & IV
SECTION C-C (BUILD-OUT MOUNTED)
SCALE 1-1/2"=1"

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166
Phone : (305)871-1530 . Fax : (305)871-1531
CA-0006719

WALTER A. TILLIT JR. P.E.
FLORIDA Lic. # 44167

IMPACT PROTECTIVE ROLLING SYSTEM WITH
END RETENTION 55mm SLAT
LARGE MISSILE IMPACT RESISTANT

ROLLINGSHIELD Inc.

9875 NW 79th AVE.
HIALEAH GARDENS MIAMI, FL 33016

W.H

DRAWN BY:


07/24/2023
DATE:

23-119


DRAWING No.

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-


SHEET 8 OF 15

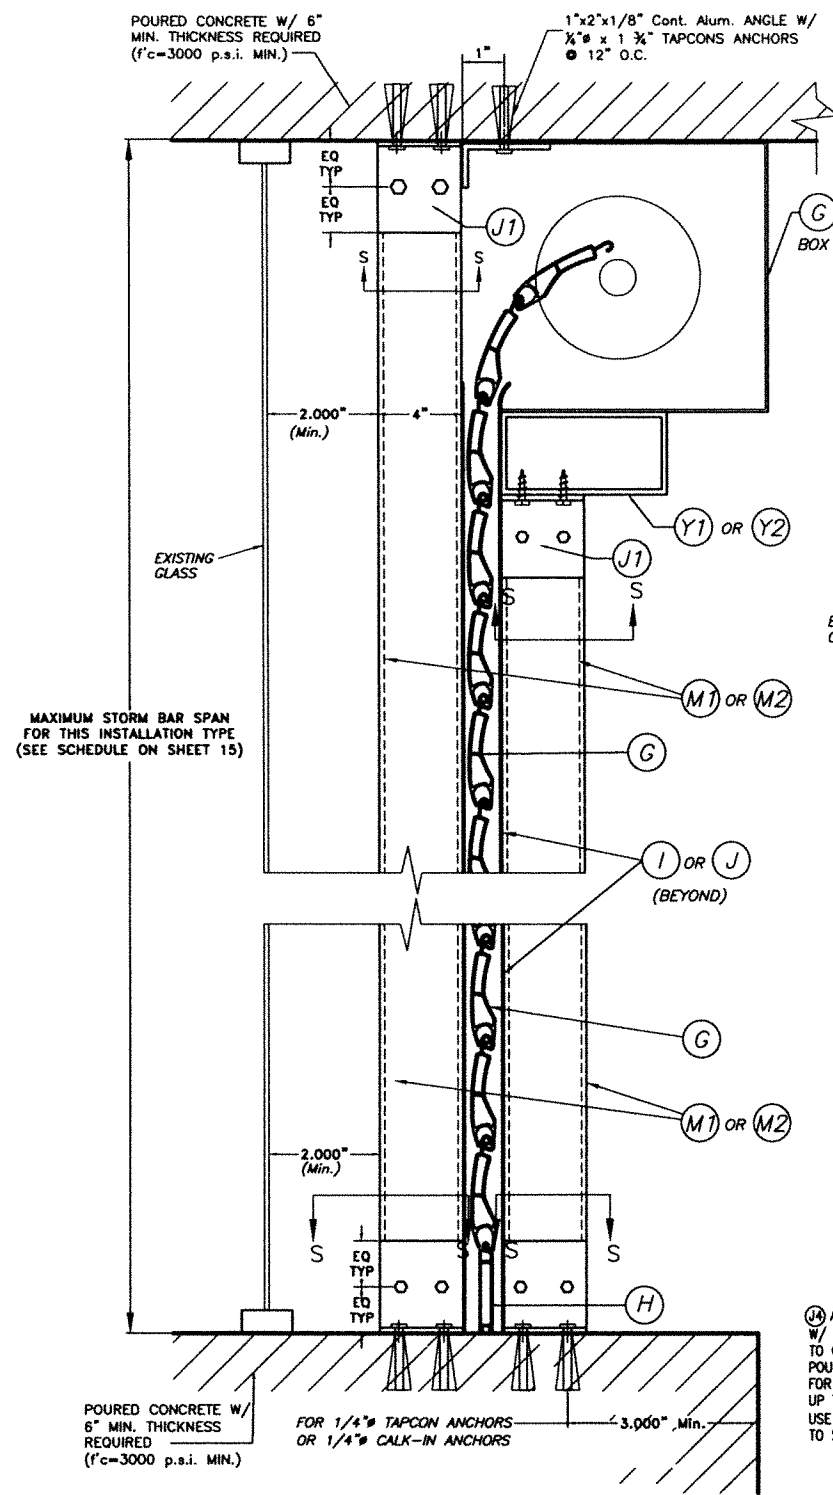


**CEILING & FLOOR MOUNTING SECTION D-D INSTALLATION
W/ FIXED OR REMOVABLE STORM BARS W/ CONCRETE ANCHORS**
(SEE SECTION "S" FOR ANCHOR TYPE REQUIREMENT)
SCALE : N.T.S.

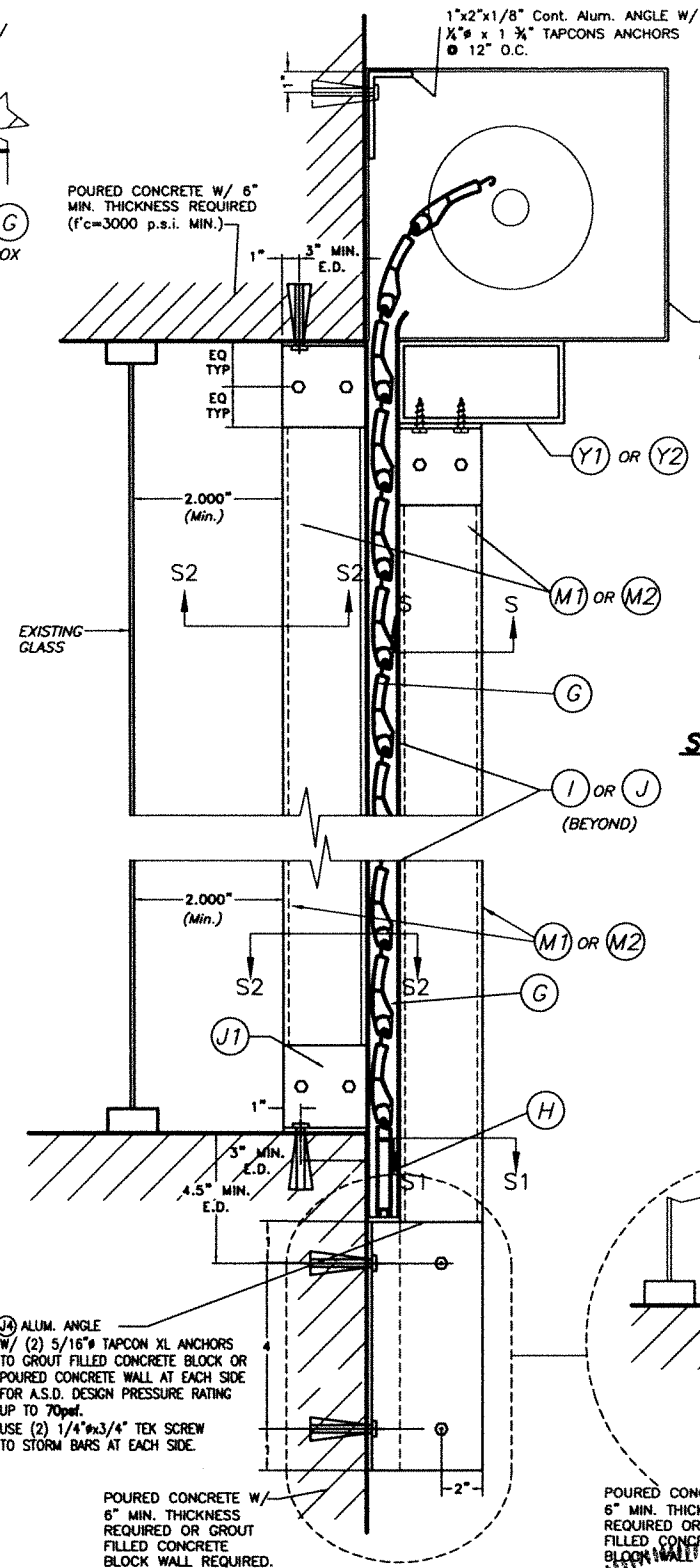


**WALL MOUNTING SECTION D-D INSTALLATION
W/ FIXED STORM BARS W/ CONCRETE ANCHORS**
SCALE : N.T.S.

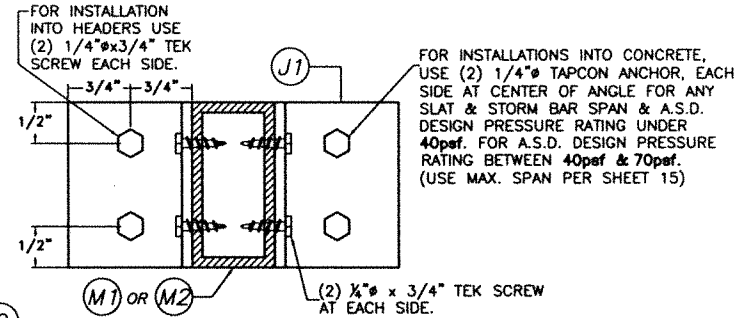


SECTION S - S (FOR FIXED STORM BAR)
SCALE : 1/2" = 1"

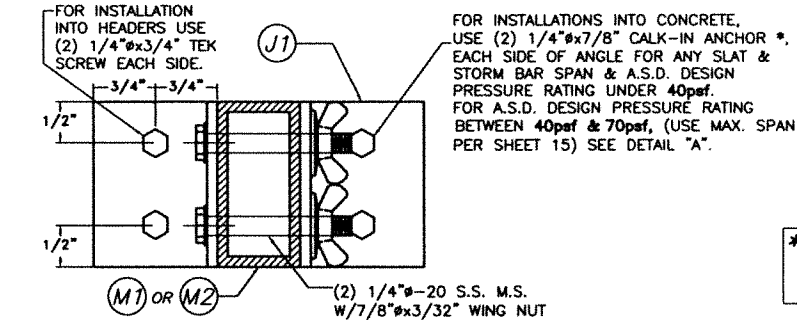


SECTION S - S (FOR REMOVABLE STORM BAR)
SCALE : 1/2" = 1"

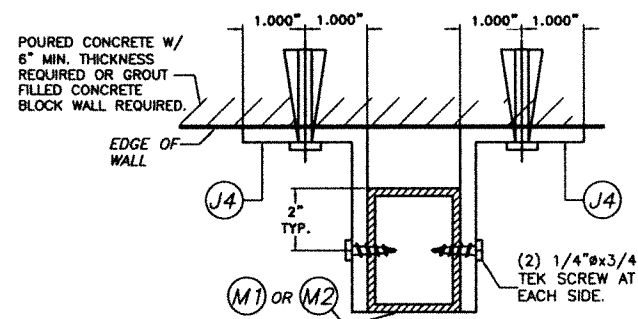

SECTION S1 - S1
SCALE : N.T.S.

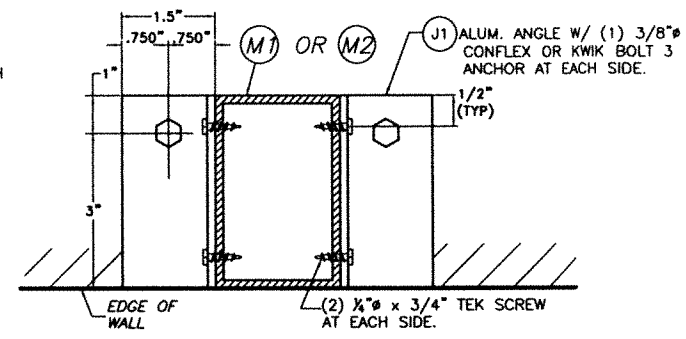


SECTION S2 - S2
SCALE : 1/4" = 1"

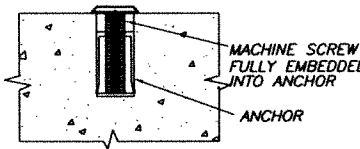


DETAIL A
N.T.S.

* 1/4" x 20 OR 3/8" x 16 MACHINE SCREWS USED JOINTLY W/ 1/4" x 7/8" OR 3/8" x 1 1/4" CALK-IN ANCHORS RESPECTIVELY SHALL BE LEFT TOGETHER W/ ANCHORS AT THE TIME STORM BARS ARE REMOVED. (SEE DET. A).

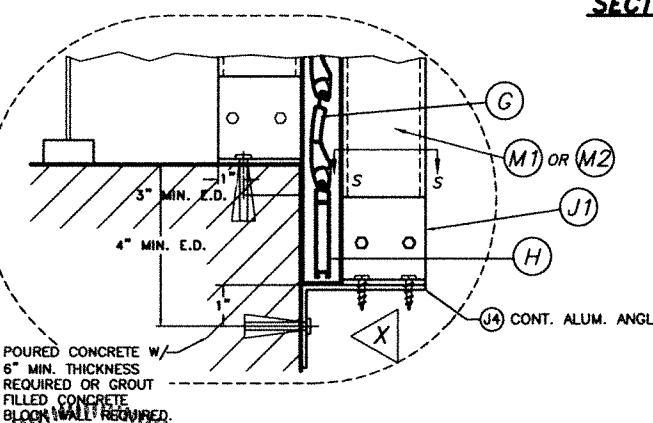

OPTIONAL STORM BAR CONNECTION

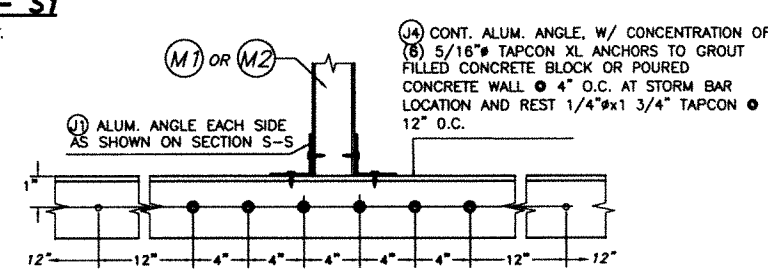


ELEVATION X
SCALE : N.T.S.


**CASES II & IV
SECTIONS D - D**

WALTER A. TILLIT JR. P.E.
FLORIDA LIC. # 44167
P.E. SEAL/SIGNATURE/DATE


FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2023 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM WITH END RETENTION 55mm SLAT LARGE MISSILE IMPACT RESISTANT		
TILTECO INC.			ROLLINGSHIELD Inc.		
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719			9875 NW 79th AVE. HIALEAH GARDENS MIAMI, FL. 33016		
WALTER A. TILLIT JR. P.E. FLORIDA Lic. # 44167			W.H. DRAWN BY: 07/24/2023 DATE: 23-119 DRAWING No.		
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-

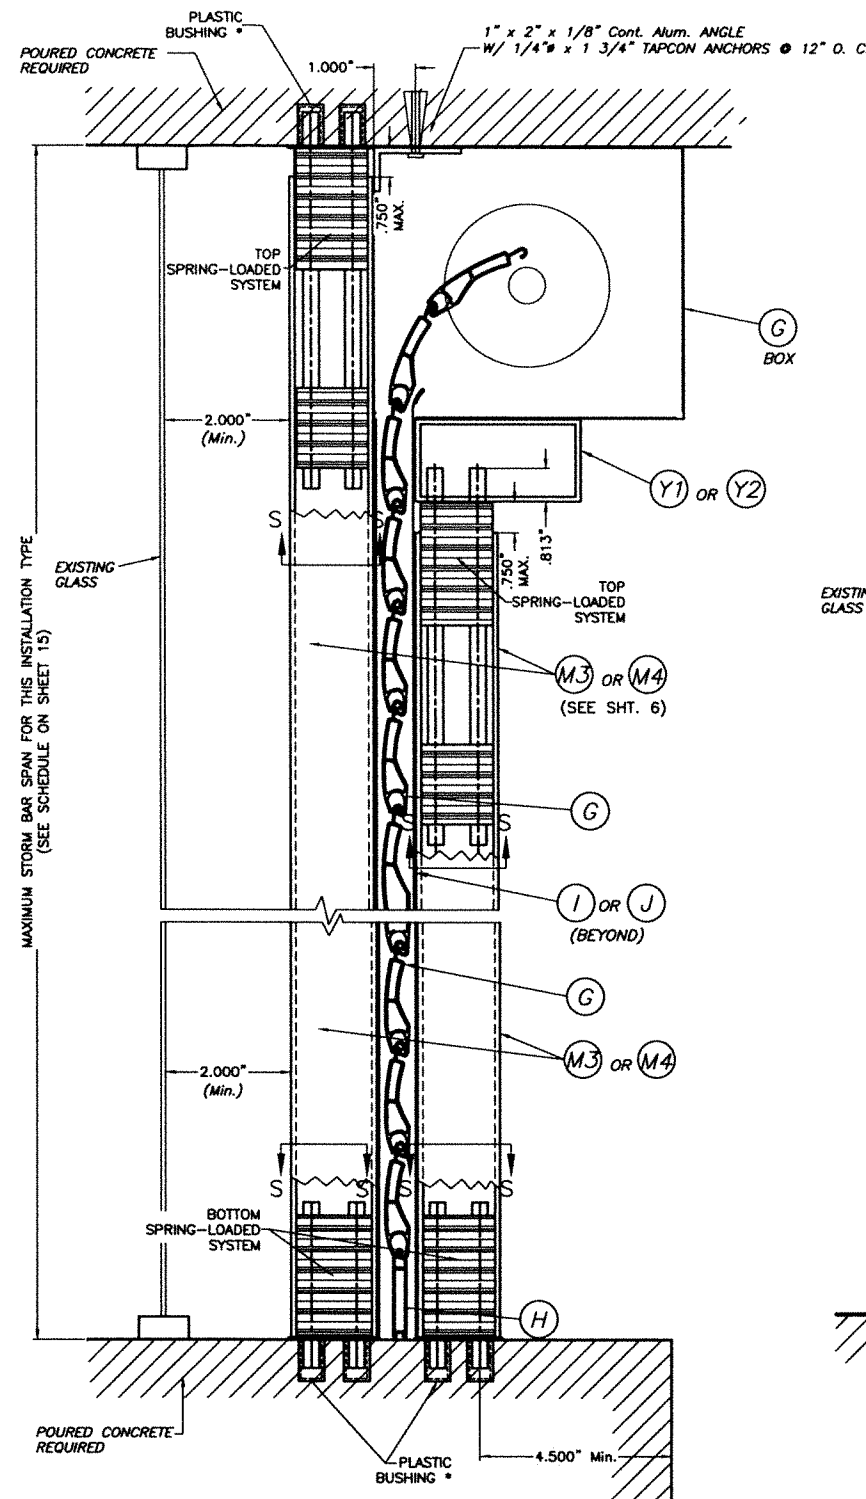


CEILING & FLOOR MOUNTING SECTION E-E INSTALLATION
W/ REMOVABLE STORM BARS W/SPRING-LOADED SYSTEM *
 SCALE : N.T.S

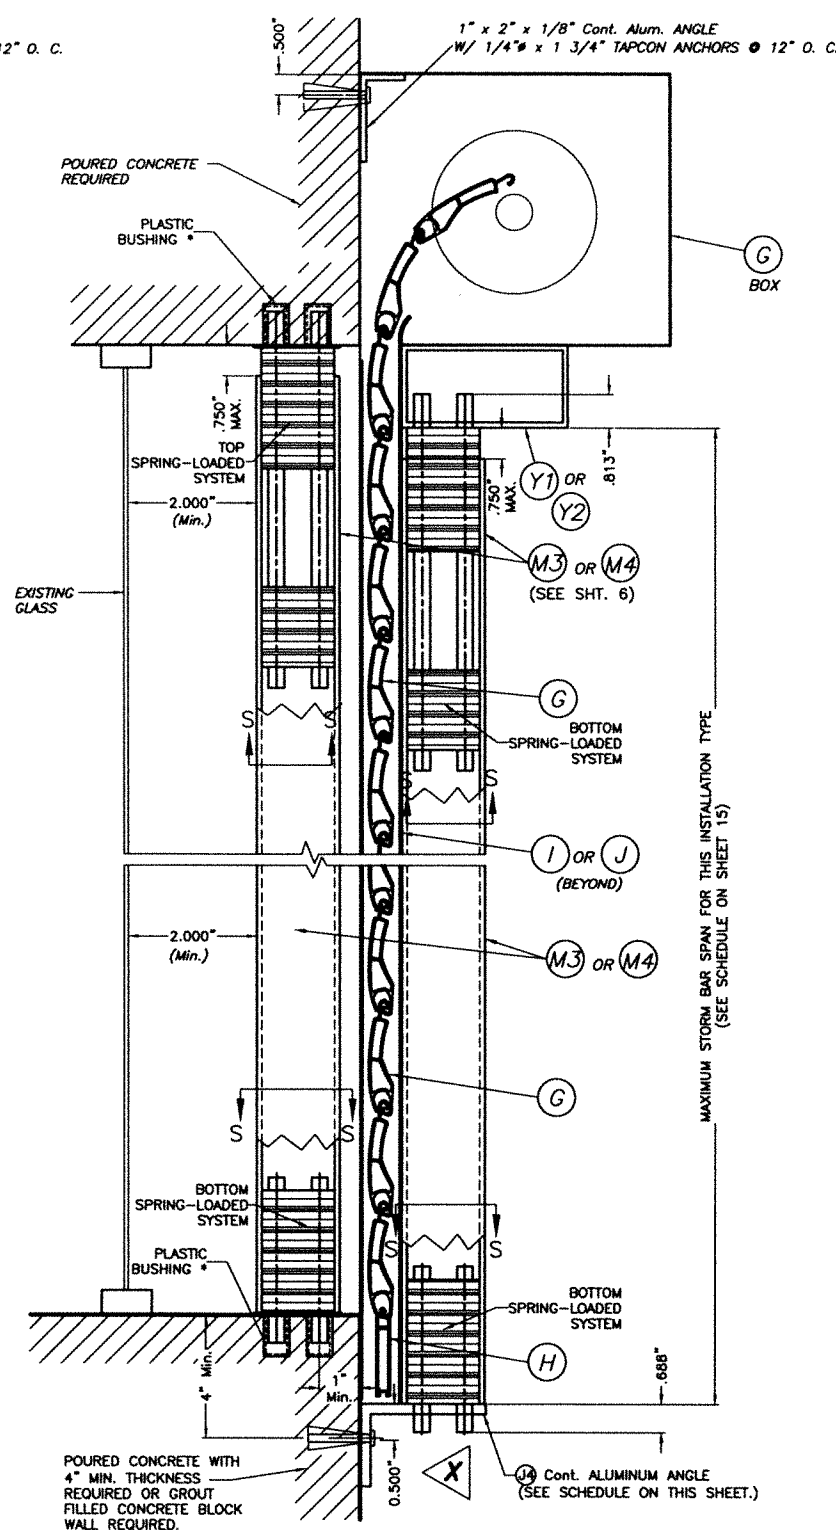

WALL MOUNTING SECTION E-E INSTALLATION
W/ REMOVABLE STORM BARS W/SPRING-LOADED SYSTEM *
 SCALE : N.T.S



SECTION S - S :
SINGLE STORM BAR
 SCALE : N.T.S

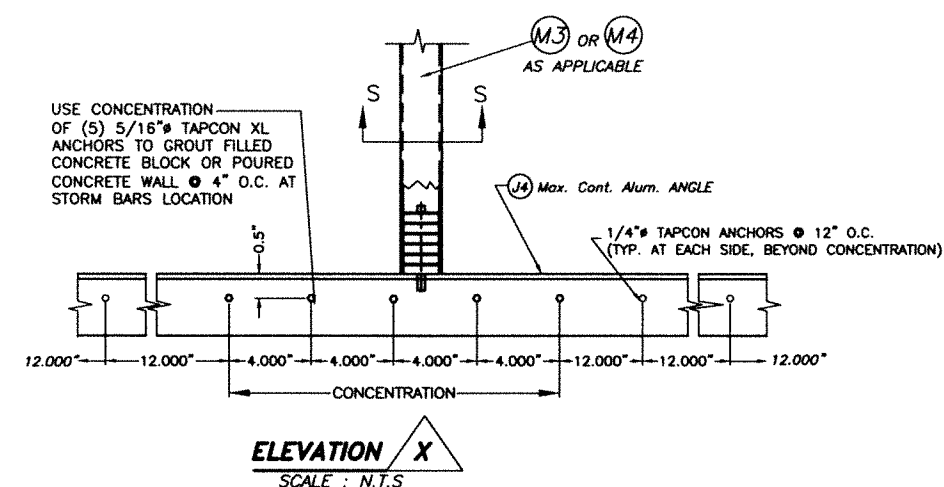

ANCHOR & ANGLE SCHEDULE FOR ELEVATION X			
A.S.D. DESIGN PRESSURE RATING (p.s.f.)	ANCHOR TYPE & QUANTITY	ANGLE	SUBSTRATE
70.0 OR LESS **	(5) 5/16" # TAPCON XL	(J4) 1/4" THICKNESS	GROUT FILLED CONCRETE BLOCK OR POURED CONCRETE

** W/ 4'-0" Max. SLAT SPAN & MAX. STORM BAR SPAN PER SHEET 15

CASES II & IV
SECTIONS E - E

WALTER A. TILLIT JR.
 No. 44167
 STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 2/24/2023
 P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

TILTECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166
 Phone : (305)871-1530 . Fax : (305)871-1531
 CA-0006719
 WALTER A. TILLIT Jr. P.E.
 FLORIDA Lic. # 44167

IMPACT PROTECTIVE ROLLING SYSTEM WITH
END RETENTION 55mm SLAT
LARGE MISSILE IMPACT RESISTANT

ROLLINGSHIELD Inc.
 9875 NW 79th AVE.
 HIALEAH GARDENS MIAMI, FL 33016


W.H
 DRAWN BY:

07/24/2023
 DATE:

23-119
 DRAWING No.

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-


SHEET 10 OF 15

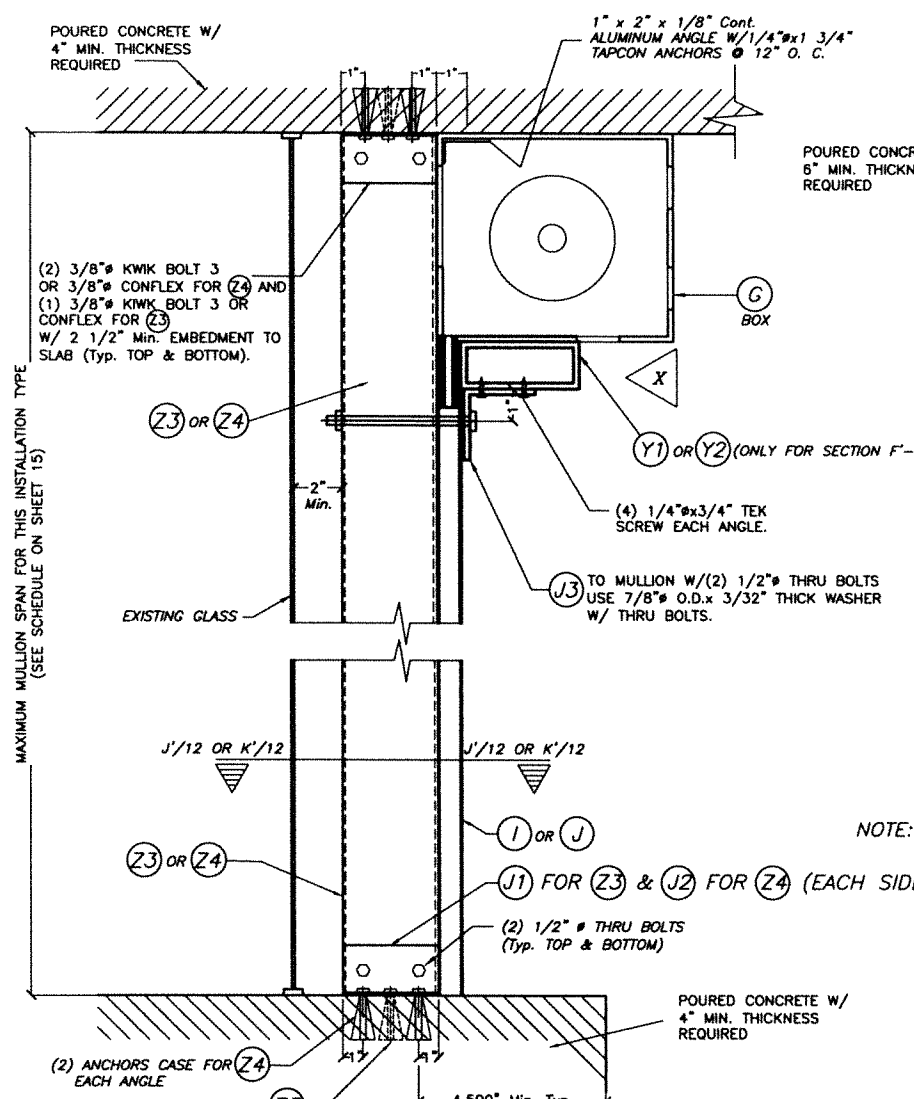

CASE II :
HEADER ANCHORAGE METHOD 1
WALL MOUNTING : SECTION G - G
 SCALE : 1/8" = 1"


NOTE: VALID FOR ALL SPANS AND LOAD COMBINATIONS.

CASES III & IV :
FLOOR/CEILING MOUNTING :
SECTION F-F W/O HEADER &
SECTION F'-F' W/HEADER
 SCALE : 1/8" = 1"

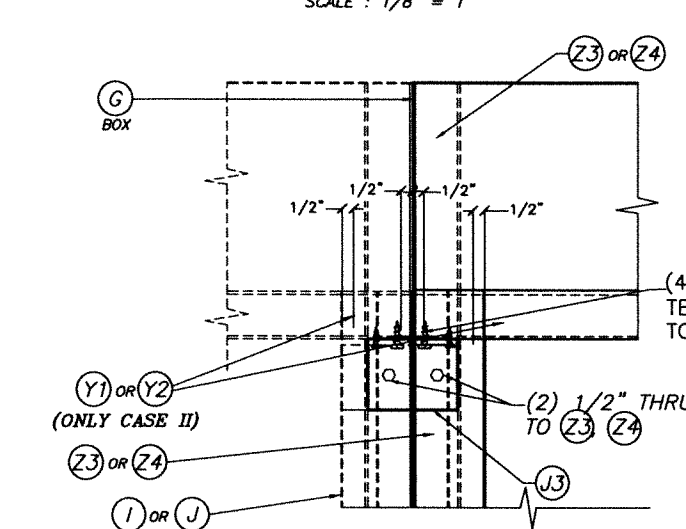


CASES III & IV : ELEVATION X
 SCALE : 1/8" = 1"


TYPICAL MULLION AND HEADER CONNECTION AT ENDS:
CASES II, III & IV AS APPLICABLE

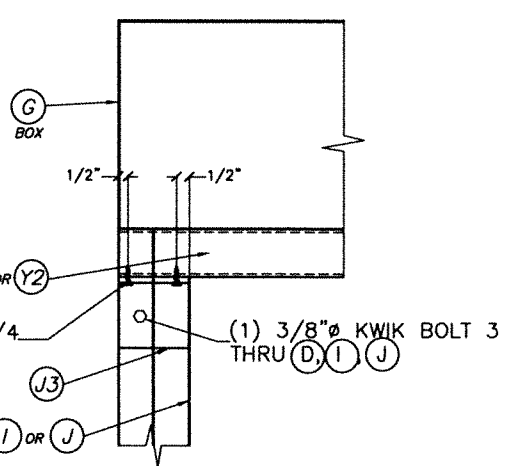

CASE II : ELEVATION X1
 SCALE : 1/8" = 1"

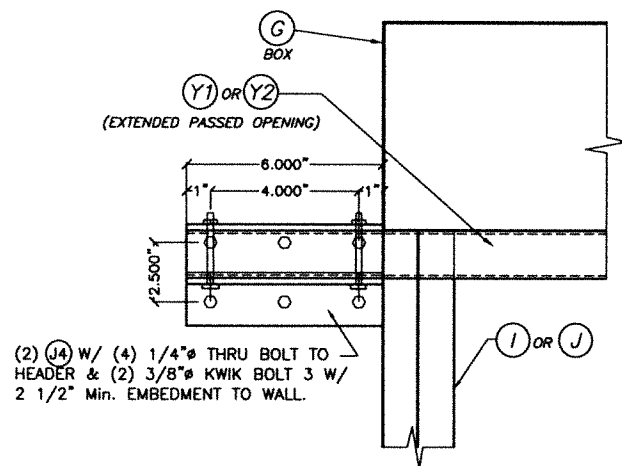


CASE II : ELEVATION X2
 SCALE : 1/8" = 1"

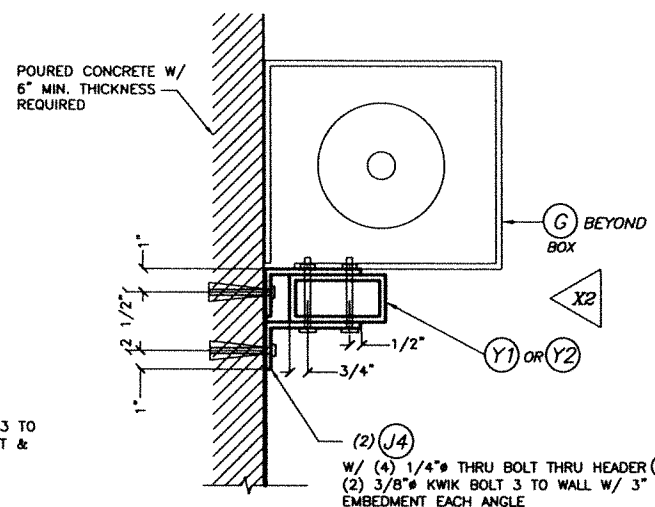

CASE II :
HEADER ANCHORAGE METHOD 2
WALL MOUNTING : SECTION H - H
 SCALE : 1/8" = 1"


NOTE: VALID FOR ALL SPANS AND LOAD COMBINATIONS.

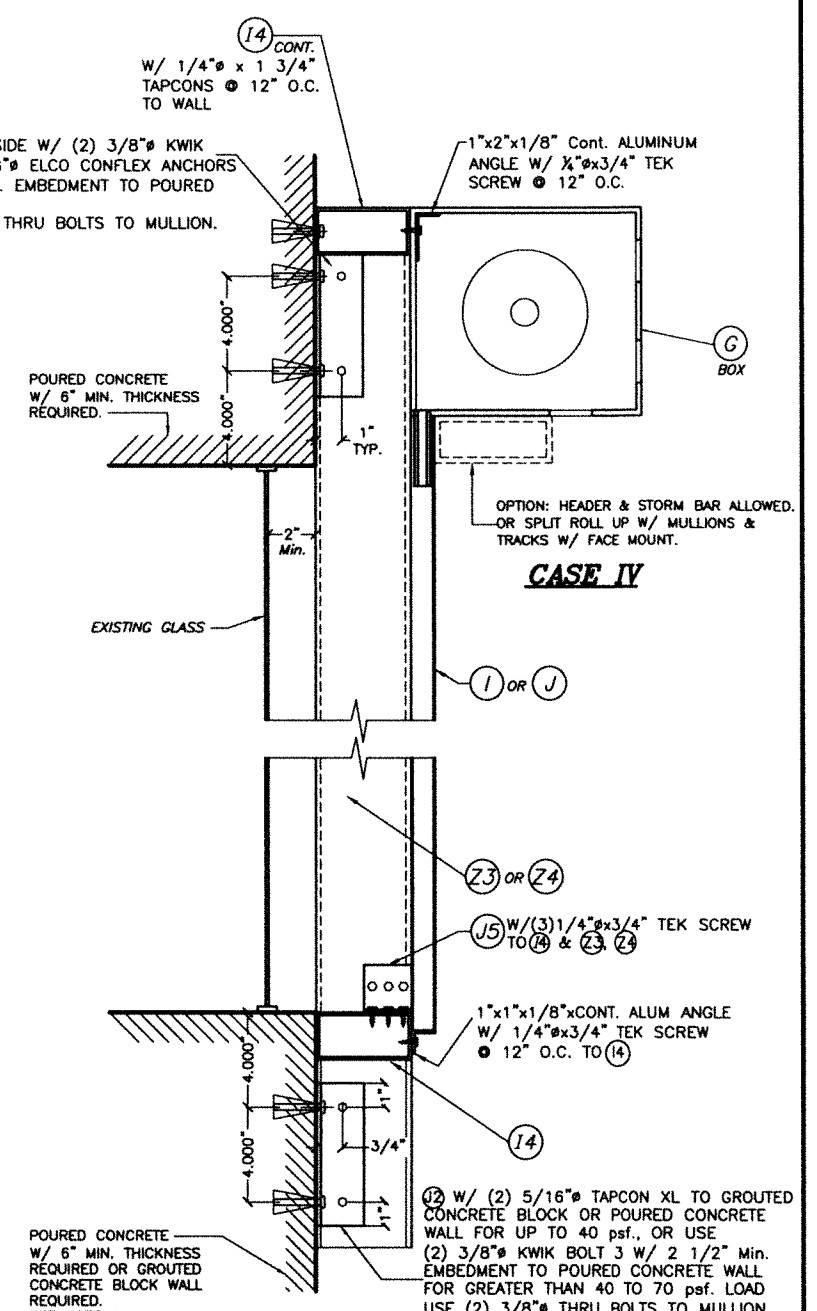


CASES III & IV :
WALL MOUNTING : MULLION CONNECTION
AT TOP & BOTTOM : SECTIONS I - I (W/O HEADER) &
I' - I' (W/HEADER)
 SCALE : 1/8" = 1"

WALTER A. TILLIT JR.
 LICENSE
 No. 44167
 STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 P.E. SEAL/SIGNATURE/DATE


FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2023 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM WITH END RETENTION 55mm SLAT LARGE MISSILE IMPACT RESISTANT		
TILTECO INC.			ROLLINGSHIELD Inc.		
TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719			9875 NW 79th AVE. HIALEAH GARDENS MIAMI, FL. 33016		
WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167			W.H DRAWN BY: 07/24/2023 DATE: 23-119 DRAWING No.		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-

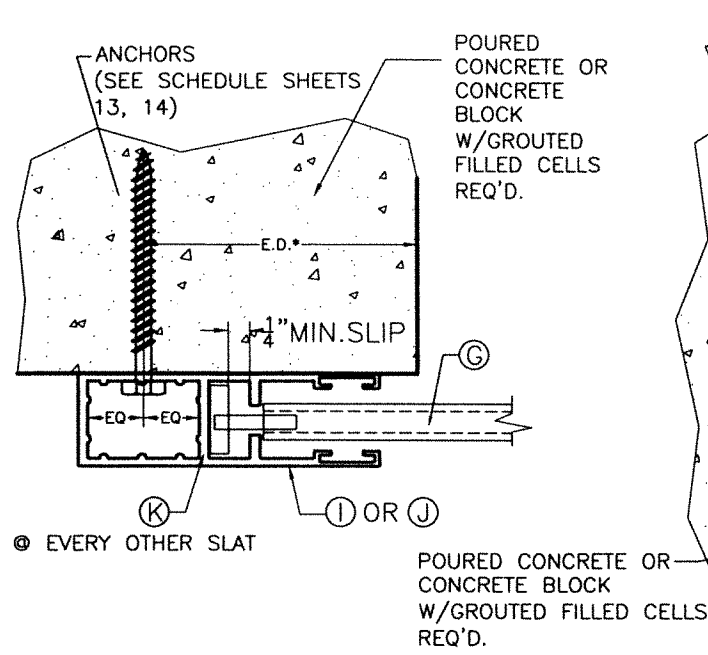


SECTION J-J : WALL MOUNT

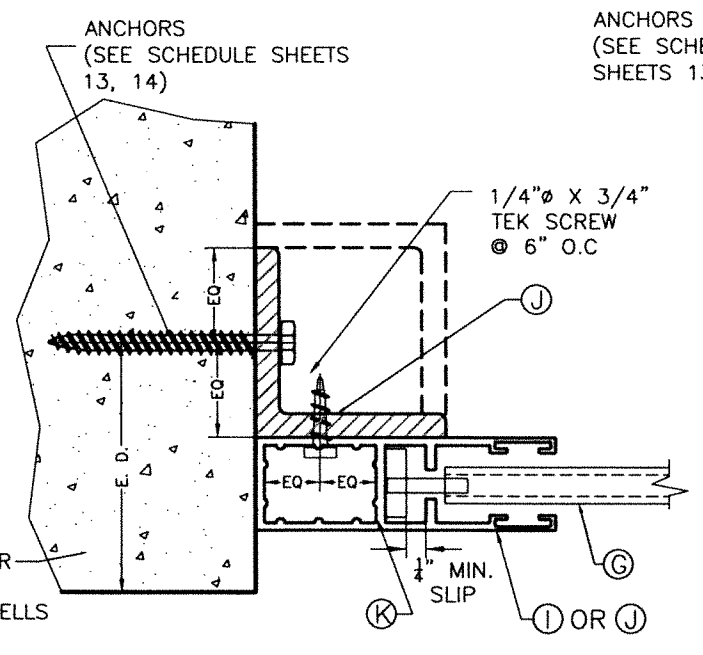


SECTION K-K: INSIDE MOUNT

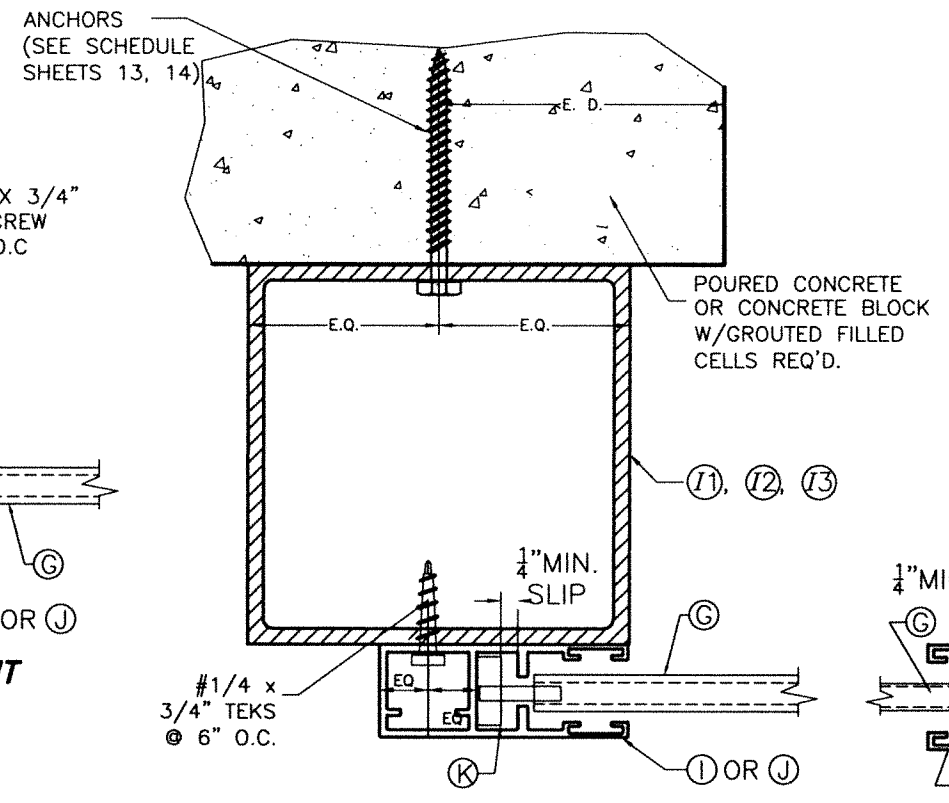


SECTION L-L: BUILD-OUT MOUNT

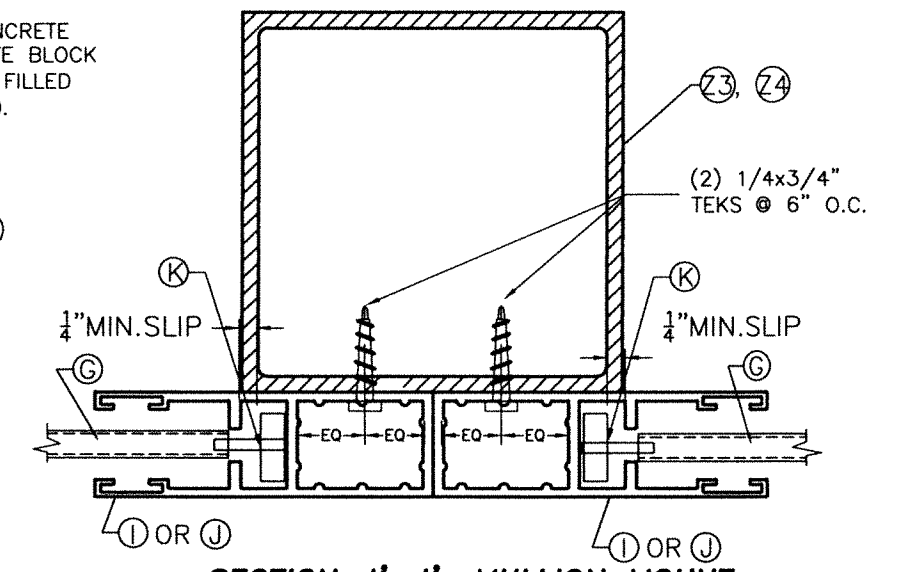

SECTION J'-J': MULLION MOUNT FACE MOUNT

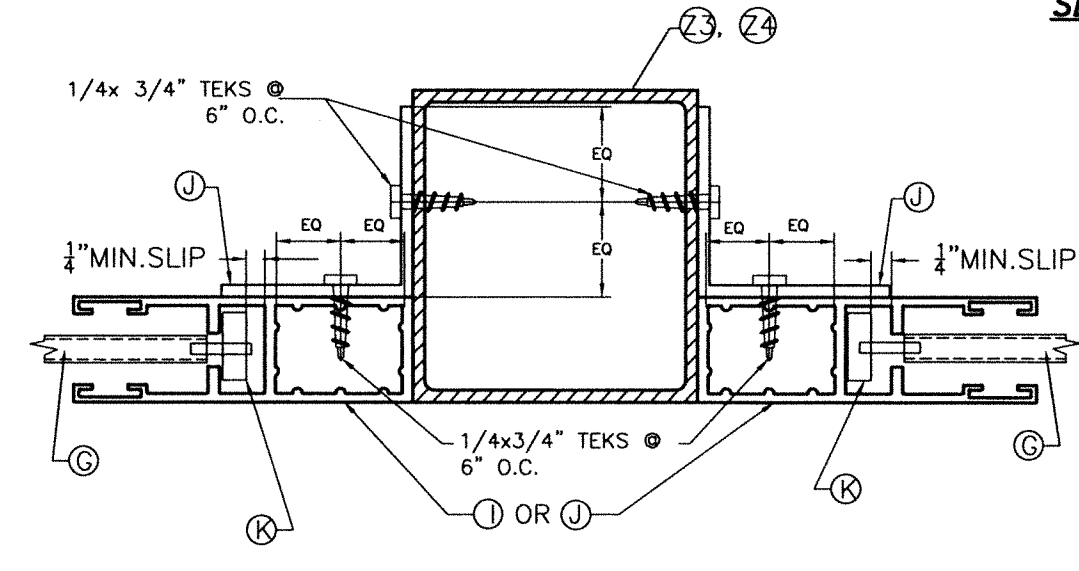

SECTION K'-K': MULLION MOUNT (INSIDE MOUNT)

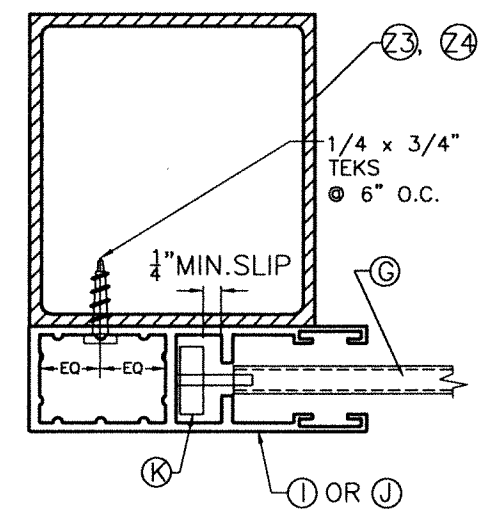

SECTION J''-J'': MULLION MOUNT (FACE MOUNT)

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2023 TILTECO, INC. TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167			IMPACT PROTECTIVE ROLLING SYSTEM WITH END RETENTION 55mm SLAT LARGE MISSILE IMPACT RESISTANT ROLLINGSHIELD Inc. 9875 NW 79th AVE. HIALEAH GARDENS MIAMI, FL. 33016		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-
			W.H DRAWN BY: 07/24/2023 DATE: 23-119 DRAWING No. SHEET 12 OF 15		

CASE I : SIDE RAIL ANCHOR SCHEDULE # 2**

MAXIMUM ALLOWABLE DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM ANCHOR SPACING (in) * FOR SIDE RAILS (I) & (J) CONNECTIONS WITH SINGLE SPAN END RETENTION SLAT TO POURED CONCRETE OR GROUTED CONCRETE BLOCK WITHOUT STORM BARS OR HEADERS OR MULLIONS
(USE NEGATIVE PRESSURE VALUES AS PER ASCE 7-16)

MAXIMUM ALLOWABLE DESIGN LOAD "W" (p.s.f.)	SIDE RAIL (I, J) FOR 55mm SLAT ONLY		SIDE RAIL (I, J) FOR 55mm SLAT ONLY	
	WALL/TRAPPED/BUILD-OUT MOUNTED		WALL/TRAPPED/BUILD-OUT MOUNTED	
	POURED CONCRETE	GROUTED CONCRETE BLOCK	POURED CONCRETE	GROUTED CONCRETE BLOCK
	3/8" CONFLEX	3/8" Kwik Bolt 3	5/16" ULTRACON OR TAPCON XL	5/16" ULTRACON OR TAPCON XL
200 p.s.f. OR LESS	4" O.C **	4" O.C **	4" O.C **	4" O.C **

NOTE:

** SEE MAXIMUM SPAN FOR SLAT (G) ON SHEET 14 FOR POURED CONCRETE OR CONCRETE BLOCK WALL W/ GROUTED CELLS AND FOR EACH TYPE OF MOUNTING AND ANCHOR TYPE GIVEN A DESIGN WIND LOAD.

CASES II , III & IV : SIDE RAIL ANCHOR SCHEDULE # 1

MAXIMUM ALLOWABLE DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM ANCHOR SPACING (in) * FOR SIDE RAILS (I) & (J) CONNECTIONS TO GROUTED FILLED CONCRETE BLOCK OR POURED CONCRETE FOR INSTALLATIONS WITH STORM BARS & HEADERS OR SINGLE SPAN BETWEEN MULLIONS WITH MAX. SPAN PER CHART II ON THIS SHEET
(USE NEGATIVE PRESSURE VALUES AS PER ASCE 7-16)


MAXIMUM ALLOWABLE DESIGN LOAD "W" (p.s.f.)	SIDE RAIL (I) & (J) USE ONLY 1/8" TAPCONS ANCHORS SEE NOTE 7/1 FOR 55mm SLAT ONLY		
	WALL MOUNT	INSIDE MOUNT	BUILD-OUT MOUNT
70 OR LESS	6"	6"	6"

CASES II , III & IV : CHART II

SLAT PERFORMANCE CHART FOR 55mm SLATS W/STORM BARS + HEADERS OR IN BETWEEN MULLIONS (SINGLE SPAN) WITHOUT STORM BARS & HEADER

MAXIMUM A.S.D. DESIGN PRESSURE RATING (p. s. f.) AND CORRESPONDING MAXIMUM SLAT SPAN "L" FOR (G) SLAT
(USE POSITIVE VALUES AS PER ASCE 7-16)

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	MAXIMUM SLAT SPAN	MINIMUM SEPARATION TO GLASS	
	SINGLE & MULTIPLE UNIT *	SINGLE & MULTIPLE UNIT **	SINGLE & MULTIPLE UNIT ***
	(G)	(G)	(G)
70.0 OR LESS	5'-6"	3"	3"

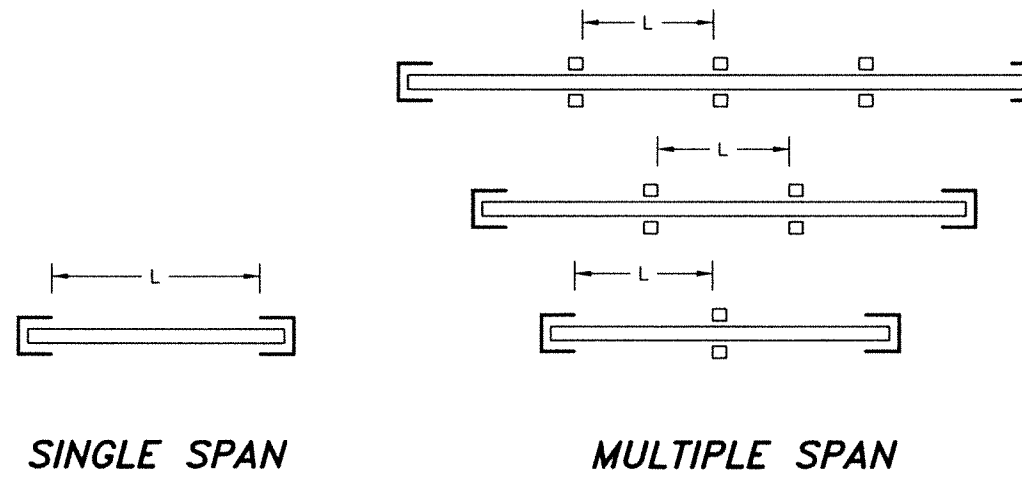


SINGLE SPAN

MULTIPLE SPAN

SPAN LAYOUT

- * SPANS VALID FOR EVERY INSTALLATION LOCATED AT ANY ELEVATION OF BUILDING MEASURED AT BOTTOM OF SHUTTER.
MINIMUM SEPARATION TO GLASS FOR SINGLE AND MULTIPLE UNITS SHALL BE MEASURED FROM BACK OF SLAT TO GLASS.
- ** MINIMUM SEPARATION TO GLASS FOR SHUTTERS INSTALLED BELOW 30'-0" ELEVATION OF BUILDING, MEASURED AT BOTTOM OF SHUTTER.
- *** MINIMUM SEPARATION TO GLASS FOR SHUTTERS INSTALLED ABOVE 30'-0" ELEVATION OF BUILDING, MEASURED AT BOTTOM OF SHUTTER.

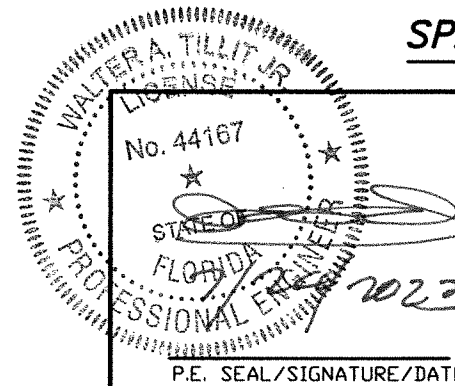

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2023 TILTECO, INC. TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL. 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167			IMPACT PROTECTIVE ROLLING SYSTEM WITH END RETENTION 55mm SLAT LARGE MISSILE IMPACT RESISTANT		W.H DRAWN BY:
			ROLLINGSHIELD Inc. 9875 NW 79th AVE. HIALEAH GARDENS MIAMI, FL. 33016		07/24/2023 DATE:
					23-119 DRAWING No.
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-
					SHEET 13 OF 15

SCHEDULE Vc:
Vx FORCES (Lb/FT) & Vy FORCES (Lb/FT) ACTING AT JAMBS FOR AN A.S.D. DESIGN LOAD RANGE, SLAT SPAN
RANGE FOR POURED CONCRETE OR GROUT FILLED CELL CONCRETE BLOCK WALL BUILDINGS *, APPLICABLE ONLY TO CASE I PER SHEET 7
(USE MAXIMUM VALUE BETWEEN POSITIVE AND NEGATIVE A.S.D. LOAD)

MAXIMUM A.S.D. DESIGN PRESSURE RATING (psf)	SLAT SPAN RANGE															
	0'-4'		> 4'-5'		> 5'-6'		> 6'-7'		> 7'-8'		> 8'-12'		> 12'-16'		> 16'-19'-3"	
	Vx	Vy	Vx	Vy	Vx	Vy	Vx	Vy	Vx	Vy	Vx	Vy	Vx	Vy	Vx	Vy
≤ 70	0	140	15	175	422	210	739	245	1015	280	1994	420	2929	560	3687	674
>71-80	0	160	116	200	540	240	879	280	1100	320	2262	480	3304	640	-	-
>81-105	0	210	353	263	827	315	1223	368	1584	420	2915	630	-	-	-	-
>106-120	0	240	490	300	995	360	1425	420	1820	480	3296	720	-	-	-	-
>121-140	0	280	689	350	1215	420	1689	490	2130	560	-	-	-	-	-	-
>141-160	76	320	845	400	1432	480	1949	560	2435	640	-	-	-	-	-	-
>161-170	147	340	932	425	1539	510	2078	595	-	-	-	-	-	-	-	-
>171-180	216	360	1018	450	1645	540	2205	630	-	-	-	-	-	-	-	-
>181-190	285	380	1103	475	-	-	-	-	-	-	-	-	-	-	-	-
>191-200	352	400	-	-	-	-	-	-	-	-	-	-	-	-	-	-


*** NOTE:**
IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR OR PERMIT HOLDER TO VERIFY THAT EXISTING STRUCTURE IS DESIGNED TO SUPPORT Vx AND Vy FORCES IN POUNDS PER UNIT FOOT OF PRODUCT HEIGHT AT BOTH JAMBS. SEE THIS SHEET FOR Vx & Vy VALUES.

SIDE RAIL

Vy

Vy

Vx

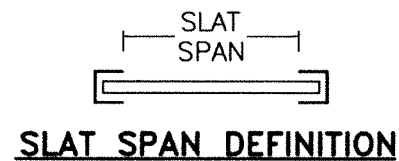

WALTER A. TILLIT JR.
LICENSE
No. 44167
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2023 TILTECO, INC. TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL. 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167			IMPACT PROTECTIVE ROLLING SYSTEM WITH END RETENTION 55mm SLAT LARGE MISSILE IMPACT RESISTANT ROLLINGSHIELD Inc. 9875 NW 79th AVE. HIALEAH GARDENS MIAMI, FL. 33016		
REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-
				W.H DRAWN BY:	
				07/24/2023 DATE:	
				23-119 DRAWING No.	
SHEET 13A OF 15					

CASE I: SINGLE UNIT PRODUCT W/ 55mm SLATⓄ(END RETENTION WITHOUT STORM BARS, HEADERS OR MULLIONS): SEE SHT. 7 FOR ELEVATION

Ⓞ SLAT PERFORMANCE CHARTS (POURED CONCRETE)


SLAT PERFORMANCE CHARTS Ia, Ib, Ic: (ONLY VALID FOR 1/4" SLIP)
FOR A GIVEN A.S.D. DESIGN LOAD (p.s.f) PRODUCT MOUNT CONDITION INCLUDING ANCHOR TYPE

	CHART Ia				CHART Ib				CHART Ic
	USE MAXIMUM VALUE BETWEEN POSITIVE AND NEGATIVE A.S.D. LOAD								USE MAXIMUM POSITIVE A.S.D. LOAD VALUE
	<u>3/8"Ø ELCO CONFLEX ANCHOR</u>				<u>5/16"Ø ULTRACON OR 5/16"Ø TAPCON XL ANCHOR</u>				
MAX. A.S.D. DESIGN PRESSURE RATING (psf)	MAX. SLAT SPAN "LMAX." (FT)				MAX. SLAT SPAN "LMAX." (FT)				REQUIRED MIN. SEPARATION TO GLASS MEASURED TO BACK OF SLAT (in)
	WALL MOUNT SEE NOTES *	TRAPPED MOUNT SEE NOTES *	BUILD-OUT MOUNT W/ Ⓢ & Ⓢ SEE NOTES *	BUILD-OUT MOUNT W/ Ⓢ SEE NOTES *	WALL MOUNT SEE NOTES *	TRAPPED MOUNT SEE NOTES *	BUILD-OUT MOUNT W/ Ⓢ & Ⓢ SEE NOTES *	BUILD-OUT MOUNT W/ Ⓢ SEE NOTES *	
70.0	19'-3"	19'-3"	19'-3"	16'-0"	12'-0"	12'-0"	12'-0"	9'-0"	18"
75.0	17'-6"	17'-6"	17'-6"	14'-6"	10'-9"	10'-9"	10'-9"	7'-9"	16"
80.0	16'-0"	16'-0"	16'-0"	13'-6"	9'-10"	9'-3"	9'-3"	7'-3"	14"
85.0	14'-6"	14'-6"	14'-6"	13'-2"	9'-9"	9'-9"	9'-9"	6'-9"	13"
90.0	13'-6"	13'-6"	13'-6"	12'-6"	9'-2"	9'-2"	9'-2"	6'-2"	12"
95.0	12'-6"	12'-6"	12'-6"	11'-6"	9'-1"	9'-1"	9'-1"	6'-1"	11"
100.0	11'-6"	11'-6"	11'-6"	10'-6"	8'-9"	8'-9"	8'-9"	5'-9"	10"
105.0	10'-6"	10'-6"	10'-6"	9'-6"	8'-4"	8'-4"	8'-4"	5'-4"	9"
110.0	9'-10"	9'-10"	9'-10"	9'-2"	8'-0"	8'-0"	8'-0"	5'-0"	8 1/2"
115.0	9'-2"	9'-2"	9'-2"	8'-6"	7'-10"	7'-10"	7'-10"	4'-10"	8"
120.0	8'-6"	8'-6"	8'-6"	7'-10"	7'-10"	7'-10"	7'-10"	4'-8"	7"
130.0	7'-6"	7'-6"	7'-6"	6'-3"	6'-6"	6'-6"	6'-6"	4'-7"	6 1/2"
140.0	7'-3"	7'-3"	7'-3"	6'-3"	6'-3"	6'-3"	6'-3"	4'-6"	6"
150.0	7'-0"	7'-0"	7'-0"	5'-9"	6'-0"	6'-0"	6'-0"	4'-3"	6"
160.0	6'-9"	6'-9"	6'-9"	5'-6"	5'-9"	5'-9"	5'-9"	4'-0"	5 1/2"
170.0	6'-6"	6'-6"	6'-6"	5'-3"	5'-6"	5'-6"	5'-6"	4'-0"	5 1/2"
180.0	6'-3"	6'-3"	6'-3"	5'-0"	5'-3"	5'-3"	5'-3"	4'-0"	5"
190.0	5'-0"	5'-0"	5'-0"	4'-6"	4'-6"	4'-6"	4'-6"	4'-0"	4 1/2"
200.0	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4"

* NOTES:

- ABOVE INDICATED MAX. SLAT SPANS MAY BE USED AS LONG AS ANCHOR SPACING SCHEDULES ON SHEET 13 (SCHEDULE # 2) INDICATE THAT AN ANCHOR SPACING IS AVAILABLE FOR THE CORRESPONDING SLAT SPAN AND DESIGN LOAD.
- REQUIRES SIDE RAILS FASTENED TO EXISTING STRUCTURE WITH 3/8"Ø ELCO CONFLEX ANCHOR OR 5/16"Ø ULTRACON OR TAPCON XL ANCHOR, INTO POURED CONCRETE. VALID FOR WALL MOUNTED, TRAPPED MOUNTED, AND BUILD-OUT MOUNTED SLATS SEE NOTE 7/1.
- MAXIMUM SLAT SPANS FOR INTERMEDIATE LOADS MAY BE DETERMINED BY LINEAR INTERPOLATION BETWEEN END VALUES.

SLAT SPAN



SLAT SPAN DEFINITION

CASE I: END RETENTION SYSTEM W/ SINGLE SPAN SLATS
W/ TRACKS ATTACHED TO EXISTING WALL
W/O STORM BARS/HEADER/MULLION.
(POURED CONCRETE OR GROUT FILLED CONCRETE BLOCK)


Ⓞ SLAT PERFORMANCE CHARTS (GROUTED POURED CONCRETE)

SLAT PERFORMANCE CHARTS Ia, Ib, Ic: (ONLY VALID FOR 1/4" SLIP)
FOR A GIVEN A.S.D. DESIGN LOAD (p.s.f) PRODUCT MOUNT CONDITION INCLUDING ANCHOR TYPE

	CHART Ia				CHART Ib				CHART Ic
	USE MAXIMUM VALUE BETWEEN POSITIVE AND NEGATIVE A.S.D. LOAD								USE MAXIMUM POSITIVE A.S.D. LOAD VALUE
	<u>3/8"Ø HILTI KWIK BOLT 3 ANCHOR</u>				<u>5/16"Ø ULTRACON OR 5/16"Ø TAPCON XL ANCHOR</u>				
MAX. A.S.D. DESIGN PRESSURE RATING (psf)	MAX. SLAT SPAN "L _{MAX.} " (FT)				MAX. SLAT SPAN "L _{MAX.} " (FT)				REQUIRED MIN. SEPARATION TO GLASS MEASURED TO BACK OF SLAT (in)
	WALL MOUNT SEE NOTES**	TRAPPED MOUNT SEE NOTES**	BUILD-OUT MOUNT W/ Ⓢ & Ⓢ SEE NOTES**	BUILD-OUT MOUNT W/ Ⓢ SEE NOTES**	WALL MOUNT SEE NOTES**	TRAPPED MOUNT SEE NOTES**	BUILD-OUT MOUNT W/ Ⓢ & Ⓢ SEE NOTES**	BUILD-OUT MOUNT W/ Ⓢ SEE NOTES**	
70.0	12'-0"	12'-0"	12'-0"	9'-0"	12'-0"	12'-0"	12'-0"	9'-0"	12"
75.0	11'-3"	11'-3"	11'-3"	8'-3"	11'-3"	11'-3"	11'-3"	8'-3"	11"
80.0	10'-9"	10'-9"	10'-9"	9'-4"	10'-4"	10'-9"	10'-9"	7'-9"	10"
85.0	10'-3"	10'-3"	10'-3"	7'-3"	10'-3"	10'-3"	10'-3"	7'-3"	9 1/2"
90.0	9'-8"	9'-8"	9'-8"	6'-8"	9'-8"	9'-8"	9'-8"	6'-8"	9"
95.0	9'-6"	9'-6"	9'-6"	6'-6"	9'-7"	9'-7"	9'-7"	6'-7"	9"
100.0	9'-3"	9'-3"	9'-3"	6'-3"	9'-3"	9'-3"	9'-3"	6'-3"	9"
105.0	8'-10"	8'-10"	8'-10"	5'-10"	8'-10"	8'-10"	8'-10"	5'-10"	9"
110.0	8'-6"	8'-6"	8'-6"	5'-6"	8'-6"	8'-6"	8'-6"	5'-6"	8"
115.0	8'-4"	8'-4"	8'-4"	5'-4"	8'-4"	8'-4"	8'-4"	5'-4"	8"
120.0	8'-2"	8'-2"	8'-2"	5'-2"	8'-2"	8'-2"	8'-2"	5'-2"	7"
130.0	7'-0"	7'-0"	7'-0"	5'-1"	7'-0"	7'-0"	7'-0"	5'-1"	6 1/2"
140.0	6-9"	6-9"	6-9"	5-0"	6-9"	6-9"	6-9"	5-0"	6"
150.0	6'-6"	6'-6"	6'-6"	4'-9"	6'-6"	6'-6"	6'-6"	4'-9"	6"
160.0	6'-3"	6'-3"	6'-3"	4'-6"	6'-3"	6'-3"	6'-3"	4'-6"	5 1/2"
170.0	6'-0"	6'-0"	6'-0"	4'-5"	6'-0"	6'-0"	6'-0"	4'-5"	5 1/2"
180.0	5'-3"	5'-3"	5'-3"	4'-0"	5'-3"	5'-3"	5'-3"	4'-0"	5"
190.0	4'-6"	4'-6"	4'-6"	4'-0"	4'-6"	4'-6"	4'-6"	4'-0"	4 1/2"
200.0	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4'-0"	4"

** NOTES:

- ABOVE INDICATED MAX. SLAT SPANS MAY BE USED AS LONG AS ANCHOR SPACING SCHEDULES ON SHEET 13 (SCHEDULE # 2) INDICATE THAT AN ANCHOR SPACING IS AVAILABLE FOR THE CORRESPONDING SLAT SPAN AND DESIGN LOAD.
- REQUIRES SIDE RAILS FASTENED TO EXISTING STRUCTURE WITH 3/8"Ø HILTI KWIK BOLT 3 ANCHOR OR 5/16"Ø ULTRACON OR TAPCON XL INTO f'c=2500 psi. GROUTED CONCRETE BLOCK. VALID FOR WALL MOUNTED, TRAPPED MOUNTED, AND BUILD-OUT MOUNTED SLATS SEE NOTE 7/1.
- MAXIMUM SLAT SPANS FOR INTERMEDIATE LOADS MAY BE DETERMINED BY LINEAR INTERPOLATION BETWEEN END VALUES.

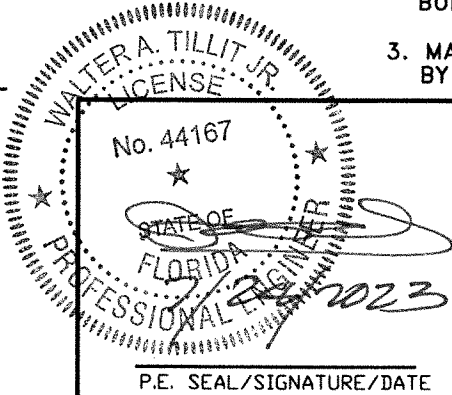

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)					
©2023 TILTECO, INC.			IMPACT PROTECTIVE ROLLING SYSTEM WITH END RETENTION 55mm SLAT LARGE MISSILE IMPACT RESISTANT		
TILTECO INC. TILLIT TESTING & ENGINEERING COMPANY 6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166 Phone : (305)871-1530 . Fax : (305)871-1531 CA-0006719 WALTER A. TILLIT Jr. P.E. FLORIDA Lic. # 44167			ROLLINGSHIELD Inc. 9875 NW 79th AVE. HIALEAH GARDENS MIAMI, FL 33016		
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-
W.H. DRAWN BY:					07/24/2023 DATE:
23-119					DRAWING No.
SHEET 14 OF 15					

CASES II & IV (SEE SHT. 7)

(M1) & (M2) STORM BAR LOADING CHART MAXIMUM A.S.D. DESIGN PRESSURE RATING (p. s. f.) AND CORRESPONDING MAXIMUM SPAN "L" FOR A GIVEN TYPE OF STORM BAR AND STORM BAR SPACING*.

(USE MAXIMUM VALUES BETWEEN POSITIVE AND NEGATIVE A.S.D. LOADS)
MAX. SPAN FOR STORM BARS (M1) OR (M2) W/REGULAR CONCRETE ANCHORS

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	(M1) TYPE 3 STORM BAR 2" x 4" x 1/8"				(M2) TYPE 4 STORM BAR 2" x 4" x 1/4"			
	* STORM BAR SPACING				* STORM BAR SPACING			
	≤ 3'-0"	3' TO 4'	4' TO 5'	5' TO 6'	≤ 3'-0"	3' TO 4'	4' TO 5'	5' TO 6'
45	10'-0"	9'-5"	8'-5"	7'-8"	10'-0"	10'-0"	10'-0"	10'-0"
50	10'-0"	8'-11"	8'-0"	7'-4"	10'-0"	10'-0"	10'-0"	10'-0"
55	9'-10"	8'-6"	7'-7"	7'-0"	10'-0"	10'-0"	10'-0"	10'-0"
60	9'-5"	8'-2"	7'-4"	6'-8"	10'-0"	10'-0"	10'-0"	10'-0"
65	9'-0"	7'-10"	7'-0"	6'-5"	10'-0"	10'-0"	10'-0"	10'-0"
70	8'-9"	7'-7"	6'-9"	6'-2"	10'-0"	10'-0"	10'-0"	9'-9"

* STORM BAR SPACING SHALL BE SUCH THAT MAXIMUM SLAT SPAN SHALL NOT BE EXCEEDED.
THIS TABLE ONLY VALID FOR (M1), (M2) STORM BARS (NOT (M3) (M4) SCHEDULE WHICH ARE BELOW).

CASES II & IV (SEE SHT. 7)

(M3) & (M4) STORM BAR LOADING CHART MAXIMUM A.S.D. DESIGN PRESSURE RATING (p. s. f.) AND CORRESPONDING MAXIMUM SPAN "L" FOR A GIVEN TYPE OF STORM BAR AND STORM BAR SPACING.
(USE MAXIMUM VALUES BETWEEN POSITIVE AND NEGATIVE A.S.D. LOADS)
MAX. SPAN FOR STORM BARS (M3) OR (M4) W/SPRING-LOADED SYSTEM

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	(M3) TYPE 3 STORM BAR 2" x 4" x 1/8"		(M4) TYPE 4 STORM BAR 2" x 4" x 1/4"	
	* STORM BAR SPACING		* STORM BAR SPACING	
	≤ 3'-0"	3' TO 4'	≤ 3'-0"	3' TO 4'
40 OR LESS	10'-0"	7'-9"	10'-4"	7'-9"
45	9'-2"	6'-11"	9'-2"	6'-11"
50	8'-3"	6'-2"	8'-3"	6'-2"
55	7'-6"	5'-8"	7'-6"	5'-8"
60	6'-11"	5'-2"	6'-11"	5'-2"
65	6'-4"	4'-9"	6'-4"	4'-9"
70	5'-11"	4'-5"	5'-11"	4'-5"

* STORM BAR SPACING SHALL BE SUCH THAT MAXIMUM SLAT SPAN SHALL NOT BE EXCEEDED.
THIS TABLE IS ONLY VALID FOR M3 & M4 REMOVABLE STORM BARS WITH SPRING LOADED SYSTEM.

APPLICABLE SCHEDULES FOR CASES II, III & IV (SEE SHT. 7)

CASES II & IV (SEE SHT. 7)

HEADER LOADING CHART MAXIMUM A.S.D. DESIGN PRESSURE RATING (p. s. f.) AND CORRESPONDING MAXIMUM SPAN "L" FOR A GIVEN TYPE OF HEADER.

(USE MAXIMUM VALUES BETWEEN POSITIVE AND NEGATIVE A.S.D. LOADS)

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	(Y1) TYPE 3 HEADER 2" x 4" x 1/4"			(Y2) TYPE 3 HEADER 2" x 6" x 1/4"		
	STORM BAR HEIGHT *			STORM BAR HEIGHT *		
	≤ 6'-0"	6' TO 8'	8' TO 10'	≤ 6'-0"	6' TO 8'	8' TO 10'
45.0	12'-0"	12'-0"	12'-0"	18'-0"	18'-0"	18'-0"
50.0	12'-0"	12'-0"	12'-0"	18'-0"	18'-0"	17'-10"
55.0	12'-0"	12'-0"	12'-0"	18'-0"	18'-0"	17'-0"
60.0	12'-0"	12'-0"	11'-9"	18'-0"	18'-0"	16'-3"
65.0	12'-0"	12'-0"	11'-4"	18'-0"	17'-6"	15'-8"
70.0	12'-0"	12'-0"	10'-10"	18'-0"	16'-10"	15'-0"

* STORM BAR HEIGHT PER CHART ON THIS SHEET.

CASES III & IV (SEE SHT. 7)

MULLION LOADING CHART MAXIMUM A.S.D. DESIGN PRESSURE RATING (p. s. f.) AND CORRESPONDING MAXIMUM SPAN "L"(Ft) FOR A GIVEN TYPE OF MULLION AND MULLION SPACING (Ft.).
(USE MAXIMUM VALUES BETWEEN POSITIVE AND NEGATIVE A.S.D. LOADS)

MAX. A.S.D. DESIGN PRESSURE RATING (p.s.f.)	(Z3) TYPE 2 MULLION * 4" x 4" x 1/4"			(Z4) TYPE 3 MULLION * 4" x 6" x 1/4"					
	MULLION SPACING			MULLION SPACING					
	< 4'-0"	4' TO 5'	5' TO 6'	< 4'-0"	4' TO 5'	5' TO 6'	6' TO 8'	8' TO 10'	10' TO 12'
45.0	11'-0"	10'-6"	9'-11"	15'-8"	14'-7"	11'-0"	11'-0"	11'-0"	11'-0"
50.0	10'-11"	10'-2"	9'-7"	15'-2"	14'-1"	11'-0"	11'-0"	11'-0"	11'-0"
55.0	10'-7"	9'-10"	9'-3"	14'-8"	13'-7"	11'-0"	11'-0"	11'-0"	11'-0"
60.0	10'-3"	9'-7"	9'-0"	14'-3"	13'-3"	11'-0"	11'-0"	11'-0"	11'-0"
65.0	10'-0"	9'-4"	8'-9"	13'-11"	12'-11"	11'-0"	11'-0"	11'-0"	11'-0"
70.0	9'-9"	9'-1"	8'-6"	13'-7"	12'-7"	11'-0"	11'-0"	11'-0"	11'-0"

* MULLION SPAN LIMITED TO 11'-0" SPAN IF STORM BARS AND HEADERS (CASE IV) USED AT UNIT.
MULLION SPACING SHALL NOT EXCEED SLAT SPAN NOR HEADER SPAN.

WALTER A. TILLIT JR.
No. 44167
STATE OF FLORIDA
PROFESSIONAL ENGINEER
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.
TILTECO INC.
TILLIT TESTING & ENGINEERING COMPANY
8355 N.W. 38th. St., Ste. 305, VIRGINIA GARDENS, FL. 33166
Phone : (305)871-1530 . Fax : (305)871-1531
CA-0006719
WALTER A. TILLIT Jr. P.E.
FLORIDA Lic. # 44167

IMPACT PROTECTIVE ROLLING SYSTEM WITH
END RETENTION 55mm SLAT
LARGE MISSILE IMPACT RESISTANT

ROLLINGSHIELD Inc.

9875 NW 79th AVE.
HIALEAH GARDENS MIAMI, FL. 33016

REV. NO	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 23-004	07/24/23	3	-	-
2	-	-	4	-	-

W.H
DRAWN BY:

07/24/2023
DATE:

23-119

DRAWING No.

SHEET 15 OF 15