

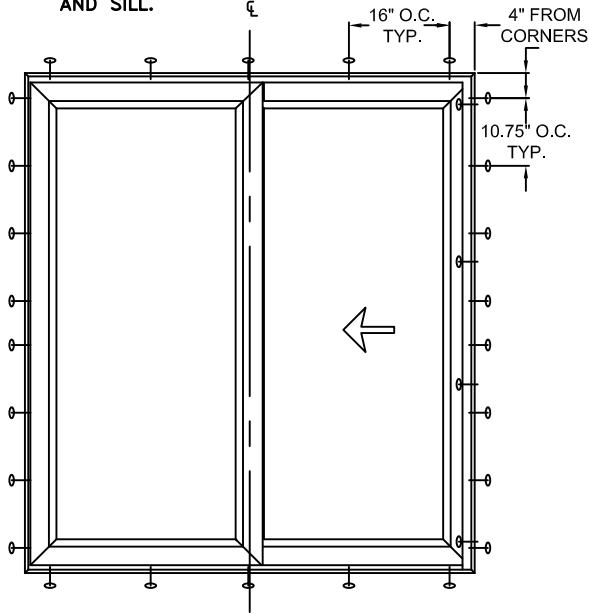


SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

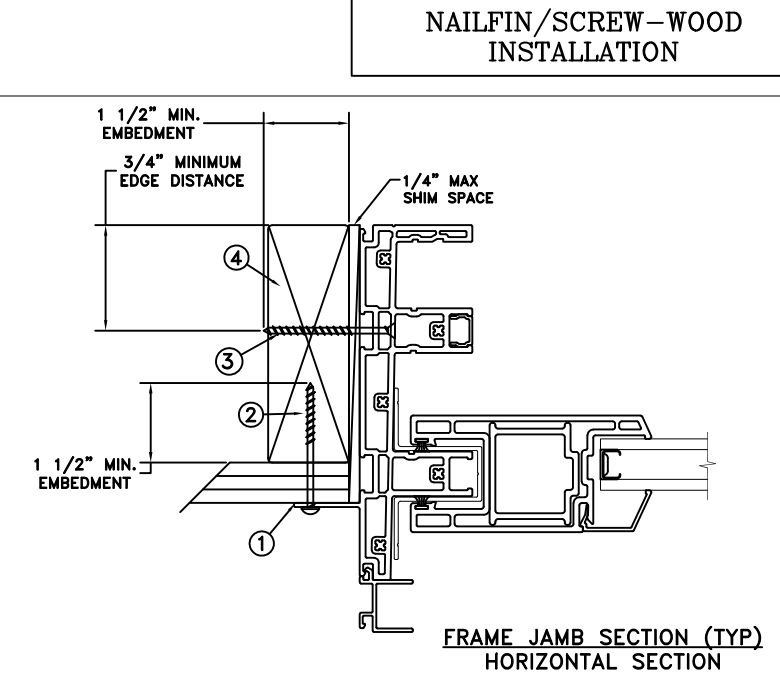

TYPICAL ELEVATION WITH FASTENER SPACING

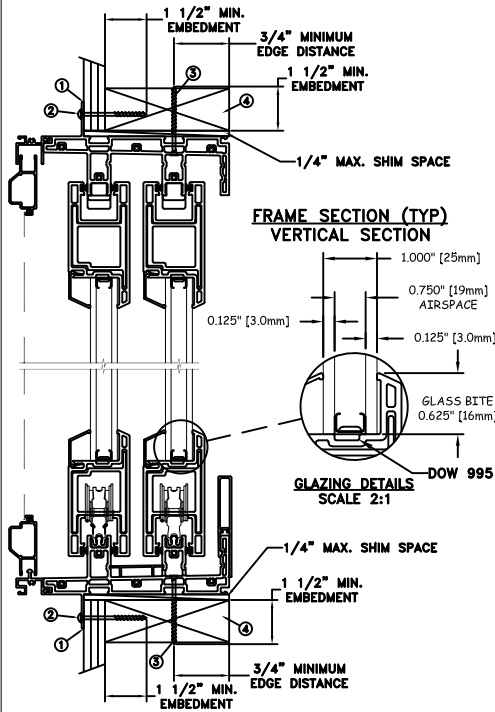

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use #10 PFH or greater fastener through the nailing flange with sufficient length to penetrate a minimum of 1-1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42).
3. Use #10 PFH or greater fastener through the pre-drilled holes in the head, side and sill tracks at the interior tower with sufficient length to penetrate a minimum of 1-1/2" into the wood framing.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 202-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.

Approved impact protective system is required on this product in areas requiring impact resistance.
This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075
11/05/25

DATE: 10/23/2025		3737 LAKEPORT BLVD.	
SCALE: NTS		KLAMATH FALLS OR, 97601	
DRAWN BY: M.HAM		PHONE: (800) 535-3936	
CHECKED BY: D.BELAU		JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684			
REPORT No.: NCTL-210-4150-01		CAD DWG. No.: —	REV: A SHEET 1 of 10


SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

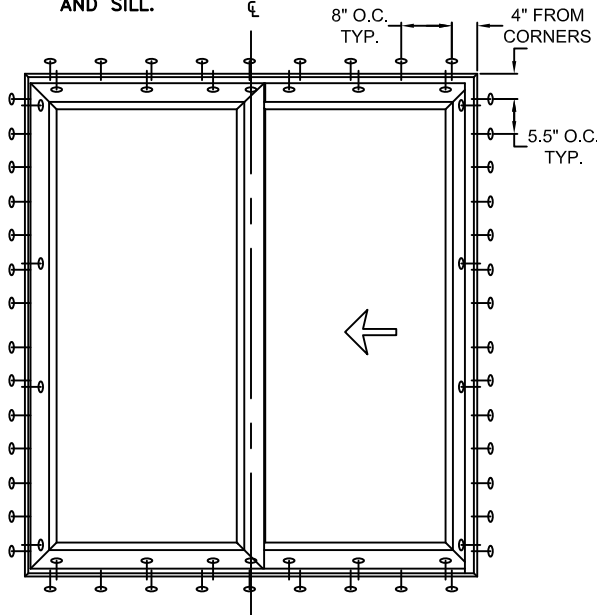

TYPICAL ELEVATION WITH FASTENER SPACING

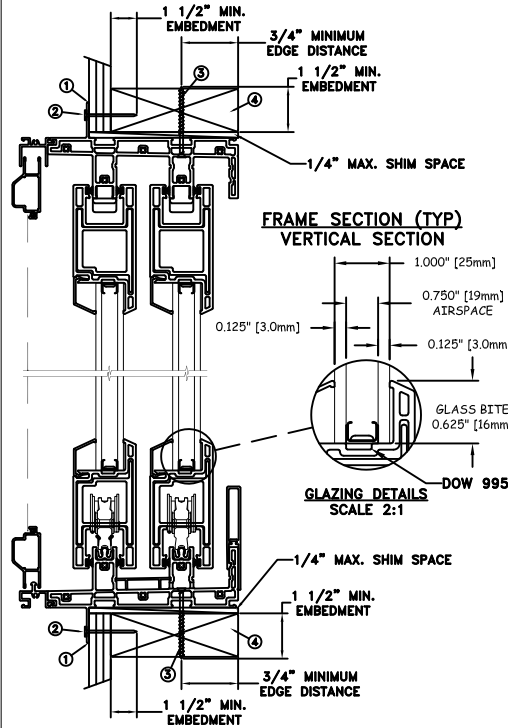

NAILFIN/NAIL-WOOD INSTALLATION

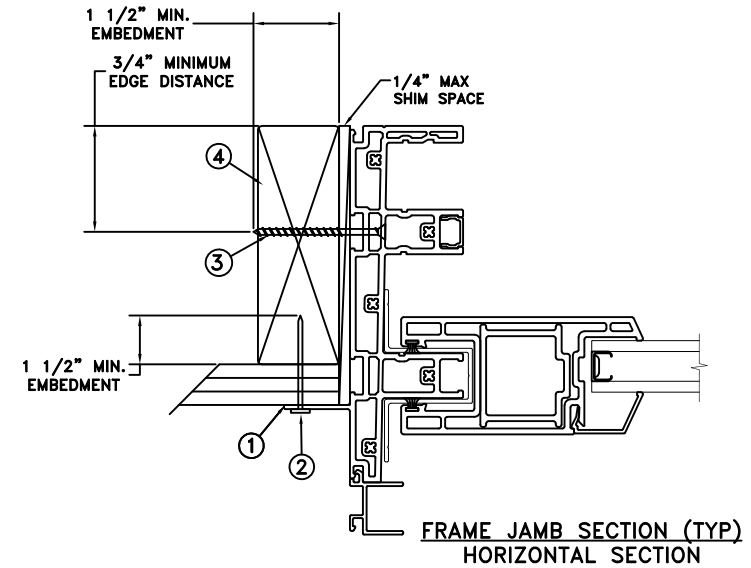

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use 6d (.113" diameter) x 2" nails through the nailing flange into the wood framing beyond. For 2x wood frame substrate (min. S.G. = 0.42).
3. Use #10 PFH or greater fastener through the pre-drilled holes in the head, side and sill tracks at the interior tower with sufficient length to penetrate a minimum of 1-1/2" into the wood framing.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 202-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.

Approved impact protective system is required on this product in areas requiring impact resistance.
This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be
verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075
11/05/25

DATE: 10/23/2025		3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS	JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
CHECKED BY: D.BELAU	TITLE:		
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684			
REPORT No.: NCTL-210-4150-01		CAD DWG. No.: —	REV: A SHEET 2 of 10


SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

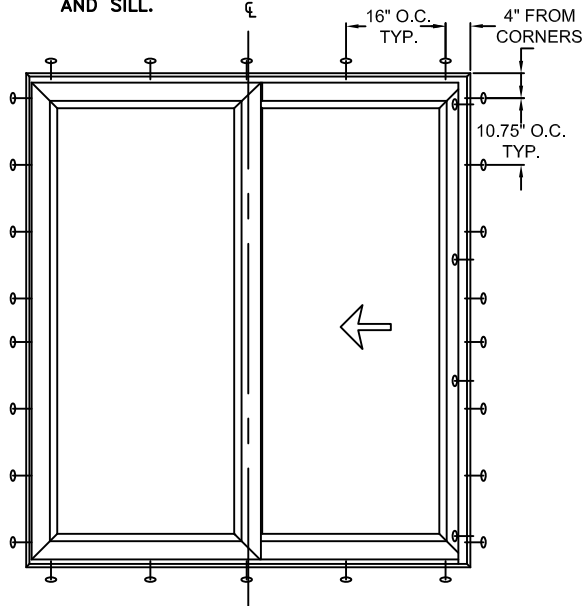

TYPICAL ELEVATION WITH FASTENER SPACING

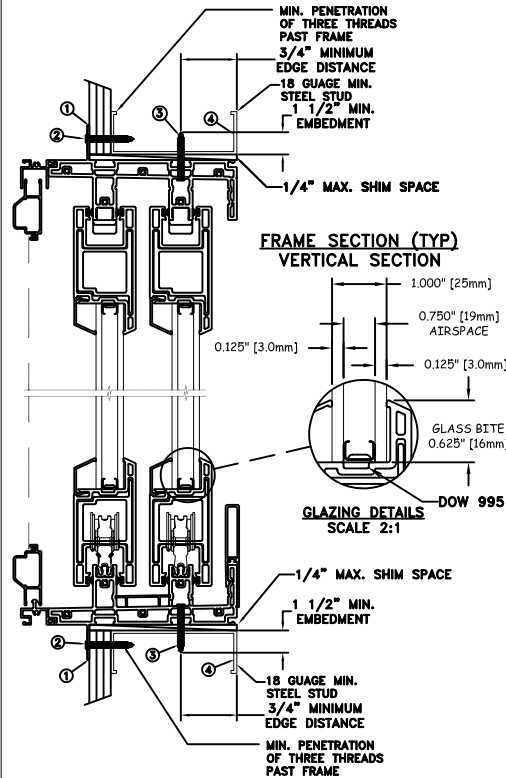

NAILFIN/SCREW-STEEL INSTALLATION

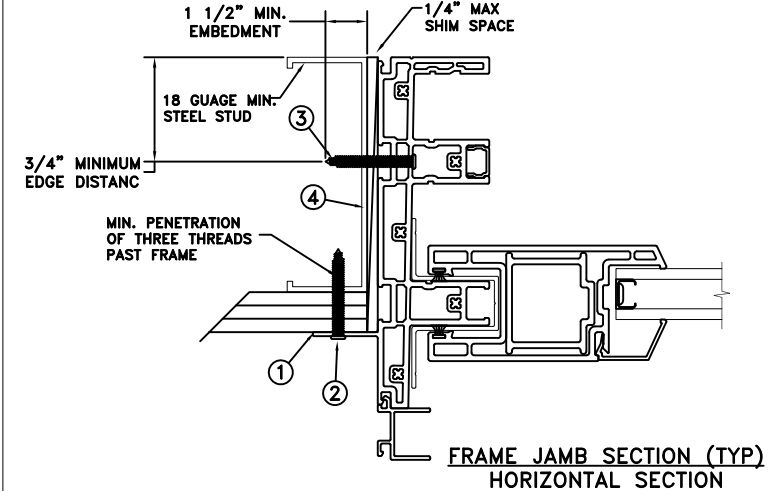

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. For anchoring through nailfin into metal framing use #10 TEK Self-Tapping screws with sufficient length to achieve a minimum penetration of three threads past the frame thickness. Steel substrate min. 18ga., $f_y = 33$ ksi.
3. For anchoring through pre-drilled holes in head, side and sill tracks at interior tower into metal framing use #10 TEK Self-Tapping screws with sufficient length to achieve a minimum penetration of three threads past the frame thickness. Steel substrate min. 18ga., $f_y = 33$ ksi.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 202-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.

7. Approved impact protective system is required on this product in areas requiring impact resistance. This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075
11/05/25

DATE: 10/23/2025		3737 LAKEPORT BLVD.	
SCALE: NTS		KLAMATH FALLS OR, 97601	
DRAWN BY: M.HAM		PHONE: (800) 535-3936	
CHECKED BY: D.BELAU		JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684			
REPORT No.: NCTL-210-4150-01		CAD DWG. No.: —	REV: A SHEET 3 of 10


SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

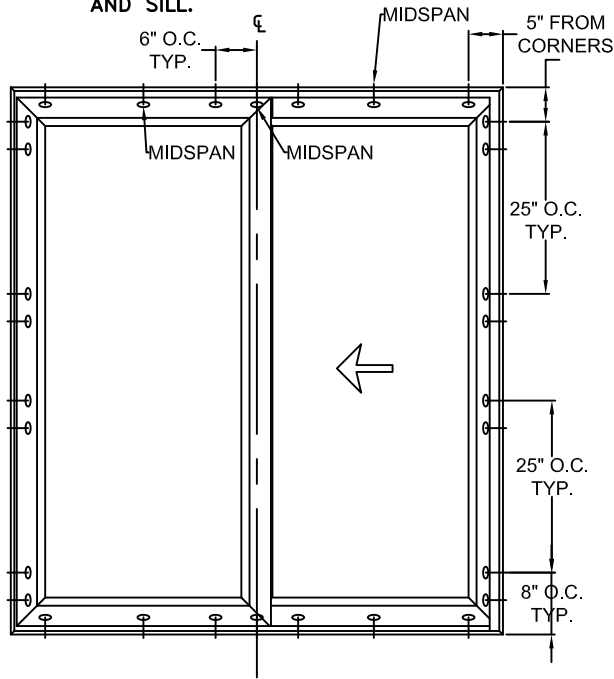

TYPICAL ELEVATION WITH FASTENER SPACING

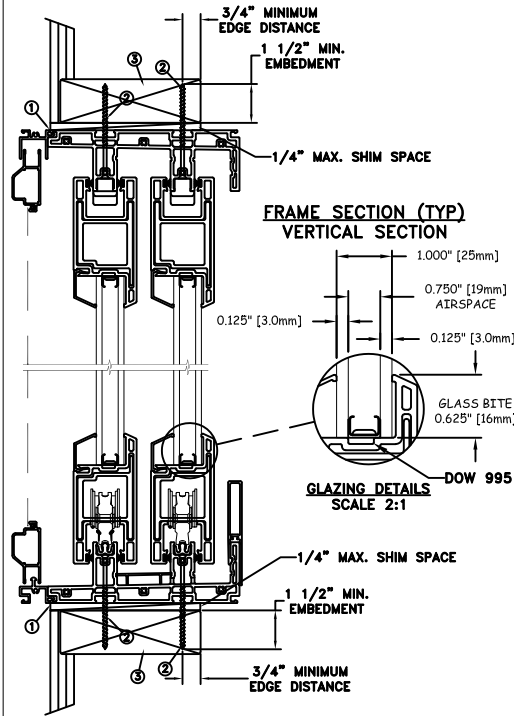

THROUGH FRAME/SCREW WOOD INSTALLATION

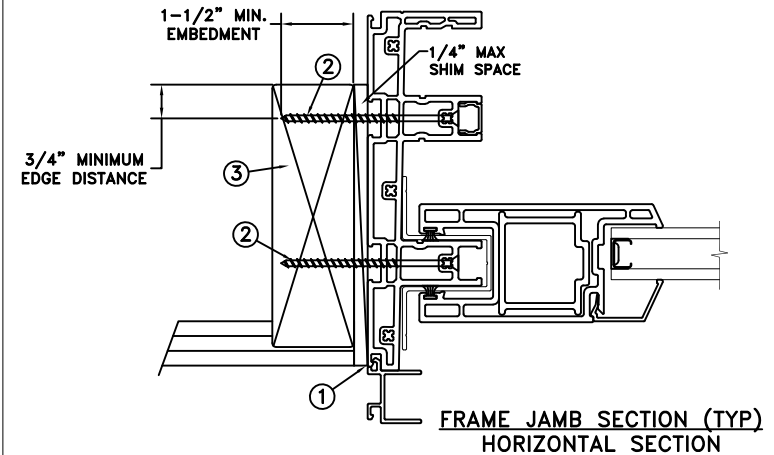

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fasteners are used to anchor the sill (typical).
2. Use #10 PH or greater fastener through the pre-drilled holes in the head, side and sill tracks at interior tower with sufficient length to penetrate a minimum of 1-1/2" into the wood framing. For 2x wood frame substrate (min. S.G. = 0.42).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 202-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.

Approved impact protective system is required on this product in areas requiring impact resistance. This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075
11/05/25

DATE: 10/23/2025		3737 LAKEPORT BLVD.	
SCALE: NTS		KLAMATH FALLS OR, 97601	
DRAWN BY: M.HAM		PHONE: (800) 535-3936	
CHECKED BY: D.BELAU		JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684			
REPORT No.: NCTL-210-4150-01		CAD DWG. No.: —	REV: A SHEET 4 of 10

SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

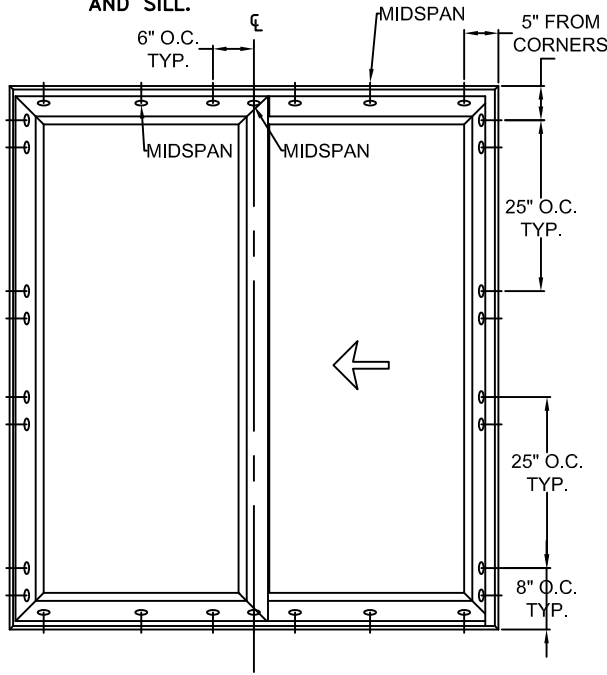


TYPICAL ELEVATION WITH FASTENER SPACING

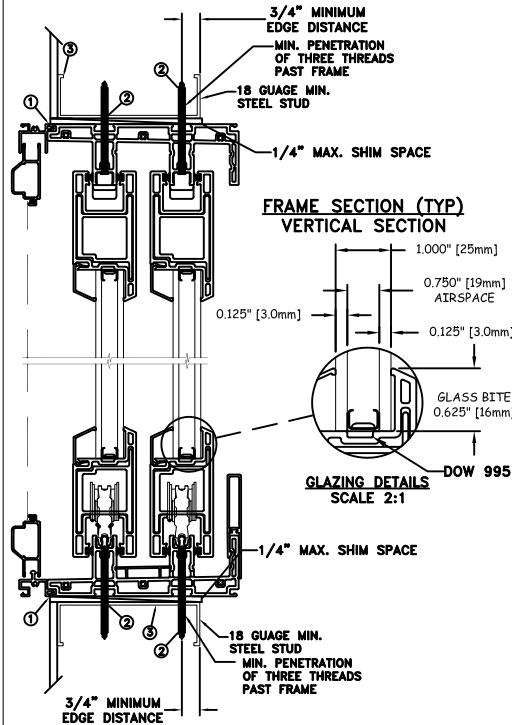

**FRAME SECTION (TYP)
VERTICAL SECTION**

**GLAZING DETAILS
SCALE 2:1**

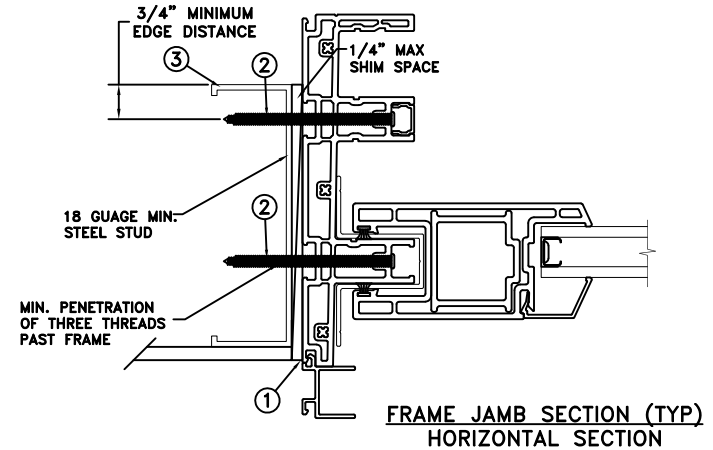

**FRAME JAMB SECTION (TYP)
HORIZONTAL SECTION**

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. For anchoring through the pre-drilled holes in the head, side and sill tracks at interior tower into metal framing use #10 TEK Self-Tapping screws with sufficient length to achieve a minimum penetration of three threads past the frame thickness. Steel substrate min. 18ga., fy = 33 ksi.
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 202-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.

Approved impact protective system is required on this product in areas requiring impact resistance. This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075
11/05/25

DATE: 10/23/2025		3737 LAKEPORT BLVD.	
DRAWN BY: M.HAM		KLAMATH FALLS OR, 97601	
SCALE: NTS		PHONE: (800) 535-3936	
CHECKED BY: D.BELAU		JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684			
REPORT No.: NCTL-210-4150-01		CAD DWG. No.: —	REV: A SHEET 5 of 10


SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

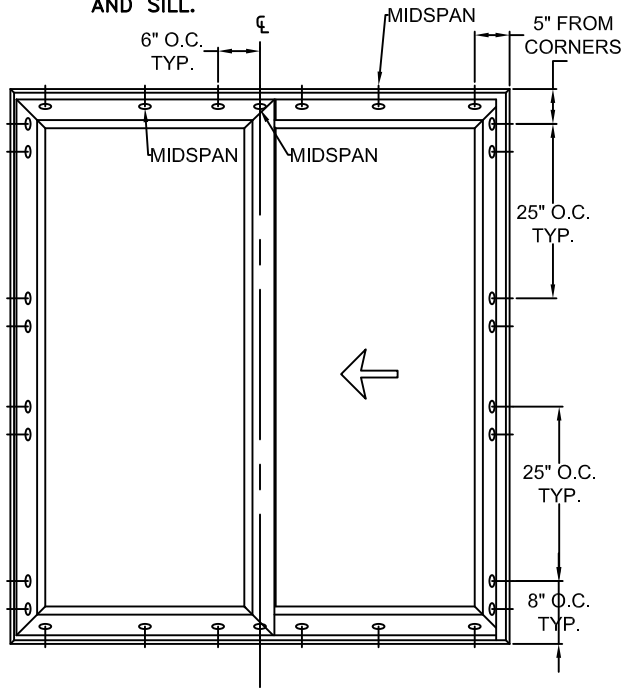

TYPICAL ELEVATION WITH FASTENER SPACING

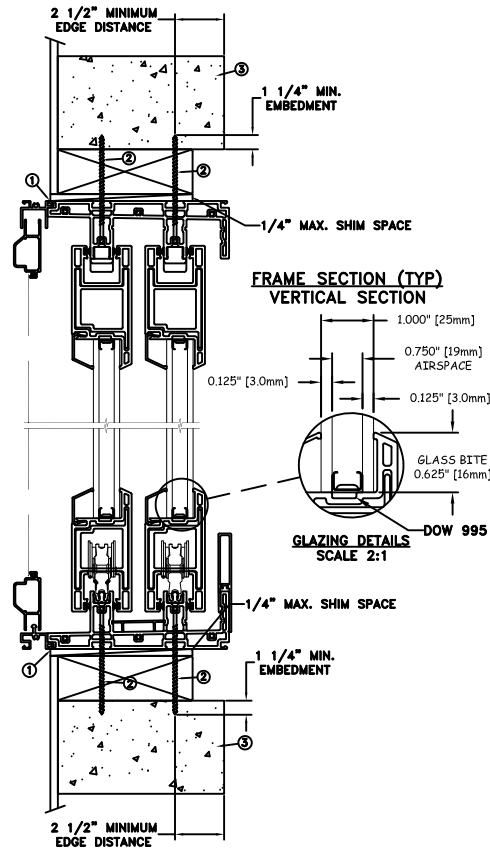

THROUGH FRAME/SCREW
CONCRETE INSTALLATION

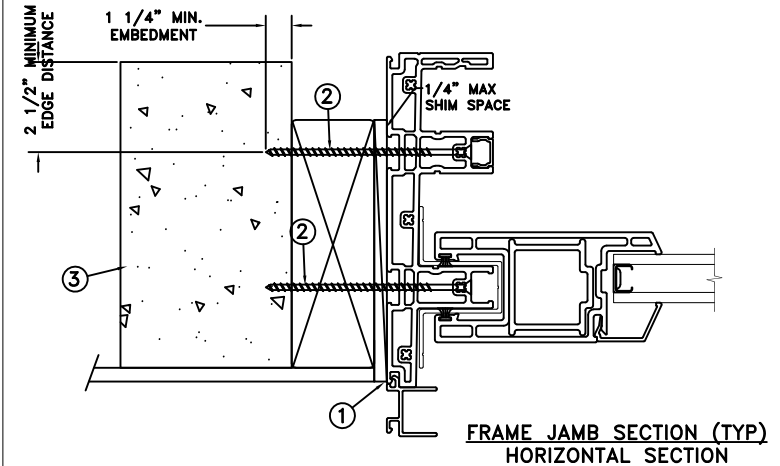

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use 1/4" Tapcon or equivalent fasteners through the pre-drilled holes in the head, side and sill at interior tower with sufficient length to penetrate a minimum of 1-1/4" into concrete or masonry at each location with a 2-1/2" min. from edge distance. For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall be ASTM C90).
3. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. TAS 202-94
6. Product meets High Velocity Hurricane Zone (HVHZ) Requirements.

Approved impact protective system is required on this product in areas requiring impact resistance. This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075
11/05/25

DATE: 10/23/2025		3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS	JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
CHECKED BY: D.BELAU	TITLE:		
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684			
REPORT No.: NCTL-210-4150-01	CAD DWG. No.: —	REV: A	SHEET 6 of 10


SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

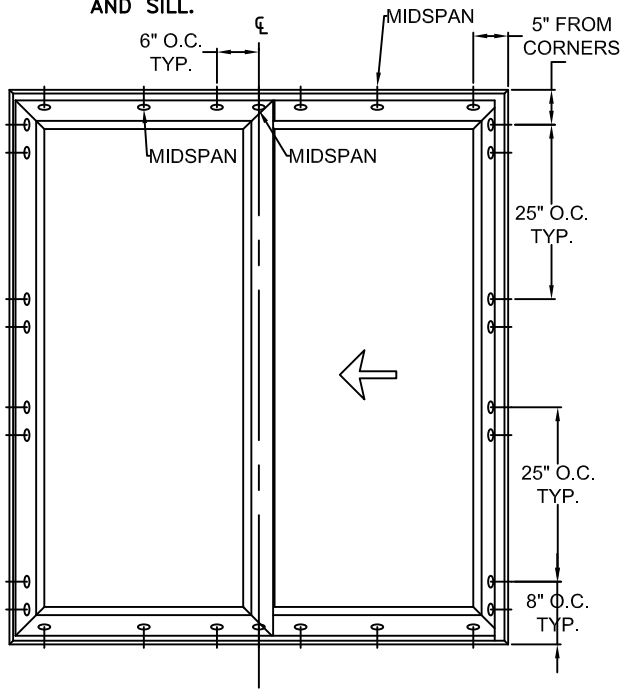

TYPICAL ELEVATION WITH FASTENER SPACING

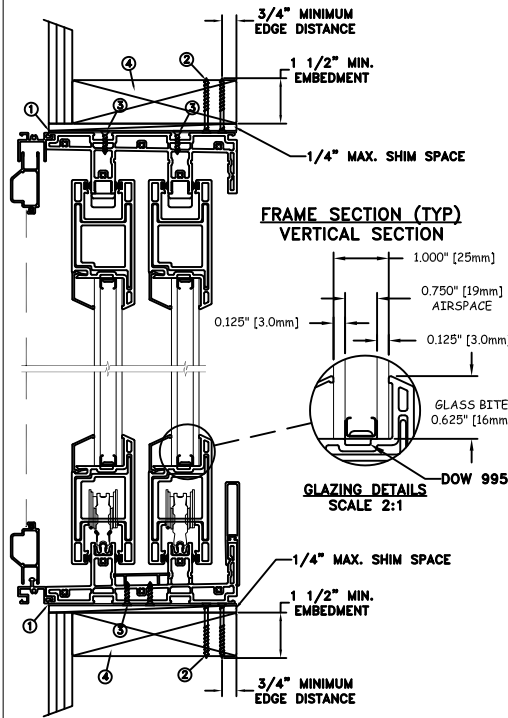

MASONRY STRAP WOOD/SCREW INSTALLATION

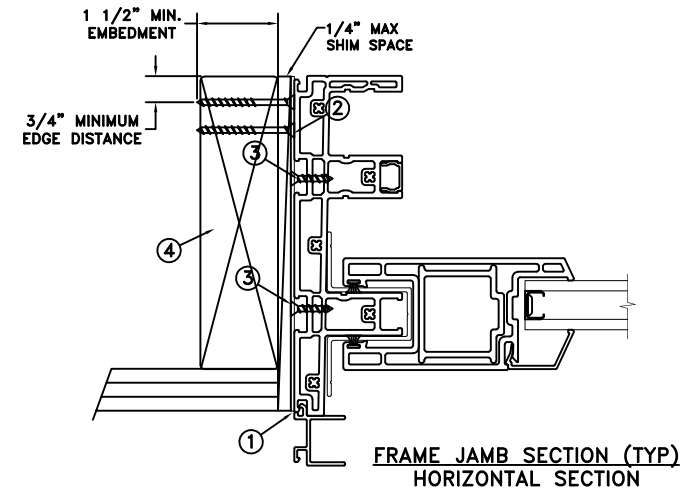

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use two (2) - #10 PFH or larger fasteners through masonry strap with sufficient length to penetrate a minimum of 1-1/2" into the buck. For 2x wood frame substrate (min. S.G. = 0.42).
3. Use two (2) - #10 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. TAS 202-94

Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.
Printed copies of this schedule are not considered signed and sealed and the signature must be verified on any electronic copies.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075
11/05/25

DATE: 10/23/2025		3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS	JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
CHECKED BY: D.BELAU	TITLE:		
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684	REPORT No.: NCTL-210-4150-01	CAD DWG. No.: —	REV: A SHEET 7 of 10


SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

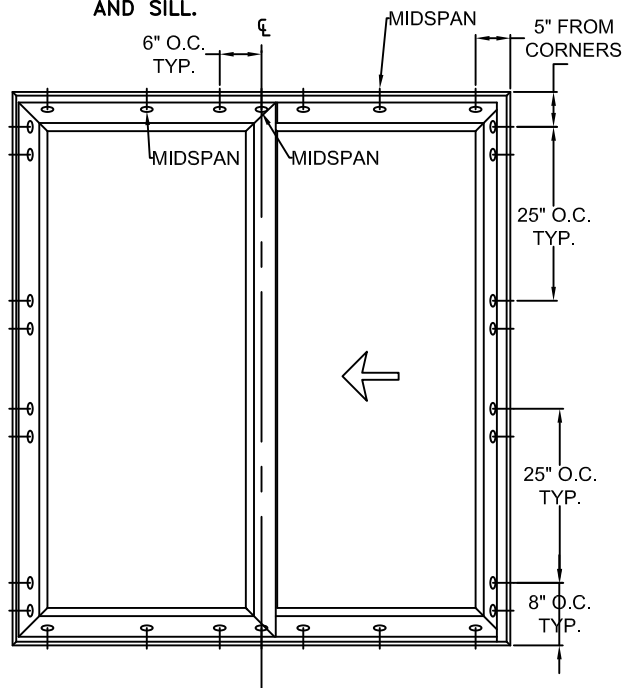

TYPICAL ELEVATION WITH FASTENER SPACING

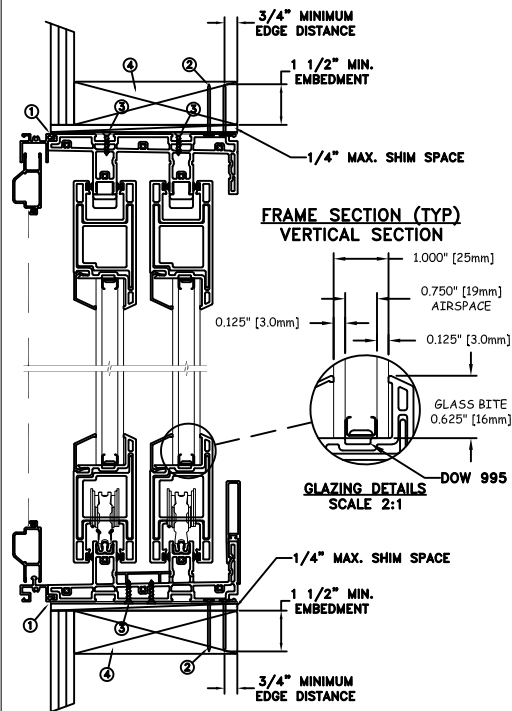

MASONRY STRAP
WOOD/NAIL INSTALLATION

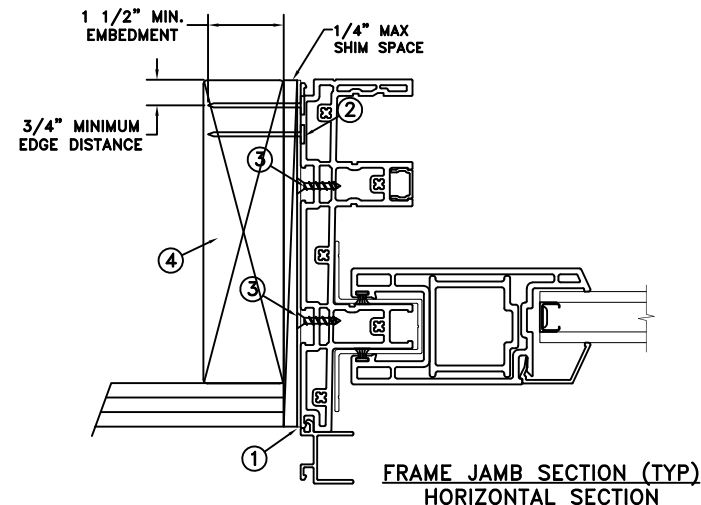

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use two (2) - 6d x 2" fasteners through masonry strap with sufficient length to penetrate a minimum of 1 1/2" into the buck. For 2x wood frame substrate (min. S.G. = 0.42).
3. Use two (2) - #10 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. TAS 202-94

Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.
Printed copies of this schedule are not considered signed and sealed and the signature must be verified on any electronic copies.

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075

DATE: 10/23/2025		3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS	JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
CHECKED BY: D.BELAU	TITLE:		
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684			
REPORT No.: NCTL-210-4150-01	CAD DWG. No.: —	REV: A	SHEET 8 of 10


SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

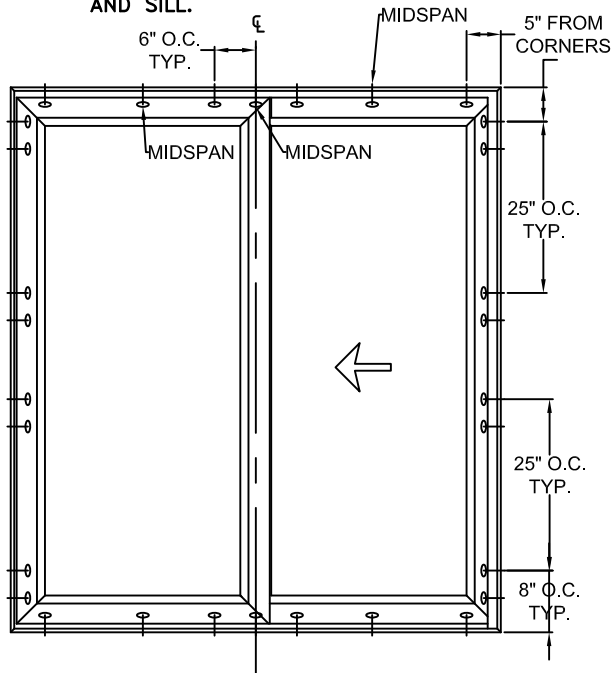

TYPICAL ELEVATION WITH FASTENER SPACING

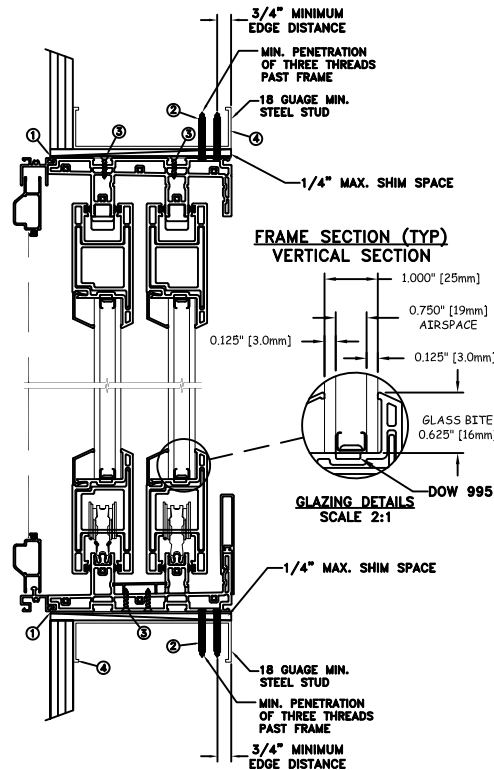

MASONRY STRAP STEEL/SCREW INSTALLATION

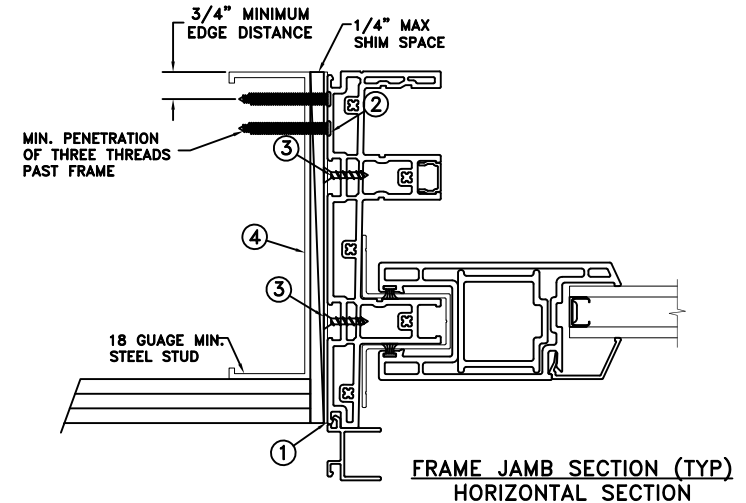

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use two (2) - #10 TEK Self-Tapping or larger screws through masonry strap with sufficient length to achieve a minimum penetration of three threads past the frame thickness. Steel substrate min. 18ga., fy = 33 ksi.
3. Use two (2) - #10 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. TAS 202-94

Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.
Printed copies of this schedule are not considered signed and sealed and the signature must be
verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.

DISCLAIMER:


This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.




MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075

DATE: 10/23/2025		3737 LAKEPORT BLVD.	
SCALE: NTS		KLAMATH FALLS OR, 97601	
DRAWN BY: M.HAM		PHONE: (800) 535-3936	
CHECKED BY: D.BELAU		JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684			
REPORT No.: NCTL-210-4150-01		CAD DWG. No.: —	REV: A SHEET 9 of 10


SEE ANCHOR DWGS ON SHEETS
11-14 FOR THRU FRAME ANCHOR
LOCATIONS AT THE JAMB, HEAD,
AND SILL.

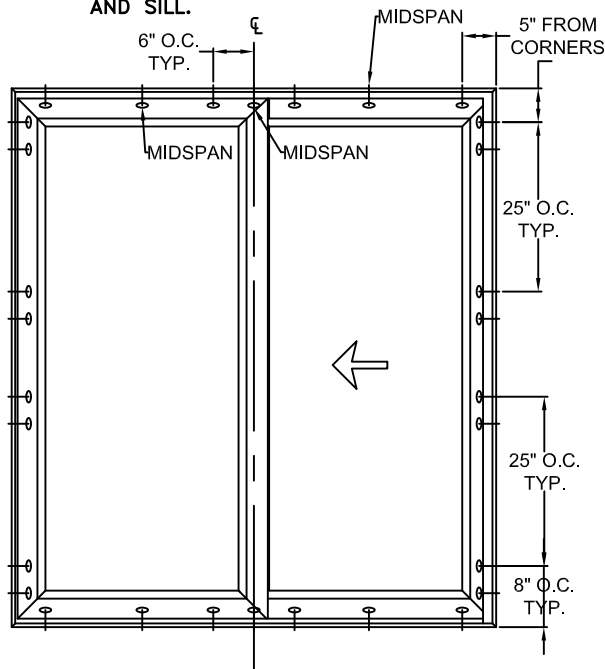

TYPICAL ELEVATION WITH FASTENER SPACING

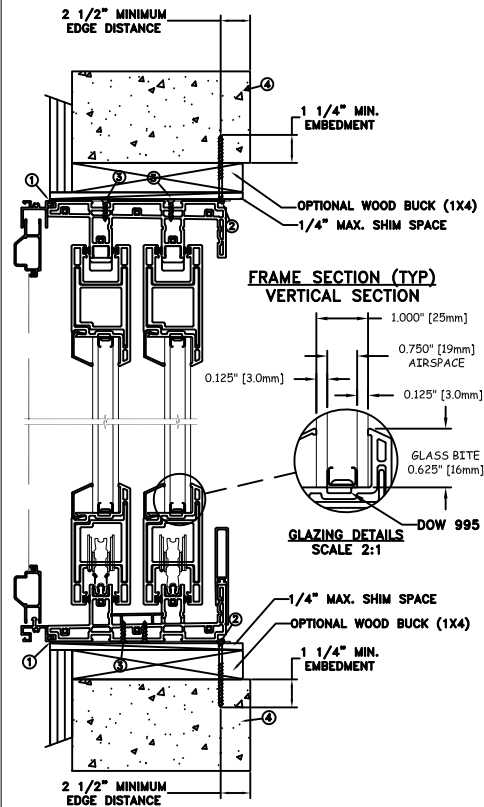

MASONRY STRAP CONCRETE SCREW INSTALLATION

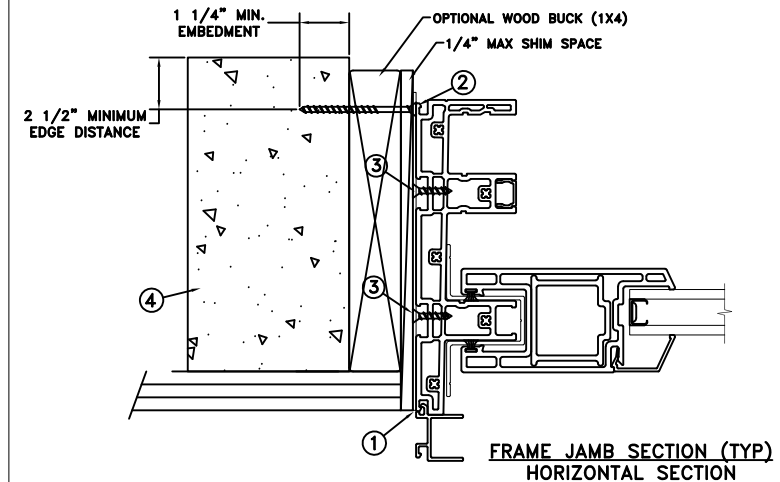

MAXIMUM FRAME	DP	IMPACT
72" x 80"	+65/-70	NO

Installation Notes:

1. Seal flange/frame to substrate. Sill shall be set on a continuous serpentine bead of structural grade silicone caulk when no fastener is used to anchor the sill (typical).
2. Use one (1) - 1/4" Tapcon or equivalent fasteners through masonry strap with sufficient length to penetrate a minimum of 1-1/4" into the buck or concrete. For 2x wood frame substrate (min. S.G. = 0.42). For concrete (min. fc = 3000 psi) or masonry substrate (CMU shall be ASTM C90).
3. Use two (2) - #10 PFH or larger fasteners through masonry strap into jamb without penetrating through the jamb into product causing visibility or collateral damage to product.
4. Host structure (wood buck, masonry, steel) to be designed and anchored to properly transfer all loads to the structure. The host structure is the responsibility of the architect or engineer of record for the project of installation.

General Notes:


1. The product shown herein is designed, tested and manufactured to comply with the wind load criteria of the adopted International Building Code (IBC), the International Residential Code (IRC), the current Florida Building Code (FBC) and the industry requirement for the stated conditions.
2. All glazing shall conform to ASTM E1300.
3. At minimum, glazing shall be 3.0mm annealed - 19.0mm airspace - 3.0mm annealed glass.
4. Use structural or composite shims where required.
5. Masonry strap specifications: 20 Ga. galvanized steel, .036" min. thickness x 1.5" min. width.
6. TAS 202-94

Product meets High Velocity Hurricane Zone (HVHZ) Requirements.
This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.
Printed copies of this schedule are not considered signed and sealed and the signature must be
verified on any electronic copies

This schedule addresses only the fasteners required to anchor the unit to achieve the rated design pressure and impact performance (where applicable) up to the size limitations noted. It is not intended as a guide to the installation process and does not address the sealing consideration that may arise in different wall conditions. For the complete installation procedure, see the instructions packaged with the unit or go to www.jeld-wen.com.



DISCLAIMER:

This drawing and its contents are confidential and are not to be reproduced or copied in whole or in part or used or disclosed to others except as authorized by JELD-WEN Inc.



MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8075
11/05/25

DATE: 10/23/2025		3737 LAKEPORT BLVD. KLAMATH FALLS OR, 97601 PHONE: (800) 535-3936	
DRAWN BY: M.HAM	SCALE: NTS	JELD-WEN Premium (V-4500) Vinyl Sliding Door Multi Slide 2 Track 2 Panel OX	
CHECKED BY: D.BELAU	TITLE:		
APPROVED BY: J.GOOSSEN			
RECORD No.: D014684			
REPORT No.: NCTL-210-4150-01	CAD DWG. No.: —	REV: A	SHEET 10 of 10

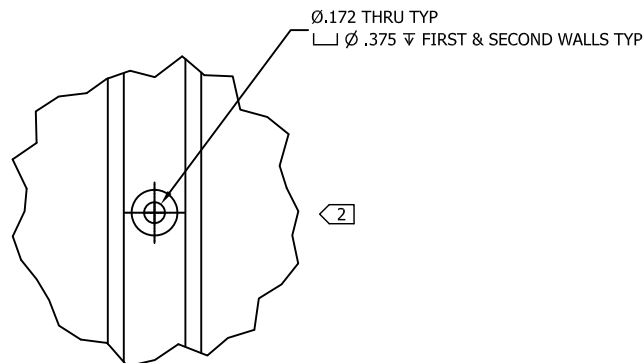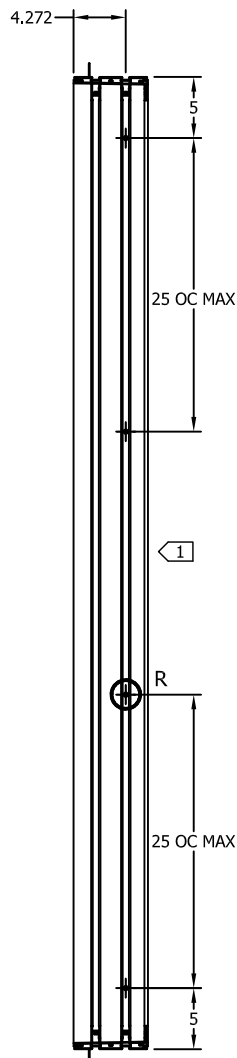


DETAIL R
SCALE 1 : 1

NOTES:

1. ANCHOR PATTERN LOCATED IN TRACK 1 SHIFT AS DETAILED
1. HOLES TO BE OMITTED IF ON CENTER CALCULATIONS FALL WITHIN 2" OF KEEPER LOCATION
2. ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS IN JAMB
3. NAIL FIN INSTALLATION

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be
verified on any electronic copies



11/05/25

MICAH SWARTZ, P.E.
PE No. 93573
5154 Cambridge Ct.
Klamath Falls, OR 97603
(541) 363-8076

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES DO NOT SCALE DRAWING - REPORT ANY ERRORS	
TOLERANCES (UNLESS SPECIFIED OTHERWISE)	
COMPONENT / PART TOLERANCES	
UNDER 10'-0" ± 1/32	.X ± .1
OVER 10'-0" ± 1/16	.XX ± .02
ANGULAR ± 1°	.XXX ± .006
UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16	WIDTH ± 1/16
MULLION ± 1/16	FRACTION ± 1/32

PROJECT ENGINEER: N HERTZOG
DRAWN BY: A BURWELL
CHECKED BY: J JONES
APPROVED BY: J JONES
IDENTIFIER No.




DATE: 9/11/2015
SCALE: 1 : 10
TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR JAMB ANCHOR HOLES DETAIL
MODEL No. P012967-198.ipt

JELD-WEN WINDOWS & DOORS	
3737 Lakeport Blvd. Klamath Falls, OR 97601 Phone: (541) 882-3451	
DRAWING No. P012967	REV: B
SHEET	

© 2015 JELD-WEN, Inc. ALL RIGHTS RESERVED. NO DUPLICATION OR
DISTRIBUTION PERMITTED. JELD-WEN, Inc. CONFIDENTIAL AND PROPRIETARY.


NOTES:

1. ANCHOR PATTERN LOCATED IN TRACKS 1 & 2 SHIFT AS DETAILED
1. HOLES TO BE OMITTED IF ON CENTER CALCULATIONS FALL WITHIN 2" OF KEEPER LOCATION
2. ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS IN JAMB
3. THRU FRAME INSTALLATION

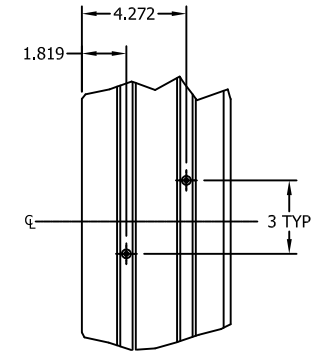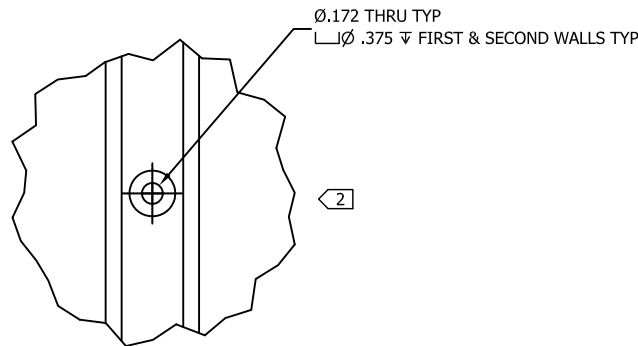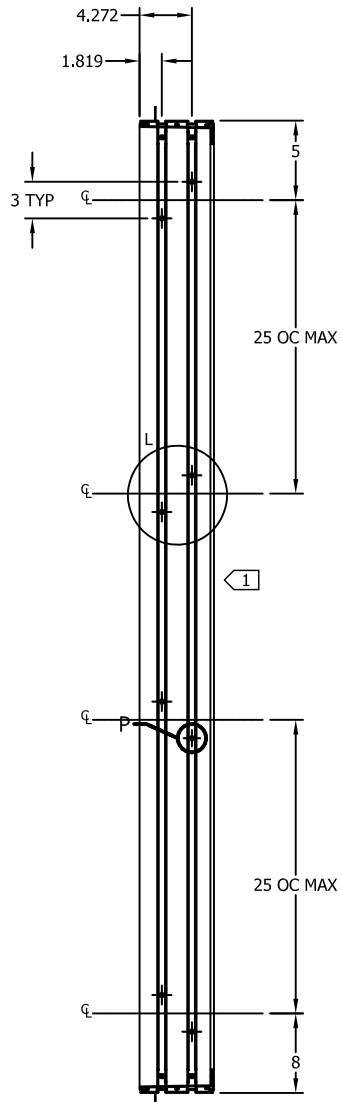

DETAIL L
SCALE 1 : 1

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.
Printed copies of this document are not considered signed and sealed and the signature must be
verified on any electronic copies

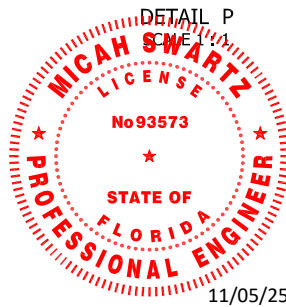

MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR 97603
(541) 363-8076

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES DO NOT SCALE DRAWING - REPORT ANY ERRORS	
TOLERANCES (UNLESS SPECIFIED OTHERWISE)	
COMPONENT / PART TOLERANCES	
UNDER 10'-0" ± 1/32	.X ± .1
OVER 10'-0" ± 1/16	.XX ± .02
ANGULAR ± 1°	.XXX ± .006
UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16	WIDTH ± 1/16
MULLION ± 1/16	FRACTION ± 1/32


PROJECT ENGINEER:
N HERTZOG
DRAWN BY:
A BURWELL
CHECKED BY:
J JONES
APPROVED BY:
J JONES
IDENTIFIER No.

DATE:
9/11/2015
SCALE:
1:10


JELD-WEN
WINDOWS & DOORS

3737 Lakeport Blvd.
Klamath Falls, OR 97601
Phone: (541) 882-3451


TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR 3 JAMB ANCHOR HOLE DETAIL	
MODEL No. P012967-199.ipt	DRAWING No. P012967
© 2015 JELD-WEN, Inc. ALL RIGHTS RESERVED. NO DUPLICATION OR DISTRIBUTION PERMITTED. JELD-WEN, Inc. CONFIDENTIAL AND PROPRIETARY.	
REV: B	SHEET

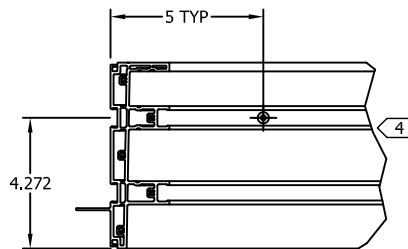


EXT ↓ DETAIL W
SCALE 1 / 4

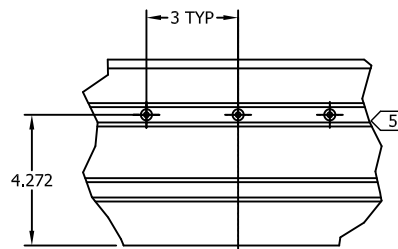

EXT ↓ DETAIL X
SCALE 1 / 4
PATTERN, SYM

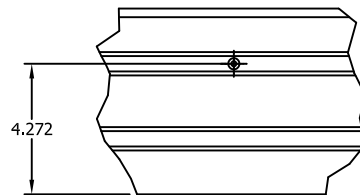


EXT ↓ DETAIL Y
SCALE 1 / 4

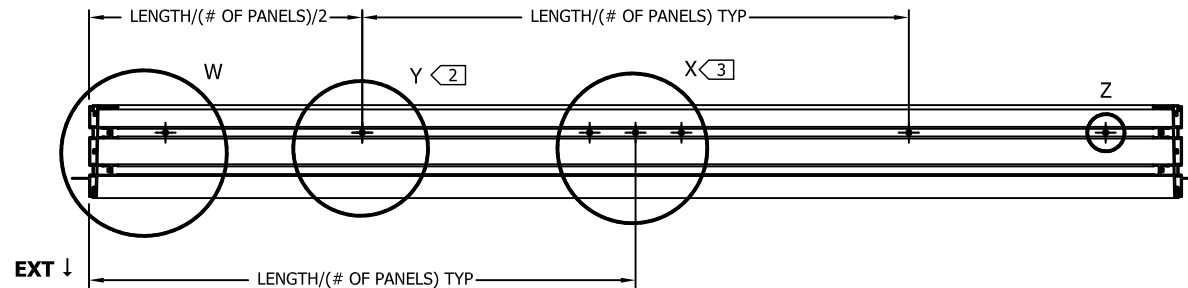

EXT ↓

Ø.172 THRU
□ Ø.375 ▽ FIRST & SECOND WALLS TYP

DETAIL Z TYPICAL HOLE
SCALE 1 / 2



MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8076

NOTES:


- 1 ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS AT HEAD OR SILL
- 2 TYP 1 ANCHOR PER PANEL LOCATED IN TRACK 1 TOWER AND ALIGNED WITH CENTER POINT OF EACH CLOSED POSITION PANEL
- 3 ANCHOR PATTERN LOCATED IN TRACK 1 TOWER AT EACH INTERLOCK AREA
- 4 1 ANCHOR AT ENDS LOCATED IN TRACK 1 TOWER BOTH HEAD AND SILL
- 5 TYP 3 ANCHOR PATTERN LOCATED IN TRACK 1 TOWER APPROXIMATE CENTER OF EACH CLOSED POSITION PANEL INTERLOCK AREA
- 6 CONFIGURATION FOR PG35/50 DOORS WITH NAIL FIN INSTALL

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies


UNLESS SPECIFIED ALL DIMENSIONS IN INCHES DO NOT SCALE DRAWING - REPORT ANY ERRORS	PROJECT ENGINEER: N HERTZOG	DATE: 9/11/2015	JELD-WEN WINDOWS & DOORS 3737 Lakeport Blvd. Klamath Falls, OR 97601 Phone: (541) 882-3451
	DRAWN BY: A BURWELL	SCALE: AS SHOWN	
TOLERANCES (UNLESS SPECIFIED OTHERWISE) COMPONENT / PART TOLERANCES UNDER 10'-0" ± 1/32 .X ± .1 OVER 10'-0" ± 1/16 .XX ± .02 ANGULAR ± 1° .XXX ± .006	CHECKED BY: J JONES	TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR 6 SILL AND HEAD ANCHOR HOLES DETAIL	
UNIT ASSEMBLY TOLERANCES HEIGHT ± 1/16 WIDTH ± 1/16 MULLION ± 1/16 FRACTION ± 1/32	APPROVED BY: J JONES	MODEL No.: P012967-394.ipt	
	IDENTIFIER No.	DRAWING No.: P012967	
© 2015 JELD-WEN, Inc. ALL RIGHTS RESERVED. NO DUPLICATION OR DISTRIBUTION PERMITTED. JELD-WEN, Inc. CONFIDENTIAL AND PROPRIETARY.			REV: R SHEET

NOTES:


- 1 ALL HOLES IN ALL POSITIONS TO BE CENTERED WITHIN TRACK TOWERS AT HEAD OR SILL
- 2 TYP 1 ANCHOR PER PANEL LOCATED IN TRACK 1 TOWER AND ALIGNED WITH CENTER POINT OF EACH CLOSED POSITION PANEL
- 3 ANCHOR PATTERN LOCATED IN TRACK 1 & 2 TOWERS AT EACH INTERLOCK AREA
- 4 1 ANCHOR AT ENDS LOCATED IN TRACK 1 TOWER BOTH HEAD AND SILL
- 5 TYP 5 ANCHOR PATTERN LOCATED IN TRACK 1 & 2 TOWERS APPROXIMATE CENTER OF EACH CLOSED POSITION PANEL INTERLOCK AREA
- 6 CONFIGURATION FOR PG65 DOORS WITH THRU FRAME INSTALL

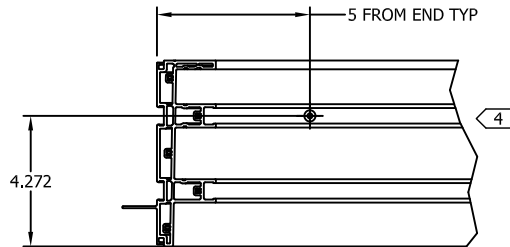



EXT ↓ DETAIL AA
SCALE 1 / 4

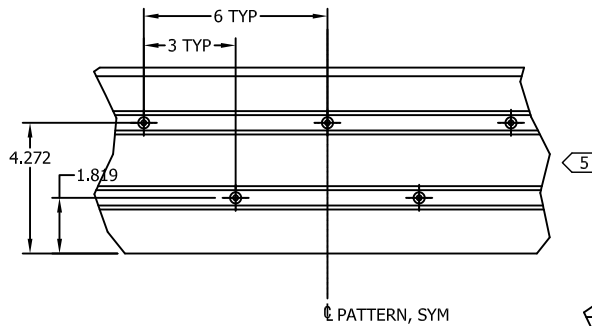

EXT ↓ DETAIL AB
SCALE 1 / 4

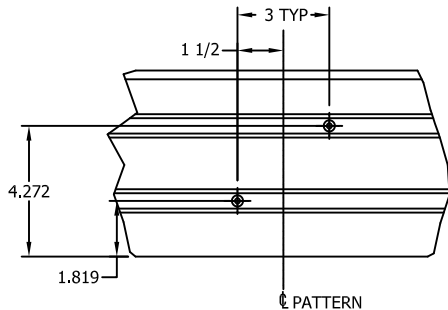


EXT ↓ DETAIL AC
SCALE 1 / 4

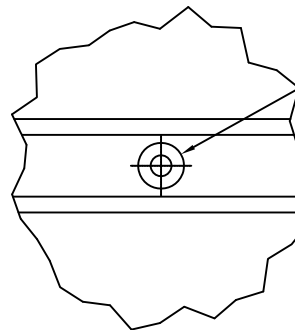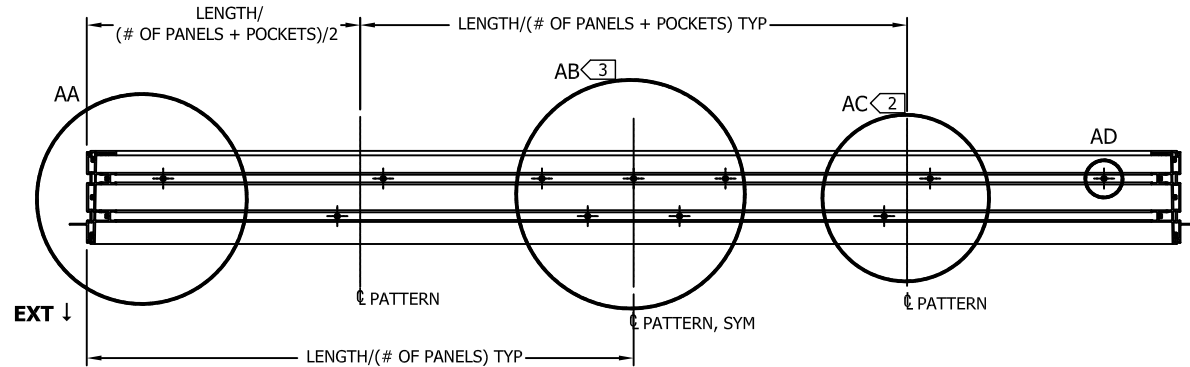

Ø.172 THRU TYP
Ø.375 FIRST & SECOND WALLS TYP

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies



MICAH SWARTZ, P.E.
PE No. 93573
5134 Cambridge Ct.
Klamath Falls, OR. 97603
(541) 363-8076

UNLESS SPECIFIED ALL DIMENSIONS IN INCHES DO NOT SCALE DRAWING - REPORT ANY ERRORS	PROJECT ENGINEER: N HERTZOG
TOLERANCES (UNLESS SPECIFIED OTHERWISE)	DRAWN BY: A BURWELL
COMPONENT / PART TOLERANCES	CHECKED BY: J JONES
UNDER 10'-0" ± 1/32 .X ± .1	APPROVED BY: J JONES
OVER 10'-0" ± 1/16 .XX ± .02	IDENTIFIER No.
ANGULAR ± 1° .XXX ± .006	
UNIT ASSEMBLY TOLERANCES	
HEIGHT ± 1/16 WIDTH ± 1/16	
MULLION ± 1/16 FRACTION ± 1/32	

DATE: 9/11/2015	3737 Lakeport Blvd. Klamath Falls, OR 97601 Phone: (541) 882-3451
SCALE: AS SHOWN	
TITLE: 2-TRACK FRAME MULTI-SLIDE PATIO DOOR 6 SILL AND HEAD ANCHOR HOLES DETAIL	
MODEL No.: P012967-397.ipt	DRAWING No.: P012967
© 2015 JELD-WEN, Inc. ALL RIGHTS RESERVED. NO DUPLICATION OR DISTRIBUTION PERMITTED. JELD-WEN, Inc. CONFIDENTIAL AND PROPRIETARY.	REV: B SHEET