

LINEA ROSSA WINDOWS AND DOORS

LRWAD-280 SLIDING GLASS DOOR & LIFT AND SLIDE SYSTEMS

(HVHZ)(IMPACT)

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/2" INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR MASONRY OR CONCRETE OPENINGS, 1X WOOD BUCK MAY BE USED (OPTIONAL AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: ALUMINUM 6063-T6/ ALUMINUM 6063-T5
7. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 2 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & INSTALLATION NOTES
2	GLAZING DETAILS & DESIGN PRESSURE TABLE
3	ELEVATION & ANCHOR LAYOUT - OXXO
4	ELEVATION & ANCHOR LAYOUT - OXXX
5	ELEVATION & ANCHOR LAYOUT - OXXXXO
6	VERTICAL SECTIONS
7	VERTICAL SECTIONS
8	VERTICAL SECTIONS
9	HORIZONTAL SECTIONS
10	HORIZONTAL SECTIONS
11	ANCHOR DETAILS & ANCHOR SCHEDULE
12	ANCHOR DETAILS CONTINUED

MAX. PANEL SIZE		CONFIG.	DESIGN PRESSURE	MISSILE IMPACT RATING
WIDTH	HEIGHT			
60"	117"	SEE SHEETS 3-5	+80/-80 PSF	LARGE & SMALL MISSILE IMPACT

LINEA ROSSA®

WINDOWS & DOORS

1850 NW. 84TH AVE., STE. 114

DORAL, FL 33126

PH: (305)815-8797

TITLE: LRWAD-280 SLIDING GLASS DOOR

& LIFT & SLIDE SYSTEMS

(HVHZ)(IMPACT)

GENERAL NOTES & INSTALLATION NOTES

PREPARED BY: BUILDING DROPS, INC.

398 E. DANIA BEACH BLVD., STE. 338

DANIA BEACH, FL 33004

PH: (954)399-8478

FAX: (954)744-4738


WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2023.08.22 12:04:00

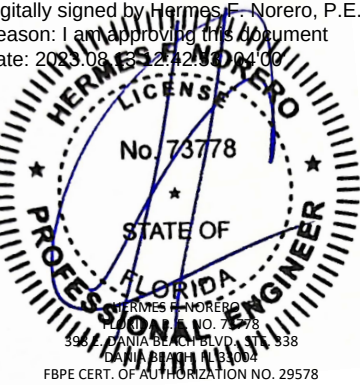

FL42288

DATE: 07.03.2023

DWG. BY: SH

CHK. BY: HFN

SCALE: NTS

DWG. #: LRA009

SHEET: OF 12


TITLE: LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)
GLAZING DETAILS & DESIGN
PRESSURE TABLE

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS
FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE
INSTALLATION TO DEVIATE FROM THE REQUIREMENTS
DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT
SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE
WITH THIS DOCUMENT.

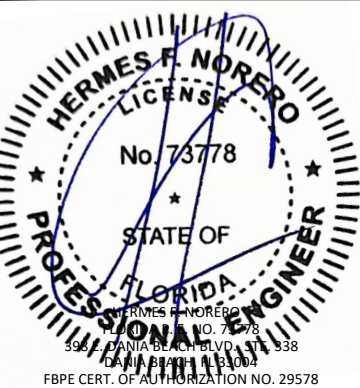

FL42288

DATE: 07.03.2023

DWG. BY:
SH

CHK. BY:
HFN


SCALE: NTS

DWG. #: LRA009

SHEET: 2 OF 12


2

9/16" LAMINATED GLASS CONSISTING OF:
1/4" HEAT-STRENGTHENED GLASS
0.090" SENTRYGLAS INTERLAYER BY KURARAY
1/4" HEAT-STRENGTHENED GLASS

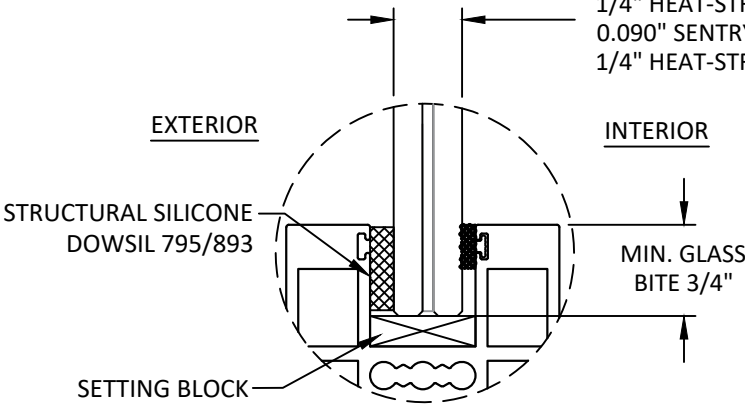

GLAZING DETAIL 1

1-3/8" INSULATED GLASS CONSISTING OF:
1/4" HEAT-STRENGTHENED GLASS
9/16" ALUMINUM SPACER
1/4" HEAT-STRENGTHENED GLASS
0.090" SENTRYGLAS INTERLAYER BY KURARAY
1/4" HEAT-STRENGTHENED GLASS

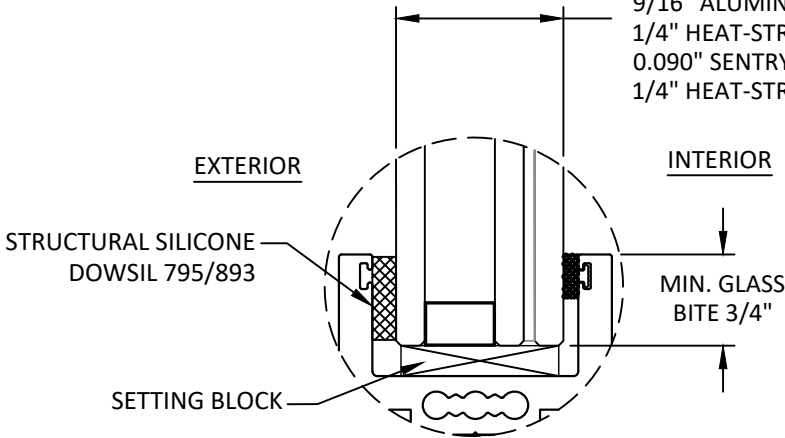

GLAZING DETAIL 2

GLAZING NOTES:

- GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- TWO APPROVED SETTING BLOCKS SHALL BE USED FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN DP TABLE ON SHEET 1, AND ELEVATIONS ON SHEETS 3-5.

DESIGN PRESSURE TABLE (+/- PSF)		
WINDOW DIMENSIONS		GLASS TYPES G1/G2
PANEL WIDTH (IN.)	PANEL HEIGHT (IN.)	
36	69	80.0
42		80.0
48		80.0
54		80.0
60		80.0
36	75	80.0
42		80.0
48		80.0
54		80.0
60		80.0
36	81	80.0
42		80.0
48		80.0
54		80.0
60		80.0
36	87	80.0
42		80.0
48		80.0
54		80.0
60		80.0
36	93	80.0
42		80.0
48		80.0
54		80.0
60		80.0
36	99	80.0
42		80.0
48		80.0
54		80.0
60		80.0
36	105	80.0
42		80.0
48		80.0
54		80.0
60		80.0
36	111	80.0
42		80.0
48		80.0
54		80.0
60		80.0
36	117	80.0
42		80.0
48		80.0
54		80.0
60		80.0




TITLE: *LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)*
ELEVATION & ANCHOR LAYOUT
OXO

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS
FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE
INSTALLATION TO DEVIATE FROM THE REQUIREMENTS
DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT
SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE
WITH THIS DOCUMENT.

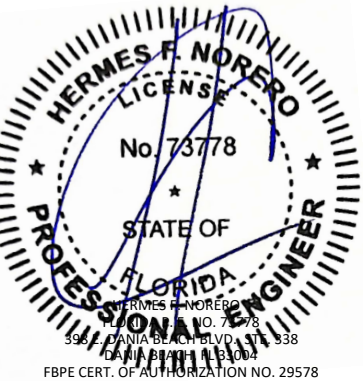

FL42288


DATE: 07.03.2023

DWG. BY: SH	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

DWG. #: LRA009

SHEET: OF 12

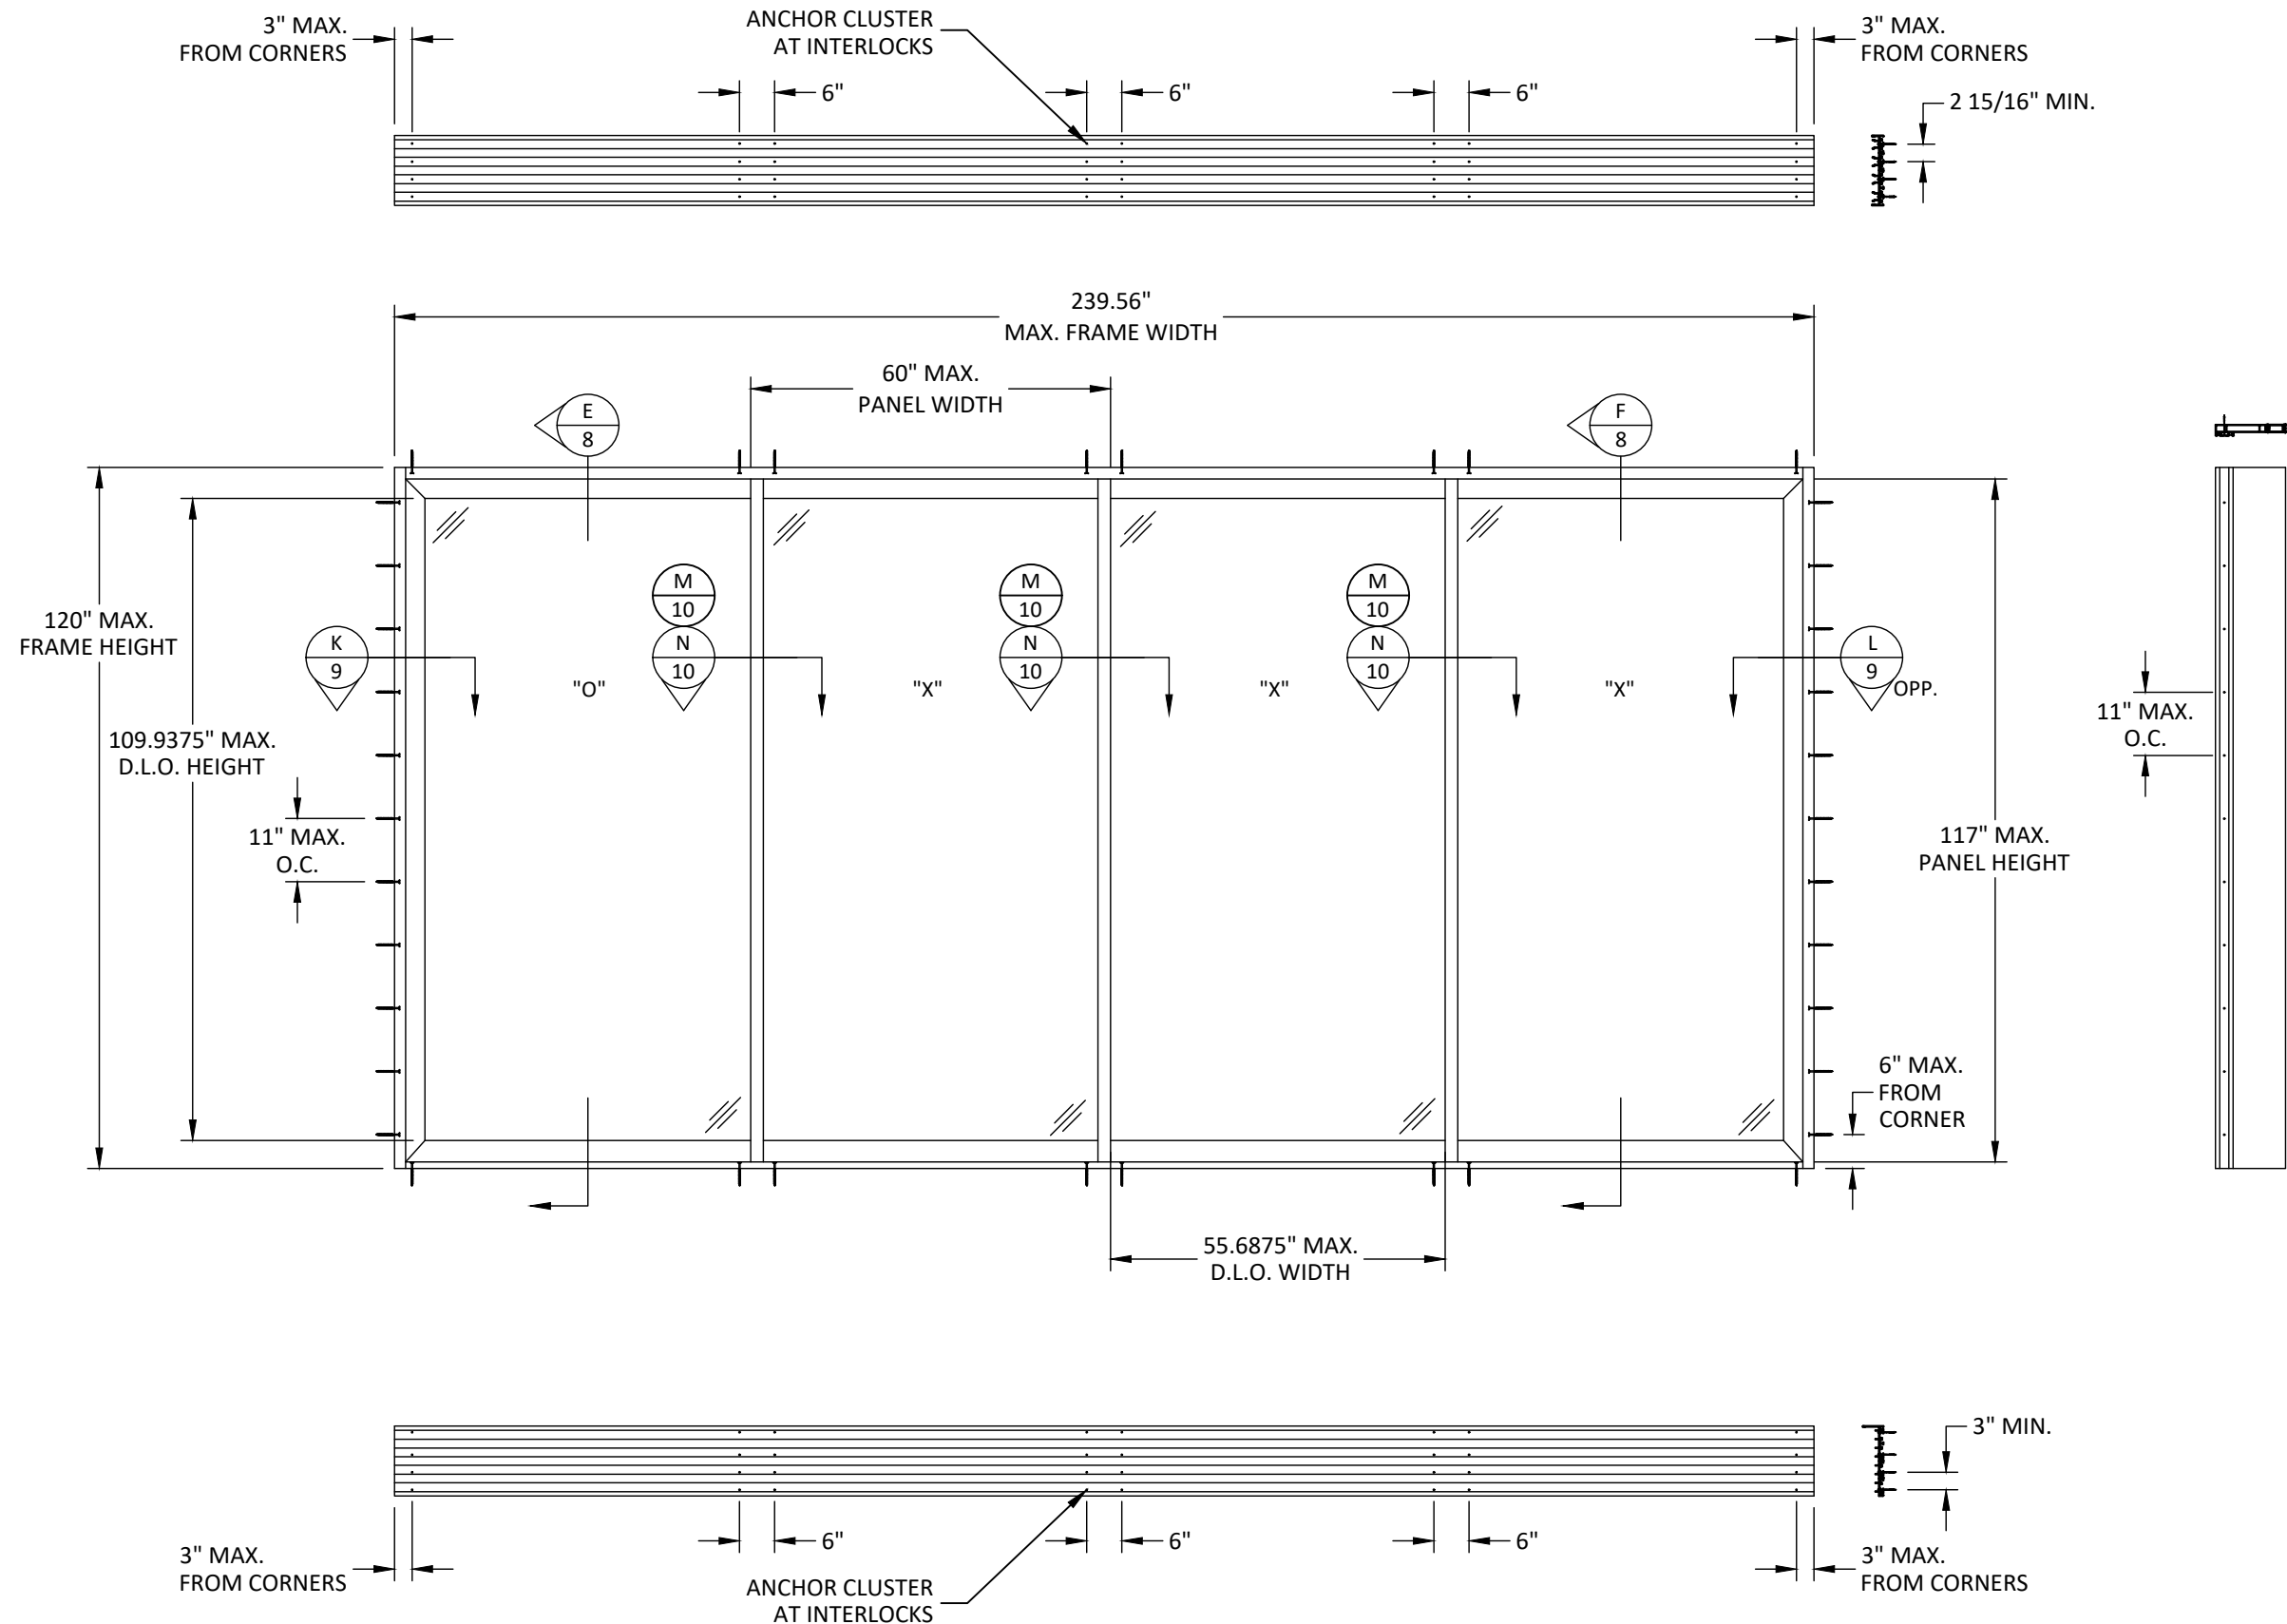

LINEA ROSSA®
WINDOWS & DOORS

1850 NW. 84TH AVE., STE. 114
DORAL, FL 33126
PH: (305)815-8797


TITLE: LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)
ELEVATION & ANCHOR LAYOUT
OXXX

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

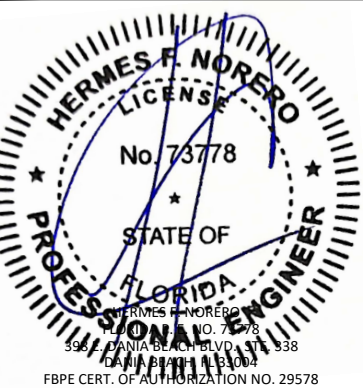

FL42288

DATE: 07.03.2023


DWG. BY: SH
CHK. BY: HFN


SCALE: NTS

DWG. #: LRA009

SHEET: OF 12

4




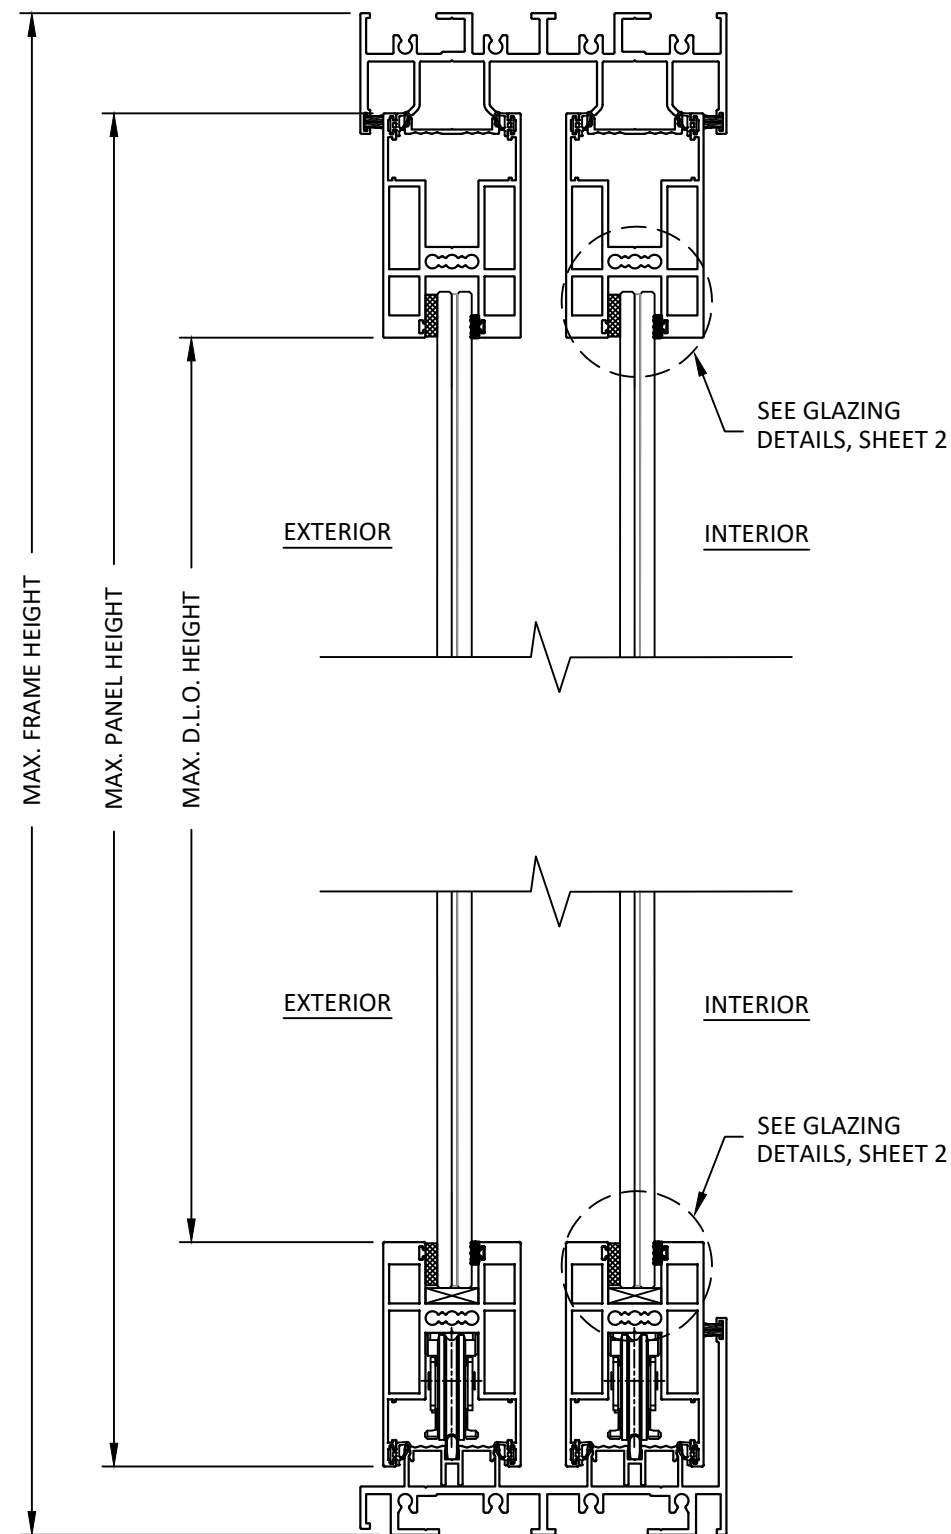

A
6

VERTICAL SECTION

2-TRACK - HEAD & SILL
LAMINATED GLASS SHOWN

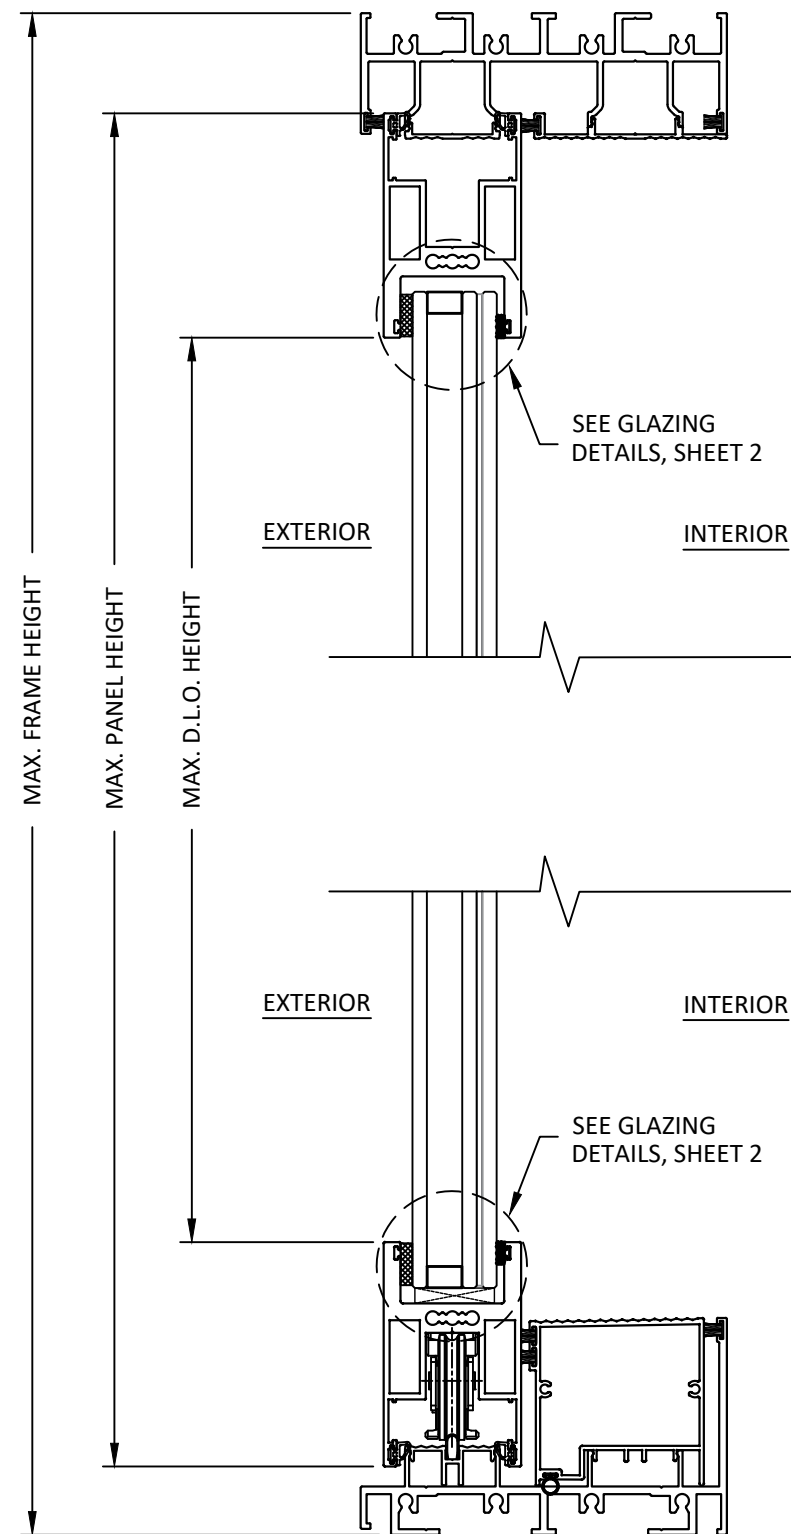

B
6

VERTICAL SECTION

2-TRACK - HEAD & SILL
INSULATED GLASS SHOWN

LINEA ROSSA®
WINDOWS & DOORS

1850 NW. 84TH AVE., STE. 114
DORAL, FL 33126
PH: (305)815-8797


TITLE: LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)
VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

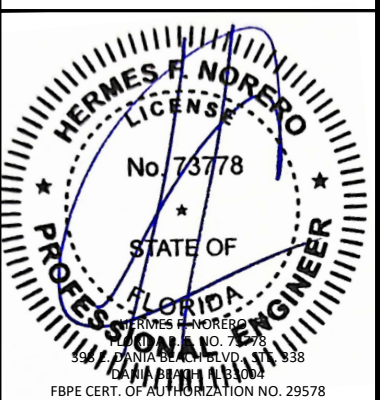

FL42288

DATE: 07.03.2023


DWG. BY: SH
CHK. BY: HFN

SCALE: NTS

DWG. #: LRA009

SHEET: OF 12


6

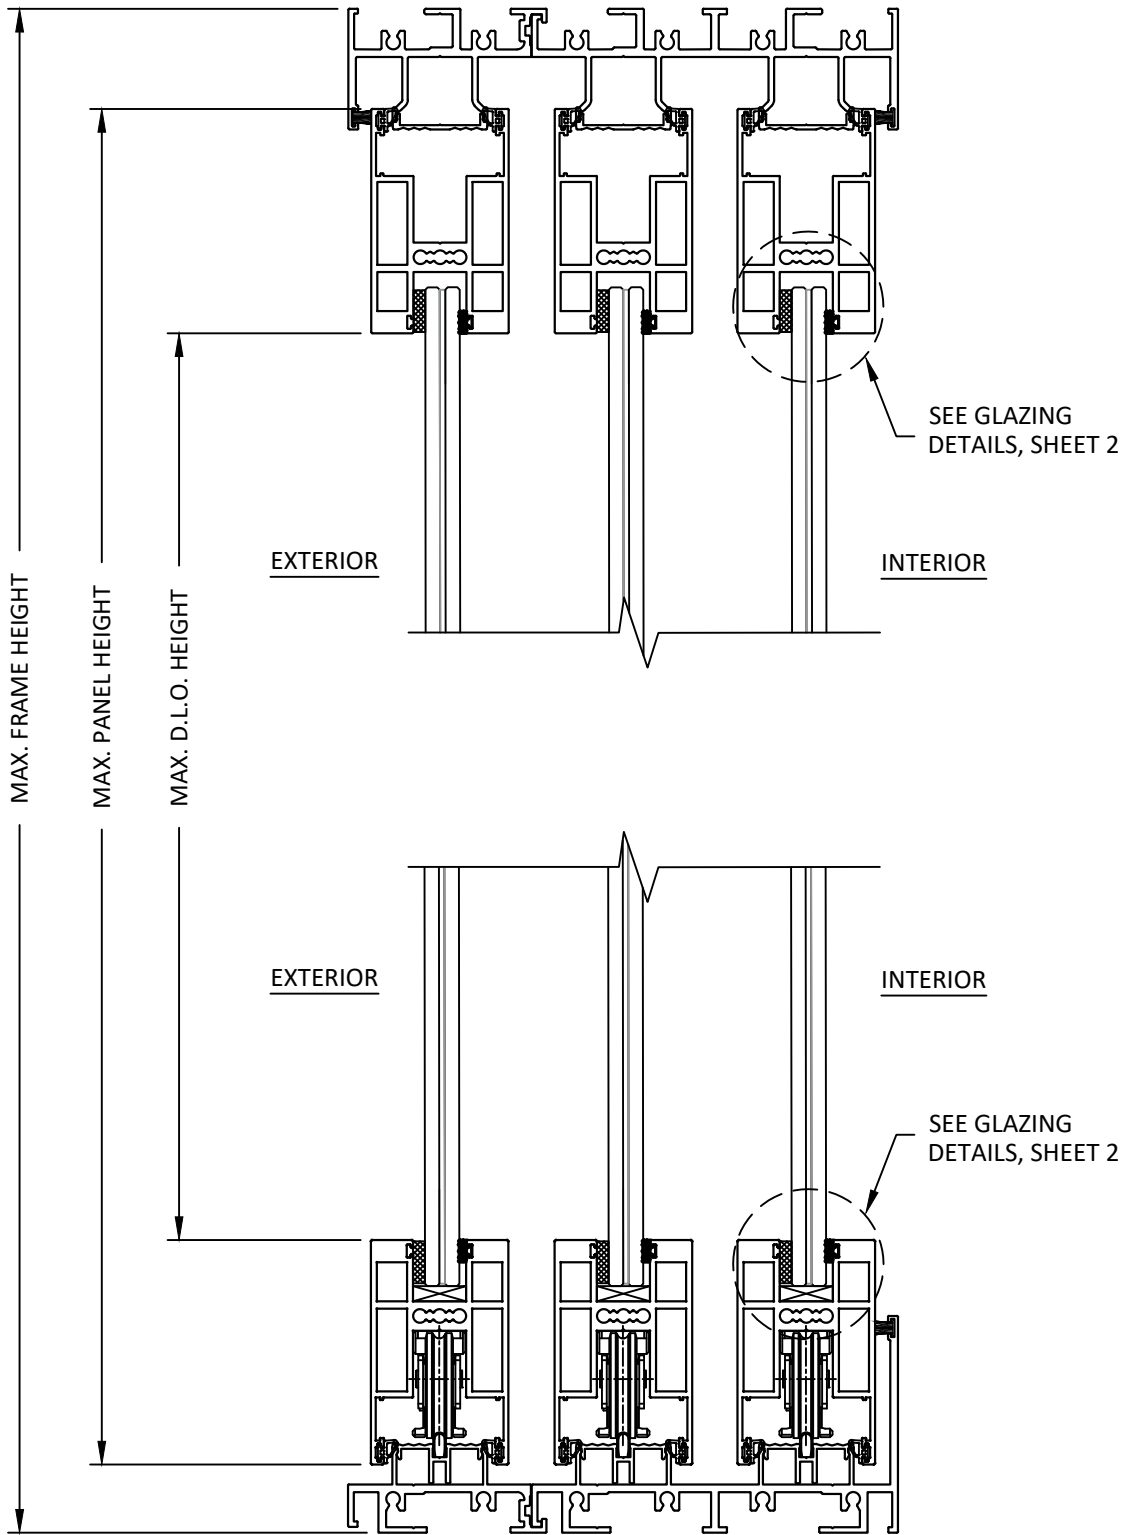

C
7

VERTICAL SECTION

3-TRACK - HEAD & SILL
LAMINATED GLASS SHOWN

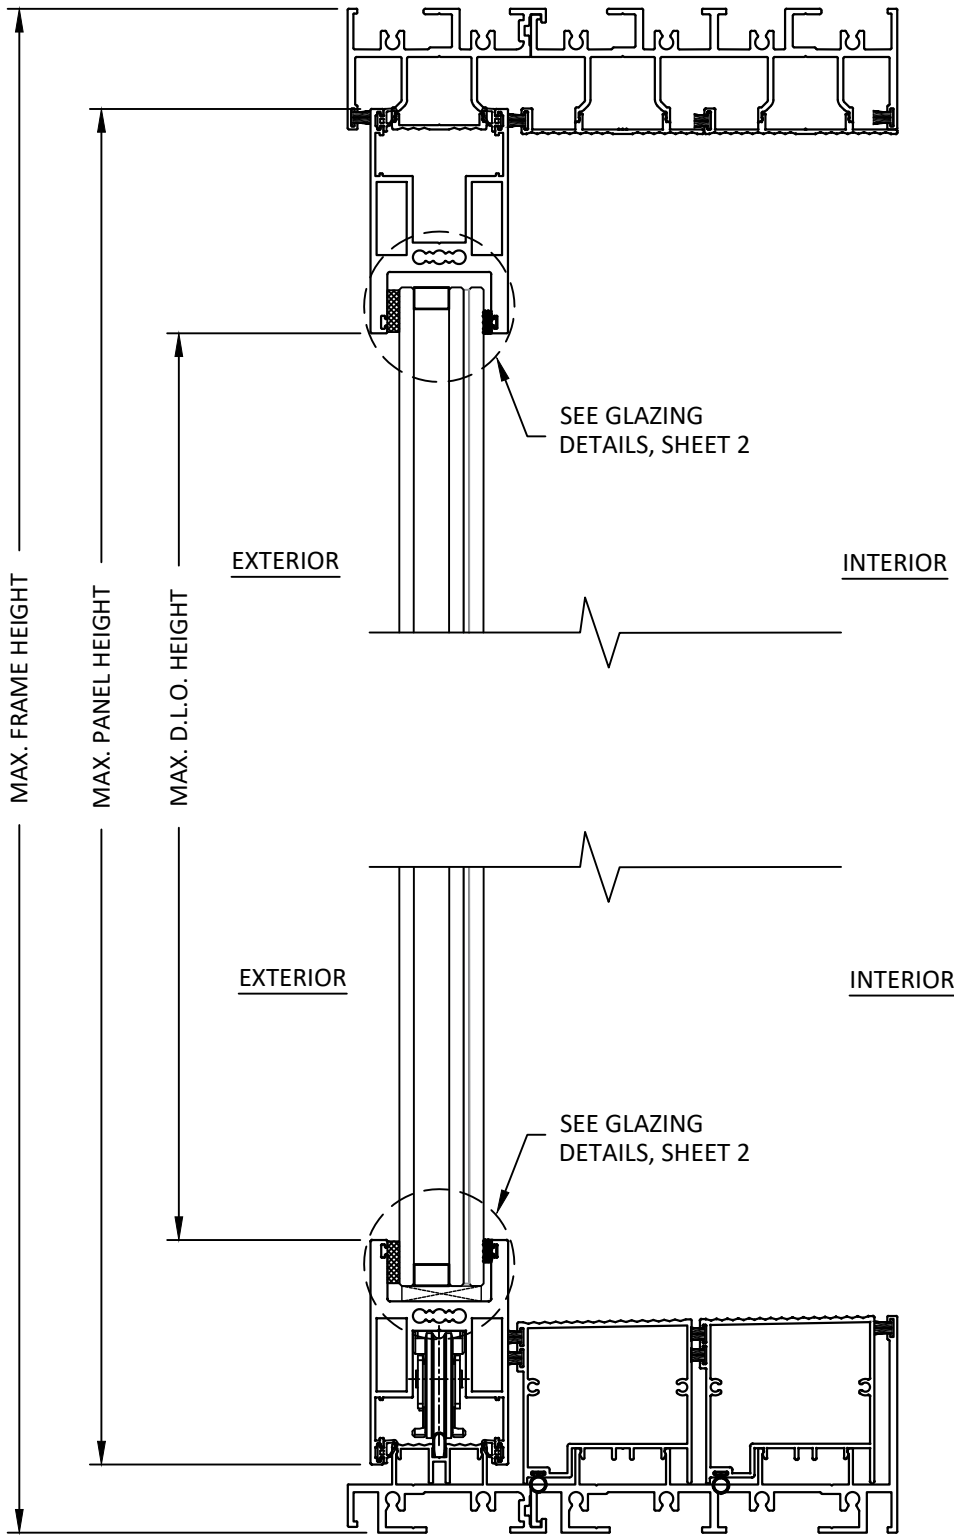

D
7

VERTICAL SECTION

3-TRACK - HEAD & SILL
INSULATED GLASS SHOWN

LINEA ROSSA®
WINDOWS & DOORS

1850 NW. 84TH AVE., STE. 114
DORAL, FL 33126
PH: (305)815-8797

TITLE: LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)


VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS
FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE
INSTALLATION TO DEVIATE FROM THE REQUIREMENTS
DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT
SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE
WITH THIS DOCUMENT.

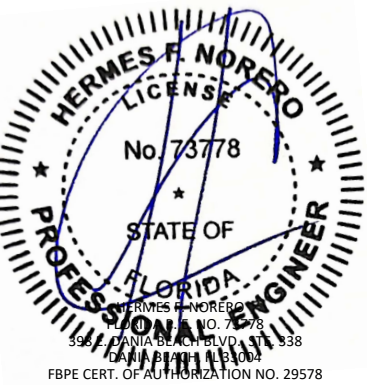

FL42288

DATE: 07.03.2023


DWG. BY: SH	CHK. BY: HFN
----------------	-----------------

SCALE: NTS

DWG. #: LRA009

SHEET: OF 12


7

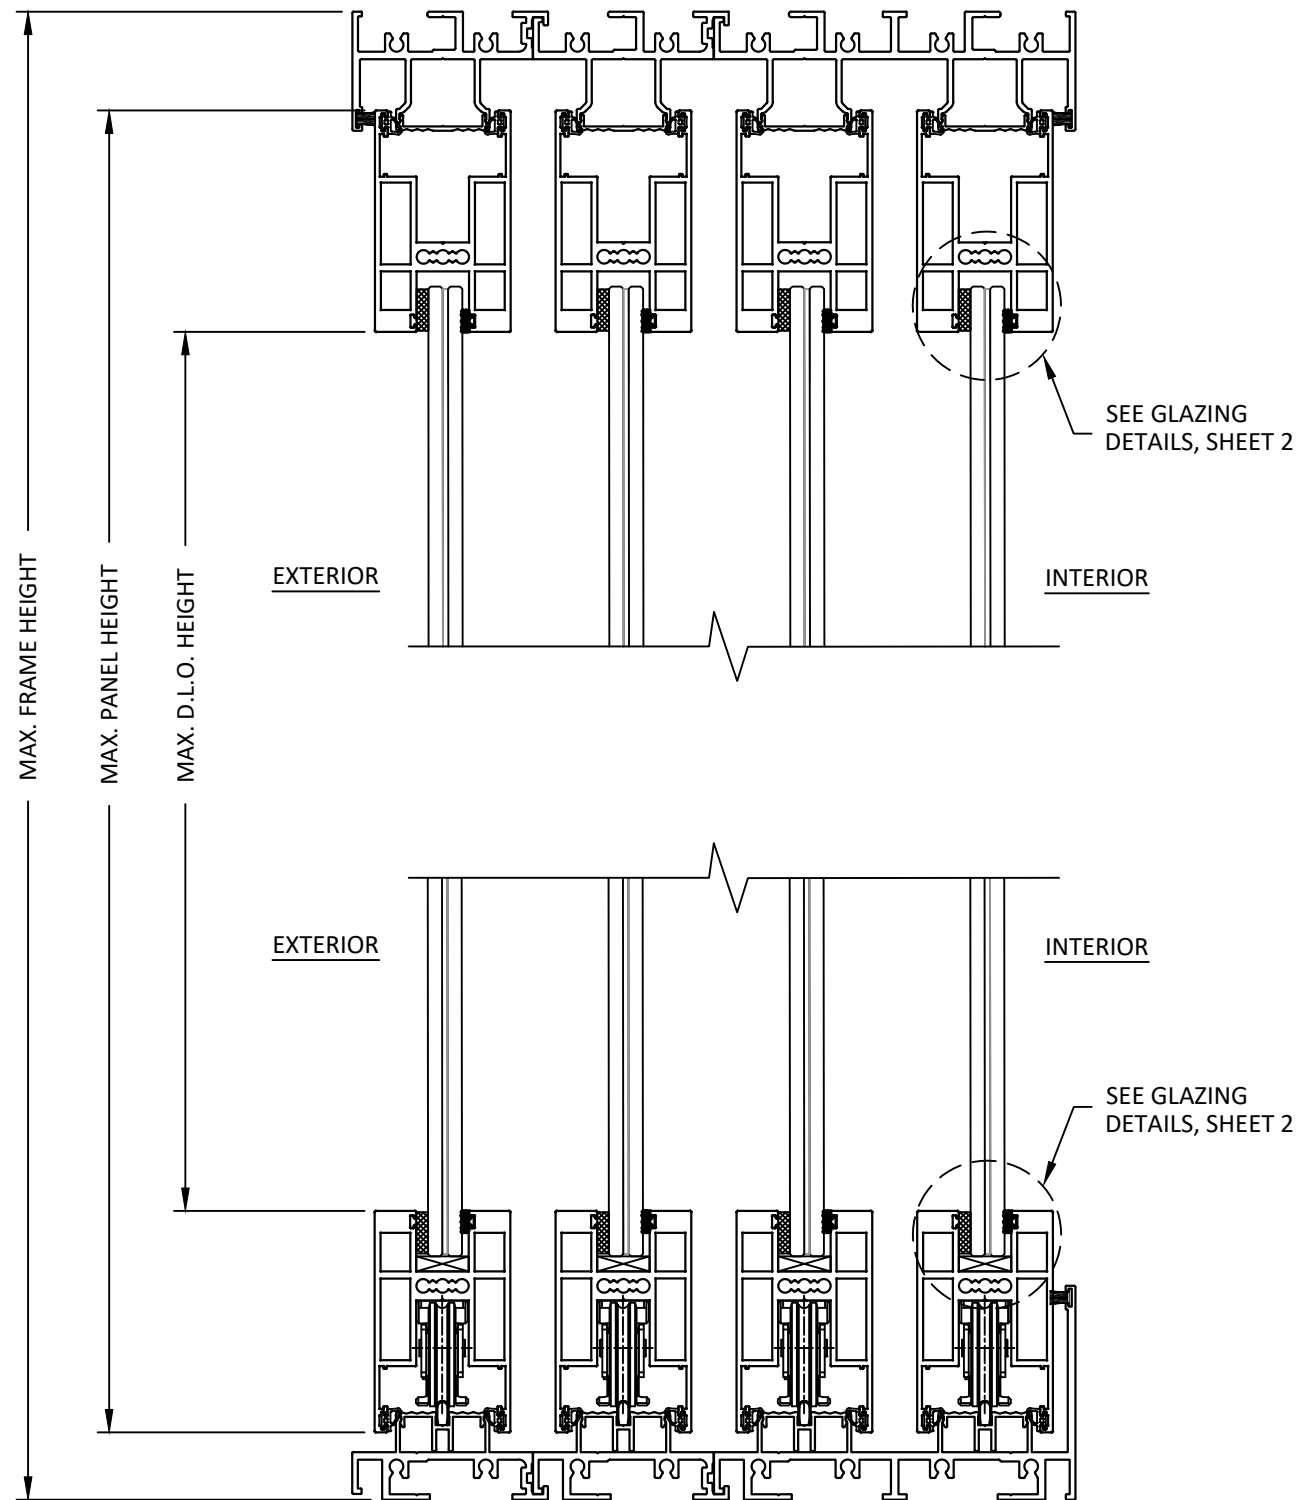

E
8

VERTICAL SECTION

4-TRACK - HEAD & SILL
LAMINATED GLASS SHOWN

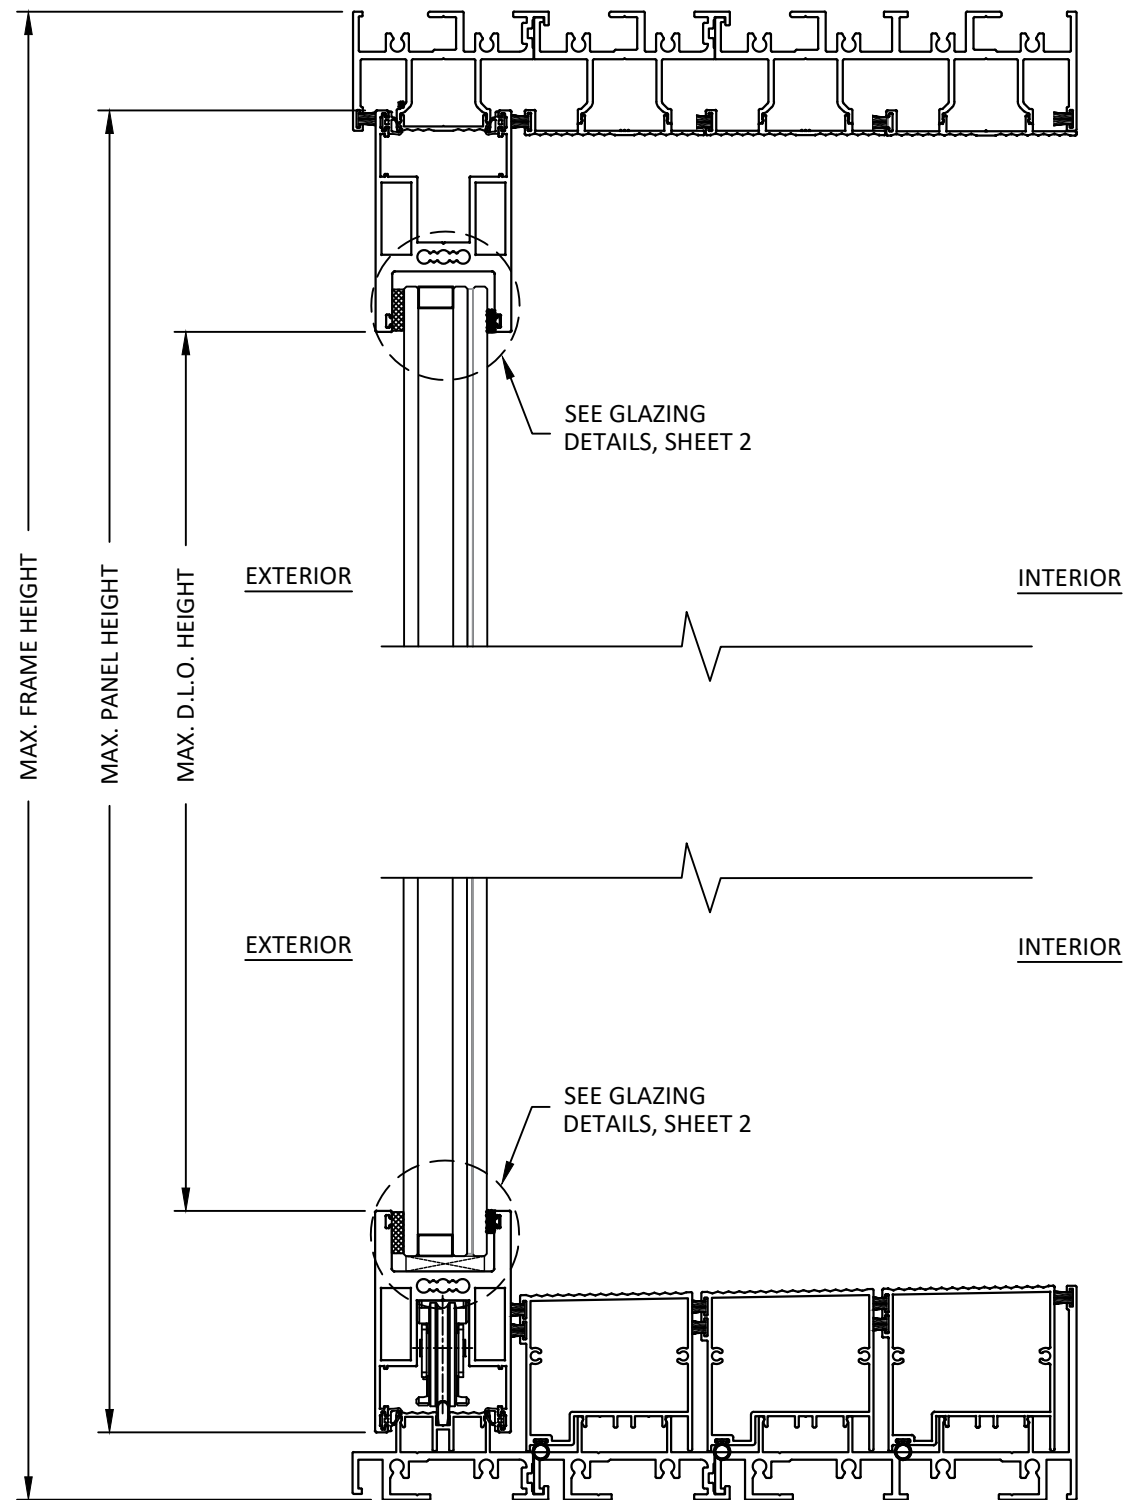

F
8

VERTICAL SECTION

4-TRACK - HEAD & SILL
INSULATED GLASS SHOWN

LINEA ROSSA®
WINDOWS & DOORS

1850 NW. 84TH AVE., STE. 114
DORAL, FL 33126
PH: (305)815-8797


TITLE: LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)
VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS
FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE
INSTALLATION TO DEVIATE FROM THE REQUIREMENTS
DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT
SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE
WITH THIS DOCUMENT.

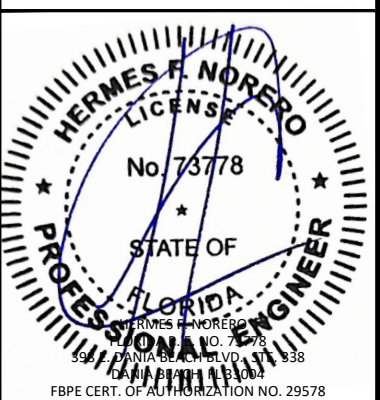

FL42288

DATE: 07.03.2023

DWG. BY:
SH


CHK. BY:
HFN

SCALE: NTS


DWG. #: LRA009

SHEET: OF 12


8

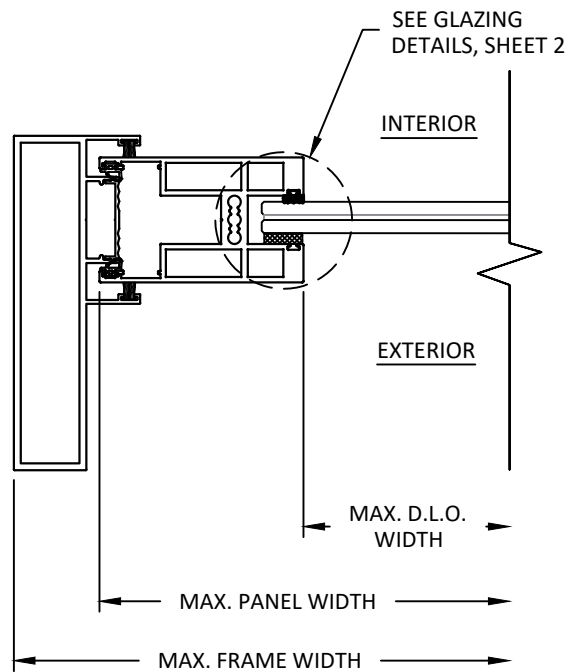


**G
9** HORIZONTAL SECTION
JAMB - FIXED PANEL
2-TRACK - LAMINATED GLASS

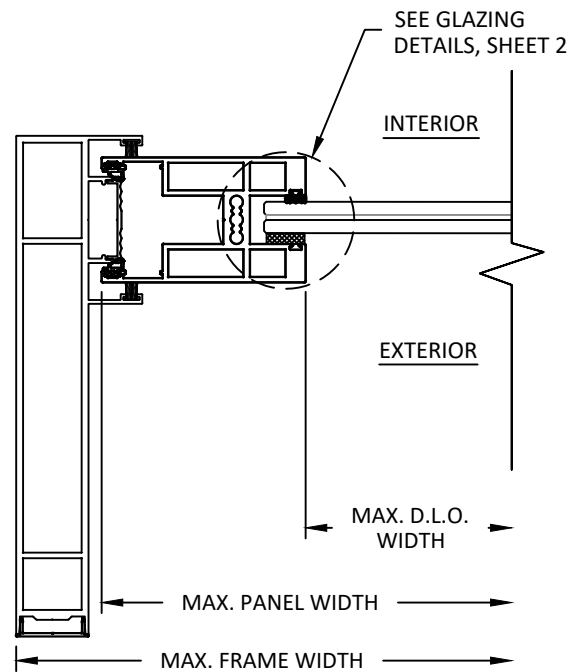


**I
9** HORIZONTAL SECTION
JAMB - FIXED PANEL
3-TRACK - LAMINATED GLASS

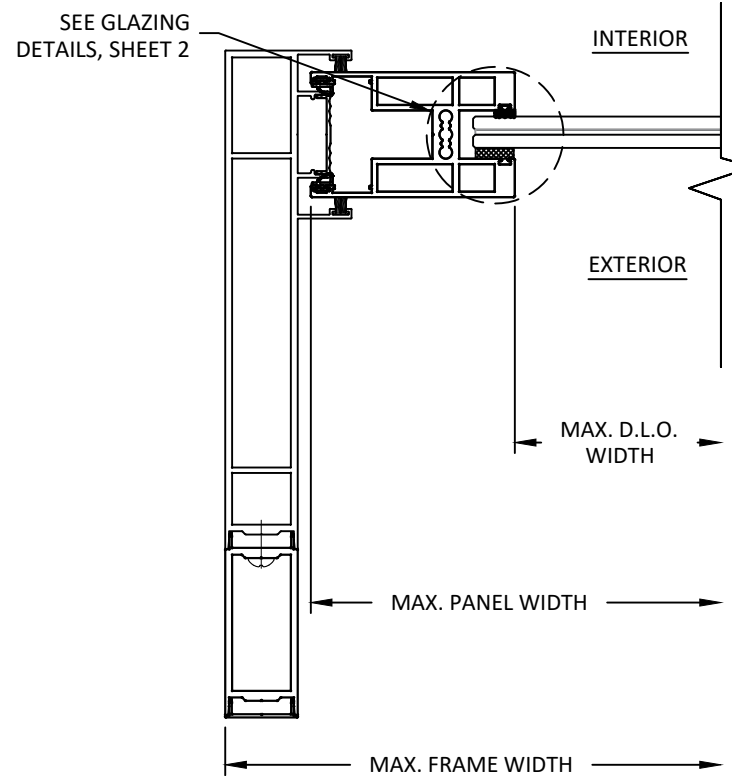


**K
9** HORIZONTAL SECTION
JAMB - FIXED PANEL
4-TRACK - LAMINATED GLASS

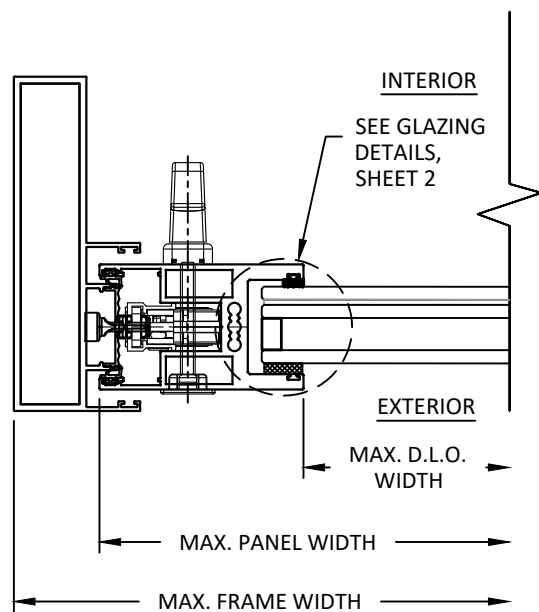

**H
9** HORIZONTAL SECTION
JAMB - OPERABLE PANEL
2-TRACK - INSULATED GLASS

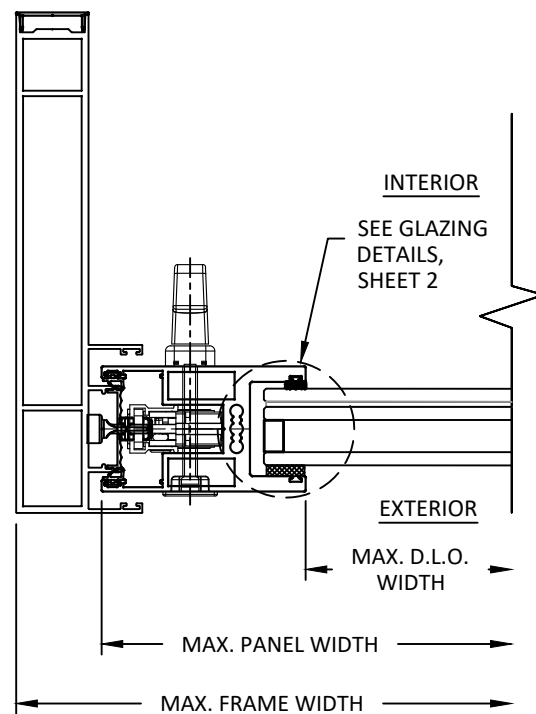

**J
9** HORIZONTAL SECTION
JAMB - OPERABLE PANEL
3-TRACK - INSULATED GLASS

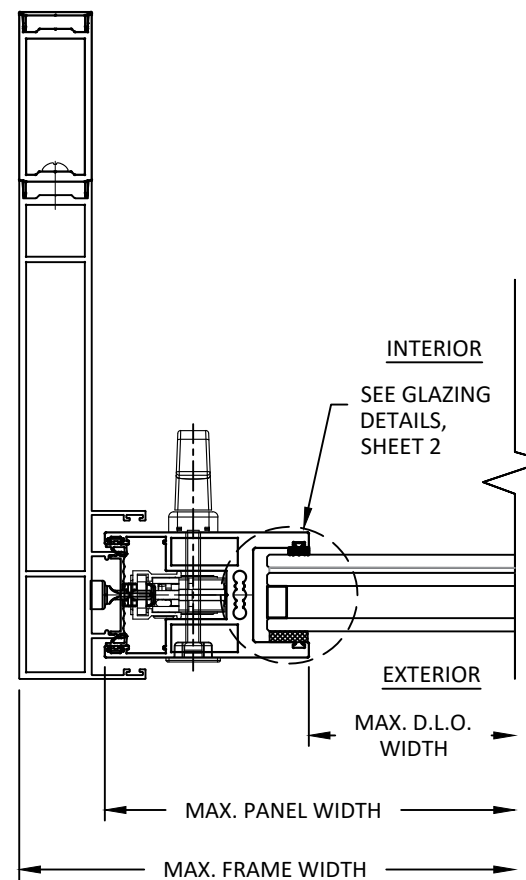

**L
9** HORIZONTAL SECTION
JAMB - OPERABLE PANEL
4-TRACK - INSULATED GLASS

LINEA ROSSA®
WINDOWS & DOORS

1850 NW. 84TH AVE., STE. 114
DORAL, FL 33126
PH: (305)815-8797

TITLE: LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)


HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS
FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE
INSTALLATION TO DEVIATE FROM THE REQUIREMENTS
DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT
SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE
WITH THIS DOCUMENT.

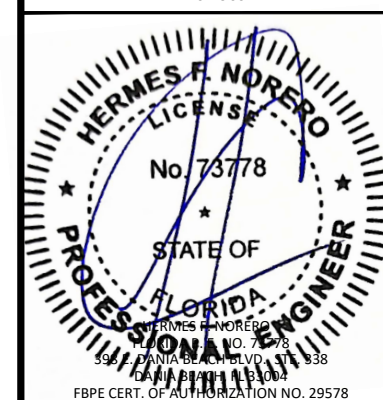

FL42288

DATE: 07.03.2023

DWG. BY:
SH


CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **LRA009**

SHEET: OF 12


9

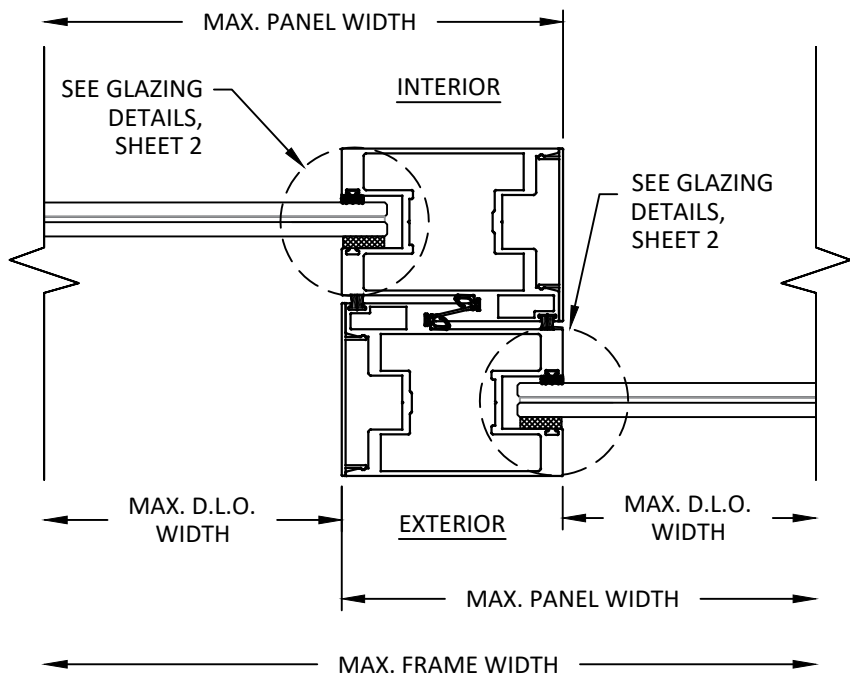


M
10
HORIZONTAL SECTION
INTERLOCK - OPTION 1
LAMINATED GLASS SHOWN

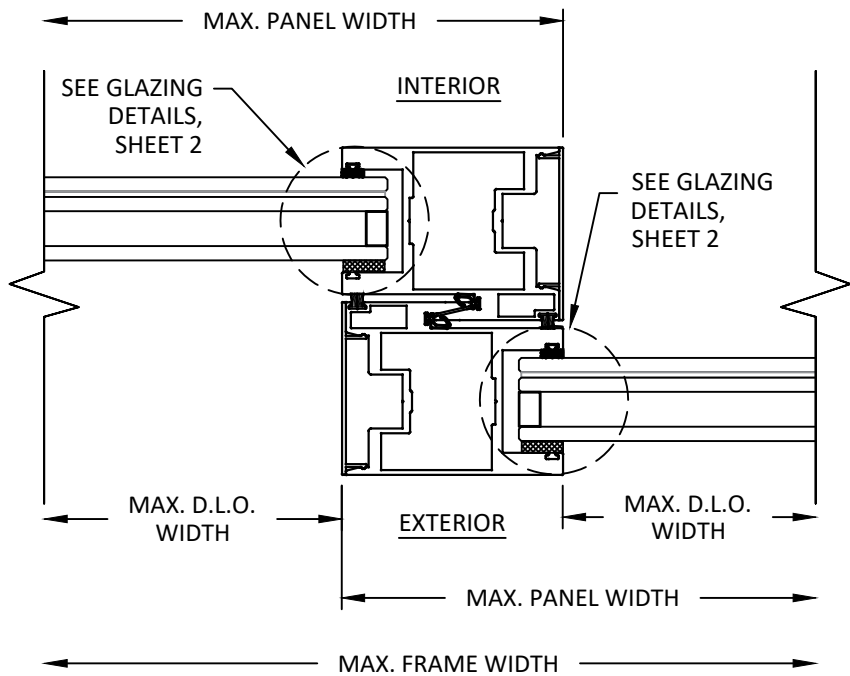


N
10
HORIZONTAL SECTION
INTERLOCK - OPTION 1
INSULATED GLASS SHOWN

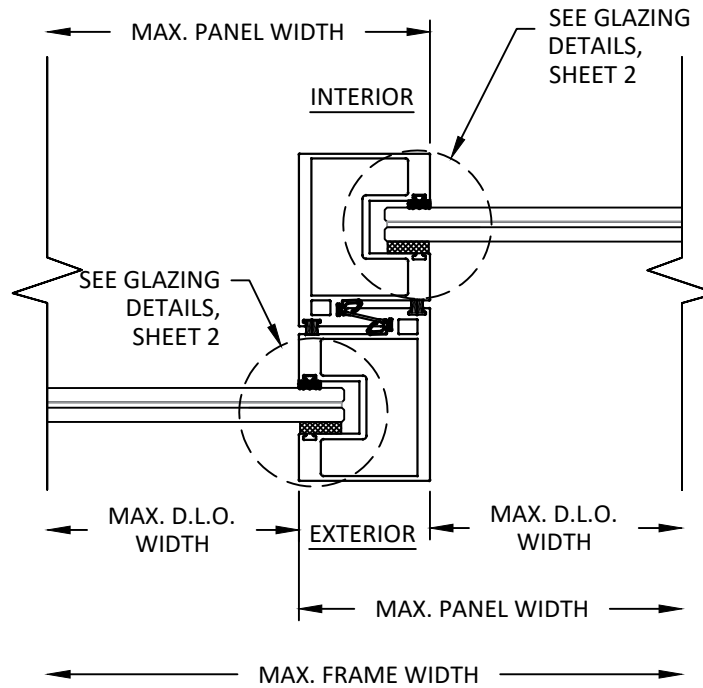


O
10
HORIZONTAL SECTION
INTERLOCK - OPTION 2
LAMINATED GLASS SHOWN

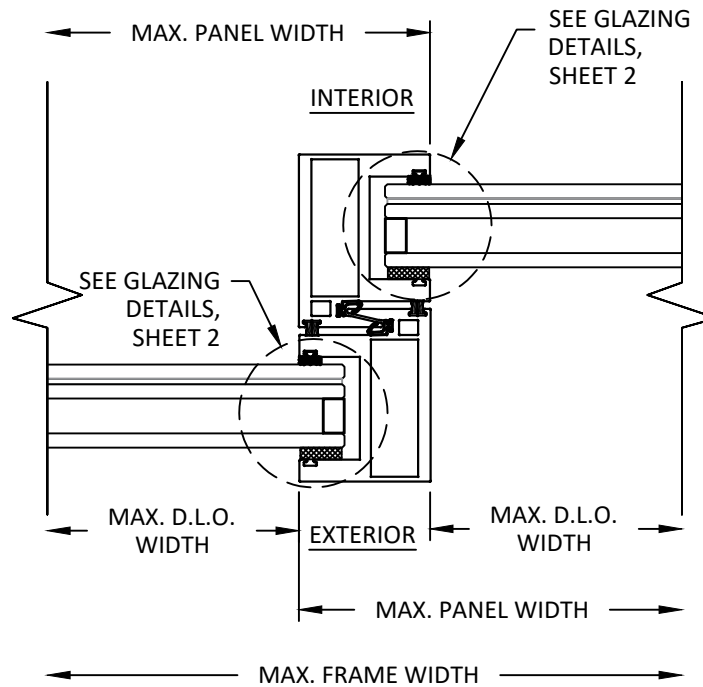

P
10
HORIZONTAL SECTION
INTERLOCK - OPTION 2
INSULATED GLASS SHOWN

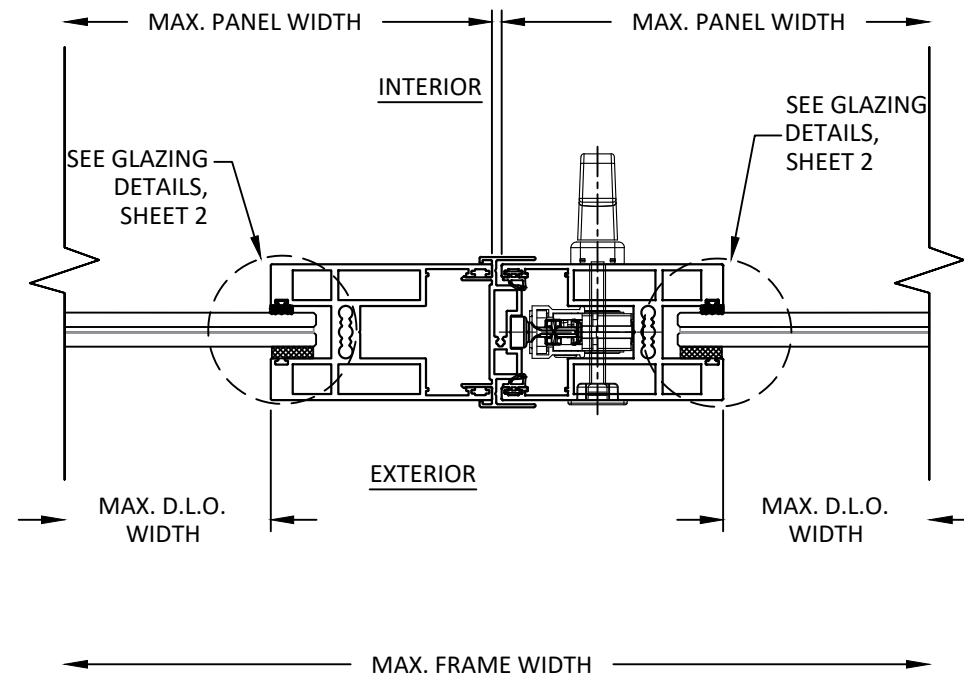

Q
10
HORIZONTAL SECTION
MEETING STILE
LAMINATED GLASS SHOWN

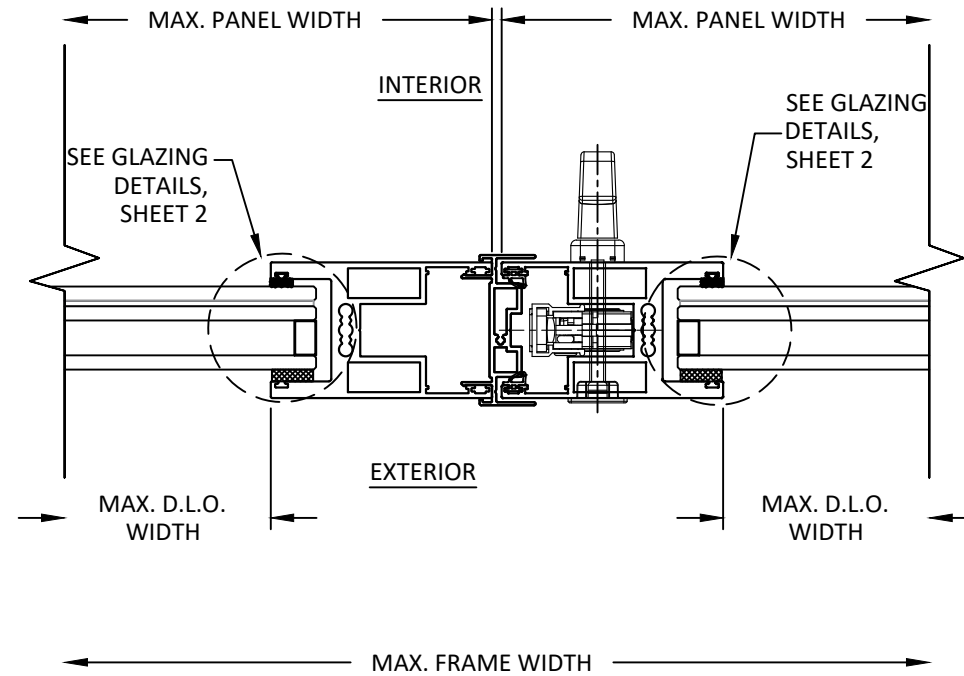

R
10
HORIZONTAL SECTION
MEETING STILE
INSULATED GLASS SHOWN

LINEA ROSSA®
WINDOWS & DOORS

1850 NW. 84TH AVE., STE. 114
DORAL, FL 33126
PH: (305)815-8797

TITLE: LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)


HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS
FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE
INSTALLATION TO DEVIATE FROM THE REQUIREMENTS
DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT
SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE
WITH THIS DOCUMENT.

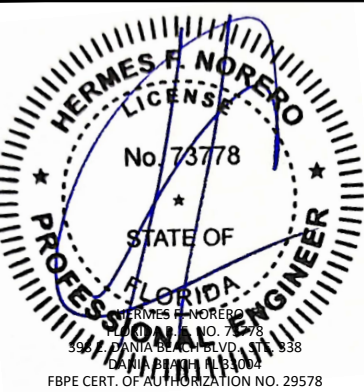


FL42288	
DATE: 07.03.2023	
DWG. BY: SH	CHK. BY: HFN
SCALE: NTS	
DWG. #: LRA009	
SHEET:	OF 12

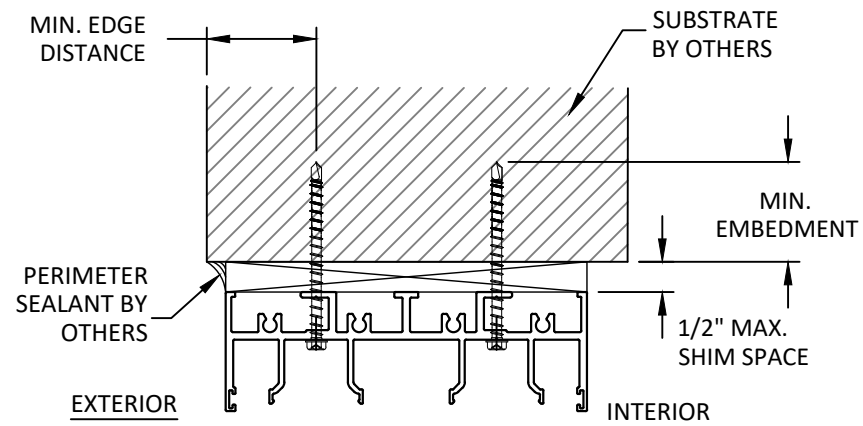

A
11

ANCHOR DETAIL


THROUGH FRAME (HEAD)
2-TRACK

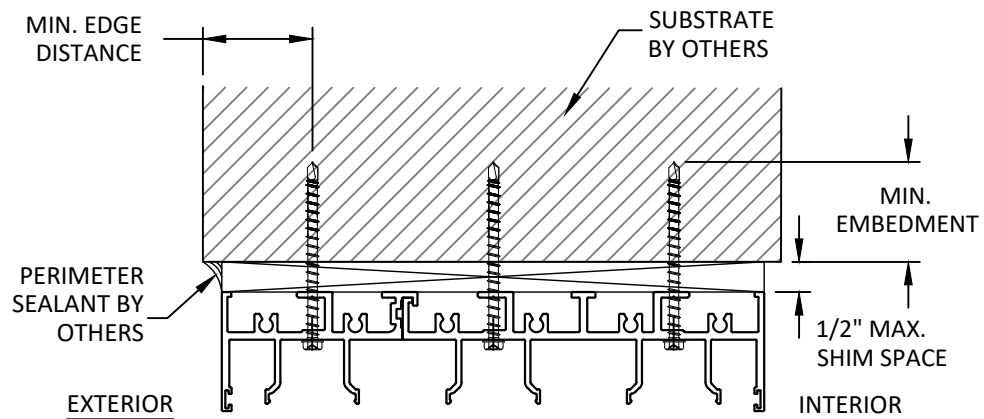

B
11

ANCHOR DETAIL


THROUGH FRAME (HEAD)
3-TRACK

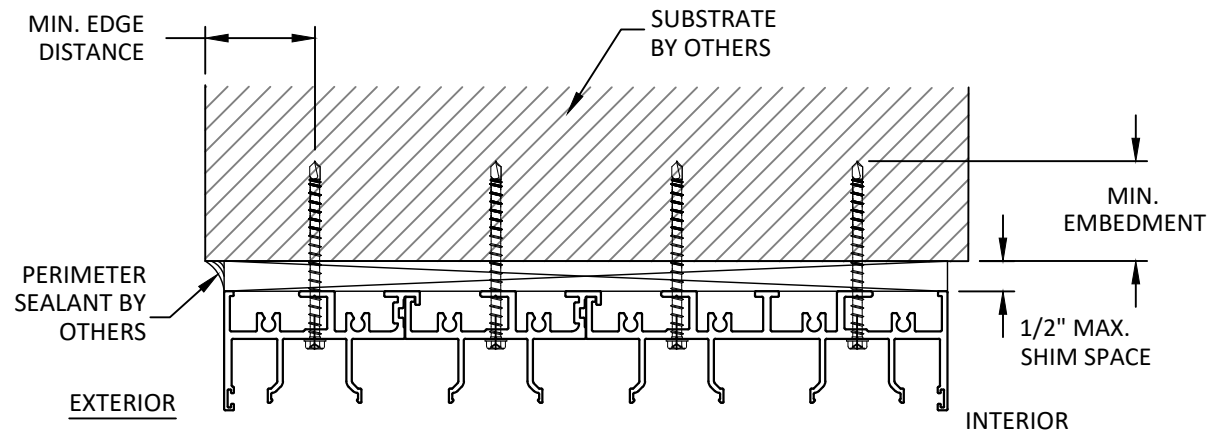

C
11

ANCHOR DETAIL

THROUGH FRAME (HEAD)
4-TRACK

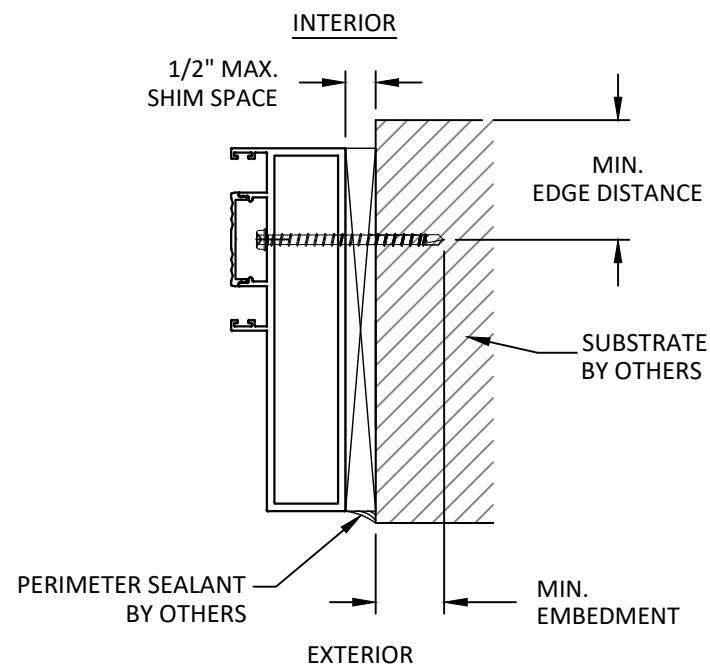

D
11

ANCHOR DETAIL

THROUGH FRAME (JAMB)
2-TRACK SHOWN (3 & 4 TRACK SIMILAR)

ANCHOR SCHEDULE					
METHOD	SUBSTRATE TYPE	SUBSTRATE	ANCHOR TYPE	MIN EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	A	WOOD: MIN. SG = 0.55	5 / 16" DEWALT ULTRACON	1.50"	1.50"
	B	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM .125" MIN, 6063-T5 MIN	1 / 4" DEWALT DRILL-FLEX	3 THREADS MIN. PENETRATION BEYOND METAL	0.75"
	C	CONCRETE: f'c=3000PSI	5 / 16" DEWALT ULTRACON	1.75"	2.50"
	D	MASONRY: CMU per ASTM C90 MIN. 2000 PSI		1.75"	2.50"

LINEA ROSSA®
WINDOWS & DOORS

1850 NW. 84TH AVE., STE. 114
DORAL, FL 33126
PH: (305)815-8797

TITLE: LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)


ANCHOR DETAILS & ANCHOR SCHEDULE

PREPARED BY: BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

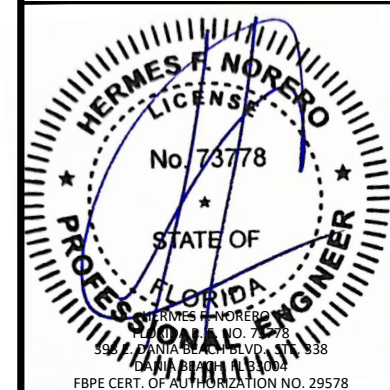

FL42288

DATE: 07.03.2023

DWG. BY:
SH


CHK. BY:
HFN

SCALE: NTS

DWG. #: LRA009


SHEET: OF 12

11

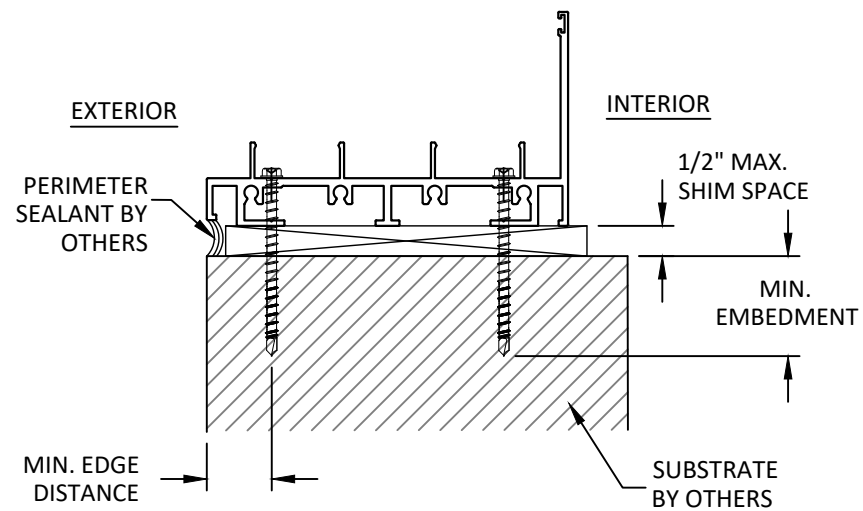


E
12

ANCHOR DETAIL
THROUGH FRAME (SILL)
2-TRACK

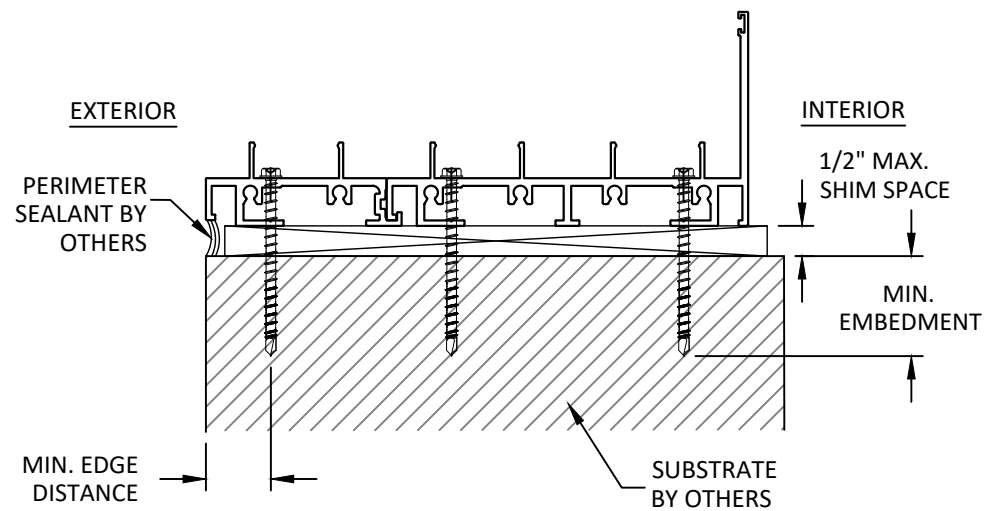

F
12

ANCHOR DETAIL
THROUGH FRAME (SILL)
3-TRACK

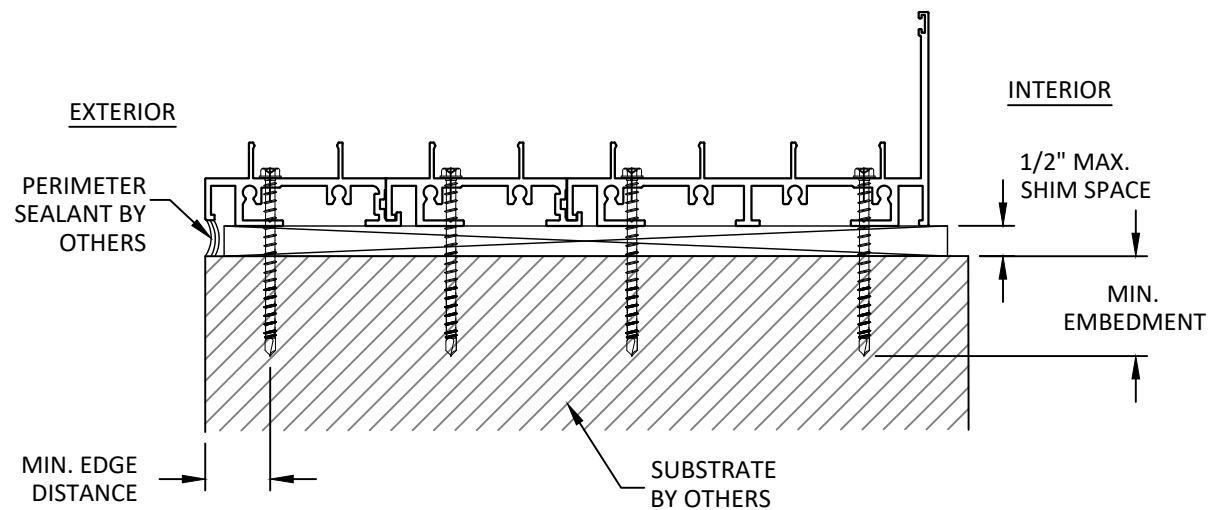

G
12

ANCHOR DETAIL
THROUGH FRAME (SILL)
4-TRACK

TITLE: LRWAD-280 SLIDING GLASS DOOR
& LIFT & SLIDE SYSTEMS
(HVHZ)/(IMPACT)


ANCHOR DETAILS CONTINUED

PREPARED BY: **BUILDING DROPS, INC.**
398 E. DANIA BEACH BLVD., STE. 338
DANIA BEACH, FL 33004
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS
FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE
INSTALLATION TO DEVIATE FROM THE REQUIREMENTS
DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT
SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE
WITH THIS DOCUMENT.

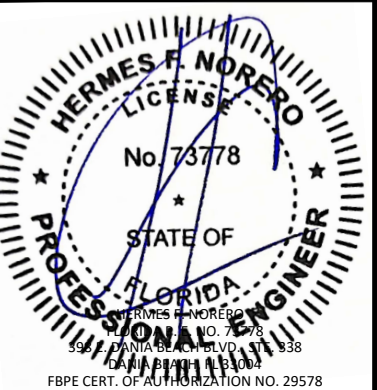

FL42288

DATE: 07.03.2023

DWG. BY:
SH

CHK. BY:
HFN

SCALE: NTS

DWG. #: LRA009

SHEET: OF 12

12