



Product Evaluation Report
DIMENSIONAL METALS, INC.

IL 20 24 Ga. 18" Wide Roof Panel over 19/32" OSB/Plywood

Florida Product Approval # 4236.3 R8


Florida Building Code 2026
Per Rule 61G20-3
Method: 1 -D

Category: Roofing
Subcategory: Metal Roofing
Compliance Method: 61G20-3.005(1)(d)
NON HVHZ

Product Manufacturer:
[Dimensional Metals, Inc.](#)
819 South Salisbury GQ Ave.
Salisbury, NC 28146

Engineer Evaluator:
[Johnathan Green, P.E. #88223](#)
Florida Evaluation ANE ID: 12901

Contents:
[Evaluation Report: Page 1 - 3](#)
[Installation Detail: Page 4](#)

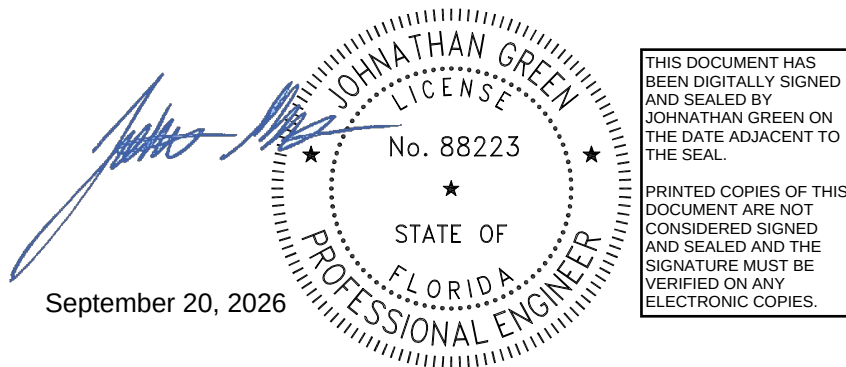



Compliance Statement: The product as described in this report has demonstrated compliance with the Florida Building Code 2026, Sections 1504.3.2.

Product Description: IL 20, 1 3/4" Snap Lock Standing Seam Roof Panel, 24 Ga., 18" Wide, Roof Panel restrained with clips at 30" O.C. over 19/32" OSB or 19/32" Plywood Deck. Non-structural Application.

Panel Material/Standards: Material: 24 Ga. Steel, ASTM A792 or ASTM A653 G90 conforming to Florida Building Code 2026 Section 1507.4.3.
 Paint Finish: Optional
 Corrosion Resistance: Panel Material shall comply with Florida Building Code 2026, Section 1507.4.3.

Panel Dimension(s): Thickness: 0.023"
 Width: 18" Max Coverage
 Rib Height: 1-3/4"
 Panel Seam: Snap Seam

Roof Panel Clips: Product Name: IL20 Clip, One Piece fixed
 Description: 18 Ga. Steel, 3 5/8" long
 Corrosion Resistance: Per Florida Building Code 2026 Section 1506.7 and Section 1711 for installations within 3000 ft. of a saltwater coastline.

Panel Clip Fasteners: (2) #10-12 Pancake Type A
 3/16" minimum penetration through plywood
 Corrosion Resistance: Per Florida Building Code 2026 Section 1506.6, 1507.4.4 and Section 1711 for installations within 3000 ft. of a saltwater coastline.

Substrate Description: Min. 19/32" OSB or 19/32" Plywood, APA Rated. Design of OSB/plywood and OSB/plywood supports are outside the scope of this evaluation. Substrate must be designed in accordance w/ Florida Building Code 2026.

Allowable Design Uplift Pressures:


Table "A"

Maximum Allowable Design Uplift Pressure:	52.5 psf
Clip Spacing:	30" O.C.
# Fasteners per Clip:	2


*Design Pressure includes a Safety Factor = 2.0.




Code Compliance:	The product described herein has demonstrated compliance with The Florida Building Code 2026, Section 1504.3.2.
Evaluation Report Scope:	The product evaluation is limited to compliance with the structural wind load requirements of the Florida Building Code 2026, as relates to Rule 61G20-3.
Performance Standards:	The product described herein has demonstrated compliance with: § UL 580-06 - Test for Uplift Resistance of Roof Assemblies
Reference Data:	1. UL 580-94 Uplift Test Underwriters Laboratories, Inc. UL File R15841, UL Construction #498A 2. Certificate of Independence By Johnathan Green, P.E. (No. 88223) @ Force Engineering & Testing (FBC Organization # ANE ID: 12901)
Test Standard Equivalency:	1. The UL 580-94 test standard is equivalent to the UL 580-06 test standard.
Quality Assurance Entity:	The manufacturer has established compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity.
Minimum Slope Range:	Minimum Slope shall comply with Florida Building Code 2026, including Sections 1507.4.2 and in accordance with Manufacturers recommendations.
Installation:	Install per manufacturer's recommended details.
Limitation:	Metal hip and ridge covers are outside the scope of this evaluation report and must be in compliance with FBC 2026 Section 1504.3.1.1 through other product approval.
Underlayment:	Per Florida Building Code 2026, Section 1507.1.1 and manufacturer's installation guidelines.
Roof Panel Fire Classification:	Fire classification is not part of this acceptance.
Shear Diaphragm:	Shear diaphragm values are outside the scope of this report.
Design Procedure:	Based on the dimensions of the structure, appropriate wind loads are determined using Chapter 16 of the Florida Building Code 2026 for roof cladding wind loads. These component wind loads for roof cladding are compared to the allowable pressure listed above. The design professional shall select the appropriate erection details to reference in his drawings for proper fastener attachment to his structure and analyze the panel fasteners for pullout and pullover. Support framing must be in compliance with Florida Building Code 2026 Chapter 22 for steel, Chapter 23 for wood and Chapter 16 for structural loading.

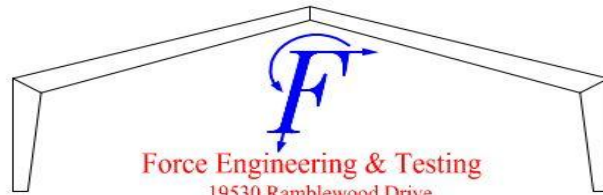


Force Engineering & Testing
 19530 Ramblewood Drive
 Humble, Texas 77338
 Office: (281) 540-6603 Test Lab: (832) 720-4251
www.forceengineeringtesting.com

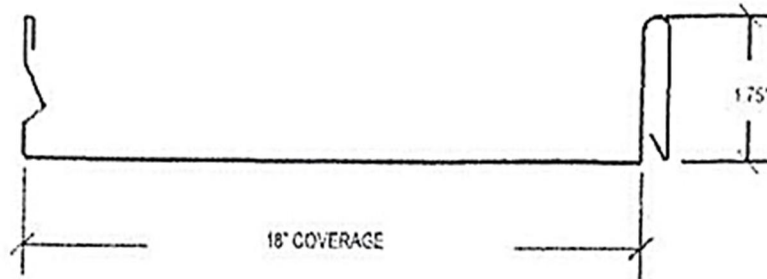

IL2018 PANEL PROFILE

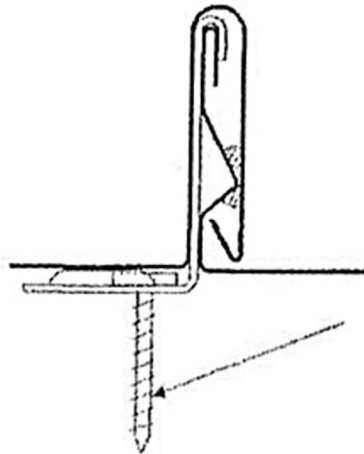

IL20 SEAM PROFILE

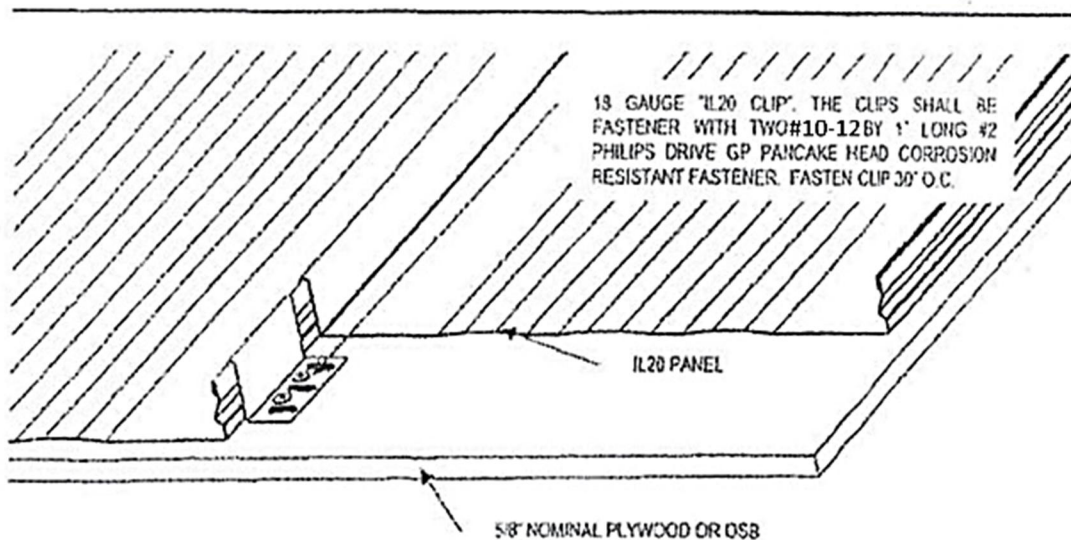

IL20 ASSEMBLY ISOMETRIC

FL# 4236.3 R8