



PUNTO GOLD USA, LLC

ELEGANTE SERIES ENTRANCE DOORS

(HVHZ) (IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) **INCLUDING** HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA 1304-18
 - ASTM E283-19
 - ASTM E331-00(23)
 - ASTM F588-07
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. FRAME MATERIAL: ALUMINUM 6060-T5.
8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

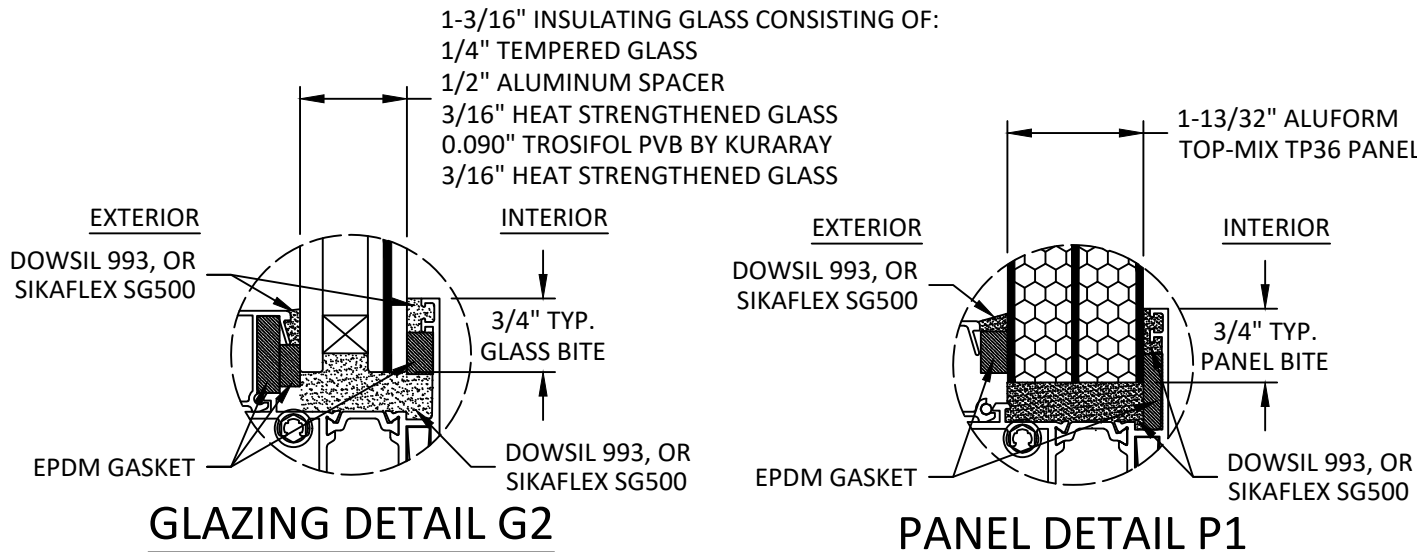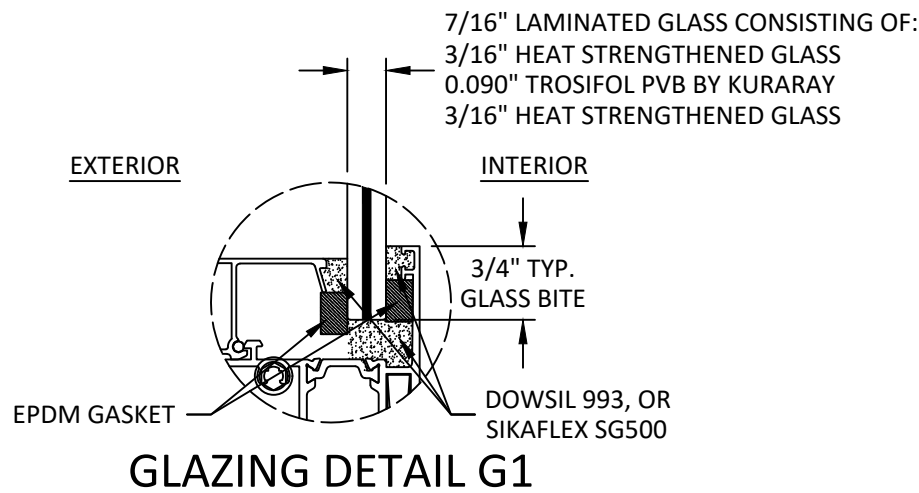

GLAZING NOTES:

1. GLASS TYPE & THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN SHEETS 2 - 4.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAILS
2	TYPICAL ELEVATIONS AND DESIGN PRESSURE TABLES
3	ANCHOR LAYOUTS AND DESIGN PRESSURE TABLES
4	ANCHOR LAYOUTS AND DESIGN PRESSURE TABLES
5	VERTICAL SECTIONS
6	HORIZONTAL SECTIONS
7	INSTALLATION DETAILS AND NOTES

DESIGN PRESSURE RATING		
FRAME SIZE	DESIGN PRESSURE	MISSILE RATING
SEE SHEETS 2 - 4		LARGE AND SMALL MISSILE IMPACT

NOTE: WHEN INSTALLED AT A LOCATION PROTECTED BY AN OVERHANG SUCH THAT:

- OVERHANG (OH) RATIO =
 $OH \text{ LENGTH} \div OH \text{ HEIGHT} \geq 1.0$,
PRODUCT REQUIRES LIMITED WATER (LW) TESTING IN HVHZ.




FIGURE A

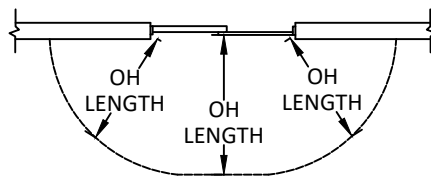


FIGURE B

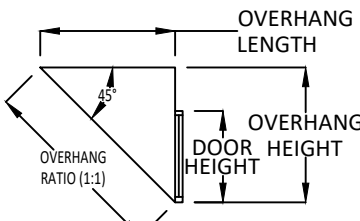


FIGURE C



240 SOUTH ANDREWS AVENUE, SUITE 3
POMPANO BEACH, FL 33069
PH: 800-676-7051

TITLE: ELEGANTE SERIES ENTRANCE DOORS (HVHZ) (IMPACT)

GENERAL NOTES & GLAZING DETAILS


PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 395-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

B.D.
BUILDING DROPS

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	07/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.21 16:21:50 -03'00'

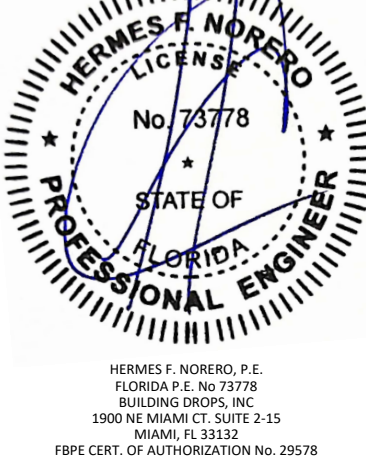

FL #:	FL42463
DATE:	08.21.2023
DWG. BY:	MS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	PGU008
SHEET:	1
REV.	A
OF 7	

c:\users\harley\my\building drops, inc\building drops landing - common\projects\2026 code change\projects\punto gold usa, llc\cc-26-6125.1 - 2026 code change\dwgs\142463\pgu008-a.dwg 7/28/2026 11:32 AM

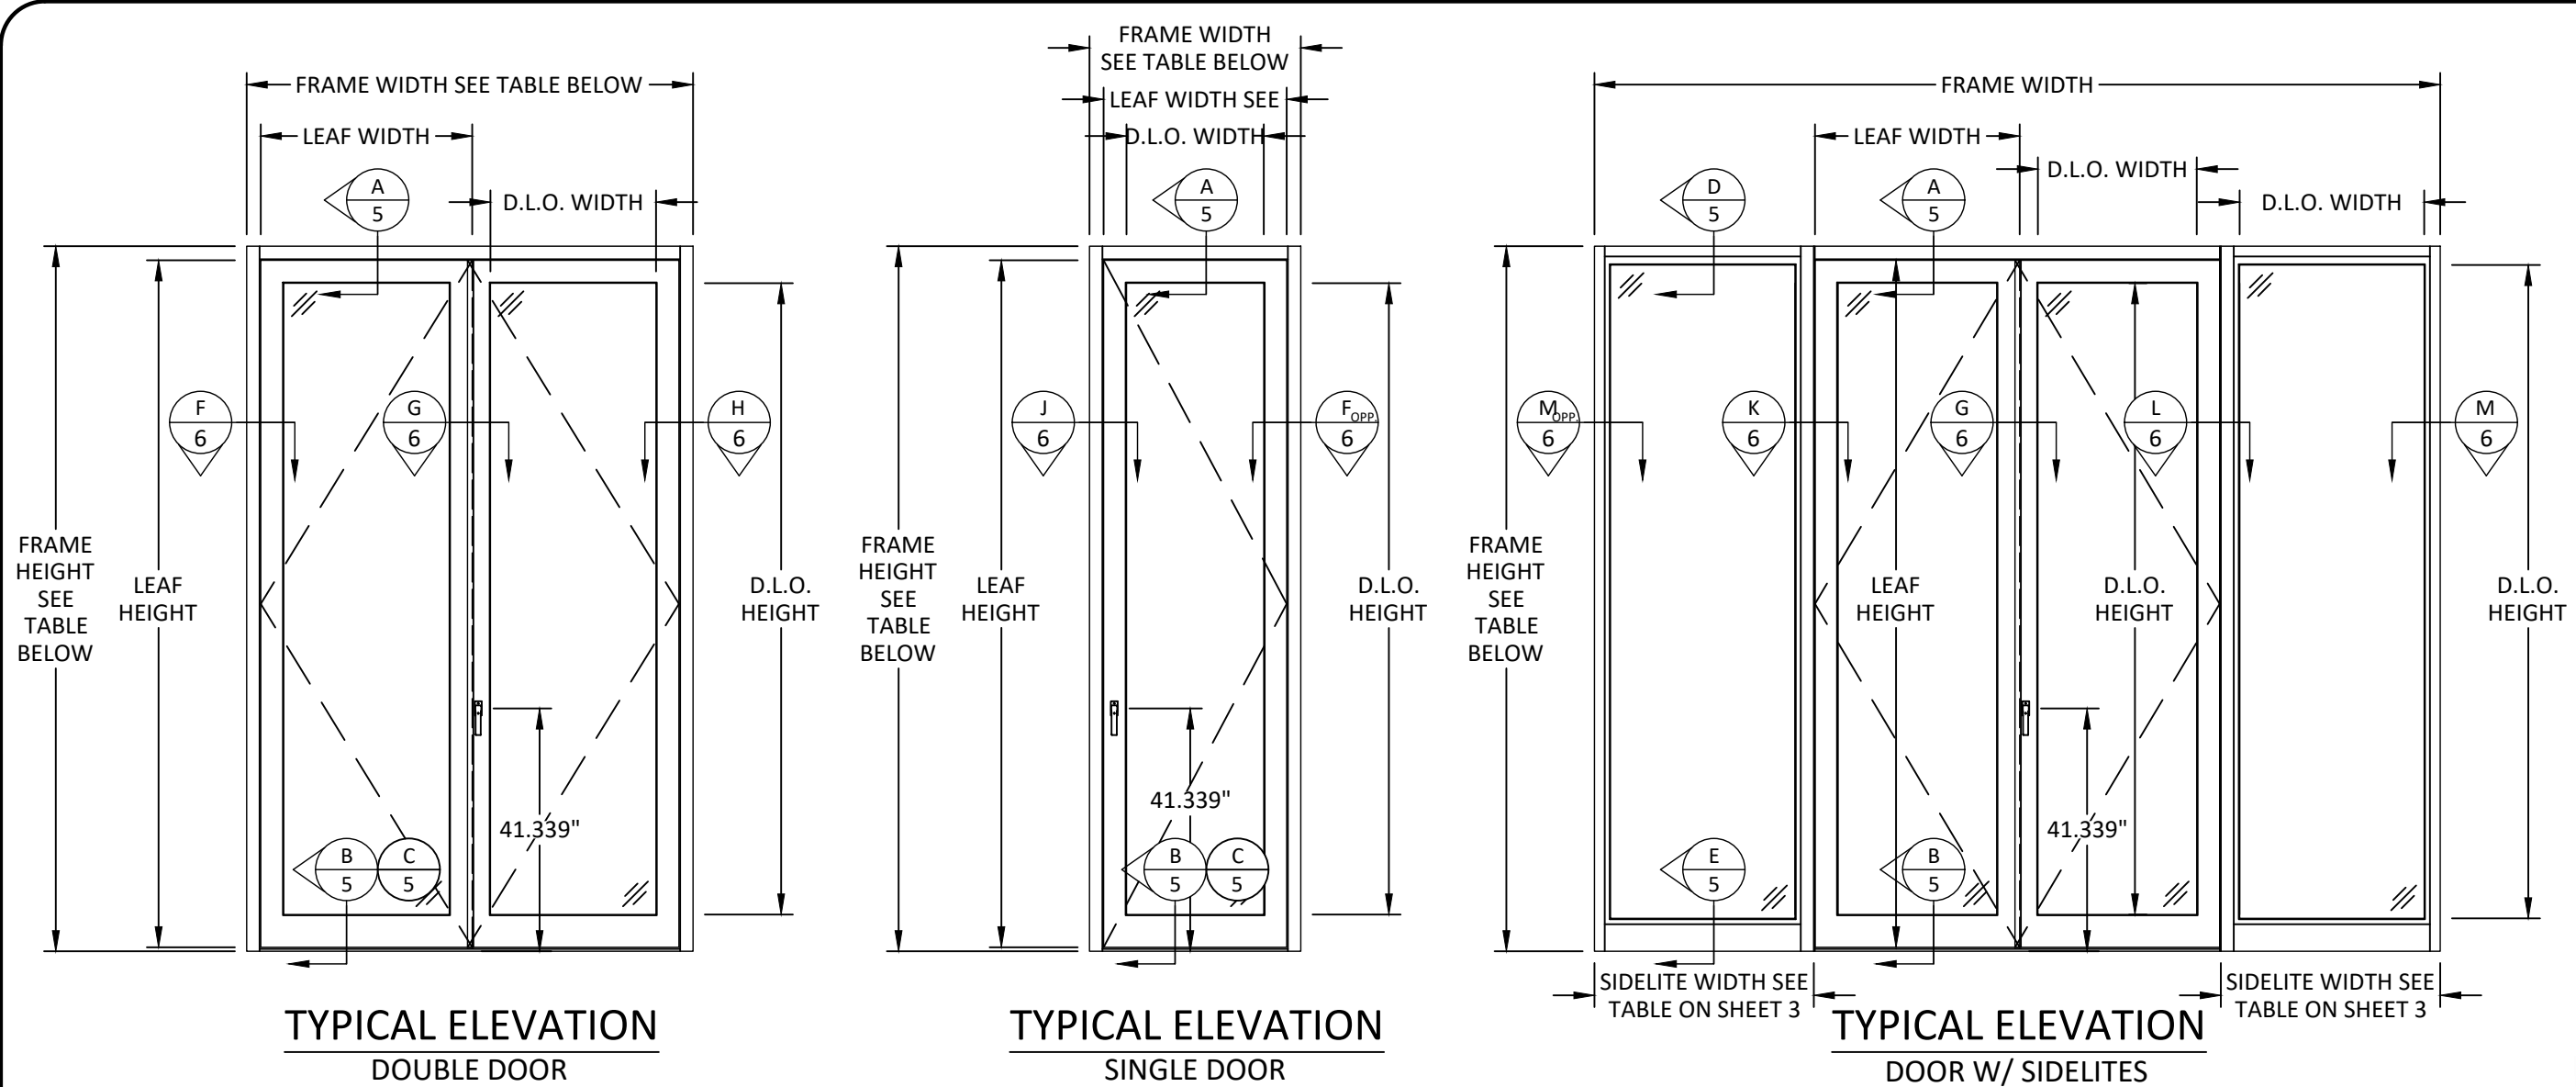

ELEGANTE SERIES SINGLE DOOR DESIGN PRESSURE TABLE - G1 & P1										
		FRAME WIDTH (IN.)								
		30	33	36	38	39	42	45	48	51
FRAME HEIGHT (IN.)	72	95.00	95.00	95.00	95.00	91.75	83.20	76.10	70.13	65.02
	78	95.00	95.00	95.00	95.00	91.75	83.20	76.10	70.13	65.02
	84	95.00	95.00	95.00	95.00	91.75	83.20	76.10	70.13	65.02
	90	95.00	95.00	95.00	95.00	91.75	83.20	76.10	70.13	-
	96	95.00	95.00	95.00	92.04	90.27	83.20	76.10	-	-
	102	95.00	95.00	89.06	85.39	83.70	79.16	-	-	-
	108	95.00	89.19	83.12	79.63	78.03	-	-	-	-
FRAME HEIGHT (IN.)	114	86.71	79.30	73.16	69.63	68.01	-	-	-	-
	120	74.14	67.76	65.00	62.56	-	-	-	-	-

ELEGANTE SERIES DOUBLE DOOR DESIGN PRESSURE TABLE - G1 & P1										
		FRAME WIDTH (IN.)								
		60	66	72	76	78	84	90	96	102
FRAME HEIGHT (IN.)	72	95.00	95.00	95.00	95.00	91.75	83.20	76.10	70.13	65.02
	78	95.00	95.00	95.00	95.00	91.75	83.20	76.10	70.13	65.02
	84	95.00	95.00	95.00	95.00	91.75	83.20	76.10	70.13	65.02
	90	95.00	95.00	95.00	95.00	91.75	83.20	76.10	70.13	-
	96	95.00	95.00	95.00	92.04	90.27	83.20	76.10	-	-
	102	95.00	95.00	89.06	85.39	83.70	79.16	-	-	-
	108	95.00	89.19	83.12	79.63	78.03	-	-	-	-
FRAME HEIGHT (IN.)	114	86.71	79.30	73.16	69.63	68.01	-	-	-	-
	120	74.14	67.76	65.00	62.56	-	-	-	-	-

ELEGANTE SERIES SINGLE DOOR DESIGN PRESSURE TABLE - G2										
		FRAME WIDTH (IN.)								
		30	33	36	38	39	42	45	48	51
FRAME HEIGHT (IN.)	72	85.00	85.00	85.00	85.00	82.09	74.44	68.09	62.75	58.18
	78	85.00	85.00	85.00	85.00	82.09	74.44	68.09	62.75	58.18
	84	85.00	85.00	85.00	85.00	82.09	74.44	68.09	62.75	58.18
	90	85.00	85.00	85.00	85.00	82.09	74.44	68.09	62.75	-
	96	85.00	85.00	85.00	82.35	80.76	74.44	68.09	-	-
	102	85.00	85.00	79.68	76.40	74.89	70.83	-	-	-
	108	85.00	79.80	74.37	71.25	69.81	-	-	-	-
FRAME HEIGHT (IN.)	114	77.58	70.95	65.46	65.00	65.00	-	-	-	-
	120	66.34	65.00	65.00	62.56	-	-	-	-	-

ELEGANTE SERIES DOUBLE DOOR DESIGN PRESSURE TABLE - G2										
		FRAME WIDTH (IN.)								
		60	66	72	76	78	84	90	96	102
FRAME HEIGHT (IN.)	72	85.00	85.00	85.00	85.00	82.09	74.44	68.09	62.75	58.18
	78	85.00	85.00	85.00	85.00	82.09	74.44	68.09	62.75	58.18
	84	85.00	85.00	85.00	85.00	82.09	74.44	68.09	62.75	58.18
	90	85.00	85.00	85.00	85.00	82.09	74.44	68.09	62.75	-
	96	85.00	85.00	85.00	82.35	80.76	74.44	68.09	-	-
	102	85.00	85.00	79.68	76.40	74.89	70.83	-	-	-
	108	85.00	79.80	74.37	71.25	69.81	-	-	-	-
FRAME HEIGHT (IN.)	114	77.58	70.95	65.46	65.00	65.00	-	-	-	-
	120	66.34	65.00	65.00	62.56	-	-	-	-	-

FOR DOUBLE DOOR:
LEAF WIDTH = FRAME WIDTH/2 - 2.009"
LEAF HEIGHT = FRAME HEIGHT - 3.071"
FOR SINGLE DOOR:
LEAF WIDTH = FRAME WIDTH - 4.804"
LEAF HEIGHT = FRAME HEIGHT - 3.071"
FOR SINGLE & DOUBLE DOOR:
D.L.O. WIDTH = LEAF WIDTH - 7.798"
D.L.O. HEIGHT = LEAF HEIGHT - 9.489"
FOR SIDELITE:
D.L.O. WIDTH = FRAME WIDTH - 4.568"
D.L.O. HEIGHT = FRAME HEIGHT - 8.779"



240 SOUTH ANDREWS AVENUE, SUITE 3
POMPANO BEACH, FL 33069
PH: 800-676-7051

TITLE:
ELEGANTE SERIES ENTRANCE DOORS
(HVHZ) (IMPACT)


TYPICAL ELEVATIONS &
DESIGN PRESSURE TABLES

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 395-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

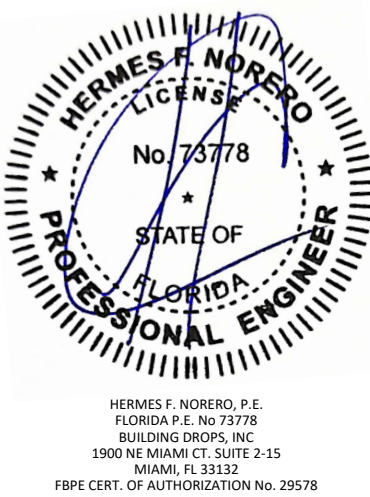

FL #:
FL42463

DATE:
08.21.2023

DWG. BY:
MS

CHK. BY:
HFN

SCALE:
NTS


DWG. #:
PGU008

SHEET:
2

REV.
A

OF 7

c:\users\harley\pnt\building drops, inc\building drops landing - common\projects\2026 code change projects\punto gold usa, llc\ccc-26-6125.1 - 2026 code change\dwgs\142463\pgu008-a.dwg 7/28/2026 11:32 AM

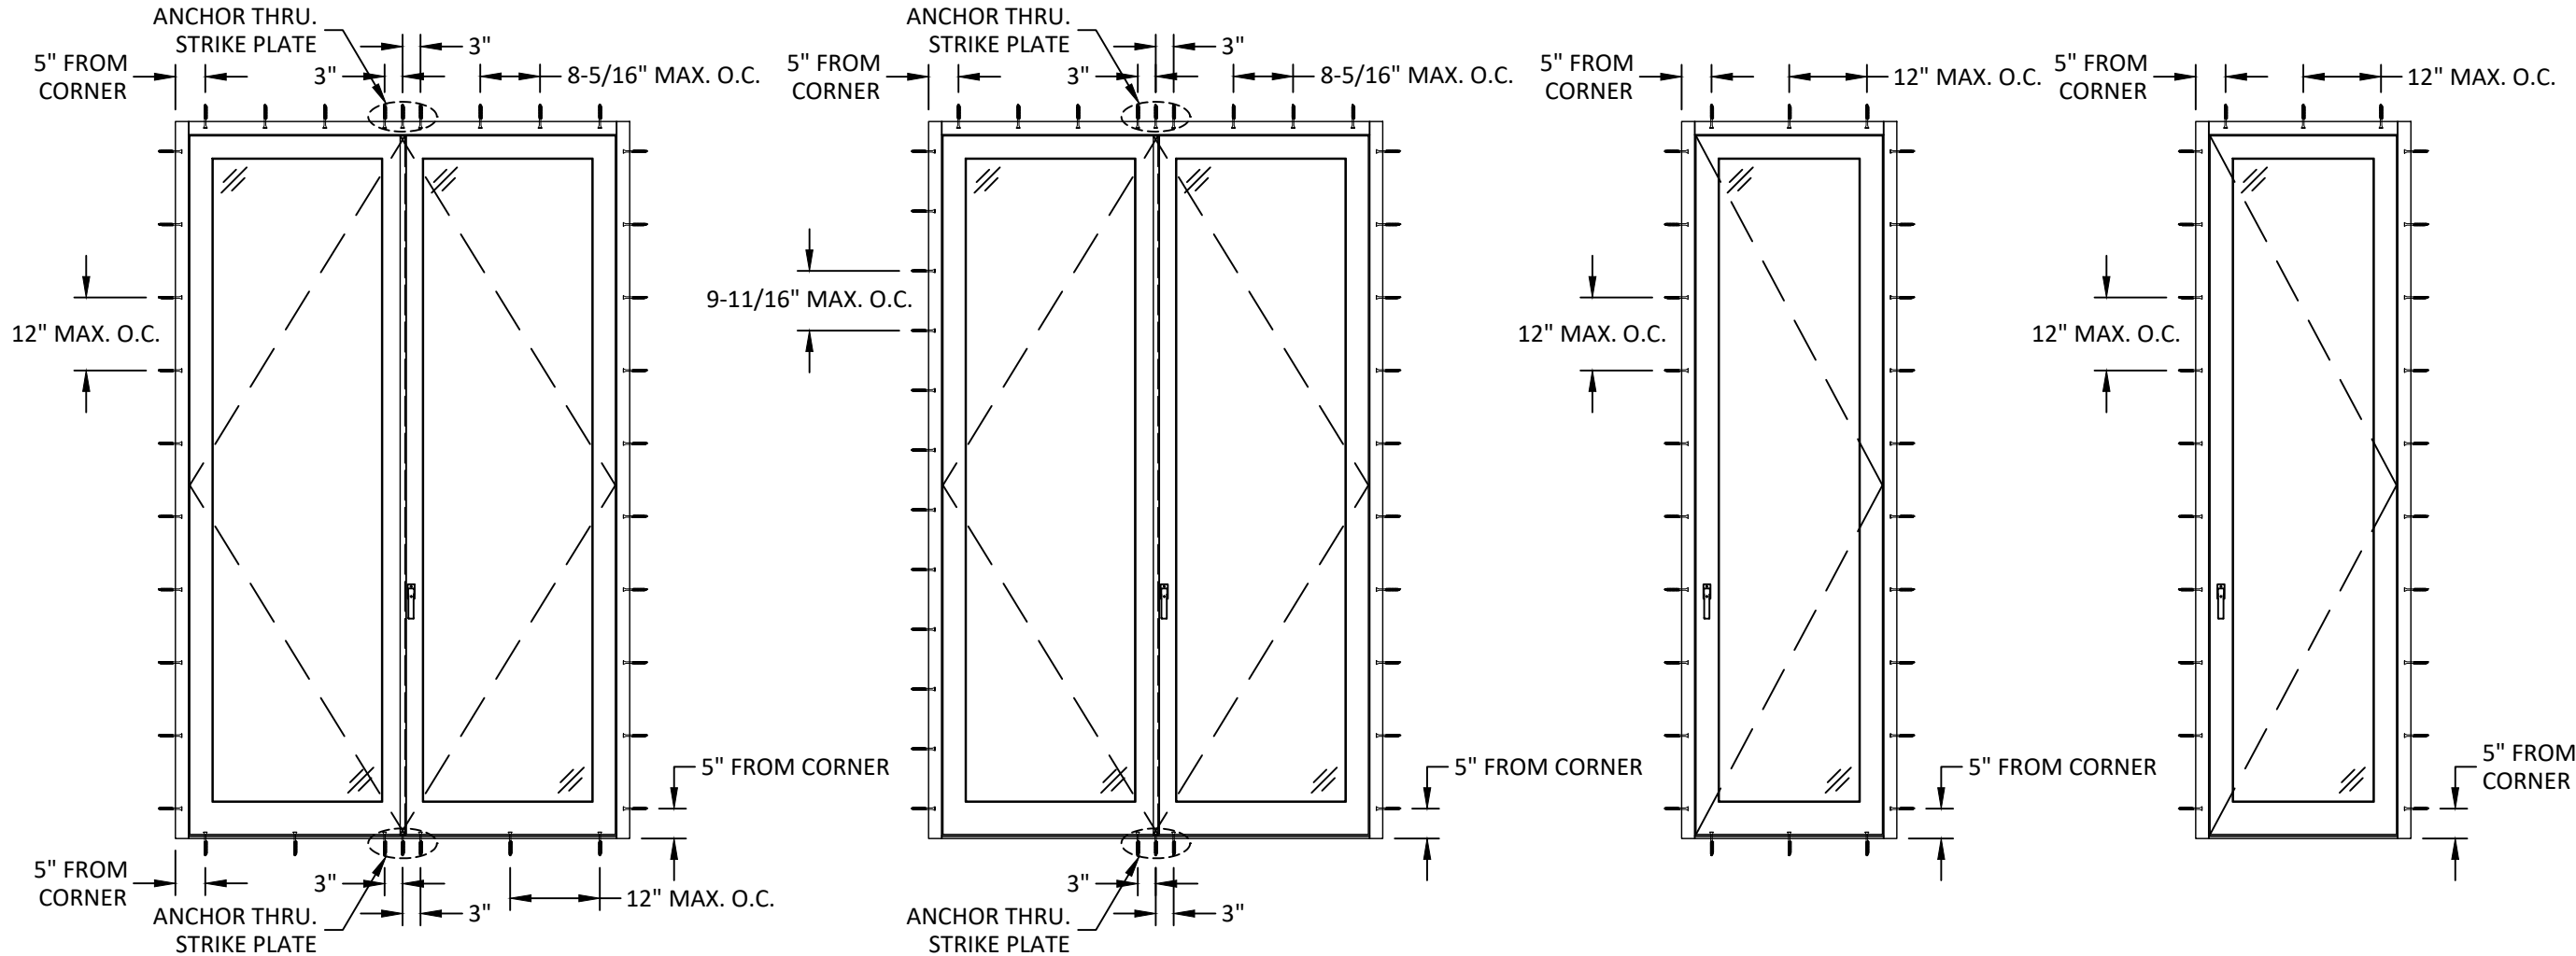

ANCHOR LAYOUT
DOUBLE DOOR
W/ SILL B/5

ANCHOR LAYOUT
DOUBLE DOOR
W/ SILL C/5

ANCHOR LAYOUT
SINGLE DOOR
W/ SILL B/5

ANCHOR LAYOUT
SINGLE DOOR
W/ SILL C/5

ELEGANTE SERIES SIDELITE DESIGN PRESSURE TABLE - G1 & P1*											
		SIDELITE WIDTH (IN.)									
		30	33	36	39	42	45	48	51	54	57
FRAME HEIGHT (IN.)	72	95.00	95.00	95.00	86.72	79.77	73.85	68.75	64.31	60.41	56.95
	78	95.00	95.00	95.00	86.72	79.77	73.85	68.75	64.31	60.41	-
	84	95.00	95.00	95.00	86.72	79.77	73.85	68.75	64.31	-	-
	90	95.00	95.00	95.00	86.72	79.77	73.85	-	-	-	-
	96	95.00	95.00	94.29	86.72	79.77	-	-	-	-	-
	102	95.00	95.00	92.97	86.55	79.77	-	-	-	-	-
	108	95.00	95.00	91.85	85.38	-	-	-	-	-	-
	114	95.00	95.00	90.87	-	-	-	-	-	-	-
	120	95.00	95.00	90.02	-	-	-	-	-	-	-

ELEGANTE SERIES SIDELITE DESIGN PRESSURE TABLE - G2*											
		SIDELITE WIDTH (IN.)									
		30	33	36	39	42	45	48	51	54	57
FRAME HEIGHT (IN.)	72	85.00	85.00	85.00	77.59	71.38	66.08	61.52	57.54	54.05	50.96
	78	85.00	85.00	85.00	77.59	71.38	66.08	61.52	57.54	54.05	-
	84	85.00	85.00	85.00	77.59	71.38	66.08	61.52	57.54	-	-
	90	85.00	85.00	85.00	77.59	71.38	66.08	-	-	-	-
	96	85.00	85.00	84.36	77.59	71.38	-	-	-	-	-
	102	85.00	85.00	83.19	77.44	71.38	-	-	-	-	-
	108	85.00	85.00	82.18	76.39	-	-	-	-	-	-
	114	85.00	85.00	81.31	-	-	-	-	-	-	-
	120	85.00	85.00	80.54	-	-	-	-	-	-	-

*NOTE: THIS TABLE MUST BE USED WITH "ELEGANTE SERIES SINGLE/DOUBLE DOOR W/ SIDELITE(S) DESIGN PRESSURE TABLE" ON SHEET 4. THE LESSER DP VALUES BETWEEN ALL TABLES SHALL CONTROL THE ALLOWABLE DP OF THE ASSEMBLY.



240 SOUTH ANDREWS AVENUE, SUITE 3
POMPANO BEACH, FL 33069
PH: 800-676-7051

TITLE:
ELEGANTE SERIES ENTRANCE DOORS
(HVHZ) (IMPACT)

ANCHOR LAYOUTS &
DESIGN PRESSURE TABLES

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL42463**

DATE: **08.21.2023**

DWG. BY: **MS** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **PGU008**


SHEET: **3** REV. **A**

OF 7


c:\users\harley\pnt\building drops, inc\building drops landing - common\projects\2026 code change projects\punto gold usa, llc\cc-26-6125.1 - 2026 code change\dwgs\142463\pgu008-a.dwg 7/28/2026 11:32 AM

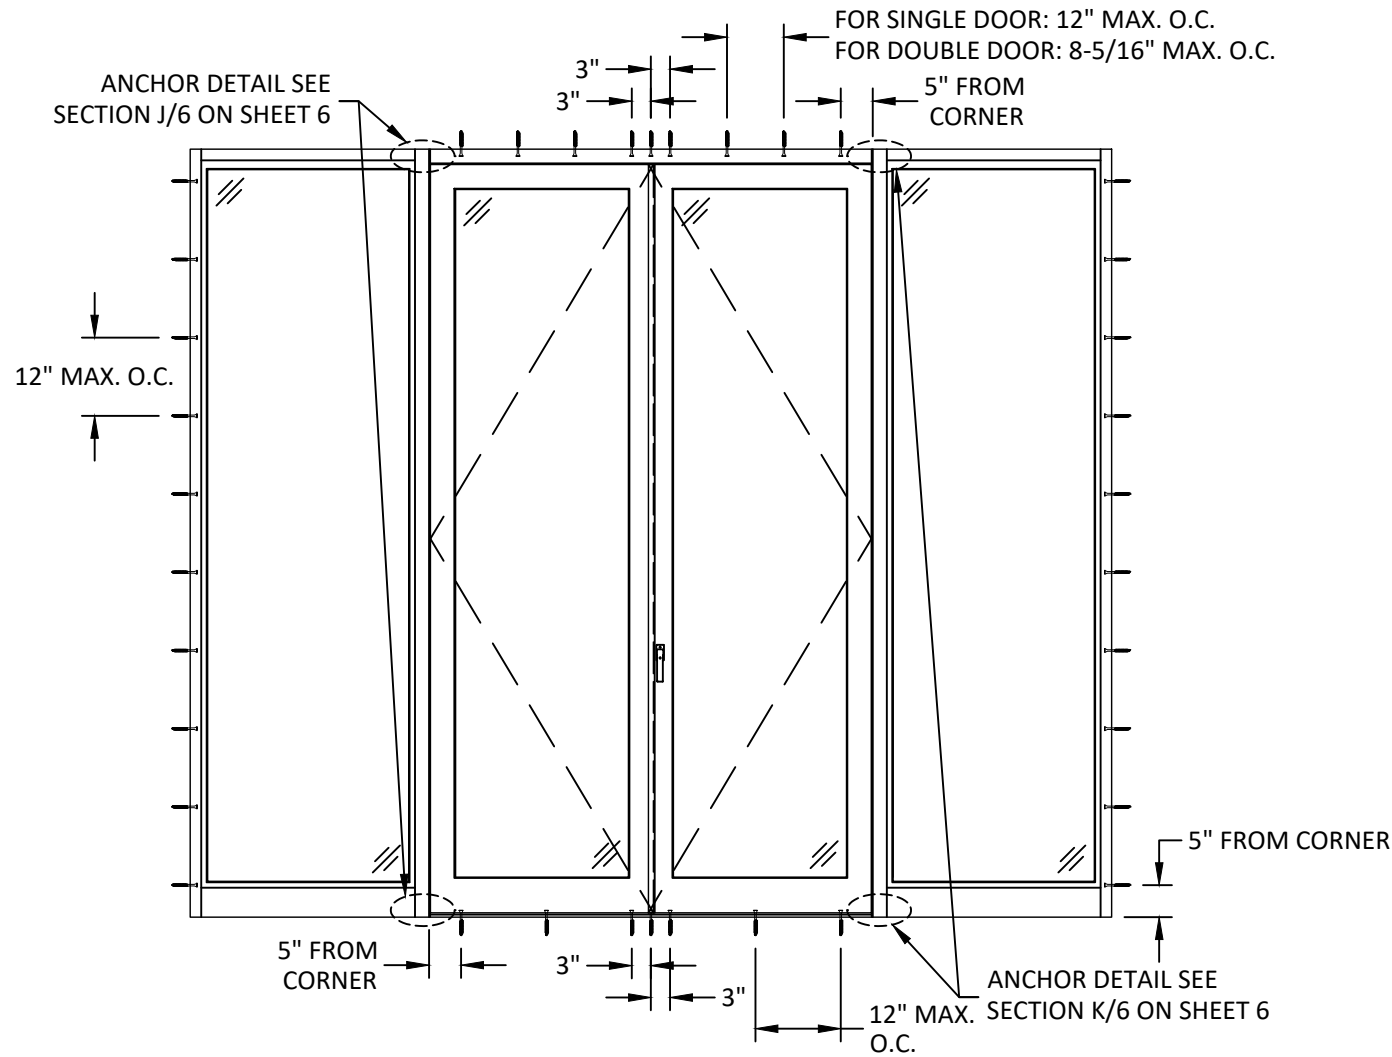

ANCHOR LAYOUT
DOOR W/ SIDELITES

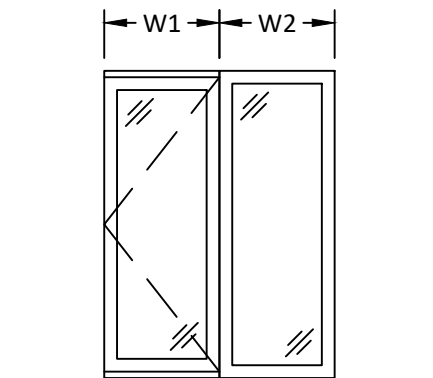

SINGLE DOOR W/ SIDELITE(S)

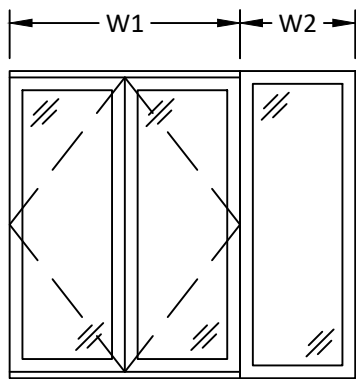

DOUBLE DOOR W/ SIDELITE(S)

TRIBUTARY WIDTH $W = \frac{W1 + W2}{2}$

ELEGANTE SERIES SINGLE DOOR W/ SIDELITE(S) DESIGN PRESSURE TABLE*											
		TRIBUTARY WIDTH (IN.)									
		30	33	36	39	42	45	48	51	54	55.5
FRAME HEIGHT (IN.)	72	95.00	95.00	95.00	95.00	95.00	95.00	95.00	95.00	95.00	95.00
	78	95.00	95.00	95.00	95.00	95.00	95.00	95.00	95.00	93.88	92.71
	84	95.00	95.00	95.00	95.00	95.00	93.42	89.77	86.66	84.00	82.82
	90	95.00	95.00	95.00	94.04	89.22	85.12	81.61	78.60	76.00	74.84
	96	95.00	95.00	92.08	86.66	82.08	78.17	74.81	71.91	-	-
	102	95.00	91.64	85.50	80.36	76.00	72.27	-	-	-	-
	108	92.67	85.63	79.80	74.91	70.76	-	-	-	-	-
	114	82.44	75.39	69.55	-	-	-	-	-	-	-
	120	70.49	65.00	62.56	-	-	-	-	-	-	-

*NOTE: THIS TABLE MUST BE USED WITH "ELEGANTE SERIES SIDELITE DESIGN PRESSURE TABLE" ON SHEET 3.

ELEGANTE SERIES DOUBLE DOOR W/ SIDELITE(S) DESIGN PRESSURE TABLE*													
		TRIBUTARY WIDTH (IN.)											
		45	48	51	54	57	60	63	66	69	72	75	79.5
FRAME HEIGHT (IN.)	72	85.00	85.00	85.00	85.00	85.00	85.00	85.00	85.00	85.00	82.88	79.56	75.06
	78	85.00	85.00	85.00	85.00	85.00	85.00	85.00	83.45	79.83	76.50	73.44	69.28
	84	85.00	85.00	85.00	85.00	85.00	85.00	81.18	77.49	74.12	71.04	68.19	-
	90	85.00	85.00	85.00	85.00	83.75	79.56	75.77	72.33	69.18	66.30	-	-
	96	85.00	85.00	83.42	78.78	74.64	70.90	67.53	65.00	-	-	-	-
	102	78.82	73.89	69.55	65.68	65.00	65.00	64.24	-	-	-	-	-
	108	66.40	65.00	65.00	65.00	65.00	63.70	-	-	-	-	-	-
	114	65.00	65.00	65.00	65.00	-	-	-	-	-	-	-	-
	120	65.00	65.00	64.78	61.18	-	-	-	-	-	-	-	-

*NOTE: THIS TABLE MUST BE USED WITH "ELEGANTE SERIES SIDELITE DESIGN PRESSURE TABLE" ON SHEET 3.



240 SOUTH ANDREWS AVENUE, SUITE 3
POMPANO BEACH, FL 33069
PH: 800-676-7051

TITLE:
ELEGANTE SERIES ENTRANCE DOORS
(HVHZ) (IMPACT)
ANCHOR LAYOUTS &
DESIGN PRESSURE TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL42463**

DATE: **08.21.2023**

DWG. BY: **MS** CHK. BY: **HFN**






SCALE: **NTS**

DWG. #: **PGU008**

SHEET: **4** REV. **A**

OF 7

c:\users\harley\p\building drops, inc\building drops landing - common\projects\2026 code change projects\punto gold usa, llc\ccc-26-6125.1 - 2026 code change\dwgs\142463\pgu008-a.dwg 7/28/2026 11:32 AM

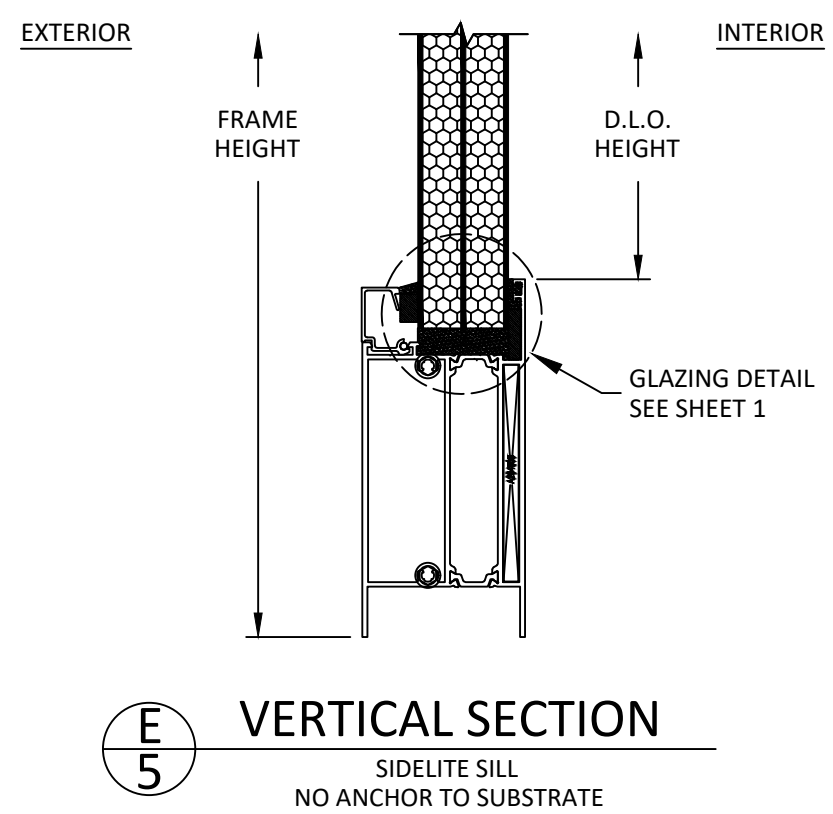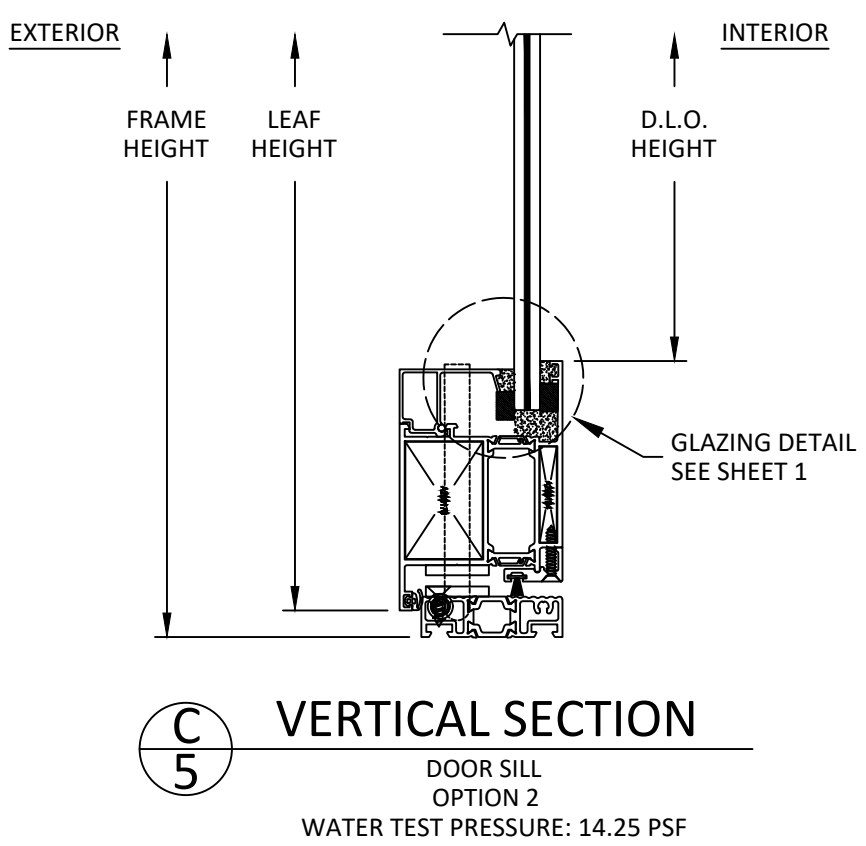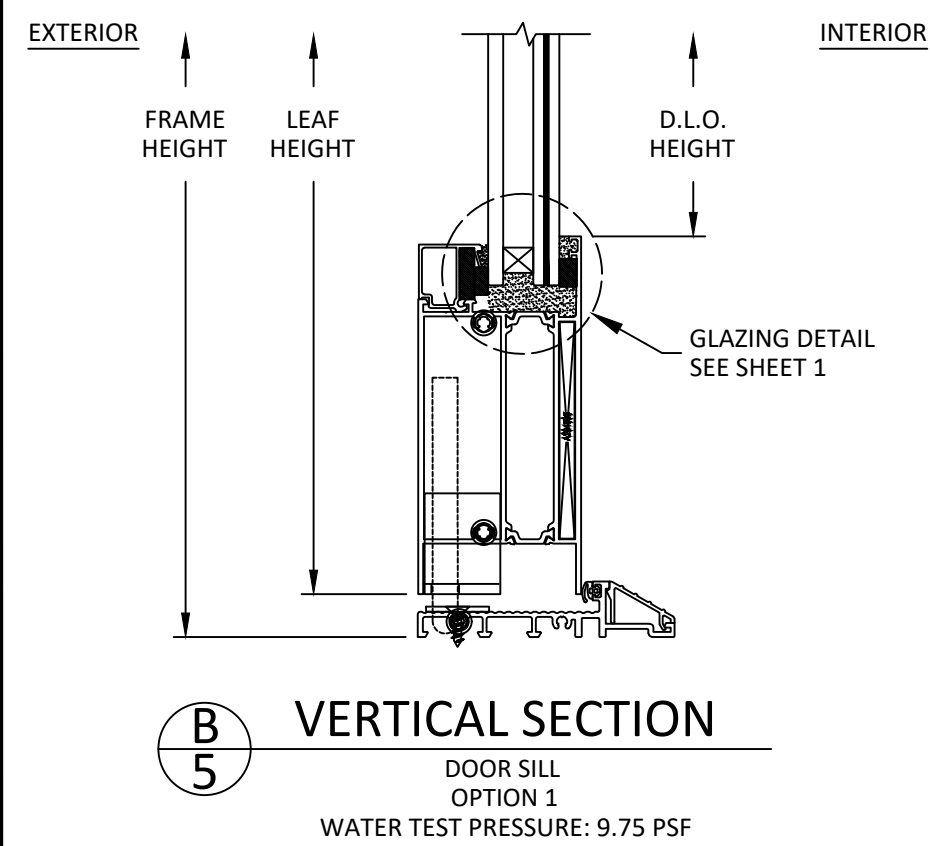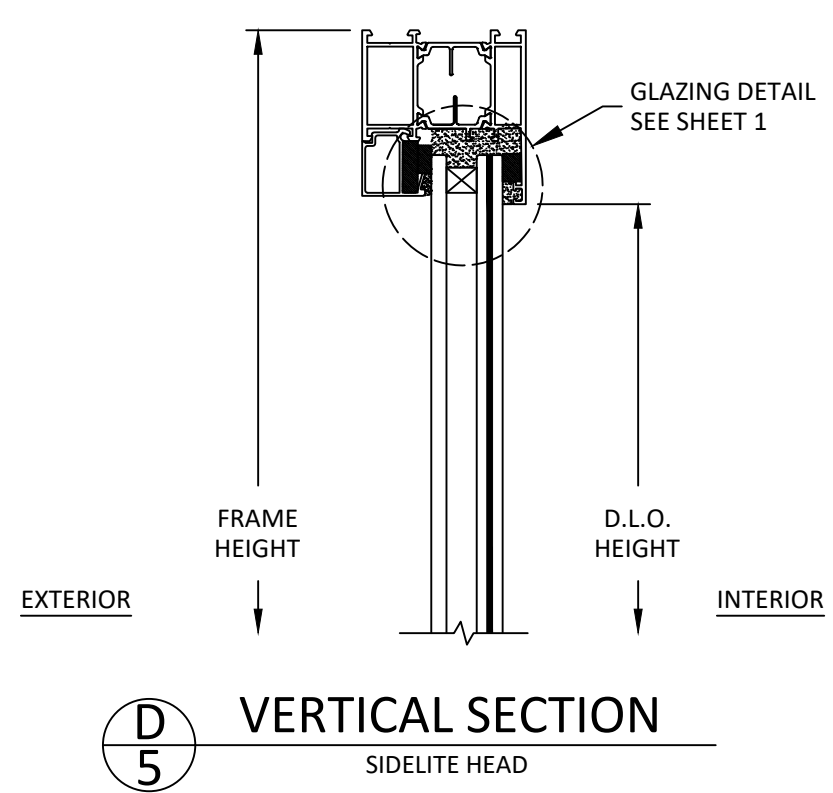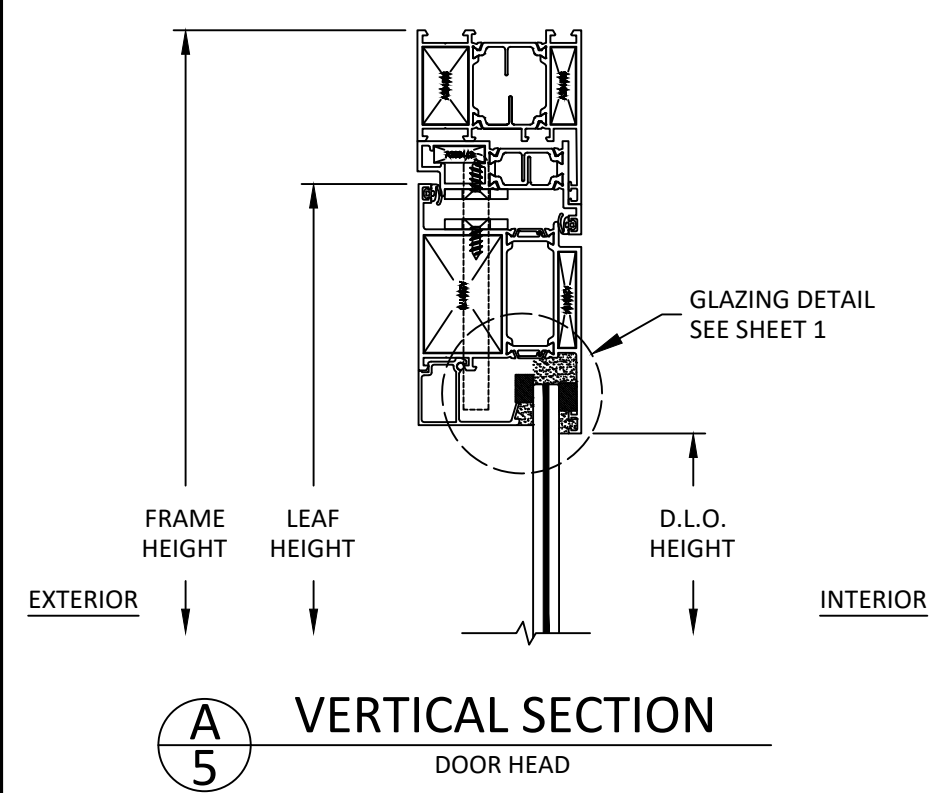

240 SOUTH ANDREWS AVENUE, SUITE 3
POMPANO BEACH, FL 33069
PH: 800-676-7051

TITLE:
ELEGANTE SERIES ENTRANCE DOORS
(HVHZ) (IMPACT)


VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com


BUILDING DROPS

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	07/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

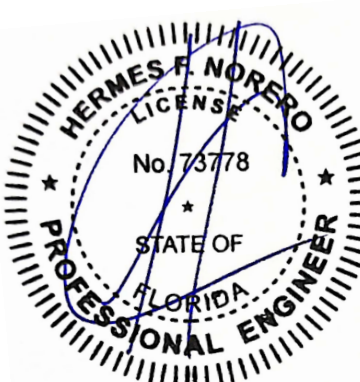

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL42463	
DATE:	08.21.2023	
DWG. BY:	MS	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	PGU008	
SHEET:	5	
REV.	A	

c:\users\harley\p\building drops, inc\building drops landing - common\projects\2026 code change projects\punto gold usa, llc\ccc-26-6125.1 - 2026 code change\dwgs\142463\pgu008-a.dwg 7/28/2026 11:32 AM

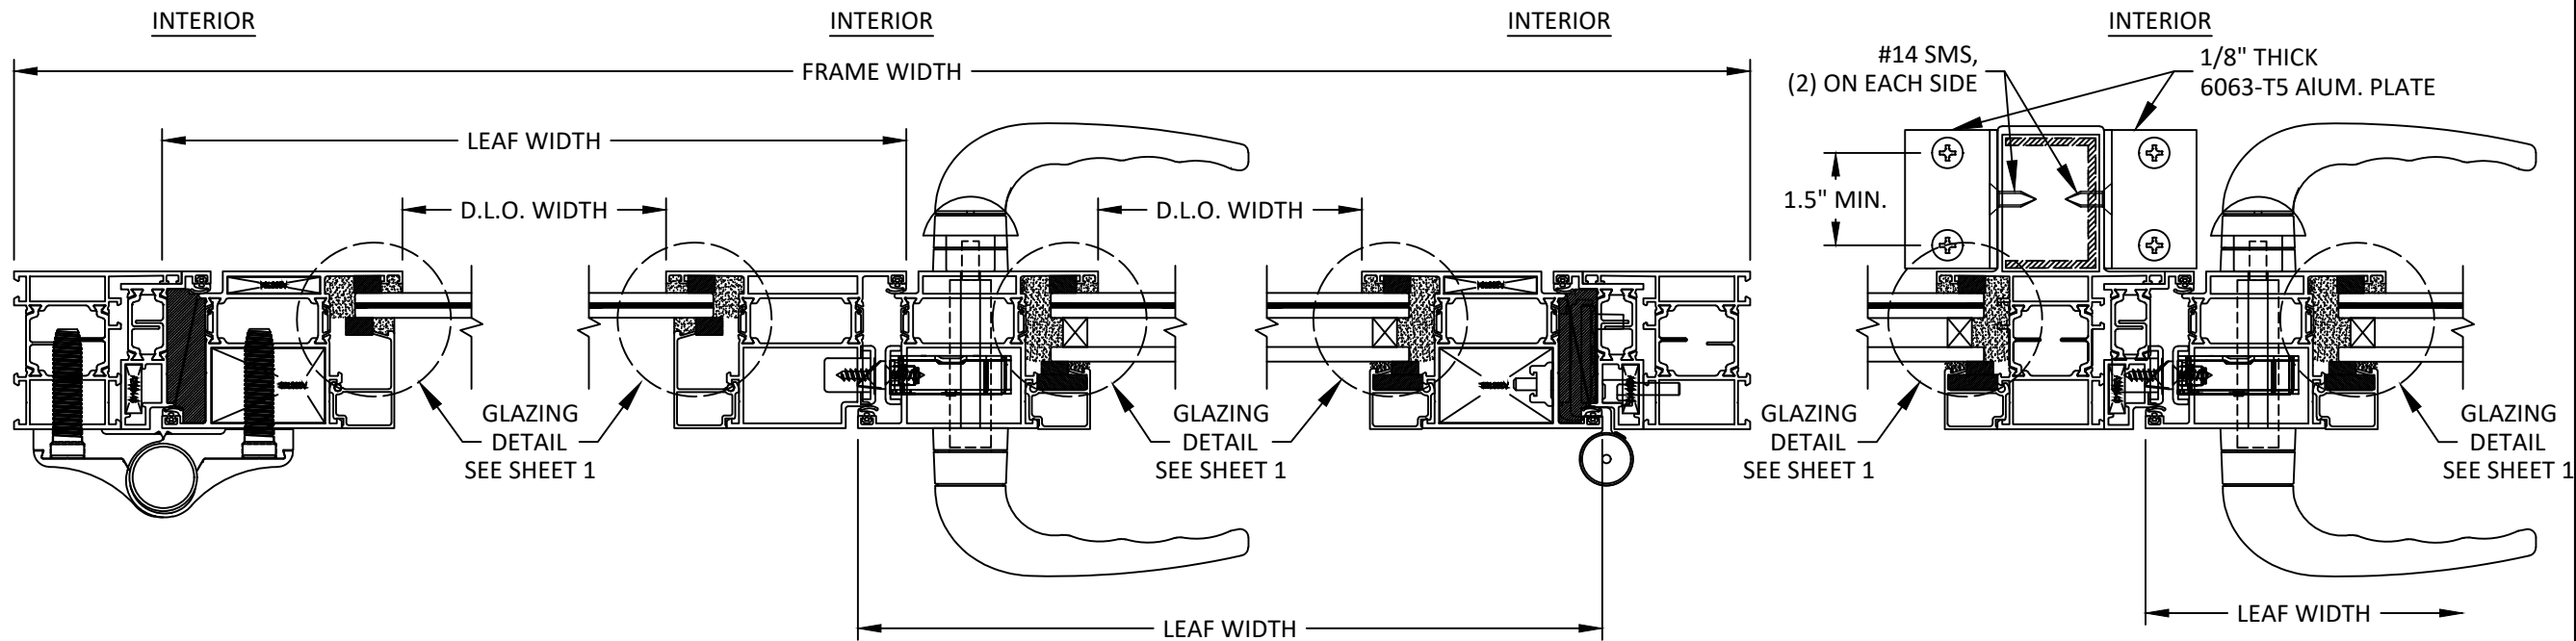


F **HORIZONTAL SECTION**
INACTIVE HINGE JAMB

G **HORIZONTAL SECTION**
ASTRAGAL

H **HORIZONTAL SECTION**
ACTIVE HINGE JAMB

I **HORIZONTAL SECTION**
LOCK MULLION

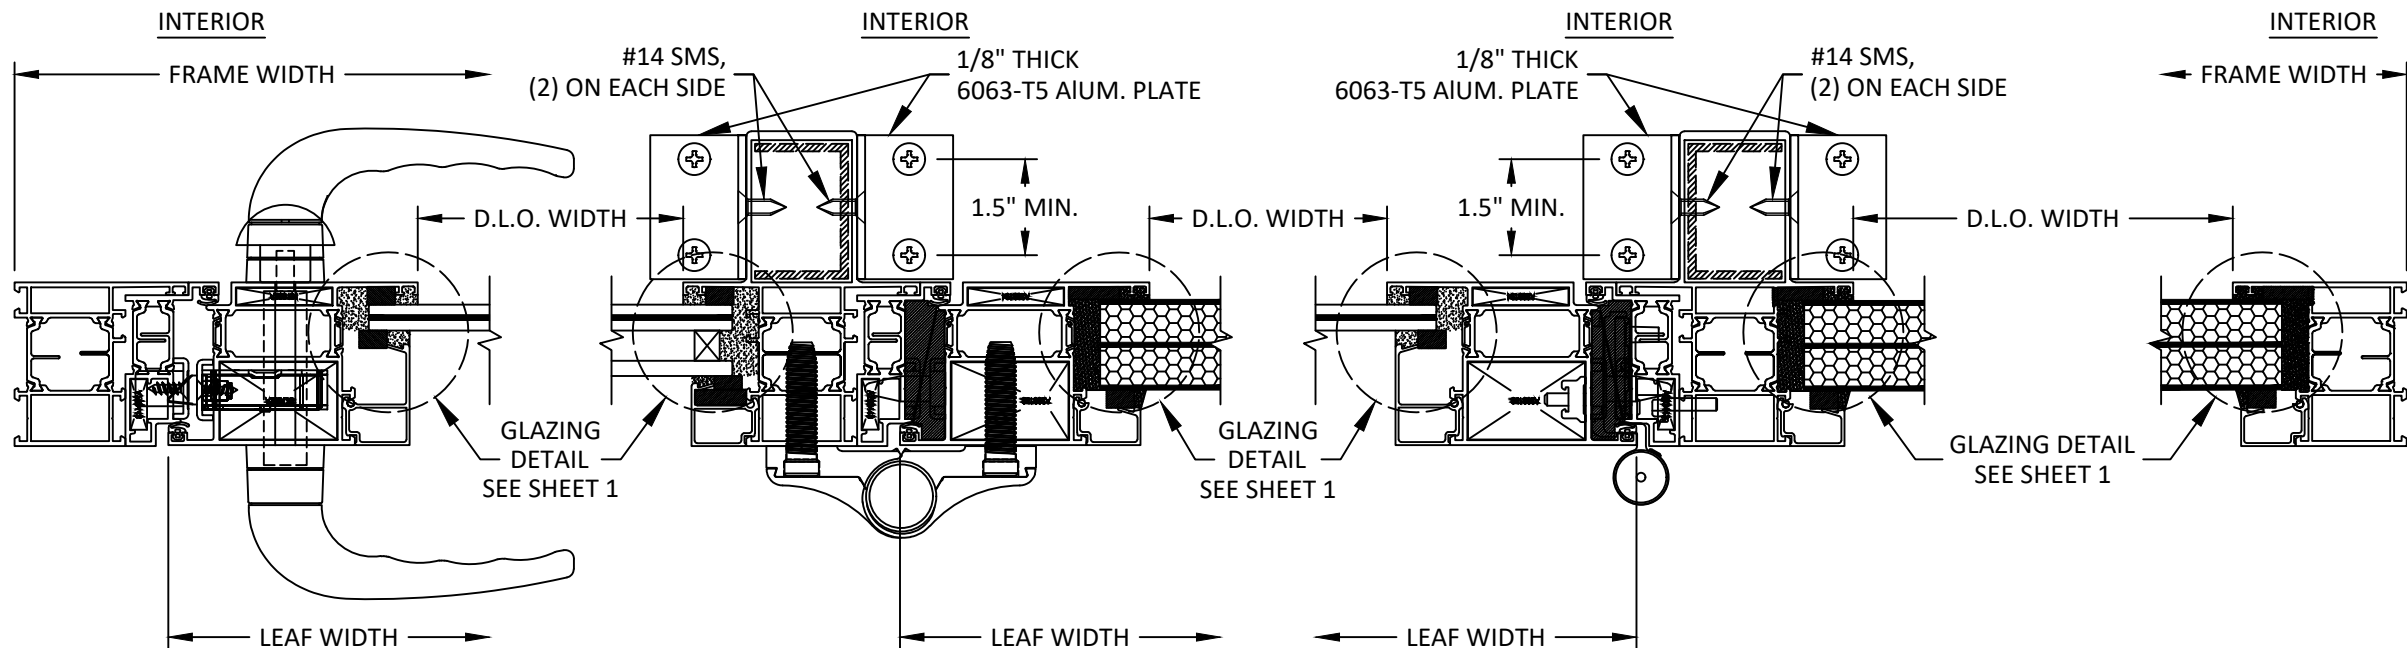

J **HORIZONTAL SECTION**
LOCK JAMB

K **HORIZONTAL SECTION**
INACTIVE HINGE MULLION

L **HORIZONTAL SECTION**
ACTIVE HINGE MULLION

M **HORIZONTAL SECTION**
SIDELITE JAMB



240 SOUTH ANDREWS AVENUE, SUITE 3
POMPANO BEACH, FL 33069
PH: 800-676-7051

TITLE: ELEGANTE SERIES ENTRANCE DOORS (HVHZ) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 395-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL42463**

DATE: **08.21.2023**

DWG. BY: MS	CHK. BY: HFN
--------------------	---------------------


SCALE: **NTS**

DWG. #: **PGU008**

SHEET: **6**

REV. **A**

7/28/2026 11:32 AM
c:\users\harley\pnt\building drops, inc\building drops landing - common\projects\2026 code change\dwgs\142463\pgu008-a.dwg

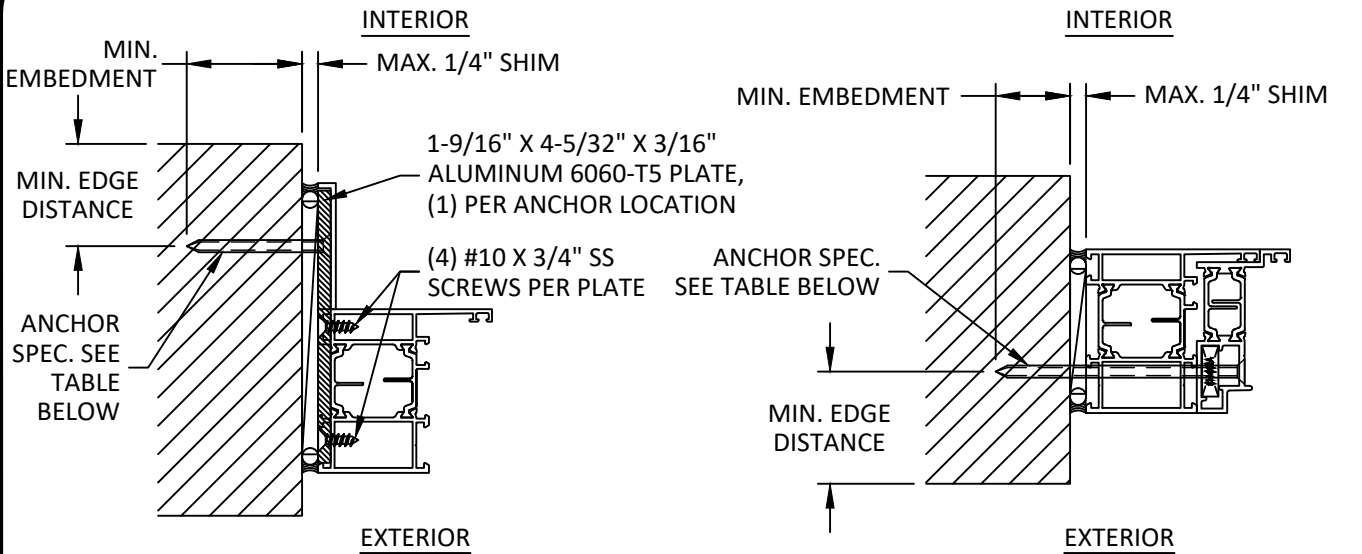


N7

INSTALLATION DETAIL

INSTALLATION PLATE
DOOR & SIDELITE

JAMB INSTALLATION SHOWN,
HEAD INSTALLATION SIMILAR.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME/ PLATE/ THRESHOLD/ MULL. CLIP	WOOD: MIN. S.G. = 0.55	#14 WOOD SCREW	1.375"	1"
	STEEL: MIN. 16 GA. MIN. Fy = 36 ksi	1/4" GRADE 5 SELF-DRILLING/ SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	0.5"
	ALUMINUM: MIN. 1/8" THICK MIN. 6063-T5			
THROUGH FRAME/ PLATE	CONCRETE: MIN. f'c = 3000 psi	1/4" ITW TAPCON	1"	2"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI		1"	2"
THROUGH THRESHOLD	CONCRETE: MIN. f'c = 3000 psi	1/4" ITW TAPCON	1.5"	2.125"
THROUGH MULLION CLIP	CONCRETE: MIN. f'c = 3000 psi	1/4" DEWALT ULTRACON+	1.75"	2.5"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI		1.25"	2.5"

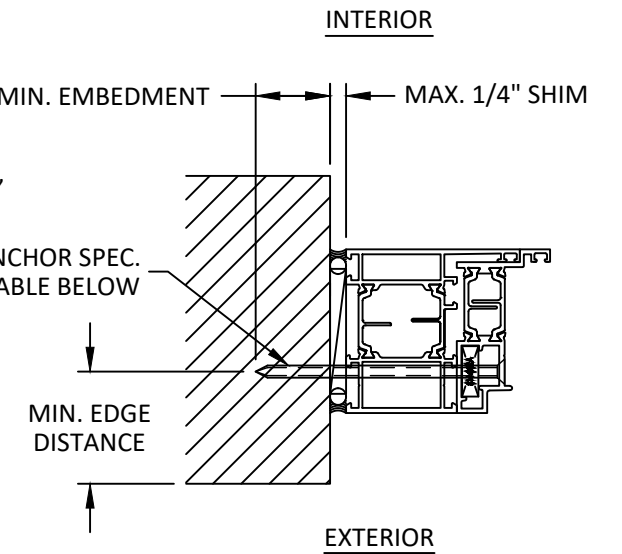


O7

INSTALLATION DETAIL

THROUGH FRAME
DOOR

JAMB INSTALLATION SHOWN,
HEAD INSTALLATION SIMILAR.

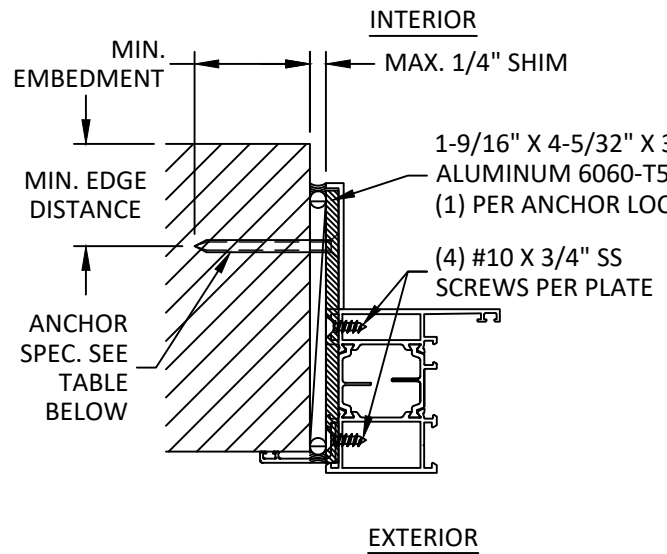


P7

INSTALLATION DETAIL

INSTALLATION PLATE W/ FLANGE
DOOR & SIDELITE


JAMB INSTALLATION SHOWN,
HEAD INSTALLATION SIMILAR.

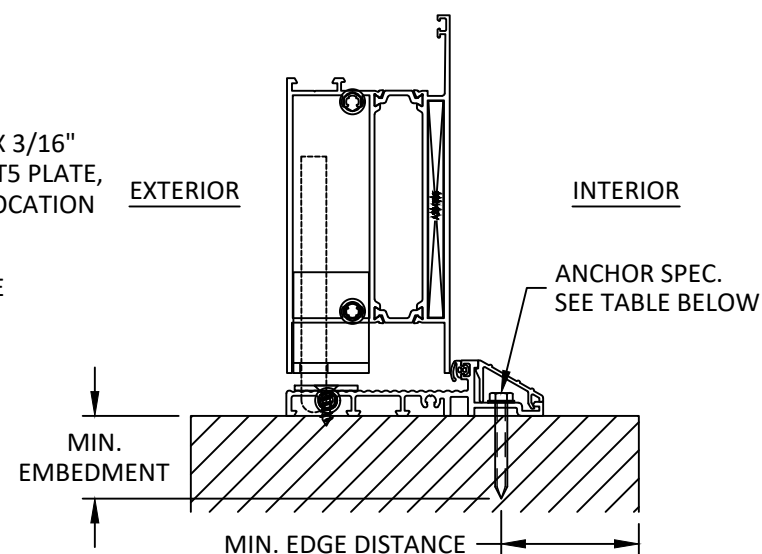

Q7

INSTALLATION DETAIL

DOOR SILL - OPTION 1

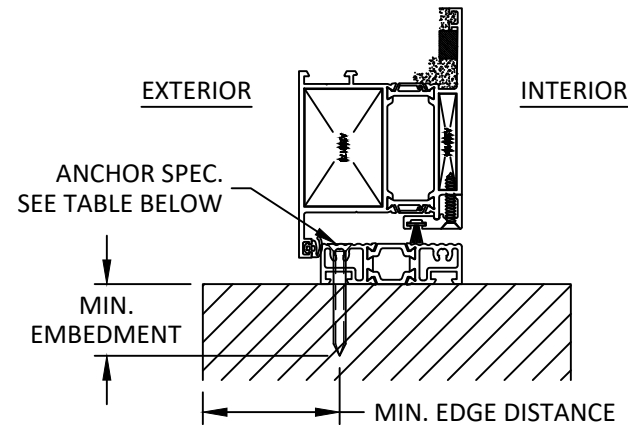

R7

INSTALLATION DETAIL

DOOR SILL - OPTION 2
FOR DOOR W/ SIDELITE(S) ONLY

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.



240 SOUTH ANDREWS AVENUE, SUITE 3
POMPANO BEACH, FL 33069
PH: 800-676-7051


TITLE:
ELEGANTE SERIES ENTRANCE DOORS
(HVHZ) (IMPACT)

INSTALLATION DETAILS & NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 395-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	07/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

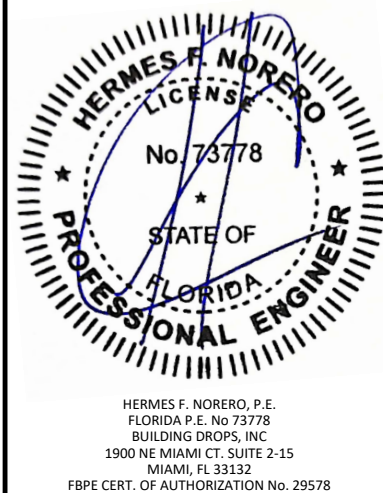

FL #: **FL42463**

DATE: **08.21.2023**

DWG. BY: **MS** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **PGU008**

SHEET: **7** REV. **A**

OF 7