

9/25/2026 2:11 PM

c:\users\harley\appdata\local\temp\project\2026 code change\dwgs\145922\arc016-a.dwg

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16 INCH DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 3/4 INCH MINIMUM EMBEDMENT.
7. FOR INSTALLATION THROUGH METAL FRAME USE #10 SELF-DRILLING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND METAL FRAME SUBSTRATE.
8. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
9. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
10. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
11. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
12. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90.

D. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.

E. ALUMINUM - MINIMUM 1/8 INCH THICK 6063-T5 ALUMINUM.

ARCADIA INC.

TD-400 TERRACE DOOR

(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

ASTM E283-19

ASTM E330-14(21)




ASTM E331-00(23)
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. DOOR FRAME MATERIAL: ALUMINUM 6063-T6
7. ALL STRUCTURAL MATERIALS & DISSIMILIAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
8. GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 3 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATIONS & ANCHOR LAYOUTS
3	ELEVATION, ANCHOR LAYOUT, & GLAZING DETAIL
4	VERTICAL SECTIONS
5	VERTICAL SECTIONS
6	HORIZONTAL SECTIONS
7	ANCHOR DETAILS & ANCHOR SCHEDULE
8	BILL OF MATERIALS & COMPONENTS

DESIGN PRESSURE TABLE					
UNIT	MAX. FRAME SIZE		DESIGN PRESSURE	CONFIGURATION	IMPACT RATING
	WIDTH	HEIGHT			
*1	77 5/8"	96"	+65/-65 PSF	"XX" OUTSWING	NON-IMPACT RATED
2	36"	84"	+65/-65 PSF	"X" OUTSWING	
3	36"	84"	+40/-65 PSF	"X" OUTSWING	
*4	42"	96"	+65/-65 PSF	"X" OUTSWING	
5	36"	84"	+65/-65 PSF	"X" INSWING	
6	36"	84"	+40/-65 PSF	"X" INSWING	

*NOTE: FOR UNITS NOT RATED FOR WATER INFILTRATION. DOOR ASSEMBLIES INSTALLED WHERE THE OVERHANG (OH) RATIO IS EQUAL TO OR MORE THAN 1 NEED NOT BE TESTED FOR WATER INFILTRATION:

- OVERHANG (OH) RATIO = OH LENGTH ÷ OH HEIGHT IS ≥ 1.0

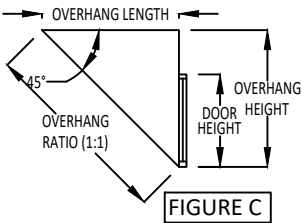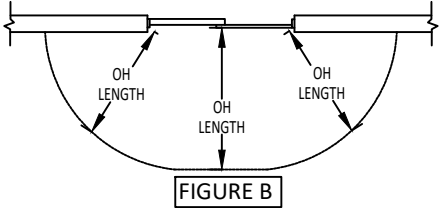

2301 EAST VERNON AVE.
VERNON, CA 90058
PH: (323)771-9819

TD-400 TERRACE DOOR
(NON-HVHZ)(NON-IMPACT)

INSTALLATION & GENERAL NOTES

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.10.05 17:15:41 -07'00'

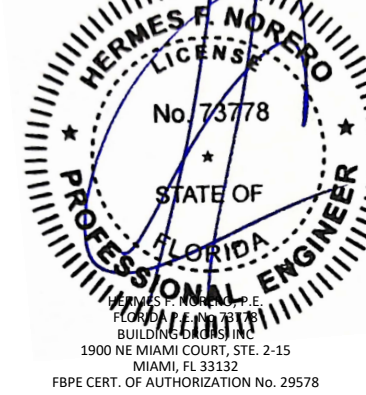

FL #:

FL45922

DATE: 12.04.2023

DWG. BY:

SH

CHK. BY:

HFN

SCALE: NTS

DWG. #: ARC016

SHEET:

1


REV.

A


OF 8

9/25/2026 2:11 PM


c:\users\harley\appdata\local\temp\building drops, inc\building drops landing - common\projects\2026 code change projects\arcadia, inc\cc-26-0125 - 2026 code change\dwgs\fl45922\arc016-a.dwg

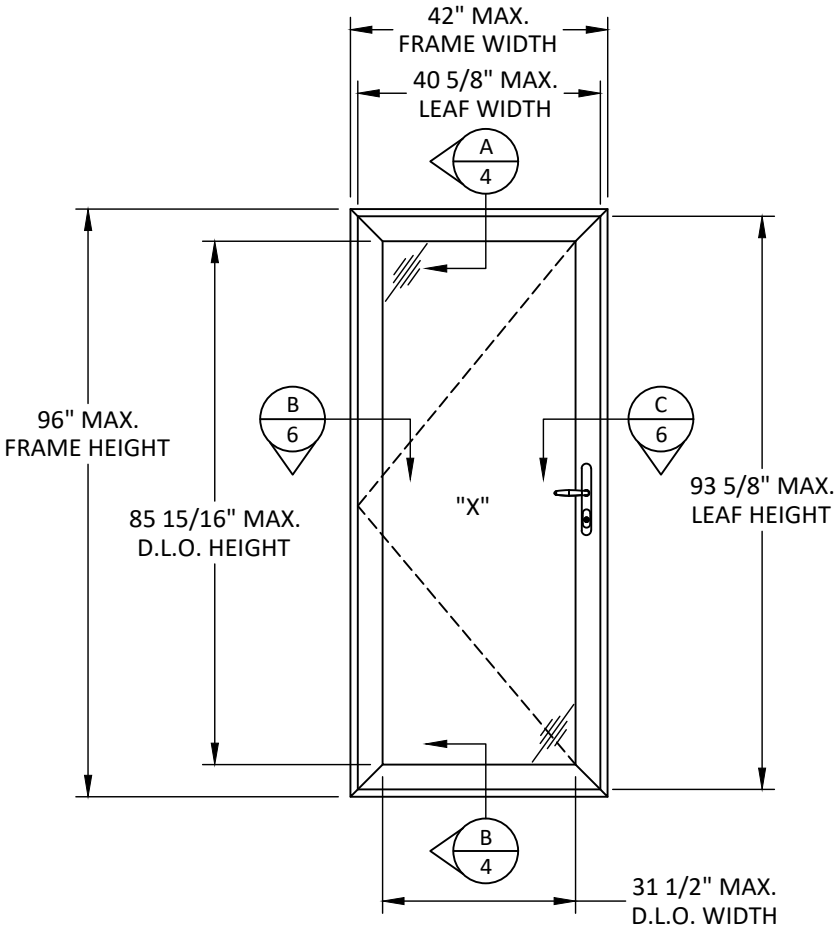


ELEVATION
SINGLE OUTSWING DOOR

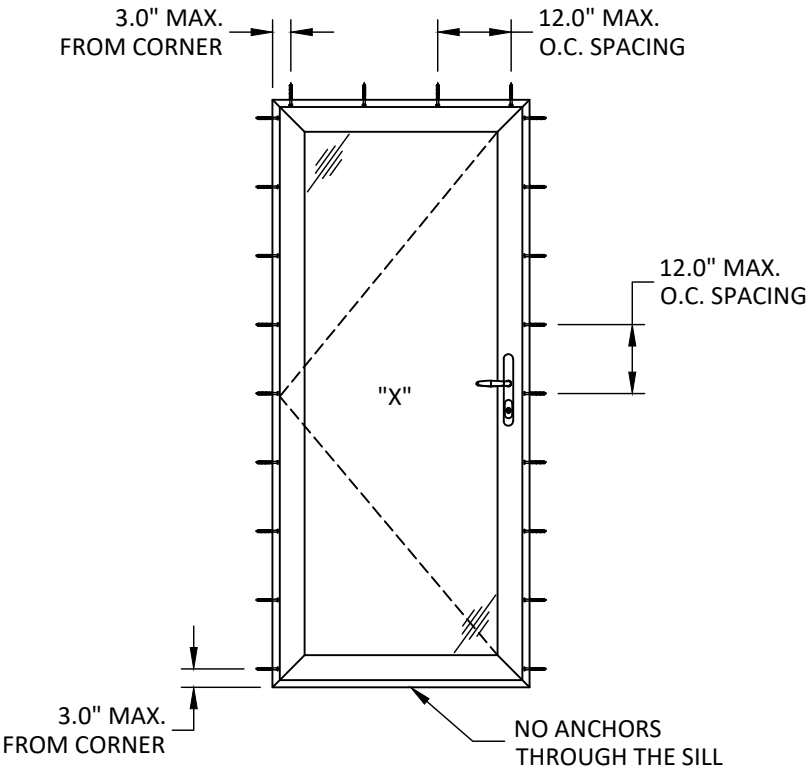

ANCHOR LAYOUT
THROUGH FRAME

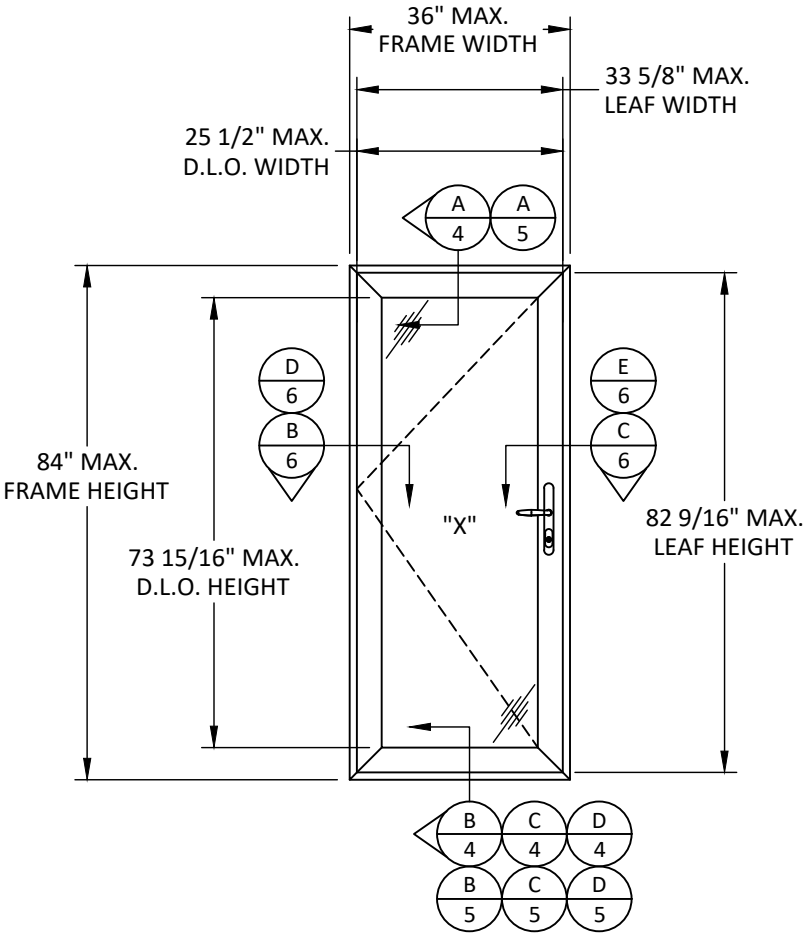

ELEVATION
SINGLE OUTSWING/INSWING DOOR

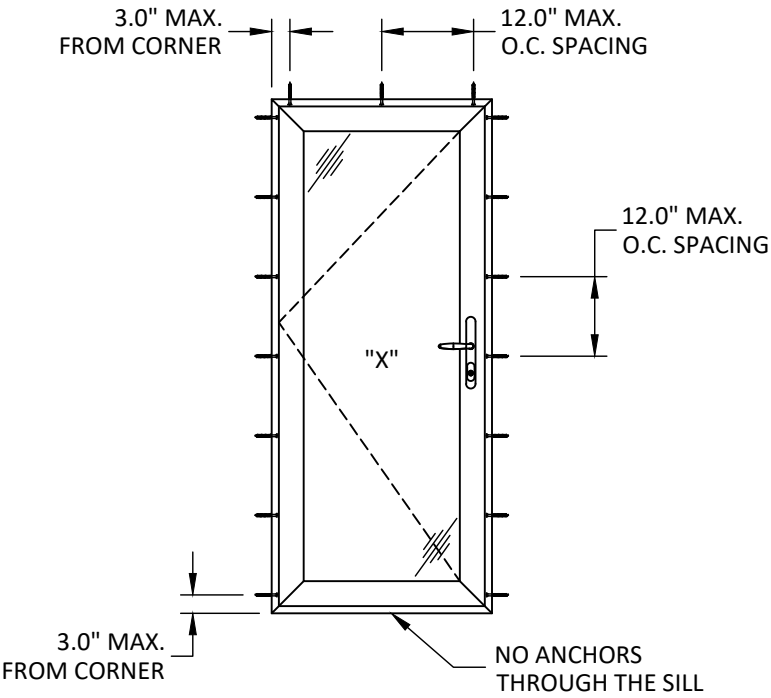

ANCHOR LAYOUT
THROUGH FRAME



2301 EAST VERNON AVE.
VERNON, CA 90058
PH: (323)771-9819

TITLE: TD-400 TERRACE DOOR
(NON-HVHZ)/(NON-IMPACT)

ELEVATIONS & ANCHOR LAYOUTS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

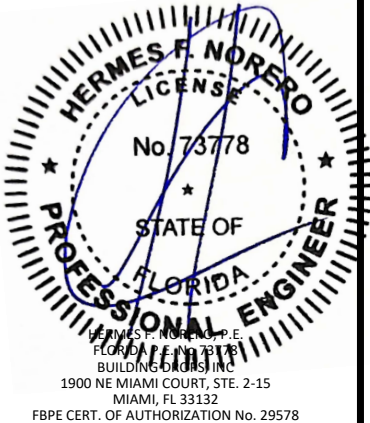


FL #:	FL45922
DATE:	12.04.2023
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ARC016
SHEET:	2
REV.	A

9/25/2026 2:11 PM


c:\users\harley\appdata\local\temp\building drops landing - common\projects\2026 code change projects\arcadia, inc\cc-26-0125 - 2026 code change\dwgs\145922\arc016-a.dwg

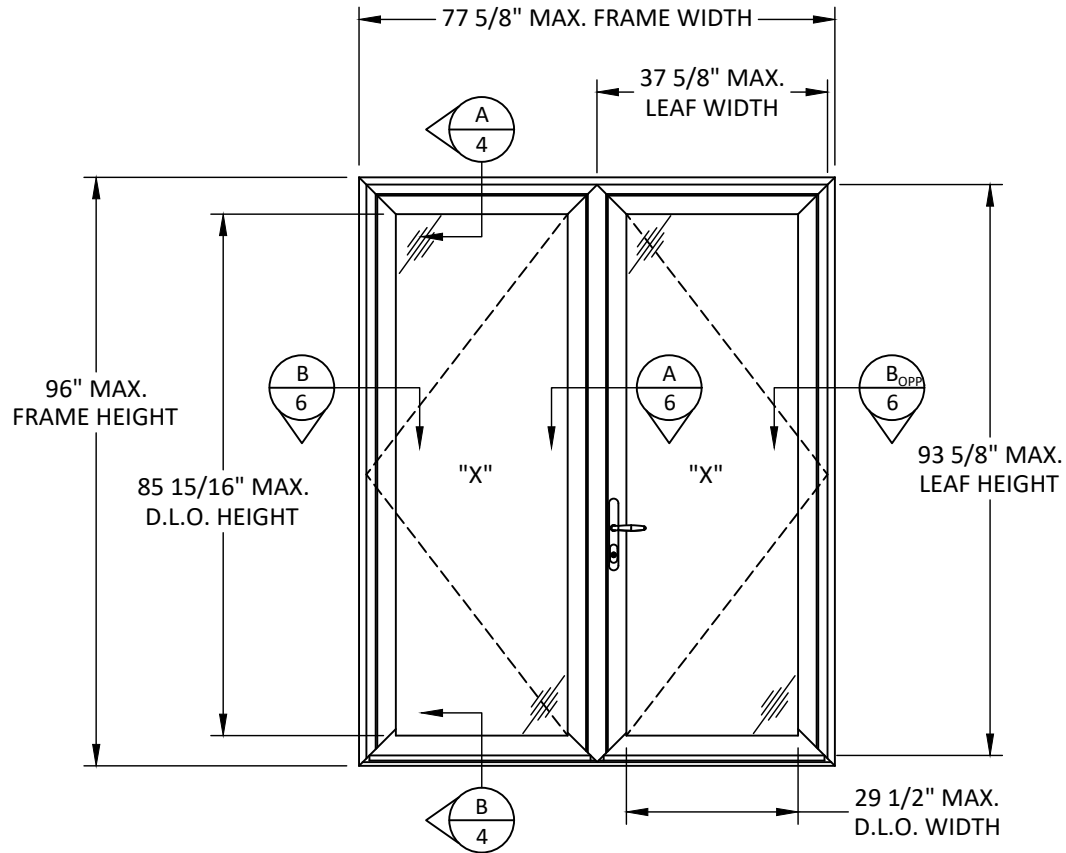


ELEVATION
DOUBLE OUTSWING DOOR

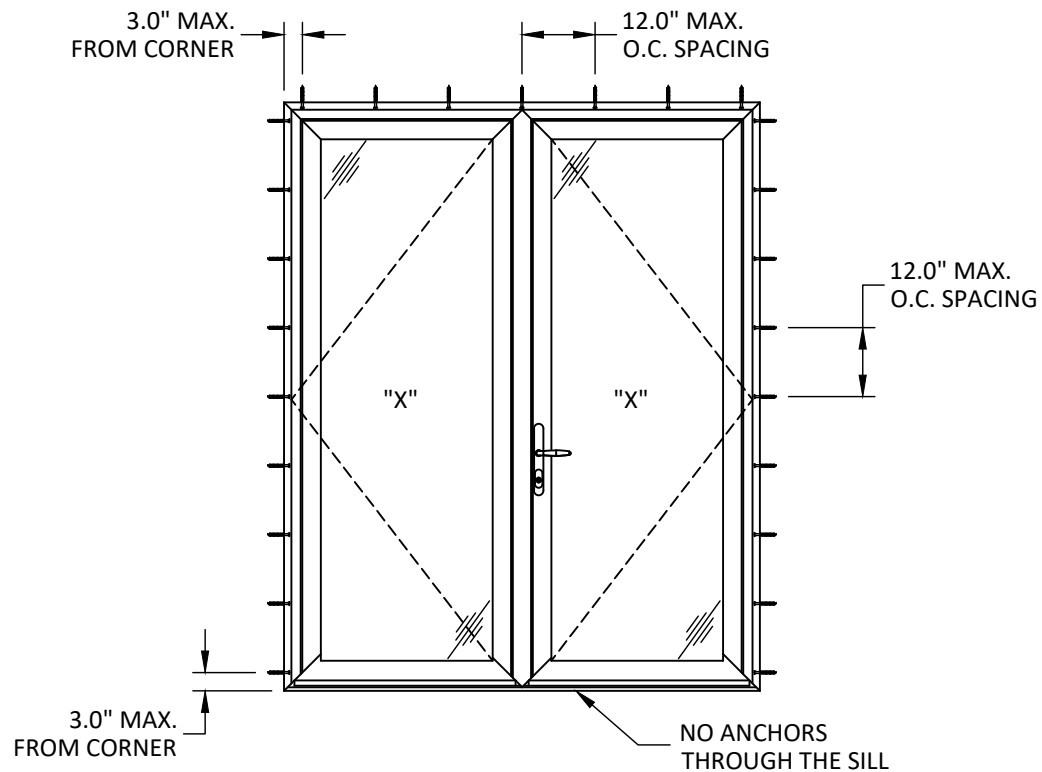

ANCHOR LAYOUT
THROUGH FRAME

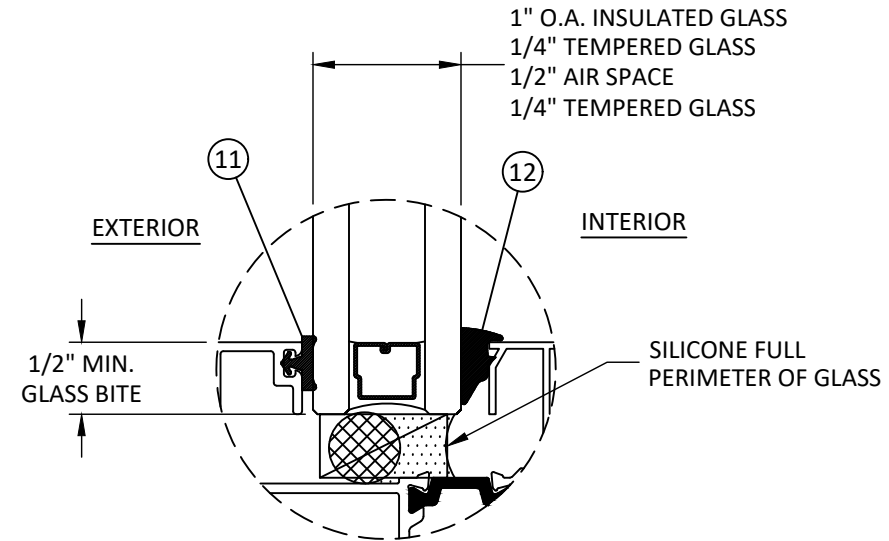

GLAZING DETAIL
OUTSWING

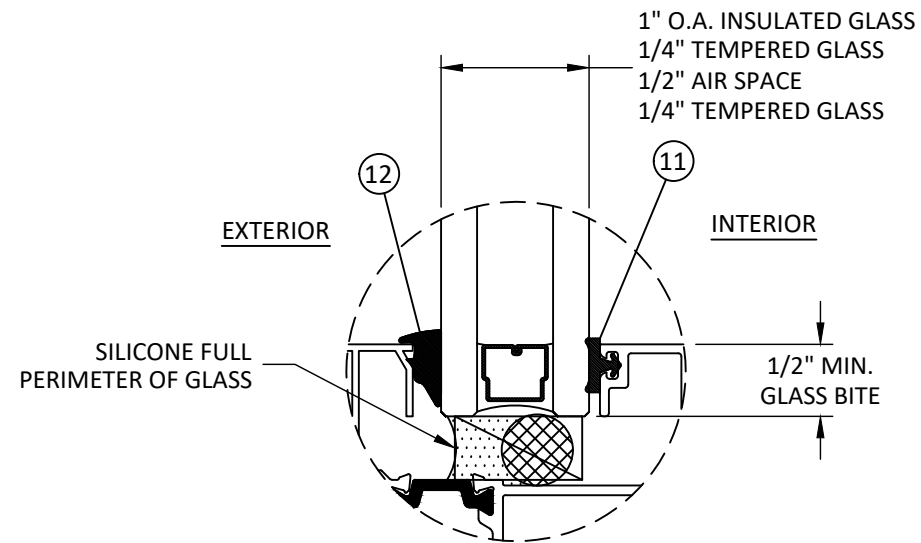

GLAZING DETAIL
INSWING

NOTES:

1. GLASS THICKNESS AND TYPE SHALL COMPLY WITH ASTM E1300 GLASS CHART REQUIREMENTS.
2. ALL GLAZING CONFIGURATIONS SHALL COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN THE FBC.
3. ALL LITES GREATER THAN 36" IN WIDTH SHALL UTILIZE SETTING BLOCKS IN ACCORDANCE WITH THE FBC. CH. 24
4. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN CHAPTER 24.



2301 EAST VERNON AVE.
VERNON, CA 90058
PH: (323)771-9819

TITLE: **TD-400 TERRACE DOOR**
(NON-HVHZ)/(NON-IMPACT)

ELEVATION, ANCHOR LAYOUT,
& GLAZING DETAILS


PREPARED BY: **BUILDING DROPS, INC.**

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

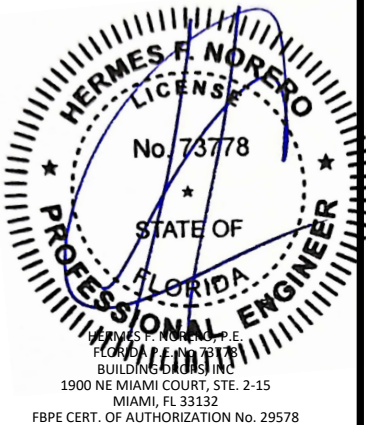


FL #:	FL45922
DATE:	12.04.2023
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ARC016
SHEET:	3
REV.	A

9/25/2026 2:11 PM

c:\users\harley\appdata\local\temp\building drops\landing - common\projects\2026 code change\dwgs\arc016-a.dwg

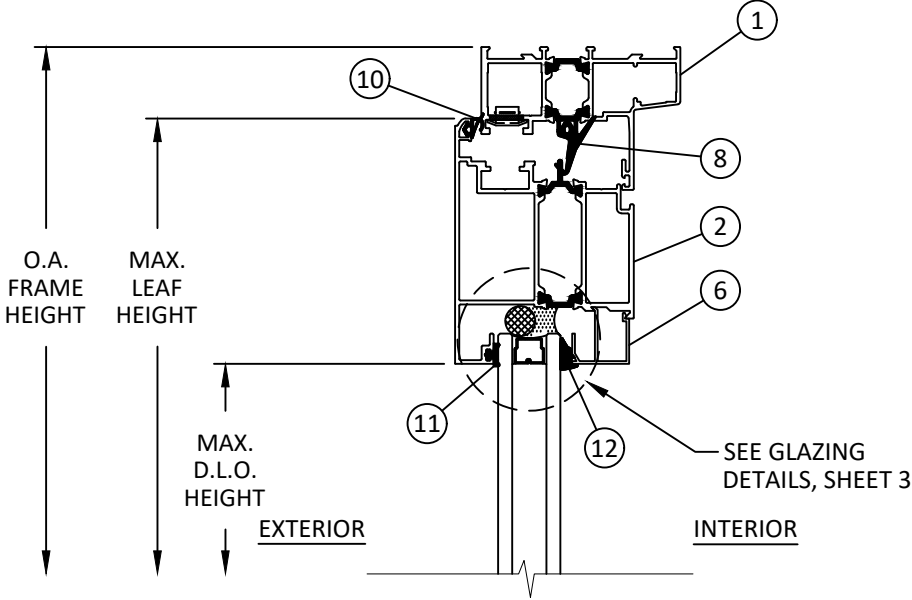


A
4 **VERTICAL SECTION**
DOOR HEAD - OUTSWING

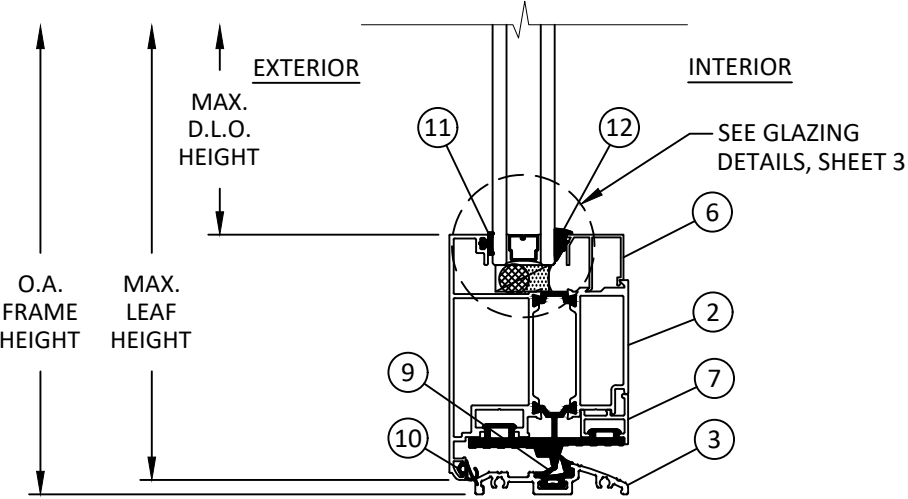


C
4 **VERTICAL SECTION**
DOOR SILL - ADA - OUTSWING
ONLY FOR SINGLE DOORS

*NOTE: ADA SILL RATED FOR WATER UP TO
A POSITIVE DESIGN PRESSURE OF +40 PSF.

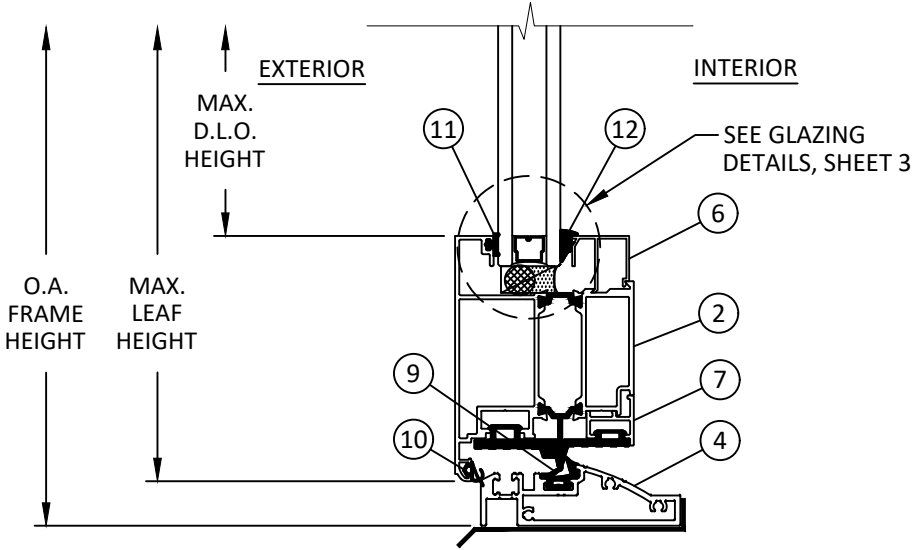

B
4 **VERTICAL SECTION**
DOOR SILL - CONCEALED THRESHOLD - OUTSWING
DOUBLE & SINGLE DOORS

*NOTE: CONCEALED THRESHOLD NOT
RATED FOR WATER.

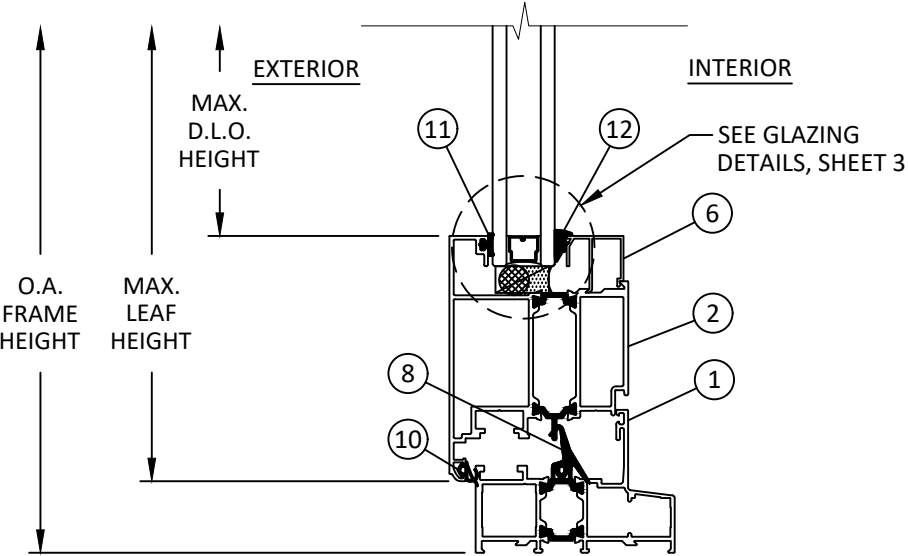

D
4 **VERTICAL SECTION**
DOOR SILL - STANDARD - OUTSWING
ONLY FOR SINGLE DOORS

*NOTE: STANDARD SILL RATED FOR WATER UP
TO A POSITIVE DESIGN PRESSURE OF +65 PSF.



2301 EAST VERNON AVE.
VERNON, CA 90058
PH: (323)771-9819

TITLE: TD-400 TERRACE DOOR
(NON-HVHZ)/(NON-IMPACT)

VERTICAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT

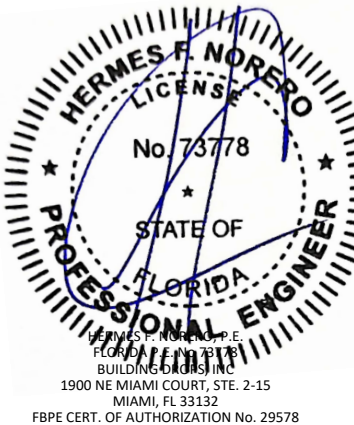


FL #:	FL45922
DATE:	12.04.2023
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ARC016
SHEET:	4
REV.	A

9/25/2026 2:11 PM

c:\users\harley\appdata\local\temp\building drops landing - common\projects\2026 code change projects\arcadia, inc\cc-26-0125 - 2026 code change\dwgs\145922\arc016-a.dwg

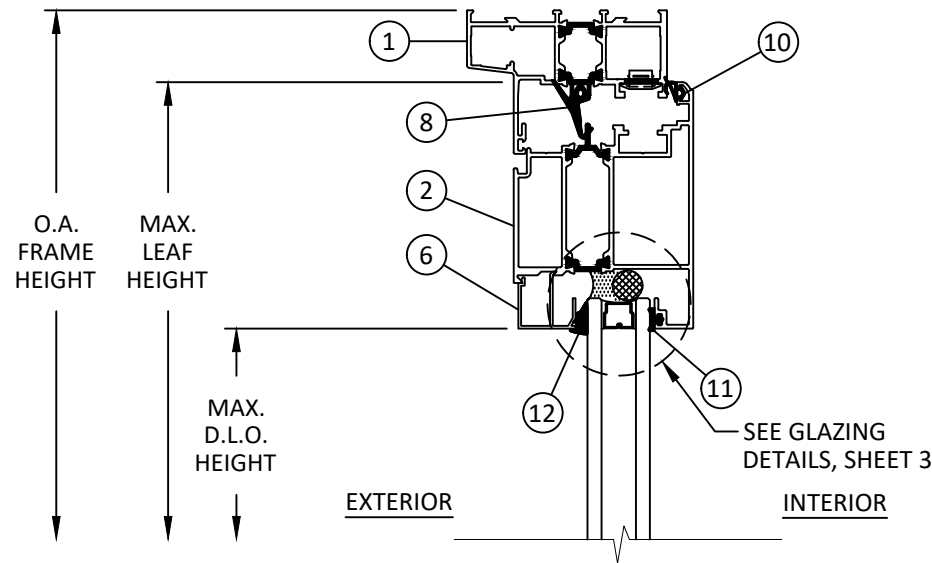


A
5 **VERTICAL SECTION**
DOOR HEAD - INSWING

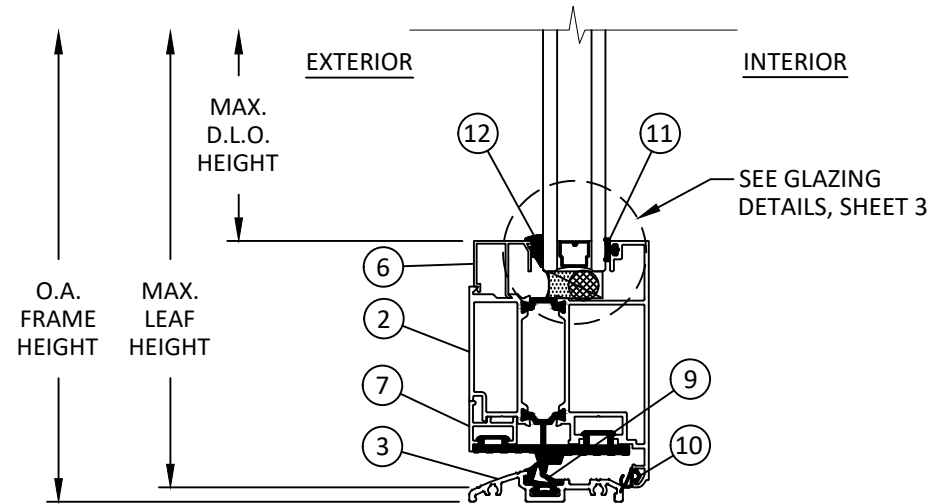


C
5 **VERTICAL SECTION**
DOOR SILL - ADA - INSWING
ONLY FOR SINGLE DOORS

*NOTE: ADA SILL RATED FOR WATER UP TO
A POSITIVE DESIGN PRESSURE OF +40 PSF.

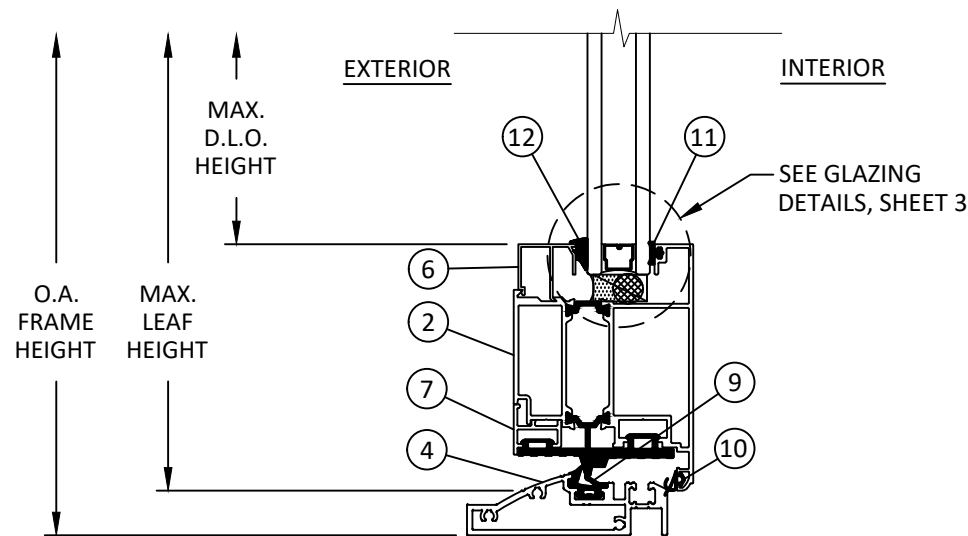

B
5 **VERTICAL SECTION**
DOOR SILL - CONCEALED THRESHOLD - INSWING
DOUBLE & SINGLE DOORS

*NOTE: CONCEALED THRESHOLD NOT
RATED FOR WATER.

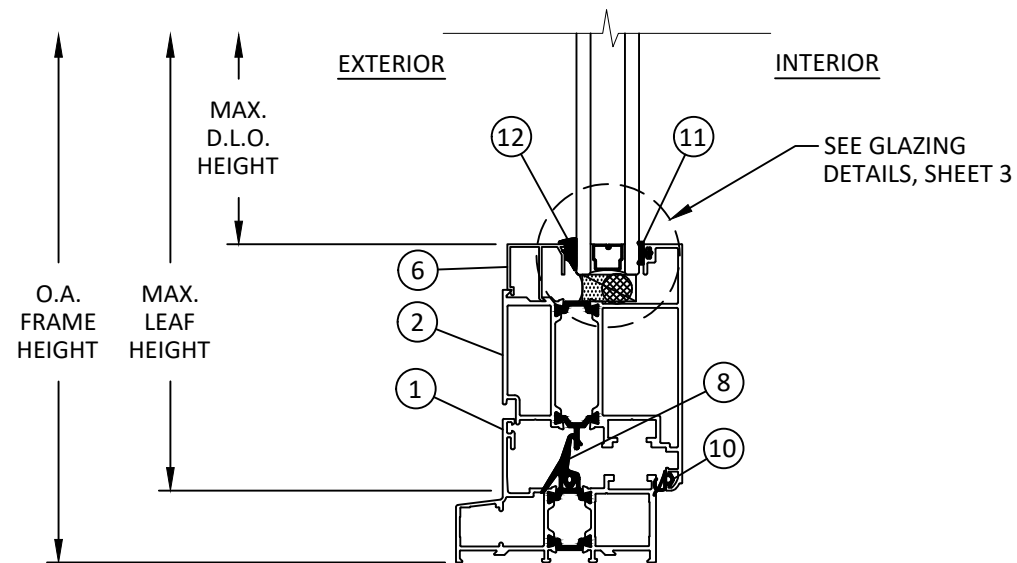

D
5 **VERTICAL SECTION**
DOOR SILL - STANDARD - INSWING
ONLY FOR SINGLE DOORS

*NOTE: STANDARD SILL RATED FOR WATER UP
TO A POSITIVE DESIGN PRESSURE OF +65 PSF.



2301 EAST VERNON AVE.
VERNON, CA 90058
PH: (323) 771-9819

TITLE: TD-400 TERRACE DOOR
(NON-HVHZ)/(NON-IMPACT)


VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT

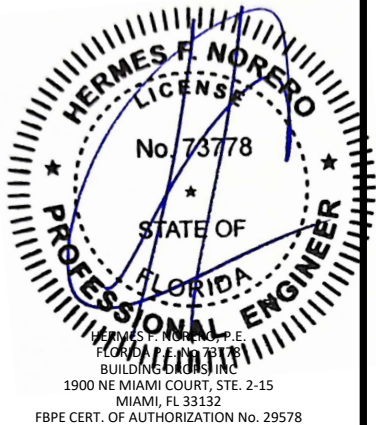


FL #:	FL45922
DATE:	12.04.2023
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ARC016
SHEET:	5
REV.	A

9/25/2026 2:11 PM


c:\users\harley\appdata\local\temp\building drops landing - common\projects\2026 code change\projects\arcadia, inc\c-26-0125 - 2026 code change\dwgs\145922\arc016-a.dwg

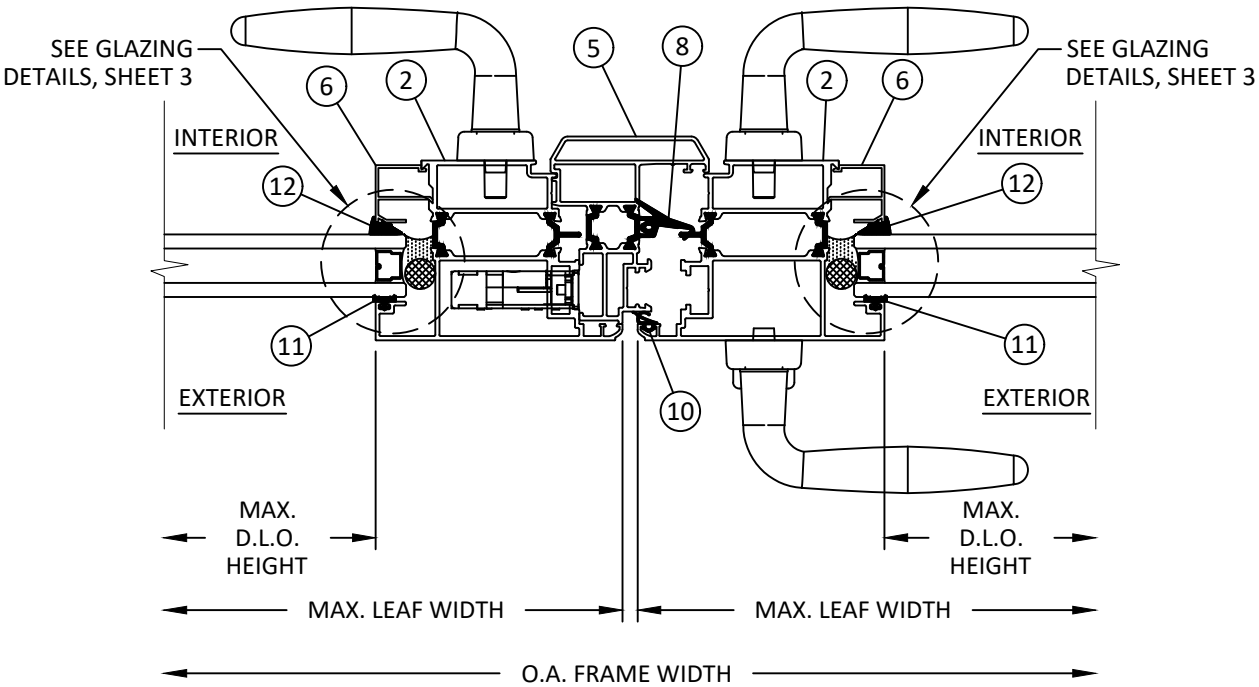


A HORIZONTAL SECTION
6 DOOR MEETING STILE - OUTSWING

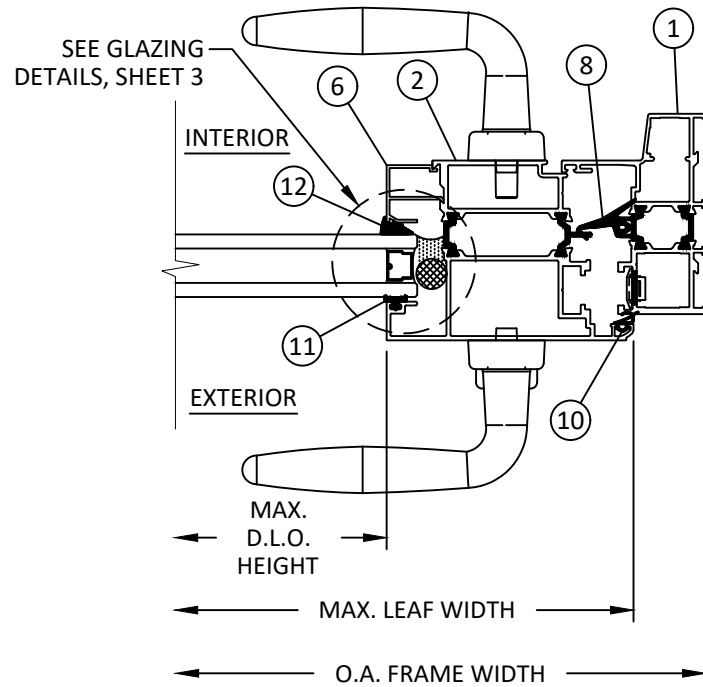


C HORIZONTAL SECTION
6 DOOR LOCK JAMB - OUTSWING

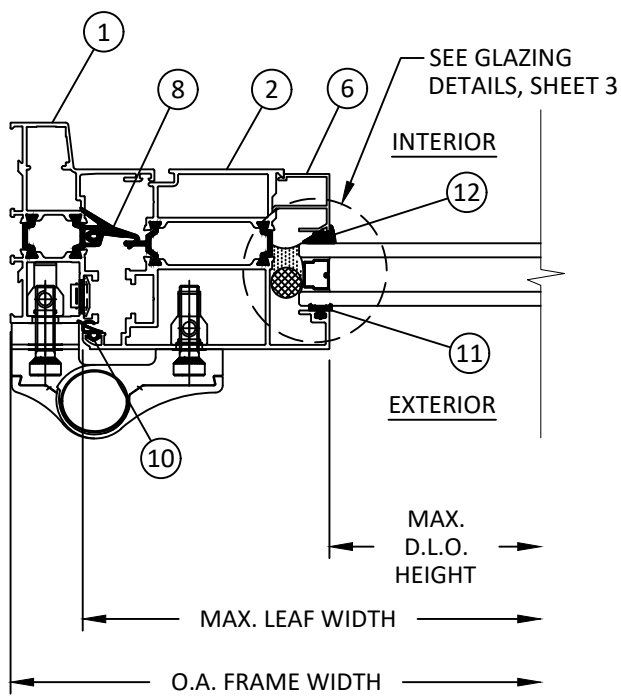

B HORIZONTAL SECTION
6 DOOR HINGE JAMB - OUTSWING

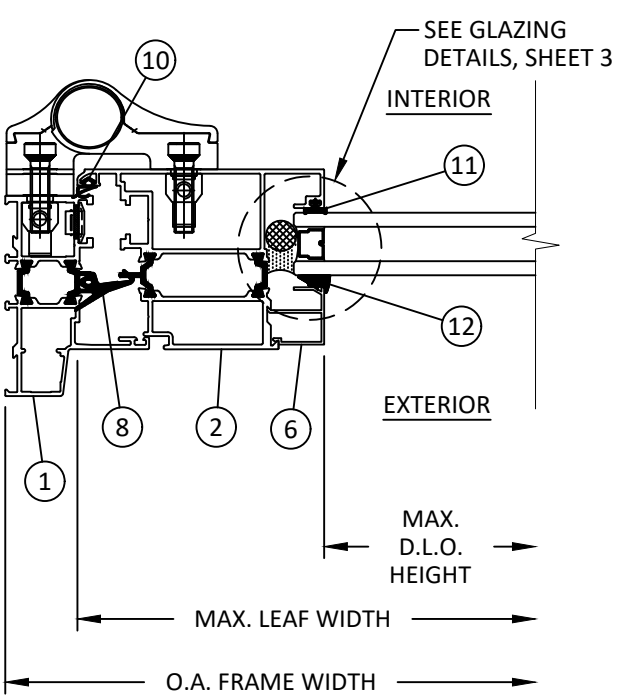

D HORIZONTAL SECTION
6 DOOR HINGE JAMB - INSWING

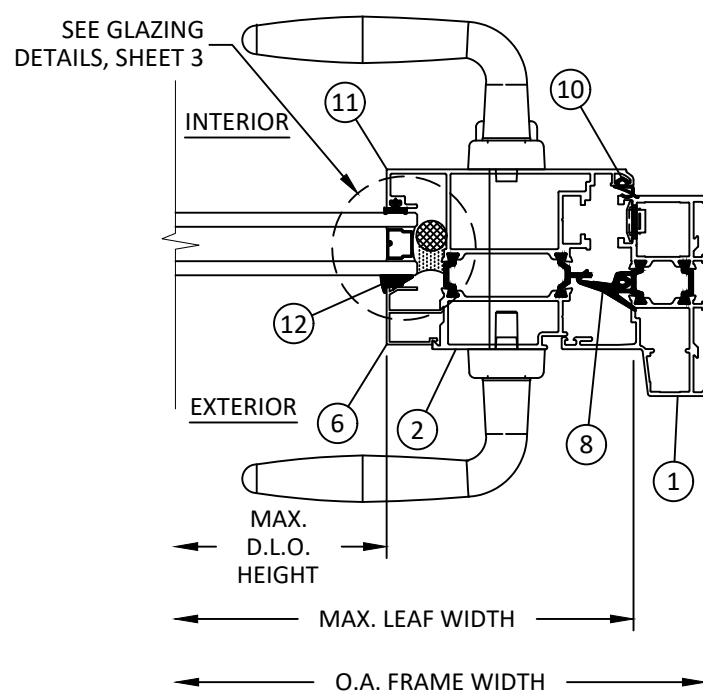

E HORIZONTAL SECTION
6 DOOR LOCK JAMB - INSWING



2301 EAST VERNON AVE.
VERNON, CA 90058
PH: (323) 771-9819


TITLE: TD-400 TERRACE DOOR (NON-HVHZ)/(NON-IMPACT)

HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

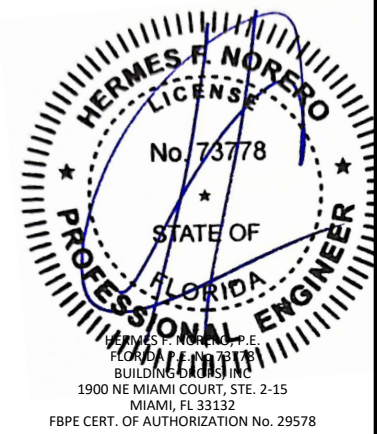

FL #:

FL45922

DATE: **12.04.2023**

DWG. BY: SH	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **ARC016**

SHEET:	REV.
6	A



C7 HORIZONTAL SECTION

DOOR JAMB
THROUGH FRAME


REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26

HERMES F. NORENO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER


HERMES F. NORENO, P.E.
FLORIDA P.E. NO. 73778
BUILDING GROUPS INC
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION NO. 29578

FL #:	
FL45922	
DATE: 12.04.2023	
DWG. BY: SH	CHK. BY: HFN
SCALE: NTS	
DWG. #: ARC016	
SHEET:	REV. A
7	
OF 8	


BILL OF MATERIALS				
ITEM	PART No.	DESCRIPTION	MATERIAL	MANUFACTURER
1	TD32511/TD3252	FRAME	6063-T6	ARCADIA INC.
2	TD3253/TD3254	STILE/RAIL	6063-T6	ARCADIA INC.
3	TD3260	ADA SILL	6063-T6	ARCADIA INC.
4	TD3266	CONCEALED THRESHOLD	6063-T6	ARCADIA INC.
5	TD3258/TD3259	ASTRAGAL	6063-T6	ARCADIA INC.
6	WWB02	GLAZING BEAD	6063-T6	ARCADIA INC.
7	TD3257	RAIL ADAPTER	6063-T6	ARCADIA INC.
8	TDG1	FRAME GASKET	NEOPRENE	BY OTHERS
9	TDG3	SILL GASKET	NEOPRENE	BY OTHERS
10	TDG4	STILE/RAIL GASKET	NEOPRENE	BY OTHERS
11	S6603	GLAZING GASKET	NEOPRENE	BY OTHERS
12	S6101	GLAZING GASKET	NEOPRENE	BY OTHERS




3 ADA SILL
TD3260

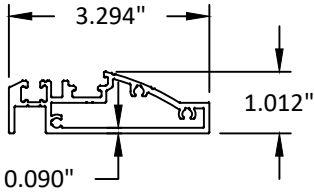


4 CONCEALED THRESHOLD
TD3266

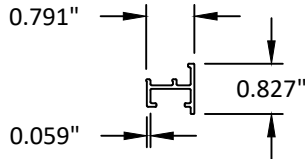


7 RAIL ADAPTER
TD3257

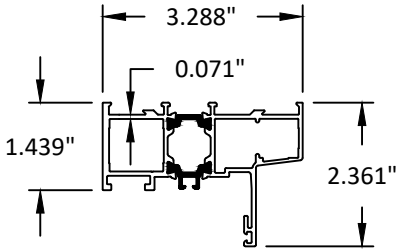


1 FRAME
TD32511/TD3252

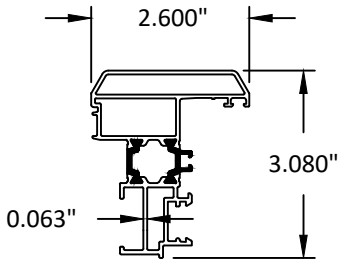

5 ASTRAGAL
TD3258/TD3259

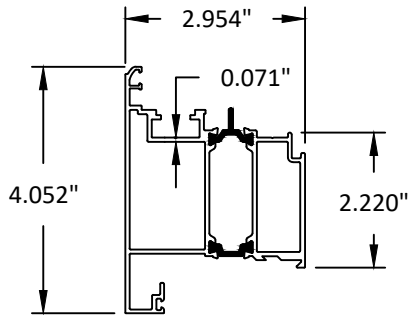

2 STILE/RAIL
TD3253/TD3254

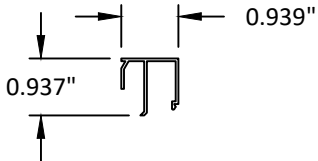

6 GLAZING BEAD
WWB02



2301 EAST VERNON AVE.
VERNON, CA 90058
PH: (323) 771-9819

TITLE: TD-400 TERRACE DOOR
(NON-HVHZ)/(NON-IMPACT)

BILL OF MATERIALS
& COMPONENTS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 CODE CHANGE	HJ	03/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT

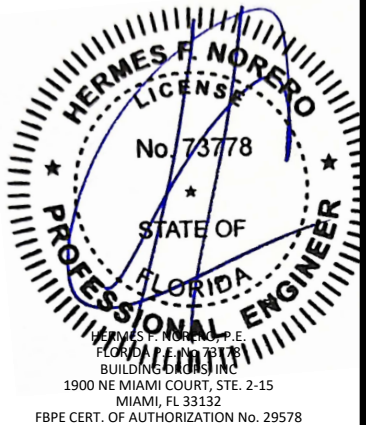

FL #:	FL45922
DATE:	12.04.2023
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ARC016
SHEET:	8
REV.	A