


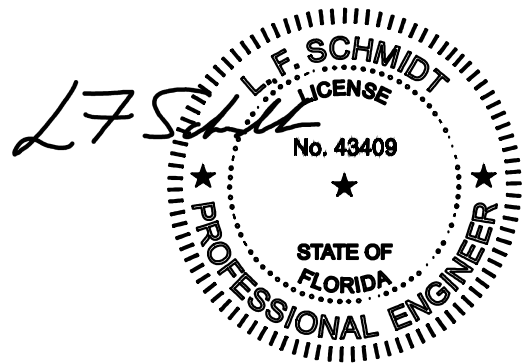


This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

**FLUSH GLAZED FIBERGLASS DOOR
DOUBLE w/ SIDELITES
INSWING/OUTSWING
"IMPACT"**

1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and excludes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS			
SHEET #	DESCRIPTION	SHEET #	
1	Typical Elevations, Design Pressures & General Notes	7	Horizontal & Vertical Cross Sections (1X Buck)
2	Door Panel Details	8	Horizontal & Vertical Cross Sections (Direct to Masonry)
3	Sidelite Panel & Lite Frame Glazing Details	9	Vertical Cross Sections (Thresholds)
4	Elevations	10	Buck & Frame Anchoring & Hardware Details
5	Horizontal Cross Sections	11	Bill of Materials & Components
6	Horizontal & Vertical Cross Sections (2X Buck)		

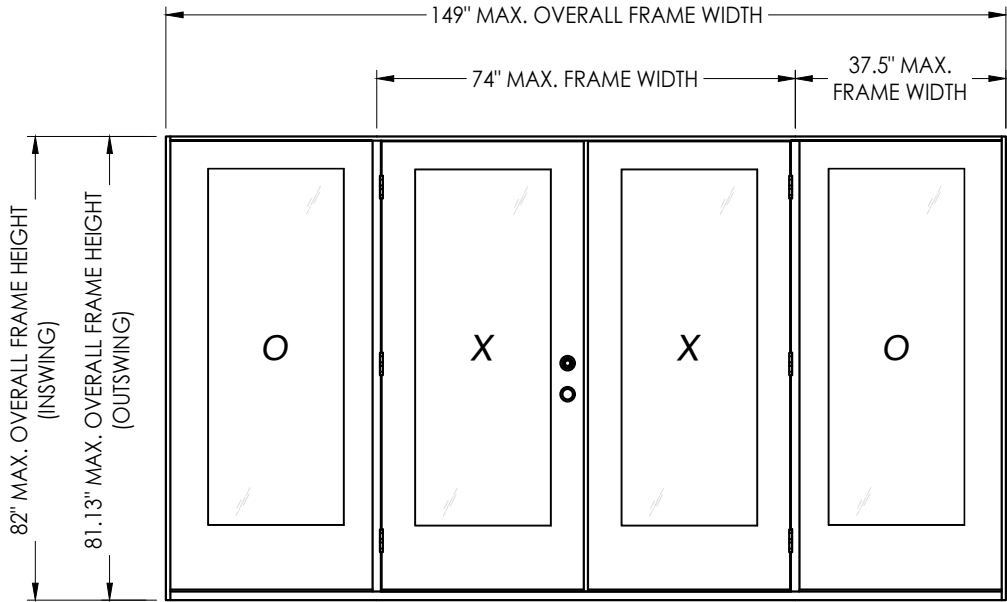


OXXO
CONTINUOUS HEAD & SILL

CONFIGURATION	MAX. FRAME DIMENSION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
OXXO	149" x 82.0"	+50.0	-50.0	+50.0	-50.0




PRODUCT:		OD FIBERGLASS DOOR		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PART OR ASSEMBLY:		TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES			
DATE:		12/10/24			
SCALE:		N.T.S.			
DWG. BY:		LFS			
CHK. BY:		RW			
DRAWING NO.:		FL-46118.10			
SHEET	<u>1</u>	OF	<u>11</u>		

Z:\2023 FBC Drawings\ODL, Inc\FL-46118\FL-46118.10.dwg

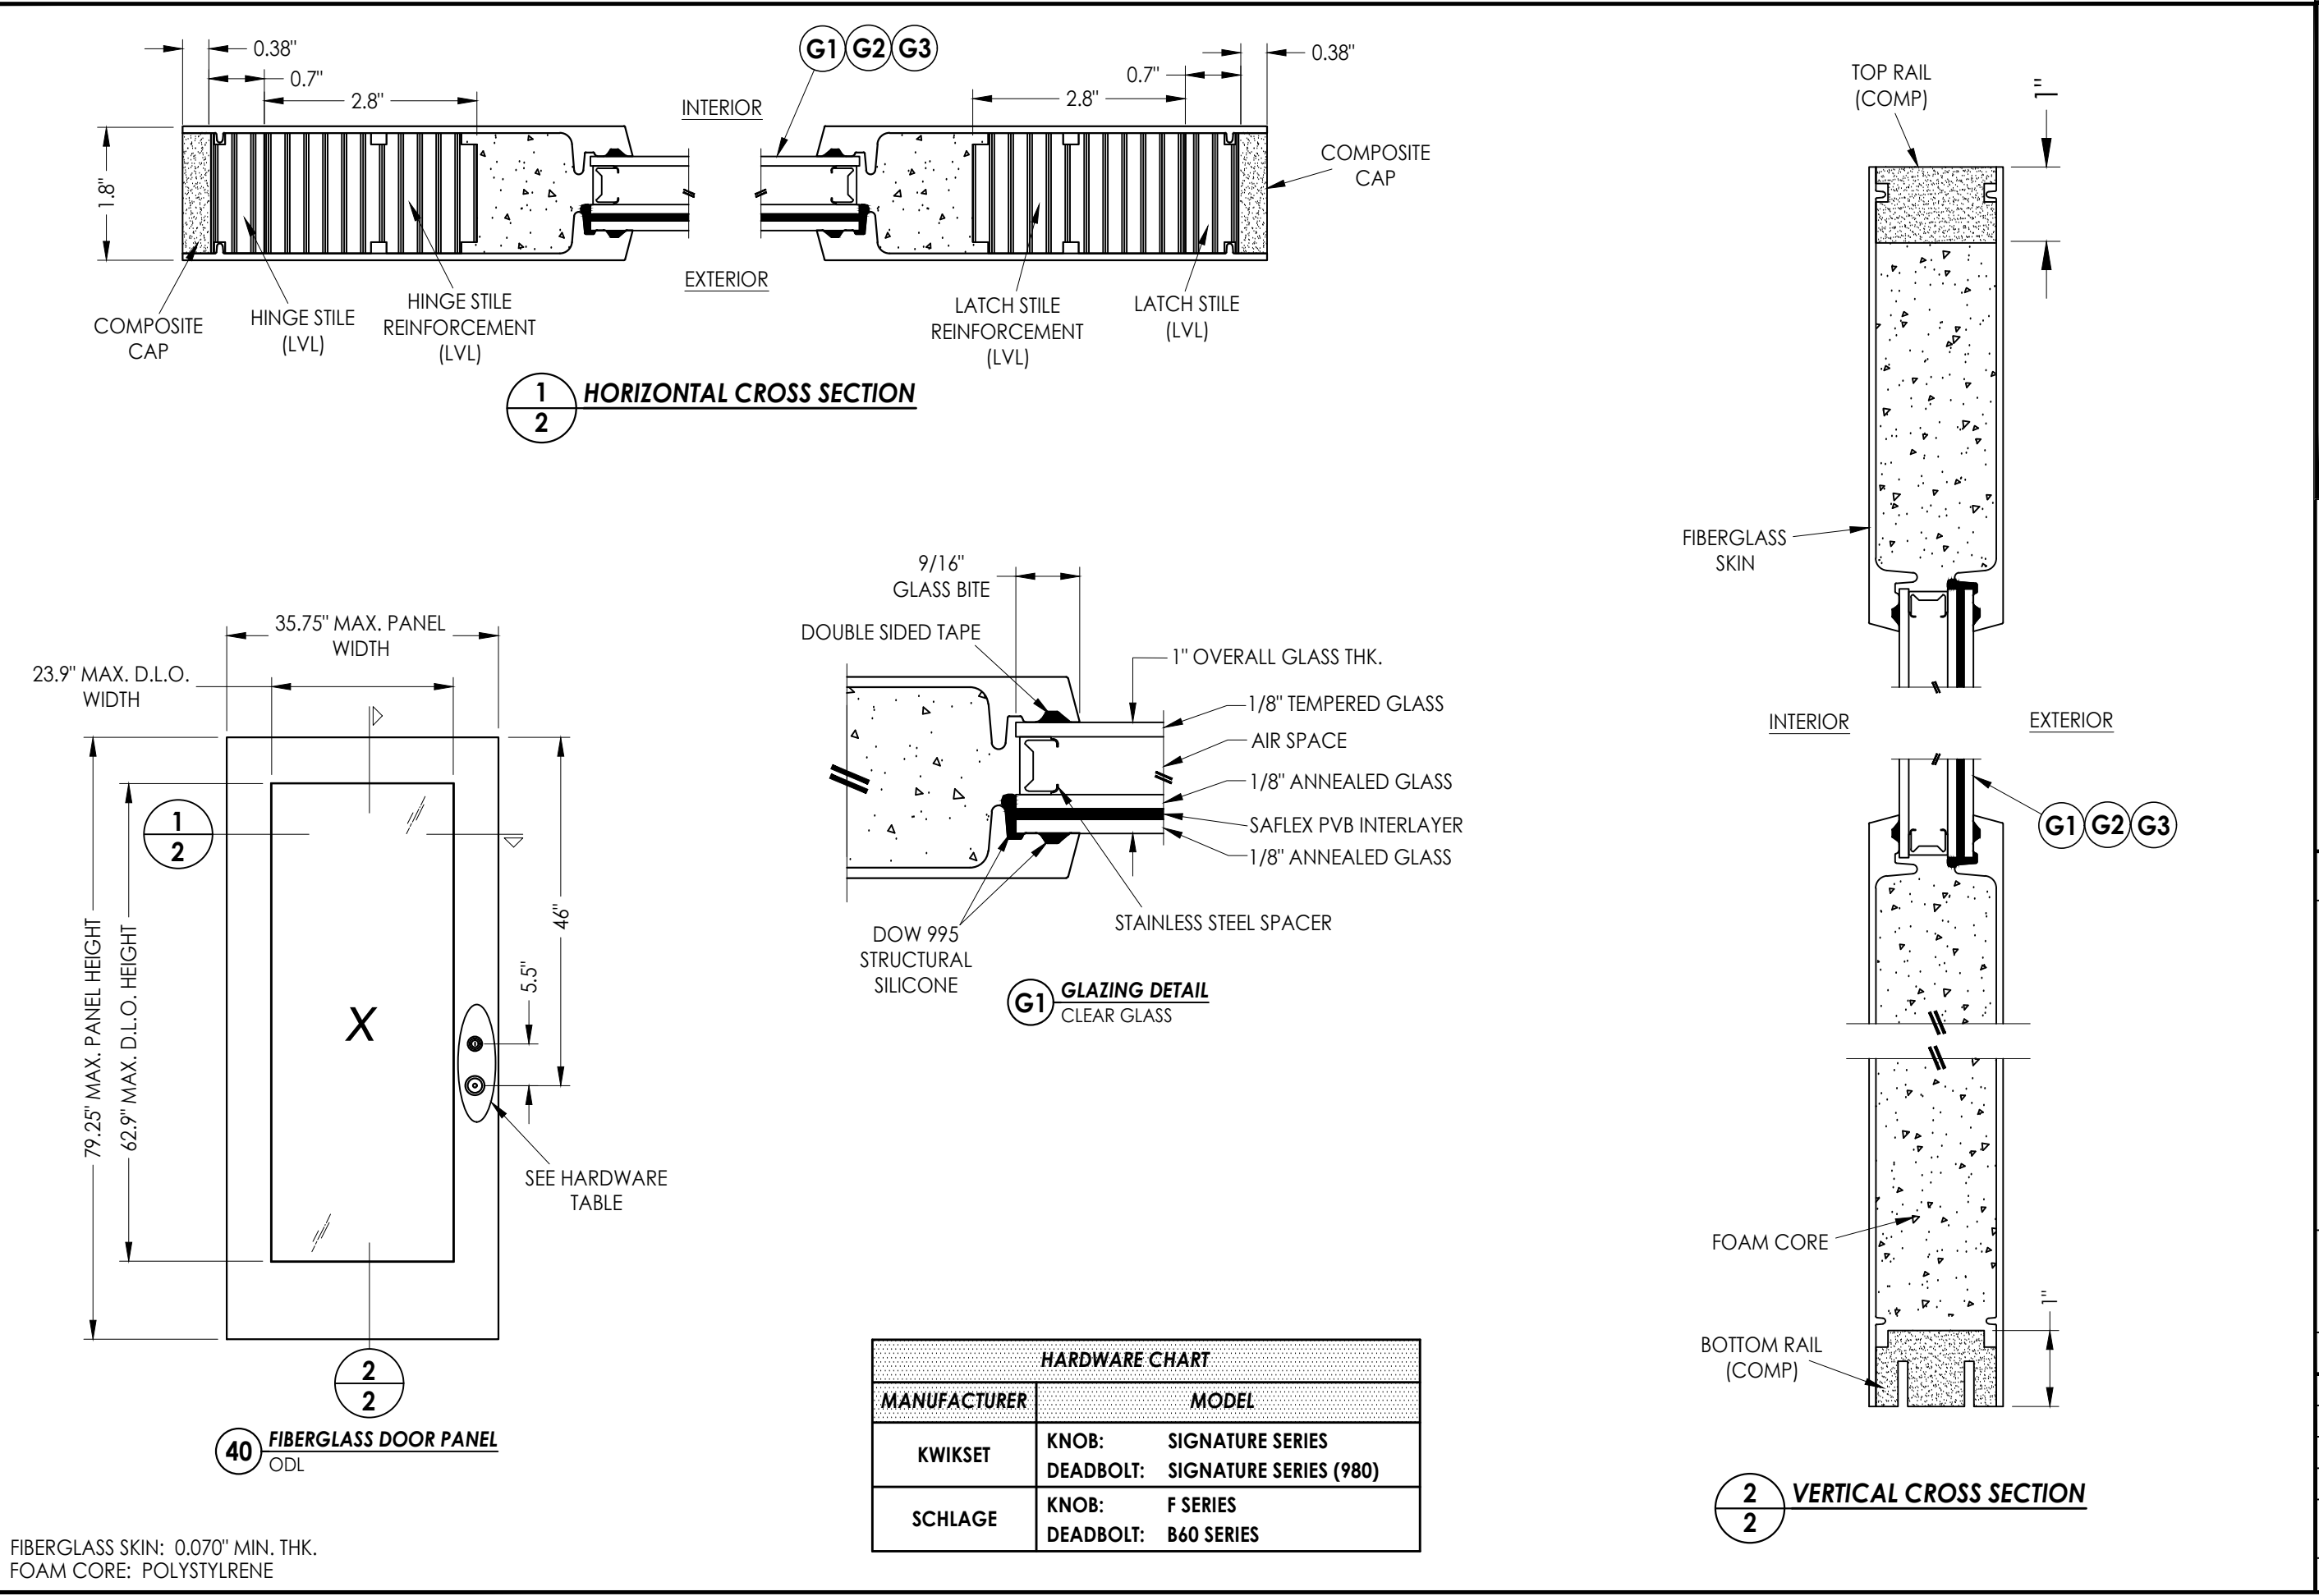

FIBERGLASS SKIN: 0.070" MIN. THK.
FOAM CORE: POLYSTYRENE

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: ODL FIBERGLASS DOOR		PART OR ASSEMBLY: DOOR PANEL DETAILS	
			</

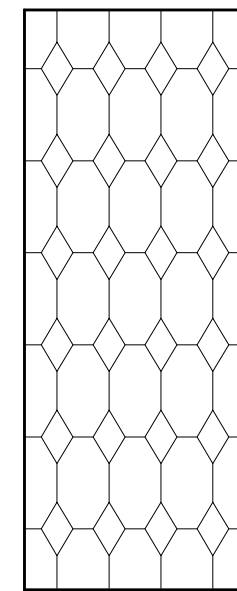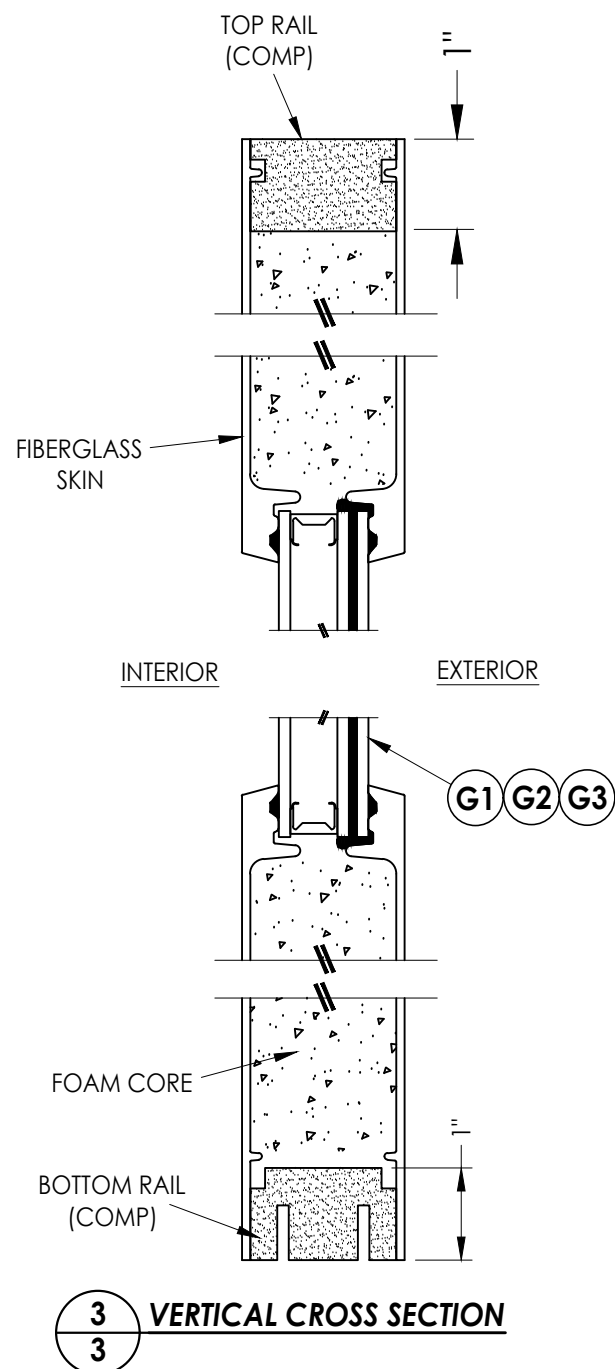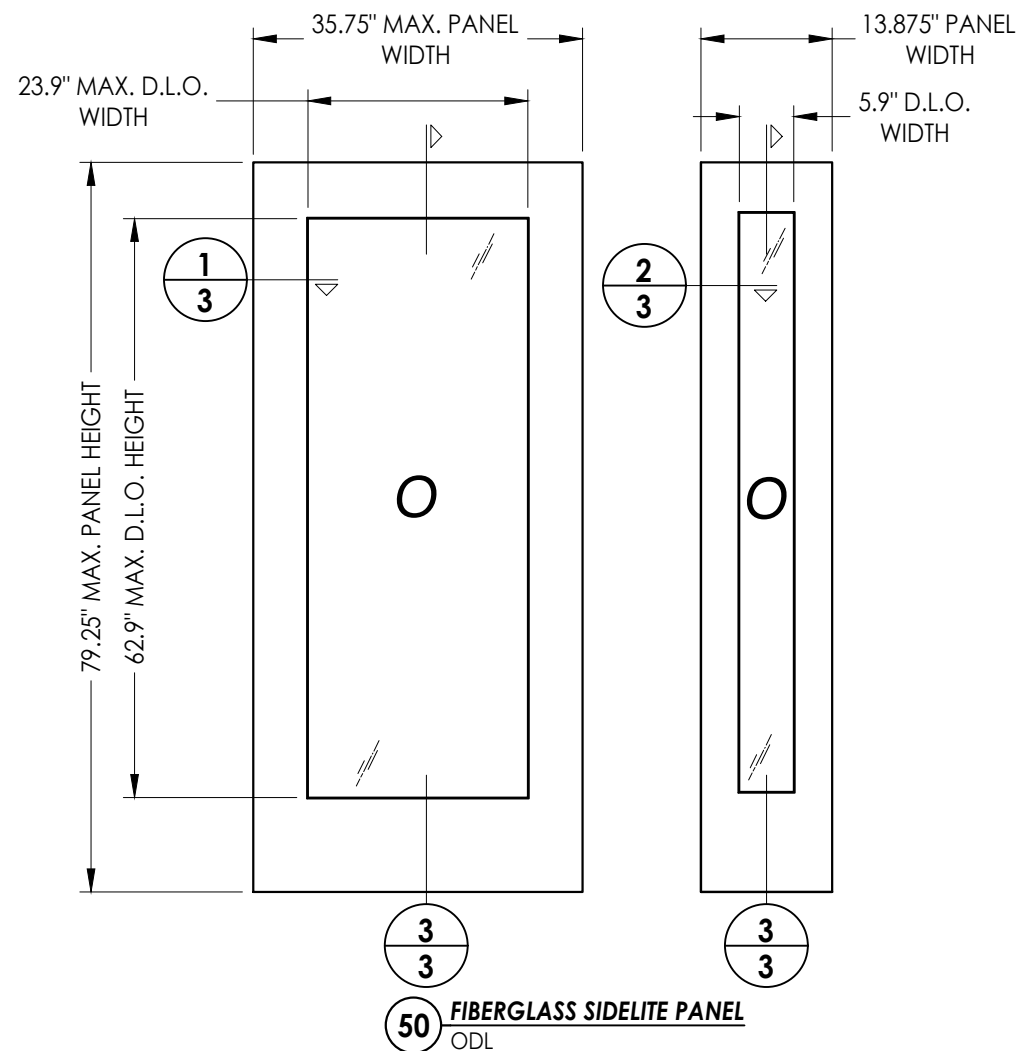

DECORATIVE

1" OVERALL GLASS THK.

1/8" TEMPERED GLASS

AIR SPACE

GRID INSERT

1/8" ANNEALED GLASS

SAFLEX PVB INTERLAYER

1/8" ANNEALED GLASS

INTERCEPT SPACER

1" OVERALL GLASS THK.

1/8" TEMPERED GLASS

AIR SPACE

DECORATIVE INSERT

1/8" ANNEALED GLASS


SAFLEX PVB INTERLAYER

1/8" ANNEALED GLASS

DURASEAL™
(BY TRUSEAL TECHNOLOGIES)

G3 **GLAZING DETAIL**
DECORATIVE


© 2024 R.W. BUILDING CONSULTANTS INC.

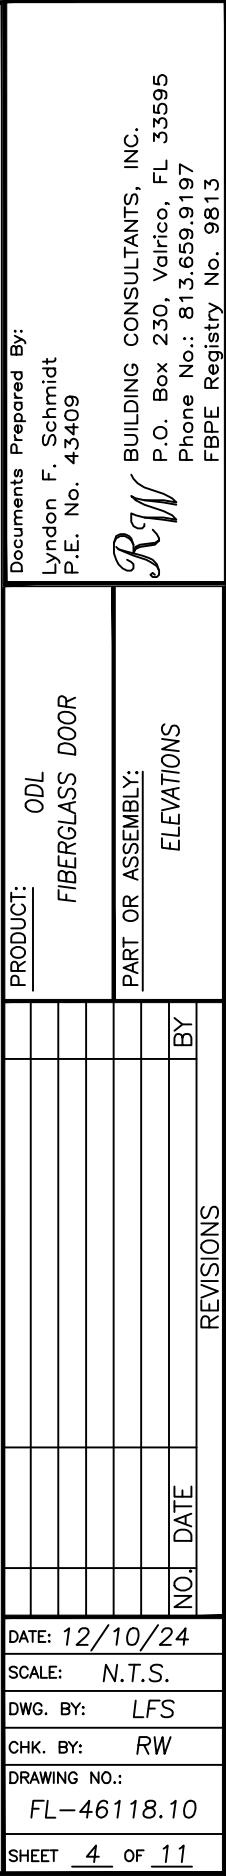


DATE:	12/10/24
SCALE:	N.T.S.
DWG. BY:	LFS
CHK. BY:	RW
DRAWING NO.:	FL-46118.10
SHEET	<u>4</u> OF <u>11</u>

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\ODL, Inc\FL-46118\FL-46118.10.dwg

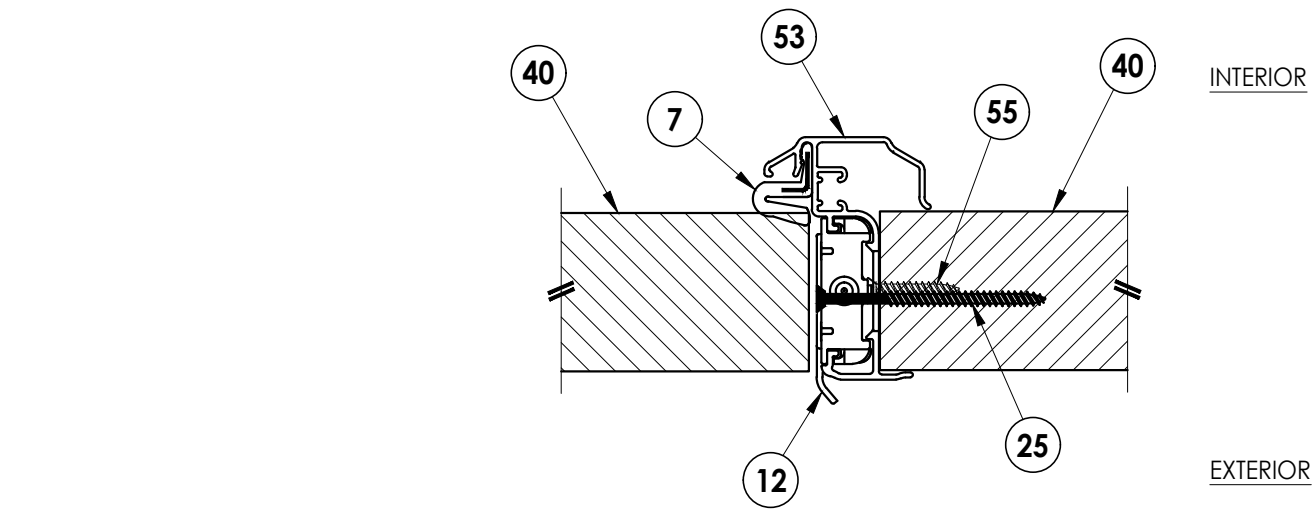

1
5 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)

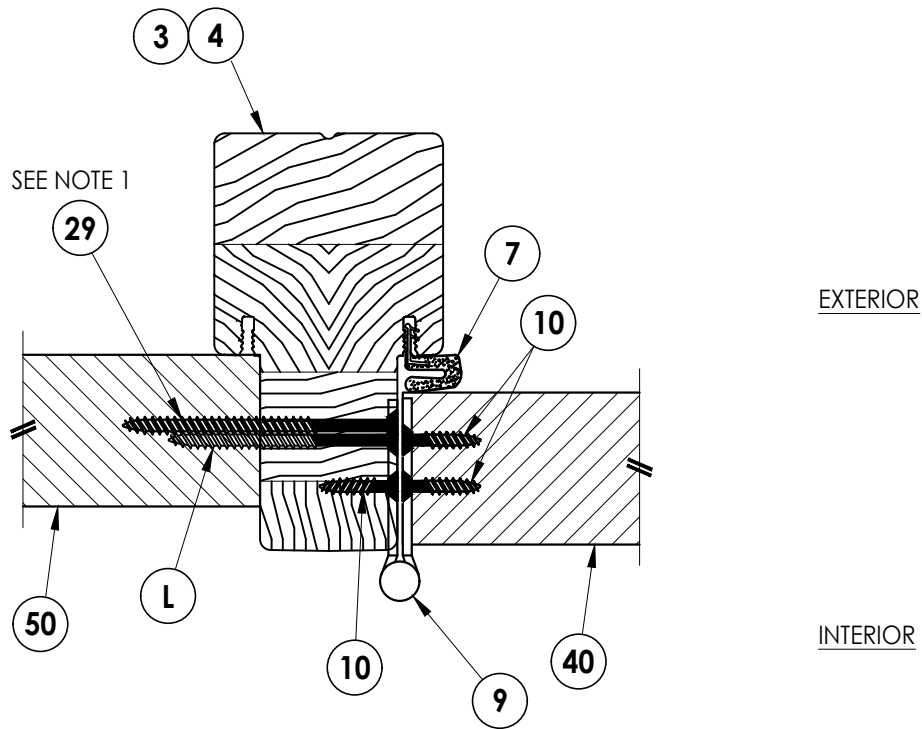

2
5 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)


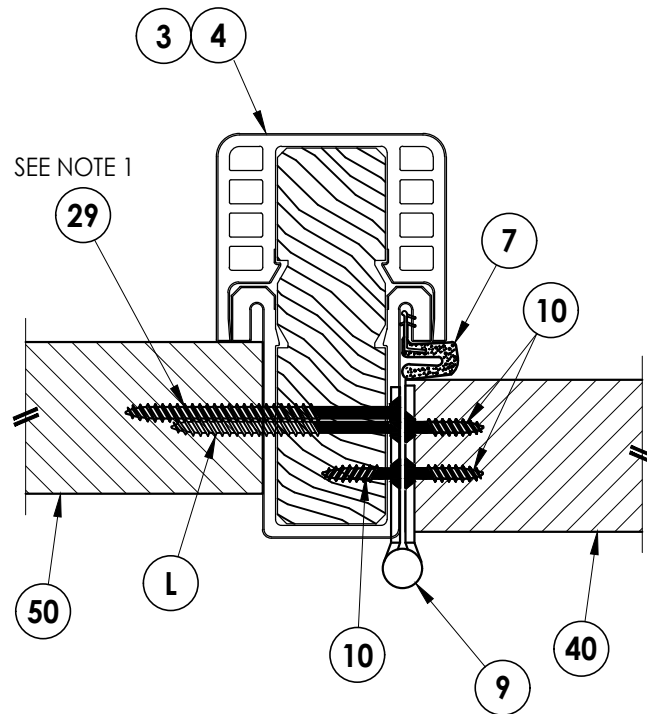


3
5 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)

Notes:


1. Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		R.W. BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813	
PRODUCT: ODL FIBERGLASS DOOR		PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS	
		BY	
		NO. DATE	
		REVISIONS	
DATE: 12/10/24			
SCALE: N.T.S.			
DWG. BY: LFS			
CHK. BY: RW			
DRAWING NO.: FL-46118.10			
SHEET 5 OF 11			

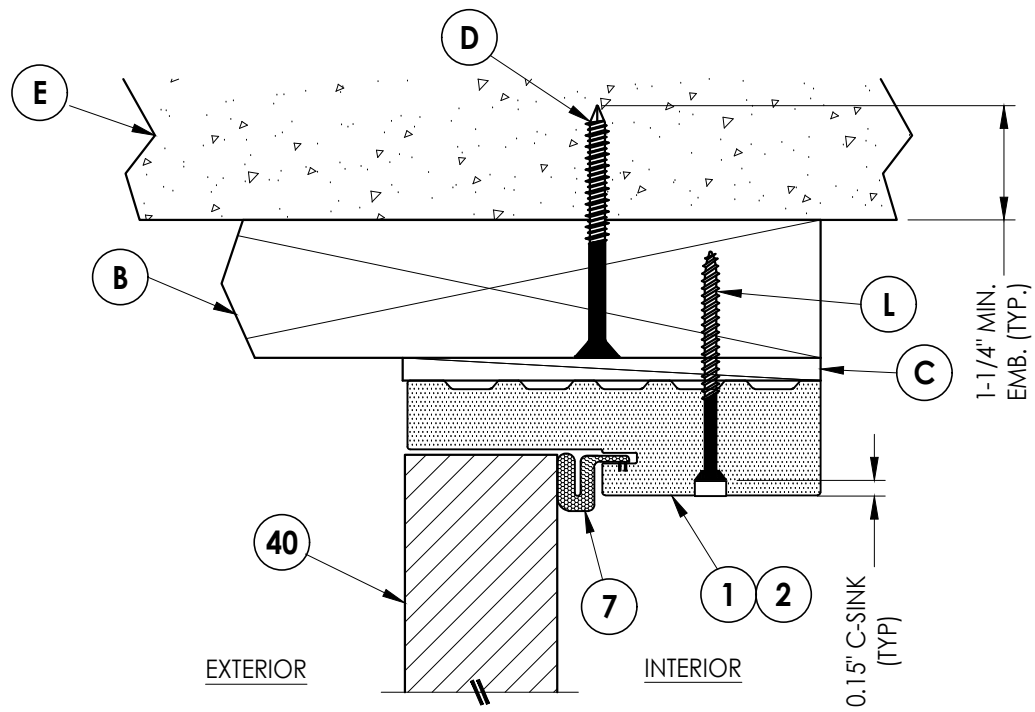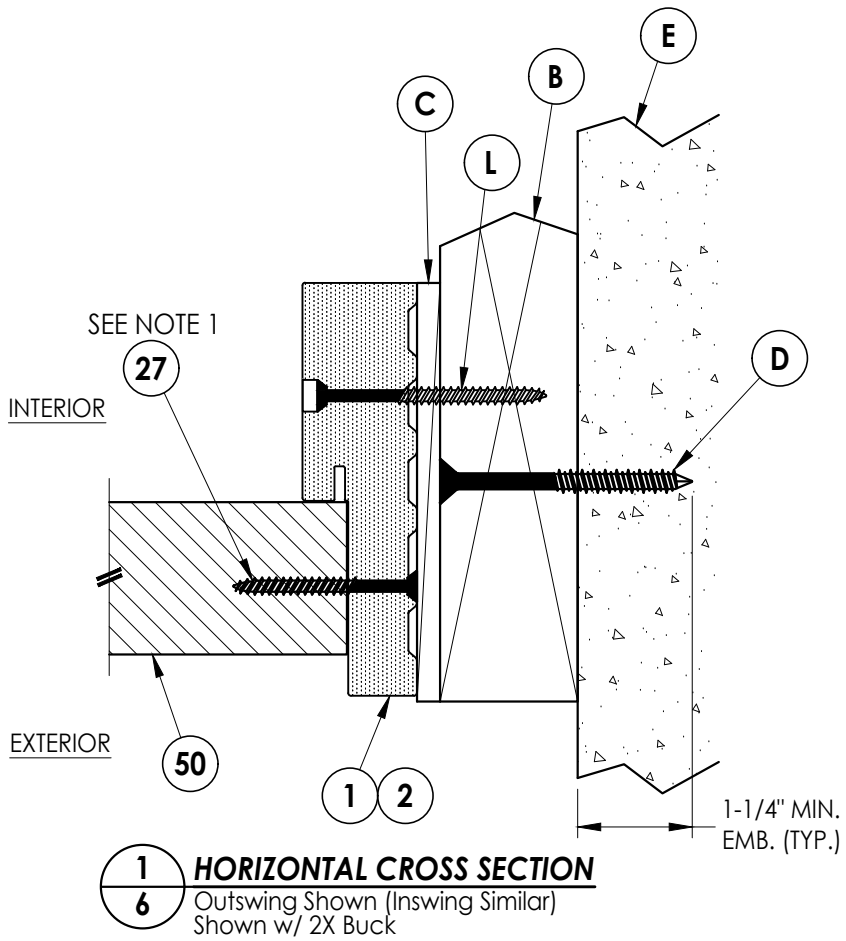

2 VERTICAL CROSS SECTION

6 Outswing Shown (Inswing Similar)
Shown w/ 2X Buck

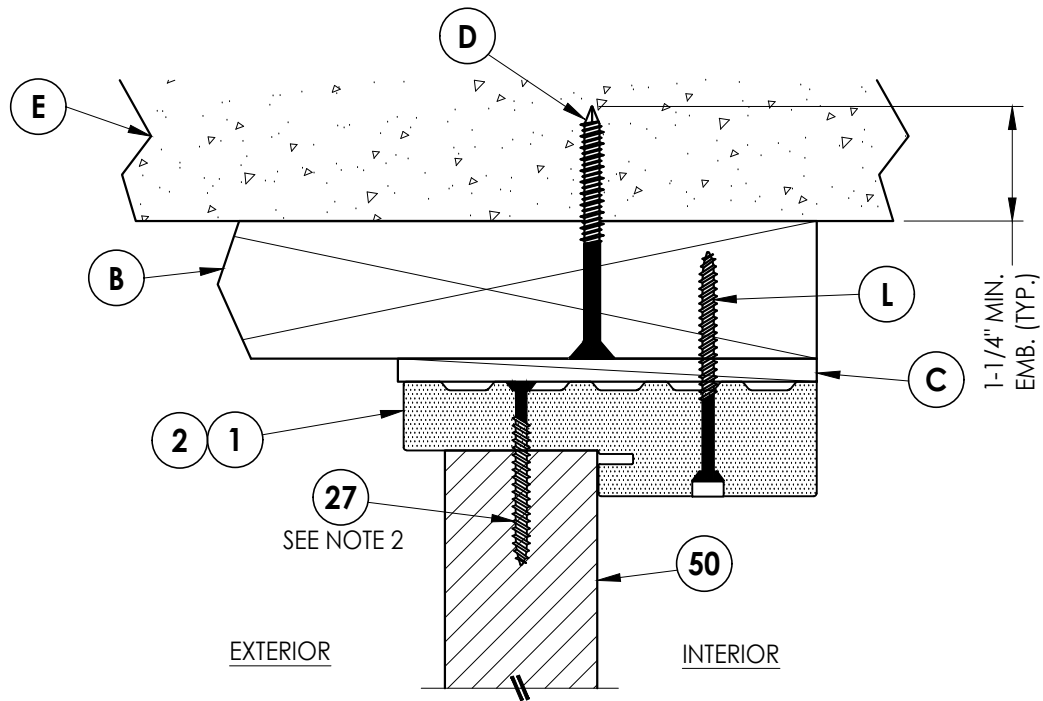

3 VERTICAL CROSS SECTION

6 Outswing Shown (Inswing Similar)
Shown w/ 2X Buck

Notes:

1. Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).
2. Sidelite assembly screws located 10" from each end (2 screws total along head & sill). Note: Screws not required on 14" Sidelites.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: ODL
FIBERGLASS DOOR

PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)

[illegible]

DATE: 12/10/24

SCALE: N.T.S.



DWG. BY: *LFS*

CHK. BY: *RW*


DRAWING NO.:

FL-46118.10

© 2024 R.W. BUILDING CONSULTANTS INC.

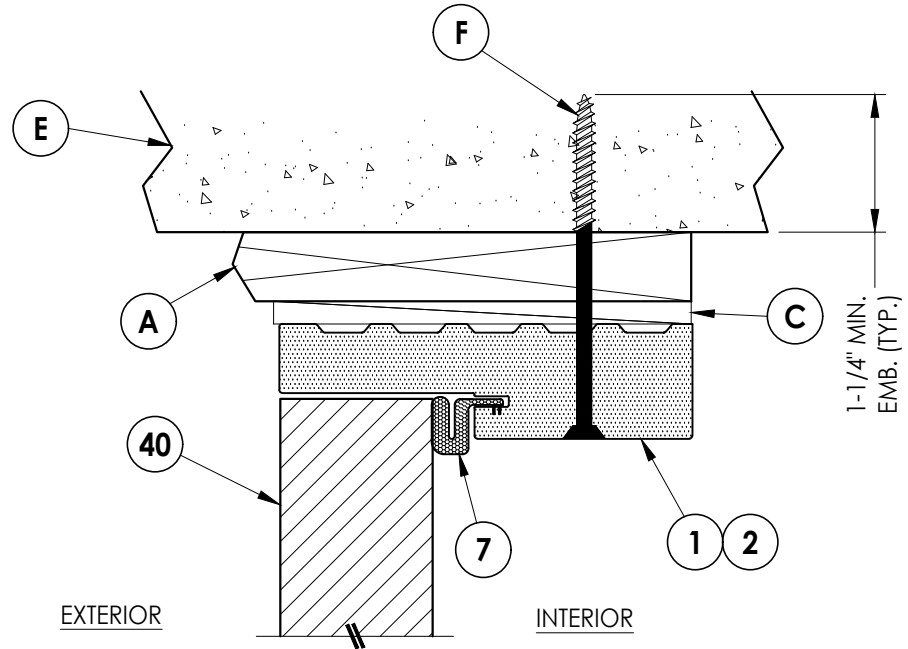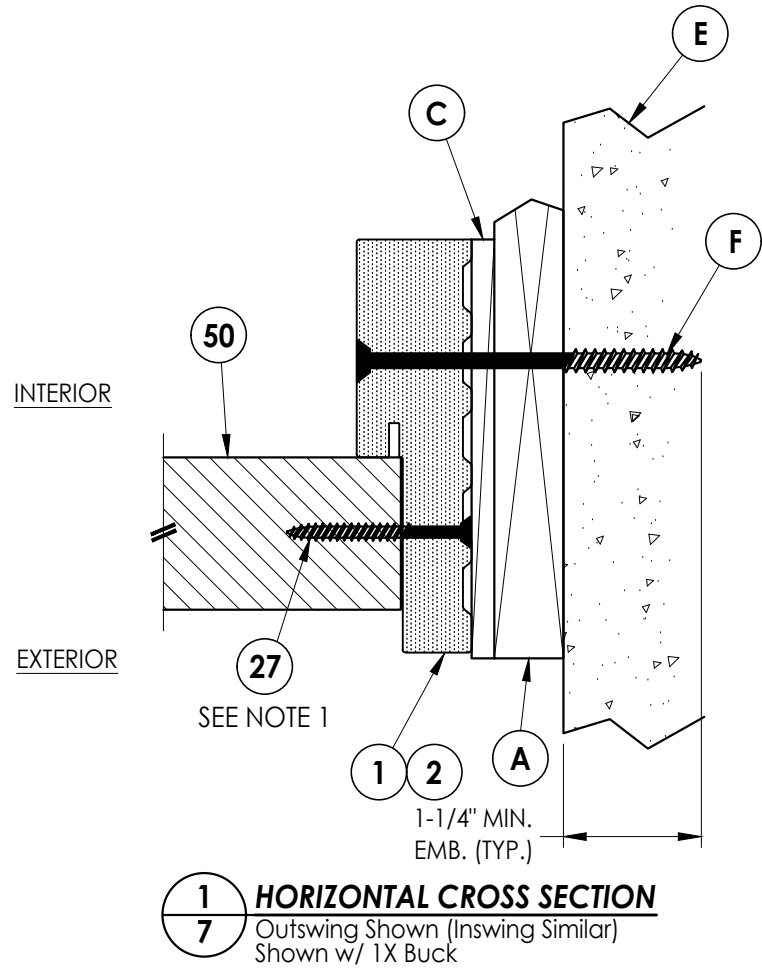

2 **VERTICAL CROSS SECTION**
7 Outswing Shown (Inswing Similar)
Shown w/ 1X Buck

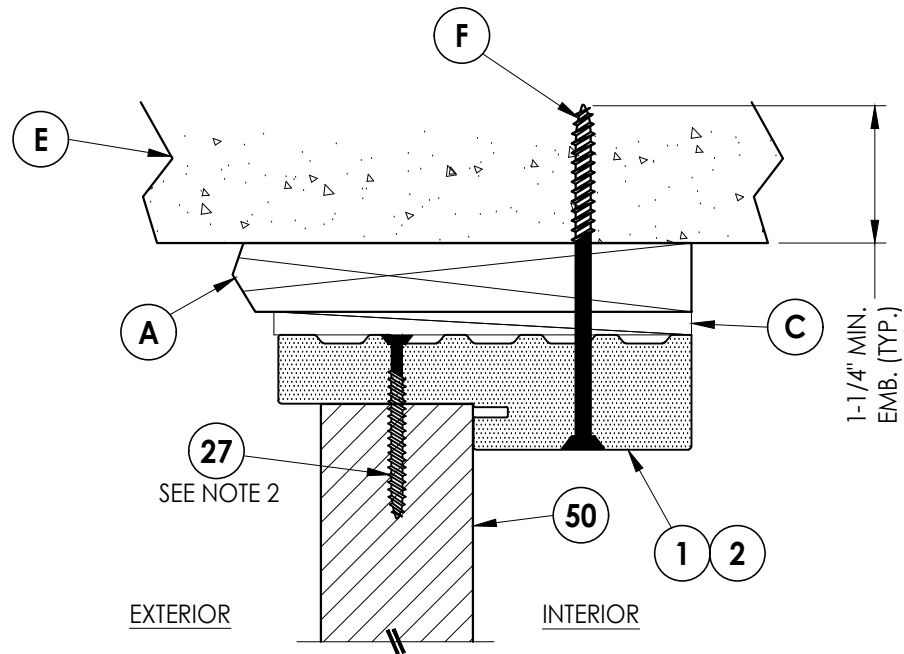

3 **VERTICAL CROSS SECTION**
7 Outswing Shown (Inswing Similar)
Shown w/ 1X Buck



Notes:

1. Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).
2. Sidelite assembly screws located 10" from each end (2 screws total along head & sill). Note: Screws not required on 14" Sidelites.


[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

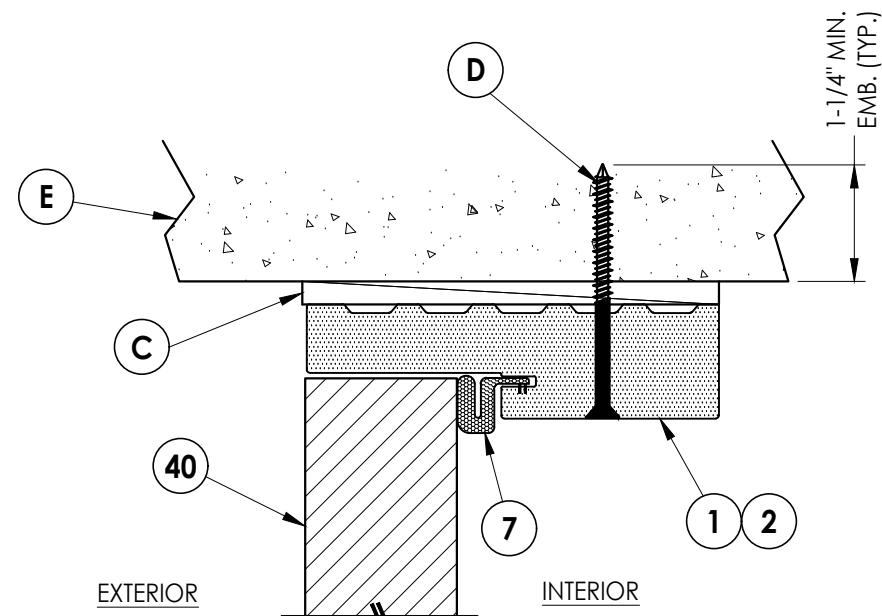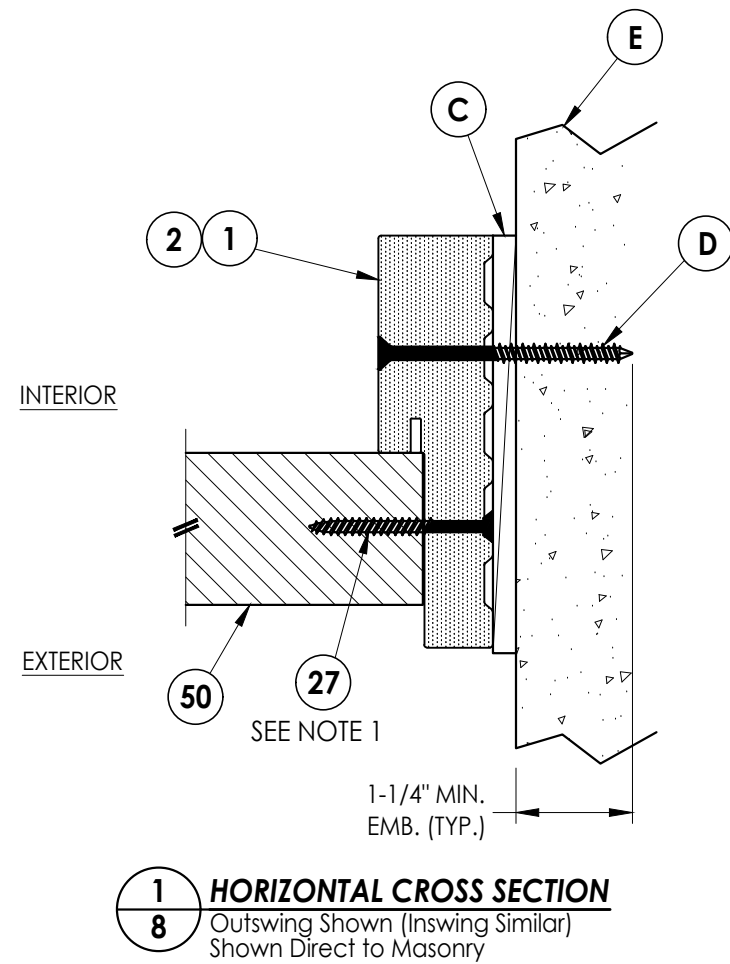

2 **VERTICAL CROSS SECTION**
8 Outswing Shown (Inswing Similar)
 Shown Direct to Masonry

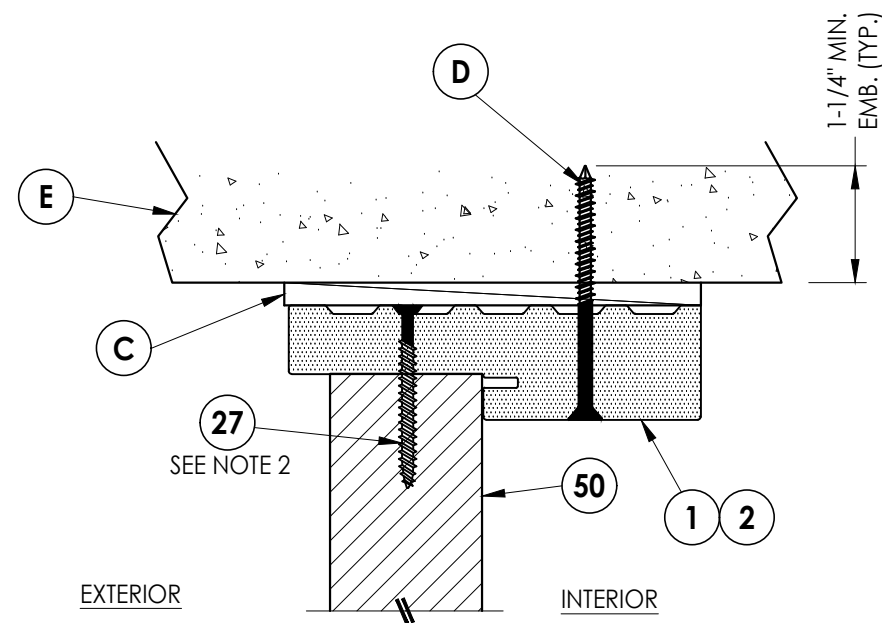

3 **VERTICAL CROSS SECTION**
8 Outswing Shown (Inswing Similar)
 Shown Direct to Masonry


Notes:

1. Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).
2. Sidelite assembly screws located 10" from each end (2 screws total along head & sill). Note: Screws not required on 14" Sidelites.


[illegible]

Z:\2023 FBC Drawings\ODL, Inc\FL-46118\FL-46118.10.dwg


Note:
1. Sidelite assembly screws located 10" from each end (2 screws total along head & sill). Note: Screws not required on 14" Sidelites.

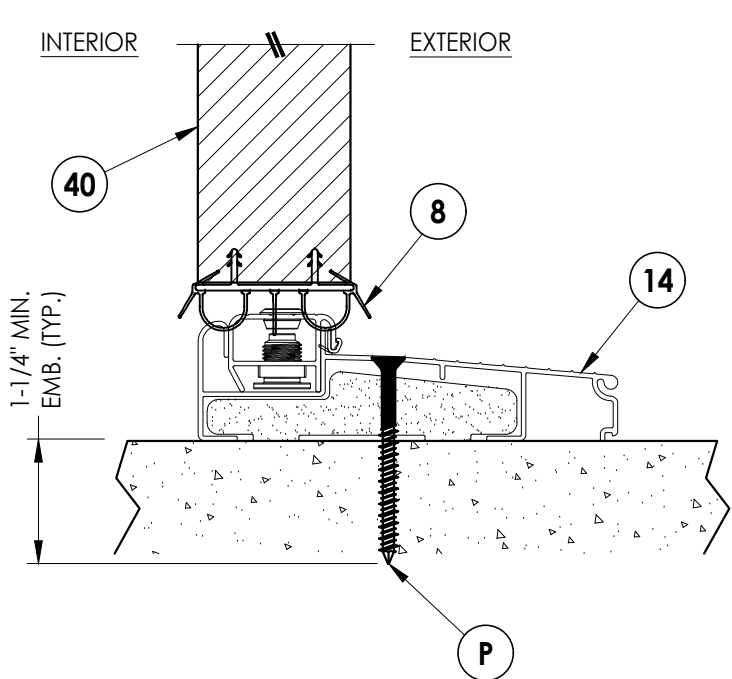


1
9 VERTICAL CROSS SECTION
Inswing Sill

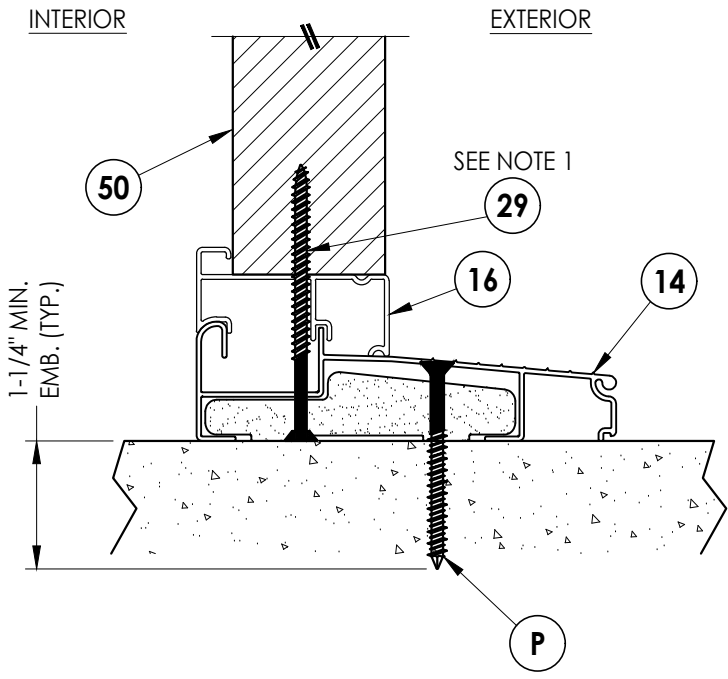

3
9 VERTICAL CROSS SECTION
Inswing Sill

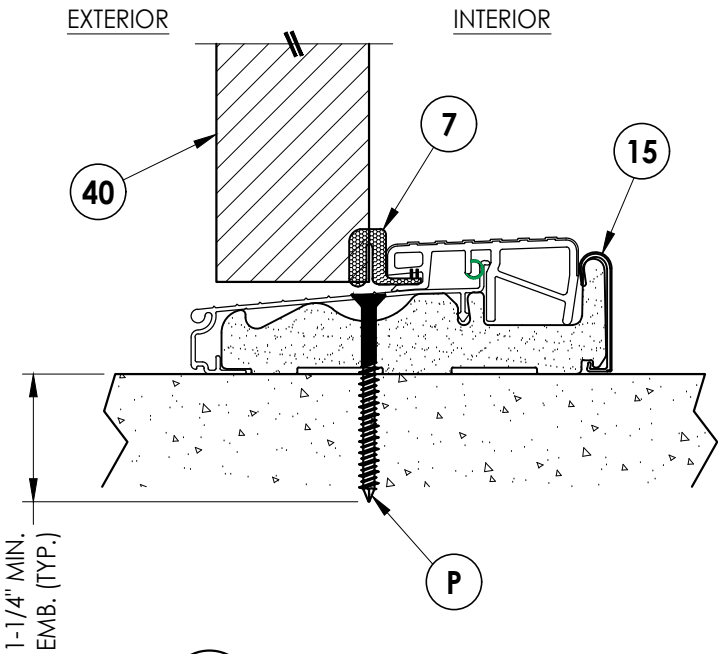

2
9 VERTICAL CROSS SECTION
Outswing Sill

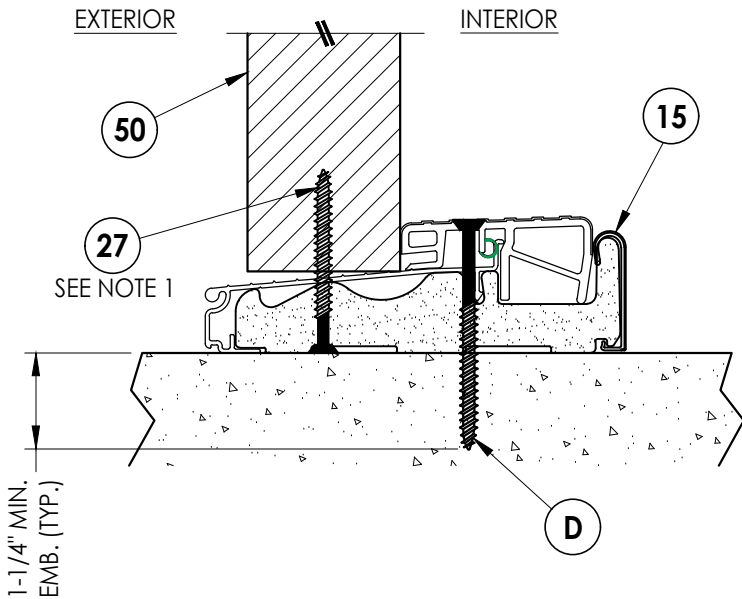

4
9 VERTICAL CROSS SECTION
Outswing Sill

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: ODL
FIBERGLASS DOOR

PART OR ASSEMBLY:
VERTICAL CROSS
SECTIONS (THRESHOLDS)

REVISIONS		NO.	DATE	BY

DATE: 12/10/24











SCALE: N.T.S.

DWG. BY: LFS

CHK. BY: RW

DRAWING NO.:
FL-46118.10

SHEET 9 OF 11

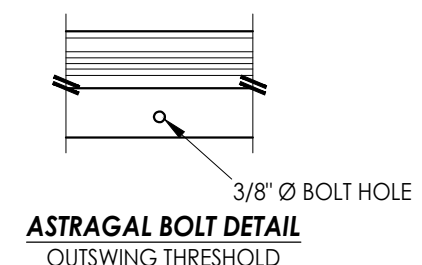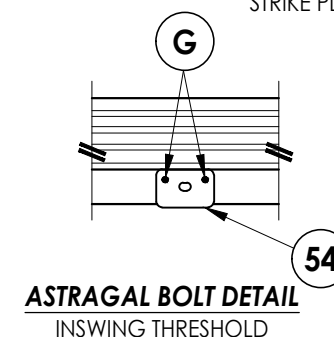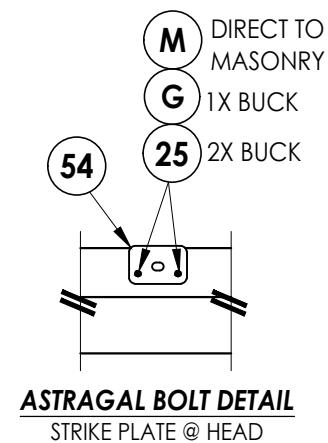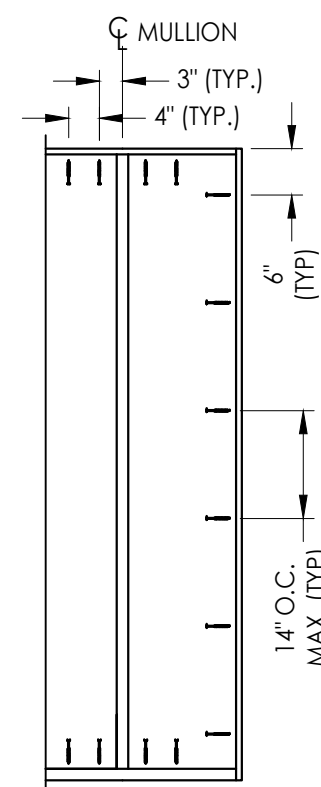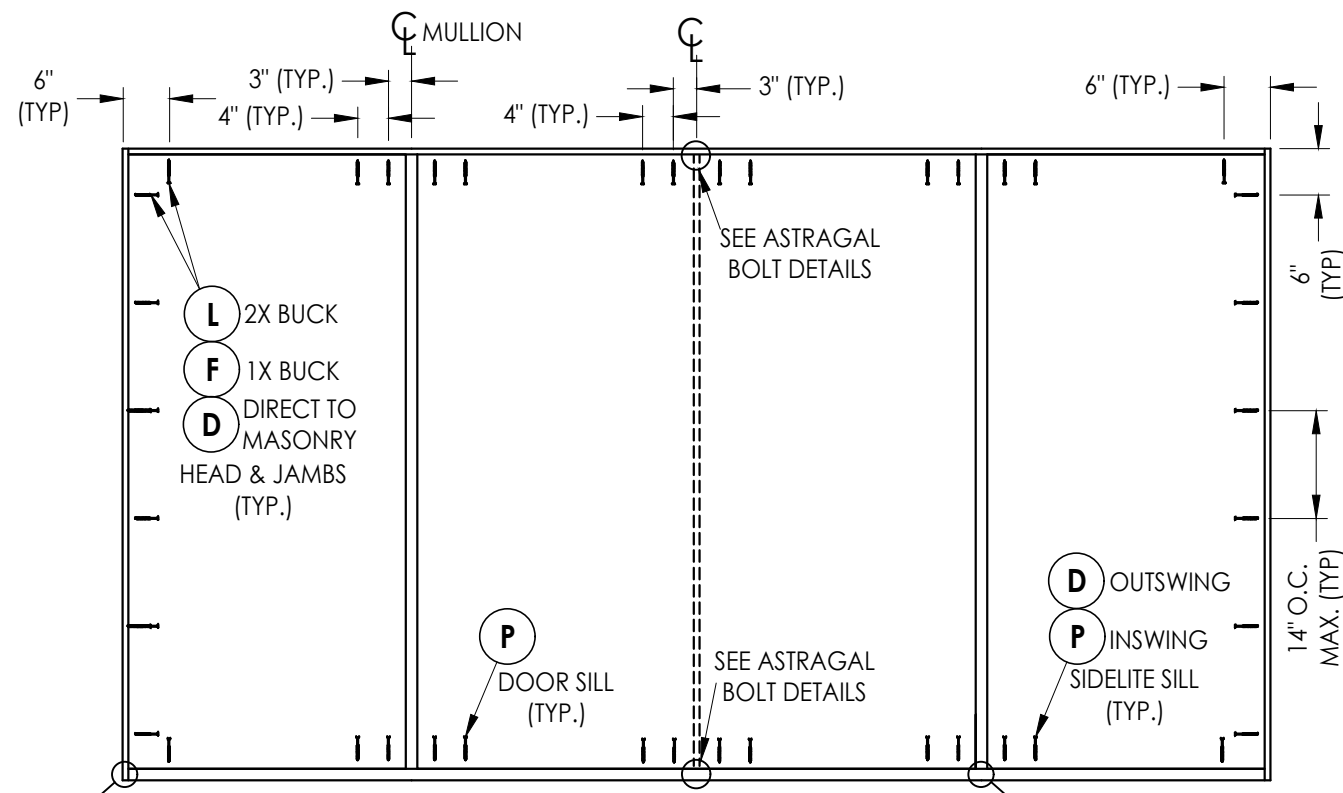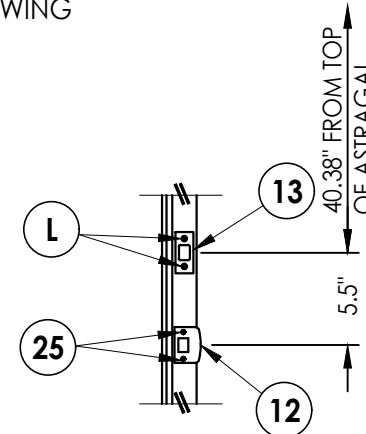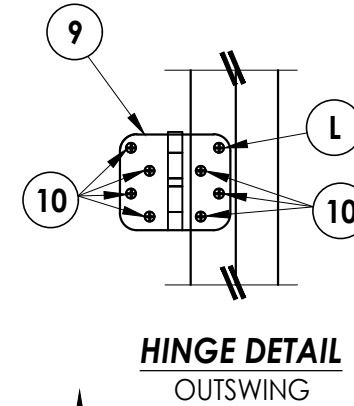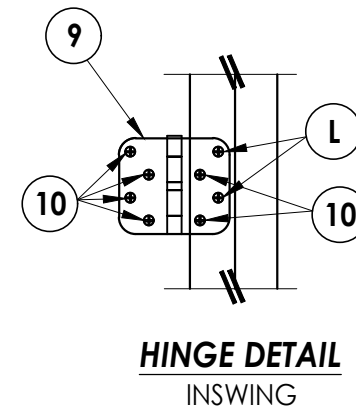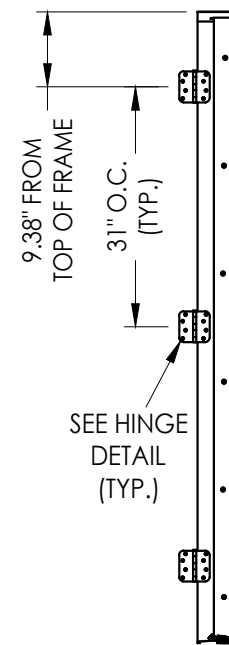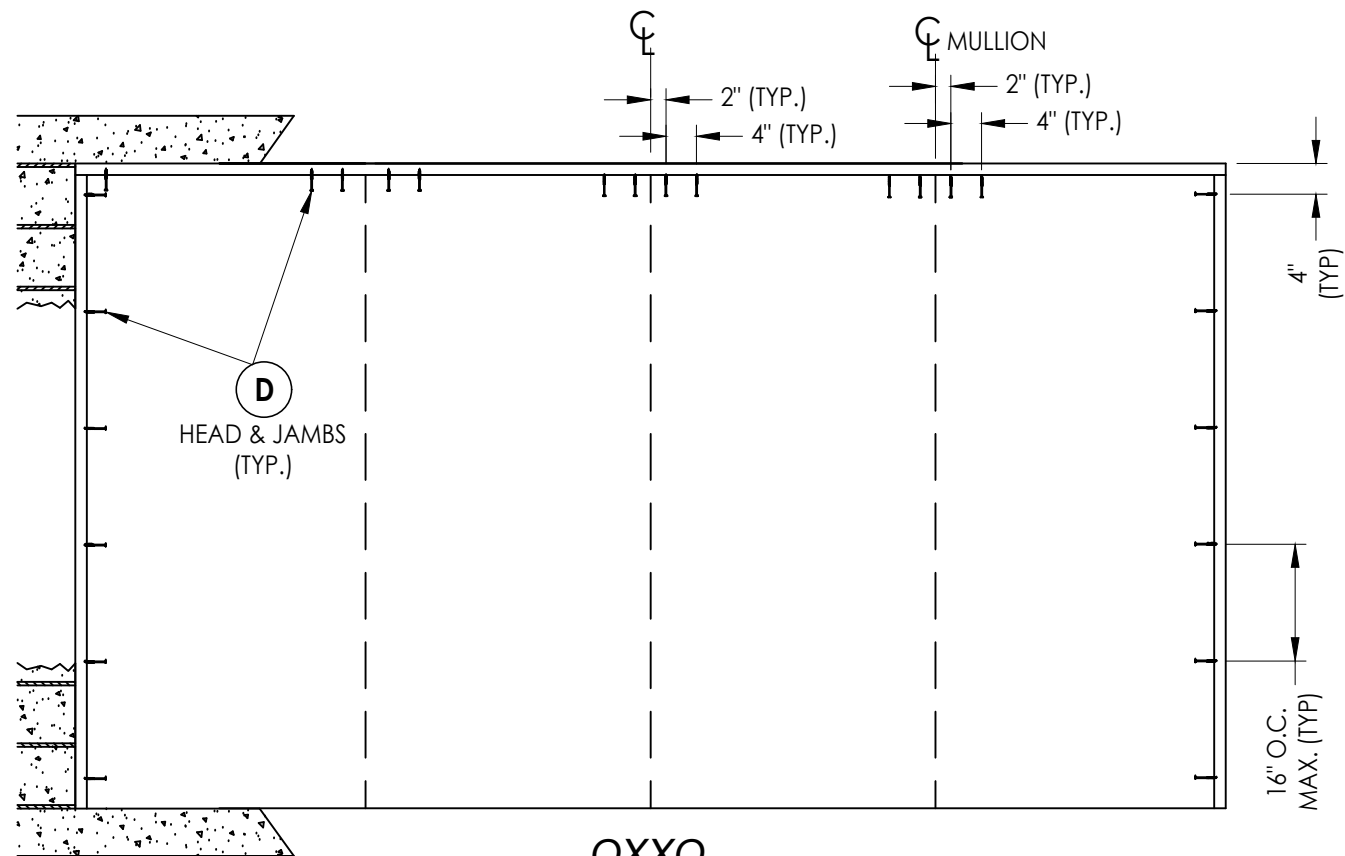

HARDWARE DETAILS

[illegible]

Z:\2023 FBC Drawings\ODL, Inc\FL-46118\FL-46118.10.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.42)	WOOD
B	2X BUCK (G >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMB.)	STEEL
M	3/16" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
P	1/4" X 2-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
1	COMPOSITE JAMB (WORLDWIDE OR PLASTPRO)	COMP
2	WOOD JAMB (FJ PINE OR PLASTPRO)	WOOD
3	COMPOSITE MULLION (ENDURA OR PLASTPRO)	PVC/WOOD
4	WOOD MULLION (PINE OR ENDURA)	WOOD
7	WEATHERSTRIP	FOAM
8	DOOR SWEEP	VINYL
9	4" X 4" HINGE	STEEL
10	#9 X 3/4" PFH WOOD SCREW	STEEL
12	LATCH STRIKE PLATE	STEEL
13	DEADBOLT STRIKE PLATE	STEEL
14	INSWING THRESHOLD	ALUM/COMP
15	OUTSWING THRESHOLD	ALUM/COMP
16	INSWING SIDELITE BASE	ALUM
25	#8 X 2-1/2" PFH WOOD SCREW	STEEL
27	#10 X 2" PFH SMS	STEEL
29	#10 X 3" FH COMPOSITE DECK SCREW	STEEL
40	DOOR PANEL	-
50	SIDELITE PANEL	-
53	ALUMINUM ASTRAGAL	ALUM
54	ASTRAGAL STRIKE PLATE (1.75" X 2.5")	STEEL
55	8 X 1" PFH WS	STEEL


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

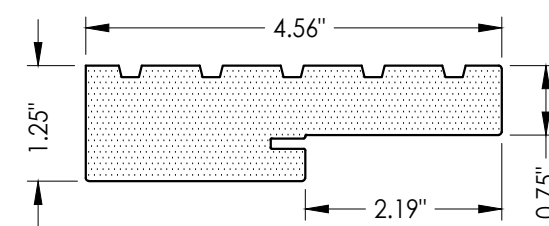


1 COMPOSITE JAMB
WORLDWIDE 4EVER COMPOSITE FRAME

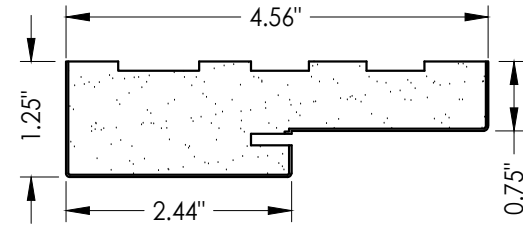


1 COMPOSITE JAMB
PLASTPRO POLY FIBER JAMB

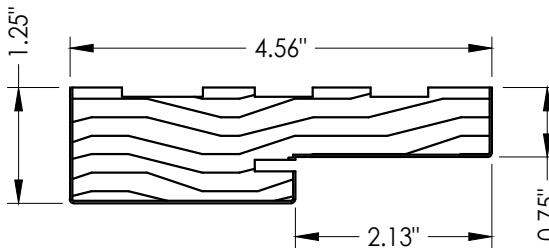


2 WOOD JAMB
FINGER JOINTED PINE

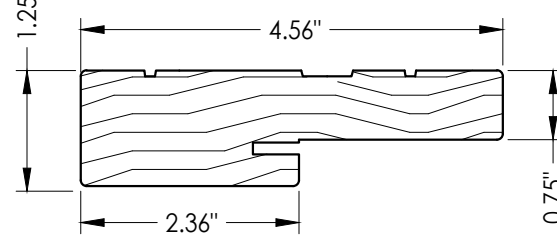


2 WOOD JAMB
ENDURA FrameSaver

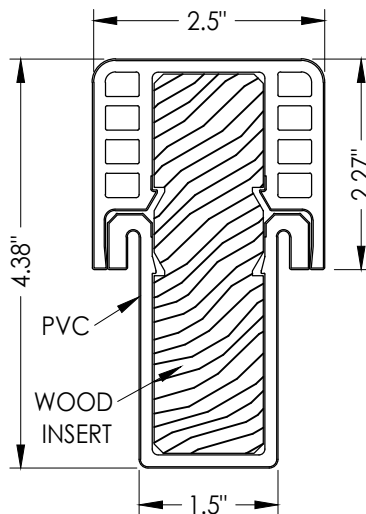


3 COMPOSITE MULLION
ENDURA FUSION
w/ PVC Boot

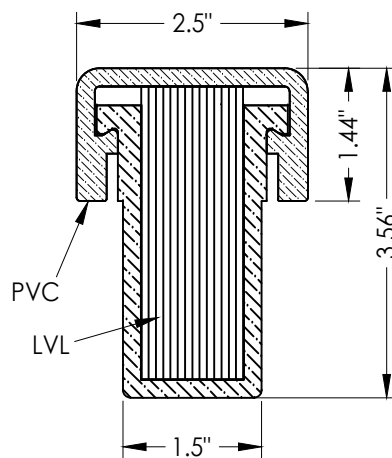


3 COMPOSITE MULLION
PLASTPRO (3-Piece)
w/ PVC Boot

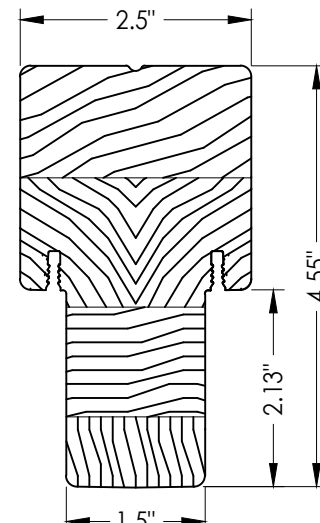


4 WOOD MULLION
PINE

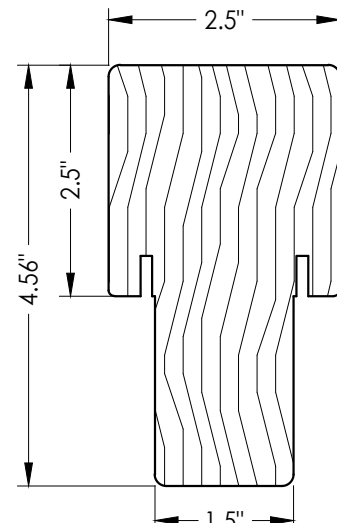


4 WOOD MULLION
ENDURA FrameSaver

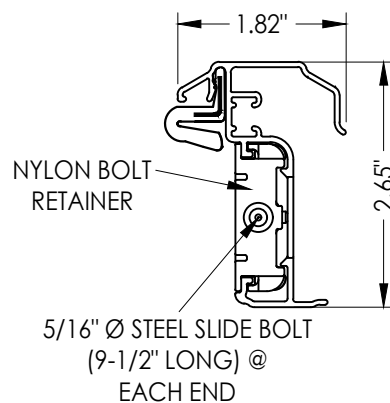


53 ENDURA ULTIMATE ALUMINUM ASTRAGAL
ULTIMATE PUSH BUTTON ASTRAGAL
ULTIMATE HURRICANE ASTRAGAL

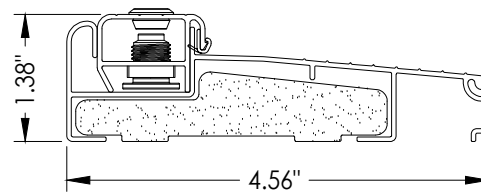

14 INSWING ADJUSTABLE THRESHOLD
ZAILAA4565

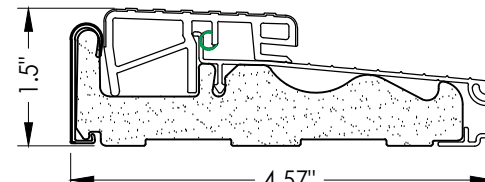

15 OUTSWING THRESHOLD
ENDURA Z SERIES

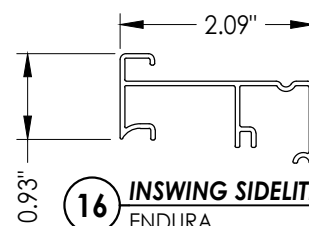

16 INSWING SIDELITE BASE
ENDURA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: ODL
FIBERGLASS DOOR

PART OR ASSEMBLY:
BILL OF MATERIALS
& COMPONENTS

NO.	DATE	BY	REVISIONS

DATE: 12/10/24

SCALE: N.T.S.

DWG. BY: LFS

CHK. BY: RW

DRAWING NO.: FL-46118.10

SHEET 11 OF 11