



THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA



**FLUSH GLAZED FIBERGLASS DOOR
SINGLE w/ SIDELITE(S)
INSWING/OUTSWING
"IMPACT"**

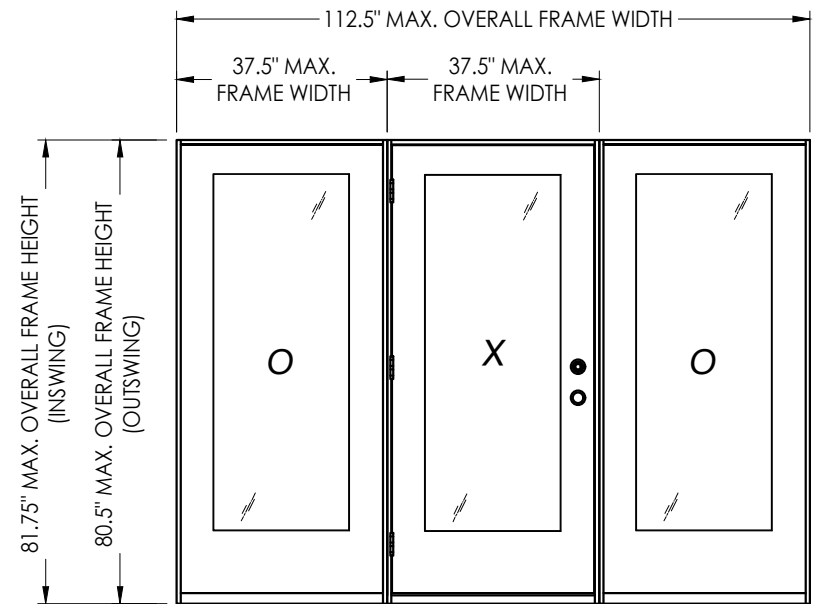


OXO



XO, OX

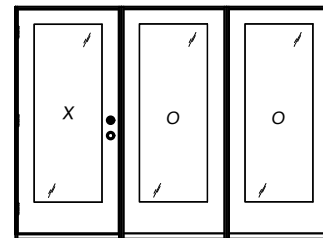OX, XO

XOO, OOX

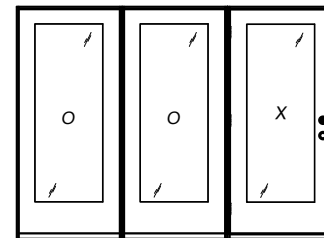

OOX, XOO

- ### GENERAL NOTES
1. This product has been evaluated and is in compliance with the 8th Edition (2023) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
 2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
 3. When used in areas requiring wind borne debris protection, this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and excludes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
 4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
 5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS			
SHEET #	DESCRIPTION	SHEET #	
1	Typical Elevations, Design Pressures & General Notes	7	Horizontal & Vertical Cross Sections (1X Buck)
2	Door Panel Details	8	Horizontal & Vertical Cross Sections (Direct to Masonry)
3	Sidelite Panel & Flush Glazing Details	9	Vertical Cross Sections (Thresholds)
4	Elevations	10	Buck Anchoring
5	Horizontal Cross Sections	11	Frame Anchoring & Hardware Details
6	Horizontal & Vertical Cross Sections (2X Buck)	12	Bill of Materials & Components

CONFIGURATION	MAX. FRAME DIMENSION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
OX, XO	75.0" x 81.75"	+50.0	-50.0	+50.0	-50.0
OXO	112.5" x 81.75"	+50.0	-50.0	+50.0	-50.0
XOO, OOX	112.5" x 81.75"	+50.0	-50.0	+50.0	-50.0

[illegible]

DATE: 7/25/24

SCALE: N.T.S.

DWG. BY: *LFS*

CHK. BY: *RW*

DRAWING NO.:

FL-46118.7

SHEET 1 OF 12

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33486
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2024 R.W. BUILDING CONSULTANTS INC.



9/16" GLASS BITE

DOUBLE SIDED TAPE

1" OVERALL GLASS THK.

1/8" TEMPERED GLASS

AIR SPACE

1/8" ANNEALED GLASS

SAFLEX PVB INTERLAYER

1/8" ANNEALED GLASS

DOW 995 STRUCTURAL SILICONE

STAINLESS STEEL SPACER

G1 GLAZING DETAIL
CLEAR GLASS

TOP RAIL (COMP)

FIBERGLASS SKIN

INTERIOR

EXTERIOR




G1 G2 G3

FOAM CORE



BOTTOM RAIL (COMP)

2 VERTICAL CROSS SECTION


© 2024 R.W. BUILDING CONSULTANTS INC.

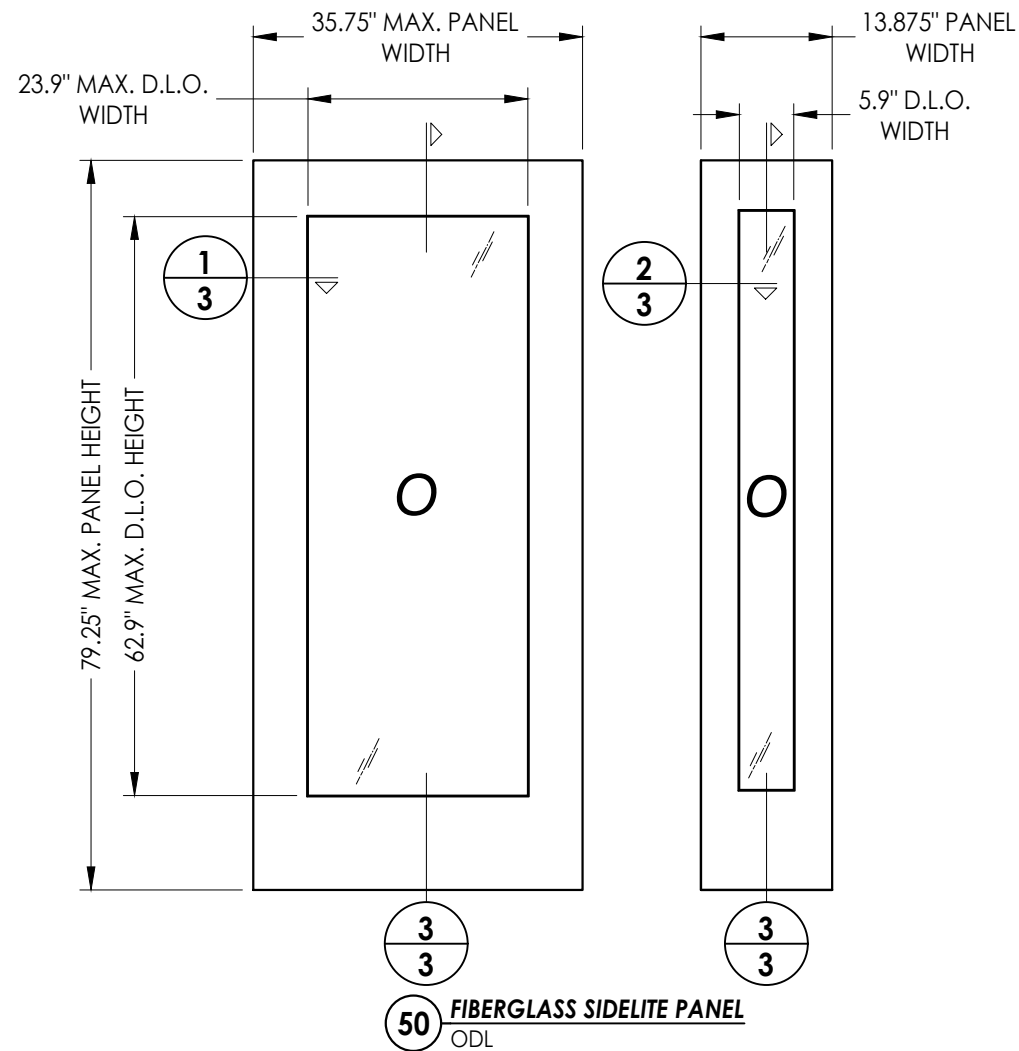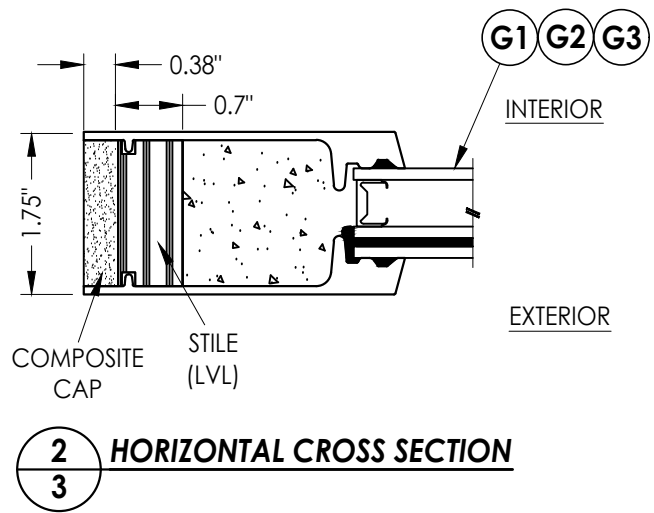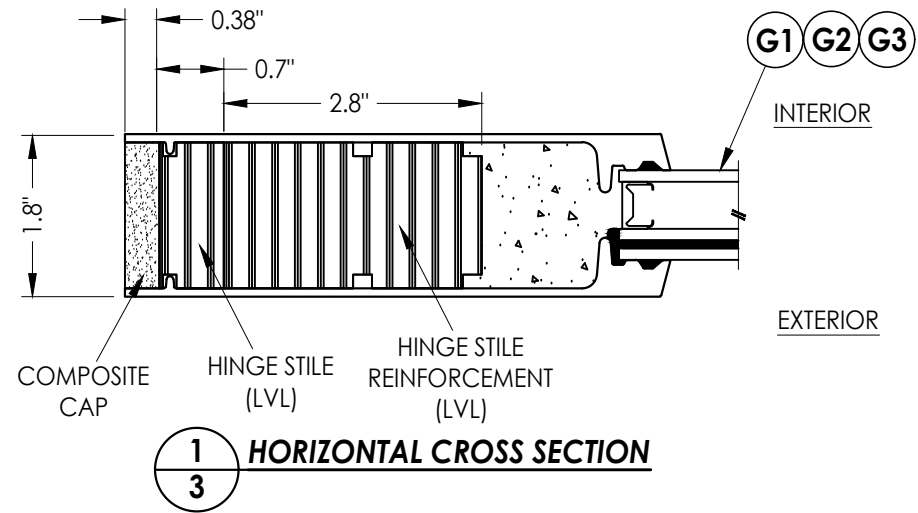

FIBERGLASS SKIN: 0.070" MIN. THK.
FOAM CORE: POLYSTYRENE

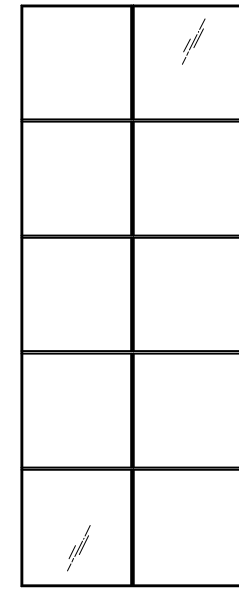
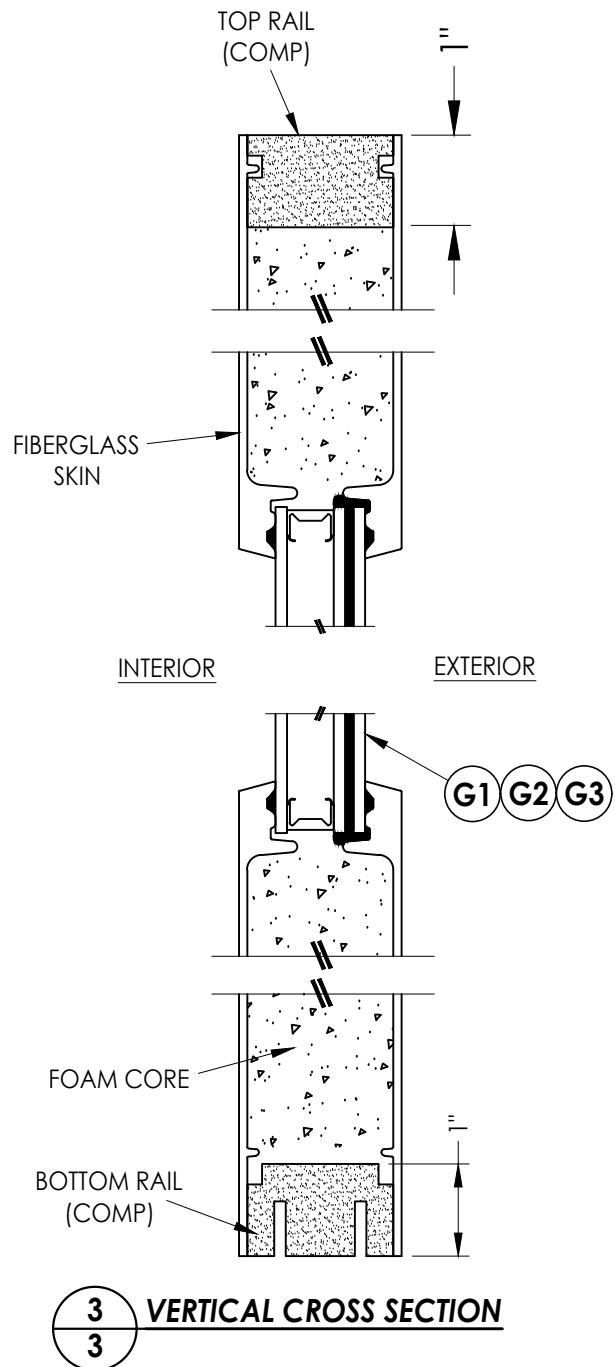


GRIDS BETWEEN GLASS



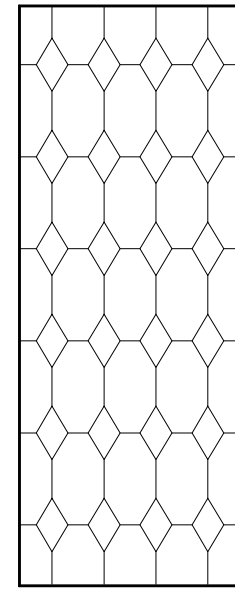


DECORATIVE

ALTERNATE GLAZING DETAILS

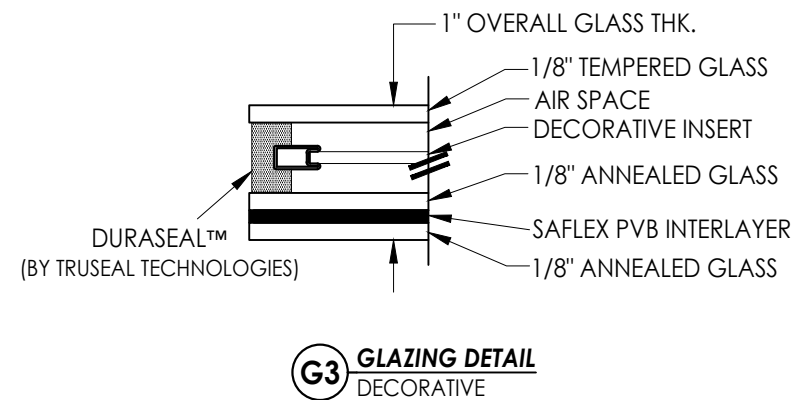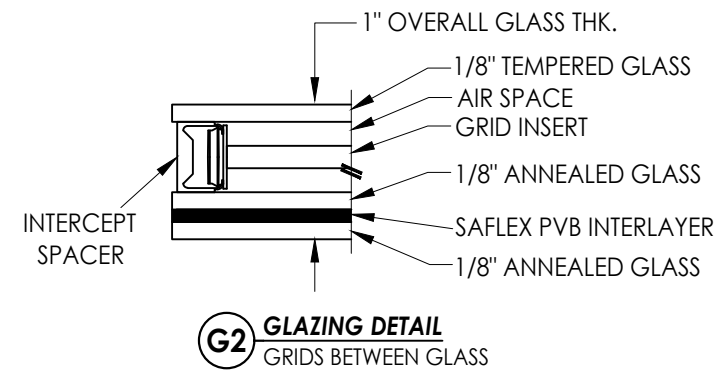[illegible]


Z:\2023 FBC Drawings\ODL, Inc\FL-46118\FL-46118.7.dwg

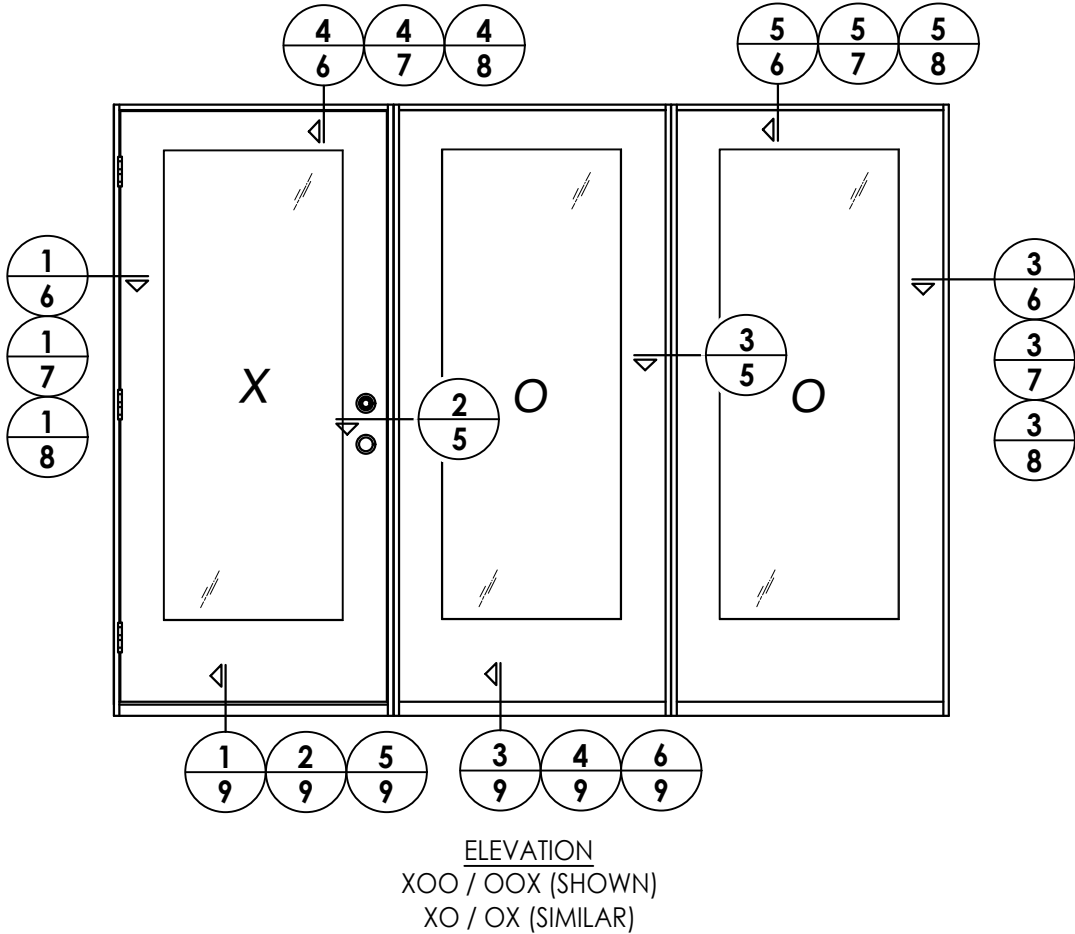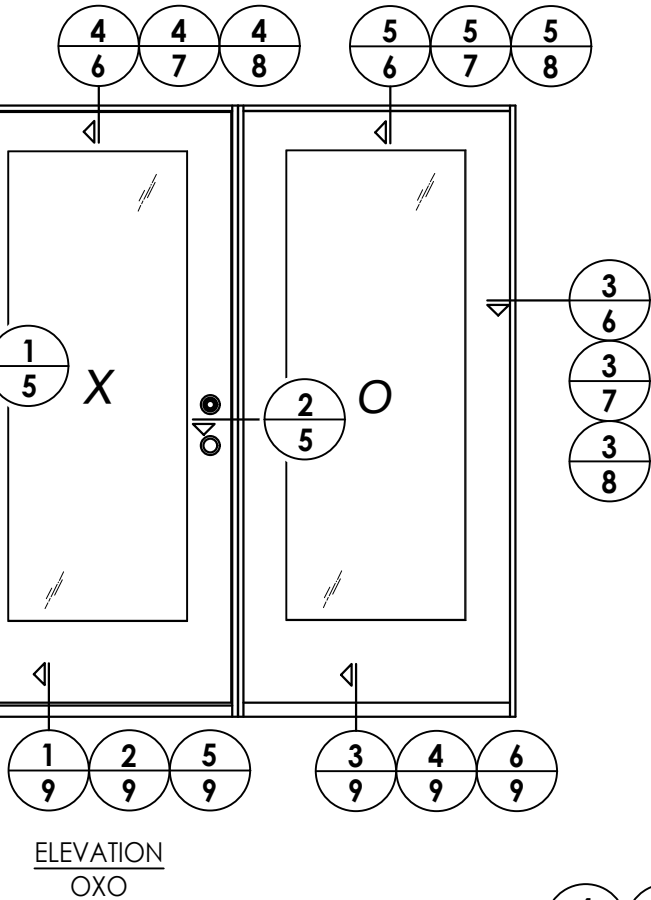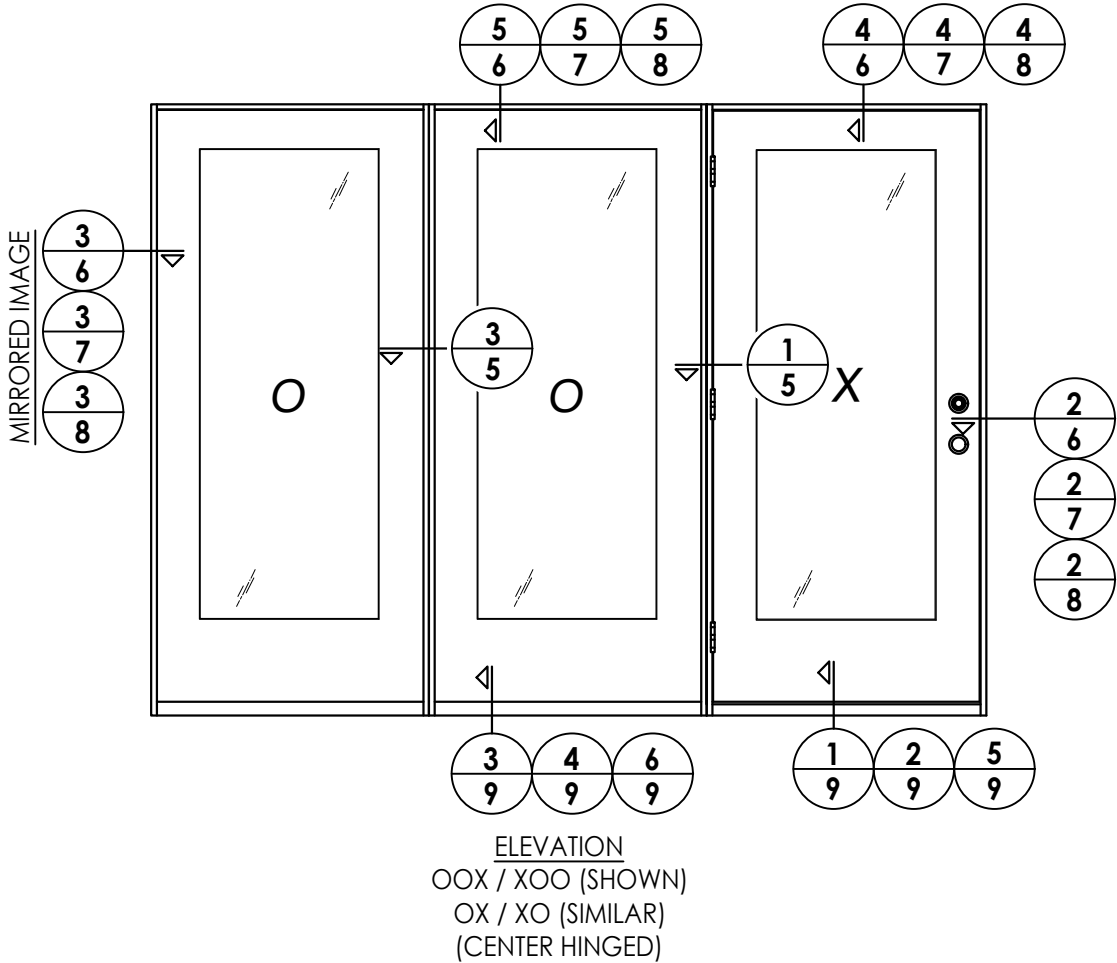


DATE: 7/25/24
SCALE: N.T.S.
DWG. BY: LFS
CHK. BY: RW
DRAWING NO.: FL-46118.7
SHEET 4 OF 12

PRODUCT:		PART OR ASSEMBLY:	
ODL FIBERGLASS DOOR		ELEVATIONS	
		NO.	DATE
		BY	
		REVISIONS	


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409
RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

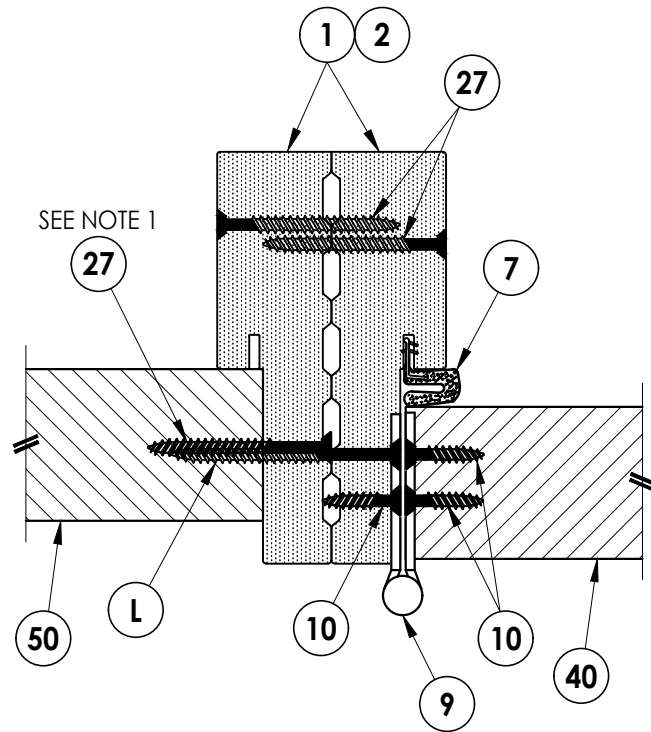

1 **HORIZONTAL CROSS SECTION**
5 Outswing Shown (Inswing Similar)

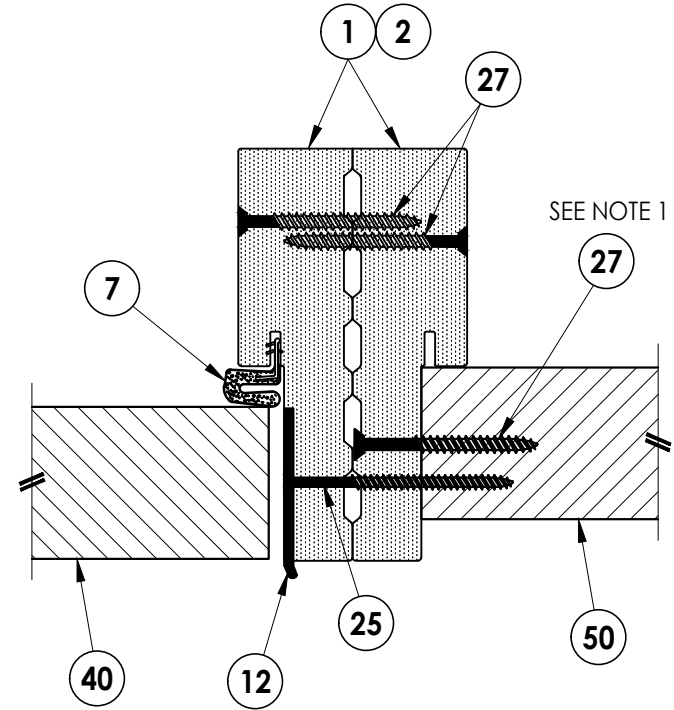

2 **HORIZONTAL CROSS SECTION**
5 Outswing Shown (Inswing Similar)

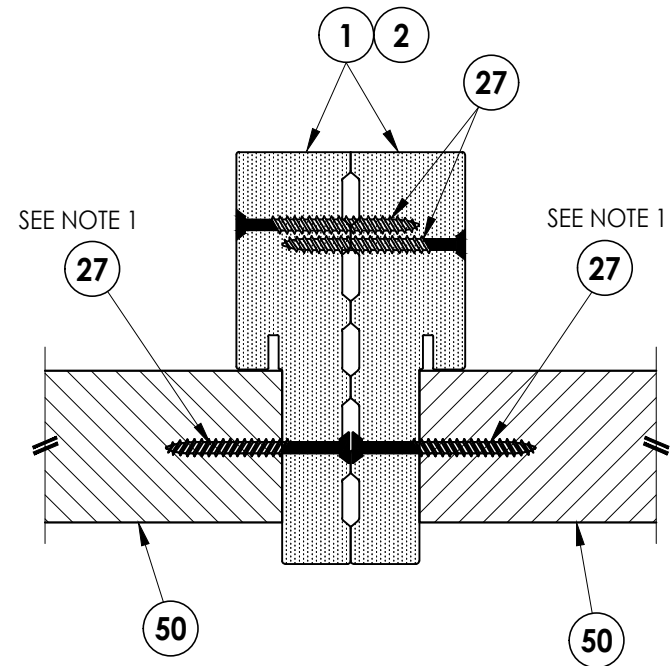


3 HORIZONTAL CROSS SECTION

5 Outswing Shown (Inswing Similar)

Notes:


1. Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).

[illegible]

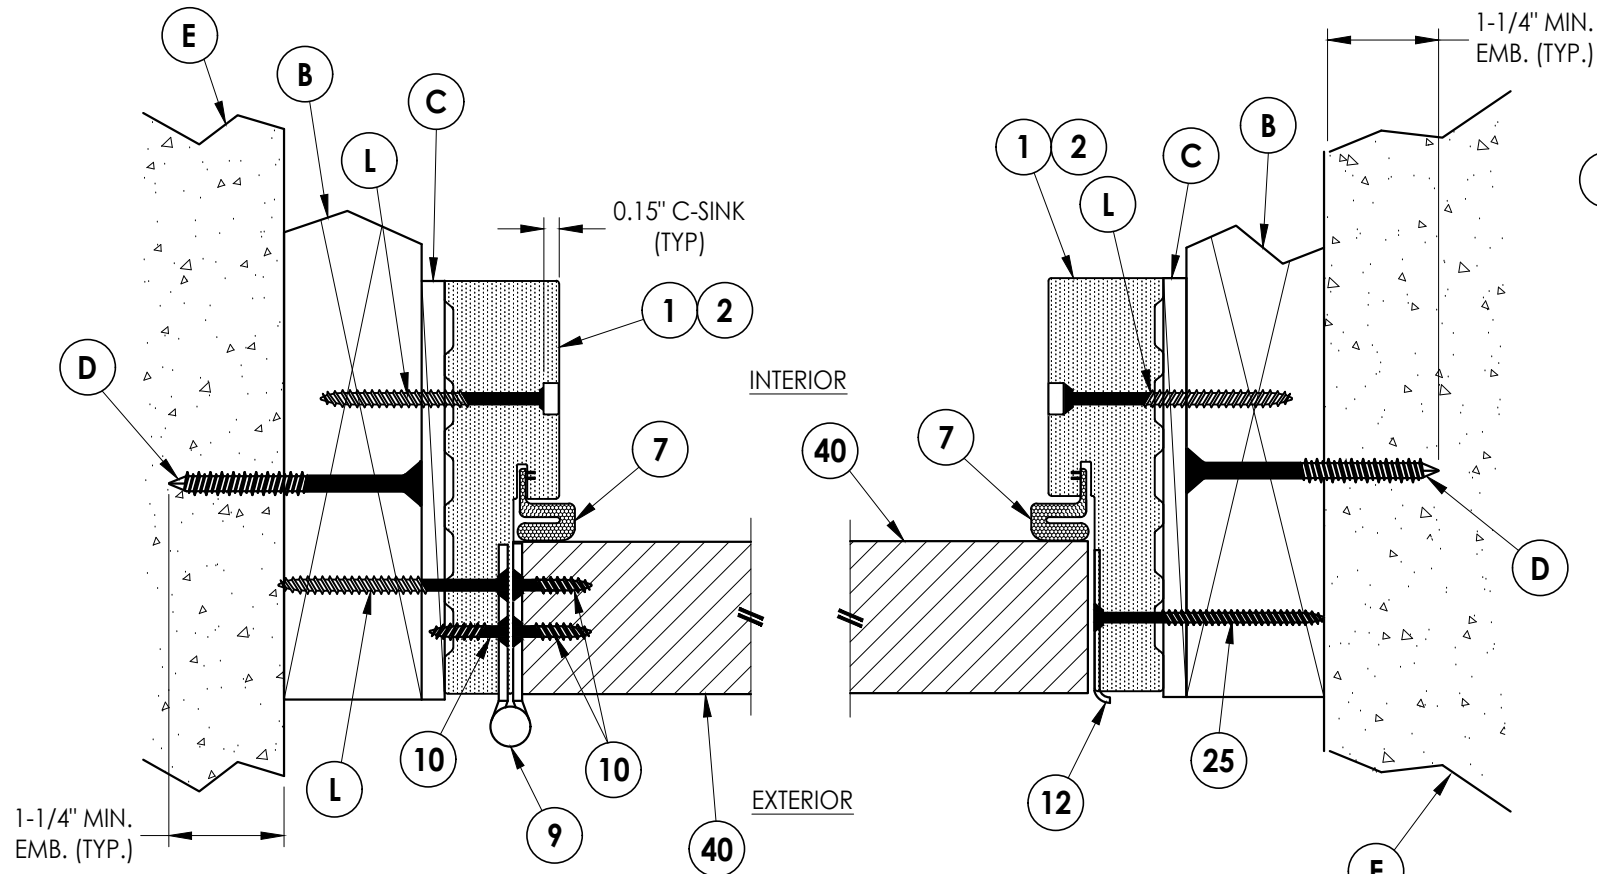


1
6 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ 2X Buck


2
6 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ 2X Buck

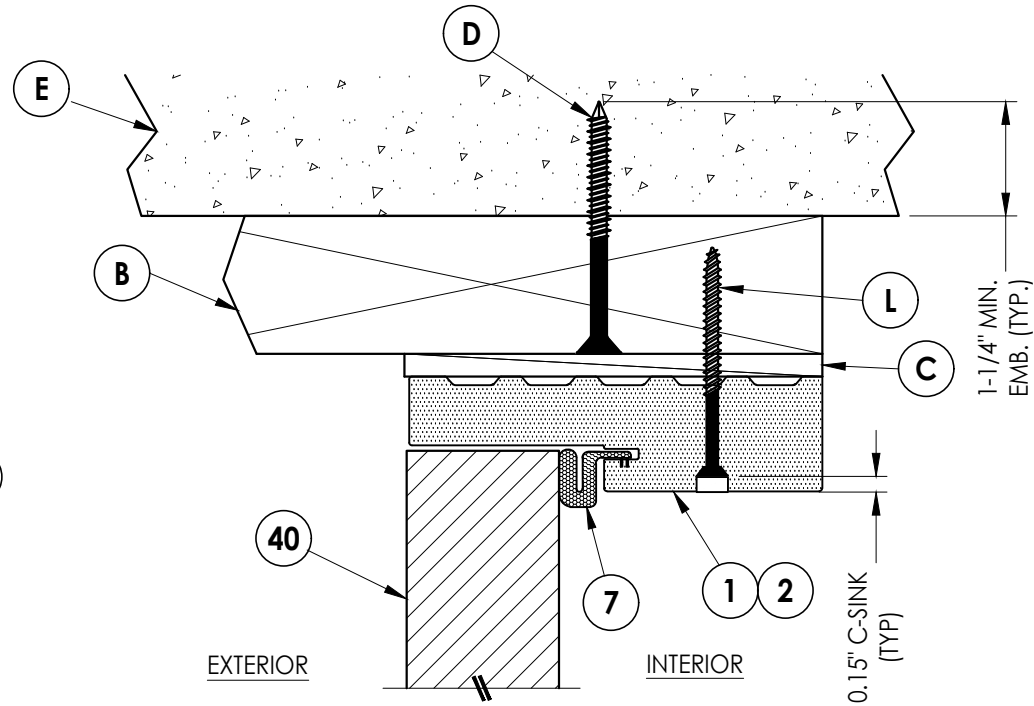

4
6 **VERTICAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ 2X Buck

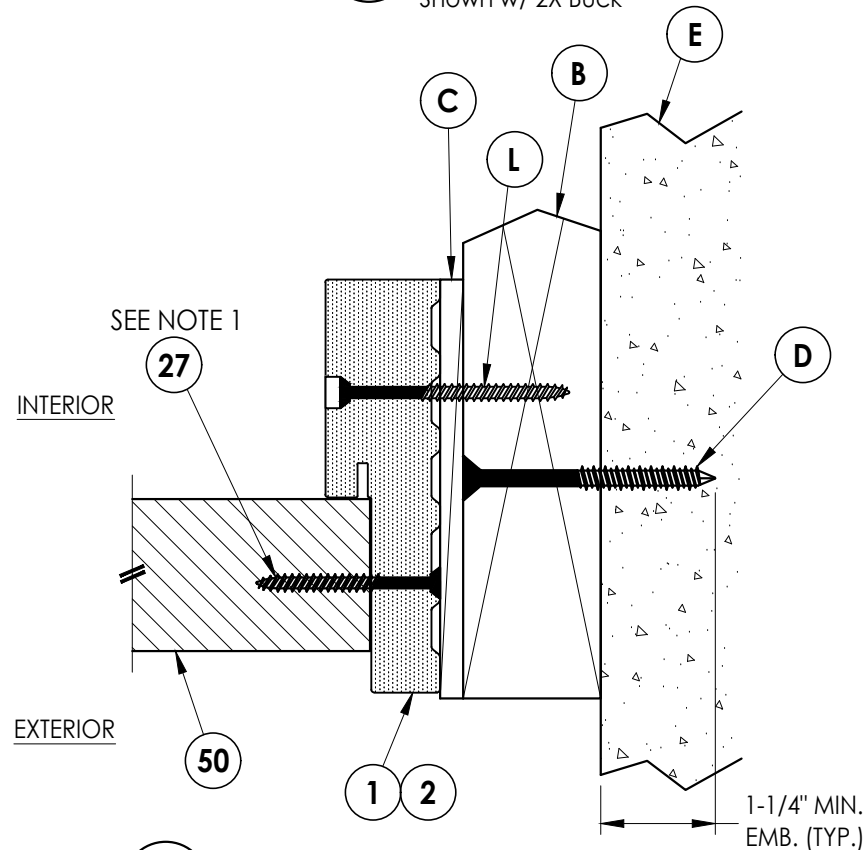

3
6 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ 2X Buck

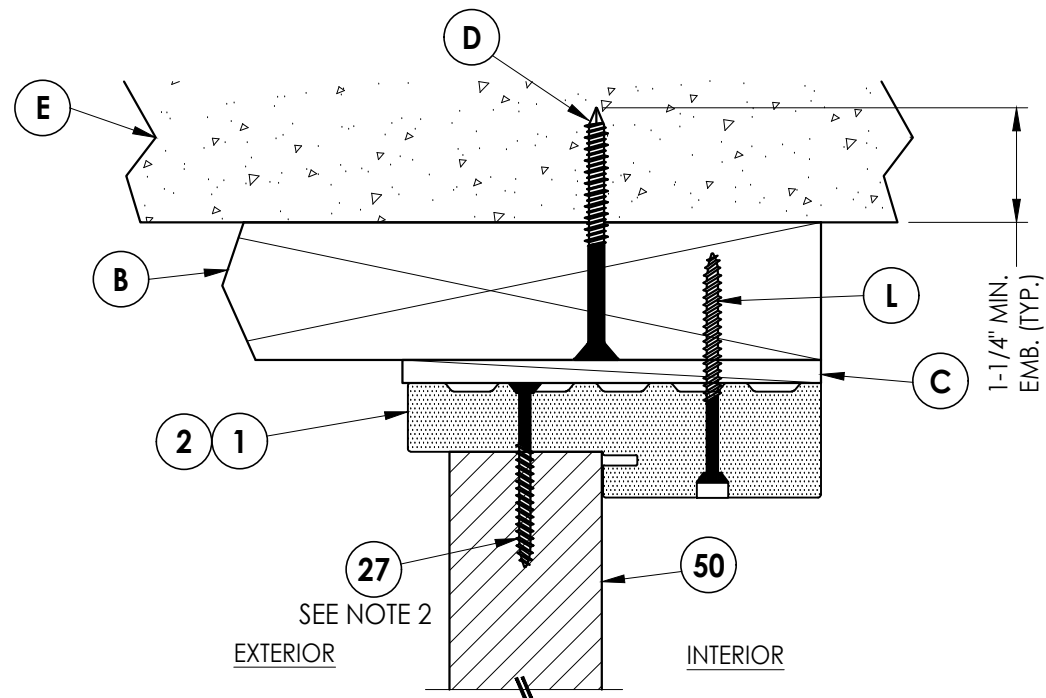

5
6 **VERTICAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ 2X Buck

Notes:

- Sidelite assembly screws located 6" from each end and 4 more screws equally spaced between (6 screws total per side jamb).
- Sidelite assembly screws located 10" from each end (2 screws total along head & sill). Note: Screws not required on 14" Sidelites.

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: ODL
FIBERGLASS DOOR

PART OR ASSEMBLY:
HORIZONTAL & VERTICAL
CROSS SECTIONS (2X BUCK)

NO.	DATE	BY	REVISIONS

DATE: 7/25/24

SCALE: N.T.S.

DWG. BY: LFS

CHK. BY: RW

DRAWING NO.:


FL-46118.7

SHEET 6 OF 12


1. Sidelite assembly screws located 10" from each end (2 screws total along head & sill). Note: Screws not required on 14" Sidelites.

[illegible]

Z:\2023 FBC Drawings\ODL, Inc\FL-46118\FL-46118.7.dwg

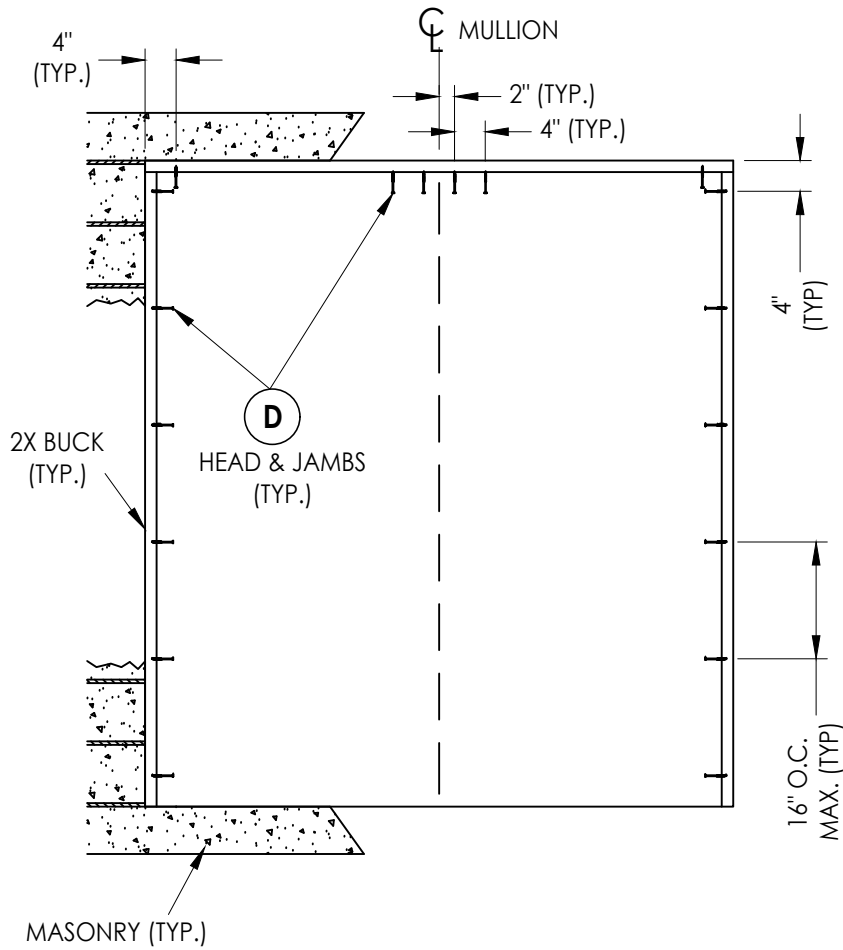

XO, OX

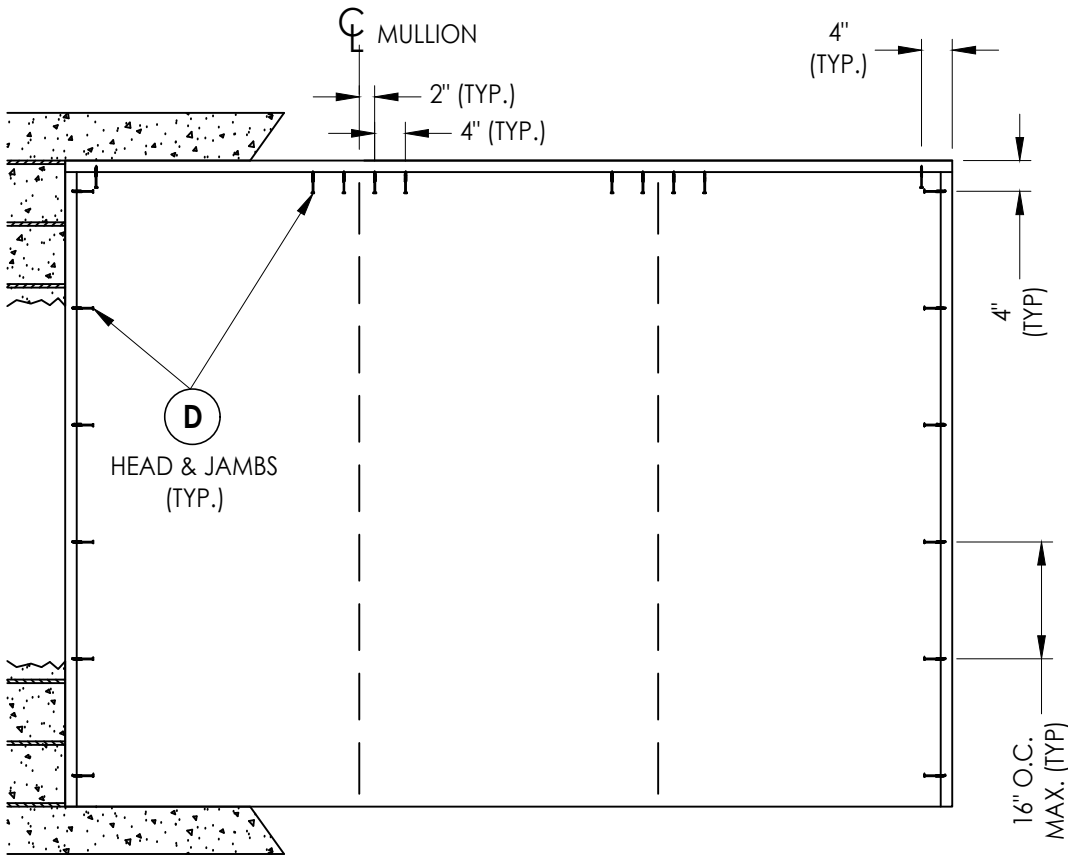

OXO, OOX, XOO

2X BUCK ANCHORING

DATE:	7/25/24
SCALE:	N.T.S.
DWG. BY:	LFS
CHK. BY:	RW
DRAWING NO.:	FL-46118.7
SHEET	10 OF 12

NO.	DATE	BY	REVISIONS


PRODUCT:	ODL FIBERGLASS DOOR
PART OR ASSEMBLY:	BUCK ANCHORING

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409




BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\ODL, Inc\FL-46118\FL-46118.7.dwg

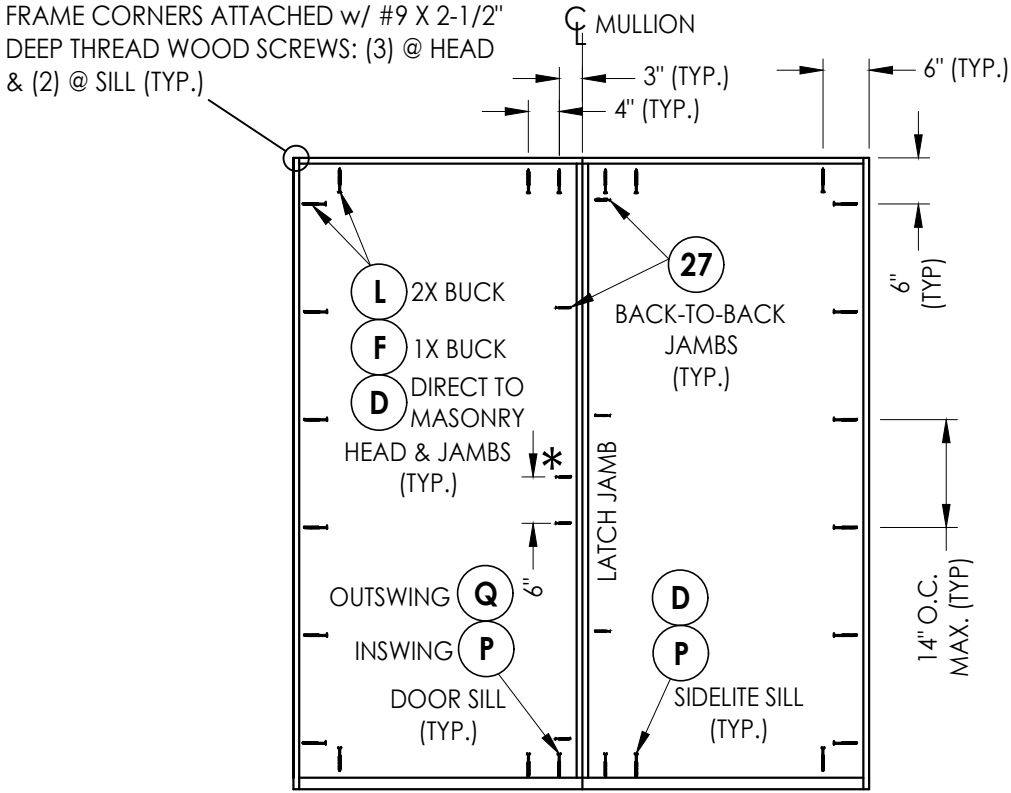


XO, OX

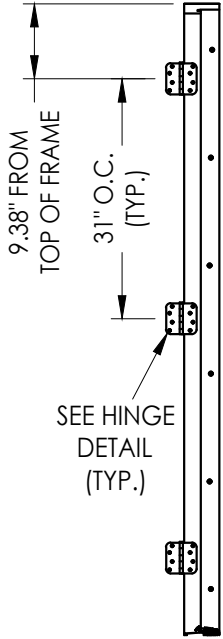


HINGE JAMB

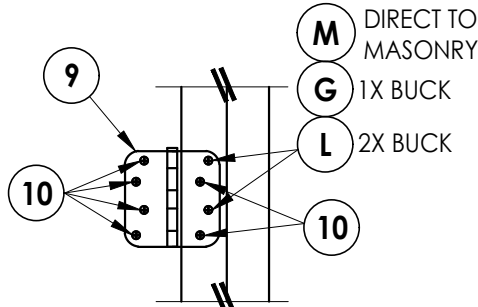

HINGE DETAIL
INSWING

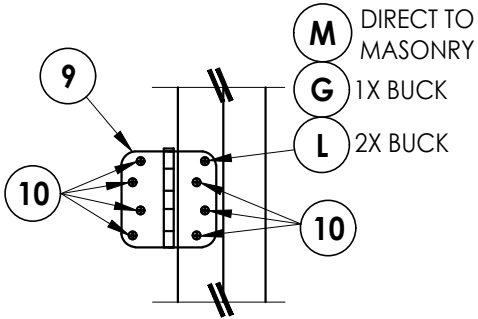


HINGE DETAIL
OUTSWING

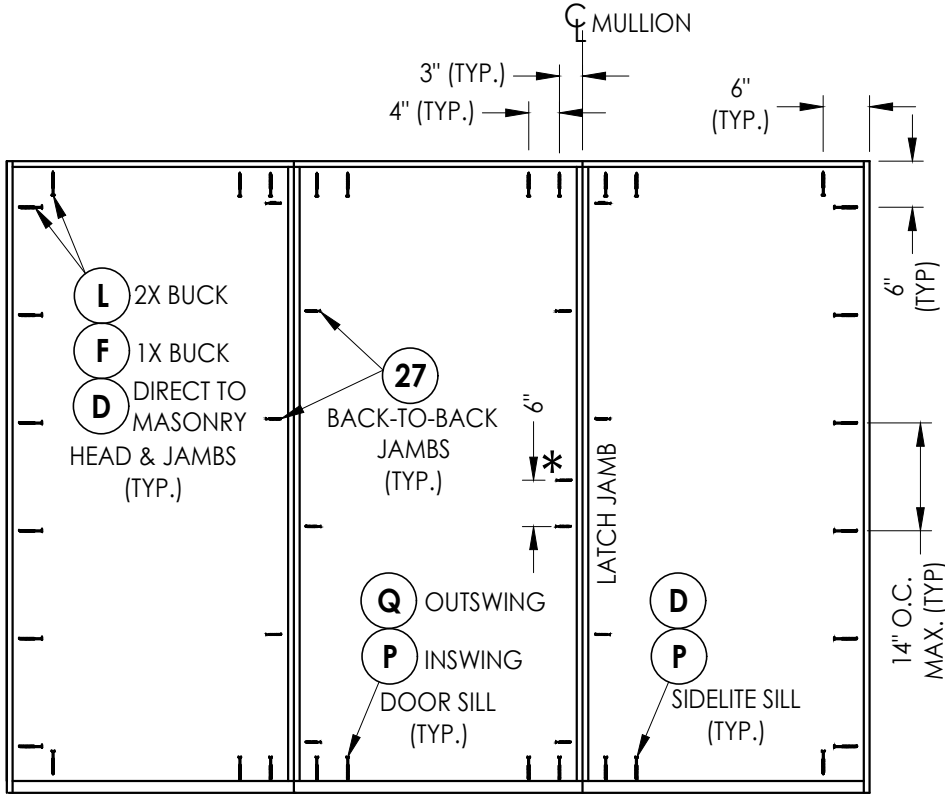


OXO, OOX, XOO

FRAME ANCHORING

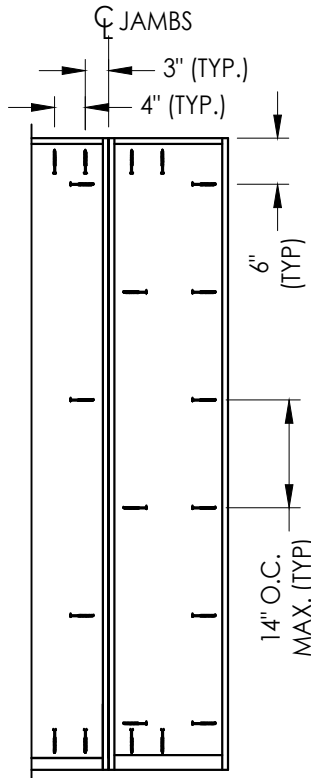


ALL ANCHORS SAME AS OXO

Shown w/ 14" Sidelite

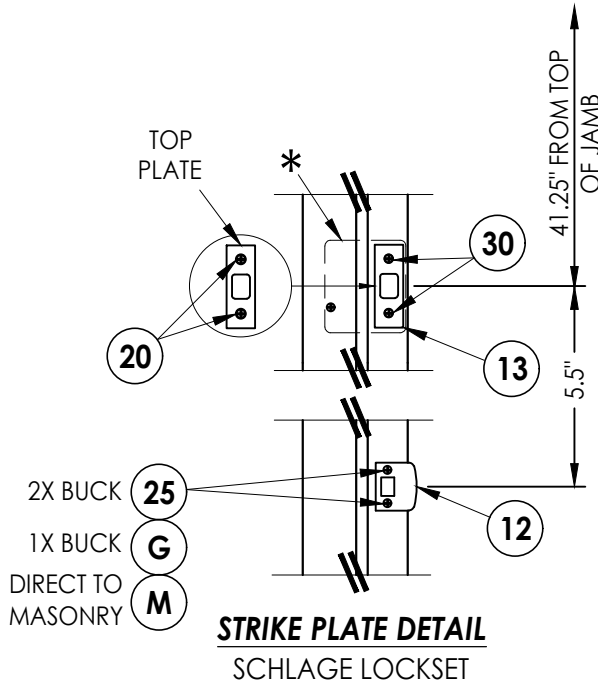

STRIKE PLATE DETAIL
SCHLAGE LOCKSET

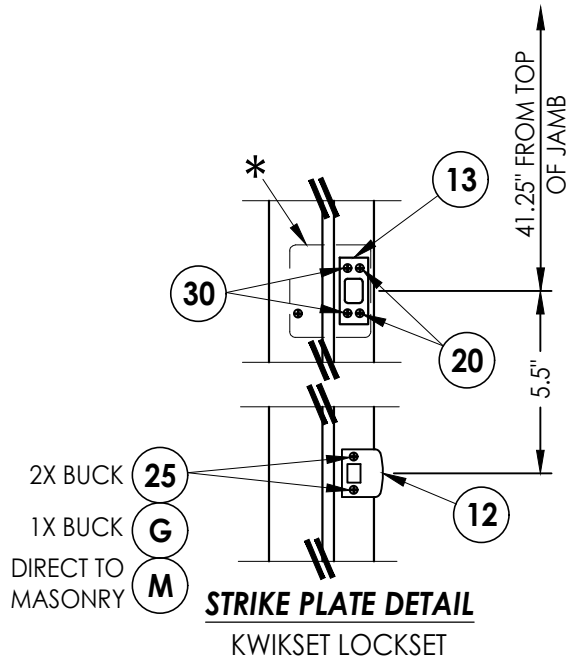

STRIKE PLATE DETAIL
KWIKSET LOCKSET

*4" X 4" 20 GA. STEEL PLATE ATTACHED TO BACK OF JAMB w/ (2) 3/8" T50 STAPLES PLUS ADDITIONAL ANCHOR THRU LATCH JAMB

HARDWARE DETAILS

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: ODL
FIBERGLASS DOOR

PART OR ASSEMBLY:
FRAME ANCHORING
& HARDWARE DETAILS

REVISIONS		NO.	DATE	BY

DATE: 7/25/24

SCALE: N.T.S.

DWG. BY: LFS

CHK. BY: RW

DRAWING NO.:

FL-46118.7

SHEET 11 OF 12

Z:\2023 FBC Drawings\ODL, Inc\FL-46118\FL-46118.7.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.42)	WOOD
B	2X BUCK (G >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMB.)	STEEL
M	3/16" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
P	1/4" X 2-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
Q	1/4" X 1-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
1	COMPOSITE JAMB	COMP
2	WOOD JAMB	WOOD
7	WEATHERSTRIP	FOAM
8	DOOR SWEEP	VINYL
9	4" X 4" HINGE	STEEL
10	#9 X 3/4" PFH WOOD SCREW	STEEL
12	LATCH STRIKE PLATE	STEEL
13	DEADBOLT STRIKE PLATE	STEEL
14	INSWING THRESHOLD	ALUM/COMP
15	OUTSWING THRESHOLD	ALUM/COMP
16	INSWING SIDELITE ADAPTER	PVC
18	ADA THRESHOLD	ALUM
19	ADA OUTSWING THRESHOLD	ALUM
20	#8 X 1/2" PFH WOOD SCREW	STEEL
25	#8 X 2-1/2" PFH WOOD SCREW	STEEL
27	#10 X 2" PFH SMS	STEEL
29	#10 X 3" PFH WOOD SCREW	STEEL
30	#12 X 2-1/2" PFH WOOD SCREW	STEEL
40	DOOR PANEL	-
50	SIDELITE PANEL	-


CONCRETE ANCHOR NOTES:

- Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
- Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
- Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:


- Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

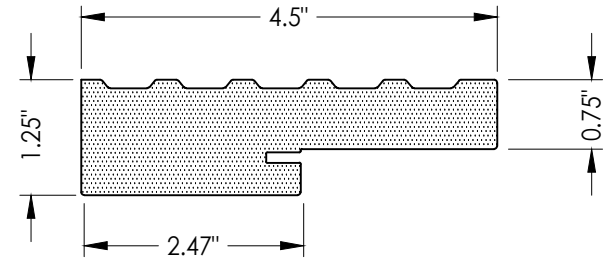


1 COMPOSITE JAMB
STARLINK SURE JAMB

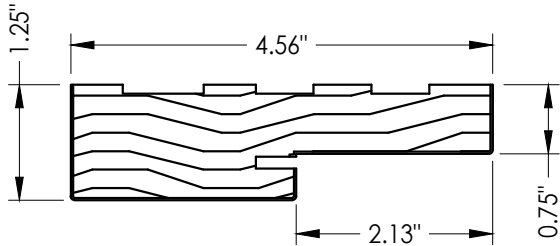


2 WOOD JAMB
FINGER JOINTED PINE

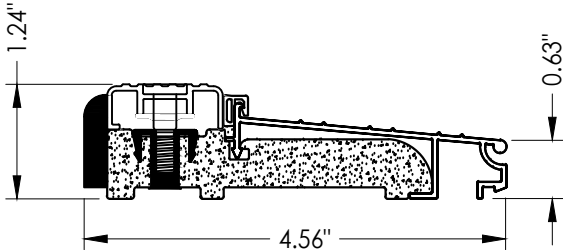


14 INSWING THRESHOLD
AFCO A-276

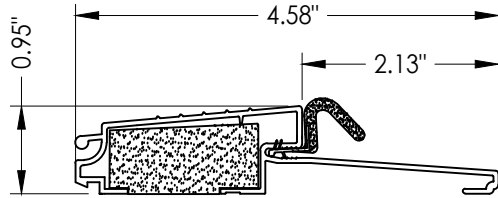


15 OUTSWING THRESHOLD
AFCO A-117



16 INSWING SIDELITE BASE
AFCO

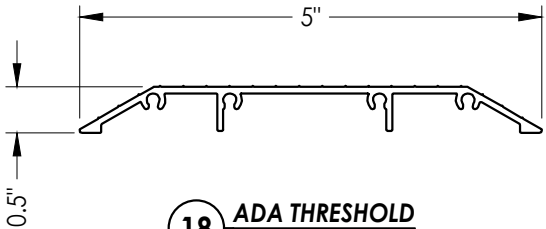

18 ADA THRESHOLD
AFCO A-204

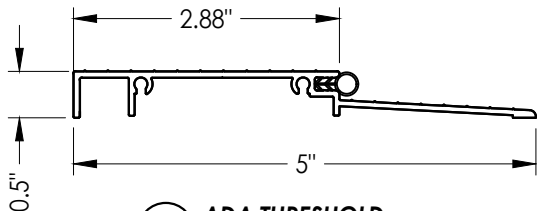

19 ADA THRESHOLD
AFCO A-204T

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: ODL
FIBERGLASS DOOR

PART OR ASSEMBLY:
BILL OF MATERIALS
& COMPONENTS

NO.	DATE	BY	REVISIONS

DATE: 7/25/24

SCALE: N.T.S.

DWG. BY: LFS

CHK. BY: RW

DRAWING NO.:

FL-46118.7

SHEET 12 OF 12