


SERIES 3300
PVC HORIZONTAL SLIDING WINDOW
"NON-IMPACT"

GENERAL NOTES

1. This product anchoring drawing has been developed in compliance with the 8th Edition (2023) Florida Building Code (FBC) excluding the "High Velocity Hurricane Zone". See the Certification Agency Certificate for sizes, specifications and ratings.
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing, stucco, foam, brick and other wall coverings.
3. Fastener embedment depths, edge distances and center-center distances shall be as specified by the fastener manufacturer but in no instance shall they be less than shown in this drawing.
4. Where shims are used, they must be a "rigid / stiff" material that complies with the requirements of the FBC.
5. Positive and negative design pressure requirements for use with this drawing shall be determined by others for specific jobs in accordance with the governing code.
6. Site conditions not covered by this drawing are subject to further engineering analysis.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	Typical elevation, design pressures & general notes
2	Cross sections, glazing details & bill of materials
3	Buck & frame anchoring

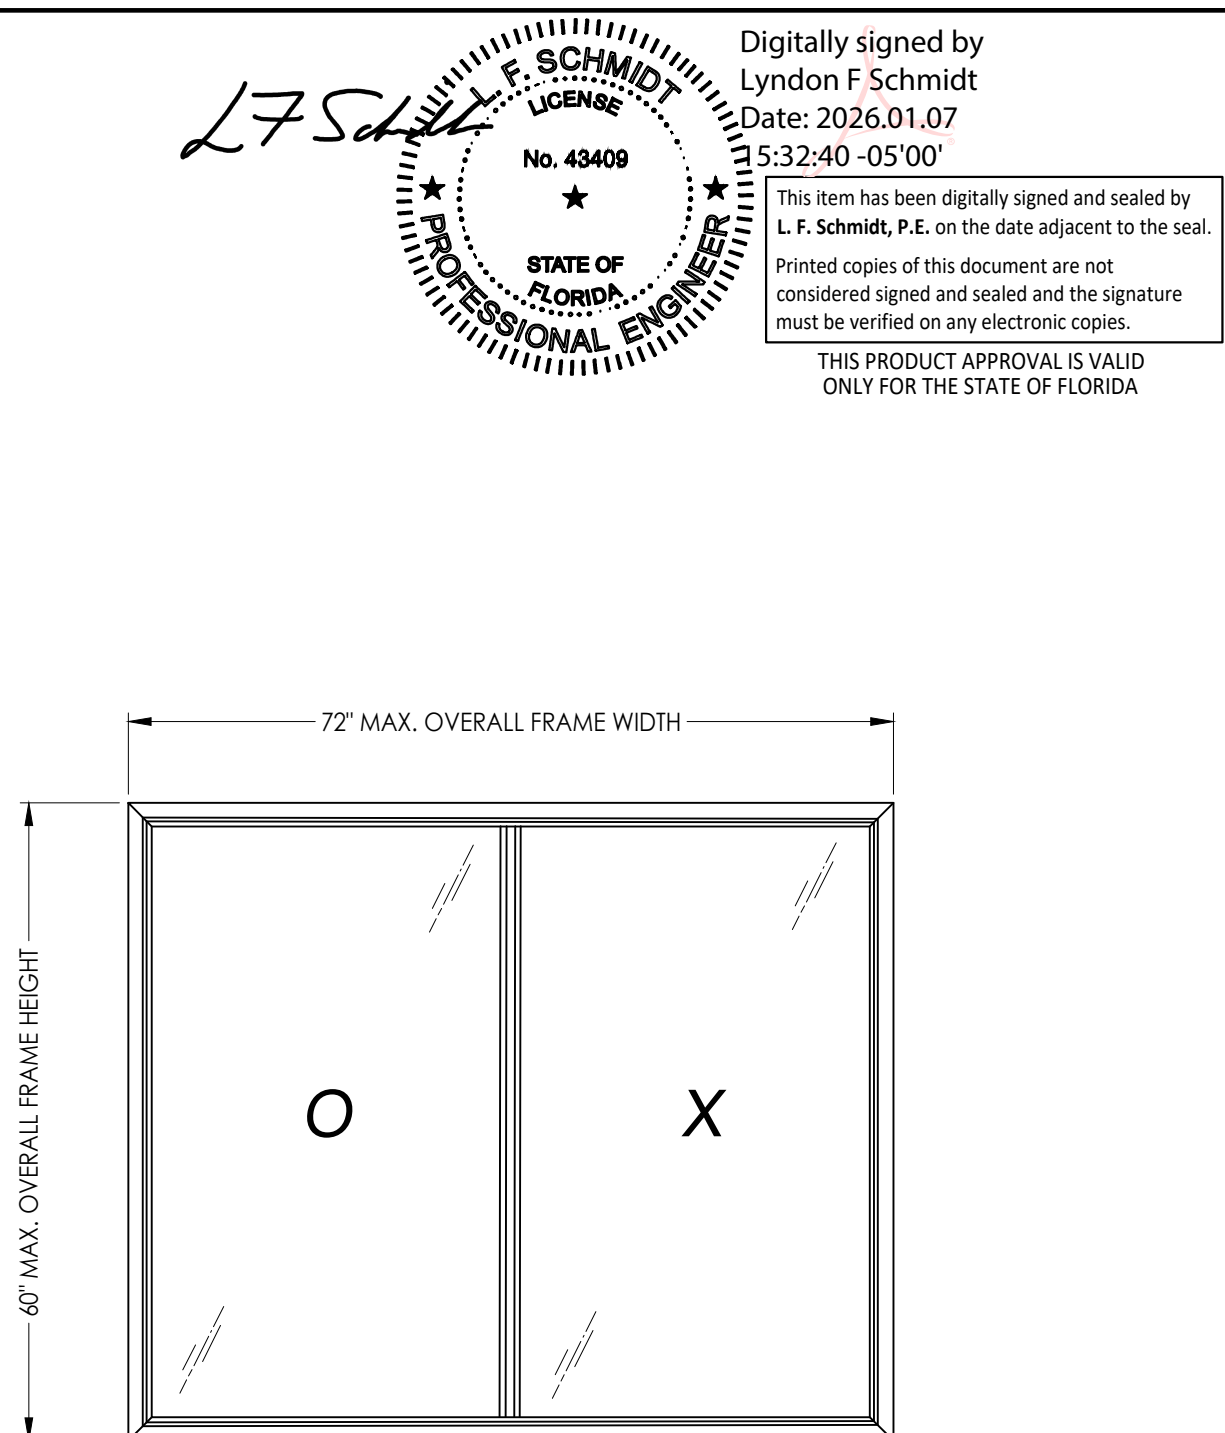

MAX. O.A. FRAME. DIMENSION	DESIGN PRESSURE (PSF)	
	POSITIVE	NEGATIVE
72.0" X 60.0"	+30.0	-30.0

PRODUCT:					
HORIZONTAL SLIDING WINDOW					
PART OR ASSEMBLY:					
TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES					
NO.	DATE	BY			
DATE: 11/03/25					
SCALE: N.T.S.					
DWG. BY: LFS					
CHK. BY: RW					
DRAWING NO.: FL-46123.2					
SHEET 1 OF 3					

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

INTERIOR

EXTERIOR

1-1/4" MIN.
EMB. TYP.

1-1/4" MIN.
EMB. TYP.

A

F

G1

E

B

C


1 HORIZONTAL CROSS SECTION
2 Shown w/ 2X Buck Core

INTERIOR

G1



EXTERIOR

1-1/4" MIN.
EMB. TYP.

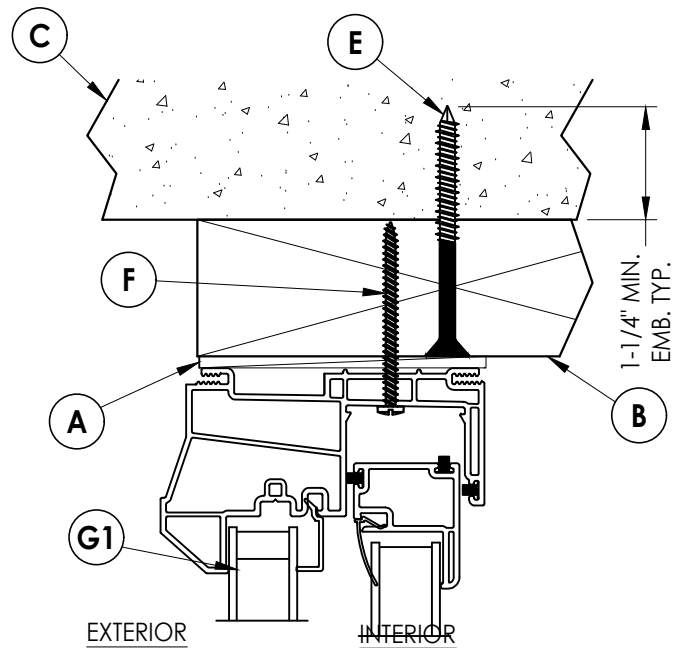

3 VERTICAL CROSS SECTION
2 Shown w/ 2X Buck Construction

© 2025 R.W. BUILDING CONSULTANTS INC.

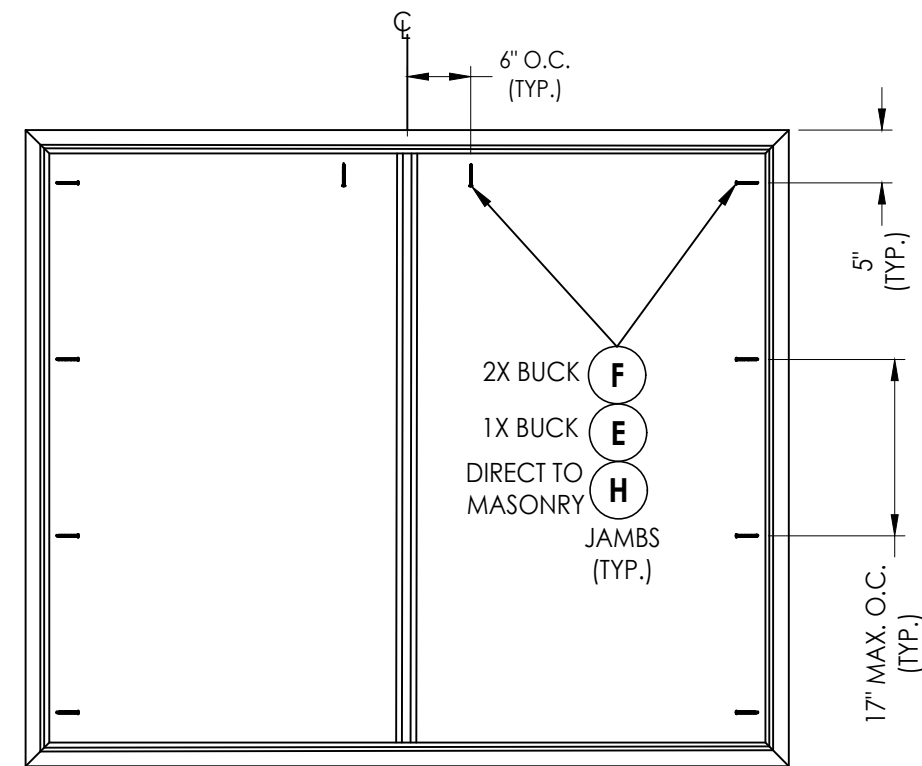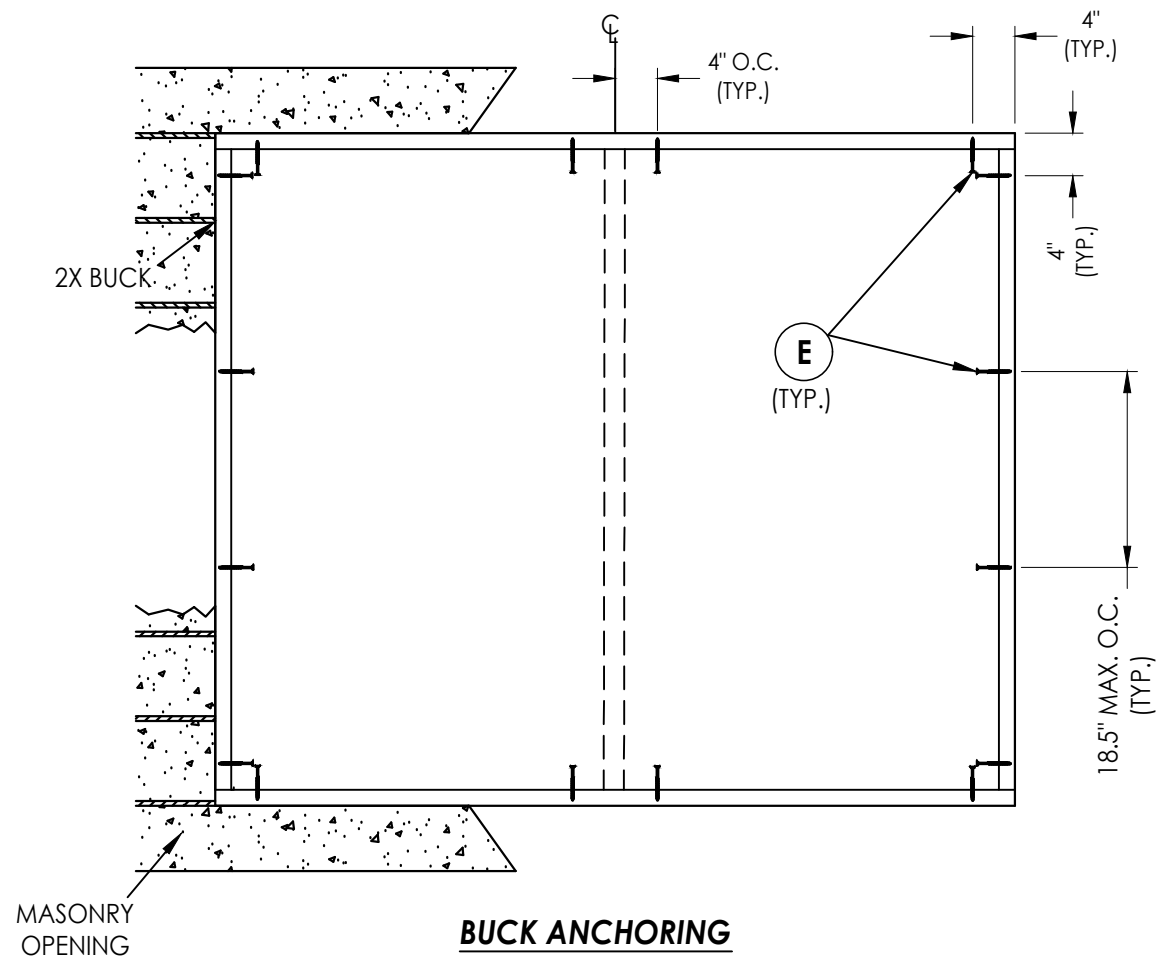

FRAME ANCHORING

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON+	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

[illegible]

DATE: 11/03/25
SCALE: N.T.S.
DWG. BY: LFS
CHK. BY: RW
DRAWING NO.: FL-46123.2
SHEET 3 OF 3

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

R^W
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813