

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	12/20/2023	R.L.

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING, METAL STRUCTURE AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" WINDOW UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. WINDOW UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND WINDOW INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. SHIM AS REQUIRED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: EXTRUDED RIGID PVC.
11. UNITS MUST BE GLAZED PER ASTM E1300.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
13. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #10 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 3/8" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
14. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING INTO METAL STRUCTURE USE #10 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. ALL FASTENERS TO BE CORROSION RESISTANT.
17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:

17.1. WOOD – MINIMUM SPECIFIC GRAVITY OF G=0.42

17.2. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.

17.3. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH f'm=2,000PSI MINIMUM.

17.4. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 1/8" THICK MINIMUM

SIGNED: 12/26/2023


TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATION
3 – 5	INSTALLATION DETAILS

VIWINCO INC. P.O. BOX 499 MORGANTOWN, PA 19543		
S-SERIES/CAMBRIDGE CXPX 45° BAY MULLED ASS'Y 144" X 80", NON-IMPACT NOTES		
DRAWN: N.G.	DWG NO. 08-02830	REV A
SCALE NTS	DATE 10/13/15	SHEET 1 OF 5
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		



Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	12/20/2023	R.L.

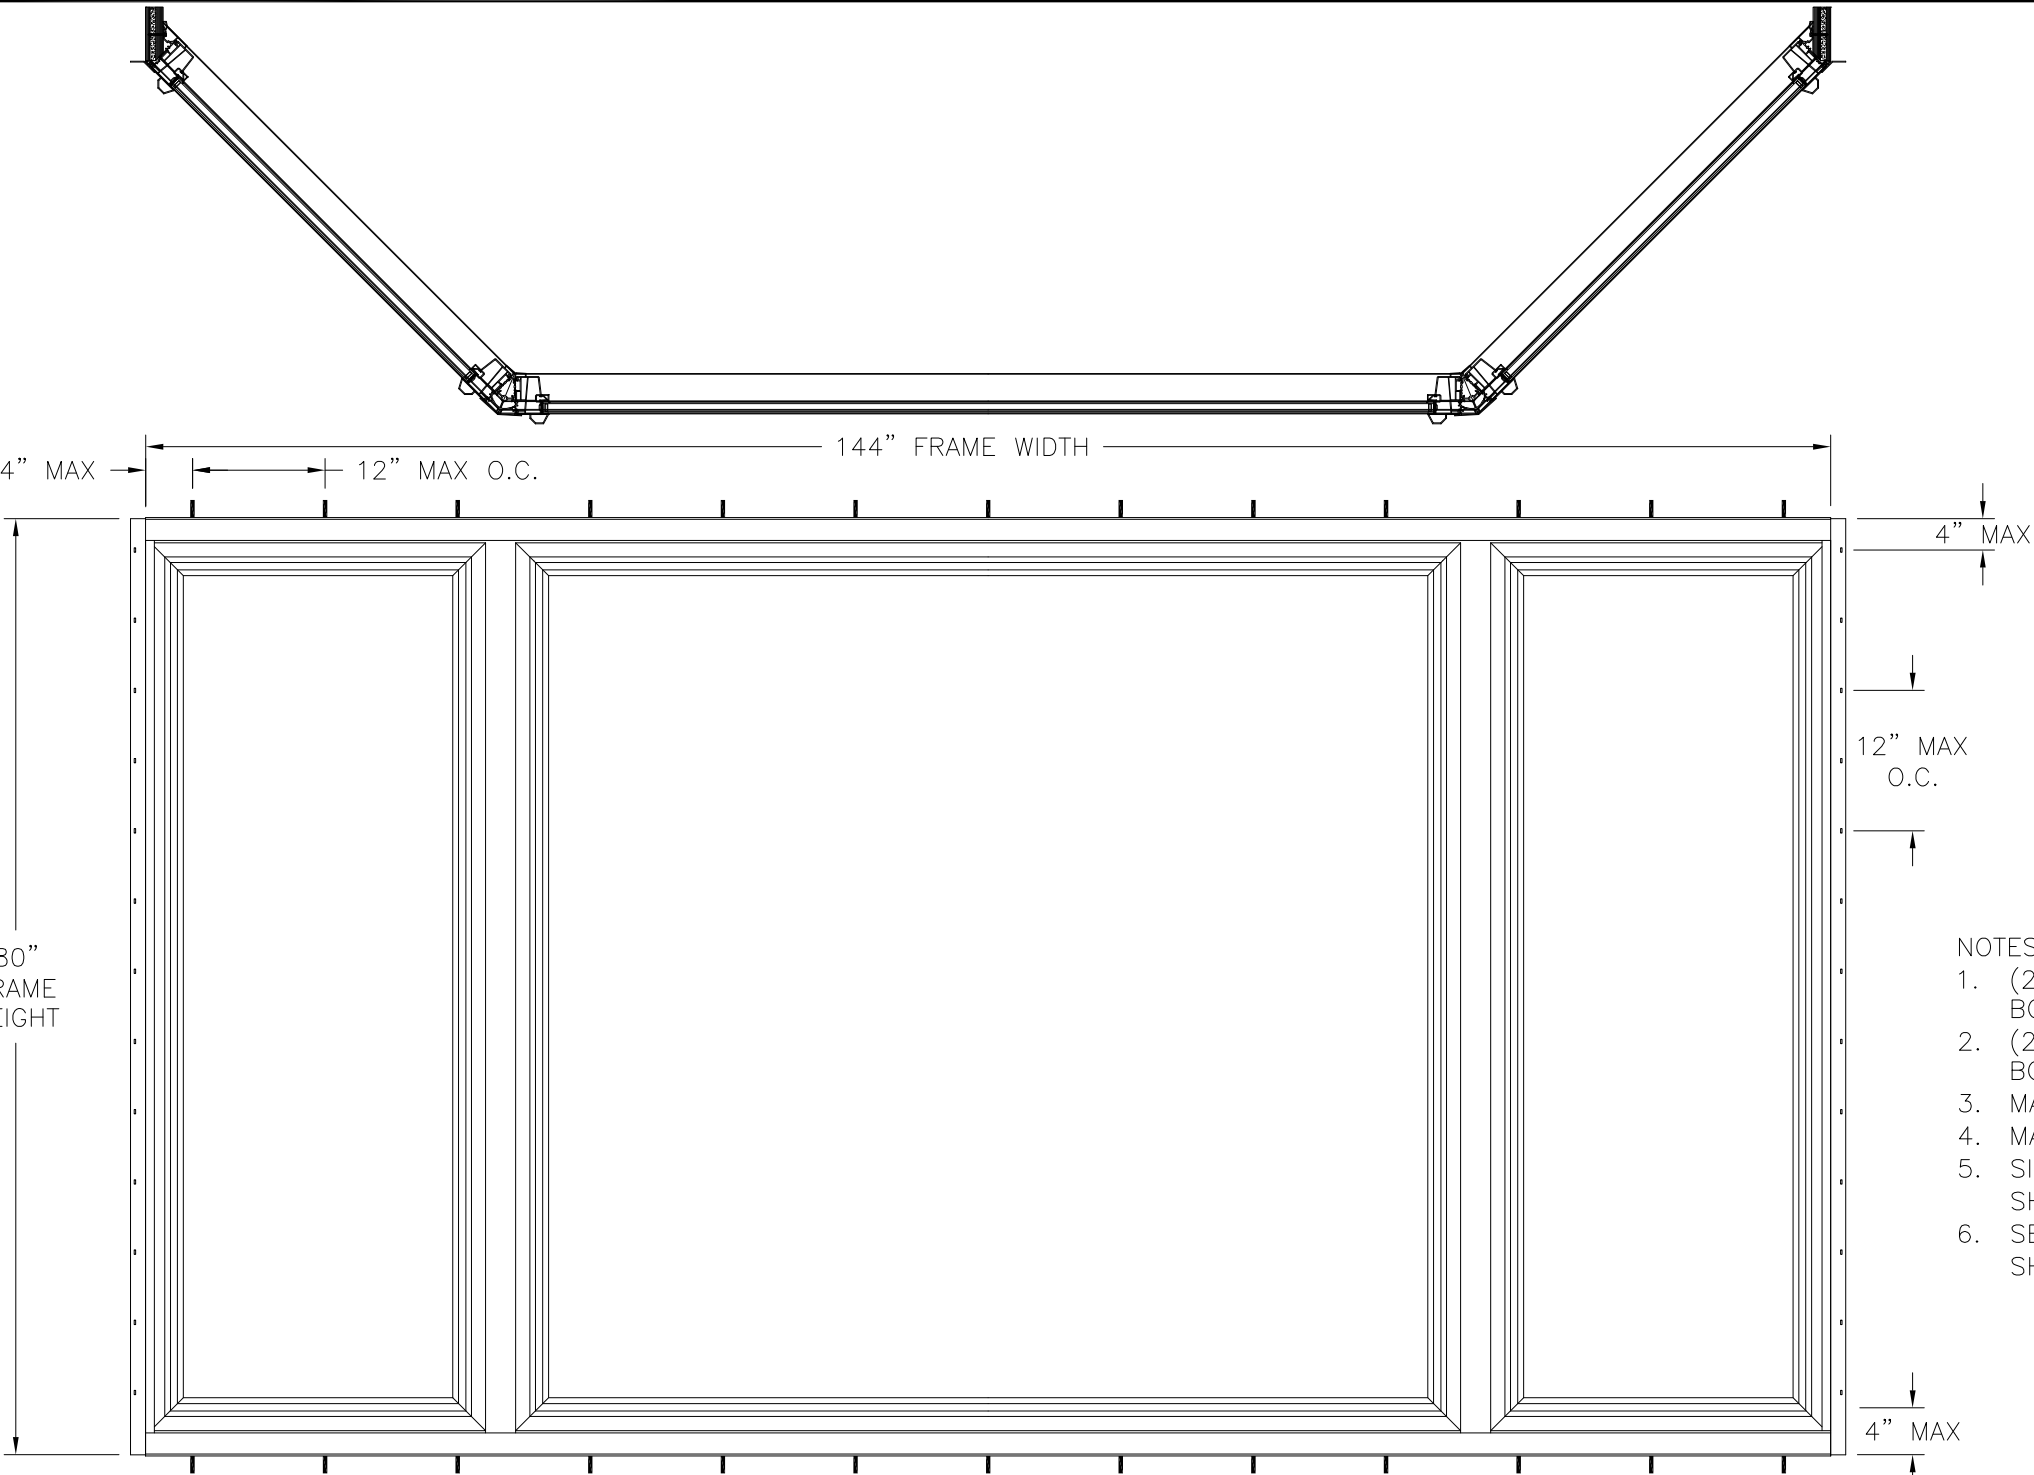


- NOTES:
1. (2) 3/8" X 3/16" WEEP SLOT LOCATED 3" FROM EACH END OF BOTTOM RAILS.
 2. (2) 3/8" DIAMETER WEEP HOLE LOCATED 3" FROM EACH END OF BOTTOM RAILS.
 3. MAXIMUM SASH SIZE: 78 1/4" X 73"
 4. MAXIMUM D.L.O.: 74 1/2" X 69 1/2"
 5. SIDE BOARD CONSISTS OF 1/2" THICK POLYSTYRENE BETWEEN (2) SHEETS OF 3/8" THICK PLYWOOD.
 6. SEAT BOARD CONSISTS OF 1/2" THICK POLYSTYRENE BETWEEN (2) SHEETS OF 3/4" THICK PLYWOOD.

S-SERIES/CAMBRIDGE CXPX 45°
EXTERIOR VIEW


DESIGN PRESSURE RATING	IMPACT RATING
±55.0PSF	NONE

SIGNED: 12/26/2023


VIWINCO INC. P.O. BOX 499 MORGANTOWN, PA 19543		
S-SERIES/CAMBRIDGE CXPX 45° BAY MULLED ASS'Y 144" X 80", NON-IMPACT ELEVATION		
DRAWN: N.G.	DWG NO. 08-02830	REV A
SCALE NTS	DATE 10/13/15	SHEET 2 OF 5
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

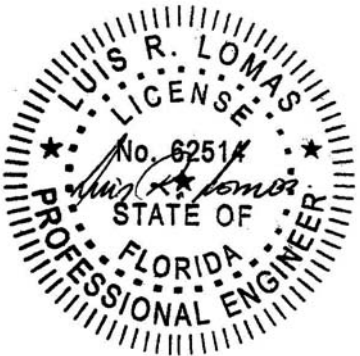

Luis R. Lomas P.E.
FL No.: 62514

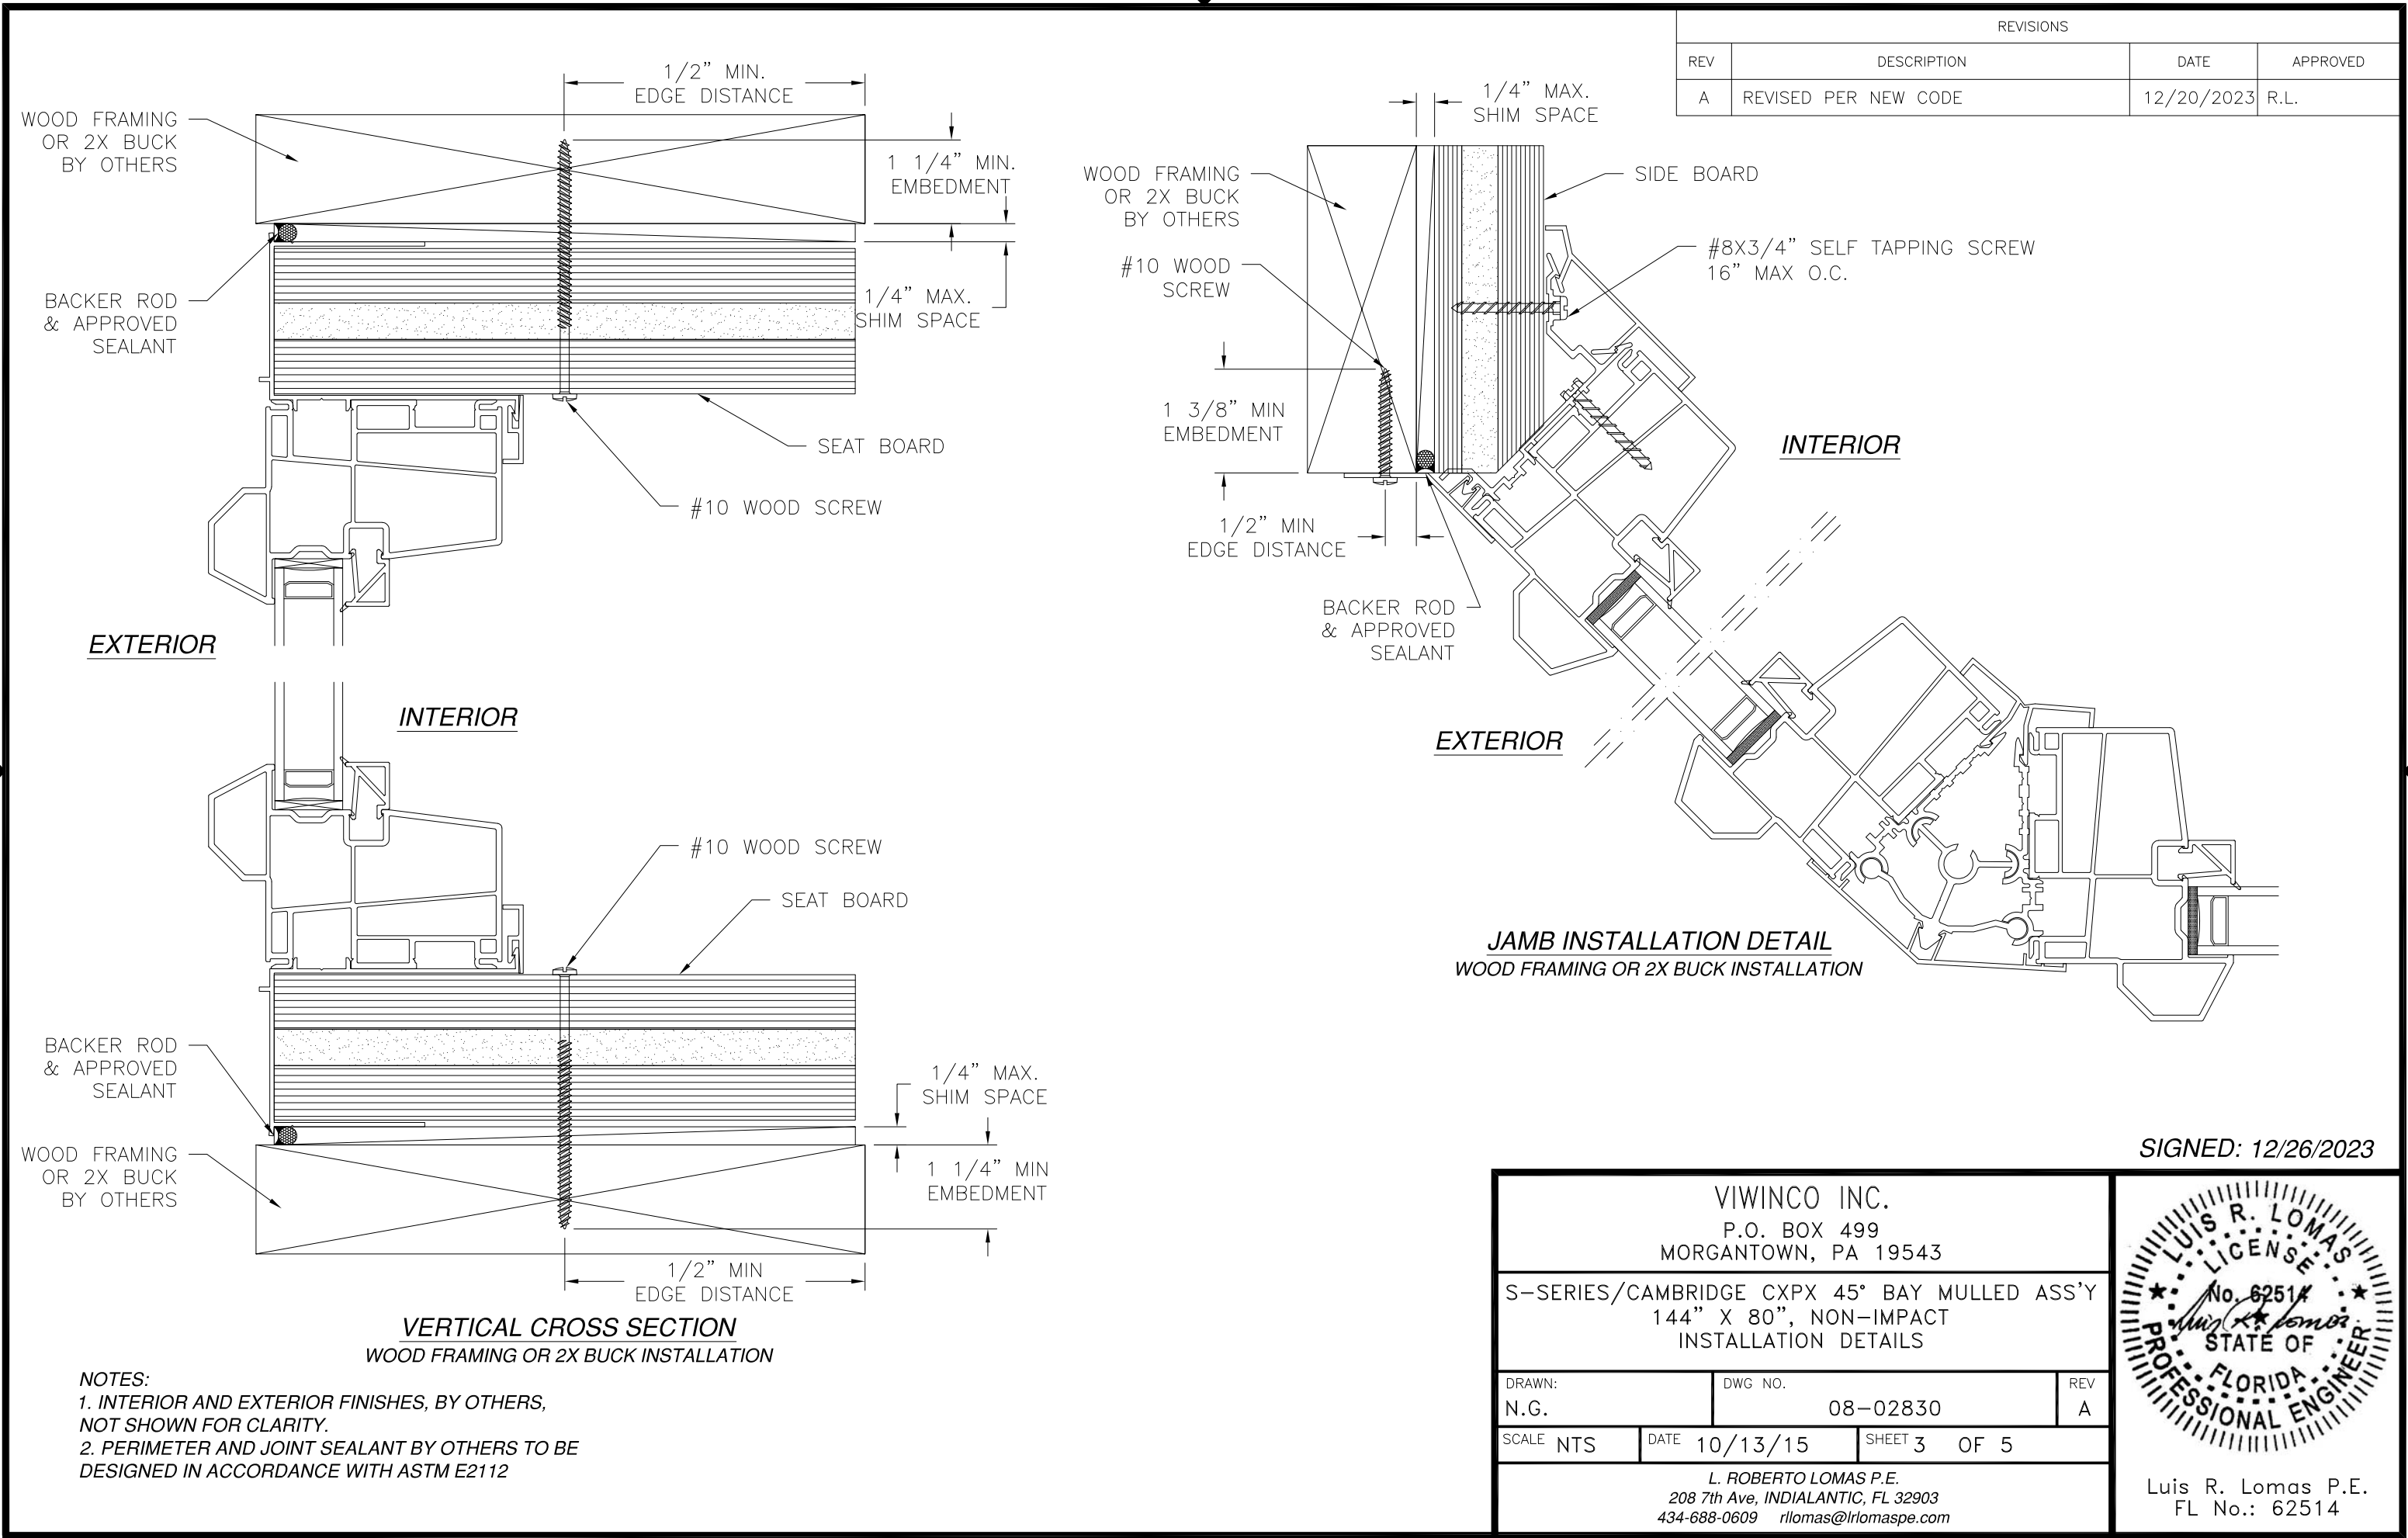


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	12/20/2023	R.L.

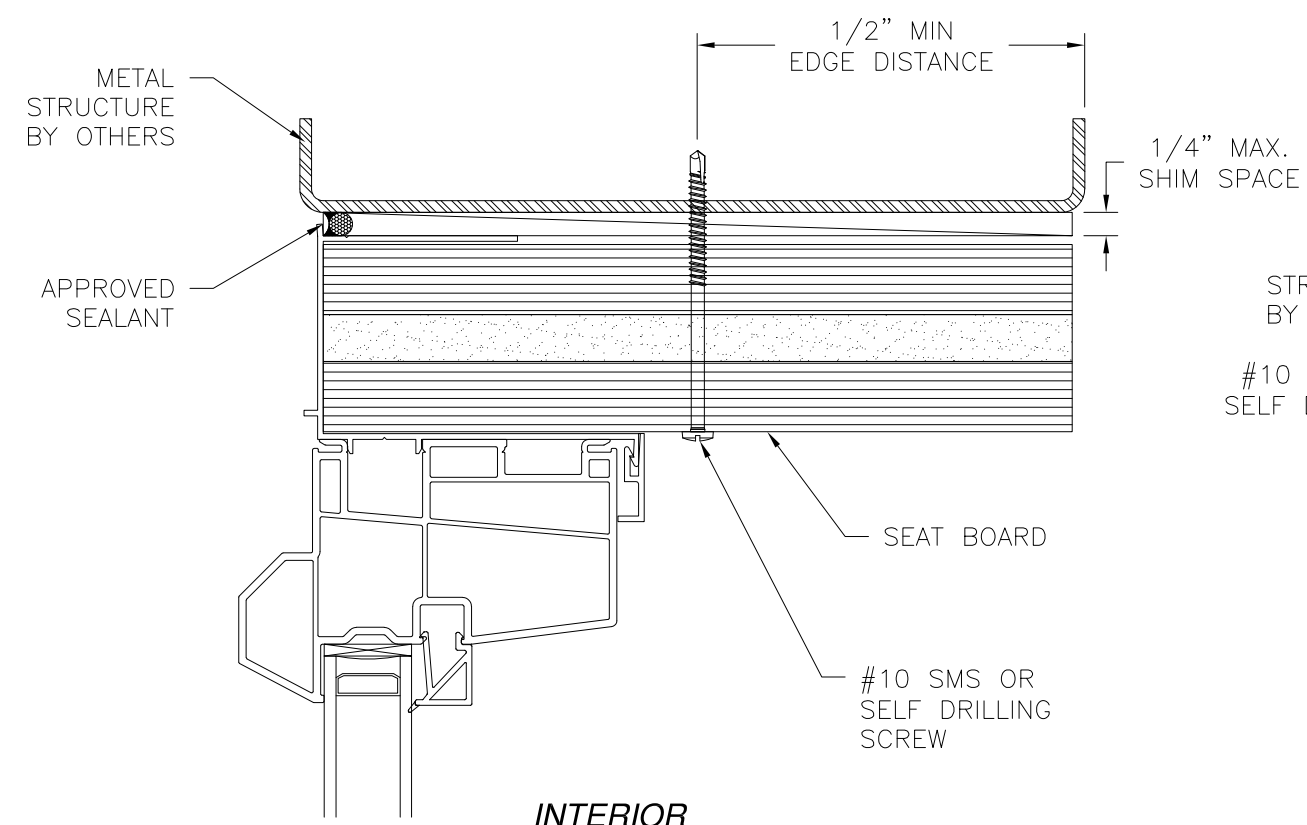


EXTERIOR

INTERIOR

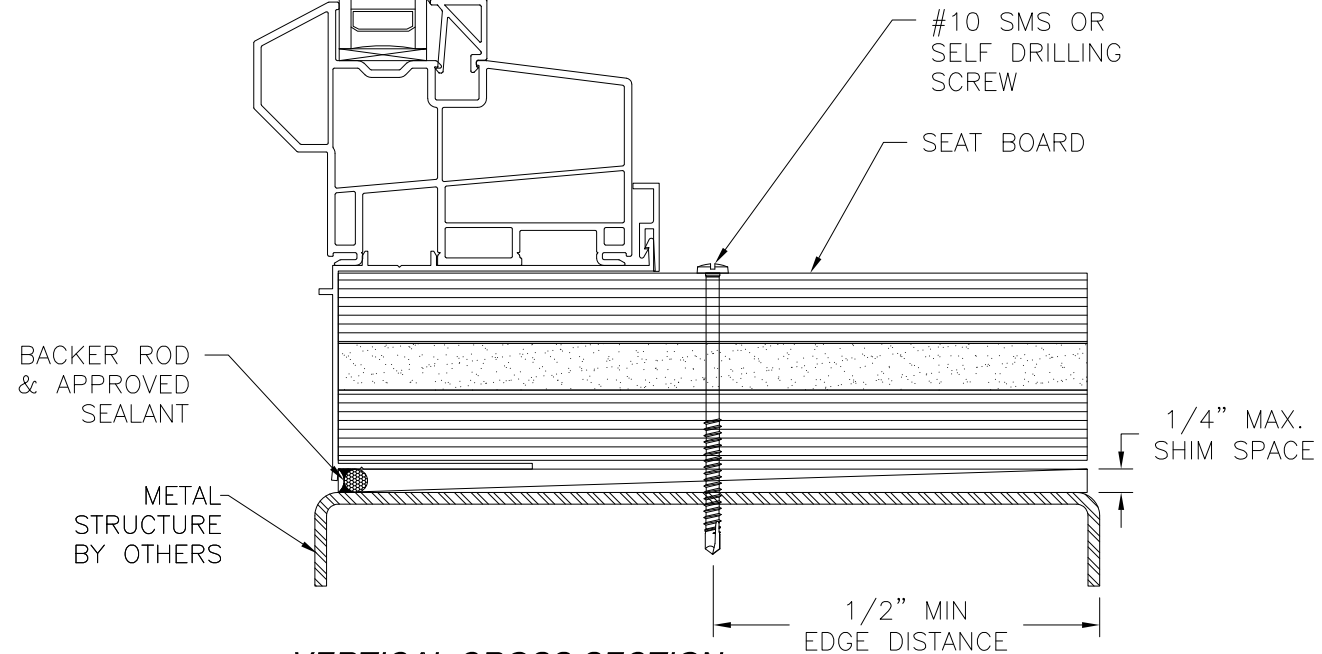

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

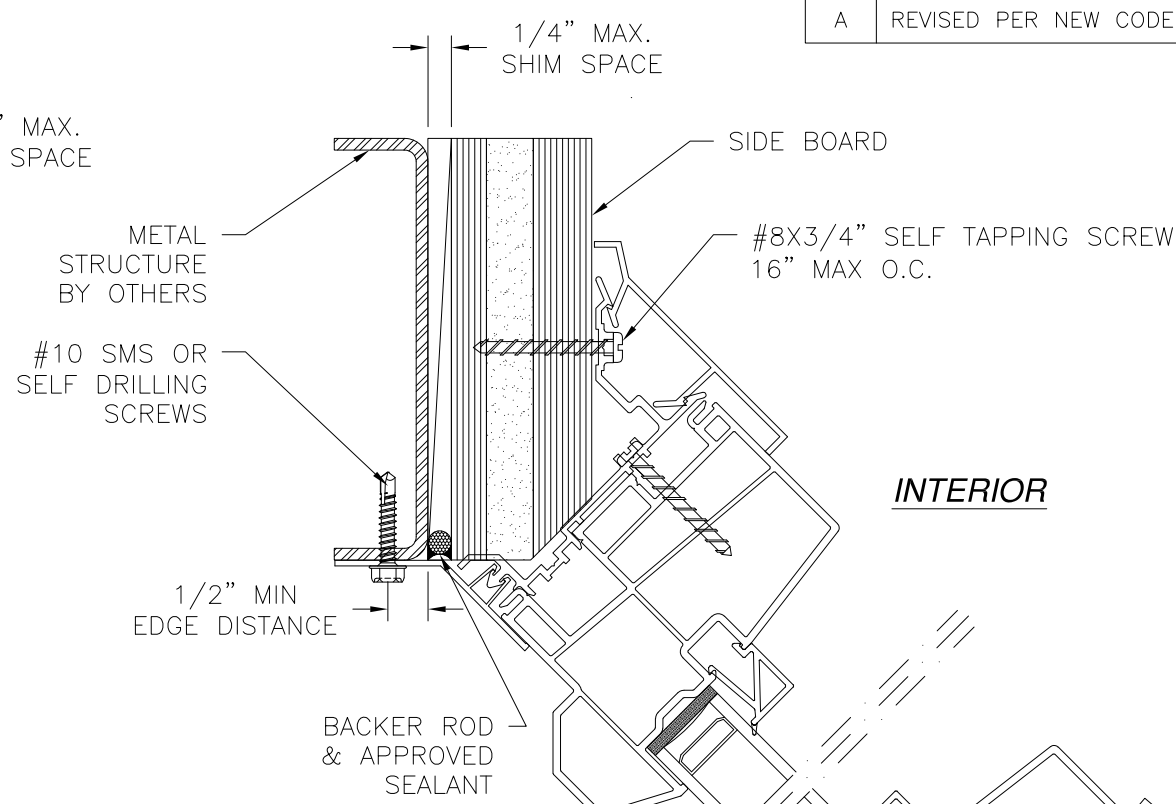

EXTERIOR

INTERIOR

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

VIWINCO INC.

P.O. BOX 499

MORGANTOWN, PA 19543

S-SERIES/CAMBRIDGE CXPX 45° BAY MULLED ASS'Y

144" X 80", NON-IMPACT

INSTALLATION DETAILS

DRAWN: N.G.

DWG NO. 08-02830

REV A

SCALE NTS

DATE 10/13/15


SHEET 4 OF 5

L. ROBERTO LOMAS P.E.


208 7th Ave, INDIALANTIC, FL 32903

434-688-0609 rllomas@lrlomaspe.com

SIGNED: 12/26/2023

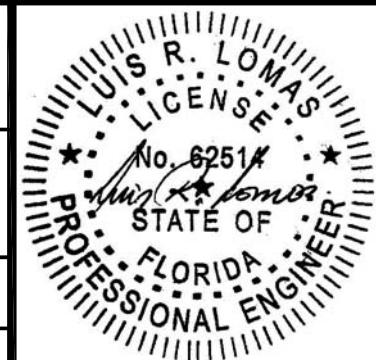

Luis R. Lomas P.E.
FL No.: 62514

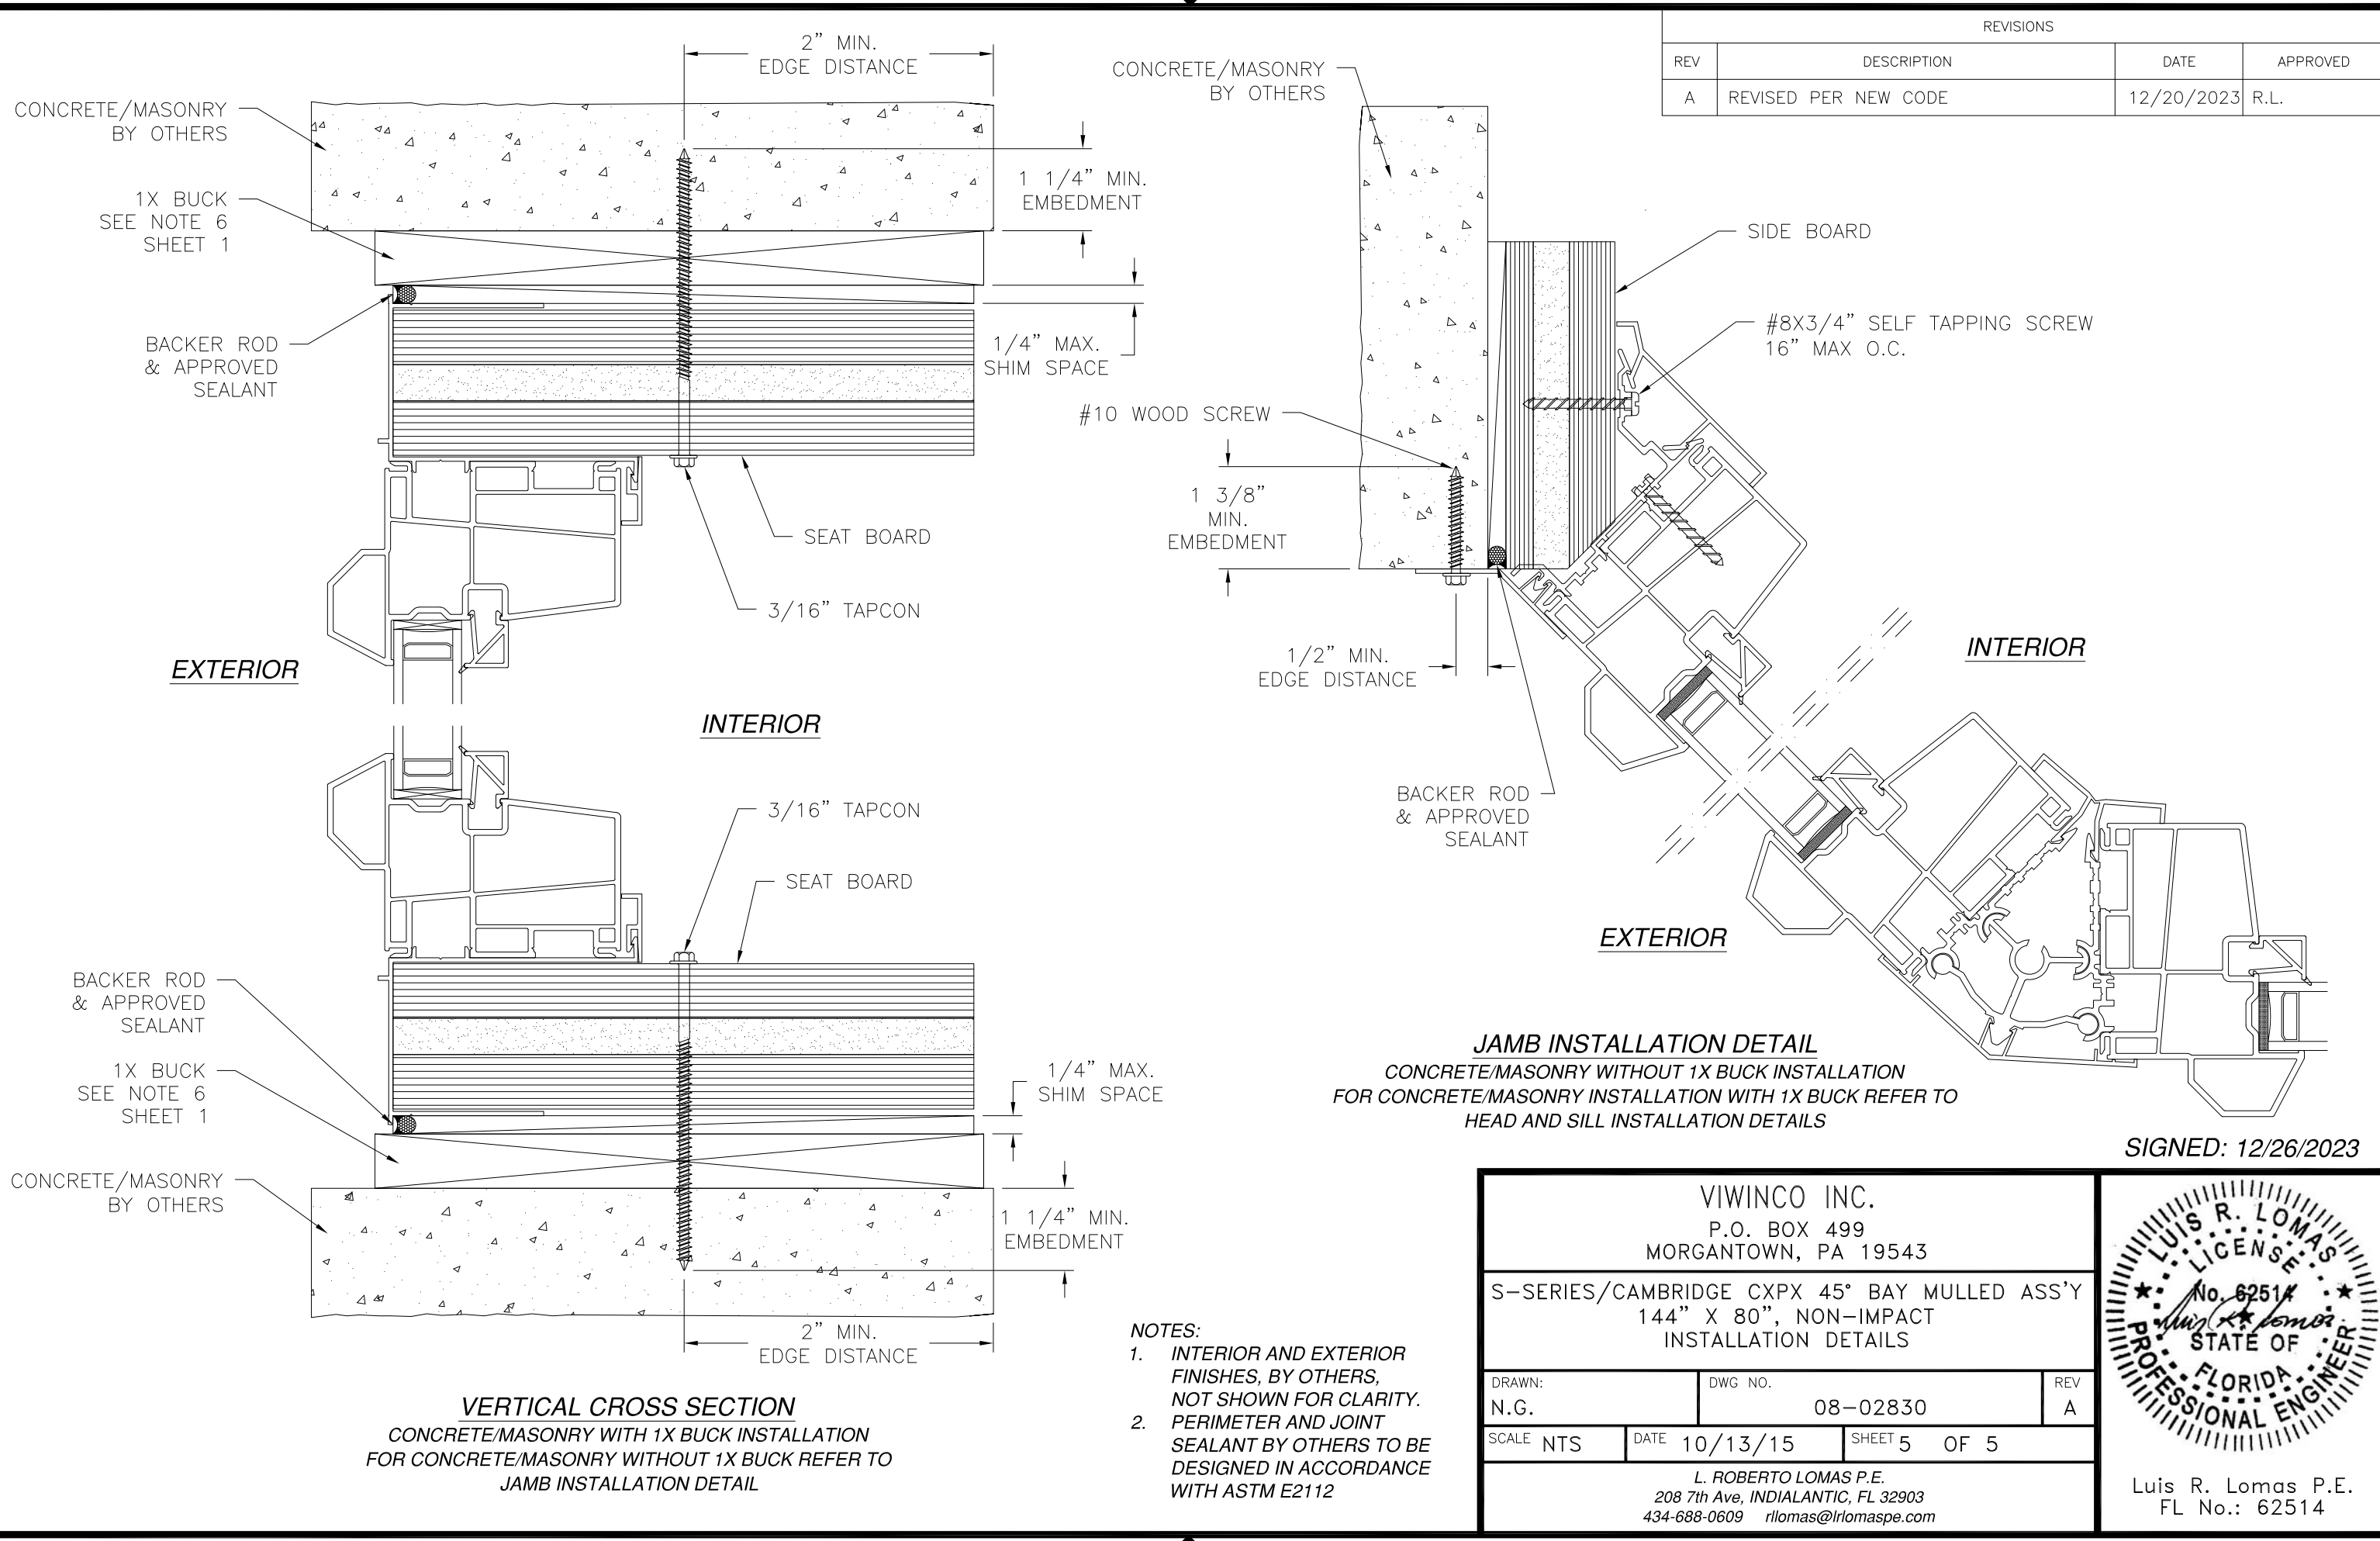

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER NEW CODE	12/20/2023	R.L.

JAMB INSTALLATION DETAIL
CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION
FOR CONCRETE/MASONRY INSTALLATION WITH 1X BUCK REFER TO
HEAD AND SILL INSTALLATION DETAILS

VERTICAL CROSS SECTION
CONCRETE/MASONRY WITH 1X BUCK INSTALLATION
FOR CONCRETE/MASONRY WITHOUT 1X BUCK REFER TO
JAMB INSTALLATION DETAIL

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 12/26/2023

VIWINCO INC.
P.O. BOX 499
MORGANTOWN, PA 19543

S-SERIES/CAMBRIDGE CXPX 45° BAY MULLED ASS'Y
144" X 80", NON-IMPACT
INSTALLATION DETAILS

DRAWN: N.G.	DWG NO. 08-02830	REV A
SCALE NTS	DATE 10/13/15	SHEET 5 OF 5

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

LUIS R. LOMAS
LICENSED
No. 62514
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Luis R. Lomas P.E.
FL No.: 62514