

PanoramAH! AMERICA, LLC

ah!38 MULLED FIXED WINDOW

(WZ3)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- TAS 201-94

TAS 202-94

TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 3 OR LESS.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 4.
7. WINDOW FRAME MATERIAL: ALUMINUM 6063-T5
8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 7 FOR GLAZING DETAIL.

INSTALLATION NOTES:

1. TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEETS 4 & 5.
2. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
3. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
4. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
5. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- 5.1. FASTENERS USED WITHIN 3000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
- 5.2. CONNECTORS AND METAL PLATES USED WITHIN 3000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
6. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
7. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
8. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER OR SHEET 10.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND INSTALLATION NOTES
2	MULLED ELEVATION
3	CURVED ELEVATION
4	ANCHOR LAYOUT
5	SINGLE ELEVATION AND ANCHOR LAYOUT
6	DESIGN PRESSURE TABLES
7	GLAZING DETAIL AND GLASS CAPACITY TABLES
8	VERTICAL SECTIONS
9	HORIZONTAL SECTIONS
10	ANCHOR DETAILS & ANCHOR SCHEDULE

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
SEE SHEETS 2, 3, & 5	SEE TABLES ON SHEETS 6 & 7			LARGE & SMALL MISSILE IMPACT



1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580

ah!38 MULLED
FIXED WINDOW
(WZ3)(IMPACT)
GENERAL NOTES &
INSTALLATION NOTES


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	DB	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.10.16.2024-07'00'

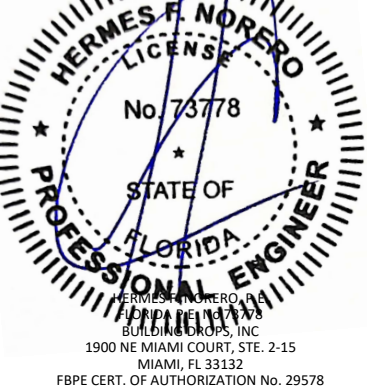

FL #:

FL46510

DATE: 10.16.2024

DWG. BY:
SH

CHK. BY:
HFN

SCALE: NTS


DWG. #: PAN025

SECTION:

1

REV.
A

c:\users\daniel(buitrago)\building drops, inc\building drops landing - common\projects\2026 code change projects\panoramahl america\cc-26-0601.1 - 2026 code change projects\panoramahl america\dwgs\146510\pan025 - a.dwg 8/3/2026 10:04 PM

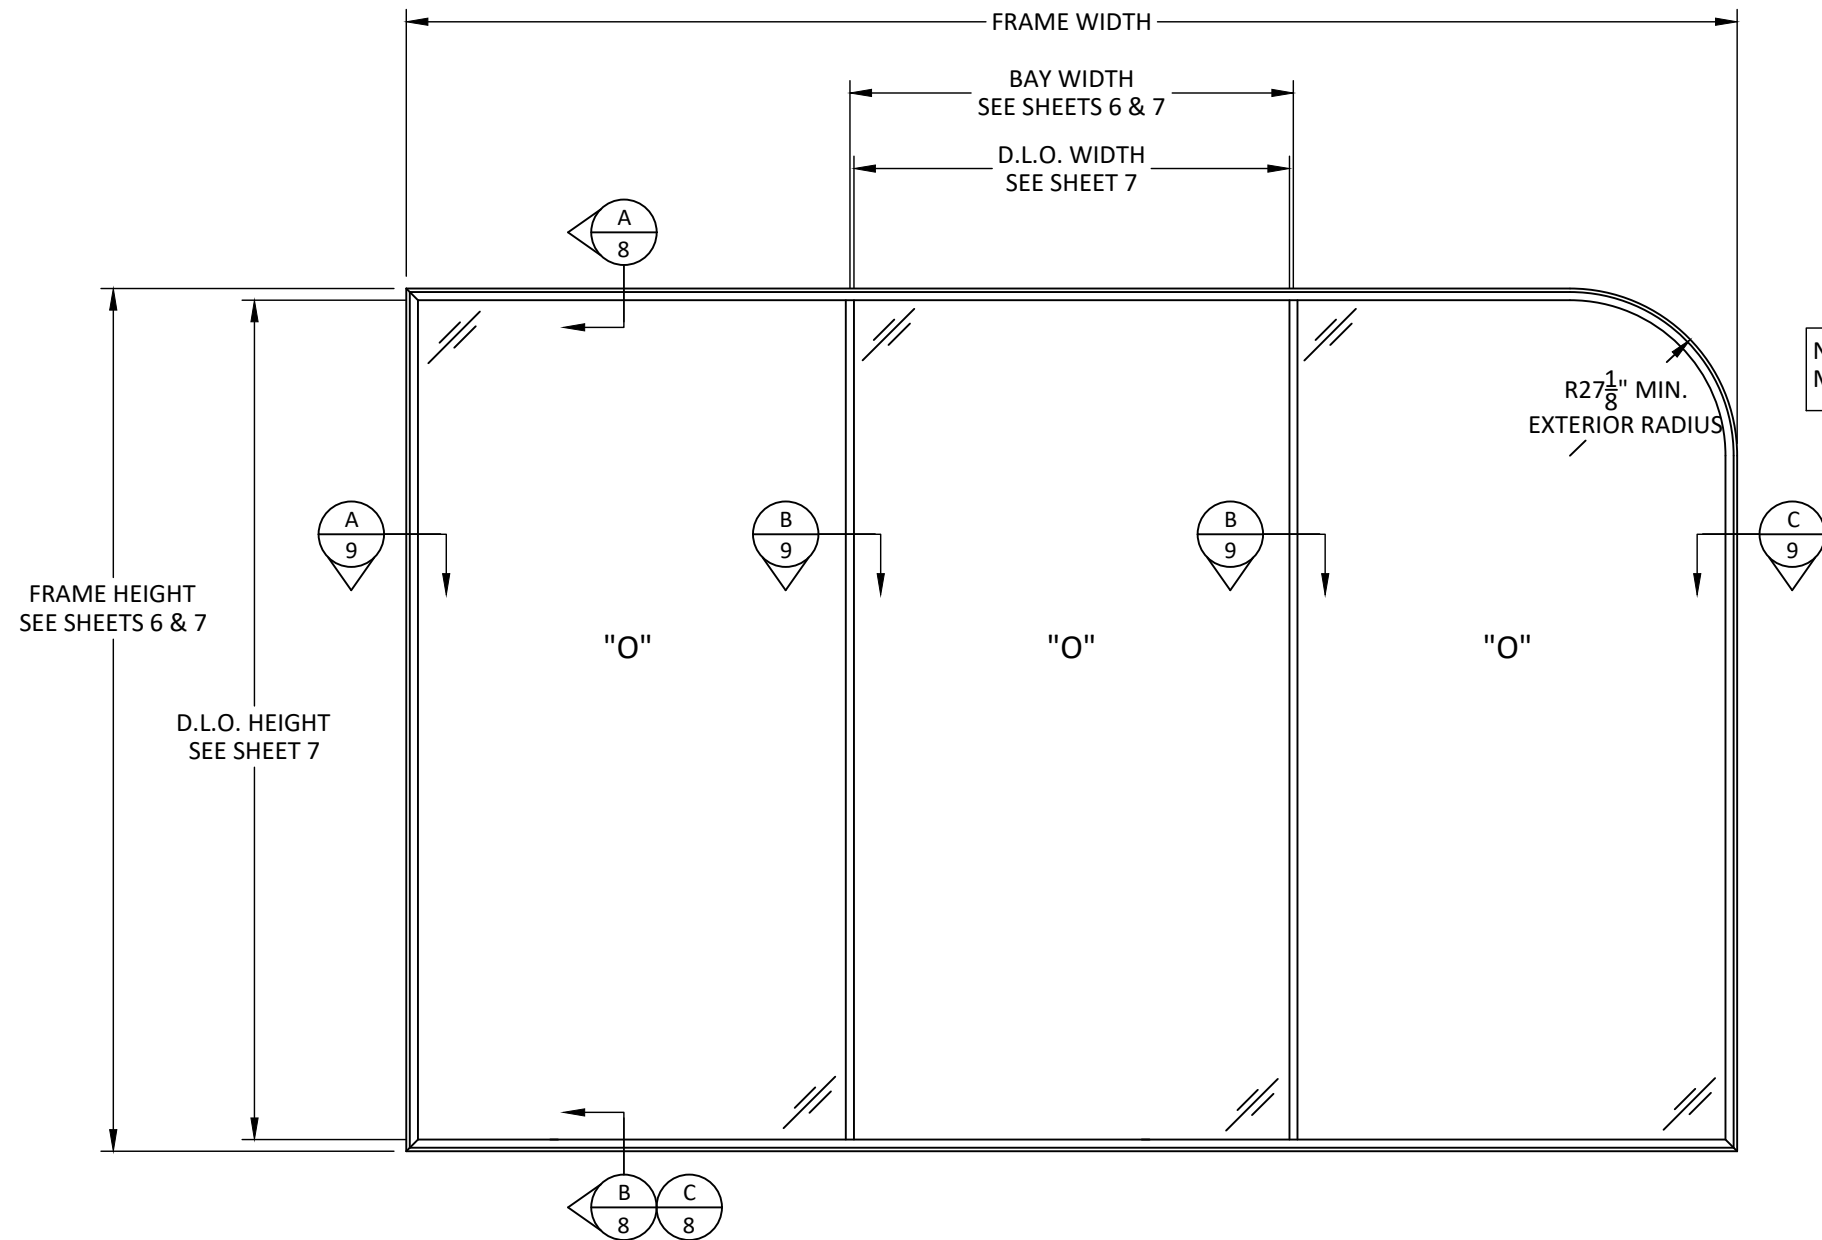

NOTE: RADIUS GLASS QUALIFIED ON
MULLED AND SINGLE CONFIGURATIONS.

ELEVATION
MULLED

D.L.O. HEIGHT = FRAME HEIGHT - 3.78"
D.L.O. WIDTH = BAY WIDTH - 1.31"
NOMINAL FRAME WIDTH = # OF BAYS X BAY WIDTH



1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580

ah!38 MULLED
FIXED WINDOW
(WZ3)/(IMPACT)
MULLED ELEVATION

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	DB	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A
LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL46510
DATE:	10.16.2024
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	PAN025
SECTION:	2
REV.	A

c:\Users\daniel\Documents\projects\2026 code change projects\panoramahi america\cc-26-0601.1 - 2026 code change projects\panoramahi america\dwgs\pan025 - a.dwg 8/3/2026 10:04 PM

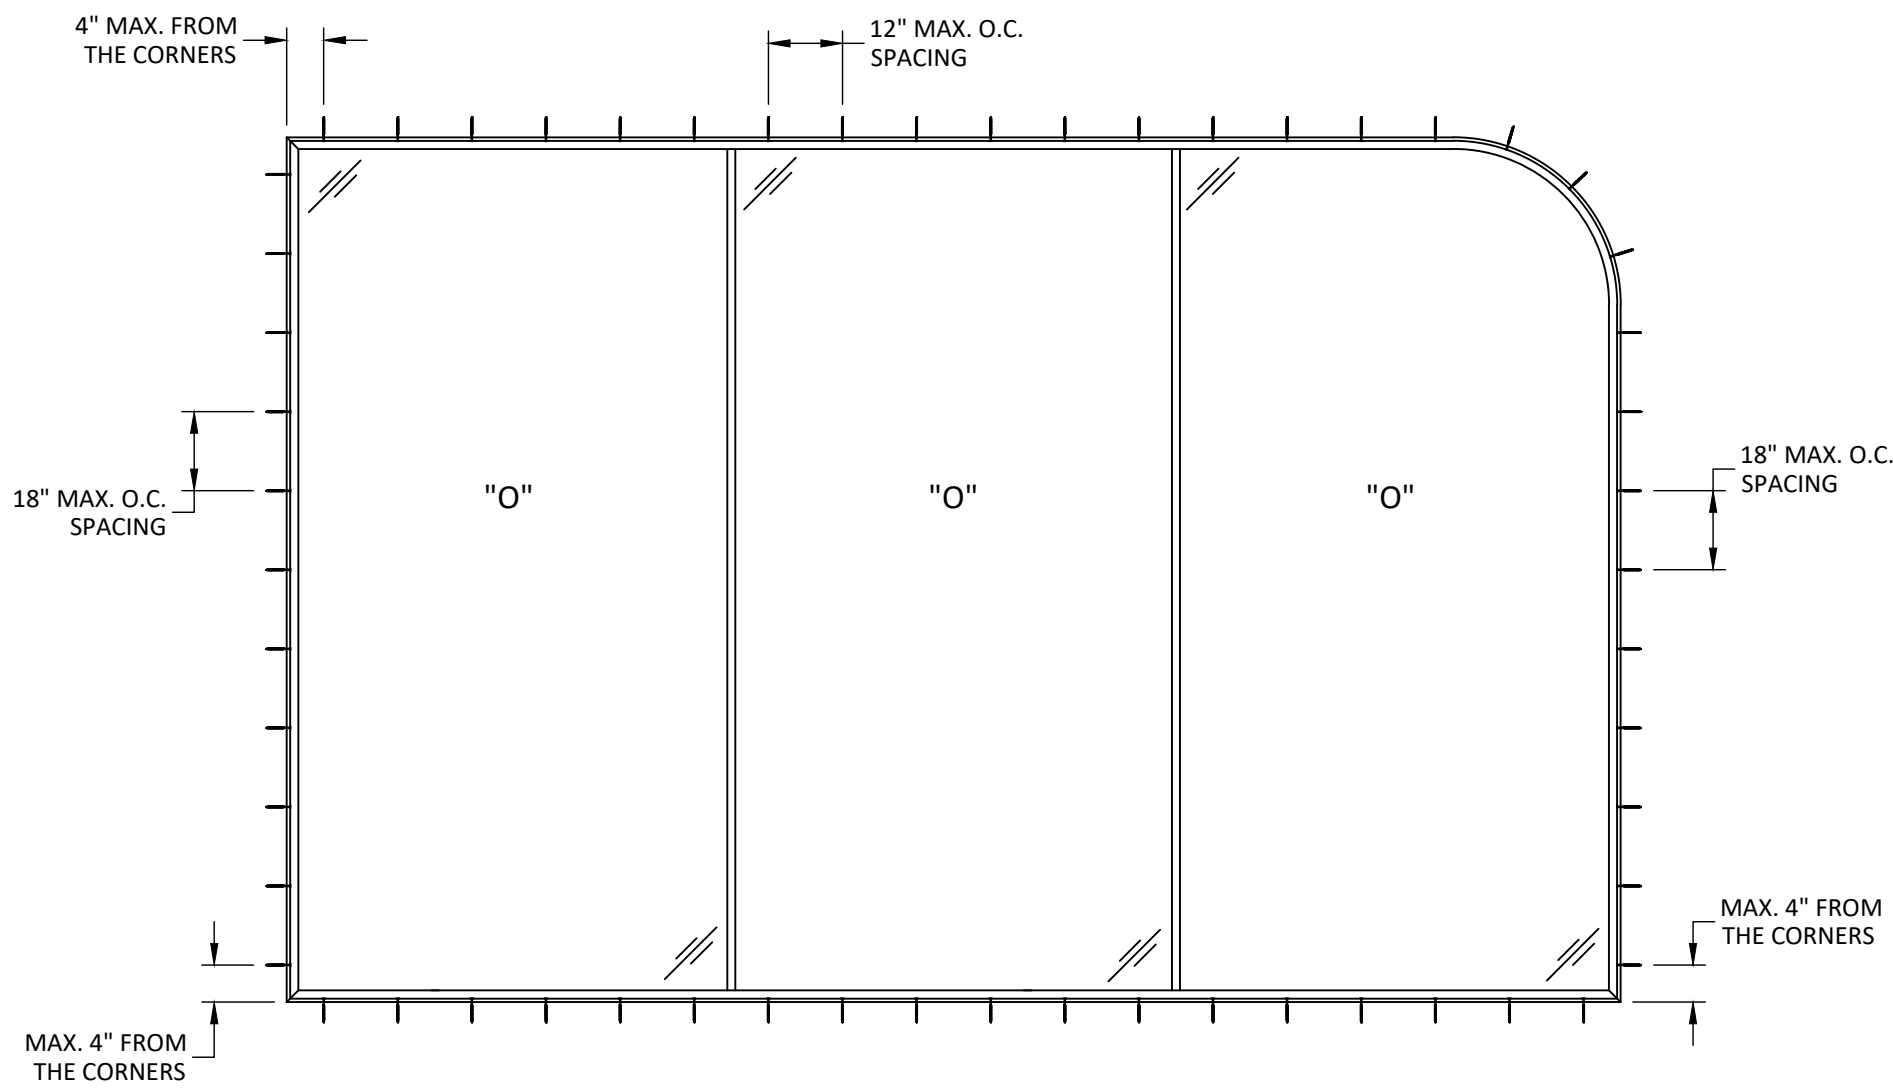

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

NOTE: CURVED GLASS ANCHOR
LAYOUT IS SIMILAR.

PANORAMAH!
unlimited perspective

1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580

TITLE:

ah!38 MULLED
FIXED WINDOW
(WZ3)/(IMPACT)
ANCHOR LAYOUT


PREPARED BY:

**BUILDING DROPS**

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	DB	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A
LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

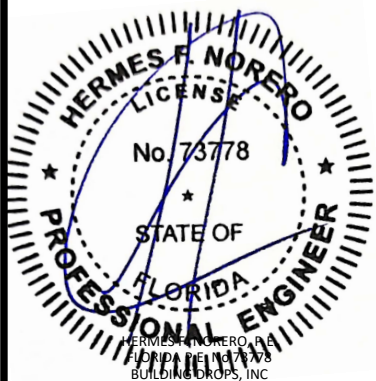

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL46510

DATE:

10.16.2024

DWG. BY:

SH

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

PAN025

SECTION:


4

REV.

A



OF 10

c:\users\daniel\workspace\building drops, inc\building drops landing - common\projects\2026 code change projects\panoramahi america\cc-26-0601.1 - 2026 code change\dwgs\146510\pan025 - a.dwg 8/3/2026 10:04 PM

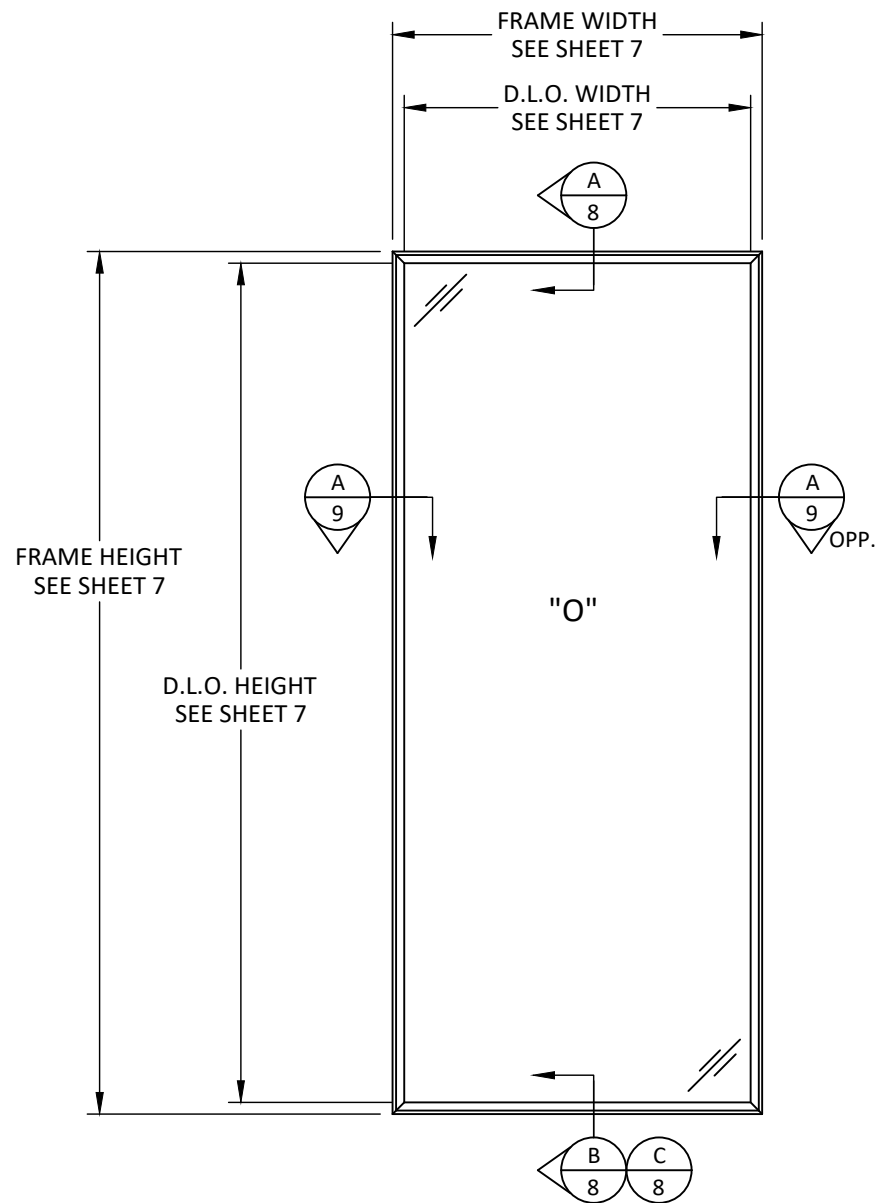

ELEVATION
SINGLE FIXED

FRAME HEIGHT = D.L.O. HEIGHT + 3.78"
FRAME WIDTH = D.L.O. WIDTH + 3.78"

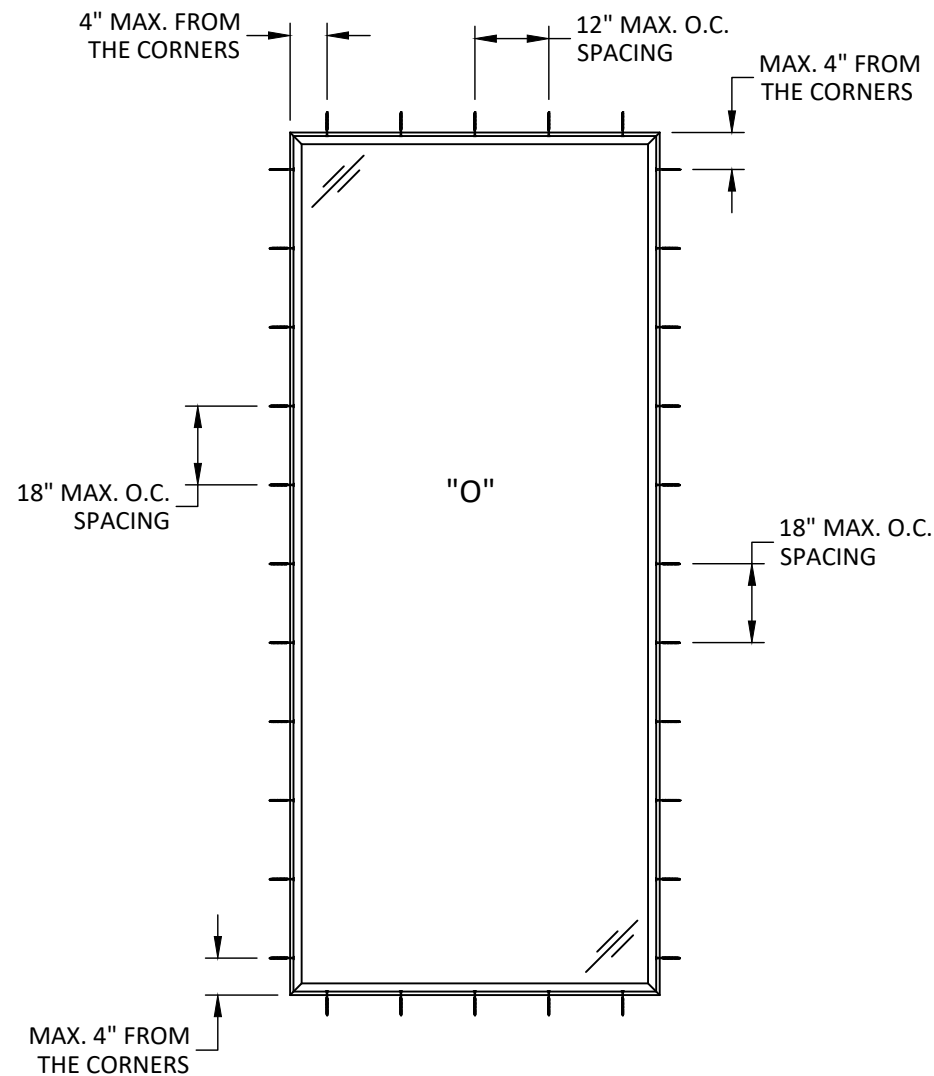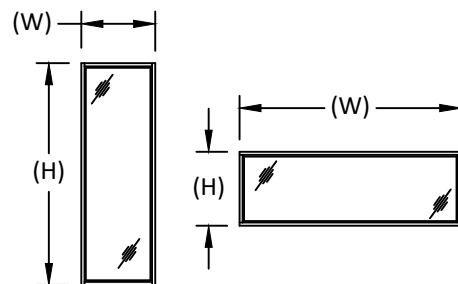

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

NOTE:
WINDOW WIDTH (W) AND HEIGHT (H) ARE
INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN
NOT TO EXCEED MAXIMUM TESTED SQUARE FOOT
AREA. ANCHOR SPACING SHALL NOT EXCEED
THOSE SHOWN FOR LONG OR SHORT LEG OF UNIT.

PANORAMAH!
unlimited perspective

1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580


TITLE:
ah!38 MULLED
FIXED WINDOW
(WZ3)/(IMPACT)
SINGLE ELEVATION &
ANCHOR LAYOUT

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	DB	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A
LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

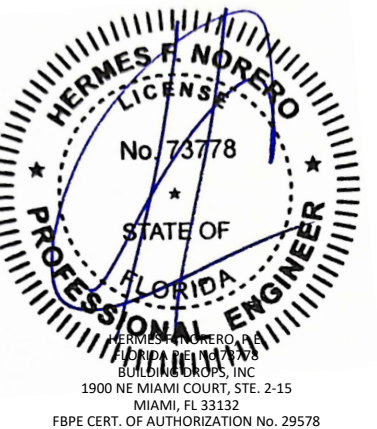

FL #:	FL46510
DATE:	10.16.2024
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	PAN025
SECTION:	5
REV.	A

8/3/2026 10:04 PM


c:\users\daniel(buitrago)\building drops, inc\building drops landing - common\projects\panoramahi america\lta-cc-26-0601.1 - 2026 code change\dwgs\lta025 - a.dwg

DESIGN PRESSURE TABLE (PSF)			
'W' - WIDTH (IN.)"	FRAME HEIGHT (IN.)	MULLION	
		+	-
24	48	85.0	-85.0
36		75.0	-75.0
48		75.0	-75.0
60		75.0	-75.0
72		75.0	-75.0
84		75.0	-75.0
96		75.0	-75.0
108		75.0	-75.0
120		75.0	-75.0
132		70.0	-70.0
144		70.0	-70.0
152		50.0	-55.0
156	60	50.0	-55.0
170		50.0	-55.0
180		50.0	-55.0
24		85.0	-85.0
36		75.0	-75.0
48		75.0	-75.0
60		75.0	-75.0
72		75.0	-75.0
84		75.0	-75.0
96		75.0	-75.0
108		70.0	-70.0
120		70.0	-70.0
132		50.0	-55.0
144		50.0	-55.0
152		50.0	-55.0
156		50.0	-55.0
170		50.0	-55.0
180		50.0	-55.0
24	72	75.0	-75.0
36		75.0	-75.0
48		75.0	-75.0
60		75.0	-75.0
72		75.0	-75.0
84		75.0	-75.0
96		70.0	-70.0
108		50.0	-55.0
120		50.0	-55.0
132		50.0	-55.0
144		50.0	-55.0
152		50.0	-55.0
156		50.0	-55.0
170		50.0	-55.0
180		50.0	-55.0


DESIGN PRESSURE TABLE (PSF)			
'W' - WIDTH (IN.)"	FRAME HEIGHT (IN.)	MULLION	
		+	-
24	84	75.0	-75.0
36		75.0	-75.0
48		75.0	-75.0
60		75.0	-75.0
72		75.0	-75.0
84		70.0	-70.0
96		50.0	-55.0
108		50.0	-55.0
120		50.0	-55.0
132		50.0	-55.0
144		50.0	-55.0
152		50.0	-55.0
156	96	50.0	-55.0
170		50.0	-55.0
180		50.0	-55.0
24		75.0	-75.0
36		75.0	-75.0
48		75.0	-75.0
60		75.0	-75.0
72		70.0	-70.0
84		50.0	-55.0
96		50.0	-55.0
108		50.0	-55.0
120		50.0	-55.0
132		50.0	-55.0
144		50.0	-55.0
152		50.0	-55.0
156		50.0	-55.0
170		50.0	-55.0
24	108	75.0	-75.0
36		75.0	-75.0
48		75.0	-75.0
60		70.0	-70.0
72		50.0	-55.0
84		50.0	-55.0
96		50.0	-55.0
108		50.0	-55.0
120		50.0	-55.0
132		50.0	-55.0
144		50.0	-55.0
24	120	75.0	-75.0
36		75.0	-75.0
48		75.0	-75.0
60		70.0	-70.0
72		50.0	-55.0
84		50.0	-55.0
96		50.0	-55.0
108		50.0	-55.0
120		50.0	-55.0
132		50.0	-55.0
24	132	75.0	-75.0
36		75.0	-75.0
48		62.6	-62.6
60		50.0	-55.0
72		50.0	-55.0
84		50.0	-55.0
96		50.0	-55.0
108		50.0	-55.0
120		50.0	-55.0

DESIGN PRESSURE TABLE (PSF)			
'W' - WIDTH (IN.)"	FRAME HEIGHT (IN.)	MULLION	
		+	-
24	144	75.0	-75.0
36		75.0	-75.0
48		50.0	-55.0
60		50.0	-55.0
72		50.0	-55.0
84		50.0	-55.0
96		50.0	-55.0
108		50.0	-55.0
24	152	75.0	-75.0
36		75.0	-75.0
40		75.0	-75.0
48		50.0	-55.0
60		50.0	-55.0
72		50.0	-55.0
84		50.0	-55.0
96		50.0	-55.0
102		50.0	-55.0
24	156	75.0	-75.0
36		75.0	-75.0
48		50.0	-55.0
60		50.0	-55.0
72		50.0	-55.0
84		50.0	-55.0
96		50.0	-55.0
102		50.0	-55.0
24	168	75.0	-75.0
36		61.1	-61.1
48		50.0	-55.0
60		50.0	-55.0
72		50.0	-55.0
84		50.0	-55.0
24	170	75.0	-75.0
36		50.0	-55.0
48		50.0	-55.0
60		50.0	-55.0
72		50.0	-55.0
84		50.0	-55.0
96		50.0	-55.0
24	180	73.7	-73.7
36		50.0	-55.0
48		50.0	-55.0
60		50.0	-55.0
72		50.0	-55.0
84		46.1	-50.7
24	192	60.7	-60.7
36		50.0	-55.0
48		50.0	-55.0
60		50.0	-55.0
72		42.9	-47.2
24	204	50.6	-55.0
36		50.0	-55.0
48		50.0	-55.0
60		42.0	-46.2
24	216	50.0	-55.0
36		50.0	-55.0
48		43.6	-47.9
60		35.3	-38.8
24	228	50.0	-55.0
36		48.9	-53.8
48		50.6	-55.0
60		50.0	-55.0

NOTE: THE LOWER DESIGN PRESSURE BETWEEN THE TABLES ON THIS SHEET AND THE TABLES ON SHEET 7 SHALL APPLY TO THE ENTIRE MULLED SYSTEM.

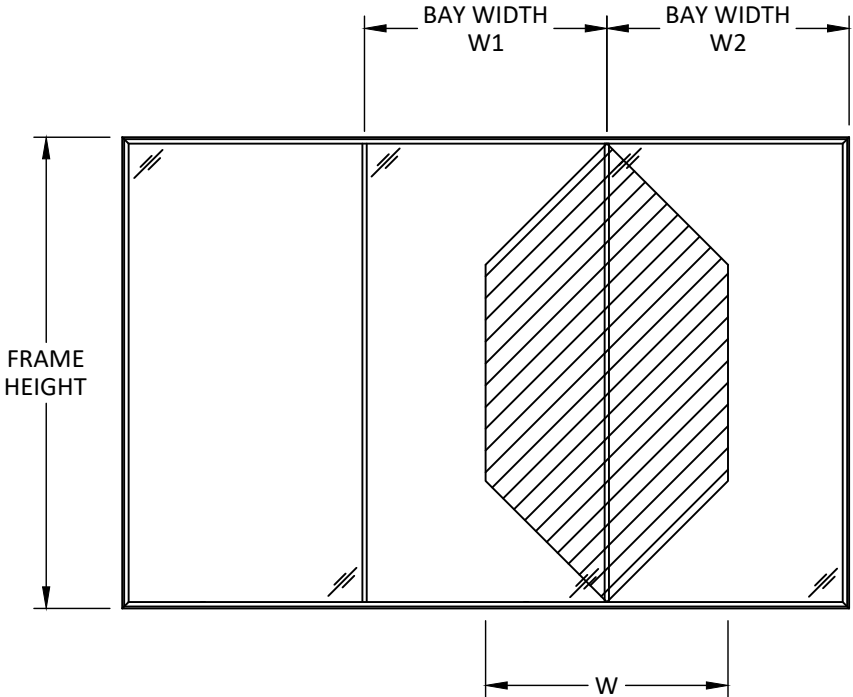

WIDTH - (W) = (W1+W2)/2

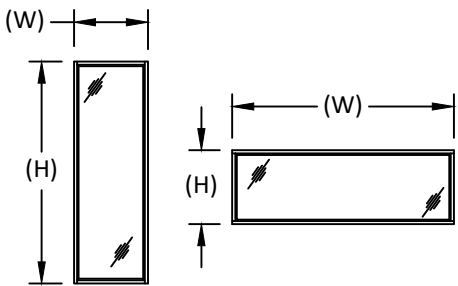

NOTE:
WINDOW WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FOOT AREA. ANCHOR SPACING SHALL NOT EXCEED THOSE SHOWN FOR LONG OR SHORT LEG OF UNIT.



1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580

TITLE:
ah!38 MULLED
FIXED WINDOW
(WZ3)/(IMPACT)

DESIGN PRESSURE TABLES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS

BY


DATE

2026 FBC UPDATE

DB

08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

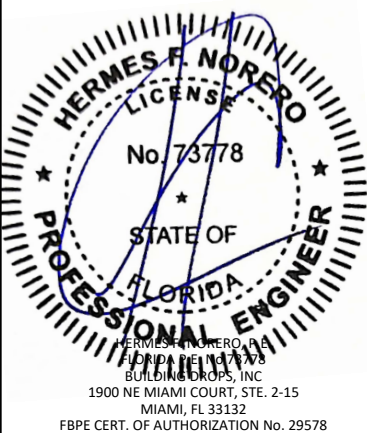

FL #:

FL46510

DATE: 10.16.2024

DWG. BY:

SH

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

PAN025

SECTION:

6

REV.


A

c:\users\daniel\buildrags\building drops, inc\building drops landing - common\projects\2026 code change projects\panoramahi america lta cc-26-0601.1 - 2026 code change\dwgs\fl46510\pan025 - a.dwg 8/3/2026 10:04 PM

DESIGN PRESSURE TABLE (PSF)					
BAY WIDTH (IN.)	FRAME HEIGHT (IN.)	FLAT GLASS		CURVED GLASS	
		+	-	+	-
24	48	-85.0	85.0	75.0	-75.0
36		75.0	75.0	75.0	-75.0
48		70.0	70.0	62.5	-62.5
24	60	85.0	85.0	75.0	-75.0
36		75.0	75.0	75.0	-75.0
48		70.0	70.0	62.5	-62.5
60		70.0	70.0	50.0	-50.0
24	72	75.0	75.0	75.0	-75.0
36		75.0	75.0	75.0	-75.0
48		70.0	70.0	62.5	-62.5
60		70.0	70.0	50.0	-50.0
72		58.3	58.3	41.7	-41.7
24	84	75.0	75.0	75.0	-75.0
36		75.0	75.0	75.0	-75.0
48		70.0	70.0	62.5	-62.5
60		70.0	70.0	50.0	-50.0
72		58.3	58.3	41.7	-41.7
84		50.0	55.0	-	-
36	96	75.0	75.0	75.0	-75.0
48		70.0	70.0	62.5	-62.5
60		70.0	70.0	50.0	-50.0
72		58.3	58.3	-	-
84		50.0	55.0	-	-
96		50.0	55.0	-	-
36	108	75.0	75.0	75.0	-75.0
48		70.0	70.0	62.5	-62.5
60		70.0	70.0	-	-
72		50.0	55.0	-	-
84		50.0	55.0	-	-
96		50.0	55.0	-	-
108		44.4	48.9	-	-
36	120	75.0	75.0	75.0	-75.0
48		70.0	70.0	62.5	-62.5
60		70.0	70.0	-	-
72		50.0	55.0	-	-
84		50.0	55.0	-	-
96		50.0	55.0	-	-

*NOTE: BAY WIDTH = FRAME WIDTH
FOR SINGLE UNITS

DESIGN PRESSURE TABLE (PSF)					
BAY WIDTH (IN.)	FRAME HEIGHT (IN.)	FLAT GLASS		CURVED GLASS	
		+	-	+	-
36	132	75.0	-75.0	75.0	-75.0
48		70.0	-70.0	-	-
60		50.0	-55.0	-	-
72		50.0	-55.0	-	-
84		50.0	-55.0	-	-
96		50.0	-55.0	-	-
108	144	44.4	-48.9	-	-
120		40.0	-44.0	-	-
36	152	75.0	-75.0	75.0	-75.0
48		70.0	-70.0	-	-
60		50.0	-55.0	-	-
72		50.0	-55.0	-	-
84		50.0	-55.0	-	-
96	156	50.0	-55.0	-	-
102		47.1	-51.8	-	-
36	168	75.0	-75.0	75.0	-75.0
48		50.0	-55.0	-	-
60		50.0	-55.0	-	-
72		50.0	-55.0	-	-
84		50.0	-55.0	-	-
96	170	50.0	-55.0	-	-
36		70.0	-70.0	-	-
48		50.0	-55.0	-	-
60		50.0	-55.0	-	-
72		50.0	-55.0	-	-
84		50.0	-55.0	-	-
96		50.0	-55.0	-	-

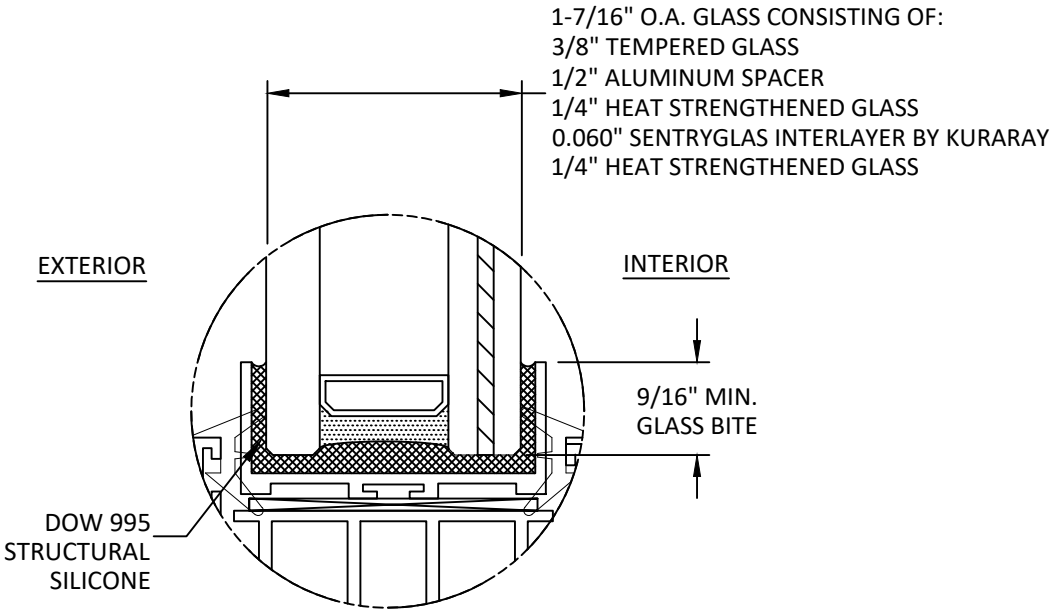

GLAZING DETAIL 1

- GLAZING NOTES:
- GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TITLE:
ah!38 MULLED
FIXED WINDOW
(WZ3)/(IMPACT)
GLAZING DETAIL &
GLASS CAPACITY TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	DB	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL46510
DATE:	10.16.2024
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	PAN025
SECTION:	7
REV.	A


c:\Users\daniel\buildr\building drops, inc\building drops landing - common\projects\2026 code change projects\panoramahi america lta\cc-26-0601.1 - 2026 code change\dwgs\166510\pan025 - a.dwg 8/3/2026 10:04 PM

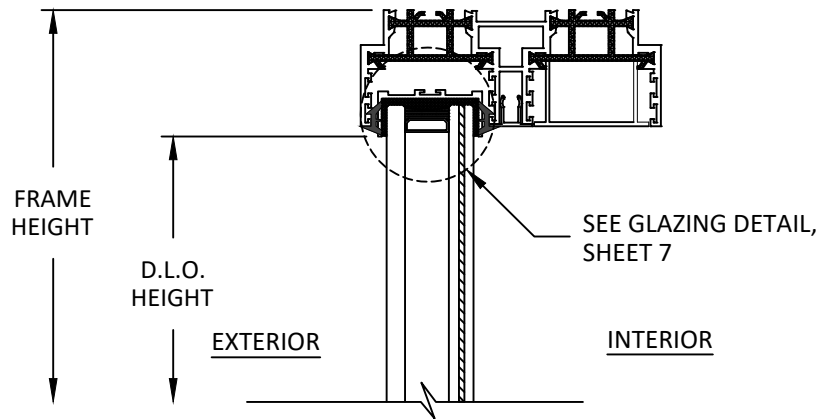

A
8 VERTICAL SECTION
HEAD

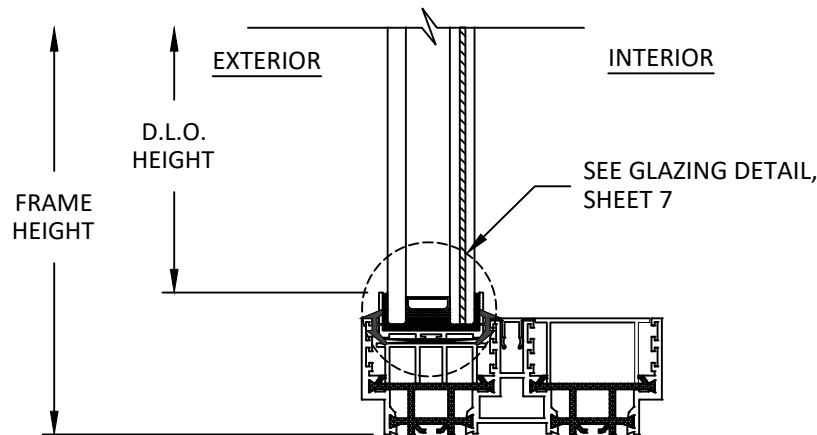

B
8 VERTICAL SECTION
STANDARD SILL

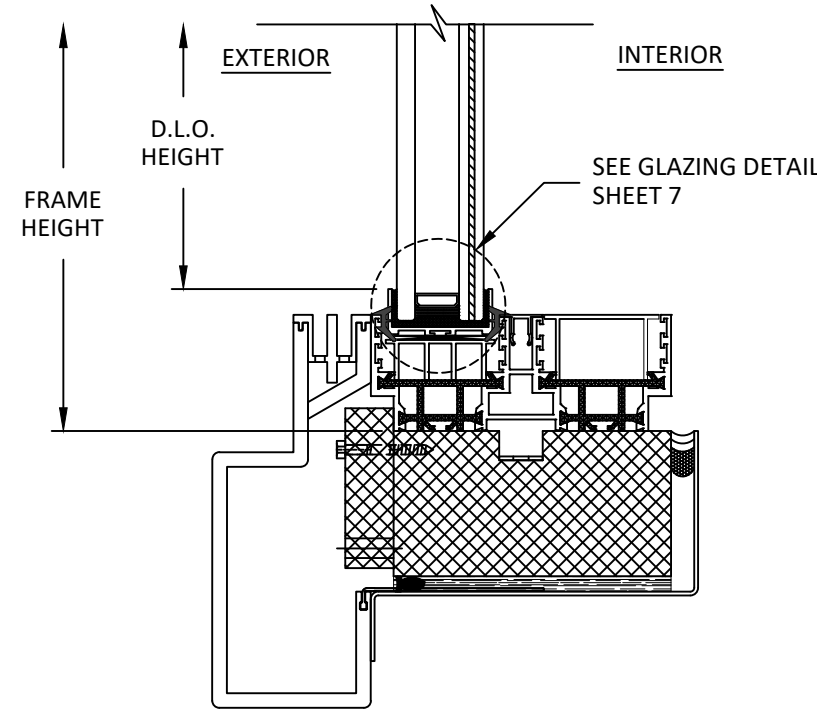

C
8 VERTICAL SECTION
SILL WITH GUTTER
OPTIONAL

PANORAMAH!
unlimited perspective

1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580


ah!38 MULLED
FIXED WINDOW
(WZ3)/(IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	DB	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

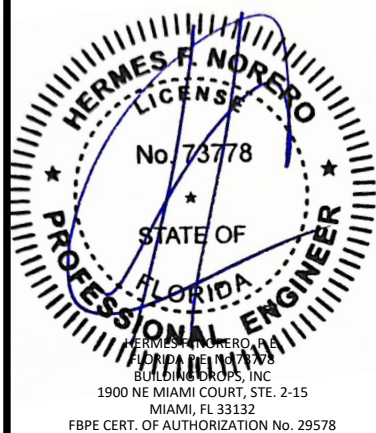


FL #:	FL46510
DATE:	10.16.2024
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	PAN025
SECTION:	8
REV.	A


c:\Users\daniel(buitrago)\building drops, inc\building drops landing - common\projects\2026 code change projects\panoramahi america\cc-26-0601.1 - 2026 code change\dwgs\166510\pan025 - a.dwg 8/3/2026 10:04 PM

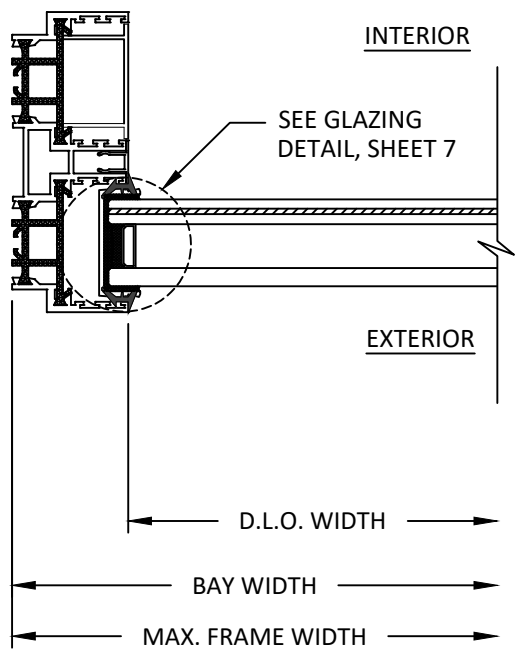


A
9 HORIZONTAL SECTION
JAMB

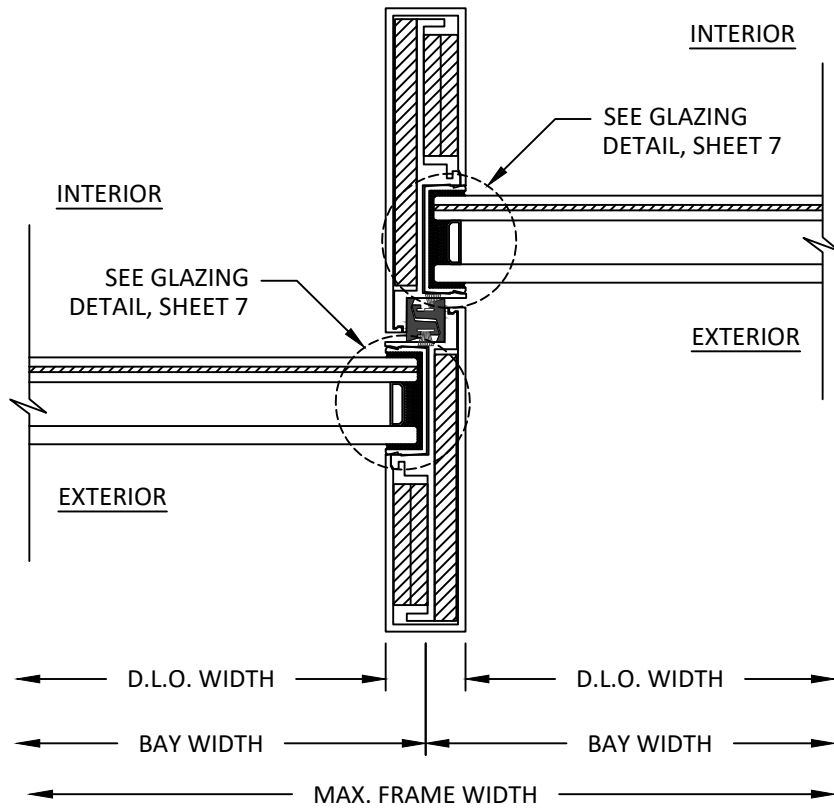


B
9 HORIZONTAL SECTION
MULLION INTERLOCK

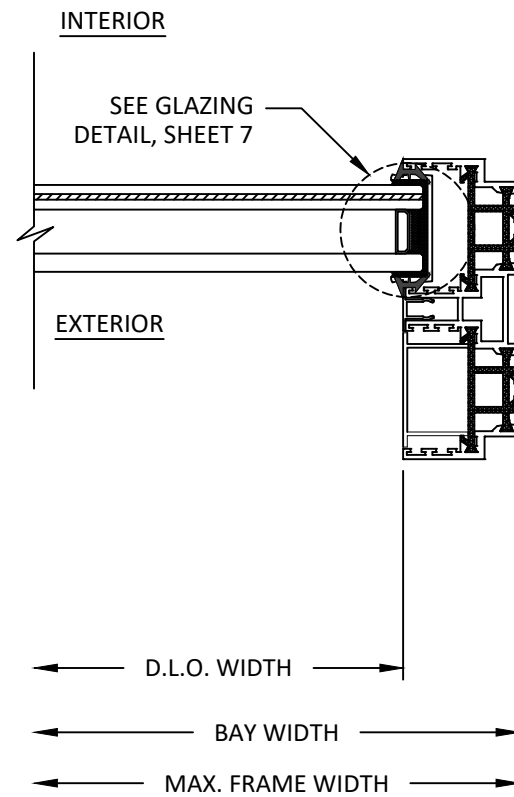

C
9 HORIZONTAL SECTION
JAMB

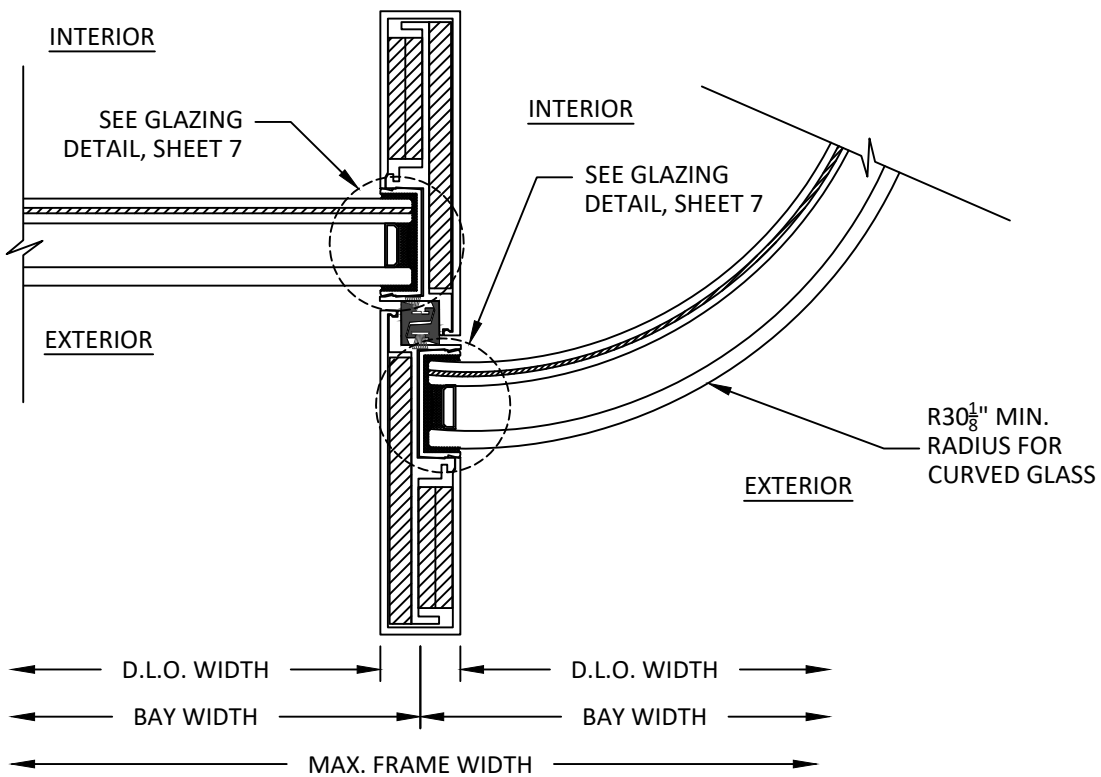

D
9 HORIZONTAL SECTION
MULLION INTERLOCK
CURVED GLASS

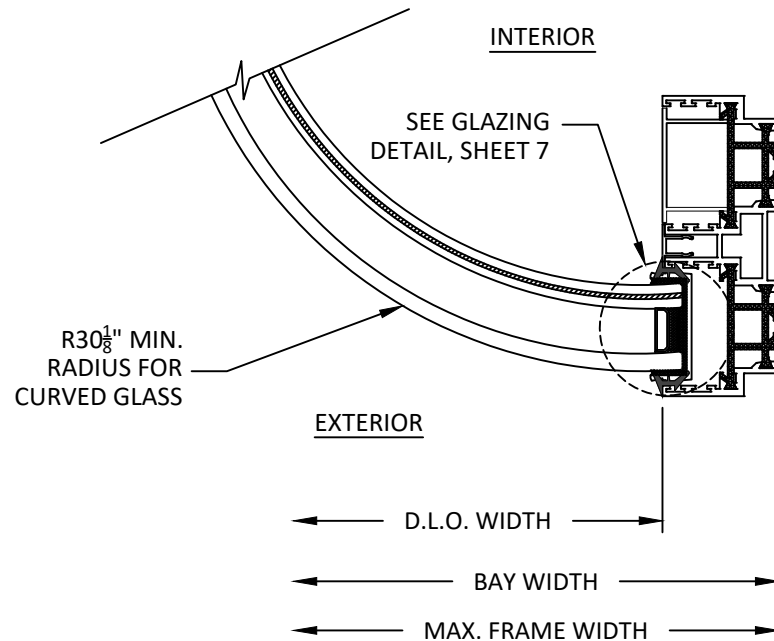

E
9 HORIZONTAL SECTION
JAMB
CURVED GLASS

PANORAMAH!
unlimited perspective

1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580

ah!38 MULLED
FIXED WINDOW
(WZ3)(IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	DB	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A
LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL46510	
DATE:	10.16.2024	
DWG. BY:	SH	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	PAN025	
SECTION:	9	REV. A

c:\users\danielbuitrago\building drops, inc\building drops landing - common\projects\2026 code change projects\panoramah! america llc\cc-26-0601.1 - 2026 code change\dwgs\146510\pano25 - a.dwg



PANORAMAH![®]
unlimited perspective

TITLE: **ah!38 MULLED
FIXED WINDOW
(WZ3)/(IMPACT)
ANCHOR DETAILS &
ANCHOR SCHEDULE**

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	DB	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



DATE: 10.16.2024

DWG. BY: SH	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: PAN025

SECTION:	REV.
10	A