


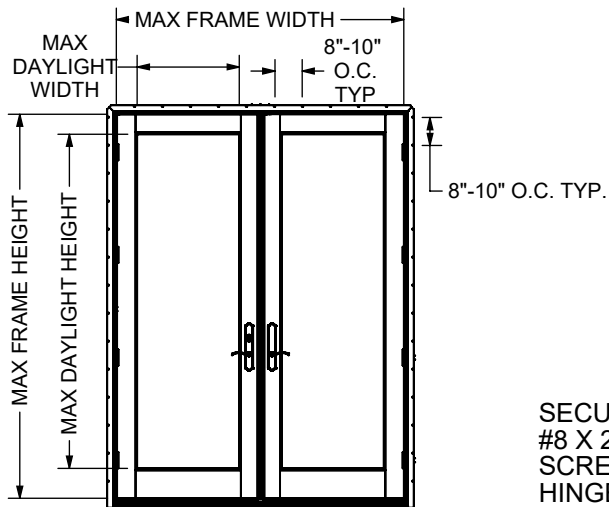


8610 Outswing Door Nailing Fin Installation

SECURE TO BUCK WITH
#7 X 1-5/8" NON-CORROSIVE SCREW
2"-4" FROM END AND 8"-10"
O.C. THROUGH NAILING
FIN AT HEAD AND SIDES, TYP.

.750" MIN DISTANCE TYP.

PERIMETER SEALANT
ON HEAD AND SIDES BY OTHER TYP.


SECURED TO BUCK WITH (2)
#8 X 2-1/2" FH NON-CORROSIVE
SCREWS PLACED THROUGH EACH
HINGE PLATE AND THROUGH THE
FRAME INTO THE BUCK. TYP.

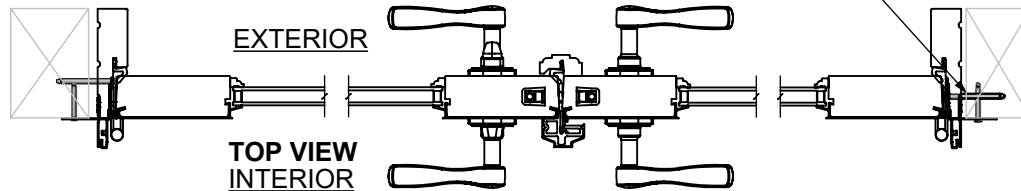

DESC.	MAX FRAME SIZE		MAX DAYLIGHT OPENING		DESIGN PRESSURE (psf)	FRAME MATERIAL	INSTALLATION METHOD
	WIDTH (IN.)	HEIGHT (IN.)	WIDTH (IN.)	HEIGHT (IN.)			
8610 OUTSWING 2-PANEL	73.75	99.09	25.64	83.63	+/-45	ALUM/WOOD	THRU NAIL FIN

NOTE(S):

- THESE UNITS HAVE BEEN TESTED, ANALYZED, HALLMARK CERTIFIED AND FBC APPROVED.
- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ. THE PRODUCT HAS BEEN EVALUATED TO THE FOLLOWING.
 - AAMA/WDMA/CSA 101/I.S.2/A440-11
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- THIS SCHEDULE ADDRESSES ONLY THE FASTENERS REQUIRED TO ANCHOR THE DOOR(S) TO ACHIEVE THE RATED DESIGN PRESSURE. THOROUGHLY READ AND FOLLOW MANUFACTURERS INSTALLATION INSTRUCTIONS RECEIVED WITH UNIT. THIS GUIDE DOES NOT ADDRESS THE SEALING CONSIDERATIONS THAT MAY ARISE IN DIFFERENT WALL CONDITIONS.
- FASTENERS, ANCHORS, AND CONNECTORS SHALL COMPLY WITH THE CORROSION RESISTANCE REQUIREMENTS OF THE 2026 FLORIDA BUILDING CODE, SECTION 1711, BASED ON EXPOSURE CONDITIONS AND PROXIMITY TO A SALTWATER SHORELINE AND NOT ALL THE ONES SHOWN HERE NECESSARILY APPLY.

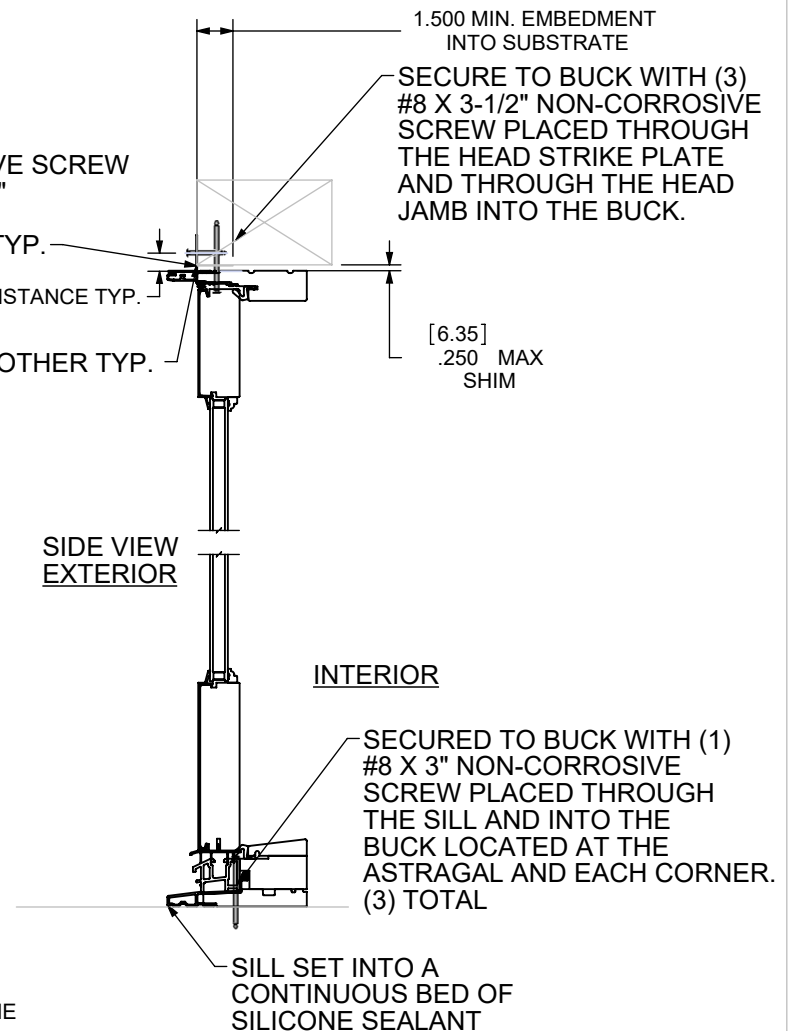

						TYP. WALL THICKNESS:	CUT STOCK SIZE:	8610 OUTSWING DOOR		
						AREA:	ECO OR W.S. #:	TITLE:		
						WT./FT.:				
						FILE PATH:			DWG. NO.	REV.
								85-2634-09		.1
REVISION	DATE	DESCRIPTION			WHITE SLIP NUMBER	ENG.	DO NOT SCALE DRAWING	DRAWN BY: JMK	DATE: 6/26/09	SCALE : 1/8 SHEET NAME: Sheet1 SHEET 1 OF 1