

DRUTEX S.A.
MB-79N SI BALCONY DOOR
(HVHZ)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- AAMA/WDMA/CSA 101/I.S.2/A440-17


ASTM E1886-19

ASTM E1996-20

TAS 201-94

TAS 202-94

TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
7. DOOR FRAME MATERIAL: ALUMINUM 6063-T5
8. GLASS MEETS THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

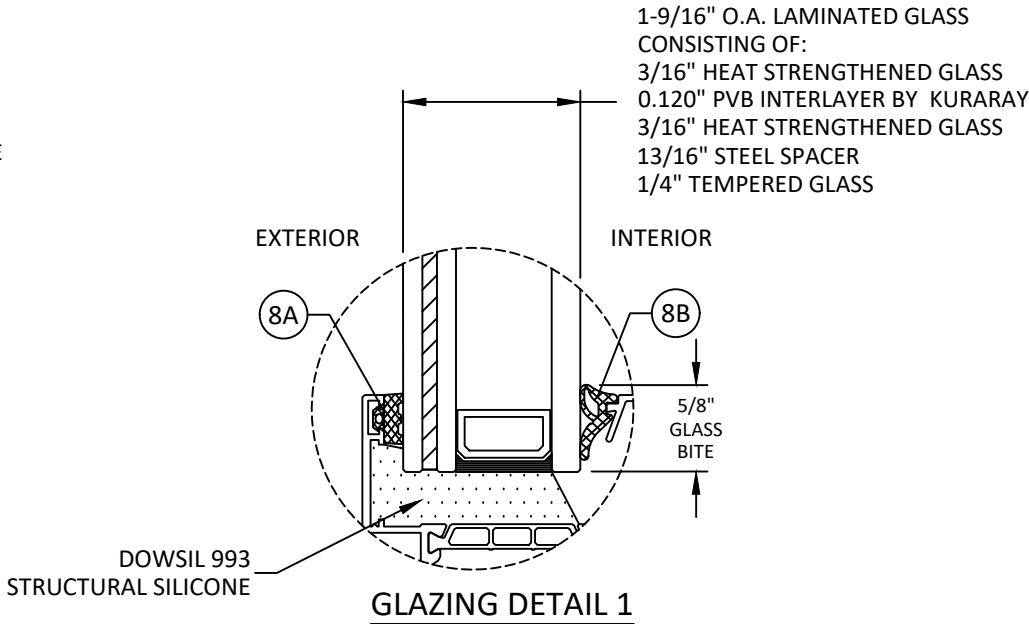

GLAZING NOTES:

1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.I.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAIL
2	ELEVATIONS & DESIGN PRESSURE TABLES
3	ANCHOR LAYOUTS
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	INSTALLATION NOTES & ANCHOR DETAILS
7	COMPONENTS & BILL OF MATERIALS

CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
X	SEE TABLES ON SHEETS 2 - 3			LARGE AND SMALL MISSILE IMPACT



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
MB-79N SI
BALCONY DOOR WINDOW
(HVHZ) (IMPACT)

GENERAL NOTES &
GLAZING DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738


WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.07 10:15:59 -0400'

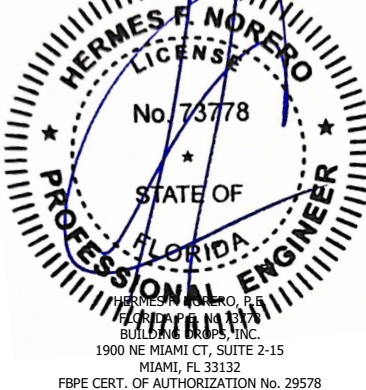

FL #:
FL46724

DATE: 03.19.24


DWG. BY: FB
CHK. BY: HFN

SCALE: NTS

DWG. #: DRU039

SHEET: 1
REV. A


c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 17111.dwg s\146724-r0\drut039.dwg 7/13/2026 10:58 AM

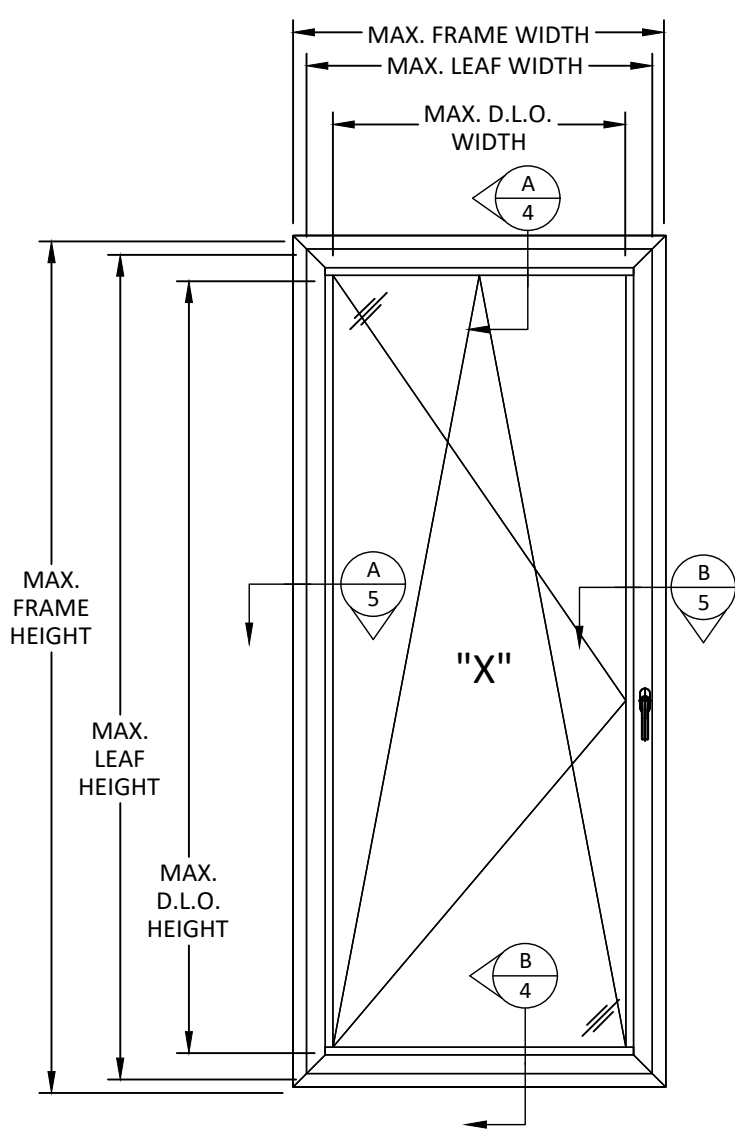

ELEVATIONS

LEAF HEIGHT = FRAME HEIGHT - 5.50"
LEAF WIDTH = FRAME WIDTH - 5.50"

D.L.O. HEIGHT = FRAME HEIGHT - 3.50"
D.L.O. WIDTH = FRAME WIDTH - 3.50"

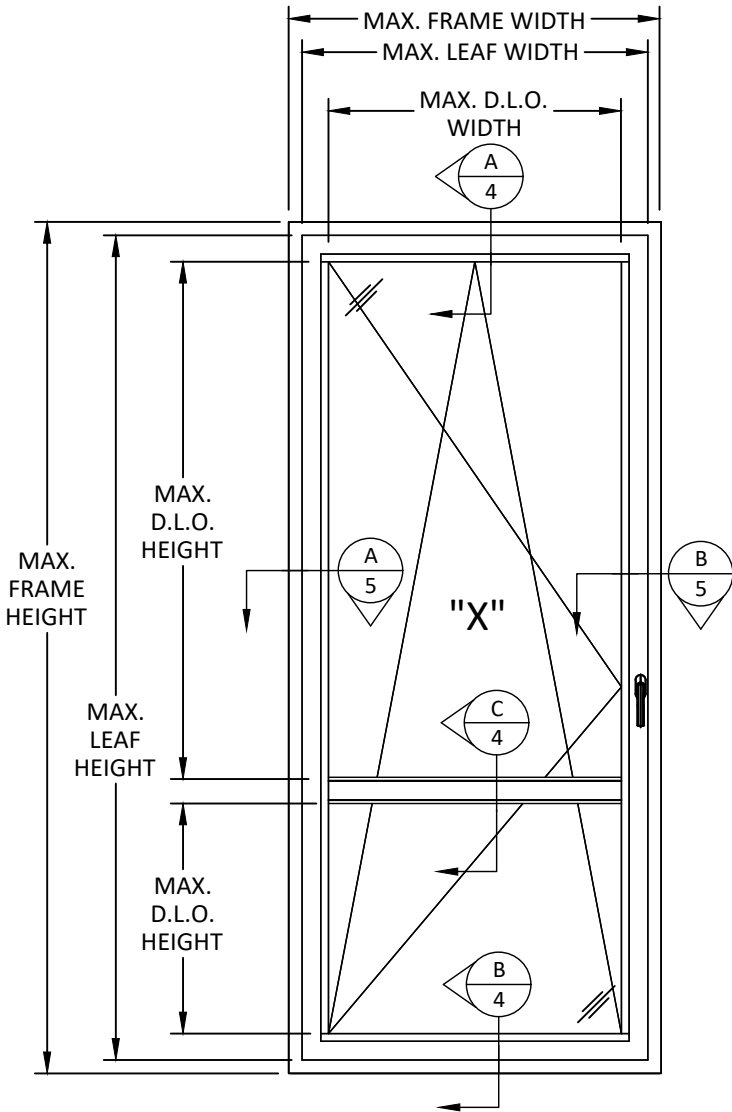

ELEVATIONS

MID-RAIL GLASS SIZES DESIGN
PRESSURE TABLE

DESIGN PRESSURE TABLE (PSF)		
NOMINAL DIMS.		POS.(+) NEG.(-)
D.L.O. HEIGHT (IN.)	D.L.O. WIDTH (IN.)	
56	24	70.0
56	30	70.0
56	36	70.0
58	42	70.0
52	48	70.0
48	54	70.0
42	60	70.0
42	66	70.0
38	72	70.0

FRAME DESIGN PRESSURE
TABLES

DESIGN PRESSURE TABLE (PSF)		
NOMINAL DIMS.		POS.(+) NEG.(-)
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	
24	72	70
30		70
36		70
41		70
48		60
54	78	53
24		70
30		70
36		70
41		70
48		60
24	84	70
30		70
36		70
41		70
24	90	70
30		70
36		70
41		70
48		60
24	96	70
30		70
36		70
41		70



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

MB-79N SI
BALCONY DOOR WINDOW
(HVHZ) (IMPACT)

ELEVATIONS &
DESIGN PRESSURE TABLES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL46724

DATE: **03.19.24**

DWG. BY: **FB** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **DRU039**


SHEET: **2** REV. **A**

OF 7

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg s\146724-r0\dru039.dwg 7/13/2026 10:58 AM

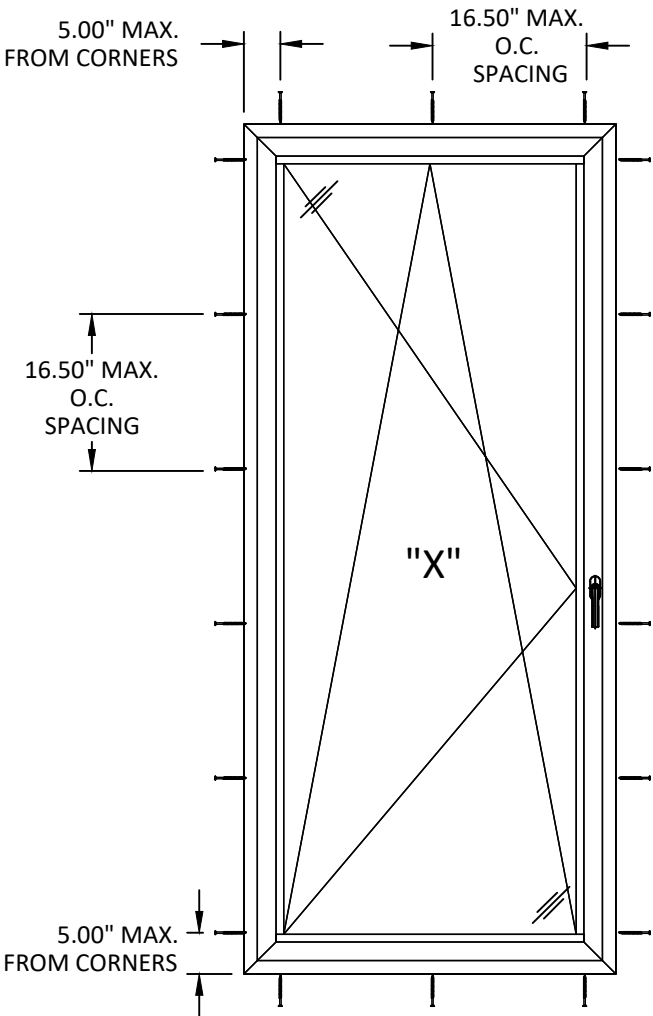

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

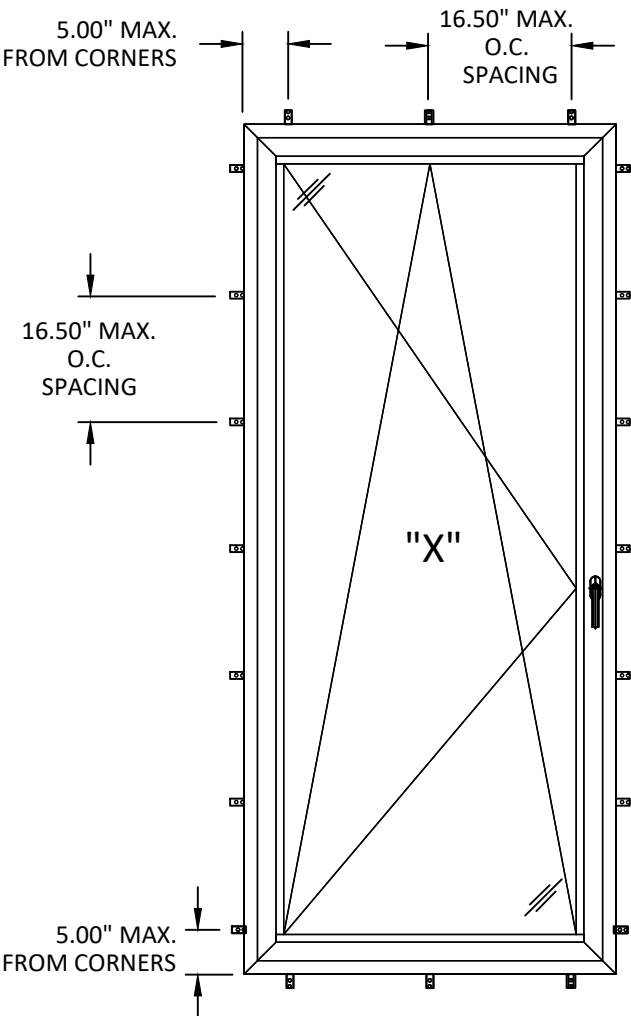

ANCHOR LAYOUT
STRAP INSTALLATION

NOTE: TWO (2) ANCHORS PER
STRAP.



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

MB-79N SI
BALCONY DOOR WINDOW
(HVHZ) (IMPACT)

ANCHOR LAYOUTS

TITLE:


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com


BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

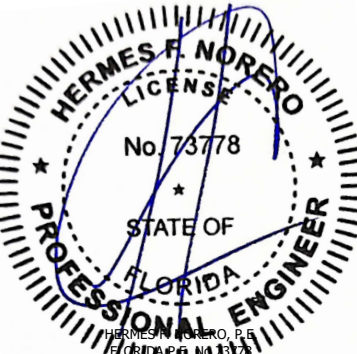

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL46724**

DATE: **03.19.24**

DWG. BY:
FB

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **DRU039**

SHEET:

REV.

3

A

OF 7



VERTICAL SECTIONS

PREPARED BY:



BUILDING DROPS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL46724**

DATE: 03.19.24

DWG. BY: FB	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: DRU039


SHEET:	REV.
1	A

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg (146724-0) dru039.dwg

7/13/2026 10:58 AM

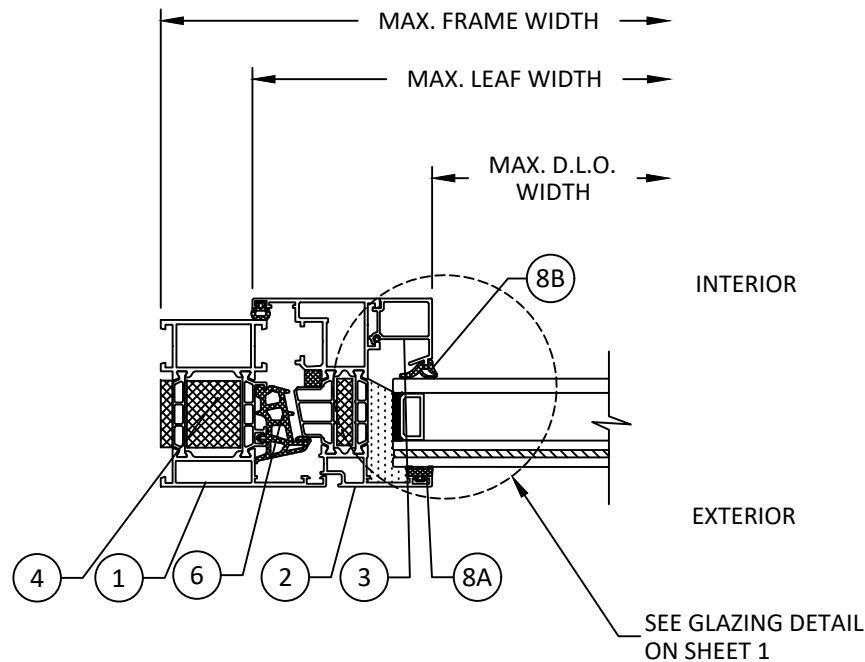

A
5
HORIZONTAL SECTION
TYP. JAMB DETAIL

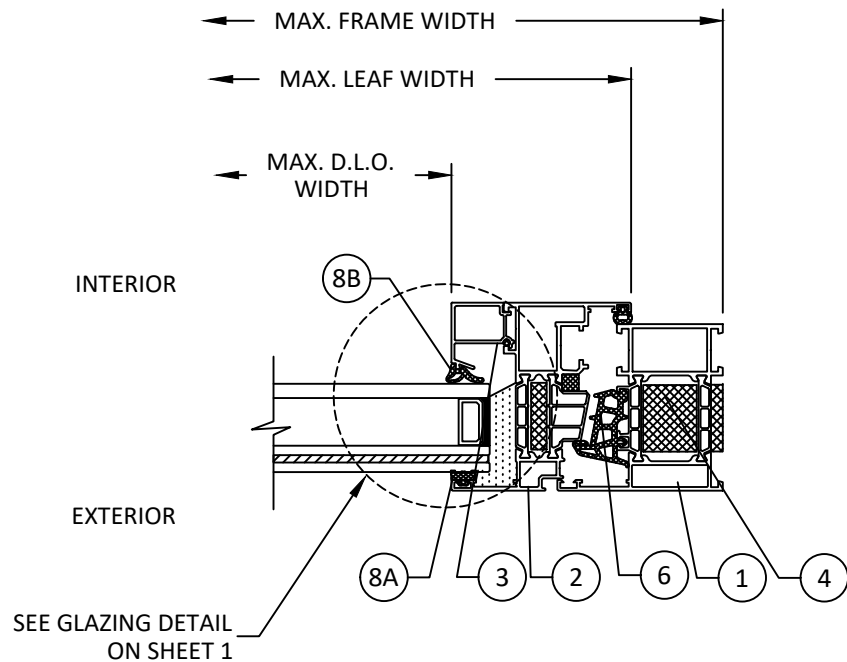

B
5
HORIZONTAL SECTION
TYP. JAMB DETAIL



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
MB-79N SI
BALCONY DOOR WINDOW
(HVBZ) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

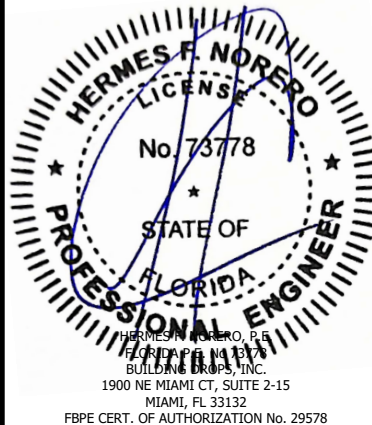


FL #:	FL46724
DATE:	03.19.24
DWG. BY:	FB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	DRU039
SHEET:	5
REV.	A

c:\users\lucianosanchez\building drops, inc\building drops landing - documents\common\projects\2026 code change projects\drutex, s.a\cc-26-0527.1 - 2026 code change - 1711.dwg s\146724-R0\dru039.dwg 7/13/2026 10:58 AM

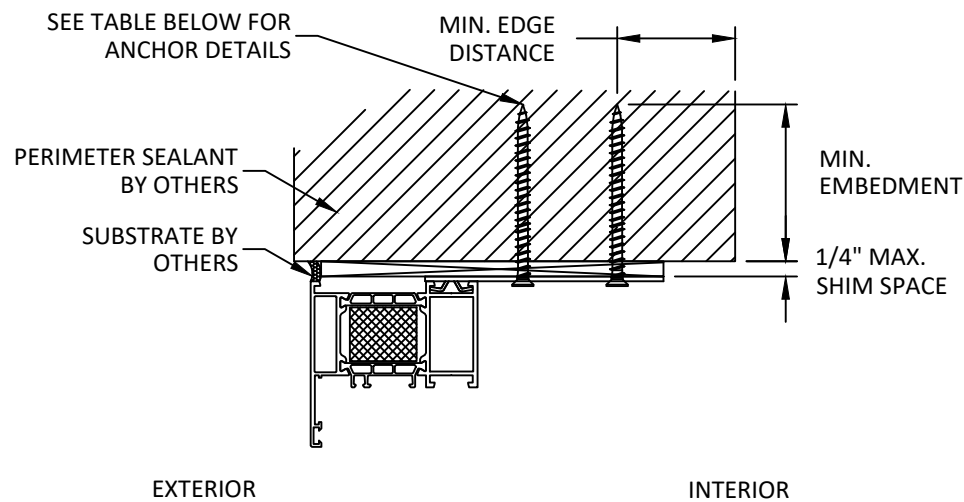

A
6
VERTICAL SECTION
THROUGH STRAP INSTALLATION

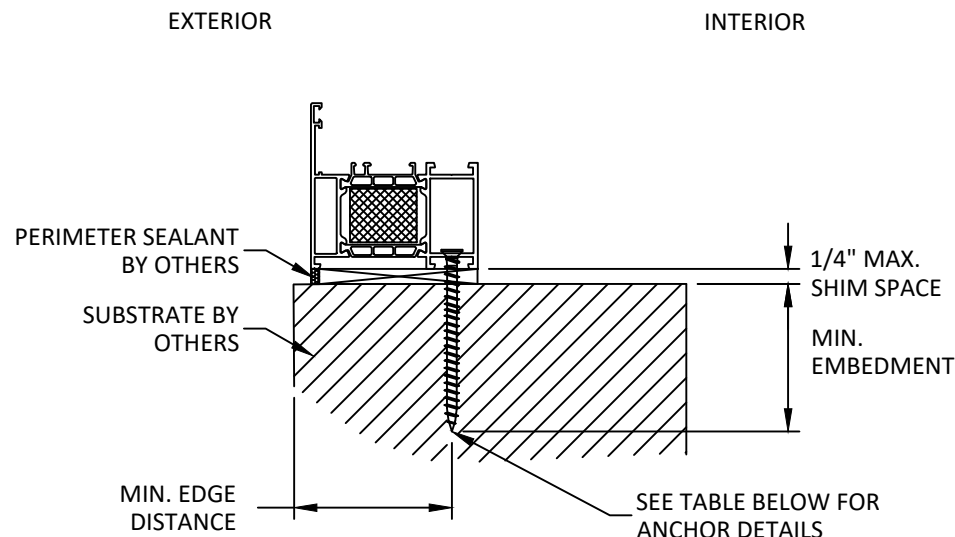

B
6
VERTICAL SECTION
THROUGH FRAME INSTALLATION

INSTALLATION NOTES:

NOTE : SILL & JAMB SIMILAR

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 3.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

NOTE : HEAD & JAMB SIMILAR

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
STRAP	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"
	METAL : 18 GA. STEEL MIN. Fy = 33 KSI ALUMINUM 1/8" MIN., 6063-T5	#8 SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"
	CONCRETE: f'c = 3000 PSI	3/16" ITW TAPCON	1.25"	2.00"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.00"	2.00"
THROUGH FRAME	WOOD: MIN. SG = 0.55	#12 WOOD SCREW	1.50"	0.75"
	METAL : 18 GA. STEEL MIN. Fy = 33 KSI ALUMINUM 1/8" MIN., 6063-T5	#12 SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"
	CONCRETE: f'c = 3000 PSI	3/16" ITW TAPCON	1.25"	2.00"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.00"	2.00"



LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

TITLE:
MB-79N SI
BALCONY DOOR WINDOW
(HVHZ) (IMPACT)

ANCHOR DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

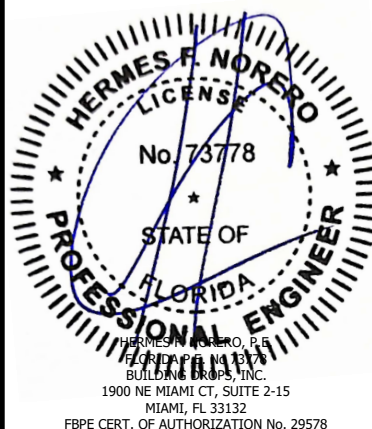

FL #:	FL46724	
DATE:	03.19.24	
DWG. BY:	FB	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	DRU039	
SHEET:	6	REV. A
OF 7		

BILL OF MATERIALS			
ITEM	PART NO.	DESCRIPTION	MATERIAL
1	K520012	FRAME	6063-T5
2	K520112	LEAF	6063-T5
3	K431624	GLAZING BEAD	6063-T5
4	-	THERMAL MATERIAL	POLYETHYLENE
5	-	GASKET	EPDM
6	8G000020	CENTRAL GASKET	EPDM
7	-	MID-RAIL	6063-T5
8A	120518	GASKET	EPDM
8B	120540	GASKET	EPDM
9	803011040	STRAP	STEEL

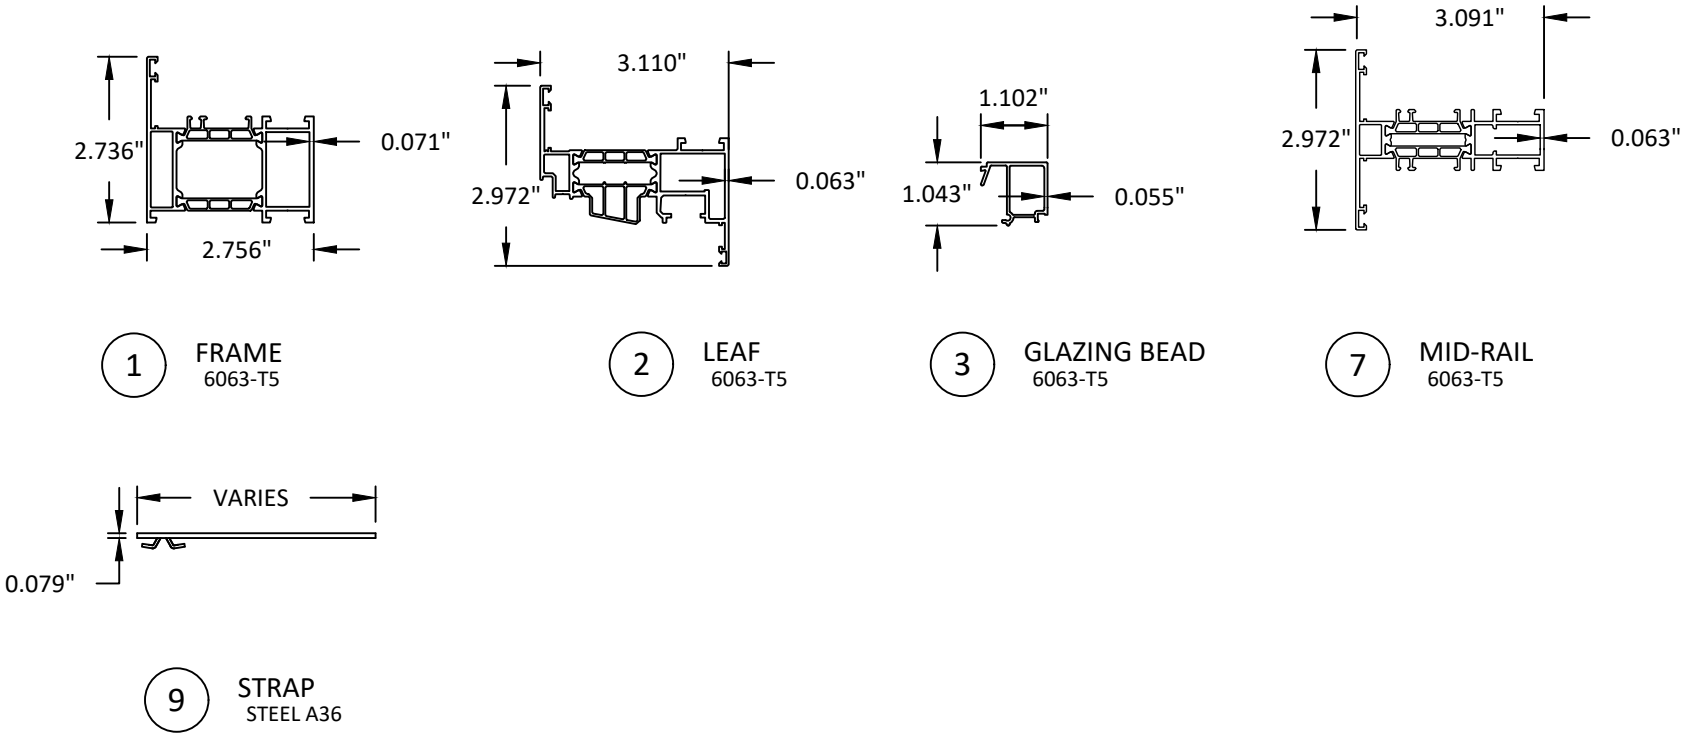

LESZKA GIERSEWSKIEGO 1, 77-100
BYTOW, POLAND
PH: +48-59-822-9101 FX: +48-59-822-9103

MB-79N SI
BALCONY DOOR WINDOW
(HVHZ) (IMPACT)

COMPONENTS & BILL OF MATERIALS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL46724**

DATE: **03.19.24**

DWG. BY: FB	CHK. BY: HFN
--------------------	---------------------

SCALE: **NTS**

DWG. #: **DRU039**

SHEET: 7	REV. A
-----------------	---------------

OF 7