


PRIMARY ANCHOR (TO SUBSTRATE CONDITION)								"BACK" ANCHOR (TRIM TO FRAME)				
SUBSTRATE	LOCATION	HARDWARE (ACCEPTABLE TRADE NAME OR EQUIVALENT)	O.C. SPACING (MAX)	END DISTANCE (MAX)	EMBEDMENT (MIN)	SUBSTRATE EDGE DISTANCE (MIN)	d1 INSTALL DIMENSION (MIN)	HARDWARE (ACCEPTABLE TRADE NAME OR EQUIVALENT)	O.C. SPACING (MAX)	END DISTANCE (MAX)	EMBEDMENT (MIN)	d2 FRAME EDGE DISTANCE (MAX)
WOOD SG = 0.42	HEAD	1/4" Ø LAG SCREW, FULL BODY	14"	4"	1-1/2"	1"	3/4"	#10-16 OR #10-24 S.S. CONDITION CW OR SAE GR. 5 STEEL PAN HEAD SCREW	16"	4"	3 THREADS	9/16"
	SILL		14"									
	JAMB		8"									
CONCRETE 3,000 PSI	HEAD	1/4" Ø HILTI KWIK HUS-EZ (CS)	18"	4"	2-1/2"	1-3/4"	3/4"	#10-16 OR #10-24 S.S. CONDITION CW OR SAE GR. 5 STEEL PAN HEAD SCREW	16"	4"	3 THREADS	9/16"
	SILL		18"									
	JAMB		14"									
CONCRETE 4,000 PSI	HEAD	1/4" Ø HILTI KWIK HUS-EZ (CS)	22"	4"	2-1/2"	1-3/4"	3/4"	#10-16 OR #10-24 S.S. CONDITION CW OR SAE GR. 5 STEEL PAN HEAD SCREW	16"	4"	3 THREADS	9/16"
	SILL		22"									
	JAMB		16"									
CMU (GROUT FILLED) f'm = 1,500 PSI	HEAD	1/4" Ø HILTI KWIK HUS-EZ (CS)	14"	4"	2-1/2"	1-1/2"	3/4"	#10-16 OR #10-24 S.S. CONDITION CW OR SAE GR. 5 STEEL PAN HEAD SCREW	16"	4"	3 THREADS	9/16"
	SILL		9"									
	JAMB		8"									
STEEL STUD (18 ga. 33ksi)	HEAD	1/4"-14 SAE GR. 5 HILTI KWIK FLEX OR DEWALT DRILL-FLEX	14"	4"	3 THREADS	1" C. 16"	3/4"	#10-16 OR #10-24 S.S. CONDITION CW OR SAE GR. 5 STEEL PAN HEAD SCREW	16"	4"	3 THREADS	9/16"
	SILL		14"									
	JAMB		8"									

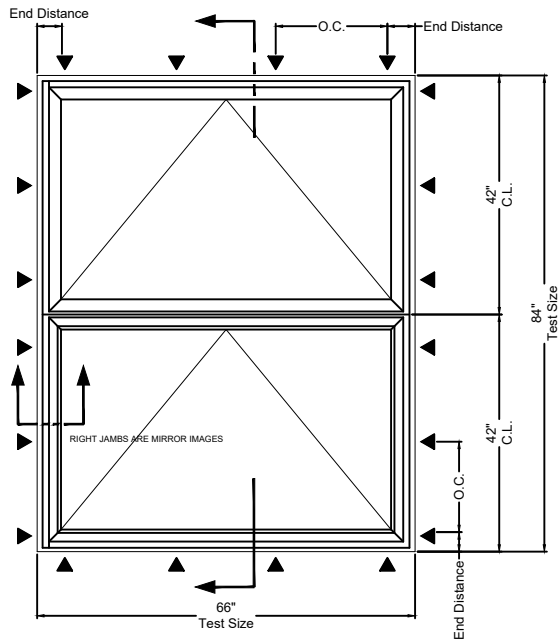

- Installations depicted comply with:
Florida Building Code - 8th Ed. (FBC 2023)
International Building Code (IBC 2021)
National Design Specifications (ANSI/AWC NDS 2018)
Aluminum Design Manual (ADM 2020)
Cold-Formed Steel Design Manual (AISI-S100 2020)

- The installation depicted in this drawing and all calculations are based on a maximum size and design wind pressure rating listed below. The products have been proven for resistance to wind-borne debris per ASTM E1886 and ASTM E1996.

Test size: **66" x 84"** Awning Test Size: **66" x 42"** Design pressure: **+/- 80 psf**

- Lag screws shall be used for a wood substrate. Screw materials and dimensions shall meet the requirements of ANSI / ASME Standard B18.2.1. All lag screw conditions must be pre-drilled with hole diameters of 40-70% of the fastener diameter. Wood buck installations are assumed to use 2 X S-P-F (G= 0.42) or denser. Tapered or partial bucks are not allowed.

- Approved screw anchors shall be used for concrete substrate. Anchor embedment shall be as indicated herein. Install per ESR-3027 requirements. Concrete installations are assumed to be at least f_c = 3,000 (or 4,000) psi, normal weight concrete.

- Approved screw anchors shall be used for CMU substrate. Anchor materials and dimensions shall meet the requirements of ICC-ES AC106 - Acceptance Criteria for Predrilled Fasteners (Screw Anchors) in masonry elements. Anchor embedment shall be as indicated herein. Install per ESR-3056 requirements. Concrete masonry installations are assumed at least ASTM C90, Type II, Grade N, with f_m = 1,500 psi, and type M or S mortar.

- Approved self-drilling screws shall be used for steel stud substrate. Screw materials and dimensions shall meet the requirements of SAE Grade 5 Carbon Steel. Steel stud installations assume 18 gauge, 33 ksi studs and follow AISI-S100 rules and procedures.





- Maximum shim thickness of 1/4" permitted at each fastener location. Shims shall be non-compressible and load-bearing type.

- Drawings depict details necessary to meet structural load requirements, but do not address air infiltration, water penetration, intrusion or thermal performance requirements of the installation. See manufacturer's Installation Instructions for sealing, flashing, drainage and other requirements.






- Minimum fastener on center spacing to be coordinated with fastener manufacturer's technical data for the expected substrate.

- All substrate types shall be secured to the building structure to resist all design loads, and shall have widths that exceed the window frame widths.






- Only the 1150S Series is shown in the various sections for convenience. Anchorage requirements apply equally to 1150 Series.

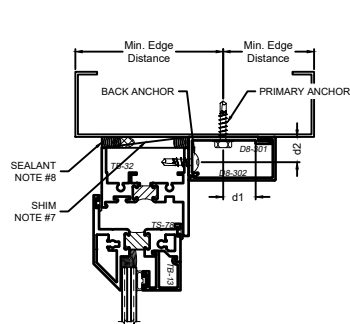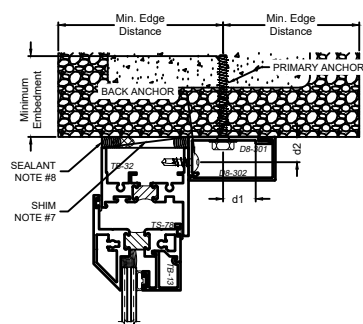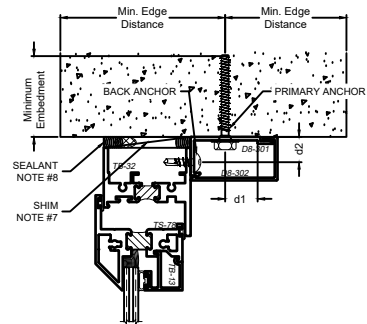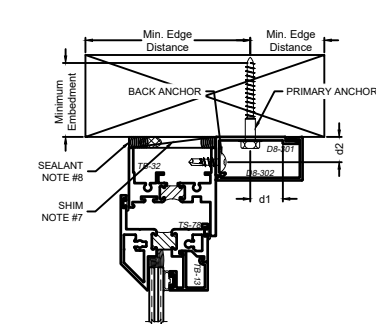

HEAD

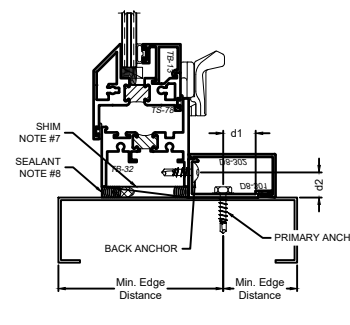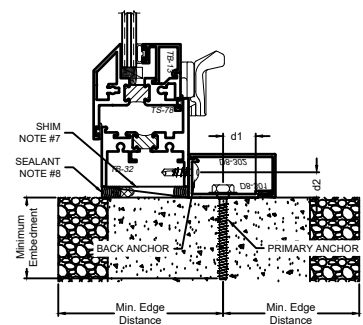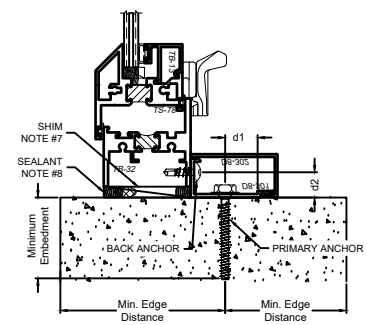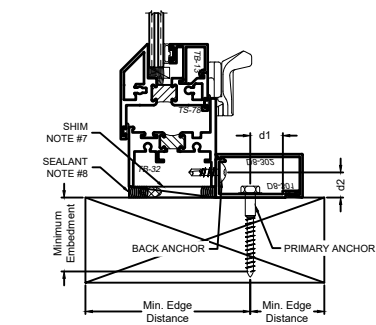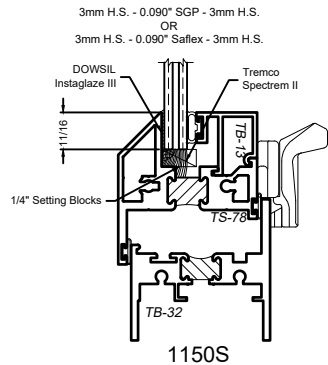

SILL

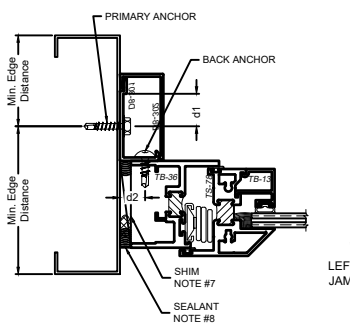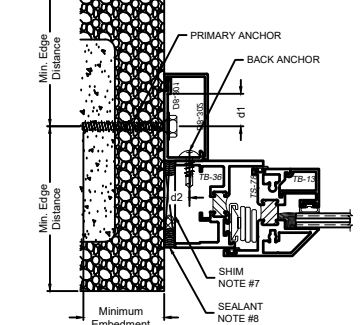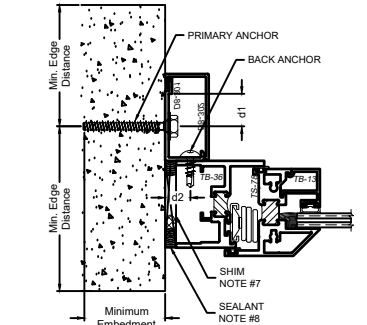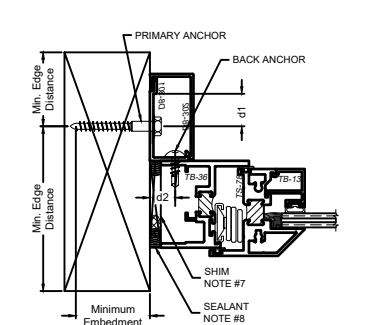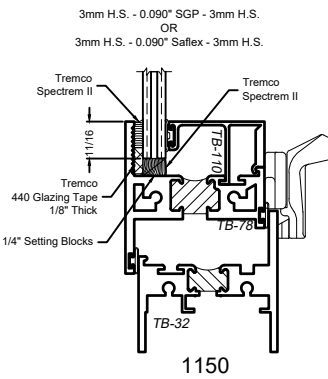

RICE
ENGINEERING

105 School Creek Trail
Luxemburg, WI 54217
Phone: (920) 617-1042
Fax: (920) 617-1100
www.rice-inc.com


Florida Firm No: F-01000005061
Certificate of Authorization: #9090
Wayne K. Helmila
Registration No: 59092

JAMBS

LEFT JAMBS SHOWN, RIGHT
JAMBS ARE MIRROR IMAGES.

Wayne K Helmila

Digitally signed by Wayne K Helmila
DN: CN=Wayne K Helmila,
dnQualifier=A01410C0000018CDB8F4AFB001A652B,
O=Wisconsin, C=US
Date: 2024.05.17 07:31:12-0500

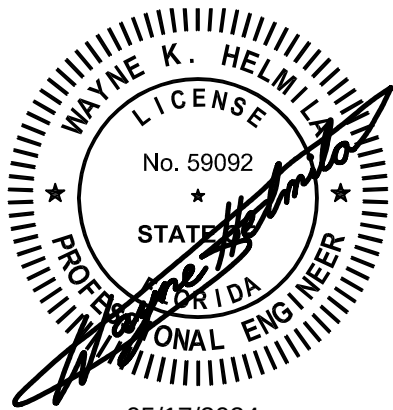

05/17/2024
COA: 9090

Rev.	Description	Date
△		
△		
△		
△		
△		

Scale:	Drawn by:
NONE	B. FOOTE
Winco Window Co. 6200 Maple Ave. St. Louis, MO 63130	
PHONE: 314-725-8088	
WINCO Product: 1150-1150S MONO AWNING	
Installation: ANCHORAGE: SNAP TRIM	
Certification: LMI - MONO - 1150-1150S AWNING	