

WINTECH - WINDOW TECHNOLOGY, INC.


RIDGEVIEW HORIZONTAL SLIDER VINYL WINDOW (NON-HVHZ) (NON-IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM IS REQUIRED TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: uPVC.
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
 - X: OPERABLE SASH
 - O: FIXED LITE
- CUSTOM SIZES AVAILABLE UPON REQUEST.

TABLE OF CONTENTS	
SHEET	SECTION DESCRIPTION
1	GENERAL NOTES & GLAZING DETAILS
2	ELEVATION, DESIGN PRESSURE TABLE, ANCHOR LAYOUTS & SCHEDULE
3	VERTICAL SECTIONS
4	HORIZONTAL SECTIONS
5	ANCHOR DETAILS & INSTALLATION NOTES
6	COMPONENTS

DESIGN PRESSURE TABLE			
SERIES	SIZE	CONFIGURATION	DESIGN PRESSURE
RIDGEVIEW	SEE SHEET 2	X O	SEE SHEET 2

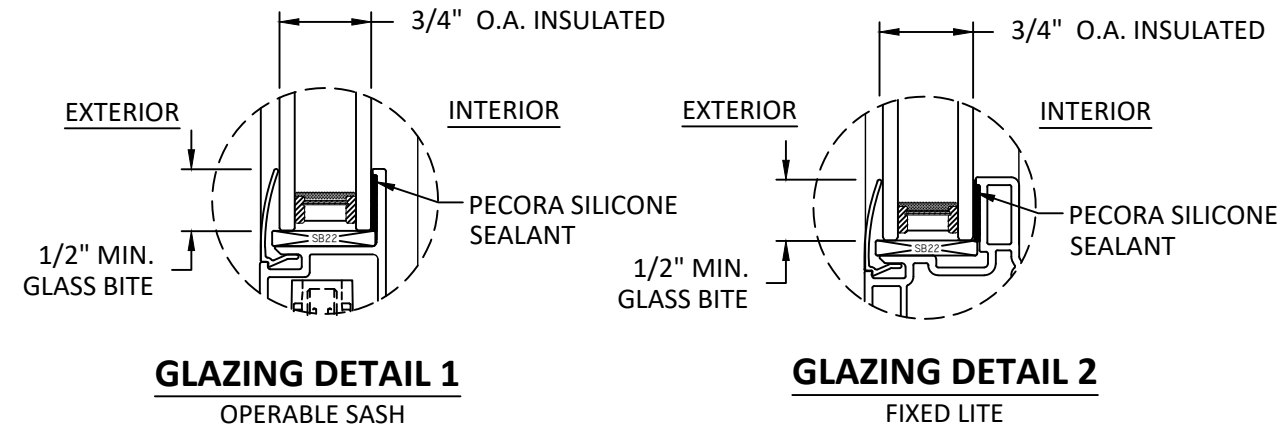

GLAZING NOTES:

- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.

WINTECH

WINDOW TECHNOLOGY, INC.

201 INDUSTRIAL DRIVE
MONETT, MO 65708 WWW.WINTECHINC.COM

PH: (417) 235-7821 FX: (417) 737-7140

TITLE: RIDGEVIEW HORIZONTAL
SLIDER VINYL WINDOW
(NON-HVHZ) (NON-IMPACT)
GENERAL NOTES &
GLAZING DETAILS


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2024.06.18 12:15:10 -0400

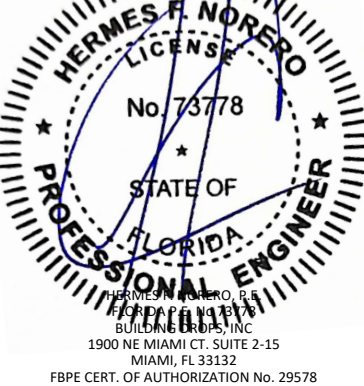

FL #:	FL46858
DATE:	05.14.2024
DWG. BY:	FB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	WNT015
SHEET:	1
	OF 6

c:\users\franciscobrite\building drops, inc\building drops landing - common\projects\wintech\bc-24-0417 - fbc submittal - ridgeview series window products\dwgs\horizontal sliding window\wnt015-2.dwg
6/24/2024 4:33 PM

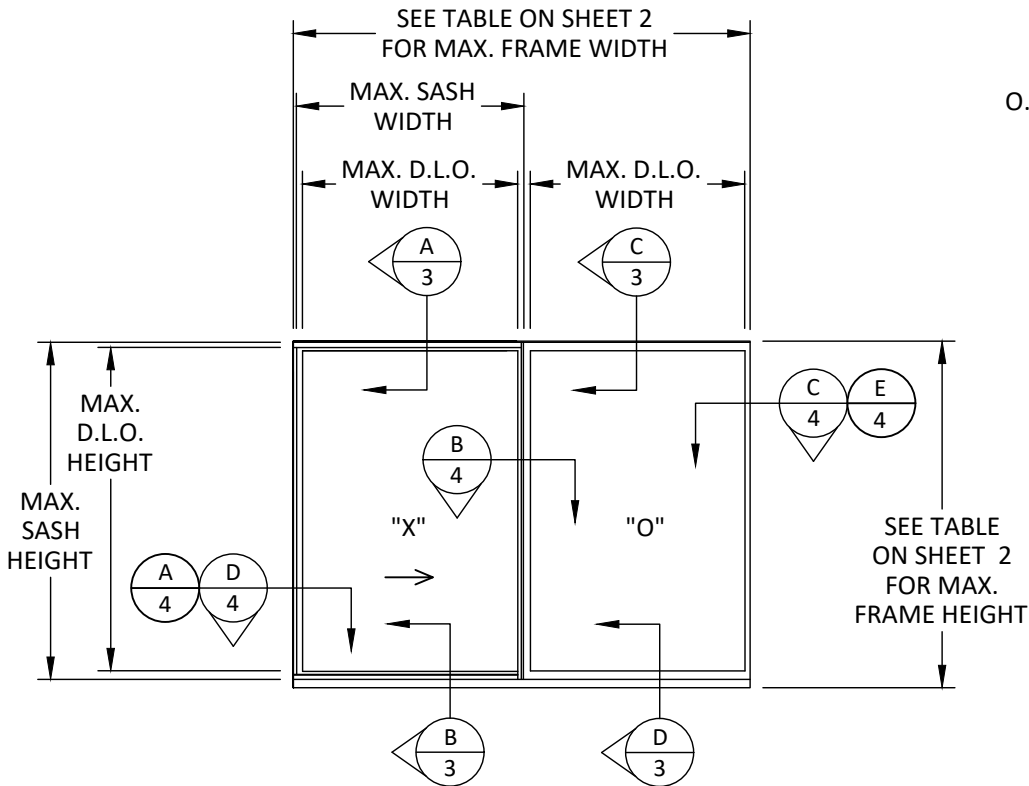


ELEVATION AS TESTED


OPERABLE SASH:
D.L.O. SIZE:
D.L.O. WIDTH = (FRAME WIDTH/2) - 3-3/8"
D.L.O. HEIGHT = FRAME HEIGHT - 5-1/2"

SASH SIZE:
SASH WIDTH = (FRAME WIDTH/2) - 1/2"
SASH HEIGHT = FRAME HEIGHT - 2-1/2"

FIXED LITE:
D.L.O. SIZE:
D.L.O. WIDTH = (FRAME WIDTH/2) - 2-3/4"
D.L.O. HEIGHT = FRAME HEIGHT - 3"

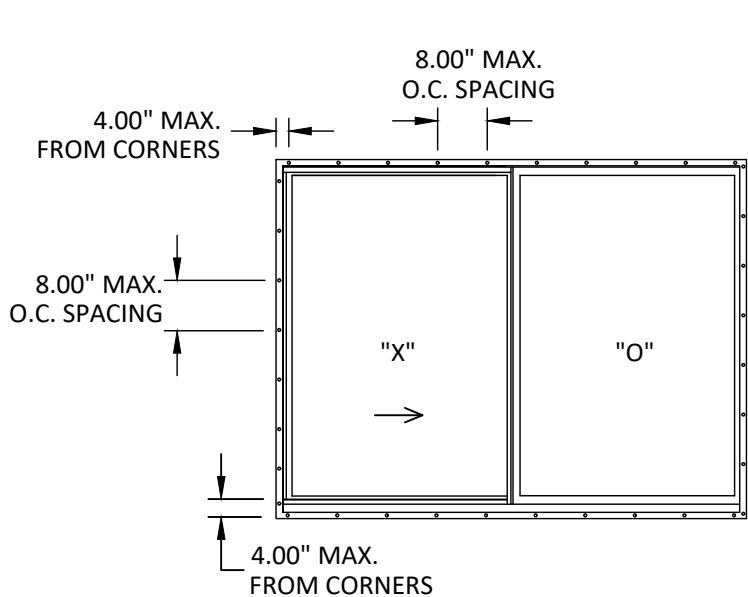

ANCHOR LAYOUT NAIL FIN INSTALLATION

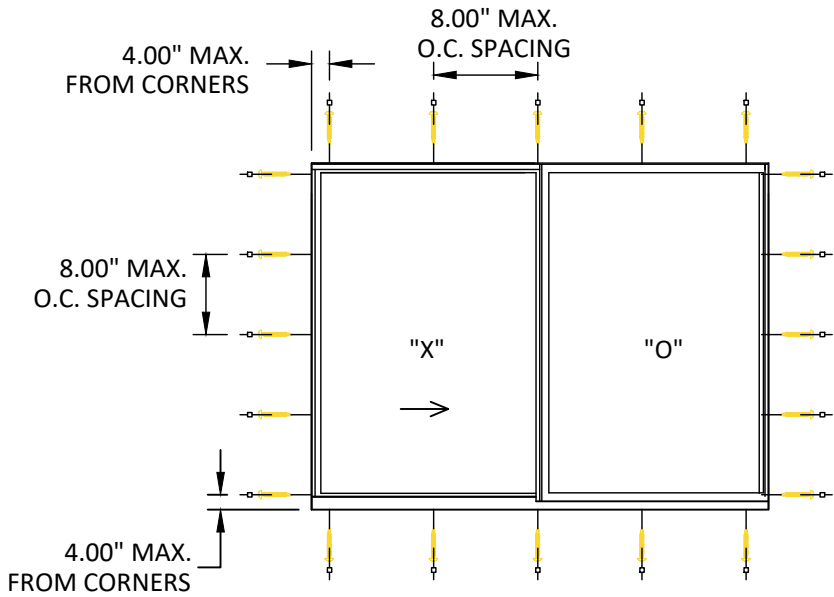

ANCHOR LAYOUT THROUGH FRAME INSTALLATION

DESIGN PRESSUTE TABLE (PSF)									
FRAME WIDTH (IN.)									
FRAME HEIGHT (IN.)		48	54	60	66	71	78	84	90
	24	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	30	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	36	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	42	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	48	30.0	30.0	30.0	30.0	30.0	30.0	-	-
	56	30.0	30.0	30.0	30.0	30.0	-	-	-
	60	30.0	30.0	28.9	26.3	-	-	-	-
	66	27.2	24.2	21.7	-	-	-	-	-

ANCHOR SCHEDULE - RIDGEVIEW FIXED VINYL WINDOW				
INST. METHOD	ANCHOR TYPE	SUBSTRATE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
NAIL FIN (FRAMES V100, V101, V152)	#8 WOOD SCREW	WOOD(S.G.=0.55)	1.25"	0.75"
	#8 GRADE 5SELF- DRILLING SCREWS	MIN. 18 GA. STEEL (33KSI) / ALUMINUM: 1/8" MIN. 6063-T5	THREE (3) THREADS MIN. PENETRATION BEYOND METAL FACE	0.50"
THROUGH FRAME (FRAME V142)	#8 WOOD SCREW	WOOD(S.G.=0.55)	1.25"	0.75"
	3/16" ITW TAPCON SCREW	CONCRETE: f'c=3000 PSI, MASONRY: CMU per ASTM C90 MIN. 2000 PSI	1.00"	2.00"
	#8 GRADE 5SELF- DRILLING SCREWS	MIN. 18 GA. STEEL (33KSI) / ALUMINUM: 1/8" MIN. 6063-T5	THREE (3) THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"

WINTech

WINDOW TECHNOLOGY, INC.

201 INDUSTRIAL DRIVE
MONETT, MO 65708 WWW.WINTECHINC.COM

PH: (417) 235-7821 FX: (417) 737-7140

TITLE: RIDGEVIEW HORIZONTAL
SLIDER VINYL WINDOW
(NON-HVHZ) (NON-IMPACT)

ELEVATION, DESIGN PRESSURE TABLE,
ANCHOR LAYOUTS & SCHEDULE

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-8478

FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:

FL46858

DATE: **05.14.2024**

DWG. BY:
FB

CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **WNT015**

SHEET:


2

OF 6


SIMILAR INSTALLATION ANCHORS AND DETAILS ARE USED PER FRAME TYPE, SEE SHEET 5 FOR INSTALLATION DETAILS.

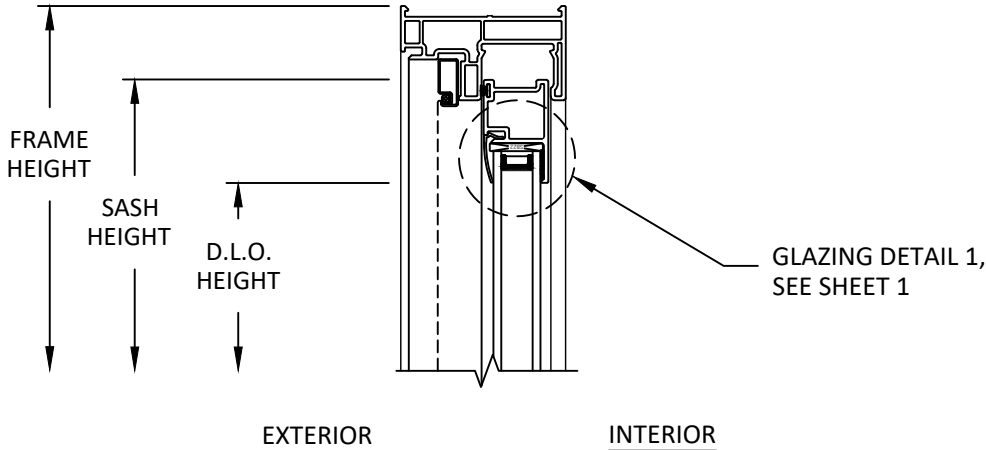


A
3 VERTICAL SECTION
V142 FRAME - OP HEAD

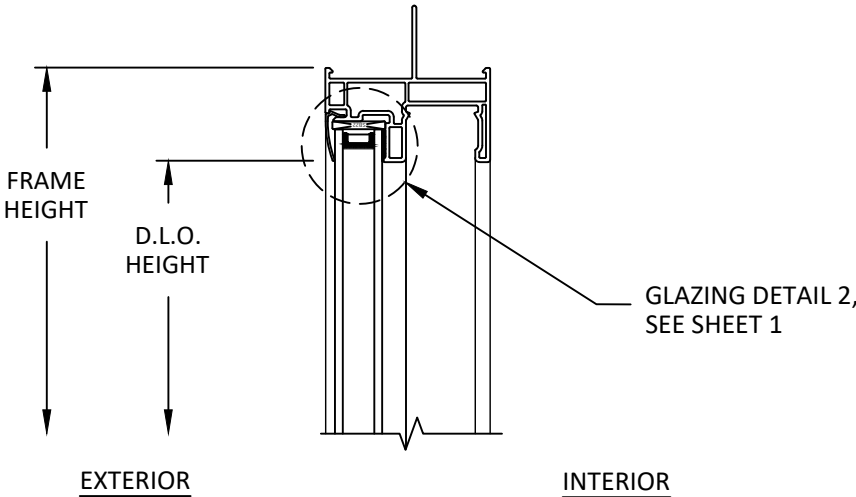

C
3 VERTICAL SECTION
V100 FRAME - FX HEAD

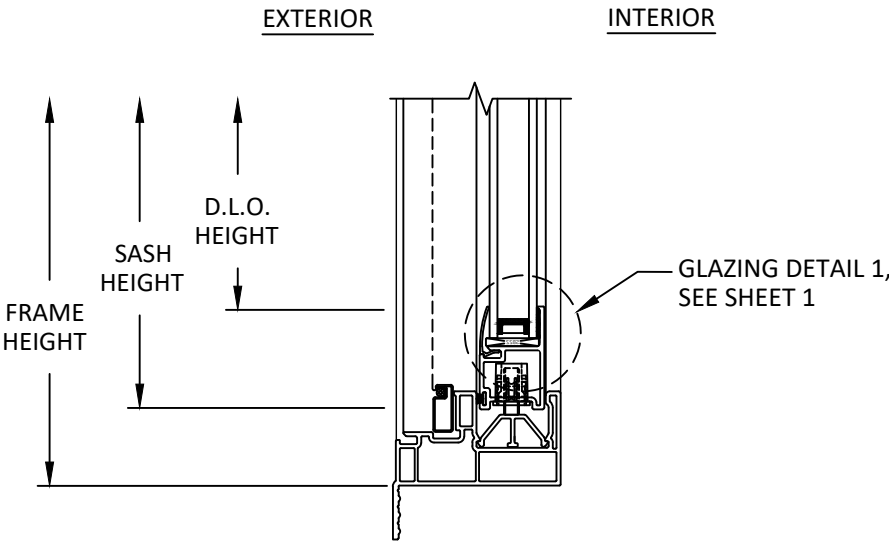

B
3 VERTICAL SECTION
V101 FRAME - OP SILL

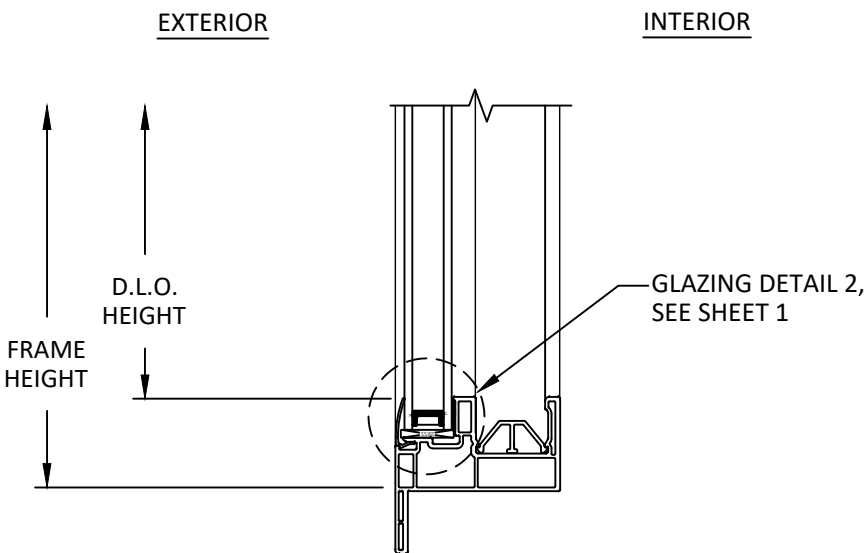

D
3 VERTICAL SECTION
V152 FRAME - FX SILL

WINTech

WINDOW TECHNOLOGY, INC.

201 INDUSTRIAL DRIVE
MONETT, MO 65708 WWW.WINTECHINC.COM

PH: (417) 235-7821 FX: (417) 737-7140

TITLE: RIDGEVIEW HORIZONTAL
SLIDER VINYL WINDOW
(NON-HVHZ) (NON-IMPACT)

VERTICAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

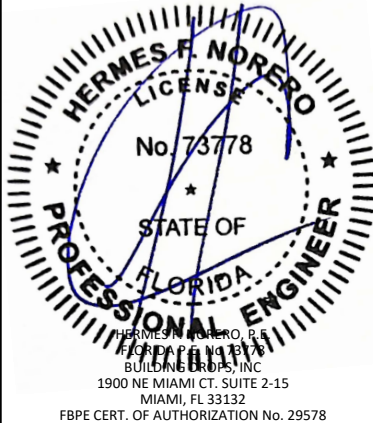

FL #: **FL46858**

DATE: **05.14.2024**

DWG. BY: **FB** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **WNT015**

SHEET:


3

OF 6


SIMILAR INSTALLATION ANCHORS AND DETAILS ARE USED PER FRAME TYPE, SEE SHEET 5 FOR INSTALLATION DETAILS.

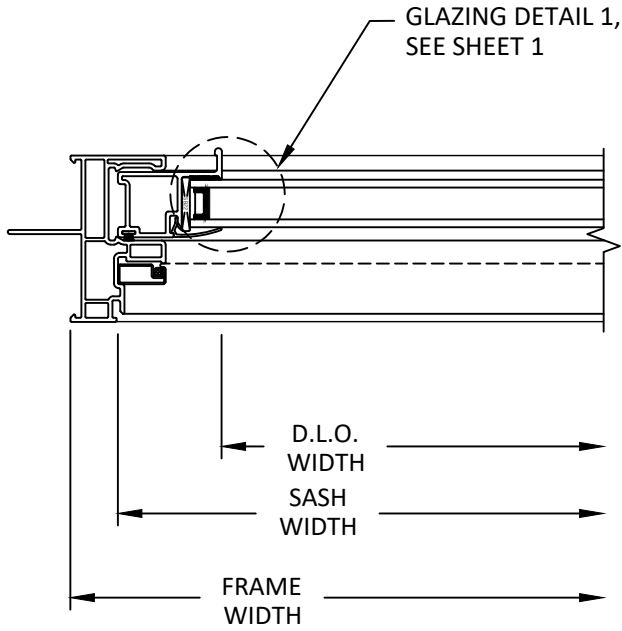


A
4 **HORIZONTAL SECTION**
V100 FRAME - OP JAMB
NAIL FIN INSTALLATION

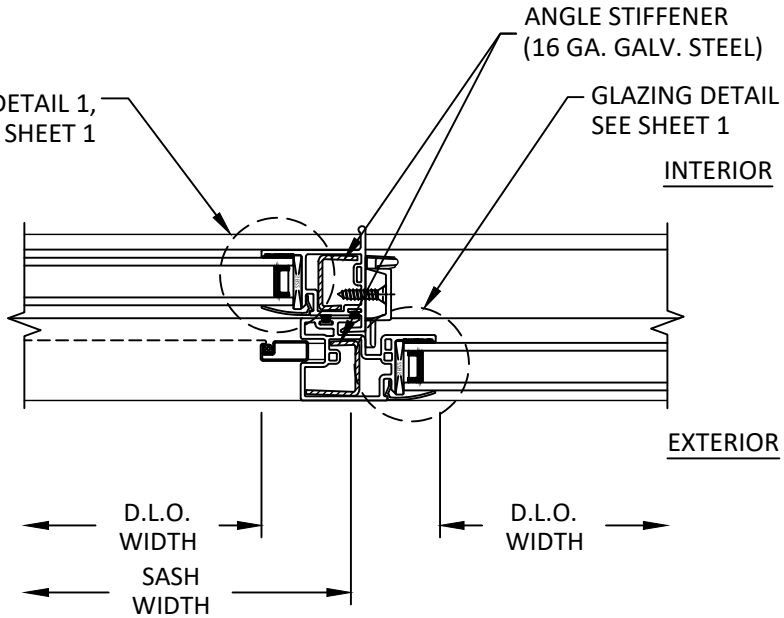


B
4 **HORIZONTAL SECTION**
INTERLOCK

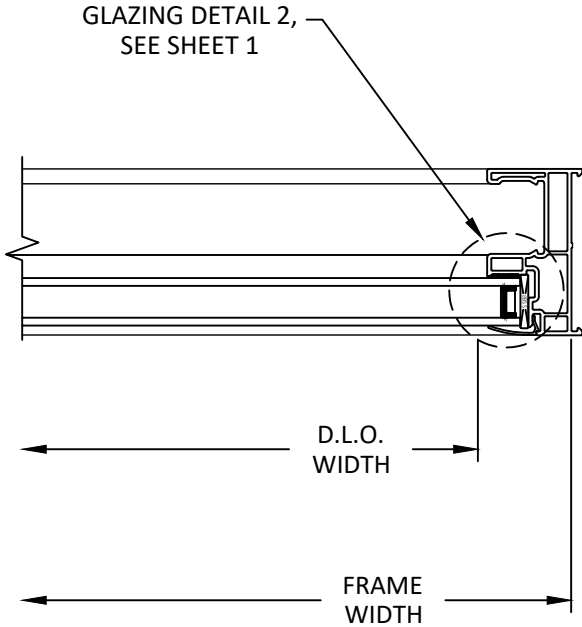

C
4 **HORIZONTAL SECTION**
V142 FRAME - FX JAMB

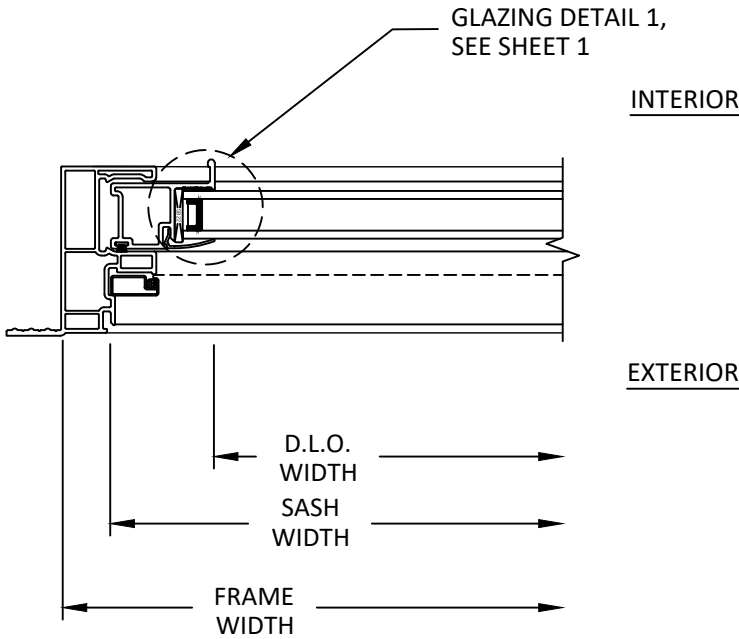

D
4 **HORIZONTAL SECTION**
V101 FRAME - OP JAMB

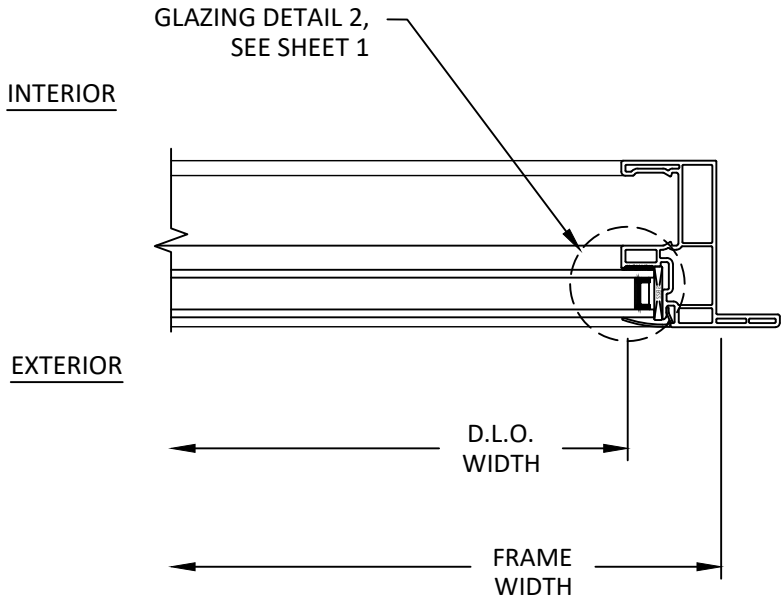

E
4 **HORIZONTAL SECTION**
V152 FRAME - FX JAMB

WINTech

WINDOW TECHNOLOGY, INC.

201 INDUSTRIAL DRIVE
MONETT, MO 65708 WWW.WINTECHINC.COM

PH: (417) 235-7821 FX: (417) 737-7140

TITLE: RIDGEVIEW HORIZONTAL
SLIDER VINYL WINDOW
(NON-HVHZ) (NON-IMPACT)
HORIZONTAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

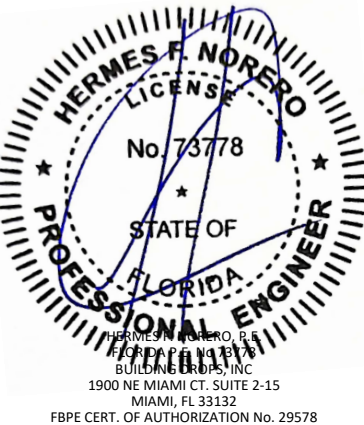

FL #: **FL46858**

DATE: **05.14.2024**

DWG. BY: **FB** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **WNT015**

SHEET:


4

OF 6


ANCHOR DETAILS AND INSTALLATION ARE SIMILAR FOR ALL FIN TYP. FRAMES (V100/ V152/ V101). THROUGH FRAME (V142) INSTALLATION AT SILL SHOWN, JAMB AND HEAD INSTILLATION IS SIMILAR.

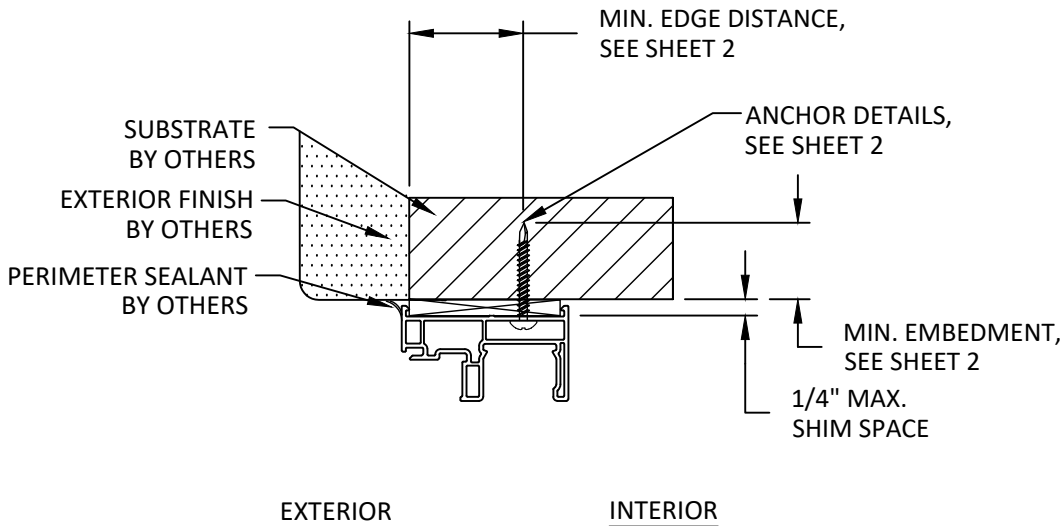

A
5 **VERTICAL SECTION**
V142 FRAME
THROUGH FRAME INSTALLATION

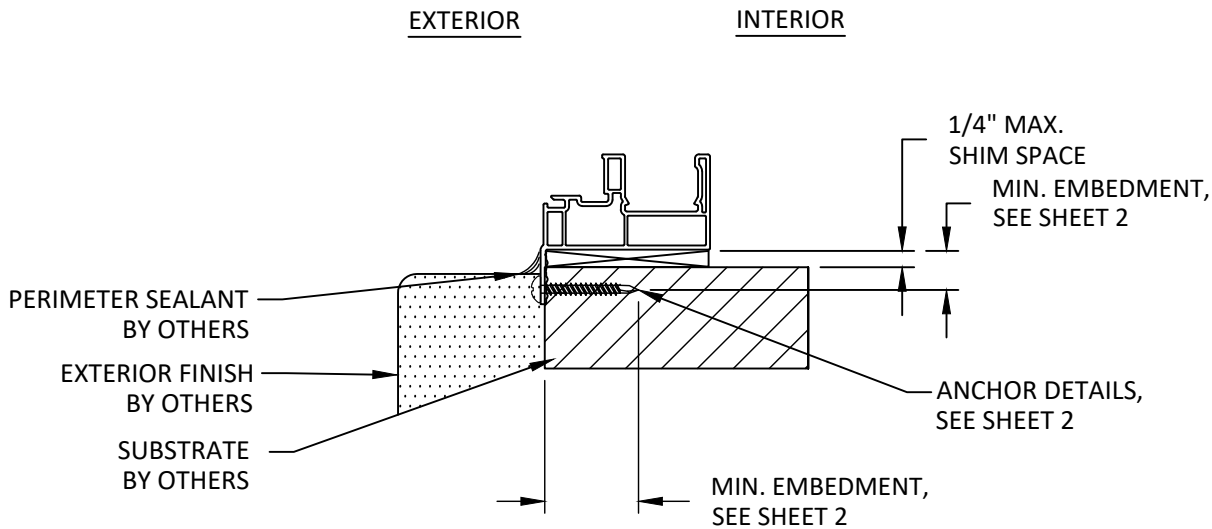

B
5 **VERTICAL SECTION**
V101 FRAME
NAIL FIN INSTALLATION

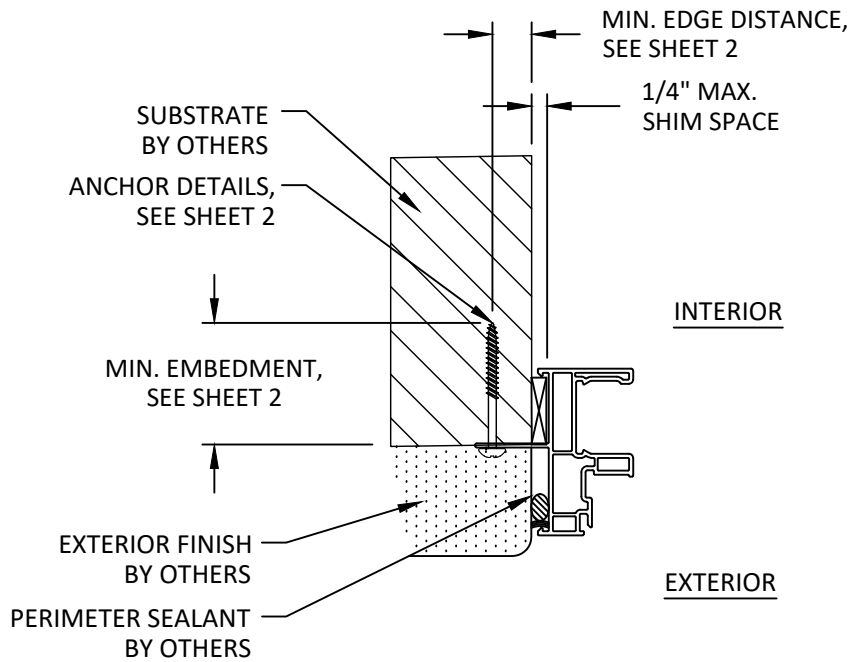

C
5 **HORIZONTAL SECTION**
V100 FRAME
NAIL FIN INSTALLATION

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO SHEATHING, STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 43 MILS. (18 GAUGE)
 - ALUMINUM - 1/8" MINIMUM THICKNESS (6063-T5).

WINTech

WINDOW TECHNOLOGY, INC.

201 INDUSTRIAL DRIVE
MONETT, MO 65708 WWW.WINTECHINC.COM

PH: (417) 235-7821 FX: (417) 737-7140

TITLE: RIDGEVIEW HORIZONTAL
SLIDER VINYL WINDOW
(NON-HVHZ) (NON-IMPACT)
ANCHOR DETAILS &
INSTALLATION NOTES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15

MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

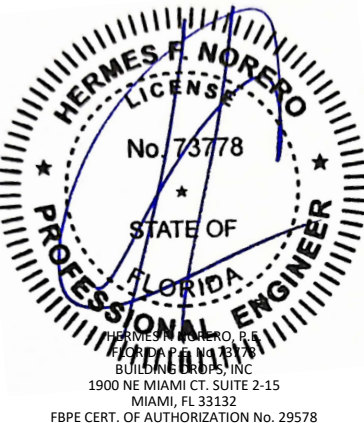

FL #:

FL46858

DATE: **05.14.2024**

DWG. BY:
FB

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **WNT015**







SHEET:

5

OF 6

c:\users\franciscobrite\building drops, inc\building drops landing - common\projects\wintech\bc-24-0417 - fbc submittal - ridgeview series window products\dwg\horizontal sliding window\wnt015-2.dwg 6/24/2024 4:33 PM

COMPONENTS

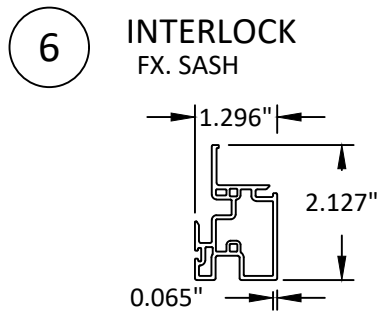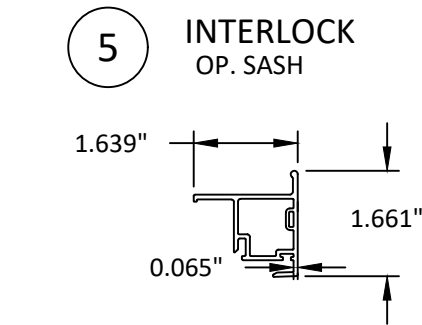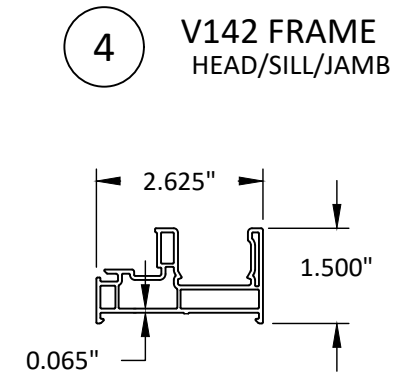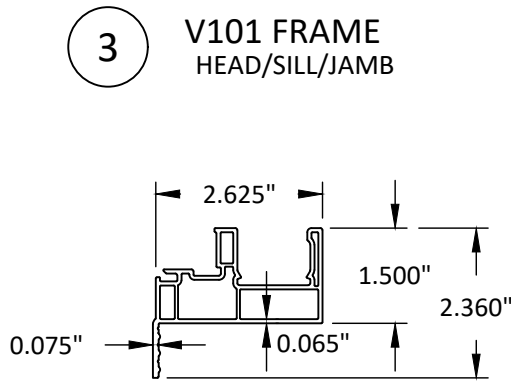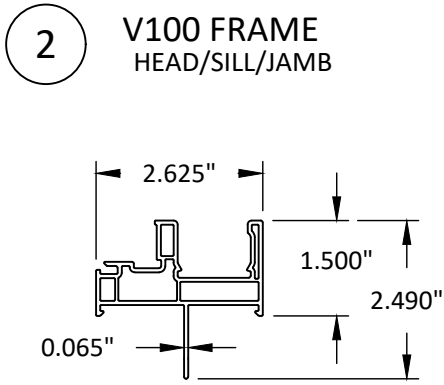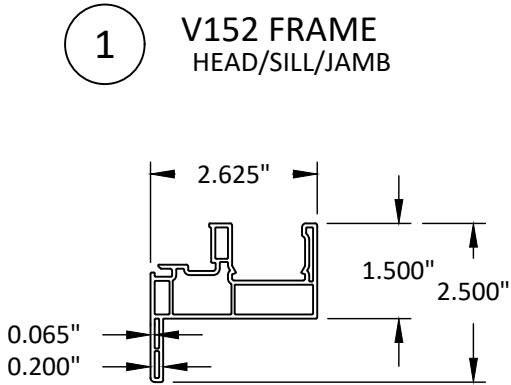

WINTech

WINDOW TECHNOLOGY, INC.

201 INDUSTRIAL DRIVE
MONETT, MO 65708 WWW.WINTECHINC.COM

PH: (417) 235-7821 FX: (417) 737-7140

TITLE: RIDGEVIEW HORIZONTAL
SLIDER VINYL WINDOW
(NON-HVHZ) (NON-IMPACT)

COMPONENTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT. SUITE 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL46858**

DATE: **05.14.2024**

DWG. BY:
FB

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **WNT015**

SHEET:

6

OF 6