



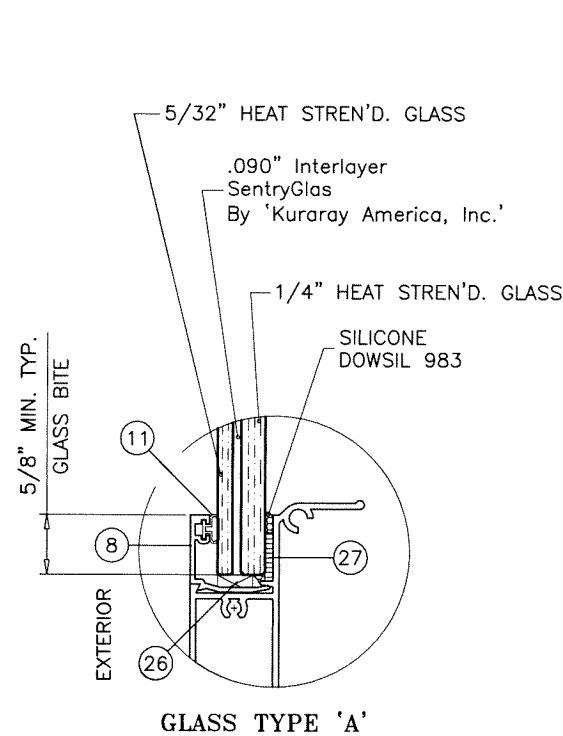


GLASS TYPE 'A'

GLASS TYPES 'A'
 MAXIMUM DESIGN LOAD RATING = + 100.0 PSF
 - 115.0 PSF

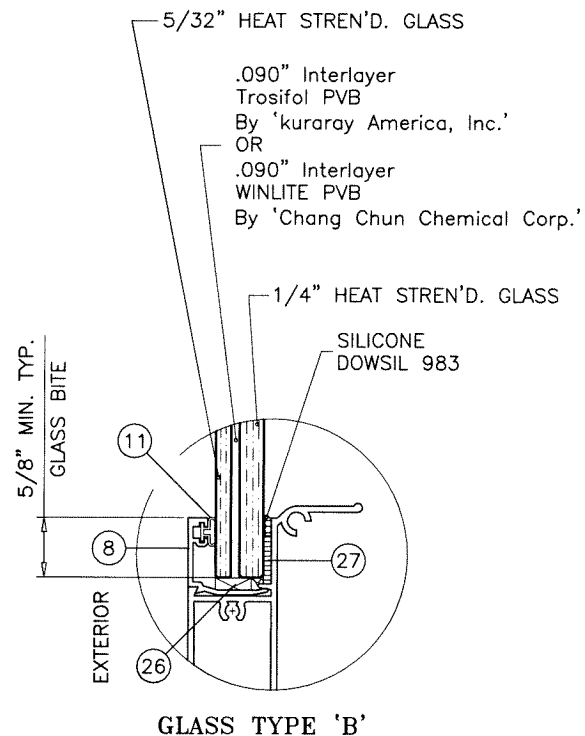

GLASS TYPE 'B'

GLASS TYPE 'B'
 MAXIMUM DESIGN LOAD RATING = + 90.0 PSF
 - 90.0 PSF

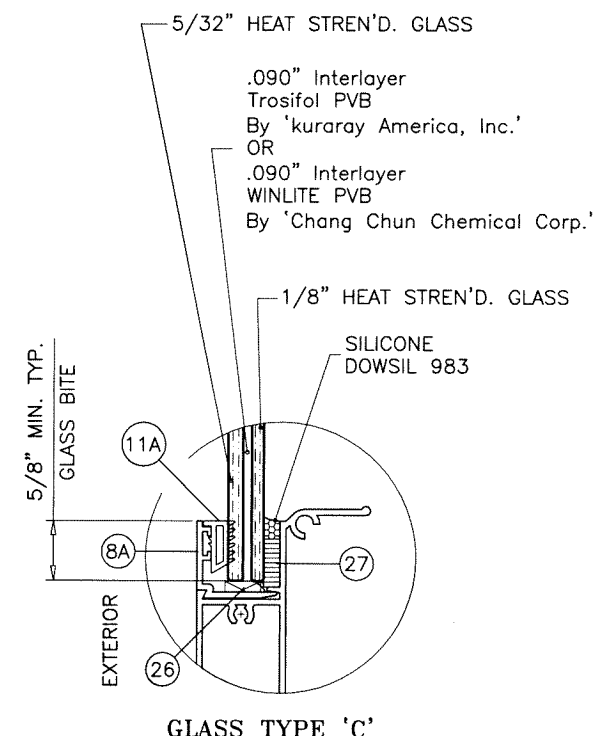

GLASS TYPE 'C'

GLASS TYPE 'C'
 MAXIMUM DESIGN LOAD RATING = + 80.0 PSF
 - 90.0 PSF

GLAZING OPTIONS

SERIES-1000WW ALUMINUM SINGLE HUNG WINDOW

THESE WINDOWS CAN BE INSTALLED AS SINGLE UNITS OR SIDE BY SIDE COMBINATION OF TWO OR MORE UNITS USING MULLIONS IN BETWEEN. FOR SINGLE HUNG WINDOW CAPACITY SEE SHEET 2. FOR SINGLE HUNG OVER FIXED WINDOW CAPACITY SEE SHEET 3. FOR SIDE BY SIDE UNITS SEE SHEET 4 FOR WINDOW MULLION CAPACITY. LOWER DESIGN PRESSURES FROM CHARTS ABOVE WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1709.9.2.


NOTE:
 GLASS CAPACITIES ON THIS SHEET ARE
 BASED ON ASTM E1300-09 (3 SEC. GUSTS)
 AND FLORIDA BUILDING COMMISSION
 DECLARATORY STATEMENT DCA05-DEC-219

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Sealed: 7/29/2025

FL #46884

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
 B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
 C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
 D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

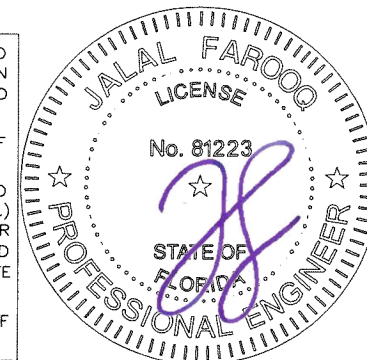

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\25-66F-ES

SERIES-1000WW ALUM SINGLE HUNG WINDOW (L.M.I.)

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	description


date: 07-10-25
 scale: 1/2"=1'-0"
 dr. by: TARIQ
 chk. by:

drawing no.
25-66F
 sheet 1 of 11

INSTRUCTIONS:
SEE SHEET 1 FOR GLASS TYPES AND DESIGN LOAD CAPACITY.
SEE CHART BELOW FOR SINGLE HUNG WINDOW ANCHOR CAPACITY.
LOWER VALUES FROM THESE CHARTS WILL APPLY TO ENTIRE SYSTEM.

SINGLE HUNG WINDOW ANCHOR LOAD CAPACITY - PSF							
WINDOW DIMS.		ANCHORS TYPE 'A'				TYPE 'C'	
		3/8" MAX. SHIM		1/2" MAX. SHIM		3/8" MAX. SHIM	
WIDTH	HEIGHT	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
19-1/8"	38-3/8" (4)	100.0	115.0	100.0	115.0	100.0	115.0
26-1/2"		100.0	115.0	100.0	115.0	100.0	115.0
30"		100.0	115.0	100.0	115.0	100.0	115.0
37"		100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	115.0	100.0	115.0
19-1/8"	50-5/8" (5)	100.0	115.0	100.0	115.0	100.0	115.0
26-1/2"		100.0	115.0	100.0	115.0	100.0	115.0
30"		100.0	115.0	100.0	115.0	100.0	115.0
37"		100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	115.0	100.0	115.0
19-1/8"	63" (6)	100.0	115.0	100.0	115.0	100.0	115.0
26-1/2"		100.0	115.0	100.0	115.0	100.0	115.0
30"		100.0	115.0	100.0	115.0	100.0	115.0
37"		100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	112.5	100.0	115.0
19-1/8"	72" (6)	100.0	115.0	100.0	115.0	100.0	115.0
26-1/2"		100.0	115.0	100.0	115.0	100.0	115.0
30"		100.0	115.0	100.0	115.0	100.0	115.0
37"		100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	107.1	100.0	115.0

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.

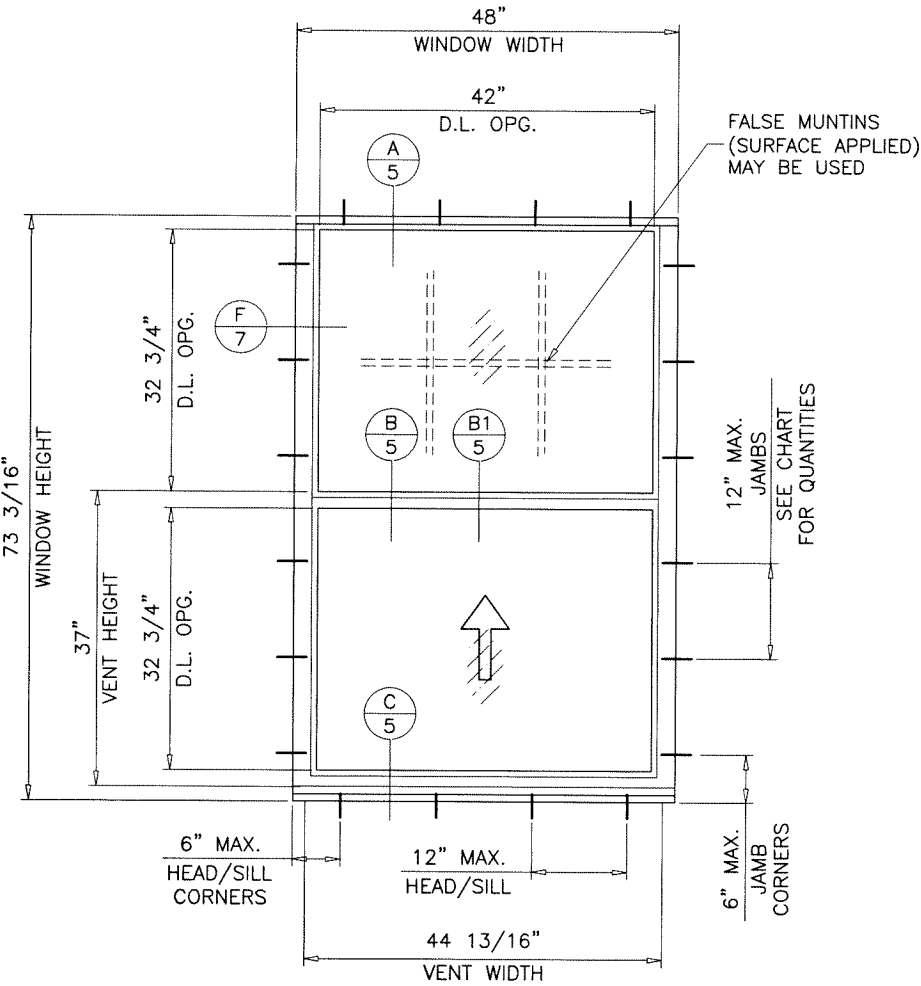

TYPICAL ELEVATION

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
TYPE 'A' - 5/16" DIA. ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)
THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)
DIRECTLY INTO CONCRETE OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

TYPE 'C' - 1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
(3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1-1/4" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

Sealed: 7/29/2025

FL #46884

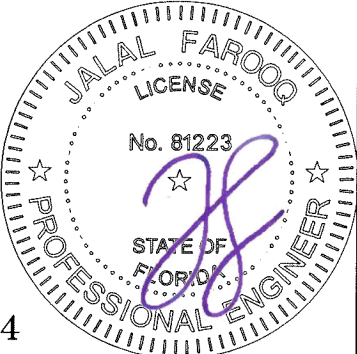

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 25-66F-ES

SERIES-1000WW ALUM SINGLE HUNG WINDOW (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no	date	by	description

date: 07-10-25
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.
25-66F
sheet 2 of 11

INSTRUCTIONS:
SEE SHEET 1 FOR GLASS TYPES AND DESIGN LOAD CAPACITY.
SEE CHART BELOW FOR S.H. OVER FIXED WINDOW ANCHOR CAPACITY.
LOWER VALUES FROM THESE CHARTS WILL APPLY TO ENTIRE SYSTEM.

SINGLE HUNG OVER FIXED WINDOW ANCHOR LOAD CAPACITY - PSF							
WINDOW DIMS.		ANCHORS TYPE 'A'				TYPE 'C'	
		3/8" MAX. SHIM		1/2" MAX. SHIM		3/8" MAX. SHIM	
WIDTH	HEIGHT	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
36"	60"	100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
45"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	115.0	100.0	115.0
36"	72"	100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
45"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	115.0	100.0	115.0
36"	84"	100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
45"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	115.0	100.0	115.0
36"	90"	100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
45"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	115.0	100.0	115.0
36"	96"	100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
45"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	112.0	100.0	115.0
36"	102"	100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
45"		100.0	115.0	100.0	115.0	100.0	115.0
48"		100.0	115.0	100.0	109.1	100.0	115.0
36"	108"	100.0	115.0	100.0	115.0	100.0	115.0
42"		100.0	115.0	100.0	115.0	100.0	115.0
45"		100.0	115.0	100.0	114.3	100.0	115.0
48"		100.0	115.0	100.0	107.1	100.0	115.0

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.


TYPICAL ANCHORS: SEE ELEV. FOR SPACING
TYPE 'A'— 5/16" DIA. ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)
THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)
DIRECTLY INTO CONCRETE OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

TYPE 'C'— 1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
(3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE


INTO CONCRETE AND MASONRY = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1-1/4" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

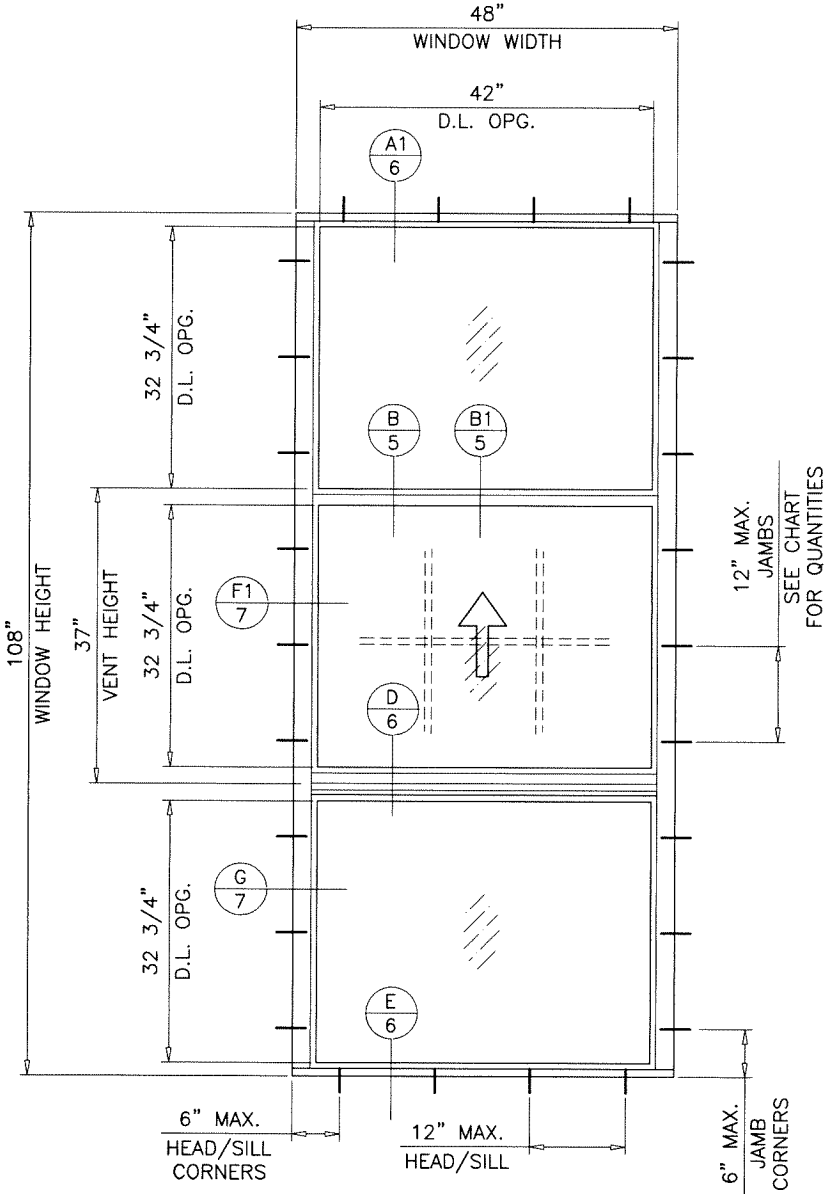

TYPICAL ELEVATION

PRODUCT COMPLIES WITH REQUIREMENTS OF ANSI Z97.1.
WITH MINIMUM SILL HEIGHT OF 36 IN. ABOVE WALKING SURFACE.

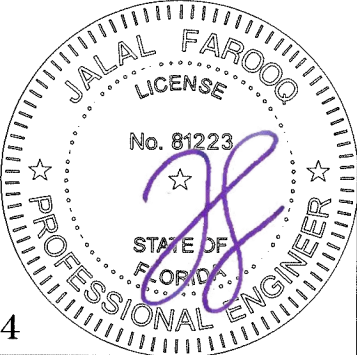

Sealed: 7/29/2025

FL #46884

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\25-66F-ES

SERIES-1000WW ALUM SINGLE HUNG WINDOW (L.M.I.)
E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158


revisions:	no	date	by	description

date: 07-10-25
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:


drawing no.
25-66F
sheet 3 of 11

MULLION LOAD CAPACITY - PSF		
WINDOW DIMS.		6 ANCHORS @ MULL END
WIDTH (W)	MULL SPAN	EXT. (+) INT. (-)
24"	60"	115.0
30"		115.0
36"		115.0
42"		115.0
48"		115.0
24"	72"	115.0
30"		115.0
36"		115.0
42"		115.0
48"		115.0
24"	84"	115.0
30"		115.0
36"		115.0
42"		115.0
48"		115.0
24"	90"	115.0
30"		115.0
36"		115.0
42"		115.0
48"		115.0
24"	96"	115.0
30"		115.0
36"		115.0
42"		115.0
48"		115.0
24"	102"	115.0
30"		115.0
36"		115.0
42"		115.0
48"		115.0
24"	108"	115.0
30"		115.0
36"		115.0
42"		115.0
48"		115.0


INSTRUCTIONS:
 SEE SHEET 1 FOR GLASS TYPES AND DESIGN LOAD CAPACITY.
 SEE CHART ON SHEET 3 FOR S.H. OVER FIXED WINDOW ANCHOR CAPACITY.
 SEE CHARTS BELOW FOR WINDOW MULLION CAPACITY.
 LOWER VALUES FROM THESE CHARTS WILL APPLY TO ENTIRE SYSTEM.

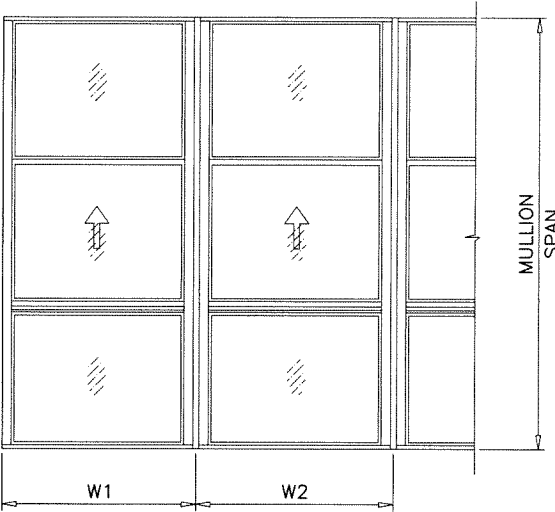

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

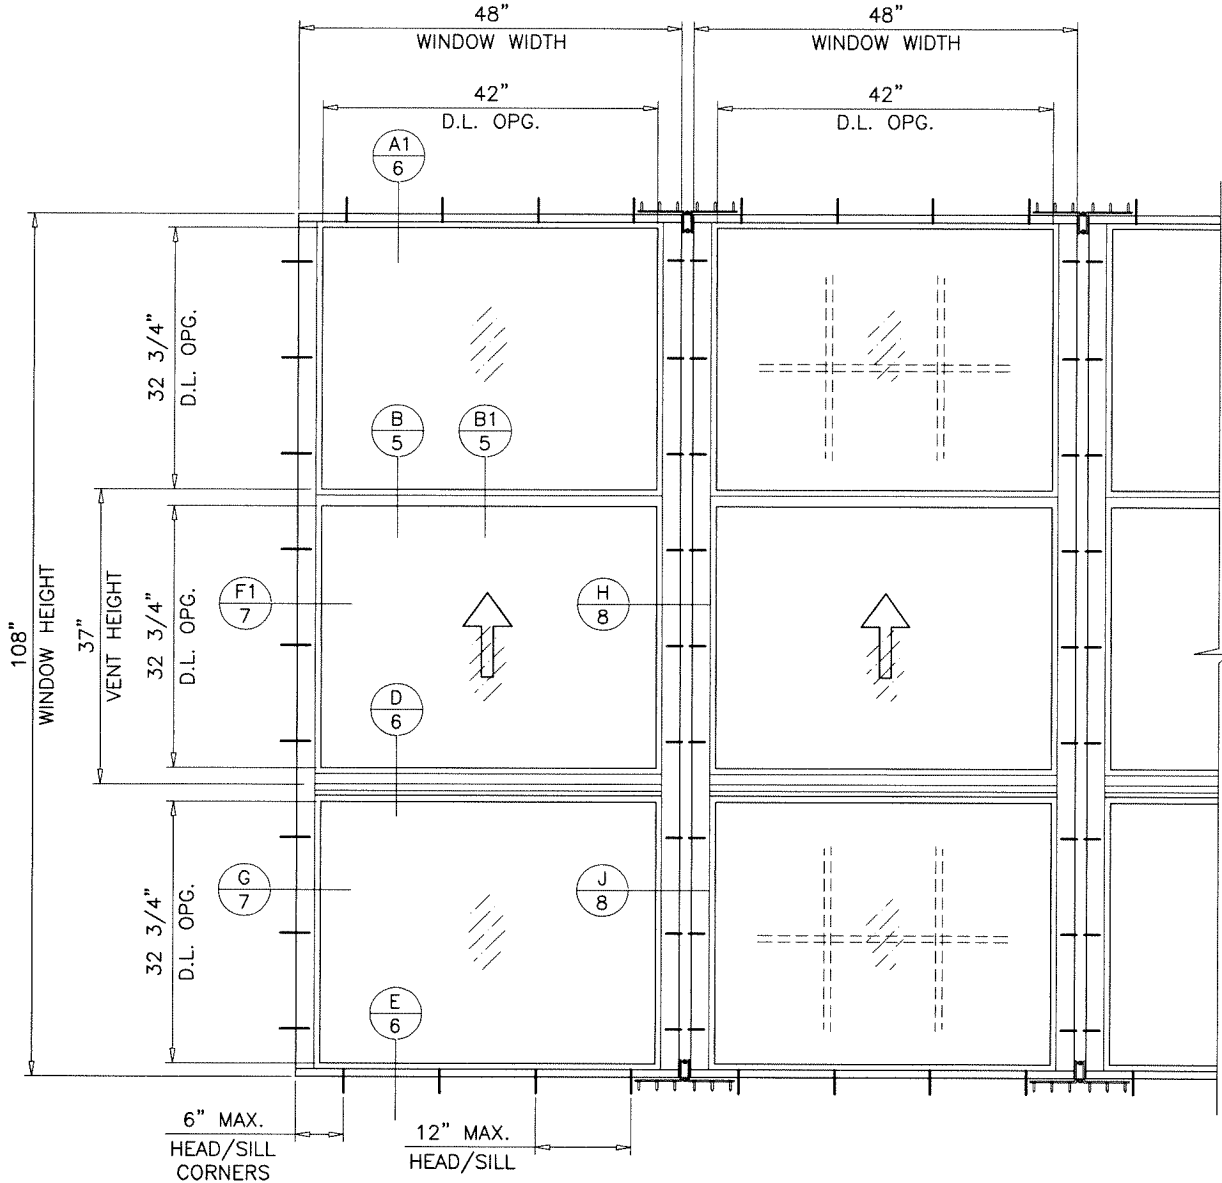


TYPICAL ELEVATION
 SIDE BY SIDE UNITS

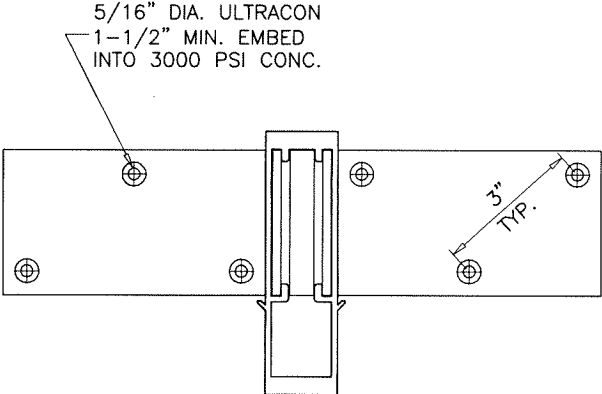

6 ANCHORS @ MULL ENDS

INSTALL CLIP ANGLES DIRECTLY TO CONC. WITHOUT SHIM SPACE
 NOTCH WOOD BUCKS TO ACCOMMODATE CLIP ANGLES
 SEE SHEET 8 FOR DETAIL

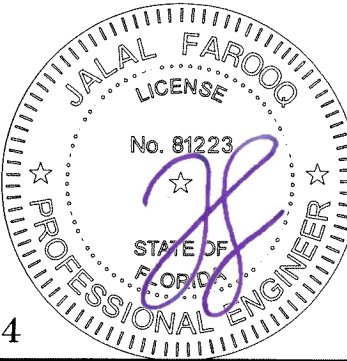

Sealed: 7/29/2025

FL #46884

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 C.A.N. 3538

SERIES-1000WW ALUM SINGLE HUNG WINDOW (L.M.I.)

E.S. WINDOWS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no	date	by	description

date: 07-10-25

scale: -


dr. by: TARIQ



chk. by:

drawing no.

25-66F

sheet 4 of 11



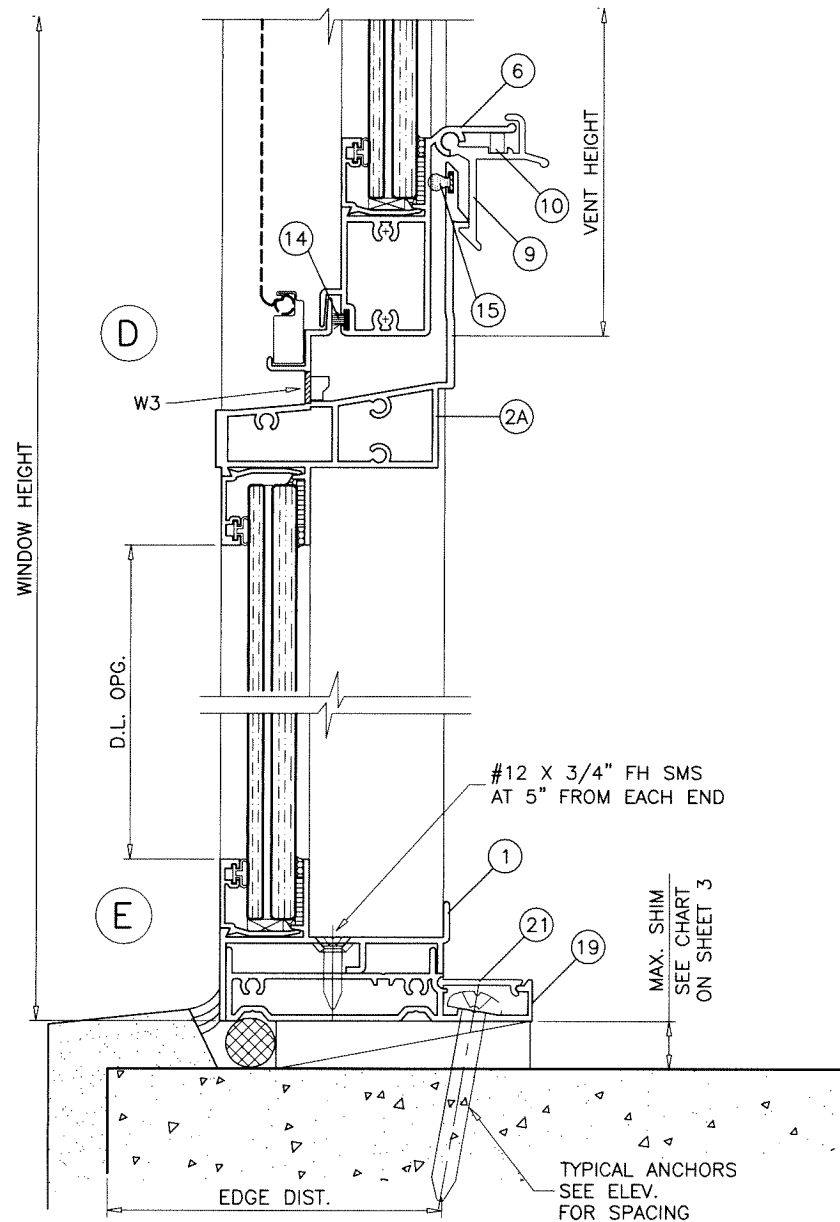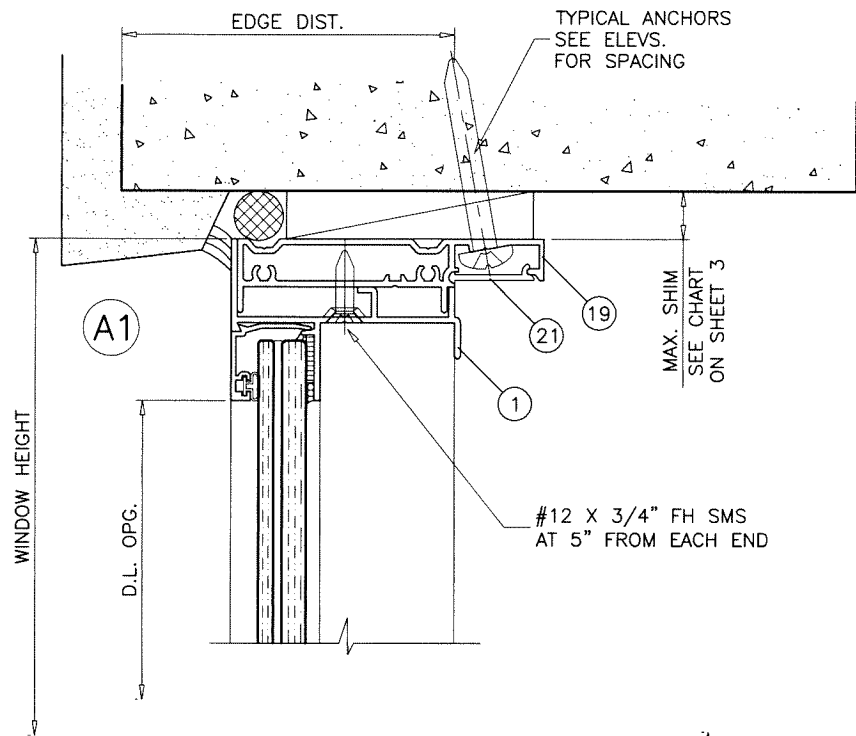


WEEPHOLES:

W3 = 5/16" WEEPHOLES AT 6" FROM EACH END
WITH PLASTIC BAFFLE

Sealed: 7/29/2025

FL #46884

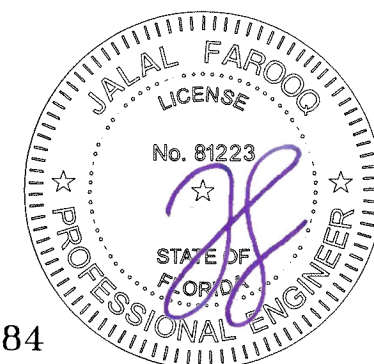

SERIES-1000WW ALUM SINGLE HUNG WINDOW (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	
no	description

date: 07-10-25
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:





drawing no.

25-66F

sheet 6 of 11


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

COMP-ANL\25-66F-ES

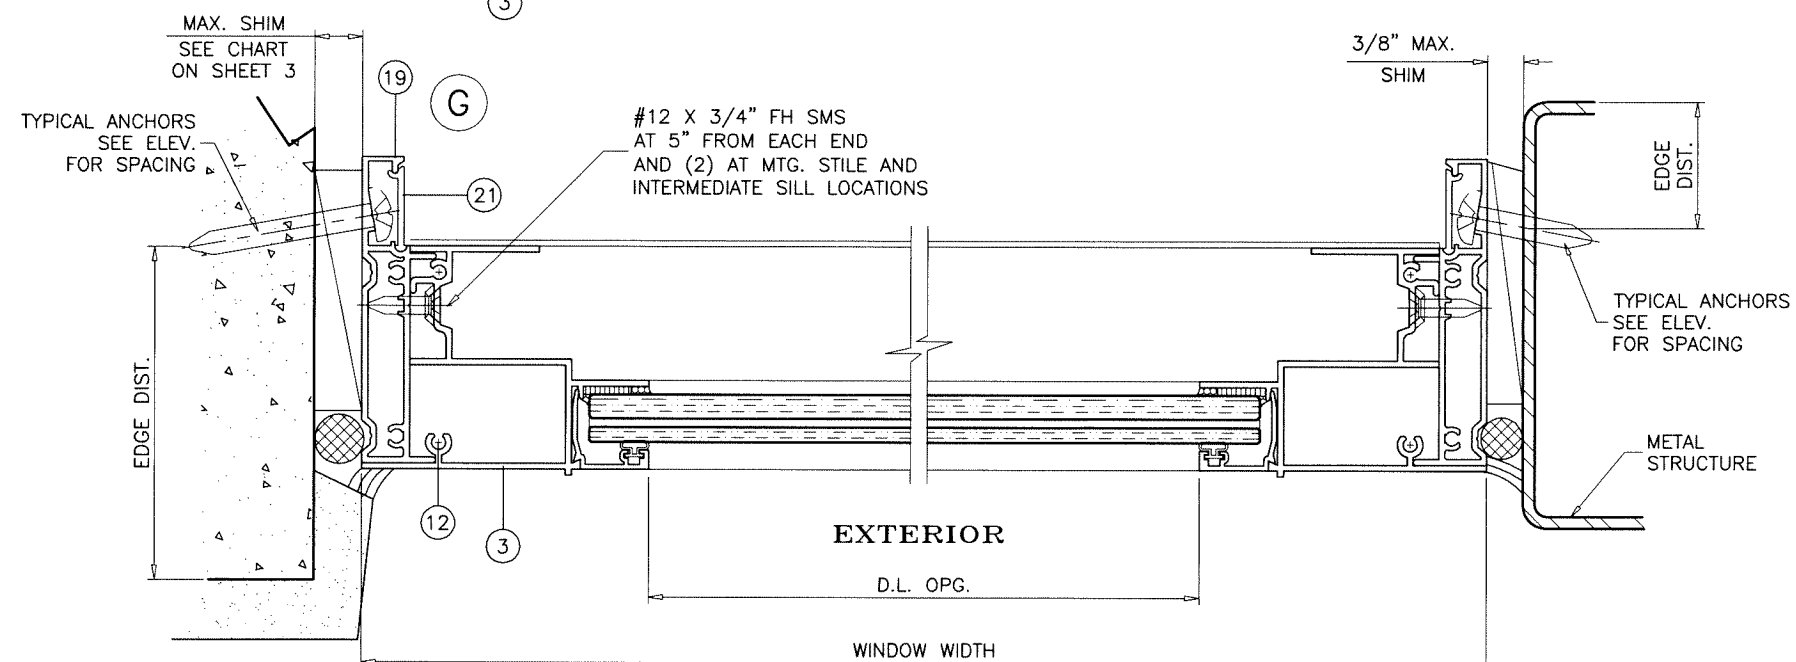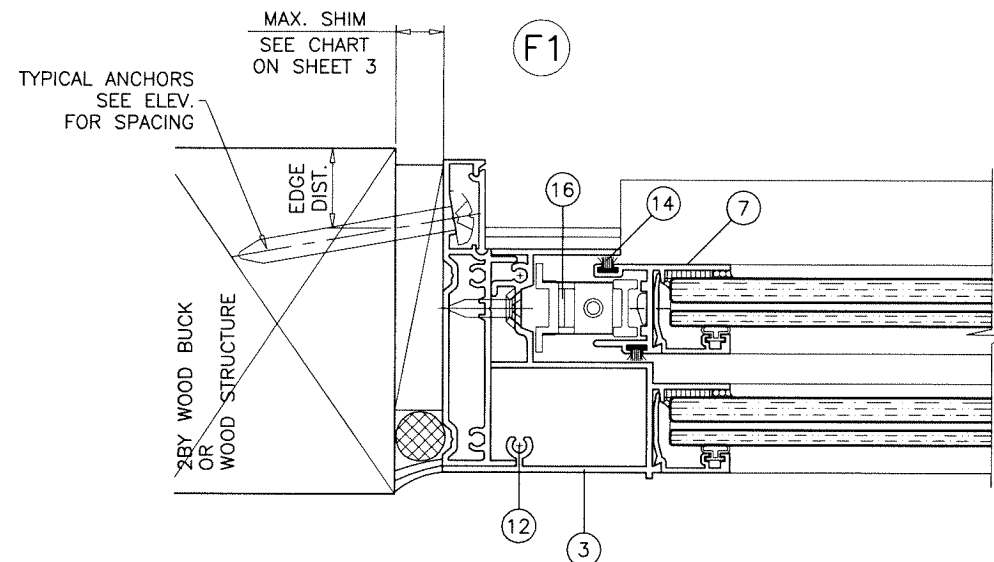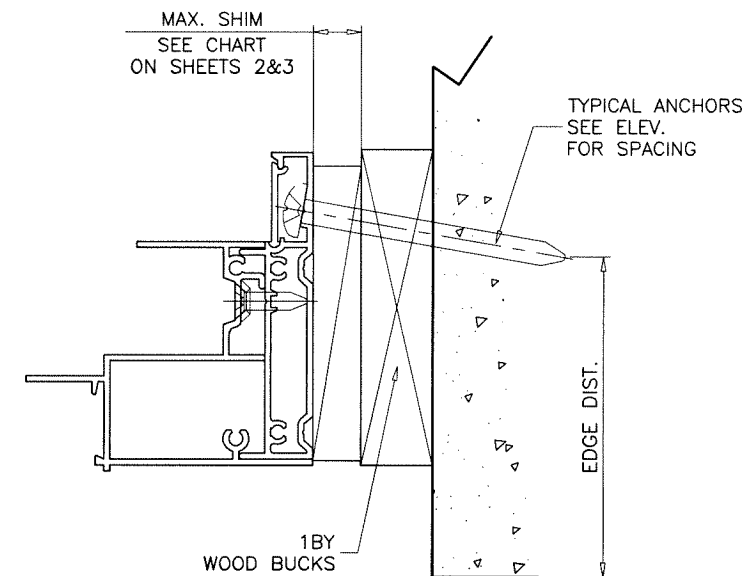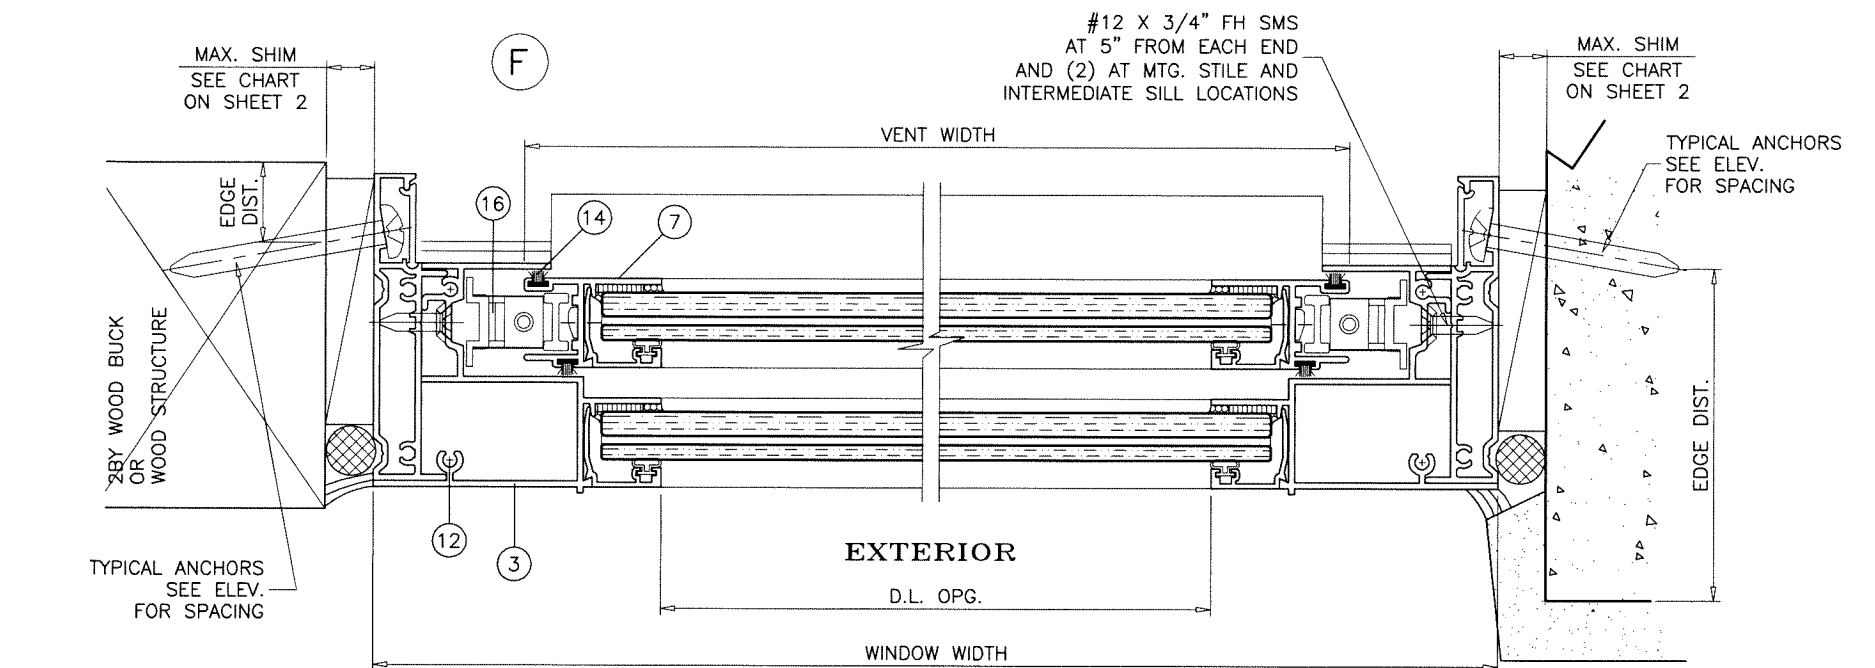

Sealed: 7/29/2025

FL #46884

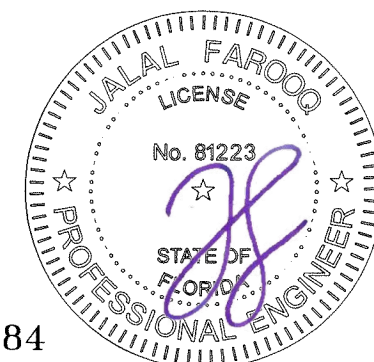

SERIES-1000WW ALUM SINGLE HUNG WINDOW (L.M.I.)




E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX.

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

date: 07-10-25		revisions:	
scale: 1/2" = 1"	no	date	by description
dr. by: TARIQ			
chk. by:			


drawing no. 25-66F

sheet 7 of 11

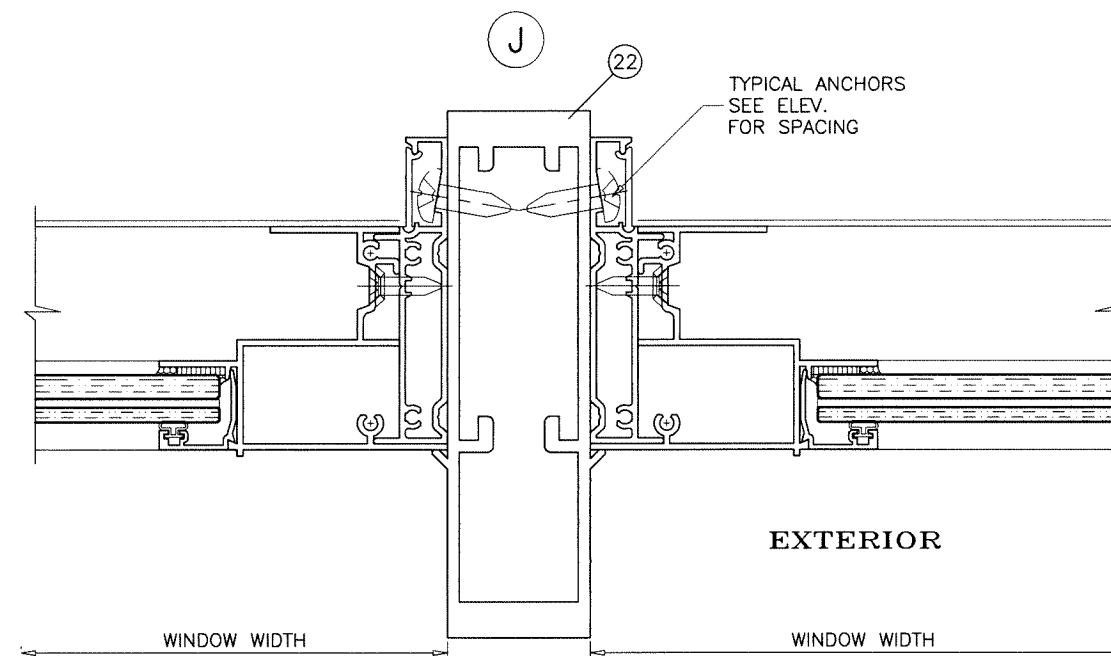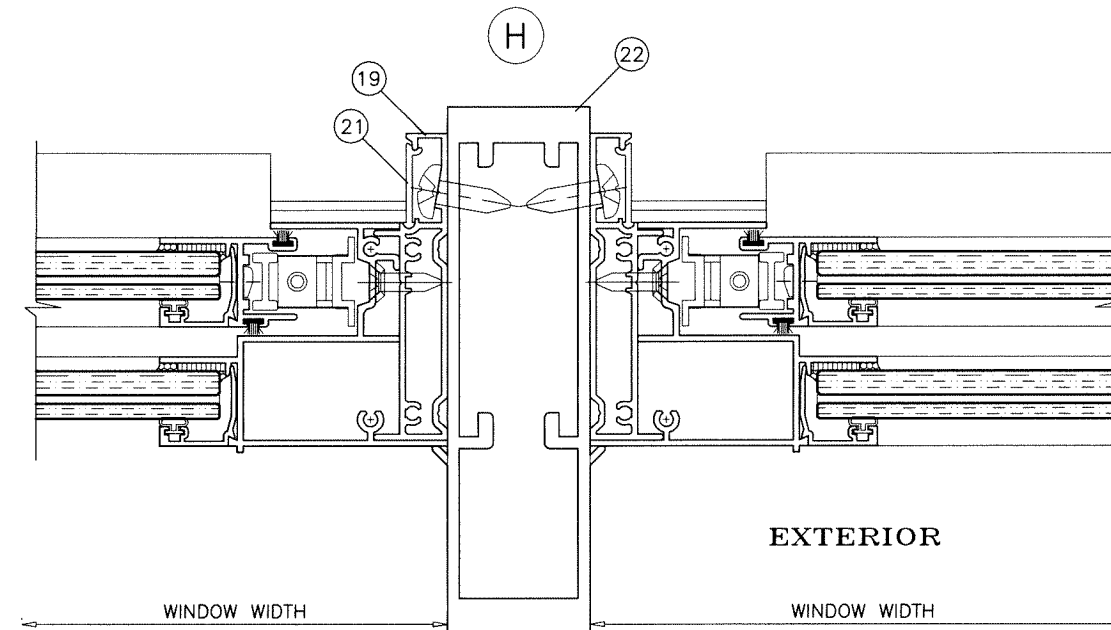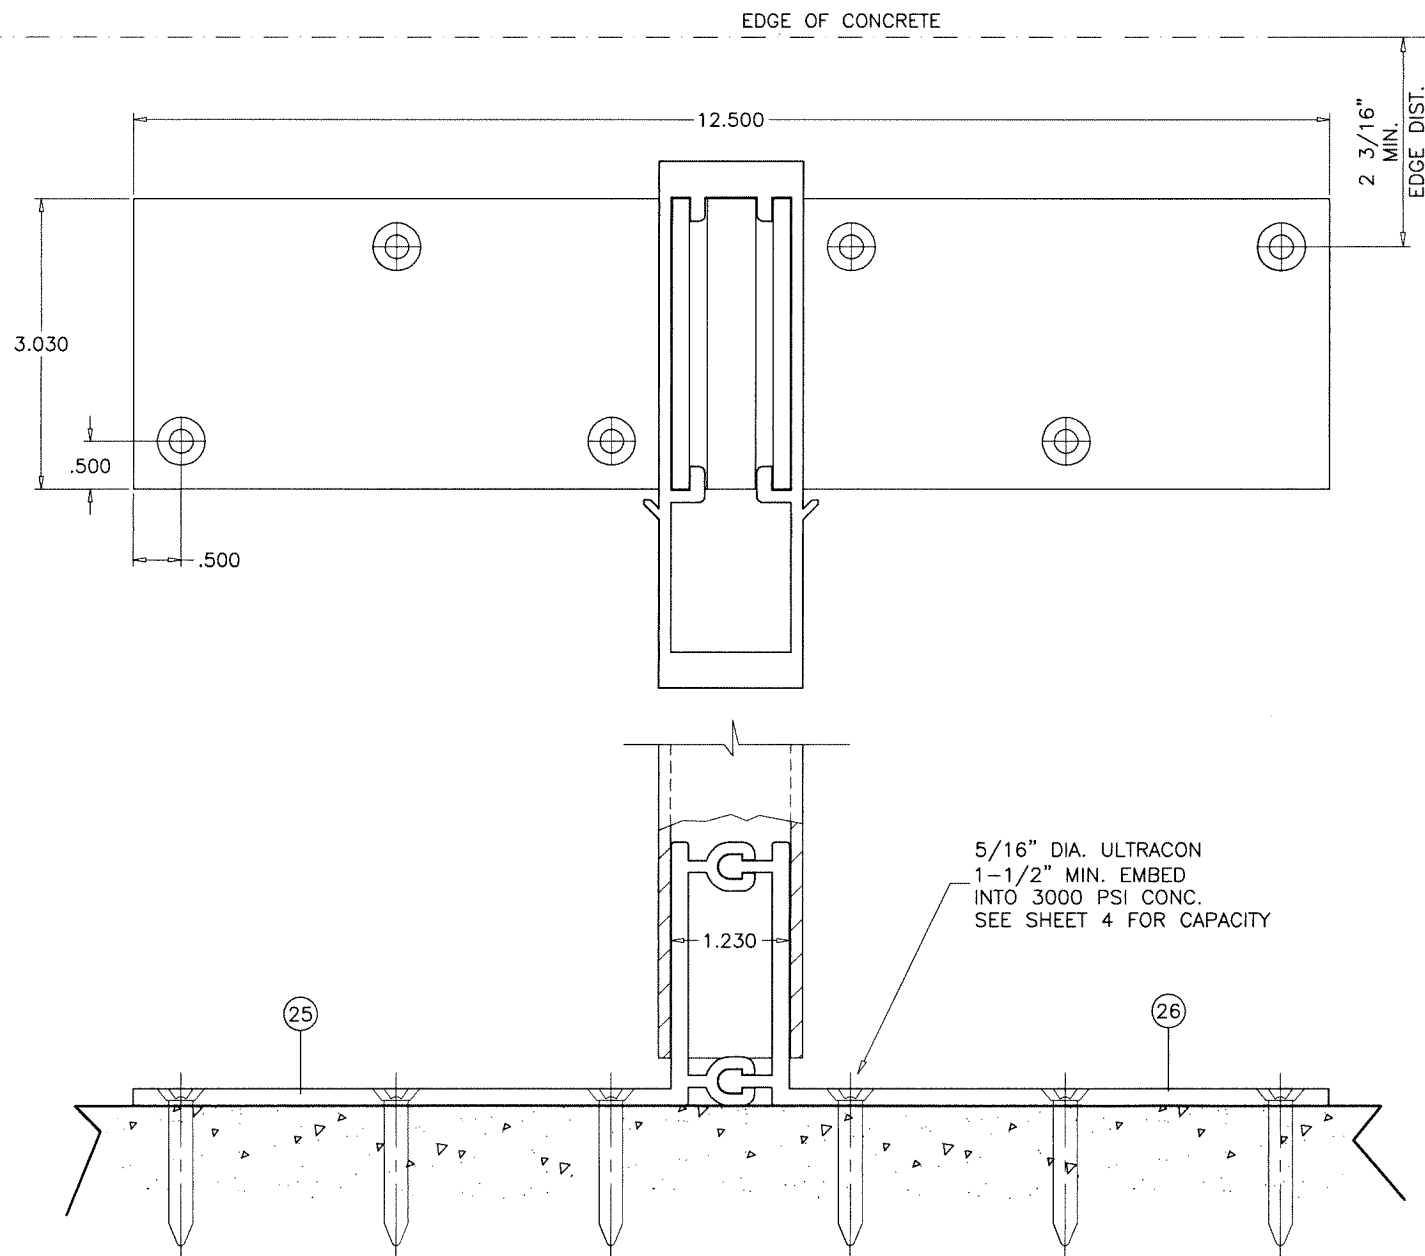

Sealed: 7/29/2025

FL #46884

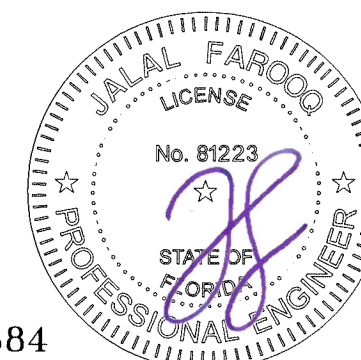

SERIES-1000WW ALUM SINGLE HUNG WINDOW (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description

date: 07-10-25

scale: 1/2" = 1"

dr. by: TARIQ

chk. by:


drawing no.

25-66F


sheet 8 of 11

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)


COMP-ANL\25-66F-ES

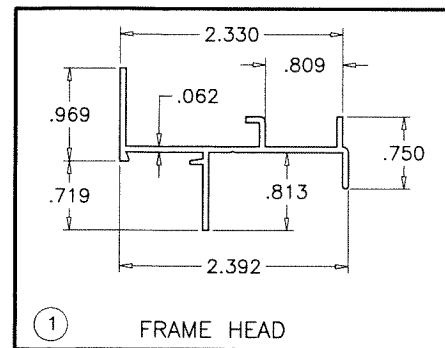


① FRAME HEAD

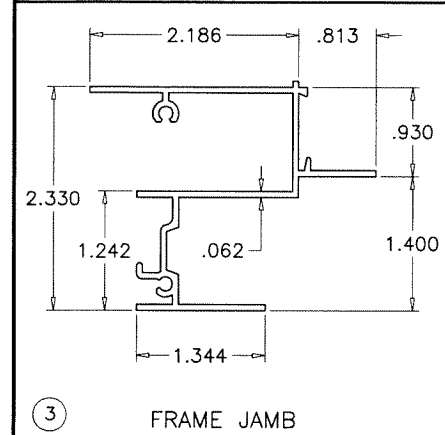


③ FRAME JAMB

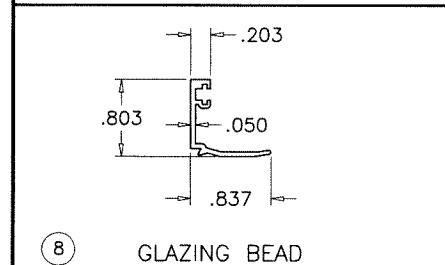


⑧ GLAZING BEAD

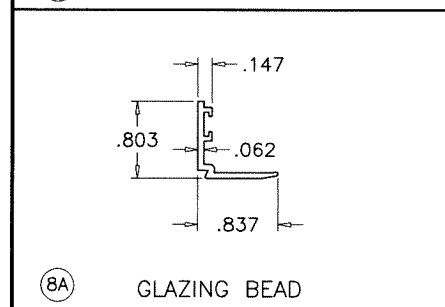


⑧A GLAZING BEAD

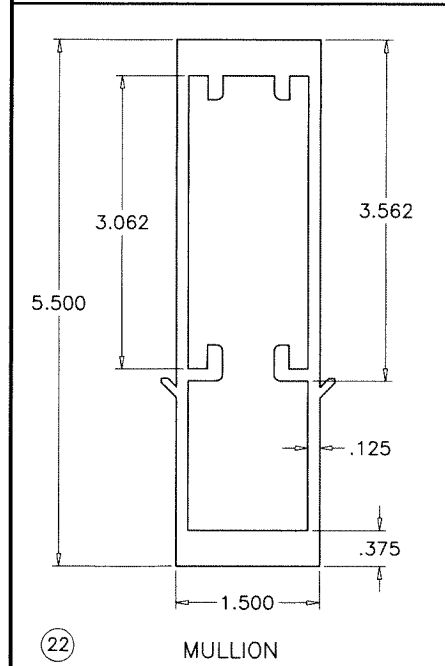


②② MULLION

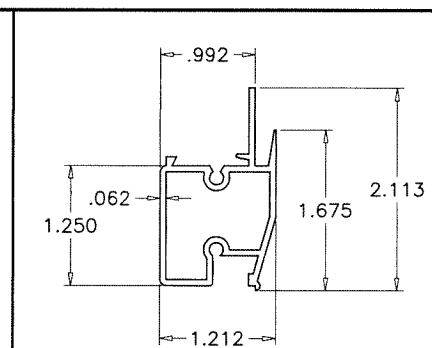


④ MEETING RAIL FOR SPRING LATCH

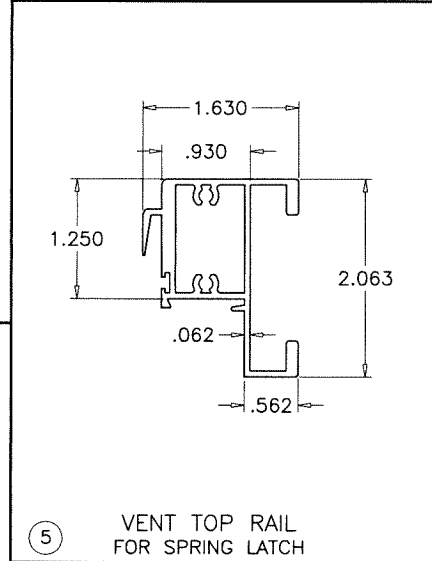


⑤ VENT TOP RAIL FOR SPRING LATCH

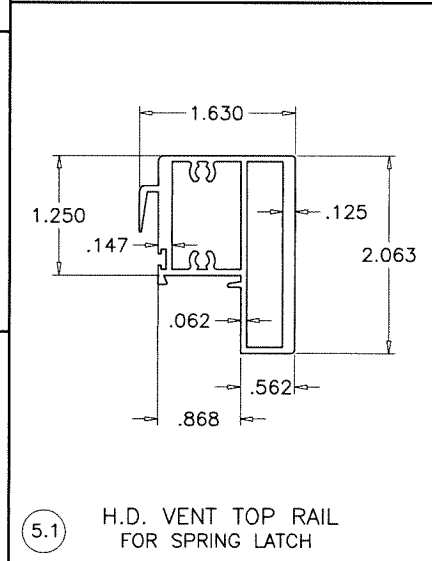


⑤.1 H.D. VENT TOP RAIL FOR SPRING LATCH

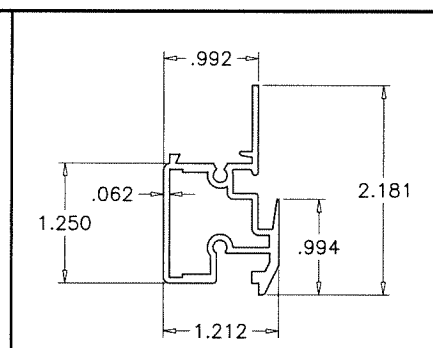


④A MEETING RAIL FOR SWEEP LATCH

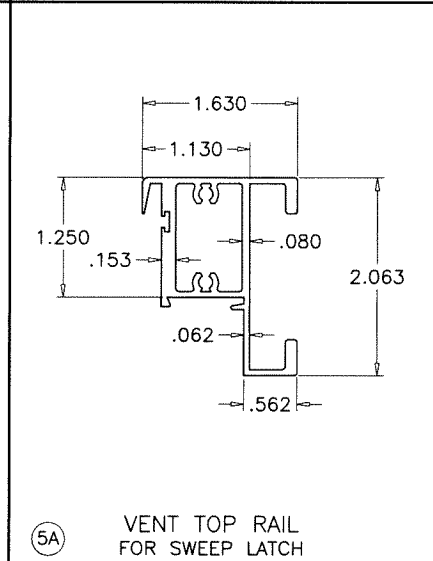


⑤A VENT TOP RAIL FOR SWEEP LATCH

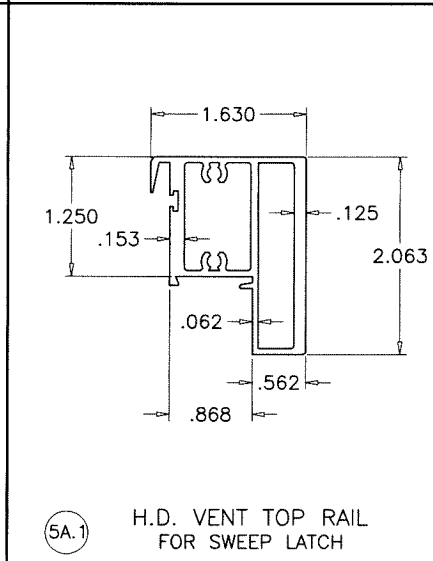


⑤A.1 H.D. VENT TOP RAIL FOR SWEEP LATCH

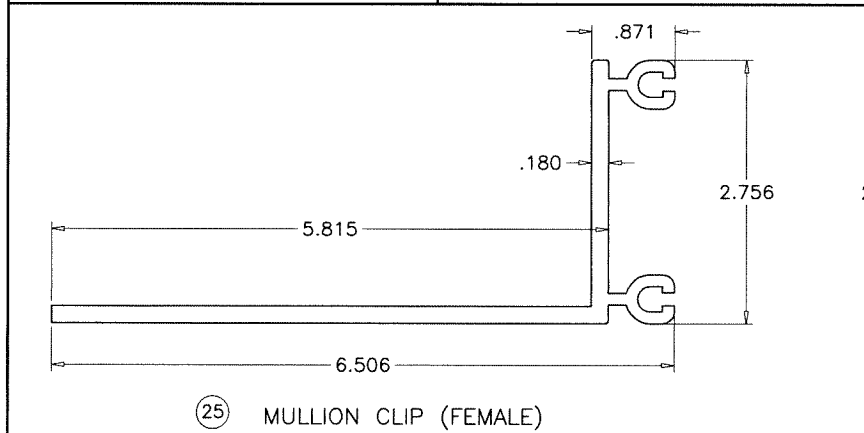


②⑤ MULLION CLIP (FEMALE)

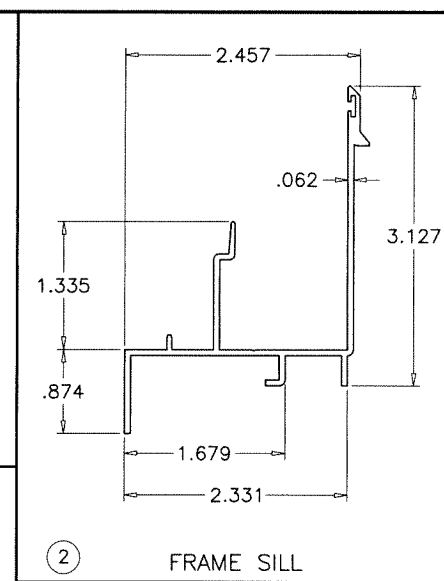


② FRAME SILL

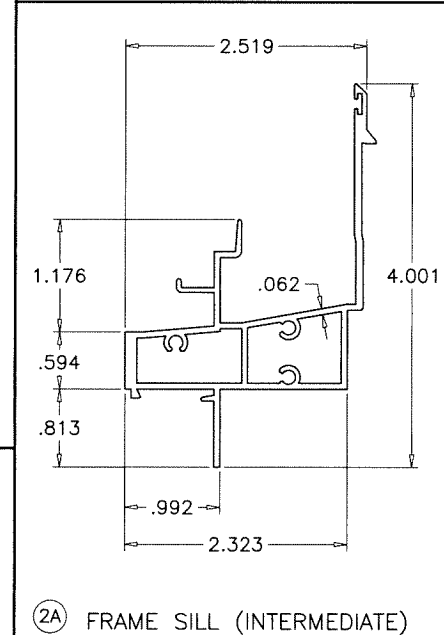


②A FRAME SILL (INTERMEDIATE)

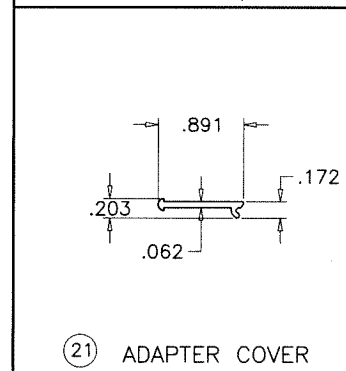


②① ADAPTER COVER

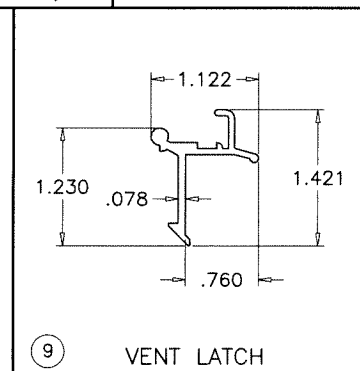


⑨ VENT LATCH

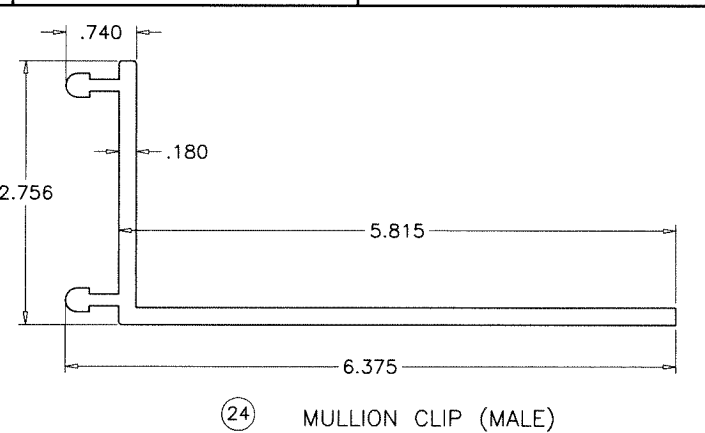


②④ MULLION CLIP (MALE)

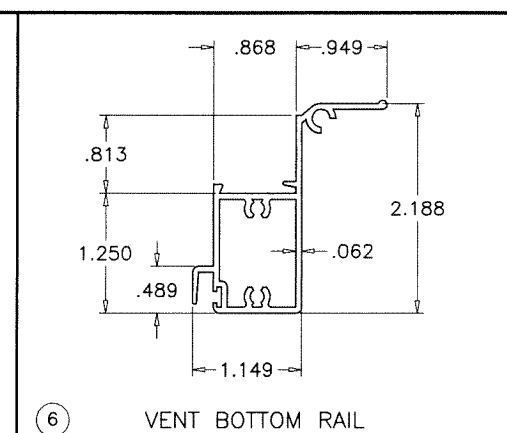


⑥ VENT BOTTOM RAIL

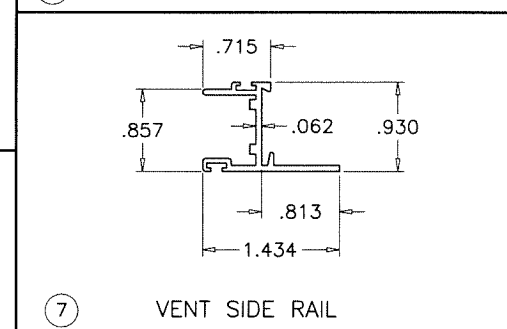

⑦ VENT SIDE RAIL

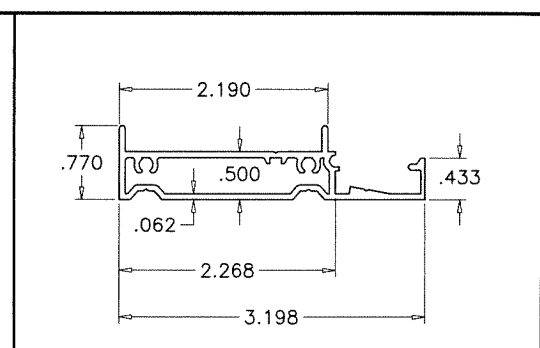

①⑨ FLUSH FRAME ADAPTER

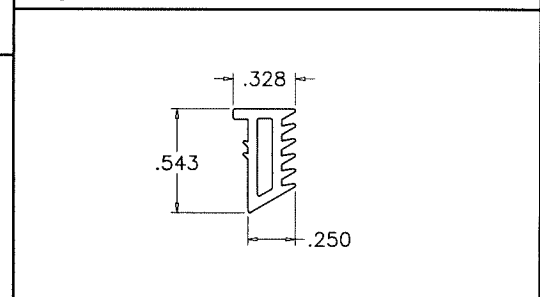


①①A GLAZING WEDGE
SCALE 1:1

BASE POLYMER = EPDM RUBBER
DENSITY = 10.26 Lbs/Gal
HARDNESS = 70±5
TENSILE STRENGTH = 905 PSI
ELONGATION AT BREAK = 273%
TEAR STRENGTH = 1.343 Kip/ft
BRITTLENESS TEMPERATURE = -40° F
COMPRESSION SET = 27% (22h@158°F)

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SCHNEE MOREHEAD SEAM SEALER SM5504.

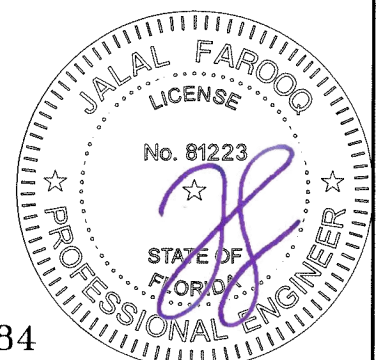

Sealed: 7/29/2025

FL #46884

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\25-66F-ES

SERIES-1000WW ALUM SINGLE HUNG WINDOW (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	description

date: 07-10-25
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
25-66F

sheet 9 of 11

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ES1001	1	FRAME HEAD	6063-T6	-
2	ES1101	1	FRAME SILL	6063-T6	-
2A	ES1055	1	FRAME SILL (INTERMEDIATE)	6063-T6	-
3	ES1003	2	FRAME JAMB	6063-T6	-
4	ES1005	1	FIXED MTG. RAIL (FOR SPRING LATCH)	6063-T6	-
4A	ES1051	1	FIXED MTG. RAIL (FOR SWEEP LATCH)	6063-T6	-
5	ES2004	1	VENT TOP RAIL (FOR SPRING LATCH)	6063-T6	-
5.1	ES2004A	1	VENT TOP RAIL (FOR SPRING LATCH)	6063-T6	-
5A	ES1053	1	VENT TOP RAIL (FOR SWEEP LATCH)	6063-T6	-
5A.1	ES1053A	1	VENT TOP RAIL (FOR SWEEP LATCH)	6063-T6	-
6	ES1006	1	VENT BOTTOM RAIL	6063-T6	-
7	ES1007	2	VENT SIDE RAIL	6063-T5	-
8	ES1017	AS RQD.	GLAZING BEAD	6063-T5	-
8A	ES1008	AS RQD.	GLAZING BEAD	6063-T6	-
9	ES1009	2/VENT	SPRING LOADED VENT LATCH	6063-T5	AT 6" FROM ENDS
9A	-	2/VENT	SWEEP LATCH	ZAMAK	AT 6" FROM ENDS
9B	#8 X 1"	2/LATCH	LATCH INSTALLATION SCREWS	-	FH SMS
10	ES1012	1/LATCH	LATCH SPRING	ST. STEEL	-
11	27-425	AS REQD.	GLAZING GASKET	EPDM	DUROMETER 60±5 SHORE 'A'
11A	ES1010	AS REQD.	GLAZING WEDGE	SOFT PVC	DUROMETER 70±5 SHORE 'A'
12	#8 X 1"	20	FRAME & VENT ASSEMBLY SCREWS	CRS	PH SMS
13	ES1011	2/VENT	SASH CAM	CELCON	-
14	23211NG	AS REQD.	PILE W'STRIPPING WITH PLASTIC FIN	POLY PROPYLENE	-
15	Q300X190	AS REQD.	FRAME SILL W'STRIPPING	-	Q-LON2
16	SERIES 86	2/ VENT	BLOCK & TACKLE BALANCE		CALDWELL
18	ES1013	2	SASH STOP	-	-
19	ES1056	AS REQD.	FLUSH FRAME ADAPTER	6063-T6	-
20	-	1	5/16" BOX SCREEN	-	OPTIONAL
21	ES5016	AS REQD.	ADAPTER COVER	6063-T5	-
22	ES1057	AS REQD.	MULLION	6063-T6	-
24	ES1059	AS REQD.	MULLION CLIP (MALE)	6063-T6	-
25	ES1060	AS REQD.	MULLION CLIP (FEMALE)	6063-T6	-
26	27-372	2/ LITE	SETTING BLOCK, 7/16" X 3/16" X 3-1/2" LONG	EPDM	DUROMETER 75±5 SHORE A
27	-	AS REQD.	GLAZING TAPE, 1/8" X 1/2" FOAM	POLYURETANE	-

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SCHNEE MOREHEAD SEAM SEALER SM5504.



Sealed: 7/29/2025

FL #46884

a f c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES-1000WW ALUM SINGLE HUNG WINDOW (L.M.I.)

E.S. WINDOWS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:
no. date by description

date: 07-10-25
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
25-66F
sheet 10 of 11

