

PanoramAH! AMERICA, LLC

ah!38 INSWING PIVOT DOOR

(HVHZ)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- TAS 201-94

TAS 202-94

TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. WINDOW FRAME MATERIAL: ALUMINUM 6063-T5
7. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 5 FOR GLAZING DETAIL.

INSTALLATION NOTES:

1. TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 4.
2. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
3. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 3/8 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
4. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
5. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
6. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
7. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
8. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND INSTALLATION NOTES
2	"XX" ELEVATION & DESIGN PRESSURE TABLE
3	"X" ELEVATION & DESIGN PRESSURE TABLE
4	ANCHOR LAYOUTS
5	VERTICAL SECTIONS & GLAZING DETAIL
6	HORIZONTAL SECTIONS
7	ANCHOR DETAILS & ANCHOR SCHEDULE

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
XX	SEE TABLE ON SHEET 2			LARGE & SMALL MISSILE IMPACT
X	SEE TABLE ON SHEET 3			



1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580

TITLE: ah!38 INSWING PIVOT DOOR (HVHZ)(IMPACT)

GENERAL NOTES & INSTALLATION NOTES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com


B.D.

BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2024.11.16 20:28:11 -0400

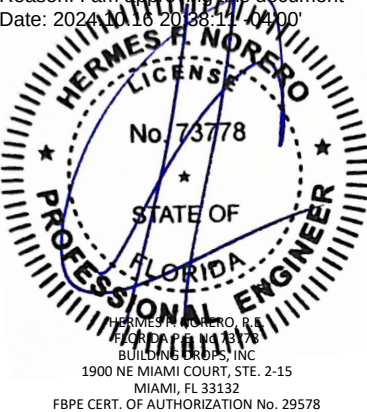

FL #:

FL46886

DATE:

04.11.2024

DWG. BY:

SH

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

PAN012

SECTION:

1

OF 7



PANORAMAH![®]
unlimited perspective

TITLE: *ah!38 INSWING PIVOT DOOR*
(HVVHZ)(IMPACT)

**"XX" ELEVATION & DESIGN
PRESSURE TABLE**


PREPARED BY:

BUILDING DROPS, INC.
9000 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

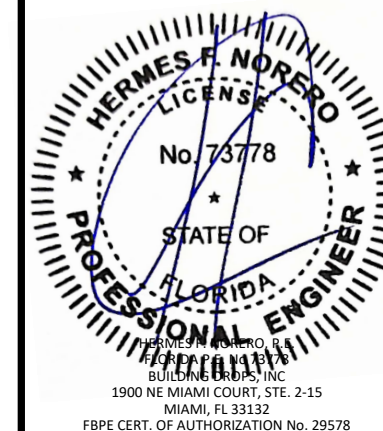

FL #:

FL46886

DATE: 04.11.2024

DWG. BY:
SH

CHK. BY:	HFN
----------	-----


SCALE: NTS

DWG. #: PAN012

SECTION:

2

c:\users\sebastianherrerros\building_drops_in\building_drops_panoramah\america\l\bc-21-0430 - fbc submittal - ph38 pivot sliding door - f21091.dwg (pivot door) pan012.dwg 10/15/2024 11:28 AM

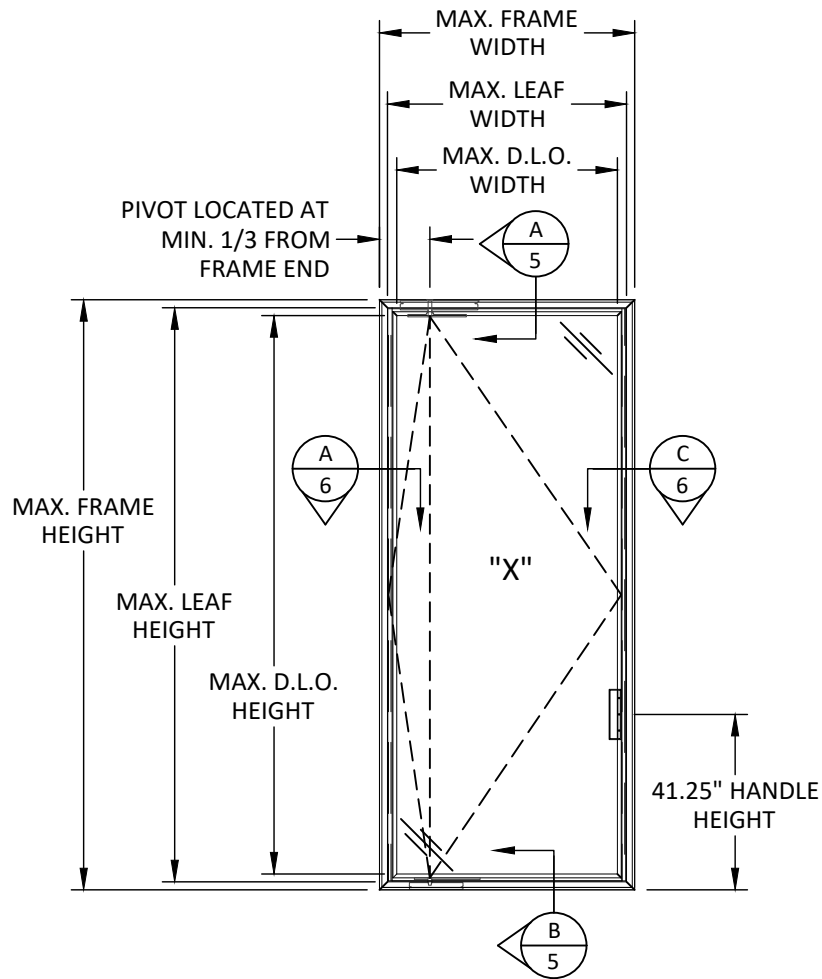

"X" ELEVATION
TYPICAL

D.L.O. HEIGHT = FRAME HEIGHT - 7.50"
D.L.O. WIDTH = FRAME WIDTH - 9.50"
LEAF HEIGHT = FRAME HEIGHT - 4.25"
LEAF WIDTH = FRAME WIDTH - 4.125"

SINGLE PIVOT DOOR ALLOWABLE DESIGN PRESSURE (PSF)												
UNIT HEIGHT (IN.)	UNIT WIDTH (IN.)											
		33	39	45	51	57	63	69	75	81	87	93
	85	75.0	69.2	55.0	55.0	55.0	55.0	55.0	55.0	50.9	48.5	48.5
	91	75.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.9	47.4	45.3
	97	75.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.9	47.4	44.4
	103	75.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.9	47.4	44.4
	109	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.9	47.4	44.4
	115	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.9	47.4	44.4
	121	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.9	47.4	44.4
	127	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.9	47.4	-
	133	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.9	-	-
	139	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	50.9	-	-
	145	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	-	-	-
	151	55.0	55.0	55.0	55.0	55.0	55.0	55.0	55.0	-	-	-
	157	55.0	55.0	55.0	55.0	55.0	55.0	55.0	-	-	-	-
	163	55.0	55.0	55.0	55.0	55.0	55.0	55.0	-	-	-	-
	169	55.0	55.0	55.0	55.0	55.0	55.0	-	-	-	-	-
	175	55.0	55.0	55.0	55.0	55.0	55.0	-	-	-	-	-



1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580

TITLE: *ah138 INSWING PIVOT DOOR (HVHZ)/(IMPACT)*


"X" ELEVATION & DESIGN
PRESSURE TABLE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

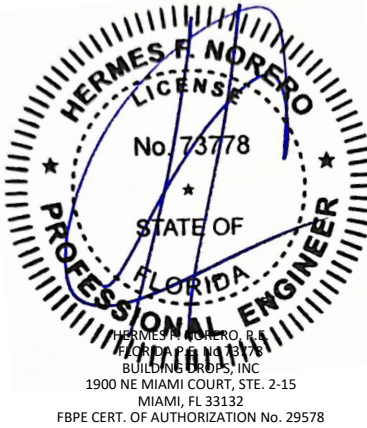

FL #:
FL46886

DATE: **04.11.2024**

DWG. BY: **SH** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **PAN012**

SECTION:
3

1000 WOODBURY ROAD, STE. 206
WOODBURY, NY 11797
PH: (631)683-8580

TITLE: *ah!38 INSWING PIVOT DOOR*
(HVVHZ)/(IMPACT)


ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

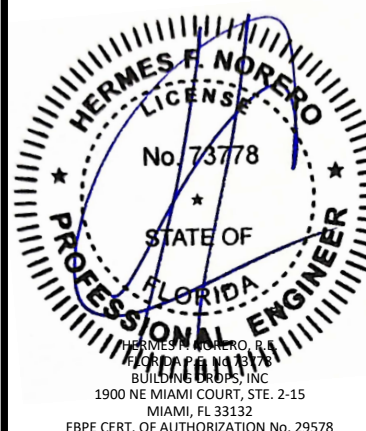

FL #: **FL46886**

DATE: 04.11.2024

DWG. BY: SH	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: PAN012


SECTION:

4

OF 7

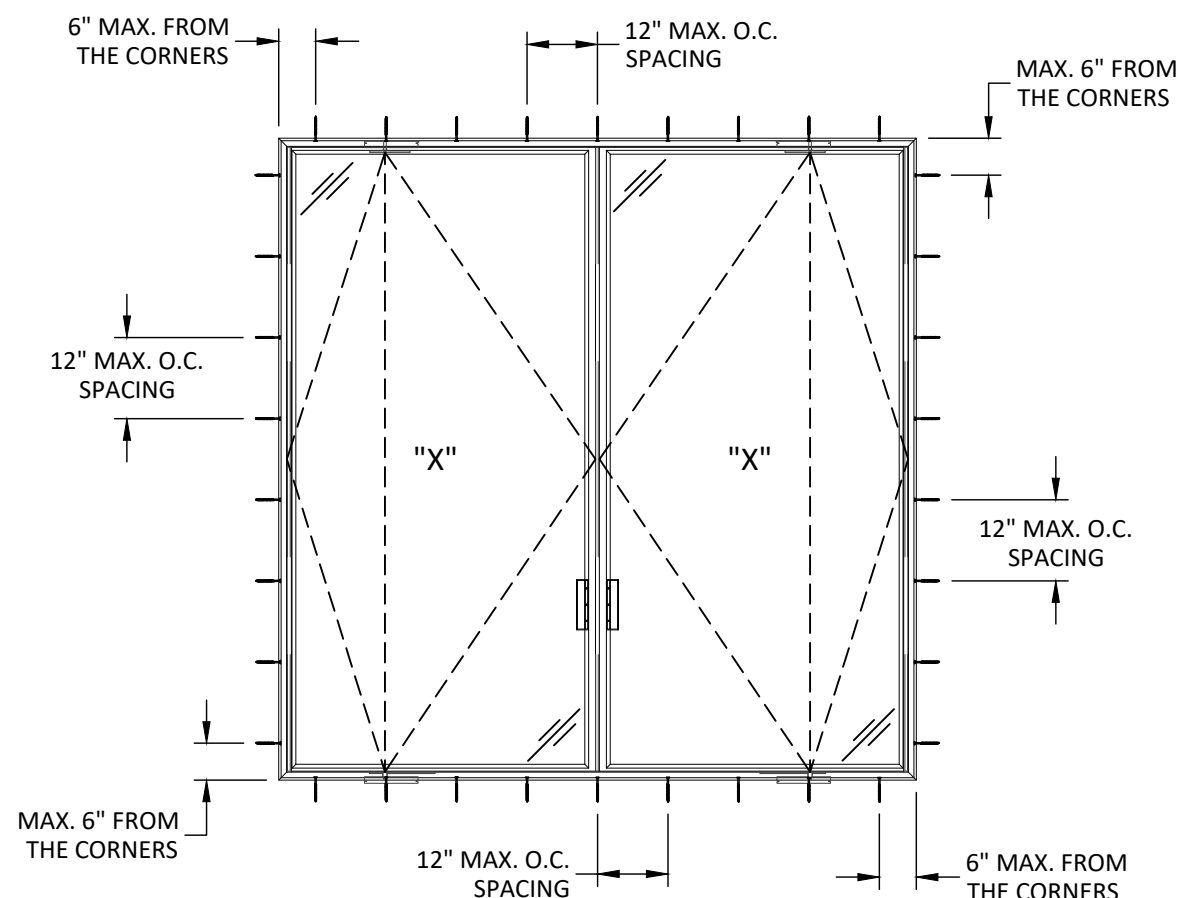


"XX" ANCHOR LAYOUT

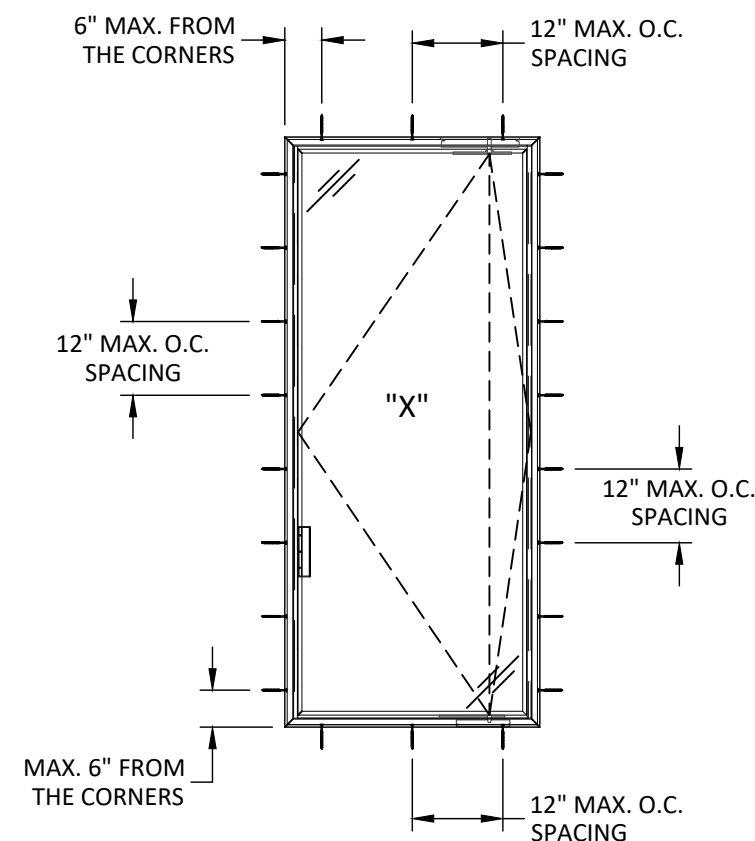


"X" ANCHOR LAYOUT THROUGH FRAME INSTALLATION


NOTE: TWO (2) ANCHORS PER LOCATION. NO ANCHORS THROUGH PIVOT HARDWARE LOCATION.

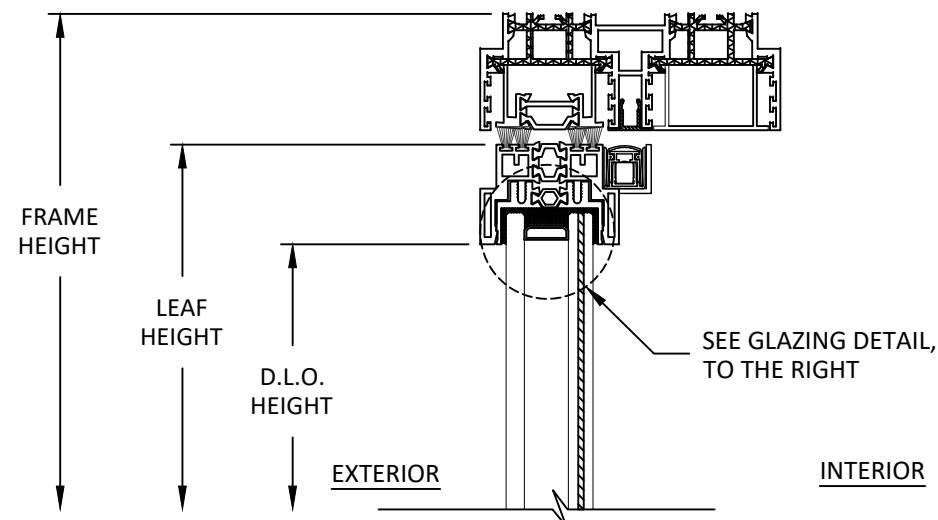

A
5 VERTICAL SECTION
HEAD

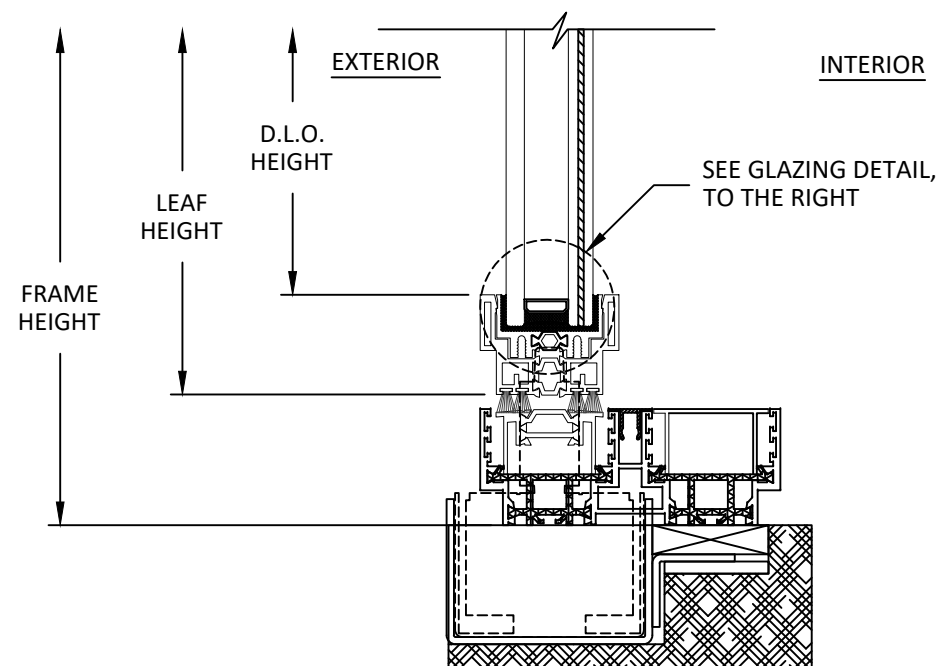

B
5 VERTICAL SECTION
SILL

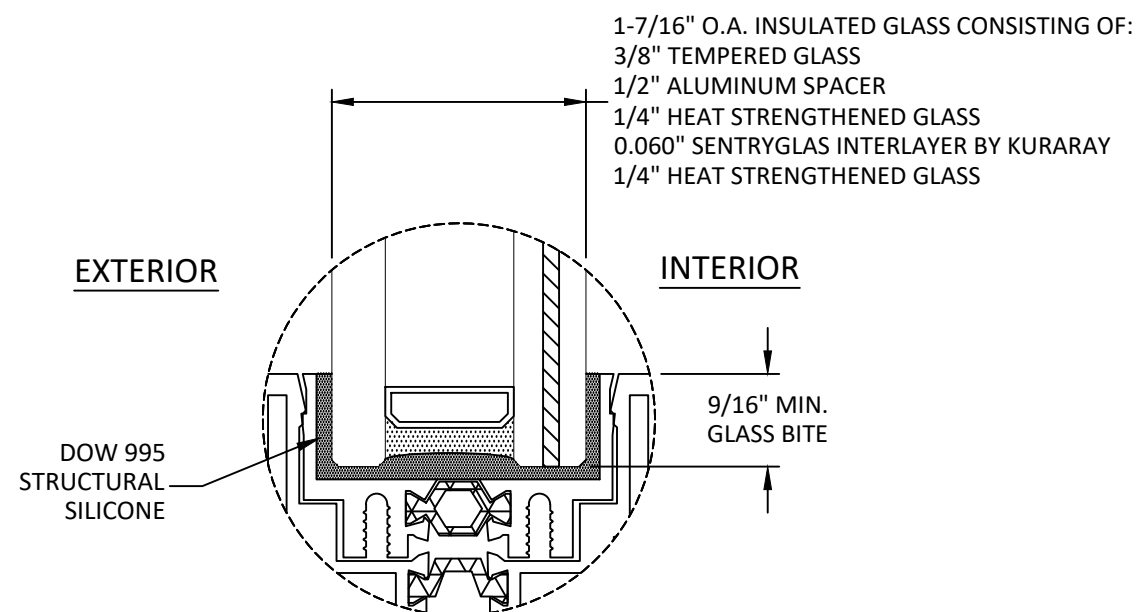

GLAZING DETAIL 1

GLAZING NOTES:

1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TITLE: *ah!38 INSWING PIVOT DOOR*
(HVHZ)/(IMPACT)


VERTICAL SECTIONS & GLAZING DETAIL

PREPARED BY: BUILDING DROPS, INC.



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A
LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

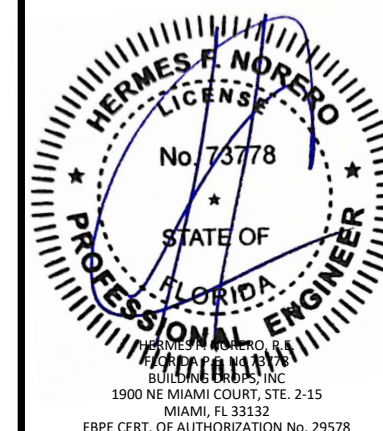

FL#:

FL46886

DATE: 04.11.2024

DWG. BY:
SH

CHK. BY:
HFN

SCALE: NTS

DWG. #: PAN012

SECTION:

5


HORIZONTAL SECTIONS

MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
www.buildingdrone.com



PREPARED BY: D

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE-SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:

FL46886

DATE: 04.11.2024

DWG. BY:
SH

CHK. BY:
HFN

SCALE: NTS

DWG. #: PAN012


SECTION:

6


DF 7




c:\Users\sebastianh\Documents\projects\panoramah\americas\lca\lca-bc-21-0430 - fbc submittal - ph38 pivot sliding door.dwg (pivot door) pan012.dwg
10/15/2024 11:28 AM

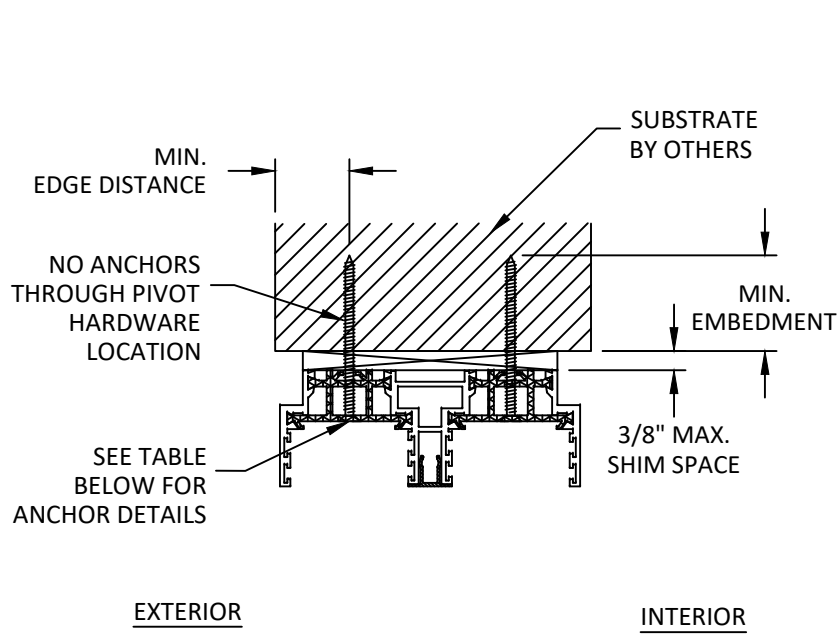

A
7 VERTICAL SECTION
HEAD - THROUGH FRAME

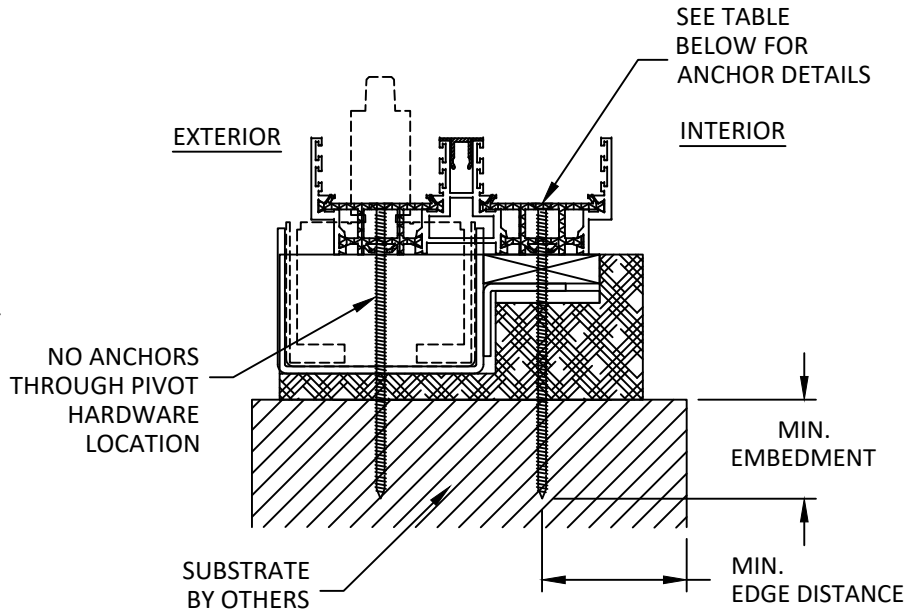

B
7 VERTICAL SECTION
SILL - THROUGH FRAME

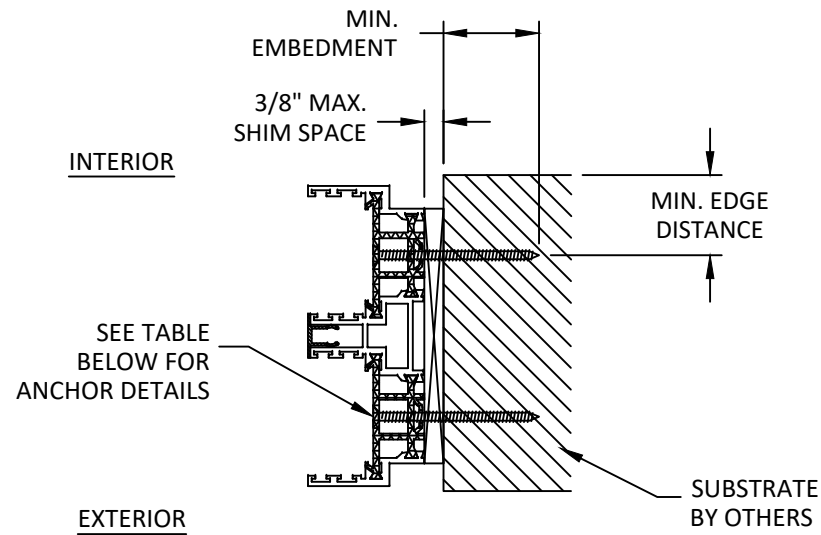

C
7 HORIZONTAL SECTION
JAMB - THROUGH FRAME

ANCHOR SCHEDULE					
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN. EMBEDMENT	MIN. EDGE DISTANCE	SPACING
THROUGH FRAME	WOOD: MIN. SG = 0.55	#14 WOOD SCREW	1.50"	0.75"	SEE SHEET 4
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	1/4" SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"	
	CONCRETE: f'c=3000PSI	1/4" ITW TAPCON	1.50"	2.50"	
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	1/4" ITW TAPCON	1.00"	2.50"	

TITLE: ah138 INSWING PIVOT DOOR
(HVHZ)/(IMPACT)

ANCHOR DETAILS &
ANCHOR SCHEDULE

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE
GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR
A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION
TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A
LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE
SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL46886
DATE:	04.11.2024
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	PAN012
SECTION:	7