


SHEET INDEX	
01	COVER PAGE
02	TYP. ELEVATION / ANCHORS DETAIL
03	SECTION DETAILS
04	SECTION DETAILS
05	GLAZING DETAILS
06	GLAZING DETAILS
07	PROFILES / INST. / BILL OF MATERIAL
TO OBTAIN AUTOCAD/REVIT COMPATIBLE DETAILS OF THIS PRODUCT, KINDLY GET IN TOUCH WITH US CONTACTING US VIA OUR OFFICIAL EMAIL ADDRESS: CONTACT@JA-PE.COM.	

ALUMINUM FIXED WINDOW

(*LARGE & SMALL MISSILE IMPACT - HVHZ*)

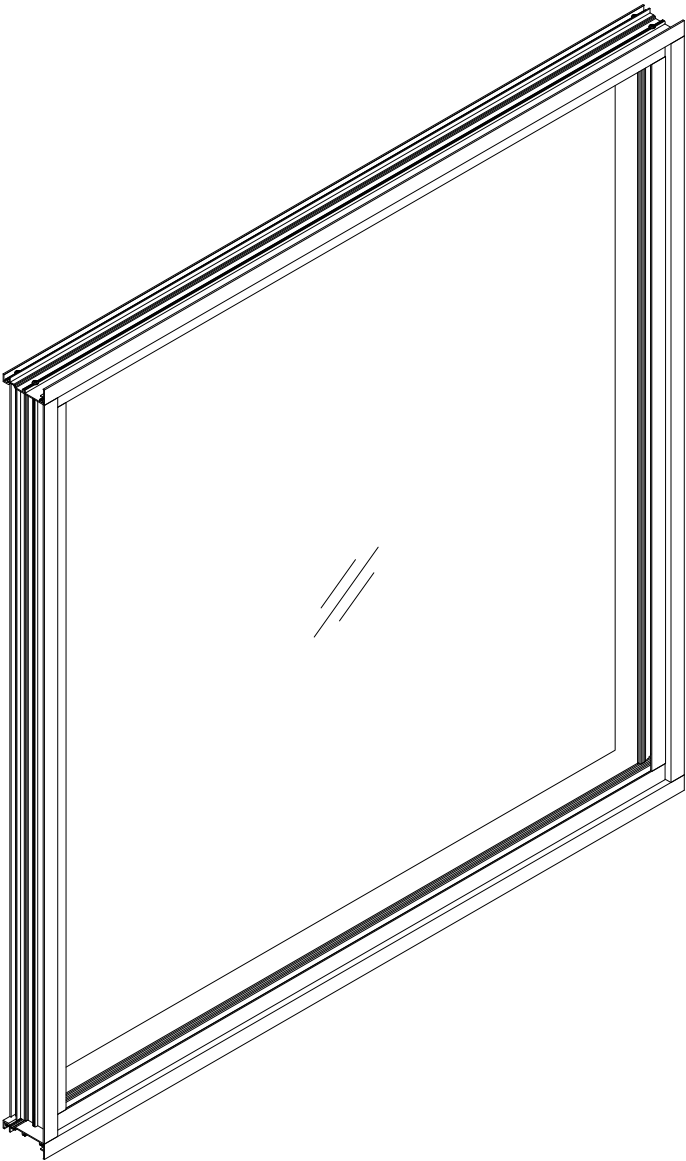

GENERAL NOTES

1. THIS SYSTEM PRESENTED HEREIN HAS UNDERGONE DESIGN AND TESTING IN FULL COMPLIANCE WITH THE FLORIDA BUILDING CODE EIGHTH EDITION (2023) AND IS INTENDED FOR USE IN HIGH VELOCITY HURRICANE ZONE PER TAS 201/202/203.

2. THE DESIGN PRESSURES OUTLINED IN THIS DOCUMENT ARE DERIVED FROM MAXIMUM TESTED PRESSURES AND INCORPORATE A 1.5 SAFETY FACTOR.

3. THE PRESSURES PROVIDED IN THIS CERTIFICATION ARE DETERMINED USING THE ALLOWABLE STRESS DESIGN METHOD (ASD).

4. THIS PRODUCT HAS BEEN RIGOROUSLY TESTED IN ACCORDANCE WITH THE STANDARDS DESCRIBED IN NOTE 1 OF THE GENERAL NOTES. IT IS CONFIRMED TO BE RESISTANT TO LARGE MISSILE IMPACT, THEREBY NOT NECESSITATING THE USE OF IMPACT-RESISTANT SHUTTERS.

5. THE DESIGN OF THIS SYSTEM DOES NOT INCORPORATE A 33-1/3% INCREASE IN ALLOWABLE STRESS. FOR WOOD ANCHOR DESIGN, A WIND LOAD DURATION FACTOR OF CD=1.6 HAS BEEN EMPLOYED.

6. THE ARCHITECT/ENGINEER OF RECORD RESPONSIBLE FOR THE PROJECT'S SUPERSTRUCTURE, WITH WHICH THIS DESIGN IS ASSOCIATED, SHALL ENSURE THE INTEGRITY OF ALL SUPPORTING SURFACES. COORDINATION WITH THE PERMITTING CONTRACTOR IS REQUIRED, AND PROPER ANCHORING OF WOOD BUCKS (BY OTHERS) MUST FACILITATE LOAD TRANSFER TO THE EXISTING STRUCTURE.
7. THE DETAILS OF THE SYSTEM PROVIDED HEREIN ARE OF A GENERIC NATURE AND DO NOT OFFER SPECIFIC SITE INFORMATION. FOR SITE CONDITIONS THAT DIFFER FROM THOSE SPECIFIED HERE, A LICENSED ENGINEER OR REGISTERED ARCHITECT MUST PREPARE SITE-SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS CERTIFICATION.

8. THE CONTRACTOR IS ACCOUNTABLE FOR INSULATING ALL MEMBERS FROM DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS (E.G., STEEL WITH ALUMINUM).

9. THE SUBSTITUTION OF FASTENERS DESCRIBED IN THIS CERTIFICATION IS PERMISSIBLE, PROVIDED THE ALTERNATIVE ANCHOR EXHIBITS STRENGTH EQUAL TO OR GREATER THAN THE ORIGINALLY SPECIFIED FINAL APPROVAL OF SUBSTITUTED ANCHORS SHALL BE GRANTED BY RELEVANT AUTHORITIES.

10. THE WOOD SCREWS REFERENCED IN THIS CERTIFICATION MUST MEET A MINIMUM GRADE OF 2 (FU = 74,000 PSI).

11. THE ENGINEER'S SEAL AFFIXED HERE VALIDATES THE STRUCTURAL DESIGN AS PRESENTED SOLELY. ANY USE OF THIS SPECIFICATION BY THE CONTRACTOR OR OTHERS INDEMNIFIES AND SAVES THE ENGINEER HARMLESS FROM ALL COSTS AND DAMAGES, INCLUDING LEGAL FEES AND APPELLATE FEES ARISING FROM MATERIAL FABRICATION, SYSTEM ERECTION, AND CONSTRUCTION PRACTICES BEYOND THE SCOPE CALLED FOR BY LOCAL, STATE, AND FEDERAL CODES OR DEVIATIONS FROM THE PLAN.


12. NO ADDITIONAL CERTIFICATIONS OR AFFIRMATIONS ARE INTENDED BEYOND WHAT IS EXPRESSLY PROVIDED IN THIS DOCUMENT.

13. ALTERATIONS, ADDITIONS, OR ANY MARKINGS TO THIS DOCUMENT ARE STRICTLY PROHIBITED AND WILL INVALIDATE THIS CERTIFICATION.

14. PROPER SAFETY MEASURES MUST BE OBSERVED DURING THE INSTALLATION AND USE OF THIS SYSTEM, EVEN THOUGH THEY ARE NOT EXPLICITLY LISTED IN THIS CERTIFICATION.

15. EACH PRODUCT SHALL BE PERMANENTLY LABELED WITH A MINIMUM OF ONE LABEL PER SYSTEM, CONTAINING THE FOLLOWING REQUIRED INFORMATION:
PLAZA DOOR COMPANY
4425 SW CARGO WAY
PALM CITY , FL 34990
PH: (561) 578-5450
info@plazadoorcompany.com

FL# 46998

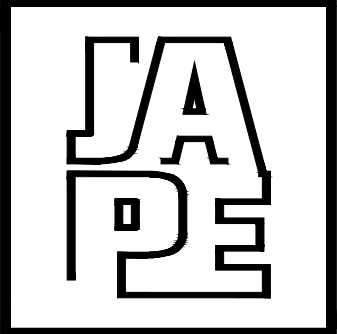


JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com


CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :			
ALUMINUM FIXED WINDOW (IMPACT) (HVHZ)			
CLIENT :			
NUEVO FLORIDA VENTURE, LLC D/B/A PLAZA DOOR			
4425 SW CARGO WAY, PALM CITY FL 34990, UNITED STATES			
REVISION			
No.	DATE	BY	DESCRIPTION
0	07/22/24		INITIAL ISSUE
date:		7/22/2024	
scale:		N/A	
drawn by:		M.S.	
check by:			
Drawing no.		JA-1463-24	
Eng: JAVAD AHMAD, PE CIVIL FLA. PE # 70592 – C.A.N. 34254			

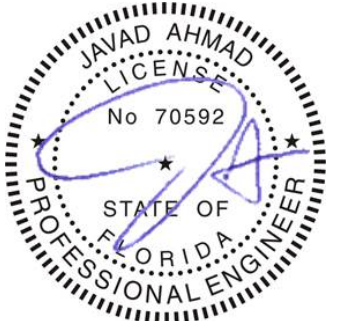

SEALED: 07/22/2024

COVER PAGE	SHEET No. 01 OF 07
------------	-----------------------

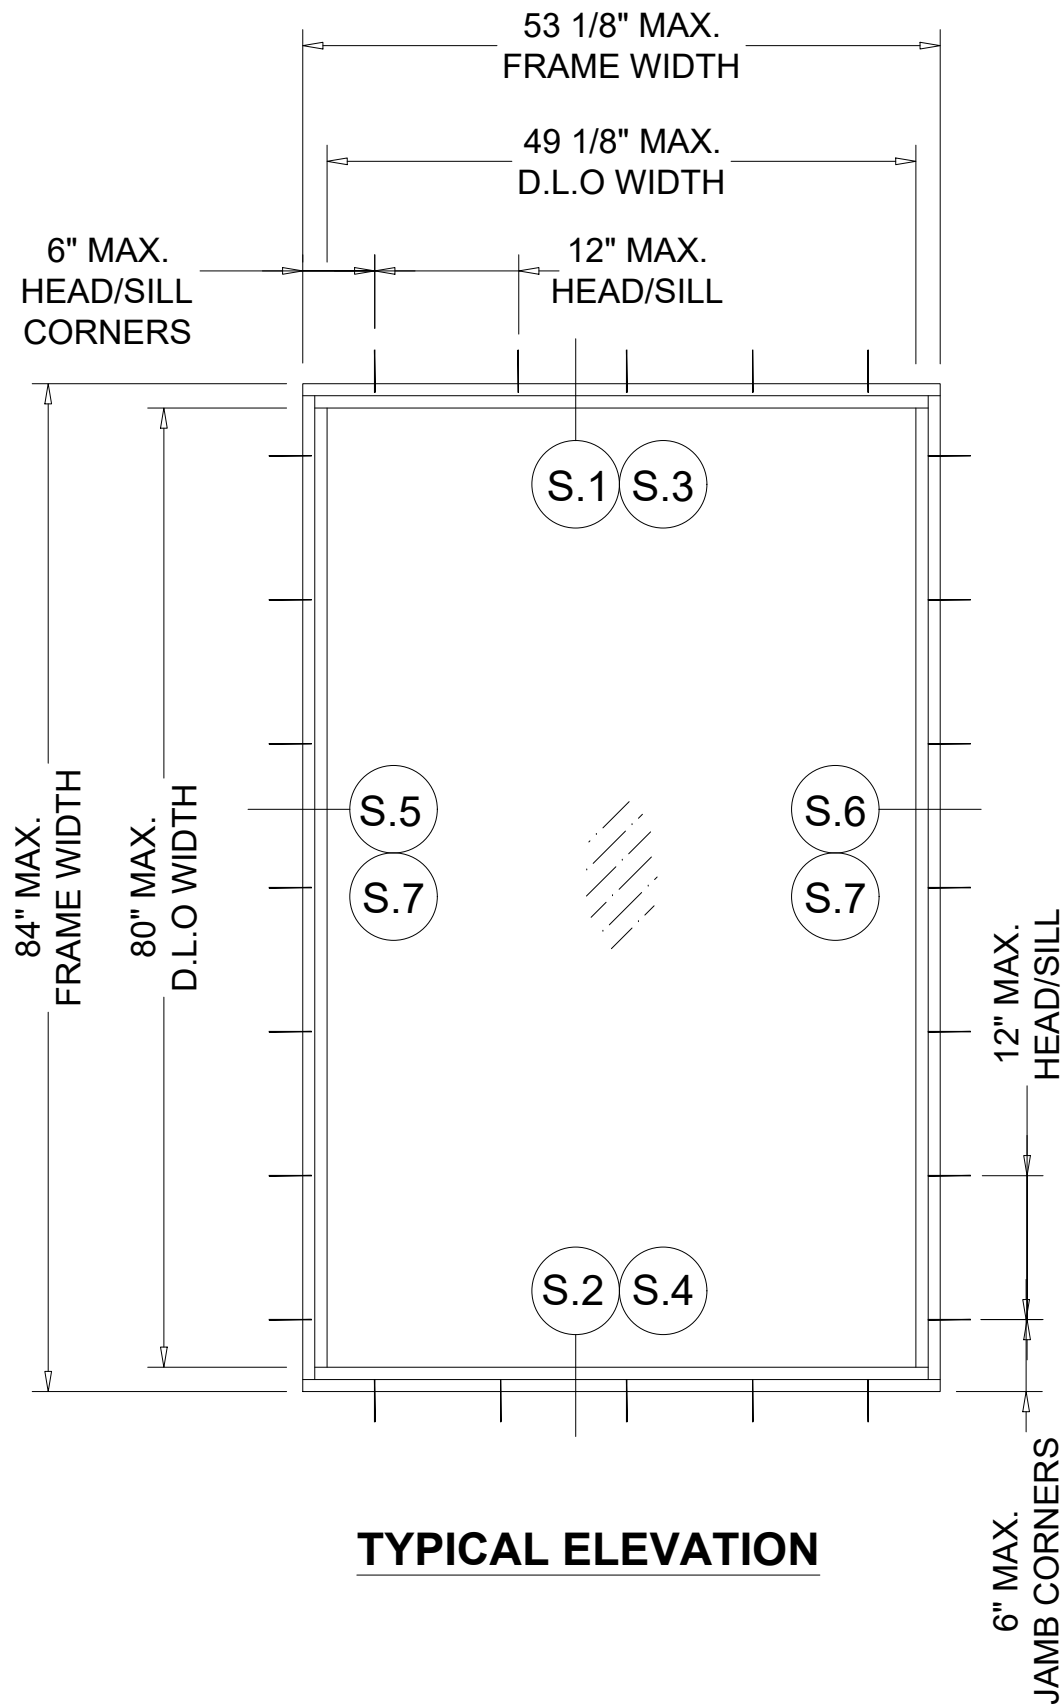

TYPICAL ELEVATION

SUBSTRATE ANCHORS:


- A** **1/4" DIA ULTRACON+ BY 'DEWALT'** (Fu=164 KSI, Fy=148 KSI)
INTO WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD / JAMBS)
- THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD, SILL & JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)
- B** **1/4" DIA ULTRACON+ BY 'DEWALT'** (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONC.OR BLOCKS
1-1/4" MIN. EMBED INTO CONC. (HEAD / SILL)
1-1/4" MIN. EMBED INTO CONC. OR BLOCKS (JAMBS)
- C** **14 SMS OR SELF-TAPPING HWH SCREWS** (GRADE 2)
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREAD MIN. PENETRATION BEYOND METAL SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 12 GA. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)
- D** **10 SMS OR SELF-TAPPING HWH SCREWS** (GRADE 5)
INTO F.B.C. APPROVED MULLIONS
(3) THREAD MIN. PENETRATION BEYOND SUBSTRATE
0.090" MIN. THK. .
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL ANCHOR EDGE DISTANCES
INTO CONCRETE (3000 PSI MIN.) = 2-1/4" MIN.
INTO CMU BLOCKS (2000 PSI MIN.) AT JAMBS = 2-1/4" MIN.
INTO WOOD STRUCTURE (0.55 MIN. S.G.) = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

SUBSTRATE STRENGTHS:

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f_c = 3000 PSI MIN.
C-90 GROUT HOLLOW / FILLED - BLOCK AT JAMBS f_m = 2000 PSI MIN.

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'PLAZA DOOR' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

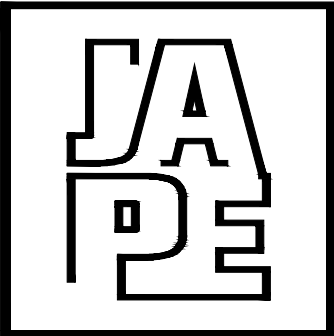

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :

ALUMINUM FIXED WINDOW
(IMPACT) (HVHZ)

CLIENT :

NUEVO FLORIDA VENTURE, LLC
D/B/A PLAZA DOOR

4425 SW CARGO WAY, PALM CITY
FL 34990, UNITED STATES

REVISION





No.	DATE	BY	DESCRIPTION
0	07/22/24		INITIAL ISSUE
date:		7/22/2024	
scale:		N/A	
drawn by:		M.S.	
check by:			
Drawing no.		JA-1463-24	

Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 – C.A.N. 34254



SEALED: 07/22/2024

FL# 46998

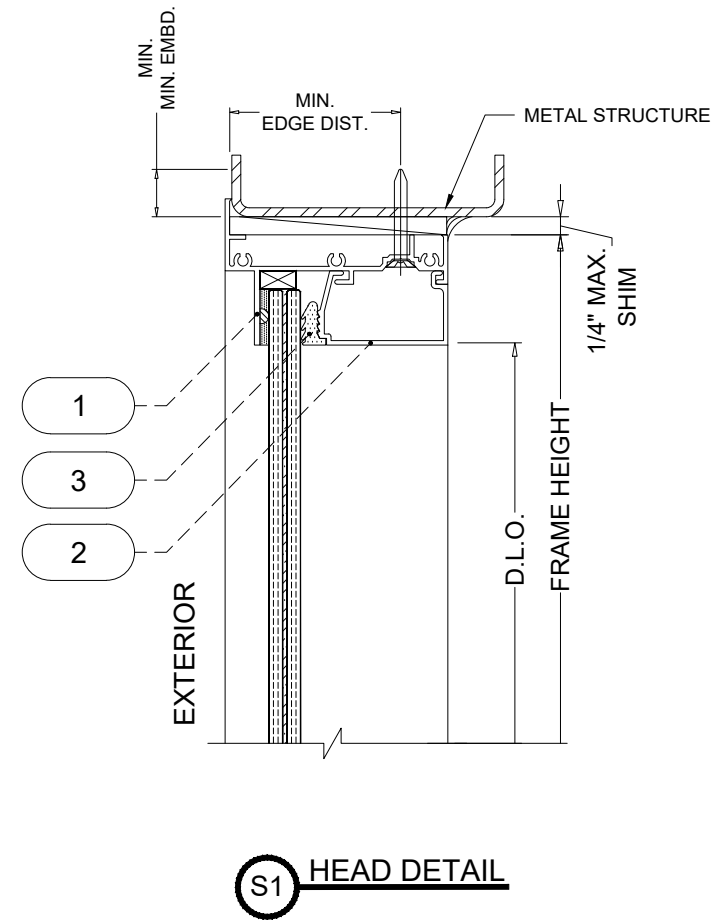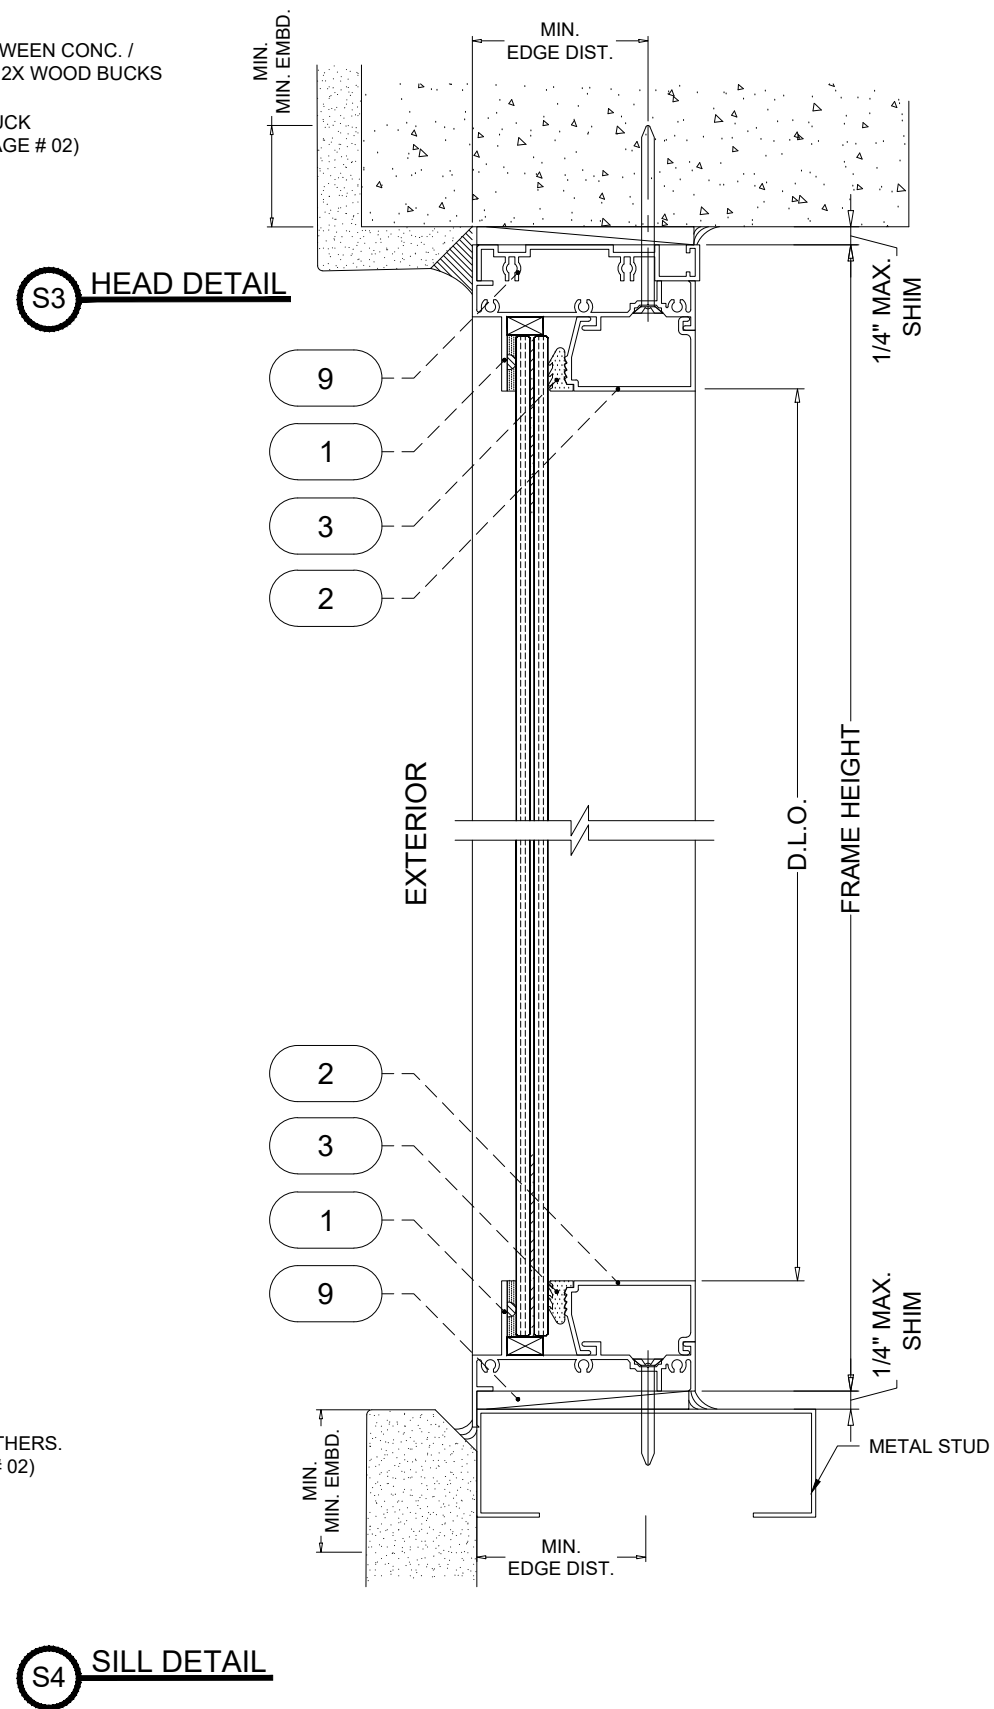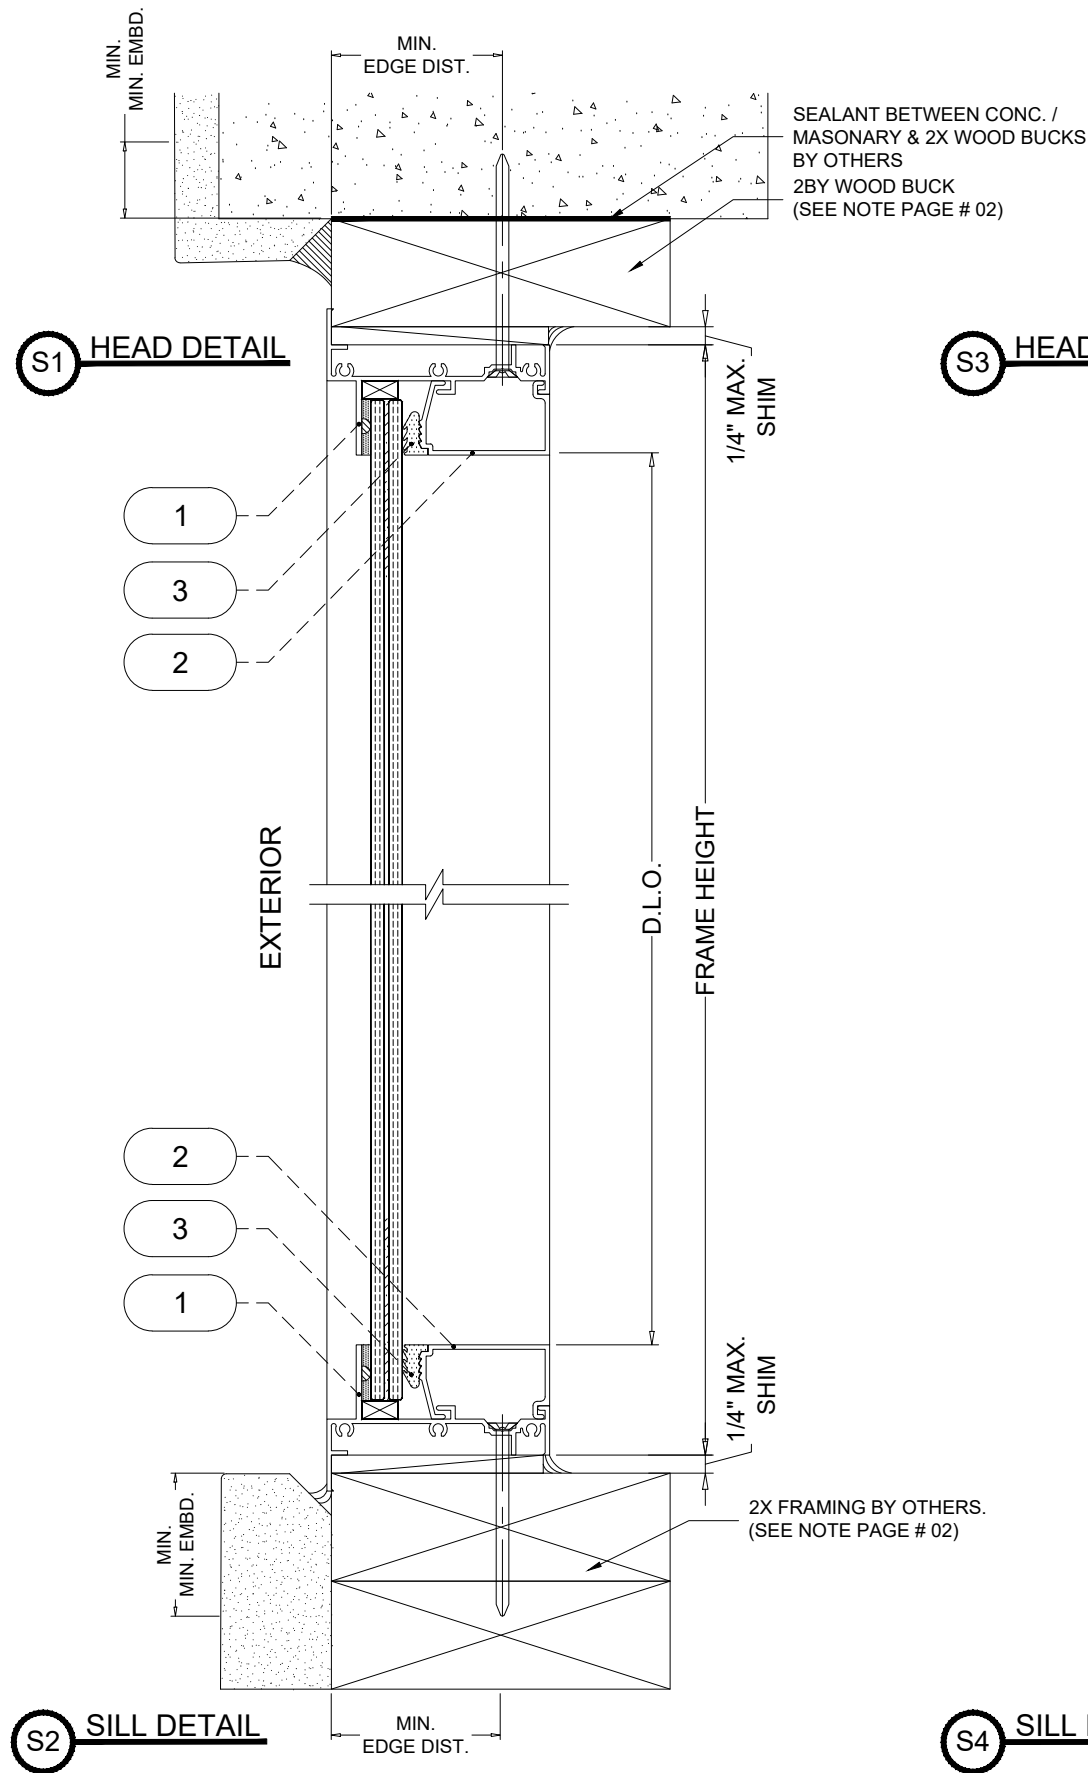

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :
ALUMINUM FIXED WINDOW (IMPACT) (HVHZ)
CLIENT :
NUEVO FLORIDA VENTURE, LLC D/B/A PLAZA DOOR
4425 SW CARGO WAY, PALM CITY FL 34990, UNITED STATES

REVISION			
No.	DATE	BY	DESCRIPTION
0	07/22/24		INITIAL ISSUE
date:		7/22/2024	
scale:		N/A	
drawn by:		M.S.	
check by:			
Drawing no.		JA-1463-24	


Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 – C.A.N. 34254




SEALED: 07/22/2024

FL# 46998


SEC. DETAILS	SHEET No. 03 OF 07
--------------	-----------------------

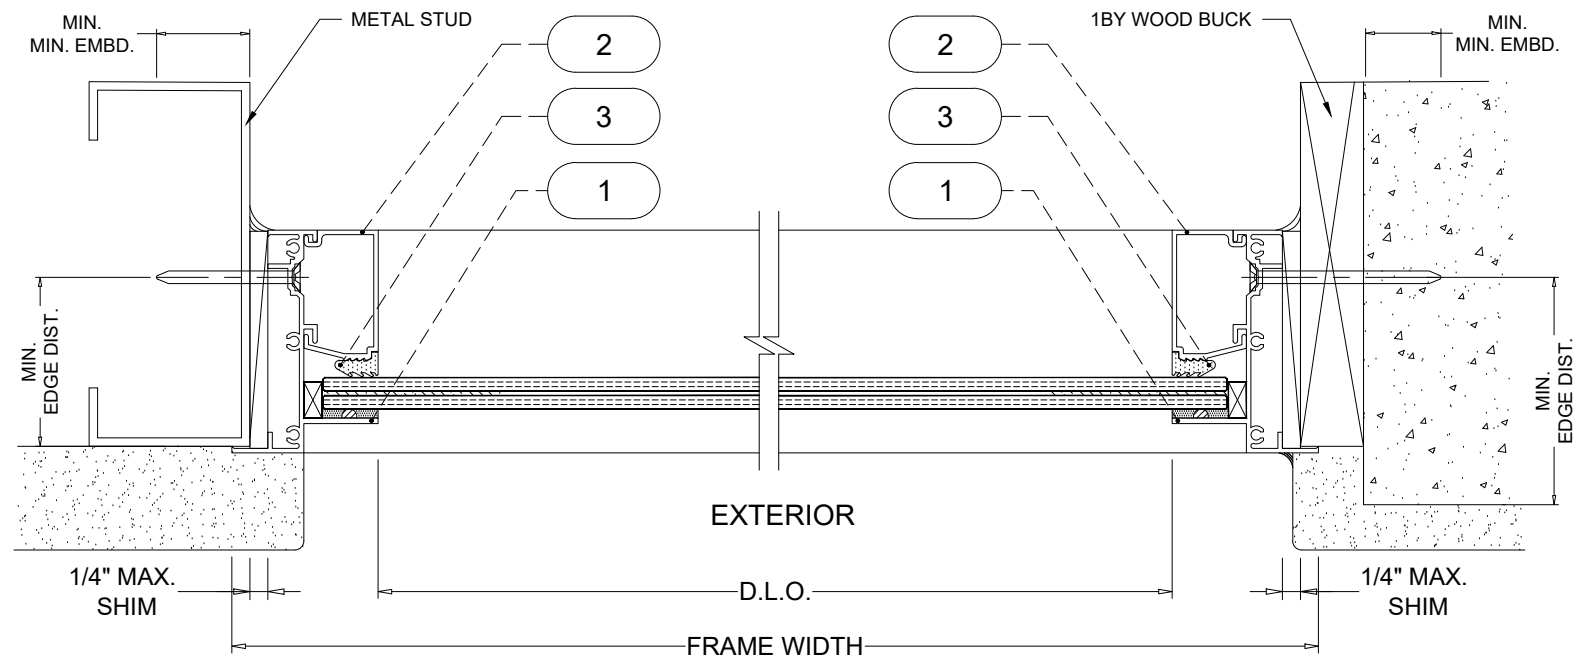


S5 JAMB DETAIL

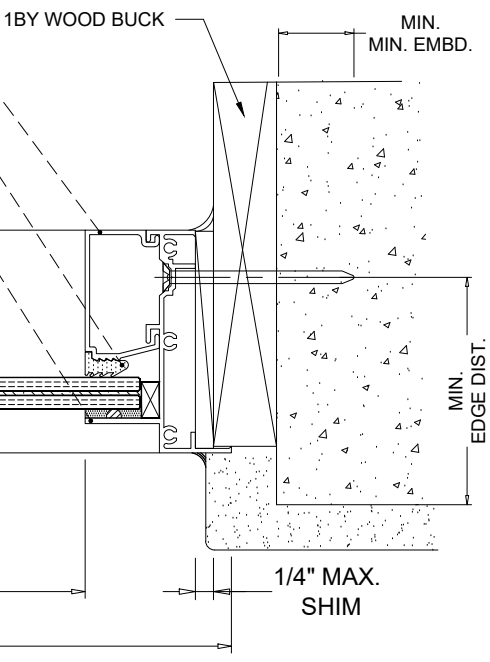


S6 JAMB DETAIL

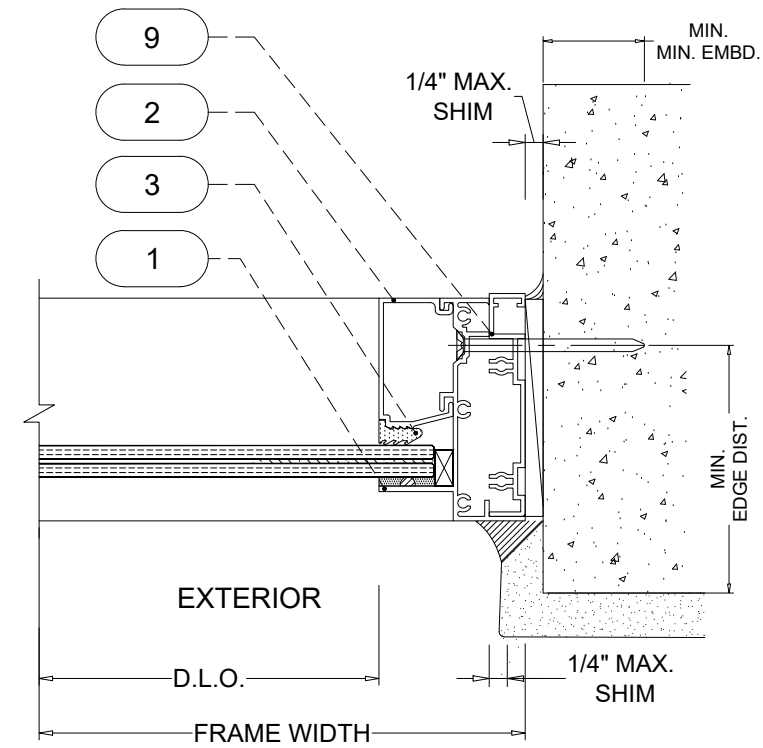


S7 JAMB DETAIL (OPTIONAL)

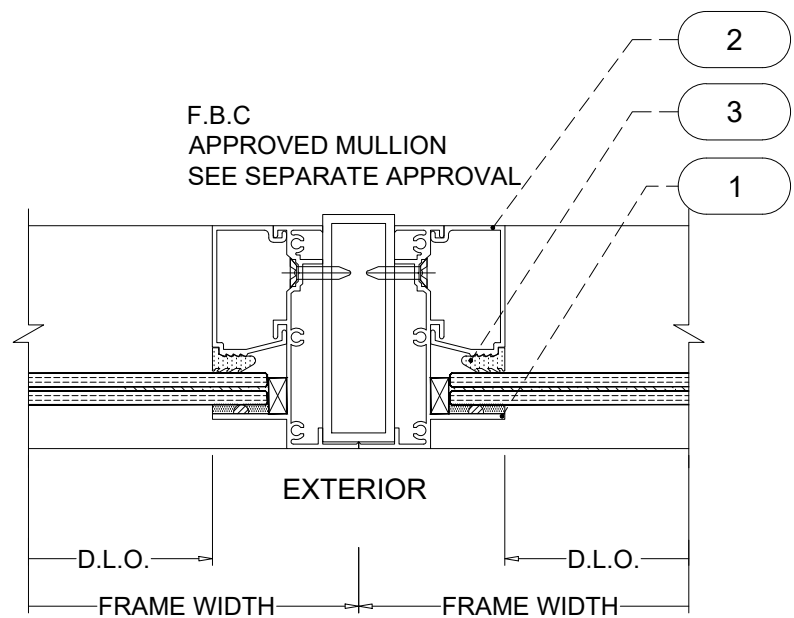

S8 MULLION DETAIL

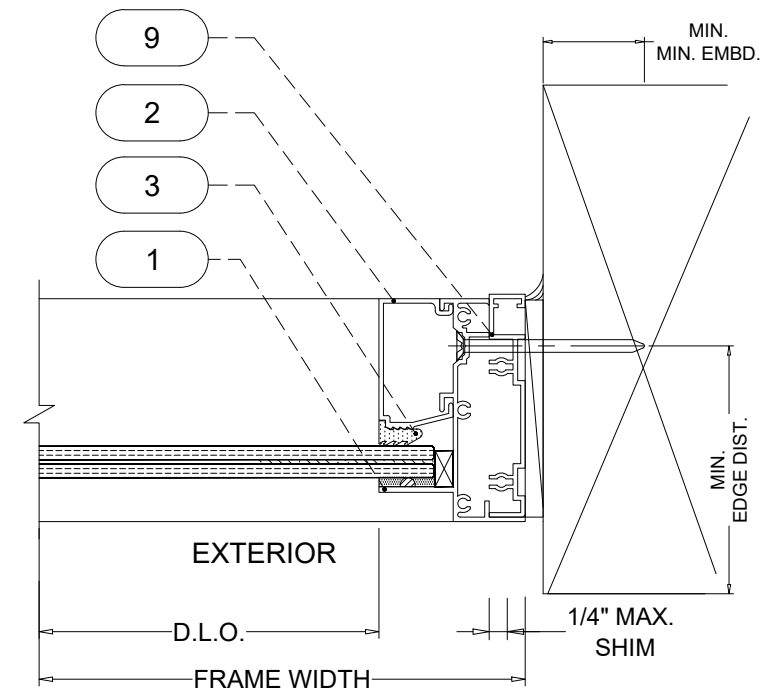

S7 JAMB DETAIL (OPTIONAL)

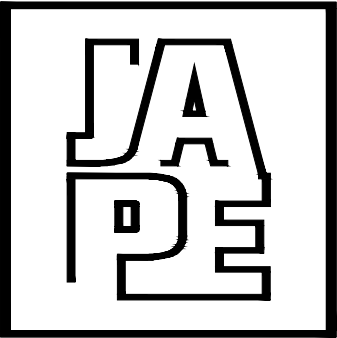


JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :
ALUMINUM FIXED WINDOW (IMPACT) (HVHZ)
CLIENT :
NUEVO FLORIDA VENTURE, LLC D/B/A PLAZA DOOR
4425 SW CARGO WAY, PALM CITY FL 34990, UNITED STATES

REVISION			
No.	DATE	BY	DESCRIPTION
0	07/22/24		INITIAL ISSUE
date:		7/22/2024	
scale:		N/A	
drawn by:		M.S.	
check by:			
Drawing no.		JA-1463-24	

Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 – C.A.N. 34254

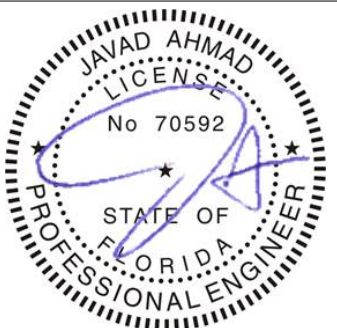

SEALED: 07/22/2024

FL# 46998

SEC. DETAILS


SHEET No.
04 OF 07

SIZES & PRESSURES FOR S.M.I. IMPACT GLASS CONFIGURATION:

DESIGN LOAD CAPACITY (PSF)(SMI)							
LENGTH INCHES	WIDTH INCHES	SERIES 3062		SERIES 3072 (BUTACITE)		SERIES 3072 (SAFLEX)	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26.00	19	90.0	120.0	90.0	155.0	90.0	140.0
	24	90.0	120.0	90.0	155.0	90.0	140.0
	26	90.0	120.0	90.0	155.0	90.0	140.0
	32	90.0	120.0	90.0	155.0	90.0	140.0
	37	90.0	120.0	90.0	155.0	90.0	140.0
	40	90.0	120.0	90.0	155.0	90.0	140.0
	46	90.0	120.0	90.0	155.0	90.0	140.0
	53	90.0	120.0	90.0	155.0	90.0	140.0
	60	90.0	120.0	90.0	155.0	90.0	140.0
	75	90.0	120.0	90.0	155.0	90.0	140.0
38.75	19	90.0	120.0	90.0	155.0	90.0	140.0
	24	90.0	120.0	90.0	155.0	90.0	140.0
	26	90.0	120.0	90.0	155.0	90.0	140.0
	32	90.0	120.0	90.0	155.0	90.0	140.0
	37	90.0	120.0	90.0	155.0	90.0	140.0
	40	90.0	120.0	90.0	155.0	90.0	140.0
	46	90.0	120.0	90.0	155.0	90.0	140.0
	53	90.0	120.0	90.0	155.0	90.0	140.0
	60	90.0	120.0	90.0	155.0	90.0	140.0
	75	90.0	120.0	90.0	155.0	90.0	140.0
50.75	19	90.0	120.0	90.0	155.0	90.0	140.0
	24	90.0	120.0	90.0	155.0	90.0	140.0
	26	90.0	120.0	90.0	155.0	90.0	140.0
	32	90.0	120.0	90.0	155.0	90.0	140.0
	37	90.0	120.0	90.0	155.0	90.0	140.0
	40	90.0	120.0	90.0	155.0	90.0	140.0
	46	90.0	120.0	90.0	155.0	90.0	140.0
	53	90.0	120.0	90.0	155.0	90.0	140.0
	60	90.0	120.0	90.0	155.0	90.0	140.0
	75	70.0	76.4	90.0	140.0	90.0	140.0
63.00	19	90.0	120.0	90.0	155.0	90.0	140.0
	24	90.0	120.0	90.0	155.0	90.0	140.0
	26	90.0	120.0	90.0	155.0	90.0	140.0
	32	90.0	120.0	90.0	155.0	90.0	140.0
	37	90.0	120.0	90.0	155.0	90.0	140.0
	40	90.0	120.0	90.0	155.0	90.0	140.0
	46	90.0	120.0	90.0	155.0	90.0	140.0
	53	90.0	120.0	90.0	155.0	90.0	140.0
	60	70.0	76.4	90.0	140.0	90.0	140.0
	75	-	-	90.0	140.0	89.0	138.0


- NOTE:
- GLASS TYPE AND THICKNESS COMPLY WITH ASTM E-1300 GLASS CHART REQUIREMENTS.
 - ALL GLAZING CONFIGURATIONS COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC.
 - SETTING BLOCK SHALL BE 70-90 DUROMETER AS PER CH 24 OF THE CURRENT FBC.
 - GLASS LITES THAT EXCEED 36" IN WIDTH SHALL USE SETTING BLOCKS AT 1/4 SPAN FROM CORNERS.

DESIGN LOAD CAPACITY (PSF)(SMI)							
LENGTH INCHES	WIDTH INCHES	SERIES 3062		SERIES 3072 (BUTACITE)		SERIES 3072 (SAFLEX)	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
76.00	19	90.0	120.0	90.0	155.0	90.0	140.0
	24	90.0	120.0	90.0	155.0	90.0	140.0
	26	90.0	120.0	90.0	155.0	90.0	140.0
	32	90.0	120.0	90.0	155.0	90.0	140.0
	37	90.0	114.0	90.0	155.0	90.0	140.0
	40	90.0	104.0	90.0	155.0	90.0	140.0
	46	70.0	76.4	90.0	155.0	90.0	140.0
	53	70.0	76.4	90.0	140.0	90.0	140.0
	60	-	-	90.0	140.0	89.0	139.0
	75	-	-	-	-	-	-
84.00	19	90.0	120.0	90.0	155.0	90.0	140.0
	24	90.0	120.0	90.0	155.0	90.0	140.0
	26	90.0	120.0	90.0	155.0	90.0	140.0
	32	90.0	120.0	90.0	155.0	90.0	140.0
	37	90.0	120.0	90.0	155.0	90.0	140.0
	40	70.0	76.4	90.0	155.0	90.0	140.0
	46	70.0	76.4	90.0	140.0	90.0	140.0
	53	70.0	75.0	90.0	140.0	89.0	139.0
	60	-	-	90.0	140.0	84.0	131.0
	75	-	-	-	-	-	-
96.00	19	90.0	120.0	90.0	155.0	90.0	140.0
	24	90.0	120.0	90.0	155.0	90.0	140.0
	26	90.0	120.0	90.0	155.0	90.0	140.0
	32	90.0	120.0	90.0	155.0	90.0	140.0
	37	70.0	76.4	90.0	140.0	90.0	140.0
	40	70.0	76.4	90.0	140.0	90.0	140.0
	46	70.0	76.0	90.0	140.0	90.0	140.0
	53	-	-	90.0	140.0	84.0	131.0
	60	-	-	-	-	-	-
	75	-	-	-	-	-	-

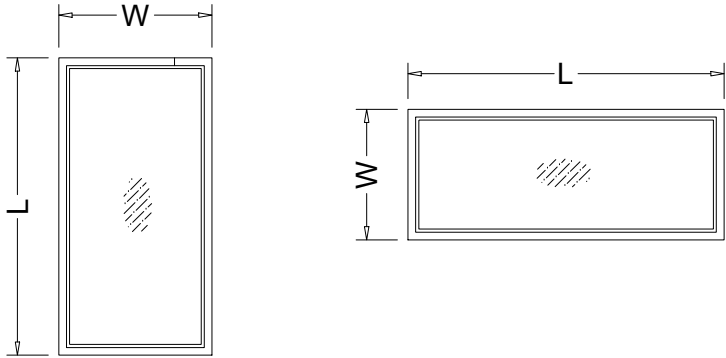


- NOTE:
- WINDOW WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FT. AREA.
- ANCHOR SPACING SHALL NOT EXCEED THOSE SHOWN FOR LONG OR SHORT LEG OF UNIT.

SIZES AND PRESSURES FOR SMALL MISSILE IMPACT GLASS CONFIGURATION

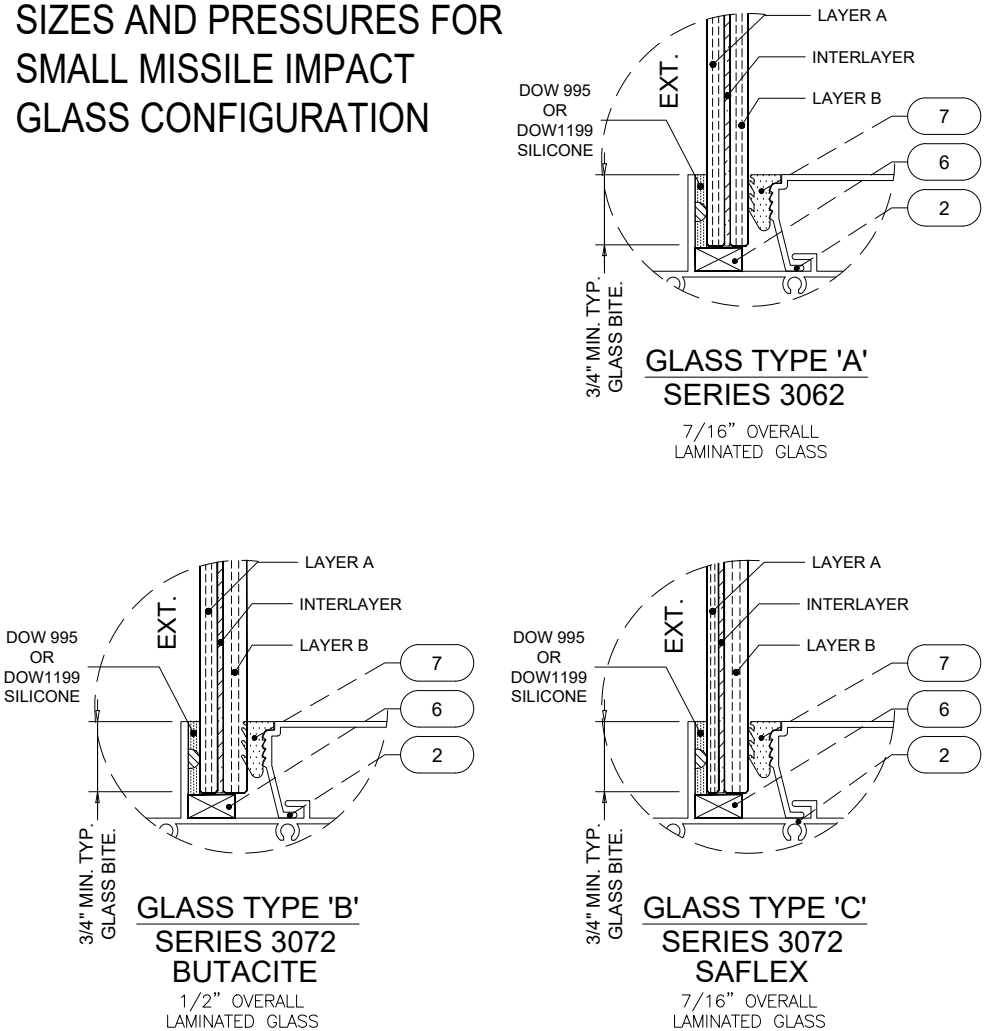


GLAZING DETAILS			
GLASS TYPE	LAYER A	INTERLAYER	LAYER B
A	3/16" HEAT STREN'D GLASS	0.090" SENTRYGLASS INTERLAYER BY 'DUPOINT.	3/16" HEAT STREN'D GLASS
B	3/16" HEAT STREN'D GLASS	0.090" BUTACITE PVB INTERLAYER BY 'DUPOINT	1/4" TEMPERED GLASS
C	1/8" ANNEALED GLASS	0.090" SAFLEX CLEAR/COLOR INTERLAYER BY 'EASTMAN CHEMICAL CO.	1/4" TEMPERED GLASS

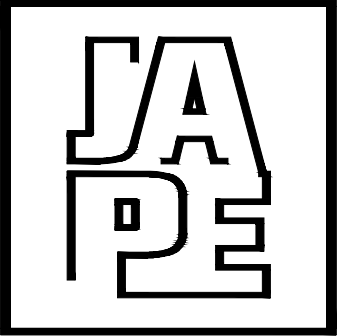

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :			
ALUMINUM FIXED WINDOW (IMPACT) (HVHZ)			
CLIENT :			
NUEVO FLORIDA VENTURE, LLC D/B/A PLAZA DOOR			
4425 SW CARGO WAY, PALM CITY FL 34990, UNITED STATES			
REVISION			
No.	DATE	BY	DESCRIPTION
0	07/22/24		INITIAL ISSUE
date:		7/22/2024	
scale:		N/A	
drawn by:		M.S.	
check by:			
Drawing no.		JA-1463-24	
Eng: JAVAD AHMAD, PE CIVIL FLA. PE # 70592 — C.A.N. 34254			

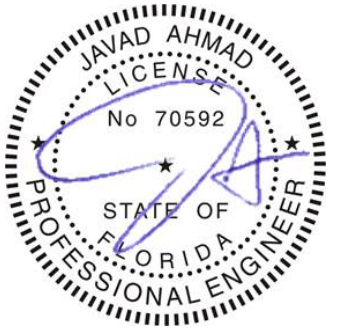

SEALED: 07/22/2024

FL# 46998


GLAZING DETAILS	SHEET No. 05 OF 07
-----------------	-----------------------

SIZES & PRESSURES FOR L.M.I. IMPACT GLASS CONFIGURATION:



DESIGN LOAD CAPACITY (PSF)(LMI)					
LENGTH INCHES	WIDTH INCHES	SERIES 3062		SERIES 3040	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
26.00	19	90.0	120.0	62.0	62.0
	24	90.0	120.0	62.0	62.0
	26	90.0	120.0	62.0	62.0
	32	90.0	120.0	62.0	62.0
	37	90.0	120.0	62.0	62.0
	40	90.0	120.0	62.0	62.0
	46	90.0	120.0	62.0	62.0
	53	90.0	120.0	62.0	62.0
	60	90.0	120.0	62.0	62.0
	75	90.0	120.0	62.0	62.0
38.75	19	90.0	120.0	62.0	62.0
	24	90.0	120.0	62.0	62.0
	26	90.0	120.0	62.0	62.0
	32	90.0	120.0	62.0	62.0
	37	90.0	120.0	62.0	62.0
	40	90.0	120.0	59.2	59.2
	46	90.0	120.0	59.2	59.2
	53	90.0	120.0	59.2	59.2
	60	90.0	120.0	59.2	59.2
	75	90.0	120.0	-	-
50.75	19	90.0	120.0	62.0	62.0
	24	90.0	120.0	62.0	62.0
	26	90.0	120.0	62.0	62.0
	32	90.0	120.0	62.0	62.0
	37	90.0	120.0	62.0	62.0
	40	90.0	120.0	57.4	57.4
	46	90.0	120.0	49.9	49.9
	53	90.0	120.0	45.2	45.2
	60	90.0	120.0	-	-
	75	70.0	76.4	-	-
63.00	19	90.0	120.0	62.0	62.0
	24	90.0	120.0	62.0	62.0
	26	90.0	120.0	62.0	62.0
	32	90.0	120.0	62.0	62.0
	37	90.0	120.0	62.0	62.0
	40	90.0	120.0	57.4	57.4
	46	90.0	120.0	-	-
	53	90.0	120.0	-	-
	60	70.0	76.4	-	-
	75	-	-	-	-

- NOTE:
- GLASS TYPE AND THICKNESS COMPLY WITH ASTM E-1300 GLASS CHART REQUIREMENTS.
 - ALL GLAZING CONFIGURATIONS COMPLY WITH SAFETY GLAZING REQUIREMENTS OUTLINED IN CURRENT FBC.
 - SETTING BLOCK SHALL BE 70-90 DUROMETER AS PER CH 24 OF THE CURRENT FBC.
 - GLASS LITES THAT EXCEED 36" IN WIDTH SHALL USE SETTING BLOCKS AT 1/4 SPAN FROM CORNERS.

DESIGN LOAD CAPACITY (PSF)(LMI)					
LENGTH INCHES	WIDTH INCHES	SERIES 3062		SERIES 3040	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
76.00	19	90.0	120.0	62.0	62.0
	24	90.0	120.0	62.0	62.0
	26	90.0	120.0	62.0	62.0
	32	90.0	120.0	62.0	62.0
	37	90.0	114.0	62.0	62.0
	40	90.0	104.0	-	-
	46	70.0	76.4	-	-
	53	70.0	76.4	-	-
	60	-	-	-	-
	75	-	-	-	-
84.00	19	90.0	120.0	62.0	62.0
	24	90.0	120.0	62.0	62.0
	26	90.0	120.0	62.0	62.0
	32	90.0	120.0	62.0	62.0
	37	90.0	120.0	-	-
	40	70.0	76.4	-	-
	46	70.0	76.4	-	-
	53	70.0	75.0	-	-
	60	-	-	-	-
	75	-	-	-	-
96.00	19	90.0	120.0	62.0	62.0
	24	90.0	120.0	62.0	62.0
	26	90.0	120.0	62.0	62.0
	32	90.0	120.0	-	-
	37	70.0	76.4	-	-
	40	70.0	76.4	-	-
	46	70.0	76.0	-	-
	53	-	-	-	-
	60	-	-	-	-
	75	-	-	-	-

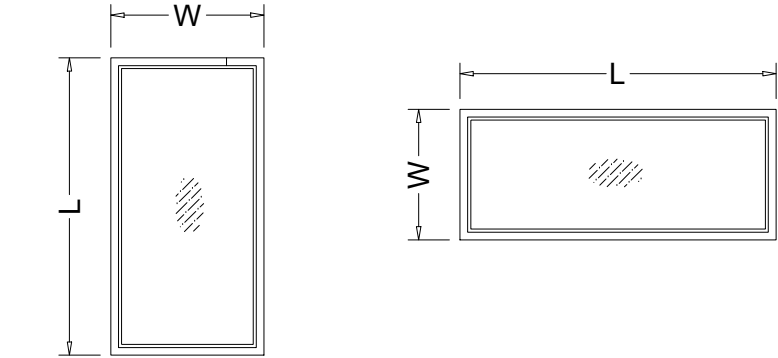


NOTE:
WINDOW WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FT. AREA.
ANCHOR SPACING SHALL NOT EXCEED THOSE SHOWN FOR LONG OR SHORT LEG OF UNIT.

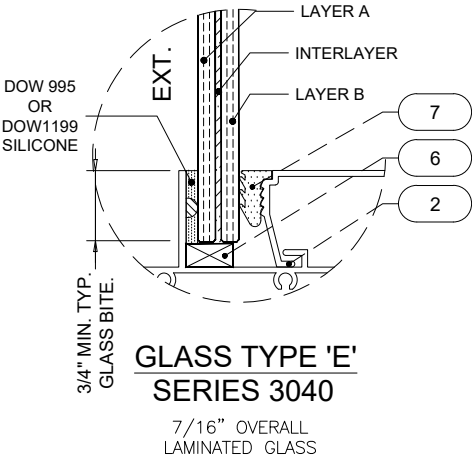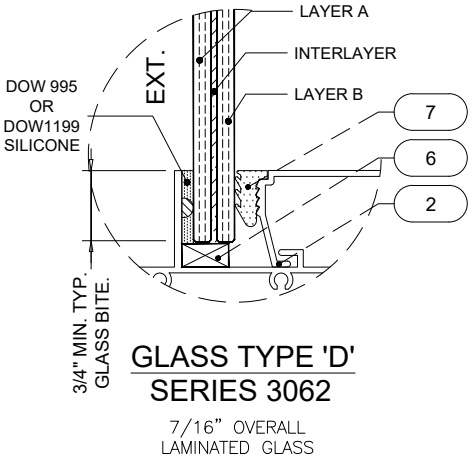

GLAZING DETAILS			
GLASS TYPE	LAYER A	INTERLAYER	LAYER B
D	3/16" HEAT STREN'D GLASS	0.090" SENTRYGLASS INTERLAYER BY 'DUPOINT.	3/16" HEAT STREND' GLASS
E	3/16" ANNEALED GLASS	0.090" PVB INTERLAYER SAFLEX BY 'SOLUTIA	3/16" ANNEALED GLASS

FL# 46998

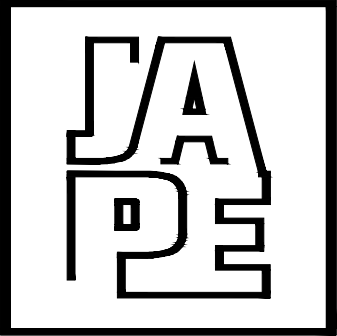


JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com

CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :			
ALUMINUM FIXED WINDOW (IMPACT) (HVHZ)			
CLIENT :			
NUEVO FLORIDA VENTURE, LLC D/B/A PLAZA DOOR			
4425 SW CARGO WAY, PALM CITY FL 34990, UNITED STATES			
REVISION			
No.	DATE	BY	DESCRIPTION
0	07/22/24		INITIAL ISSUE
date:		7/22/2024	
scale:		N/A	
drawn by:		M.S.	
check by:			
Drawing no.		JA-1463-24	
Eng: JAVAD AHMAD, PE CIVIL FLA. PE # 70592 – C.A.N. 34254			

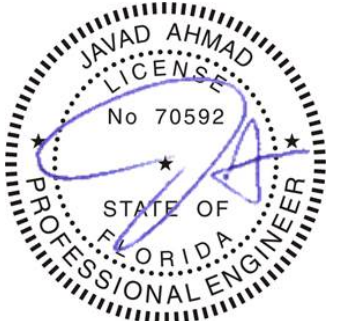


SEALED: 07/22/2024


GLAZING DETAILS

SHEET No.
06 OF 07


CORNER CONNECTION DETAIL

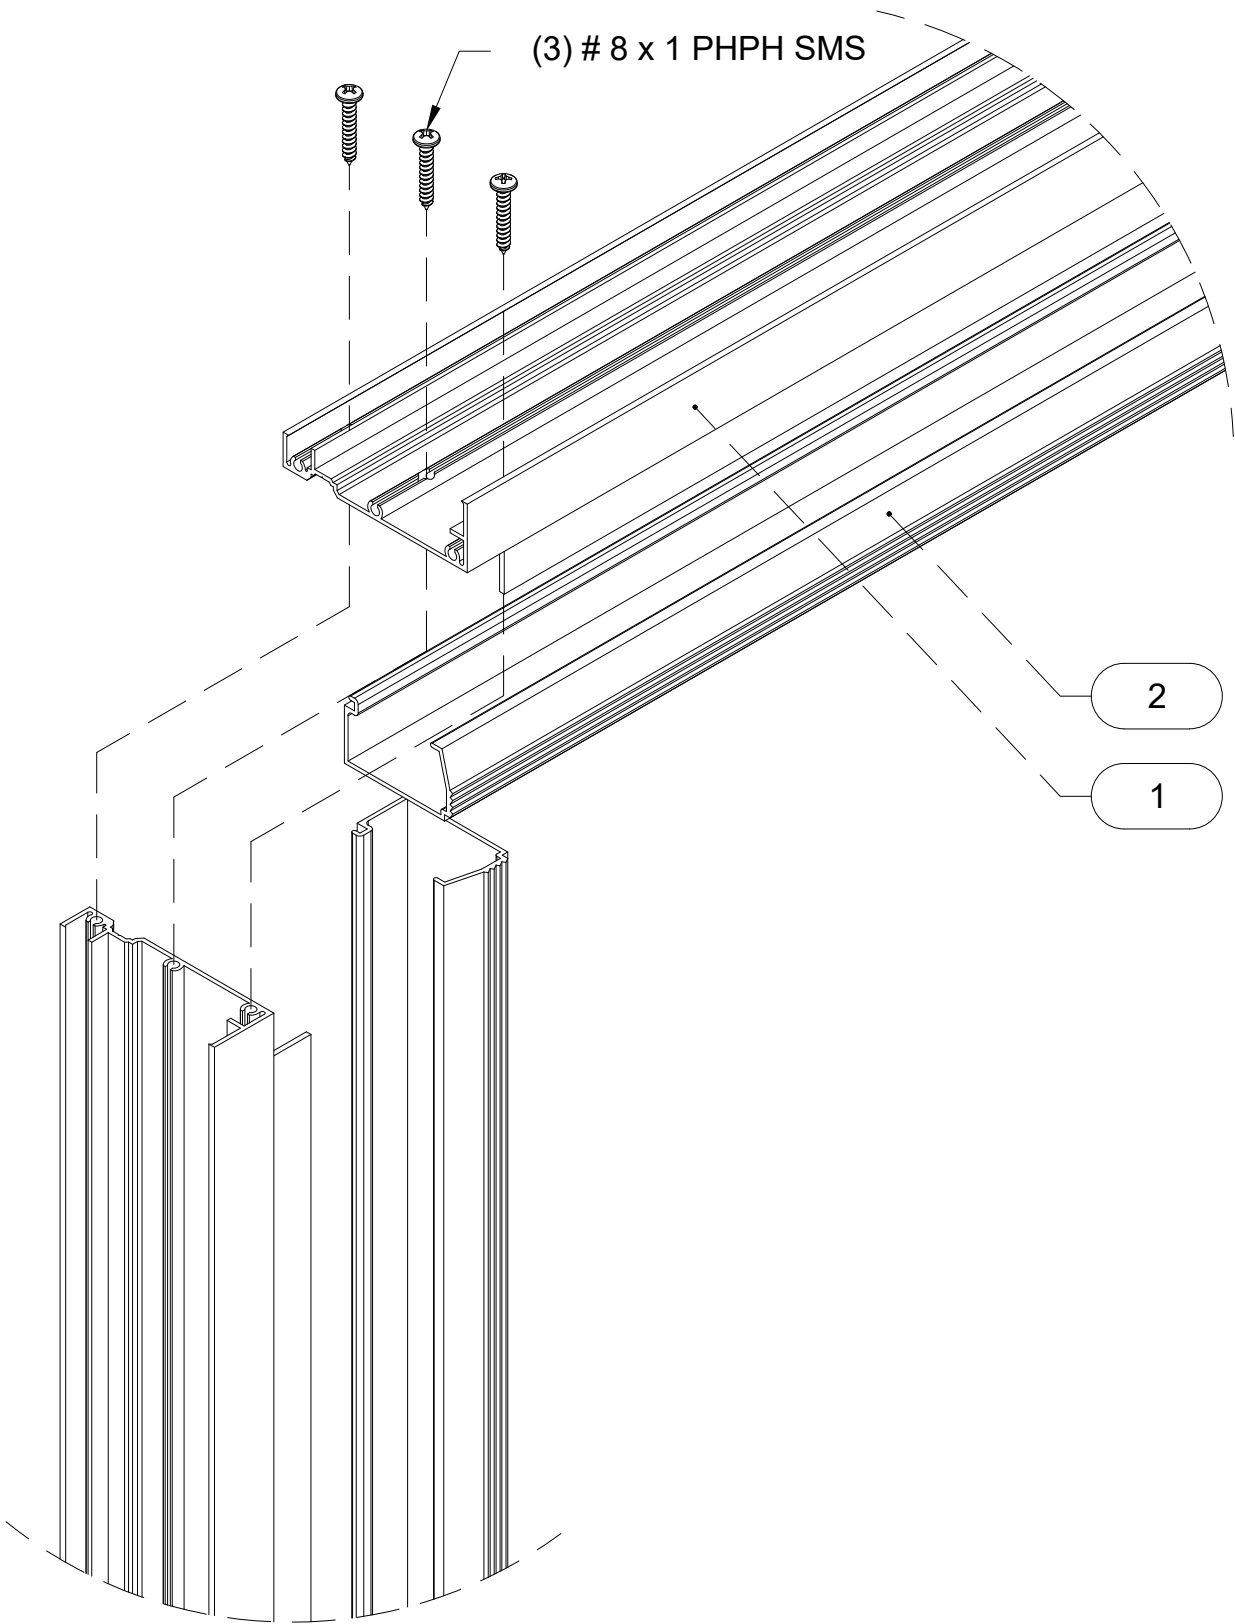


BILL OF MATERIALS				
ITEM #	PART NO.	DESCRIPTION	MATERIAL	MANUF. / SUPPLIER / REMARKS
1	021-024	FRAME HEAD	6063-T5	ARCH ALUMN
2	021-020	GLAZING STOP	6063-T5	-
3	008-014	# 8 x 1 PPH SMS	ST/ST	-
4	012-001	SEAM SEALER	ACRYLIC	SCHNEE MOREHEAD
5	012-003	DOW 995	SILICONE	DOW CORNING
6	015-008	1 / 2XL 4XL / SETTING BLOCK	80 DUROMETER NEOPRENE	FRANK LOWE RUBBER
7	015-007	WEDGE GASKET	VINYL	MASTER TOOL
8	015-006	0.150 SPACER	VINYL	FRANK LOWE RUBBER
9	-	LEG ADAPTOR	6063-T5	ARCH ALUMN

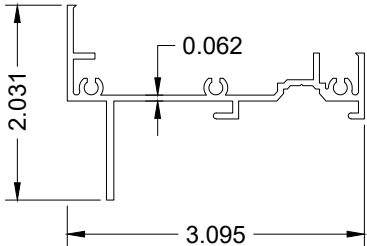


1 FRAME HEAD
SCALE = 6" = 1'-0"




2 GLAZING STOP
SCALE = 6" = 1'-0"



7 WEDGE GASKET
SCALE = N.T.S

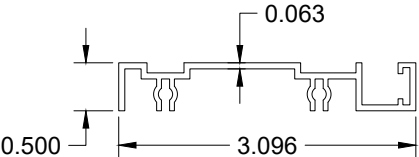

9 LEG ADAPTOR
SCALE = N.T.S

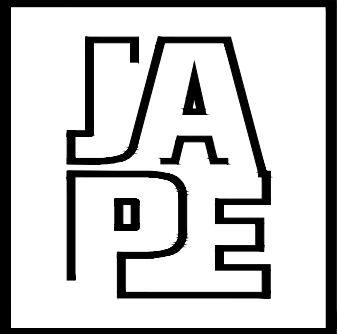

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :

ALUMINUM FIXED WINDOW
(IMPACT) (HVHZ)

CLIENT :

NUEVO FLORIDA VENTURE, LLC
D/B/A PLAZA DOOR

4425 SW CARGO WAY, PALM CITY
FL 34990, UNITED STATES

REVISION

No.	DATE	BY	DESCRIPTION
0	07/22/24		INITIAL ISSUE

date: 7/22/2024

scale: N/A

drawn by: M.S.

check by:

Drawing no. JA-1463-24

Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 – C.A.N. 34254



SEALED: 07/22/2024

FL# 46998

PROFILES / INST.

SHEET No.
07 OF 07