

# LINDSAY WINDOWS, LLC

## SERIES 183 SINGLE HUNG / SINGLE HUNG (SLOPED SILL) (NON-HVHZ) (NON-IMPACT)

### GENERAL NOTES:


- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) **EXCLUDING** HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X WOOD AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF  $\pm 1/4$  INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- FRAME MATERIAL: uPVC.
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

### GLAZING NOTES:


- GLASS TYPE & THICKNESS SHALL COMPLY WITH ASTM E1300-16 REQUIREMENTS. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN SHEETS 1 & 2.

| TABLE OF CONTENTS |                                     |
|-------------------|-------------------------------------|
| SHEET             | SHEET DESCRIPTION                   |
| 1                 | GENERAL NOTES AND GLAZING DETAILS   |
| 2                 | TYPICAL ELEVATIONS                  |
| 3                 | ANCHOR LAYOUTS                      |
| 4                 | VERTICAL SECTIONS                   |
| 5                 | HORIZONTAL SECTIONS                 |
| 6                 | INSTALLATION DETAILS                |
| 7                 | INSTALLATION NOTES AND ANCHOR TABLE |


| DESIGN PRESSURE RATING |                |                 |                |
|------------------------|----------------|-----------------|----------------|
| FRAME SIZE             | GLAZING METHOD | DESIGN PRESSURE | MISSILE RATING |
| 36" X 60"              | WET            | +/- 50 PSF      | NON-IMPACT     |
| 43" X 75"              |                | +/- 35 PSF      |                |
| 35-1/2" X 71-1/2"      |                | +/- 50 PSF      |                |
| 44" X 75"              | DRY            | +/- 35 PSF      |                |

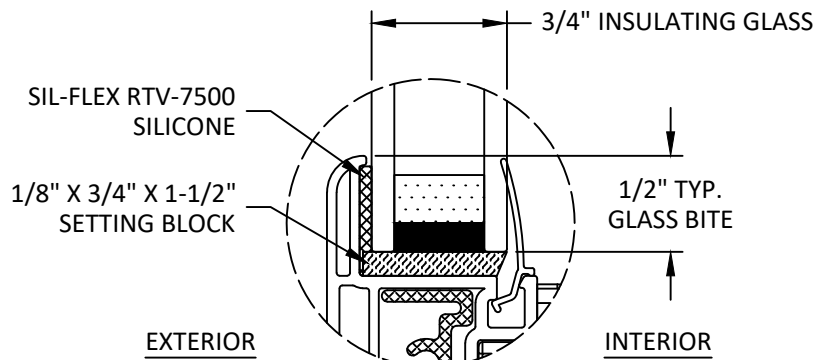


**GLAZING DETAIL 1**  
WET GLAZED, FIXED

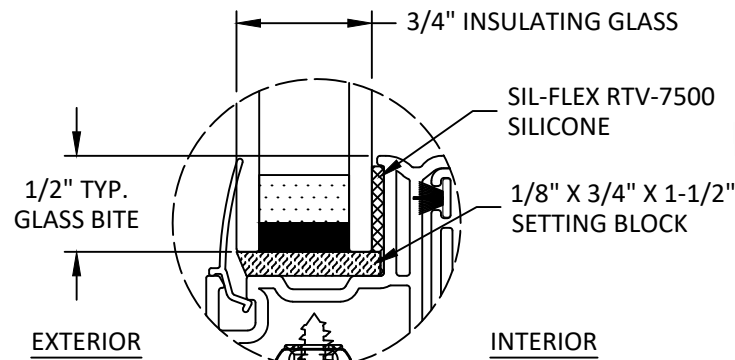

**GLAZING DETAIL 2**  
WET GLAZED, SASH

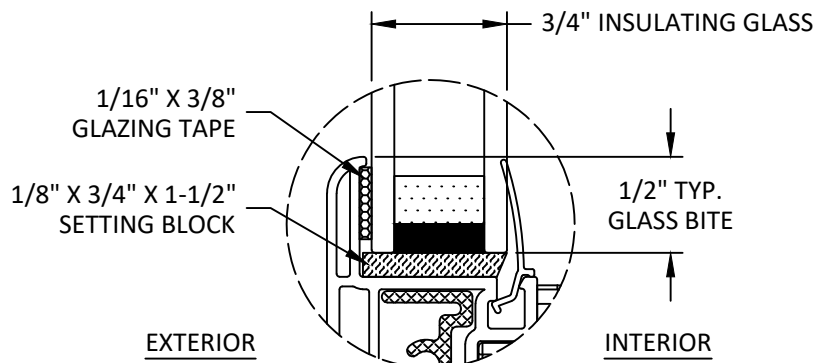

**GLAZING DETAIL 3**  
DRY GLAZED, FIXED

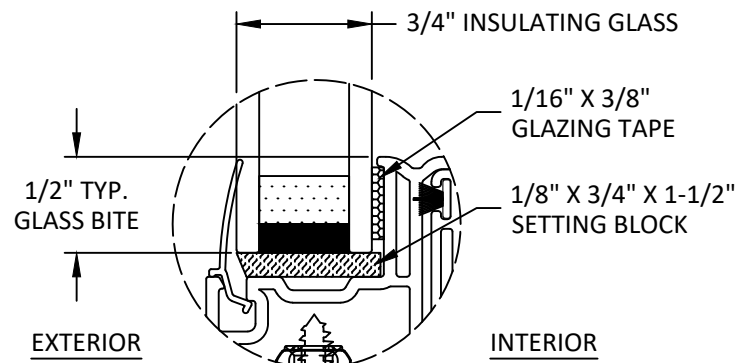

**GLAZING DETAIL 4**  
DRY GLAZED, SASH



LINDSAY WINDOWS, LLC  
1995 COMMERCE DRIVE  
NORTH MANKATO, MN 56003  
PH: (346) 635-0030

TITLE: SERIES 183 SINGLE HUNG /  
SINGLE HUNG (SLOPED SILL)  
(NON-HVHZ) (NON-IMPACT)

GENERAL NOTES &  
GLAZING DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, SUITE 2-15

MIAMI, FL 33132

PH: (954) 399-8478

FAX: (954) 44-4738


WEB: www.buildingdrops.com



| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| A: SIZE & DP UPDATE | JR | 03/2026 |
| B. 2026 FBC UPDATE  | LS | 06/26   |
|                     |    |         |


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.  
Reason: I am approving this document  
Date: 2026.08.26 19:15:41 -0400

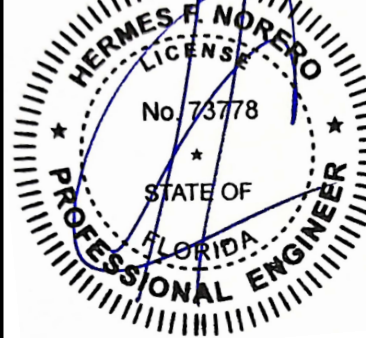


HERMES F. NORERO, P.E.  
FLORIDA P.E. No. 73778  
BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 29578


|          |            |
|----------|------------|
| FL #:    | FL47036    |
| DATE:    | 09.12.2024 |
| DWG. BY: | MS         |
| CHK. BY: | HFN        |
| SCALE:   | NTS        |
| DWG. #:  | LSW002     |
| SHEET:   | 1          |
| REV.     | B          |
|          | OF 7       |

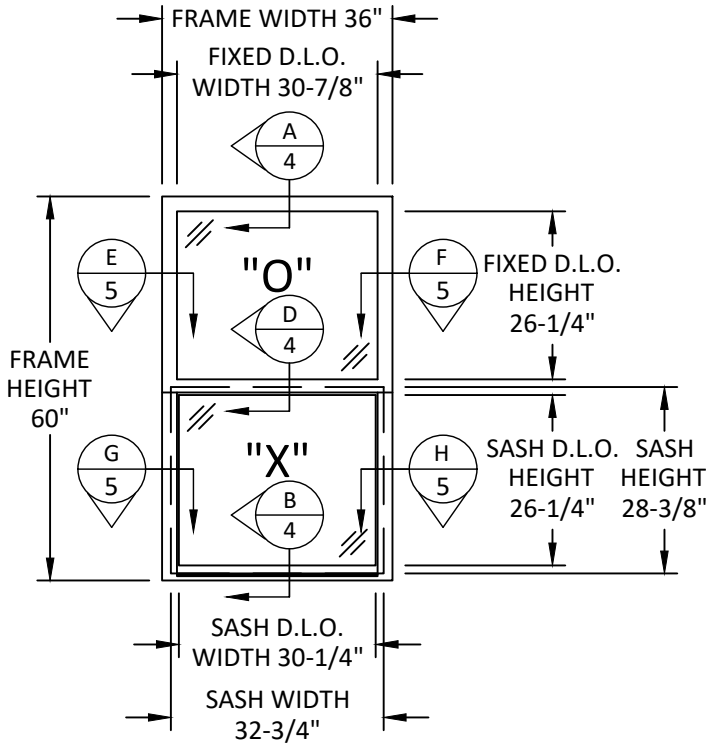


TYPICAL ELEVATION  
36" x 60", WET GLAZED, DP50

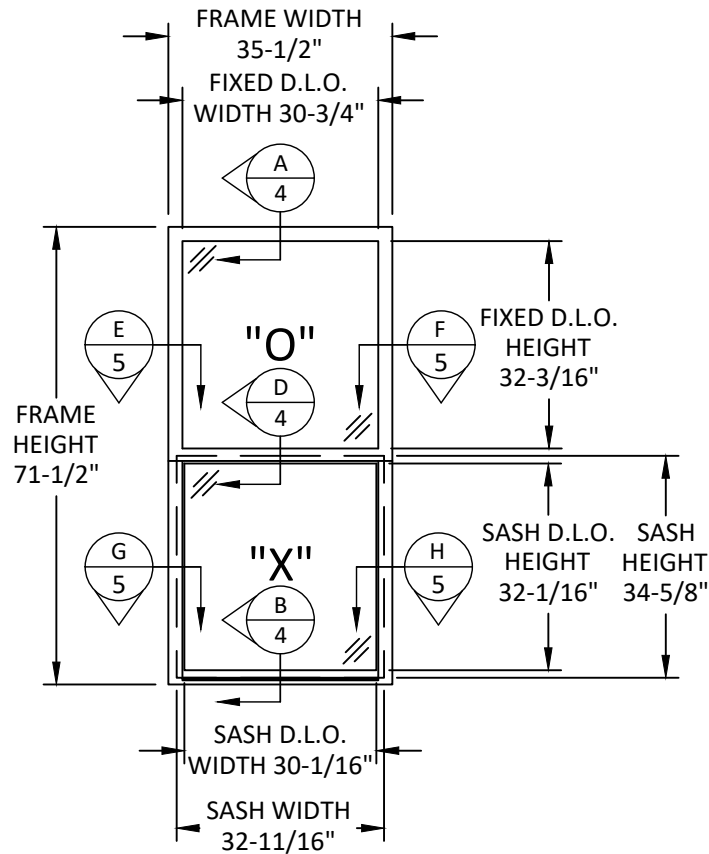

TYPICAL ELEVATION  
31-1/2" x 71-1/2", WET GLAZED, DP50

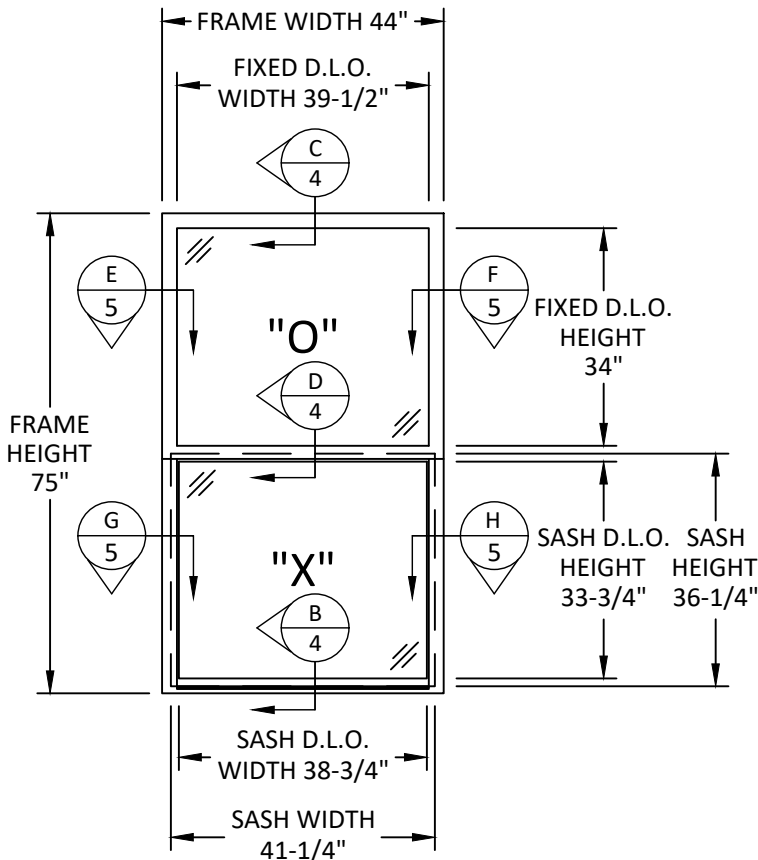

TYPICAL ELEVATION  
44" x 75", DRY GLAZED, DP35

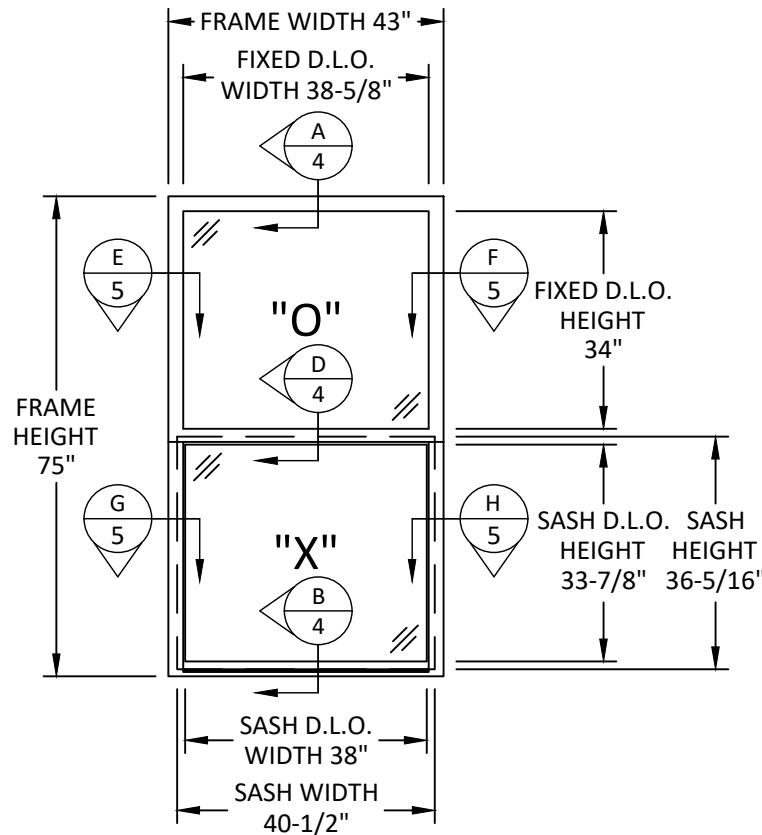

TYPICAL ELEVATION  
43" x 75", WET GLAZED, DP35



LINDSAY WINDOWS, LLC  
1995 COMMERCE DRIVE  
NORTH MANKATO, MN 56003  
PH: (346) 635-0030

TITLE: SERIES 183 SINGLE HUNG /  
SINGLE HUNG (SLOPED SILL)  
(NON-HVHZ) (NON-IMPACT)

TYPICAL ELEVATIONS


PREPARED BY:

BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com




| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| A: SIZE & DP UPDATE | JR | 03/2026 |
| B. 2026 FBC UPDATE  | LS | 06/26   |
|                     |    |         |
|                     |    |         |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

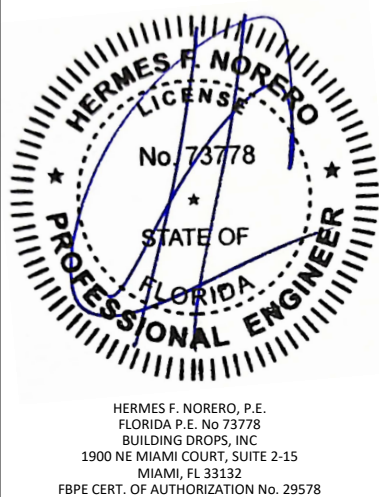


HERMES F. NORERO, P.E.  
FLORIDA P.E. No. 73778  
BUILDING DROPS, INC  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 295578


|          |            |
|----------|------------|
| FL #:    | FL47036    |
| DATE:    | 09.12.2024 |
| DWG. BY: | MS         |
| CHK. BY: | HFN        |
| SCALE:   | NTS        |
| DWG. #:  | LSW002     |
| SHEET:   | 2          |
| REV.     | B          |

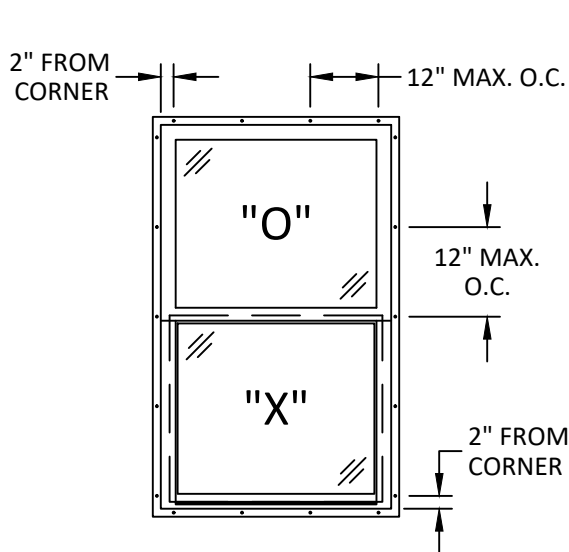


ANCHOR LAYOUT  
36" x 60", NAIL FIN

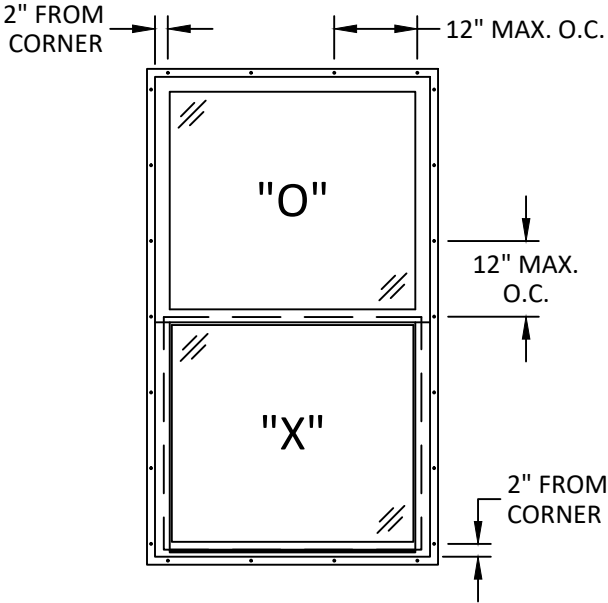


ANCHOR LAYOUT  
43" x 75", NAIL FIN

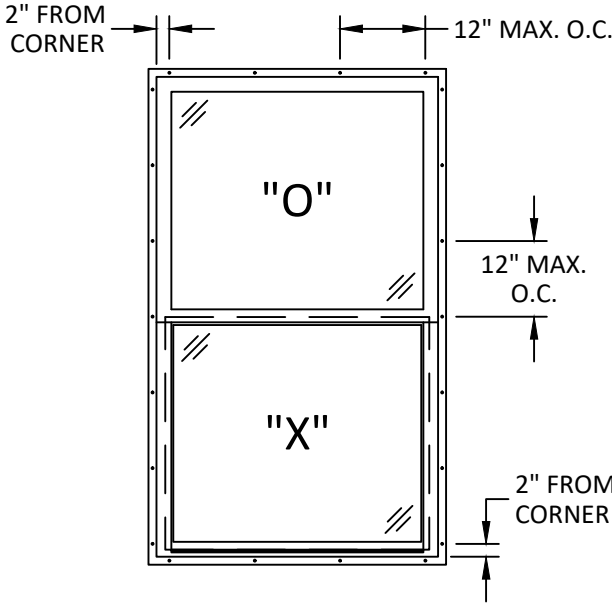


ANCHOR LAYOUT  
44" x 75", NAIL FIN

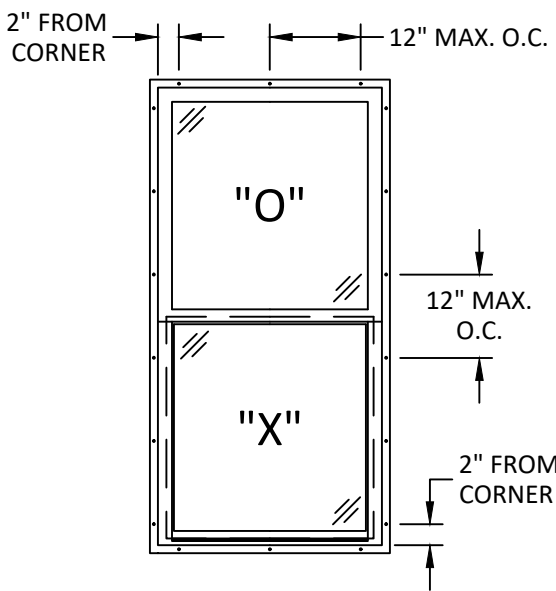


ANCHOR LAYOUT  
35-1/2" x 71-1/2", NAIL FIN

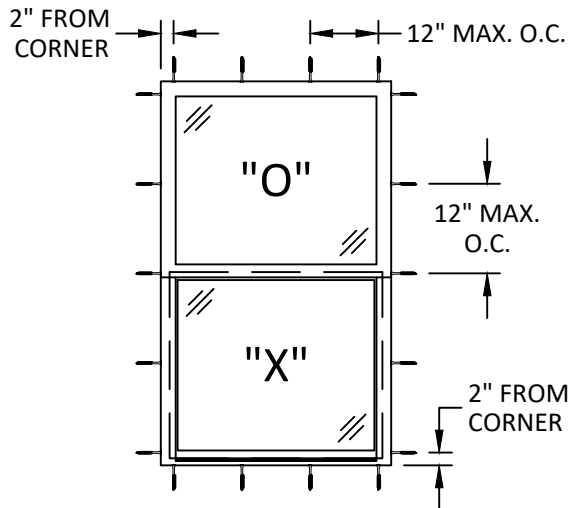

ANCHOR LAYOUT  
36" x 60", THROUGH FRAME

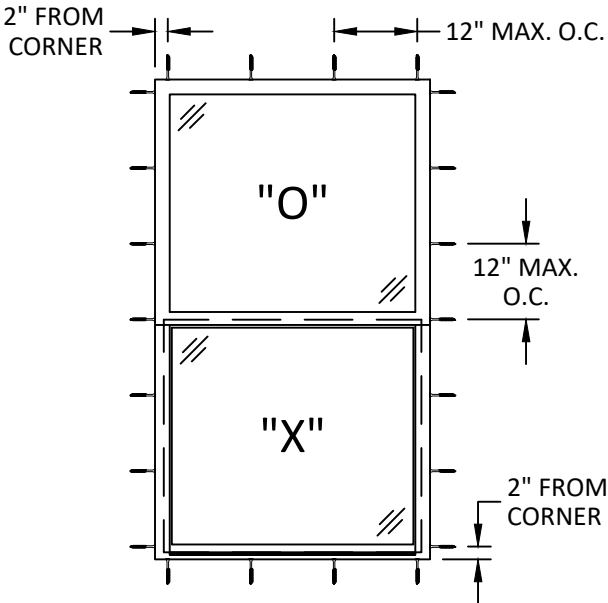

ANCHOR LAYOUT  
43" x 75", THROUGH FRAME

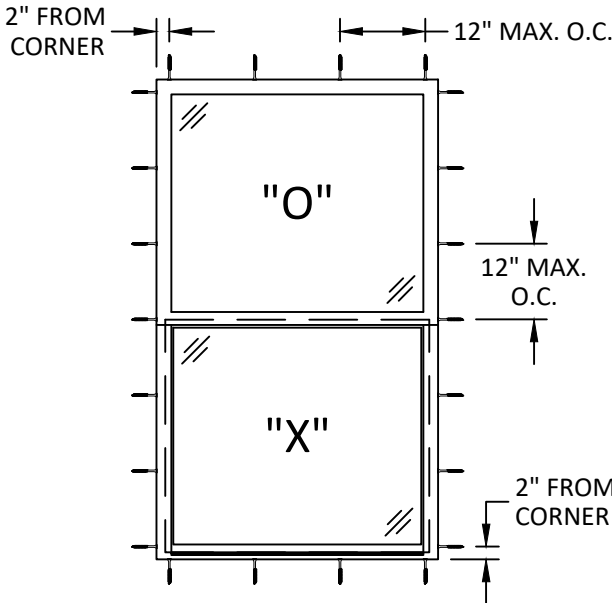

ANCHOR LAYOUT  
44" x 75", THROUGH FRAME



LINDSAY WINDOWS, LLC  
1995 COMMERCE DRIVE  
NORTH MANKATO, MN 56003  
PH: (346) 635-0030

TITLE: SERIES 183 SINGLE HUNG /  
SINGLE HUNG (SLOPED SILL)  
(NON-HVHZ) (NON-IMPACT)

ANCHOR LAYOUTS


PREPARED BY:

BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| A: SIZE & DP UPDATE | JR | 03/2026 |
| B. 2026 FBC UPDATE  | LS | 06/26   |
|                     |    |         |
|                     |    |         |


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

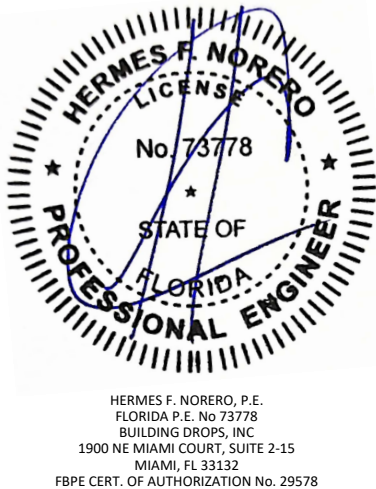


HERMES F. NORERO, P.E.  
FLORIDA P.E. No. 73778  
BUILDING DROPS, INC  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 29578

|          |            |              |
|----------|------------|--------------|
| FL #:    | FL47036    |              |
| DATE:    | 09.12.2024 |              |
| DWG. BY: | MS         | CHK. BY: HFN |
| SCALE:   | NTS        |              |
| DWG. #:  | LSW002     |              |
| SHEET:   | 3          | REV. B       |

NOTE: SECTION DETAILS ARE NOT TO SCALE.

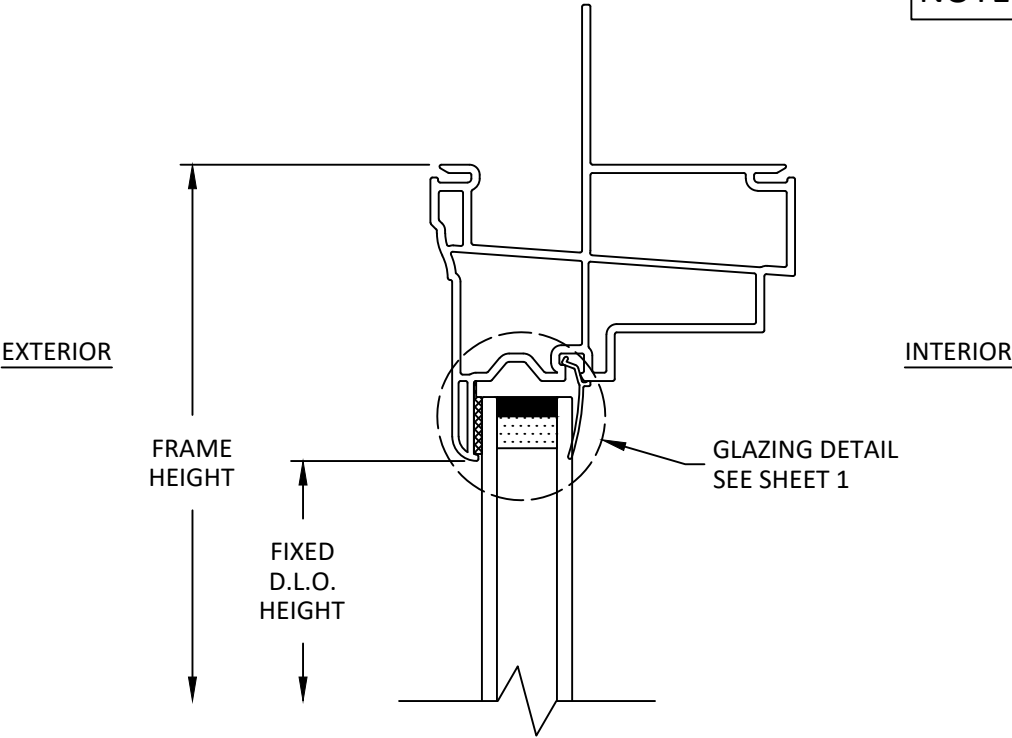


**A**  
**4** VERTICAL SECTION  
WINDOW HEAD

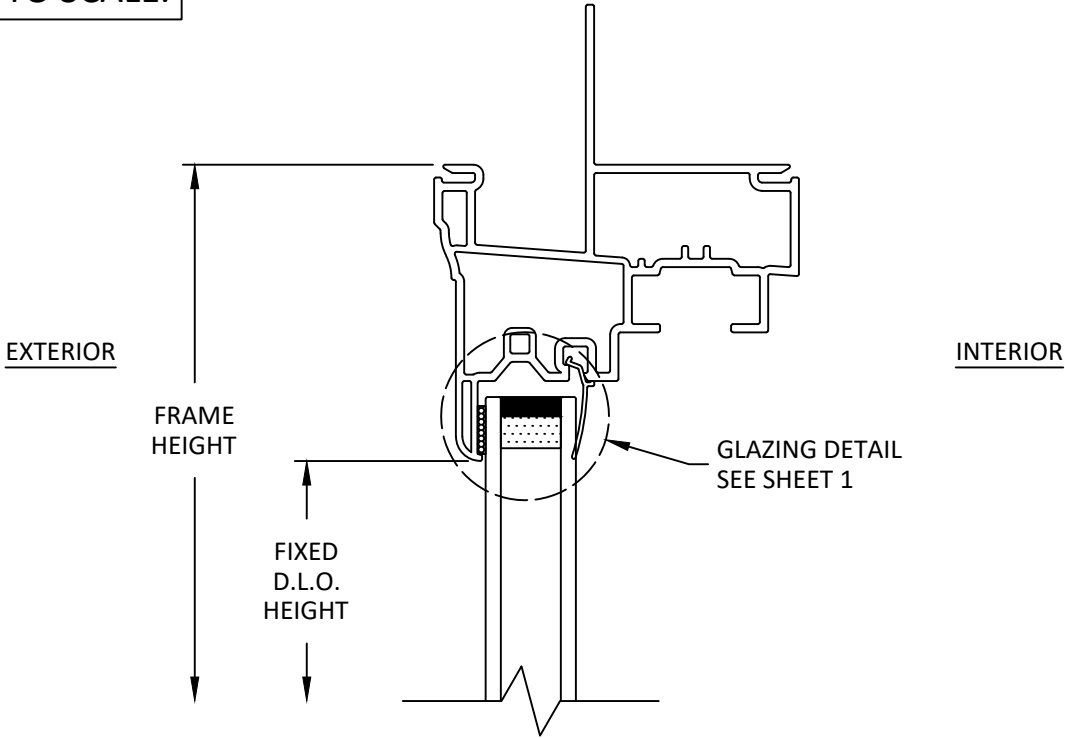


**C**  
**4** VERTICAL SECTION  
WINDOW HEAD

FRAME W/ NAIL FIN SHOWN,  
FRAME W/O NAIL FIN SEE SHEET 6.

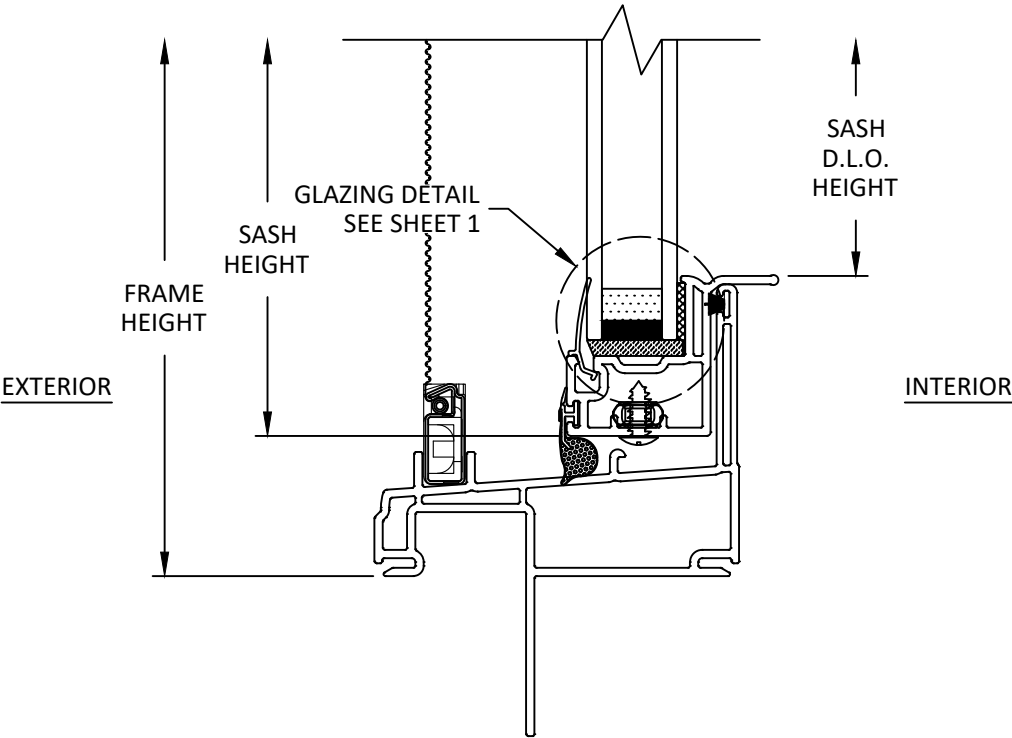

**B**  
**4** VERTICAL SECTION  
WINDOW SILL

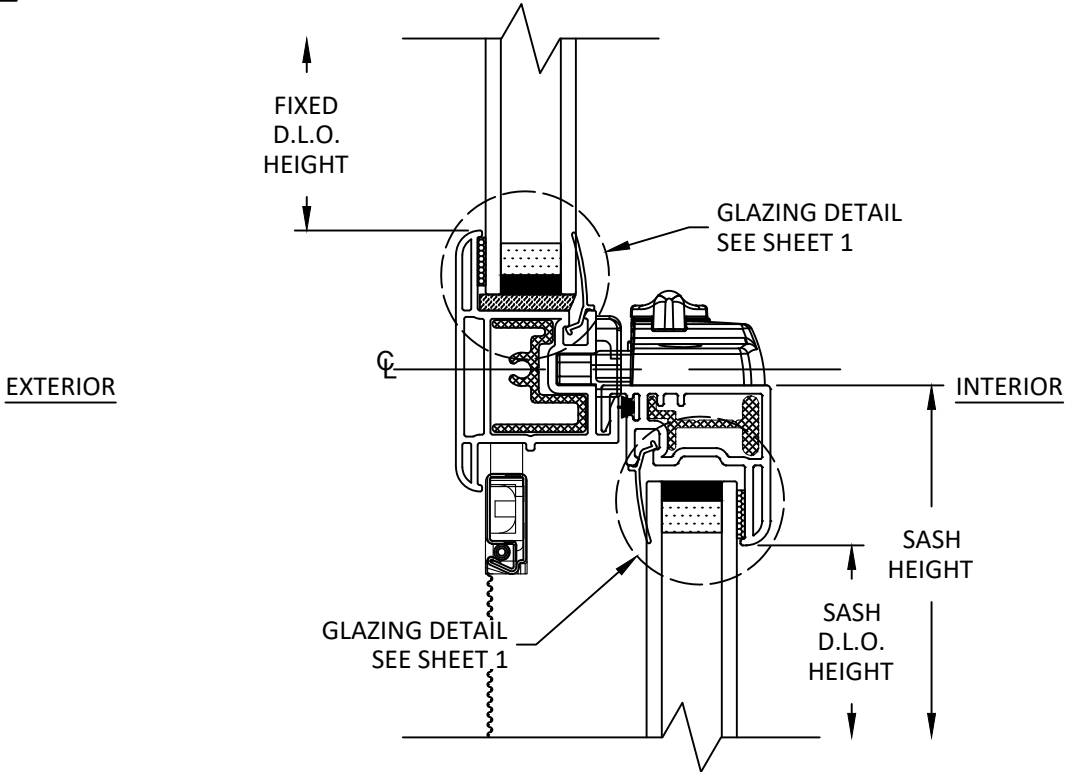

**D**  
**4** VERTICAL SECTION  
INTERLOCK



LINDSAY WINDOWS, LLC  
1995 COMMERCE DRIVE  
NORTH MANKATO, MN 56003  
PH: (346) 635-0030

TITLE: SERIES 183 SINGLE HUNG /  
SINGLE HUNG (SLOPED SILL)  
(NON-HVHZ) (NON-IMPACT)

VERTICAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (346) 635-0030  
FAX: (346) 635-0030  
WEB: www.buildingdrops.com



| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| A: SIZE & DP UPDATE | JR | 03/2026 |
| B. 2026 FBC UPDATE  | LS | 06/26   |
|                     |    |         |


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

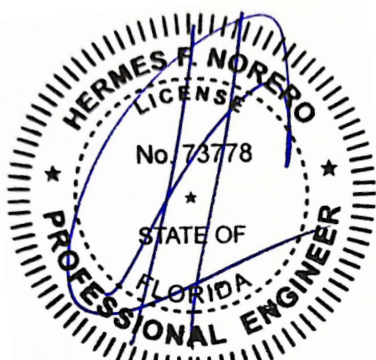


HERMES F. NORERO, P.E.  
FLORIDA P.E. No. 73778  
BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 29578

|          |            |
|----------|------------|
| FL #:    | FL47036    |
| DATE:    | 09.12.2024 |
| DWG. BY: | MS         |
| CHK. BY: | HFN        |
| SCALE:   | NTS        |
| DWG. #:  | LSW002     |
| SHEET:   | 4          |
| REV.     | B          |

NOTE: SECTION DETAILS ARE NOT TO SCALE.

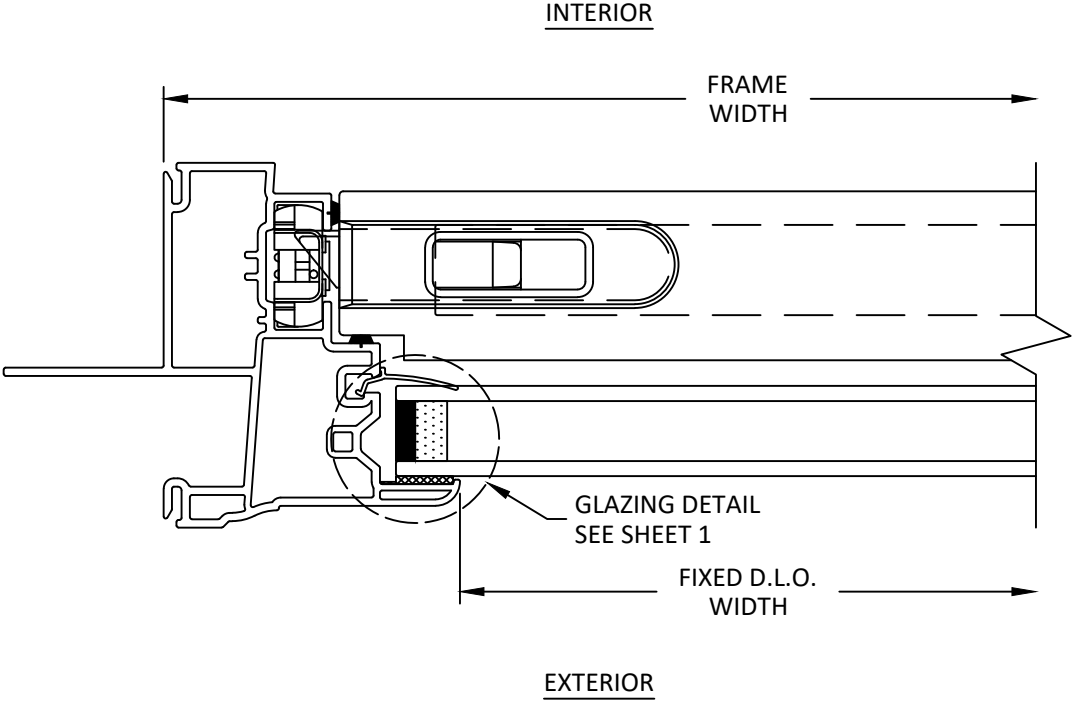


**E**  
**5** HORIZONTAL SECTION  
FIXED JAMB

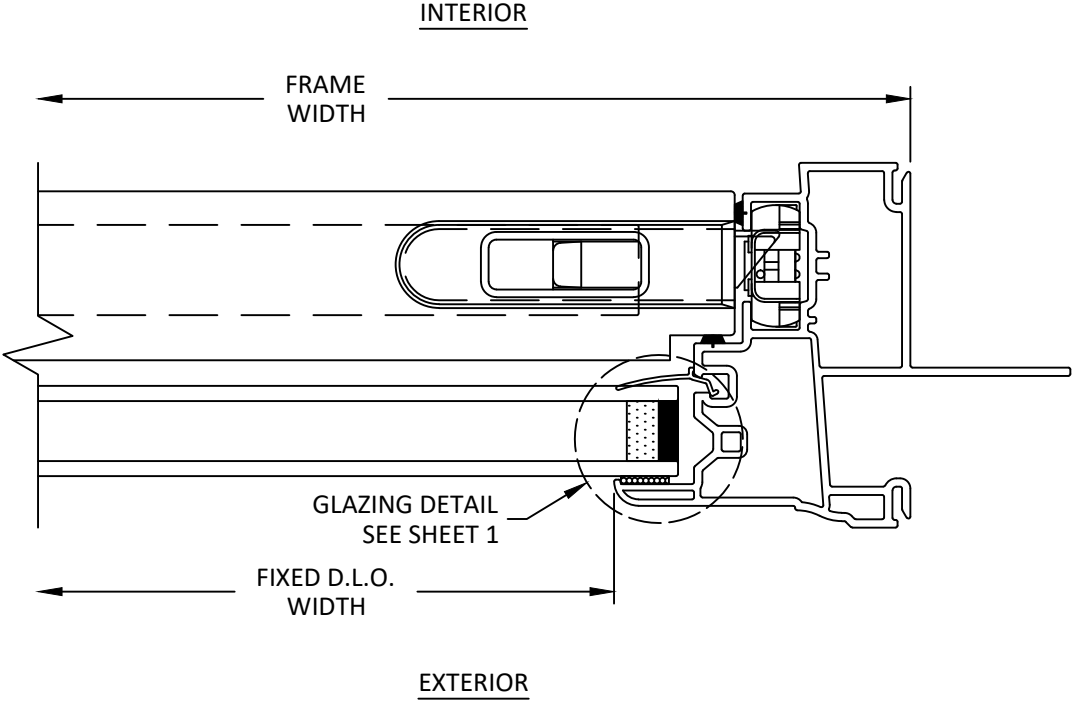


**F**  
**5** HORIZONTAL SECTION  
FIXED JAMB

FRAME W/ NAIL FIN SHOWN,  
FRAME W/O NAIL FIN SEE SHEET 6.

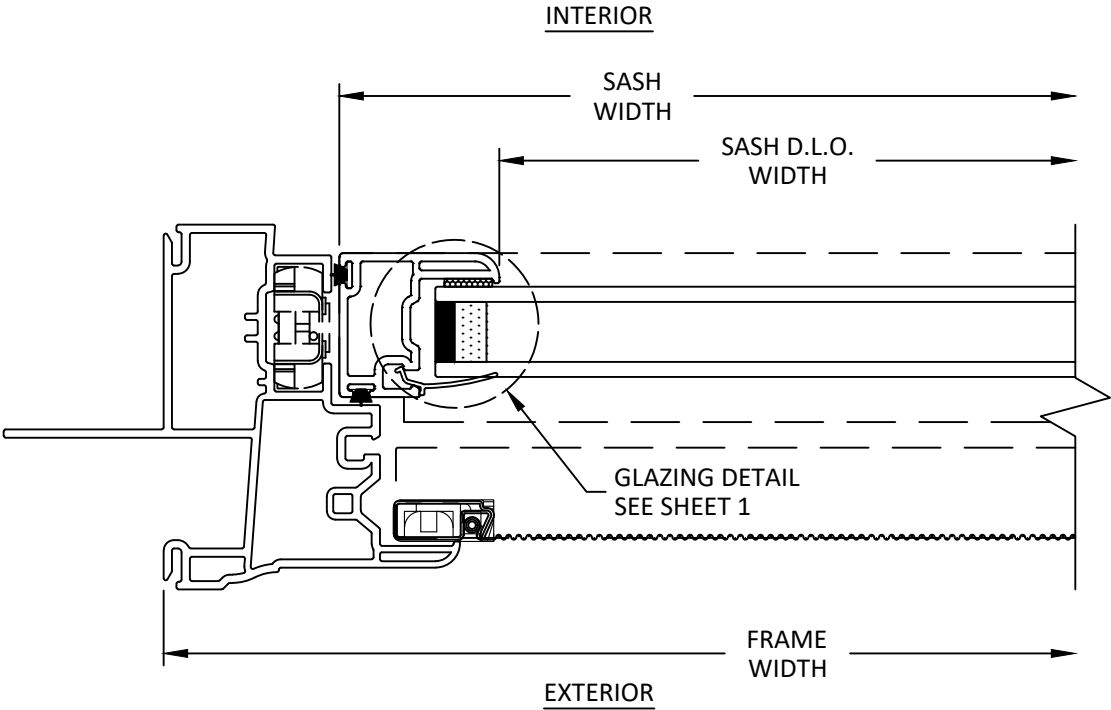

**G**  
**5** HORIZONTAL SECTION  
SASH JAMB

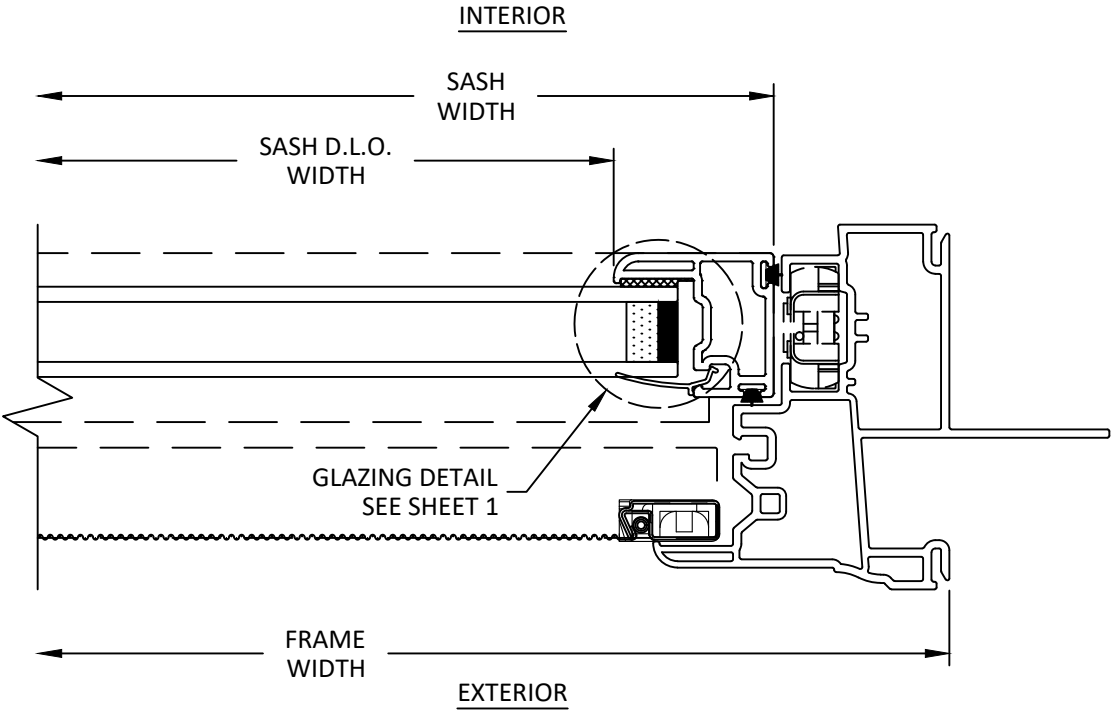

**H**  
**5** HORIZONTAL SECTION  
SASH JAMB



LINDSAY WINDOWS, LLC  
1995 COMMERCE DRIVE  
NORTH MANKATO, MN 56003  
PH: (346) 635-0030

TITLE: SERIES 183 SINGLE HUNG / SINGLE HUNG (SLOPED SILL) (NON-HVHZ) (NON-IMPACT)


HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (354)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com

 BUILDING DROPS

| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| A: SIZE & DP UPDATE | JR | 03/2026 |
| B. 2026 FBC UPDATE  | LS | 06/26   |
|                     |    |         |


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

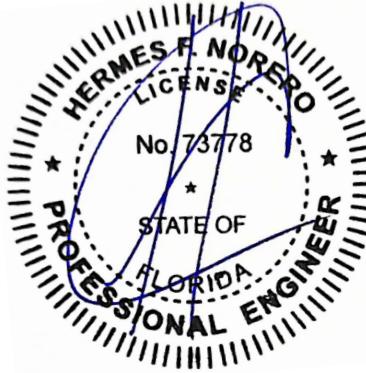


HERMES F. NORERO, P.E.  
FLORIDA P.E. No 73778  
BUILDING DROPS, INC  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 29578

|          |            |
|----------|------------|
| FL #:    | FL47036    |
| DATE:    | 09.12.2024 |
| DWG. BY: | MS         |
| CHK. BY: | HFN        |
| SCALE:   | NTS        |
| DWG. #:  | LSW002     |
| SHEET:   | 5          |
| REV.     | B          |


NOTE: ANCHOR DETAILS ARE NOT TO SCALE.

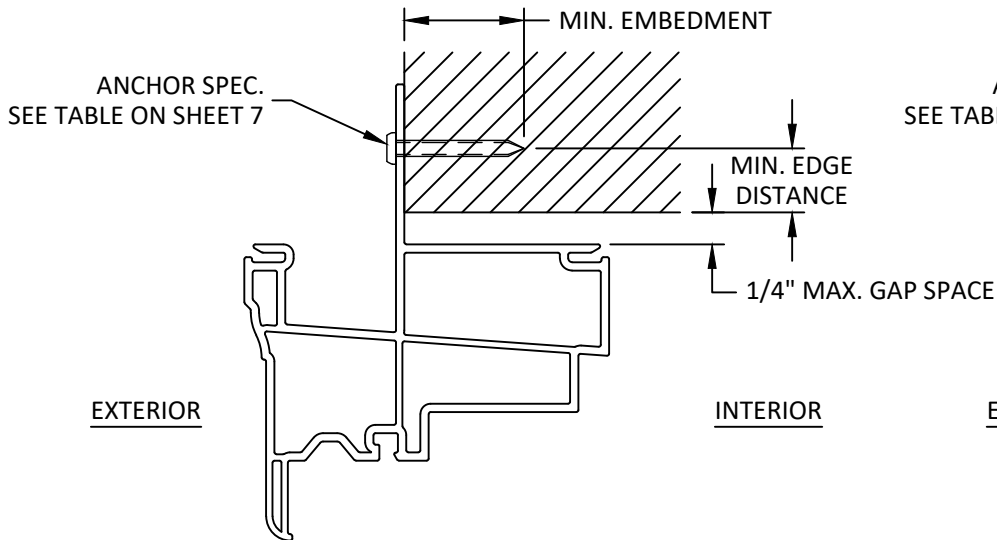

I  
6 INSTALLATION DETAIL  
NAIL FIN  
HEAD INSTALLATION

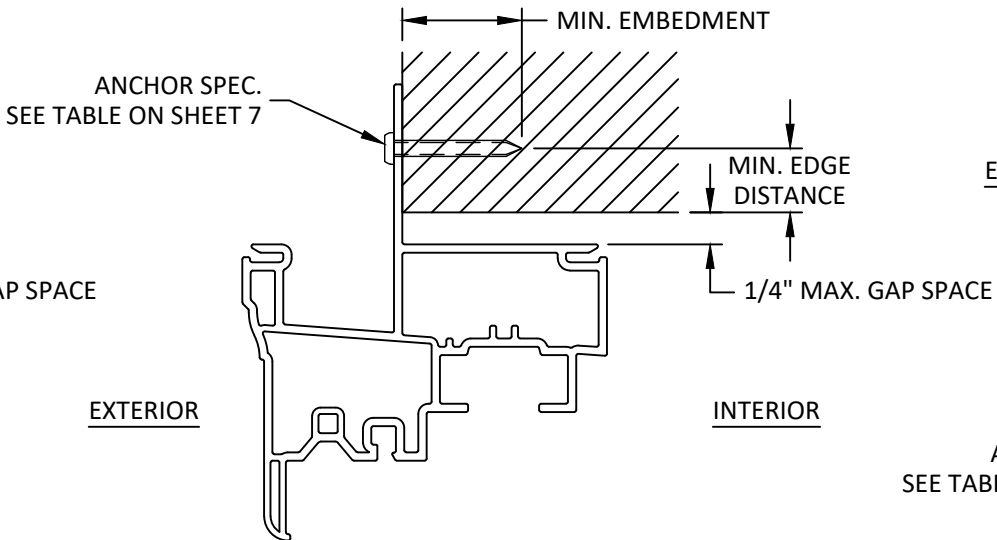


J  
6 INSTALLATION DETAIL  
NAIL FIN  
HEAD (SLOPED SILL) INSTALLATION

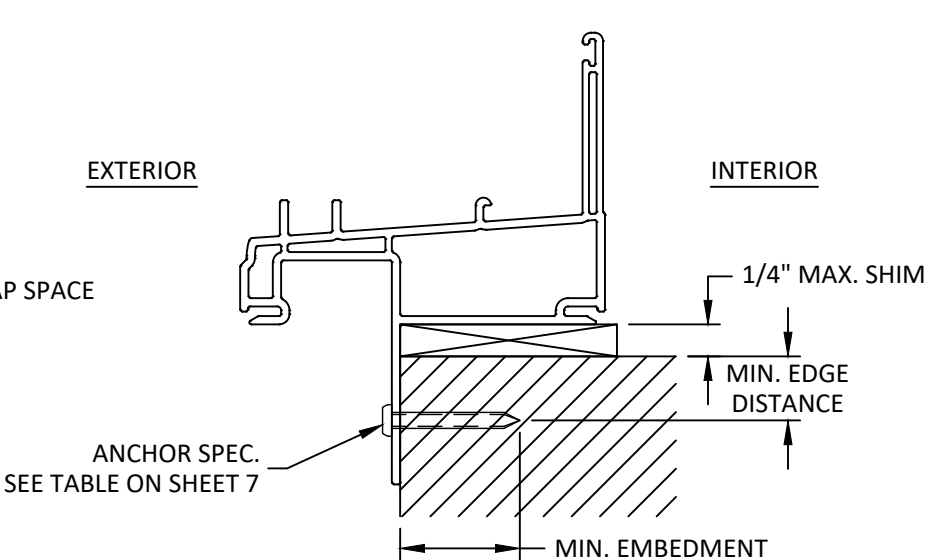


K  
6 INSTALLATION DETAIL  
NAIL FIN  
SILL INSTALLATION


HEAD INSTALLATION SHOWN,  
JAMB INSTALLATION IS SIMILAR.

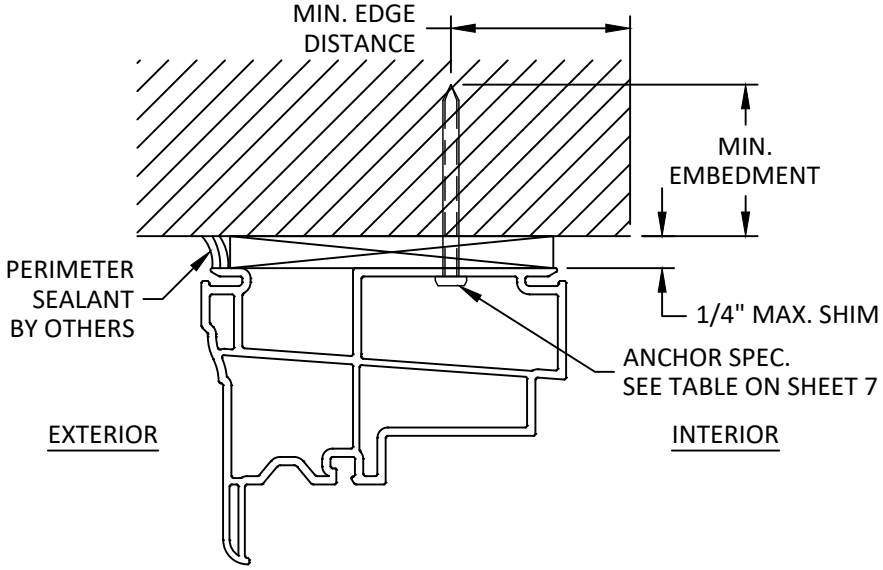

L  
6 INSTALLATION DETAIL  
THROUGH FRAME  
HEAD INSTALLATION

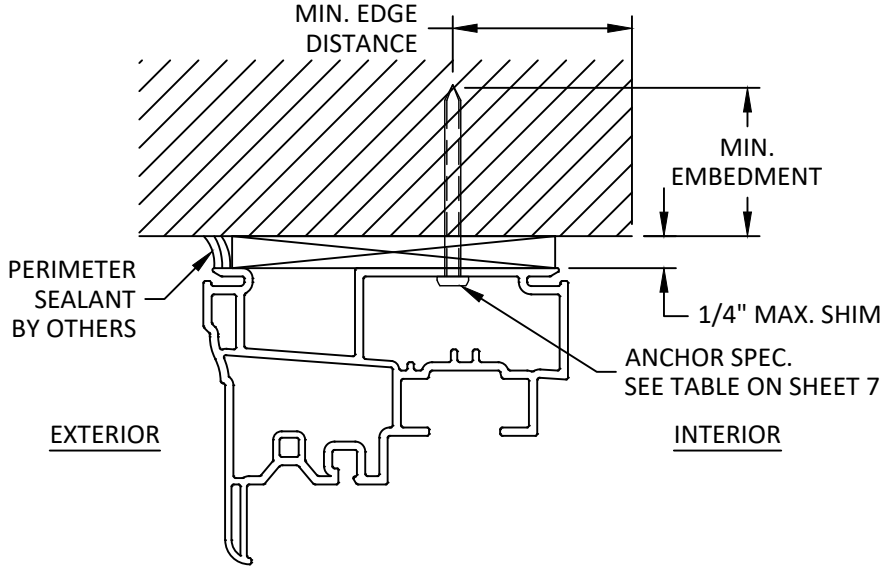

M  
6 INSTALLATION DETAIL  
THROUGH FRAME  
HEAD (SLOPED SILL) INSTALLATION

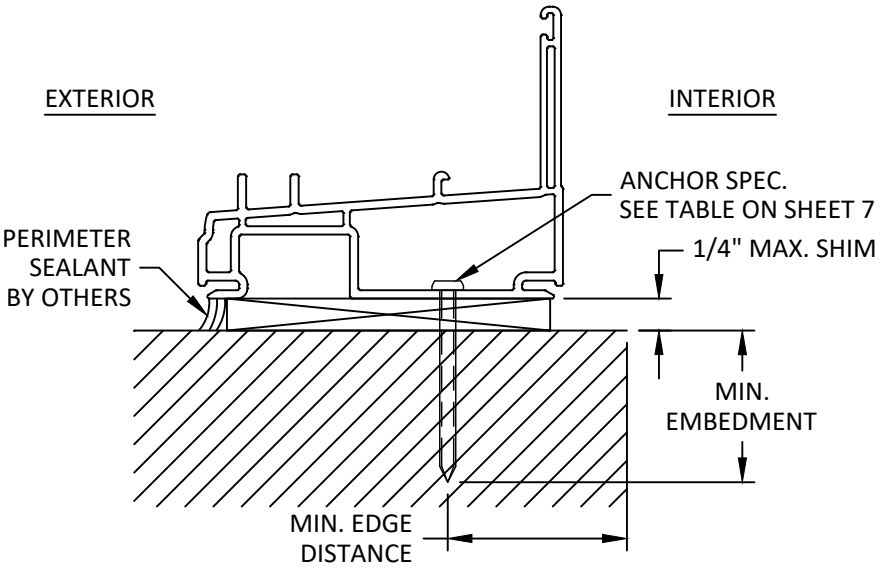

N  
6 INSTALLATION DETAIL  
THROUGH FRAME  
SILL INSTALLATION



LINDSAY WINDOWS, LLC  
1995 COMMERCE DRIVE  
NORTH MANKATO, MN 56003  
PH: (346) 635-0030

TITLE: SERIES 183 SINGLE HUNG /  
SINGLE HUNG (SLOPED SILL)  
(NON-HVHZ) (NON-IMPACT)

INSTALLATION DETAILS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (554)399-8478  
FAX: (954)44-4738  
WEB: www.buildingdrops.com



| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| A: SIZE & DP UPDATE | JR | 03/2026 |
| B. 2026 FBC UPDATE  | LS | 06/26   |
|                     |    |         |
|                     |    |         |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

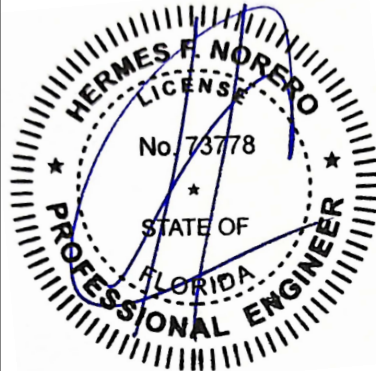

HERMES F. NORERO, P.E.  
FLORIDA P.E. No 73778  
BUILDING DROPS, INC  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 29578

|          |            |
|----------|------------|
| FL #:    | FL47036    |
| DATE:    | 09.12.2024 |
| DWG. BY: | MS         |
| CHK. BY: | HFN        |
| SCALE:   | NTS        |
| DWG. #:  | LSW002     |
| SHEET:   | 6          |
| REV.     | B          |

c:\users\mengqium\building drops, inc\building drops landing - common\projects\lindsay windows\2026 code change projects\lindsay windows\cc-26-6107 - 2026 code change\dwgs\fl47036\lsw002 - b.dwg 8/6/2026 6:26 PM

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. FOR NAIL FIN INSTALLATION, SHIM AS NEEDED TO ACHIEVE A PLUMB AND SQUARE INSTALLATION. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4". SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR THROUGH FRAME INSTALLATION, SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
6. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
7. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
8. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:

FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
9. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
10. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

| ANCHOR SCHEDULE |                                               |                                                          |                                           |                    |
|-----------------|-----------------------------------------------|----------------------------------------------------------|-------------------------------------------|--------------------|
| METHOD          | SUBSTRATE                                     | ANCHOR TYPE                                              | MIN. EMBEDMENT                            | MIN. EDGE DISTANCE |
| NAIL FIN        | WOOD:<br>MIN. S.G. = 0.55                     | #8 PAN HEAD WOOD SCREW                                   | 3/4"                                      | 3/4"               |
|                 | STEEL:<br>MIN. 16 GA.<br>MIN. Fy = 36 ksi     | #8 GRADE 5 PAN HEAD SELF-DRILLING/<br>SELF-TAPPING SCREW | 3 THREADS MIN<br>PENETRATION BEYOND METAL | 1/2"               |
|                 | ALUMINUM:<br>MIN. 1/8" THICK<br>MIN. 6063-T5  |                                                          |                                           |                    |
| THROUGH FRAME   | WOOD:<br>MIN. S.G. = 0.55                     | #8 WOOD SCREW                                            | 1-1/2"                                    | 3/4"               |
|                 | STEEL:<br>MIN. 16 GA.<br>MIN. Fy = 36 ksi     | #8 GRADE 5 SELF-DRILLING/<br>SELF-TAPPING SCREW          | 3 THREADS MIN<br>PENETRATION BEYOND METAL | 1/2"               |
|                 | ALUMINUM:<br>MIN. 1/8" THICK<br>MIN. 6063-T5  |                                                          |                                           |                    |
|                 | CONCRETE:<br>MIN. f'c = 3000 psi              | 3/16" ITW TAPCON                                         | 1"                                        | 1-1/8"             |
|                 | MASONRY:<br>CMU per ASTM C90<br>MIN. 2000 PSI |                                                          | 1"                                        | 2"                 |



LINDSAY WINDOWS, LLC  
1995 COMMERCE DRIVE  
NORTH MANKATO, MN 56003  
PH: (346) 635-0030

TITLE: SERIES 183 SINGLE HUNG /  
SINGLE HUNG (SLOPED SILL)  
(NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES &  
ANCHOR TABLE


PREPARED BY:

BUILDING DROPS, INC.  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



| REMARKS             | BY | DATE    |
|---------------------|----|---------|
| A: SIZE & DP UPDATE | JR | 03/2026 |
| B. 2026 FBC UPDATE  | LS | 06/26   |
|                     |    |         |
|                     |    |         |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

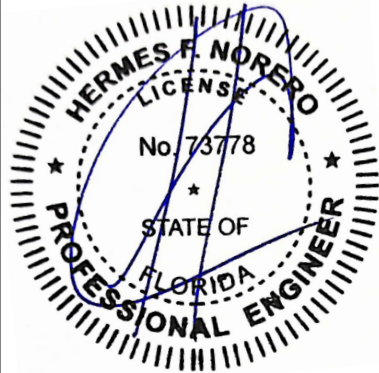

HERMES F. NORERO, P.E.  
FLORIDA P.E. No. 73778  
BUILDING DROPS, INC  
1900 NE MIAMI COURT, SUITE 2-15  
MIAMI, FL 33132  
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: FL47036

DATE: 09.12.2024

|                |                 |
|----------------|-----------------|
| DWG. BY:<br>MS | CHK. BY:<br>HFN |
|----------------|-----------------|

SCALE: NTS

DWG. #: LSW002

|             |           |
|-------------|-----------|
| SHEET:<br>7 | REV.<br>B |
|-------------|-----------|