


TABLE 1 - ANCHORS AWAY FROM MULLION & AT JAMBS

		PRIMARY ANCHOR (TO SUBSTRATE CONDITION)						"BACK" ANCHOR (TRIM TO FRAME)				
SUBSTRATE	LOCATION	HARDWARE (ACCEPTABLE TRADE NAME OR EQUIVALENT)	O.C. SPACING (MAX)	END DISTANCE (MAX)	EMBEDMENT (MIN)	SUBSTRATE EDGE DISTANCE (MIN)	d1 INSTALL DIMENSION	HARDWARE (ACCEPTABLE TRADE NAME OR EQUIVALENT)	O.C. SPACING (MAX)	END DISTANCE (MAX)	EMBEDMENT (MIN)	d2 INSTALL DIMENSION
WOOD SG = 0.42	HEAD	1/4" Ø LAG SCREW, FULL BODY	14"	4"	1-1/2"	1"	7/8"	#10-16 OR #10-24 S.S. CONDITION CW OR SAE GR. 5 STEEL PAN HEAD SCREW	16"	4"	3 THREADS	9/16"
	SILL		12"						12"			
	JAMB		12"						12"			
CONCRETE 3,000 PSI	HEAD	1/4" Ø HILTI KWIK HUS-EZ (KH-EZ)	16"	4"	2-1/2"	1-3/4"	7/8"		16"	4"	3 THREADS	9/16"
	SILL		18"						12"			
	JAMB		18"						12"			
CONCRETE 4,000 PSI	HEAD	1/4" Ø HILTI KWIK HUS-EZ (KH-EZ)	22"	4"	2-1/2"	1-3/4"	7/8"		16"	4"	3 THREADS	9/16"
	SILL		12"						12"			
	JAMB		12"						12"			
CMU (GROUT FILLED) f'm = 1,500 PSI	HEAD	1/4" Ø HILTI KWIK HUS-EZ (KH-EZ)	14"	4"	2-1/2"	1-1/2"	7/8"		16"	4"	3 THREADS	9/16"
	SILL		9"						12"			
	JAMB		12"						12"			
STEEL STUD (18 ga. 33ksi)	HEAD	1/4"-14 SAE GR. 5 HILTI KWIK FLEX OR DEWALT DRIL-FLEX	14"	4"	3 THREADS	7/8"	7/8"		16"	4"	3 THREADS	9/16"
	SILL		12"						12"			
	JAMB		12"						12"			

SEE SHEET 2 FOR ANCHOR SPACING AT / NEAR MULLION AT HEAD & SILL

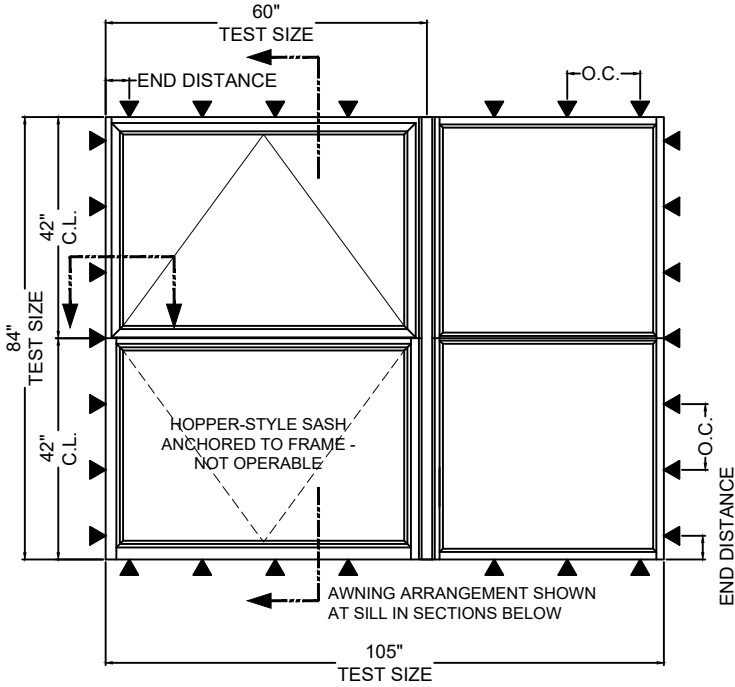

- Installations depicted comply with:
Florida Building Code - 8th Ed. (FBC 2023)
International Building Code (IBC 2021)
National Design Specifications (ANSI/AWC NDS 2018)
Aluminum Design Manual (ADM 2020)
Cold-Formed Steel Design Manual (AISI-S100 2020)

- The installation depicted in this drawing and all calculations are based on a maximum size and design wind pressure rating listed below. These products **have** been proven for resistance to wind-borne debris per ASTM E1886 and ASTM E1996.

Test size: **105" x 84"** Max Awning Size: **60" x 42"** Design pressure: **+/- 75 psf**

- Lag screws shall be used for a wood substrate. Screw materials and dimensions shall meet the requirements of ANSI / ASME Standard B18.2.1. All lag screw conditions must be pre-drilled with hole diameters of 40-70% of the fastener diameter. Wood buck installations are assumed to use 2 X S-P-F (G= 0.42) or denser. Tapered or partial bucks are not allowed.

- Approved screw anchors shall be used for concrete substrate. Anchor materials and dimensions shall meet the requirements of ICC-ES AC106 - Acceptance Criteria for Predrilled Fasteners (Screw Anchors) in concrete or masonry elements. Anchor embedment shall be as indicated herein. Install per ESR-3027 requirements. Concrete installations are assumed to be at least f'c = 3,000 (or 4,000) psi, normal weight concrete.

- Approved screw anchors shall be used for CMU substrate. Anchor materials and dimensions shall meet the requirements of ICC-ES AC106 - Acceptance Criteria for Predrilled Fasteners (Screw Anchors) in concrete or masonry elements. Anchor embedment shall be as indicated herein. Install per ESR-3056 requirements. Concrete masonry installations are assumed at least ASTM C90, Type II, Grade N, with f'm = 1,500 psi, and type M or S mortar.





- Approved self-drilling screws shall be used for steel stud substrate. Screw materials and dimensions shall meet the requirements of SAE Grade 5 Carbon Steel. Steel stud installations assume 18 gauge, 33 ksi studs and follow AISI-S100 rules and procedures.

- Maximum shim thickness of 1/4" permitted at each fastener location. Shims shall be non-compressible and load-bearing type.

- Drawings depict details necessary to meet structural load requirements, but do not address air infiltration, water penetration, intrusion or thermal performance requirements of the installation. See manufacturer's Installation Instructions for sealing, flashing, drainage and other requirements.

- Minimum fastener on center spacing to be coordinated with fastener manufacturer's technical data for the expected substrate.





- All substrate types shall be secured to the building structure to resist all design loads, and shall have widths that exceed the window frame widths.

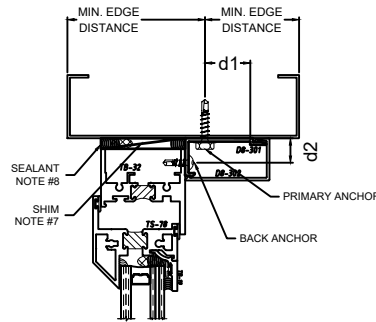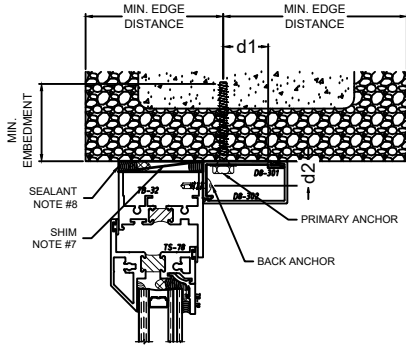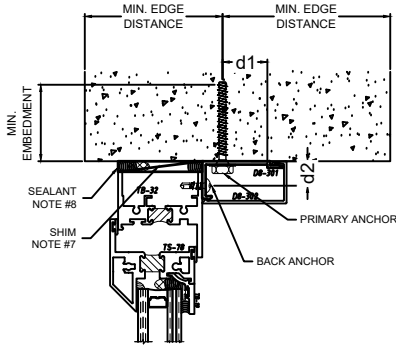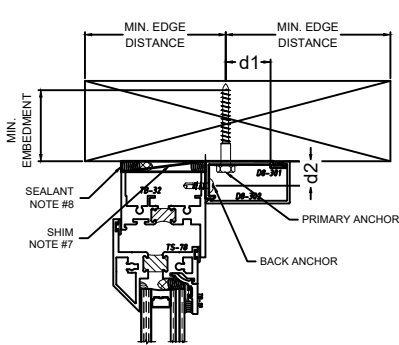

HEAD

RICE
ENGINEERING
105 School Creek Trail
Luxemburg, WI 54217
Phone: (920) 617-1042
Fax: (920) 617-1100
www.rice-inc.com

Florida Firm No: F-01000005061
Certificate of Authorization: #9090
Wayne K. Helmila
Registration No: 59092

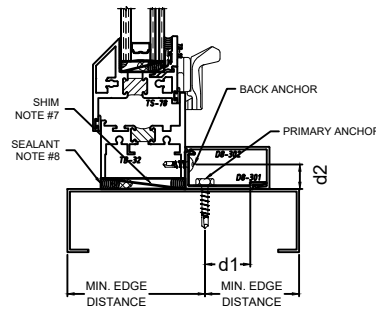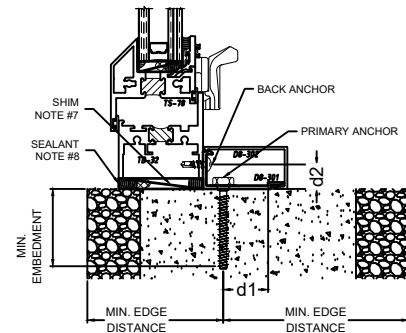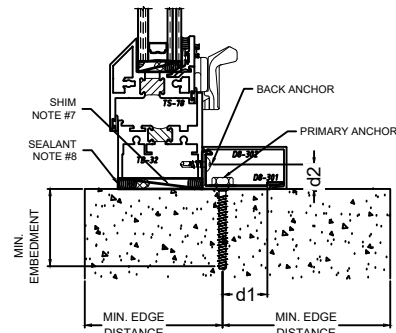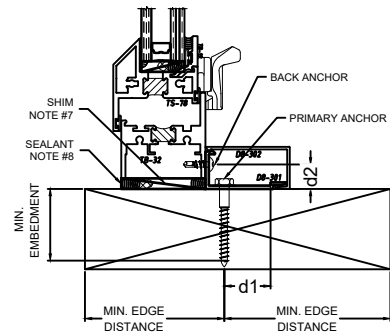

SILL

Wayne K Helmila

Digitally signed by Wayne K Helmila
DN: cn=Wayne K Helmila,
dnQualifier=A01430C0000018CDB8F4AFB001A652B,
o=Winconsin, c=US
Date: 2024.10.24 11:06:46 -05'00'

JAMBS



10/24/2024
COA: 9090

Rev.	Description	Date
△		
△		
△		
△		
△		

Scale: NONE Drawn by: B. FOOTE

Winco Window Co.
6200 Maple Ave.
St. Louis, MO 63130

PHONE: 314-725-8088


WINCO Product: 1150S AWNING - FX

Installation: ANCHORAGE: SNAP TRIM (SHT.1 OF 2)



Certification: LMI 1150S

TABLE 2 - ANCHOR CLUSTER - CENTERED ON MULLION							
PRIMARY ANCHOR (TO SUBSTRATE CONDITION)					"BACK" ANCHOR (TRIM TO FRAME)		
SUBSTRATE	LOCATION	HARDWARE (ACCEPTABLE TRADENAME OR EQUIVALENT)	NUMBER OF ANCHORS IN CLUSTER	O.C. SPACING (MAX)	HARDWARE (ACCEPTABLE TRADE NAME OR EQUIVALENT)	NUMBER OF ANCHORS IN CLUSTER	O.C. SPACING (MAX)
WOOD SG = 0.42	HEAD	1/4" Ø LAG SCREW, FULL BODY	5	4"	#10-16 OR #10-24 S.S. CONDITION CW OR SAE GR. 5 STEEL PAN HEAD SCREW	6	4"
	SILL						
CONCRETE 3,000 PSI	HEAD	1/4" Ø HILTI KWIK HUS-EZ (KH-EZ)	4	5"			
	SILL						
CONCRETE 4,000 PSI	HEAD	1/4" Ø HILTI KWIK HUS-EZ (KH-EZ)	4	5"			
	SILL						
CMU (GROUT FILLED) f'm = 1,500 PSI	HEAD	1/4" Ø HILTI KWIK HUS-EZ (KH-EZ)	6	4"			
	SILL		8				
STEEL STUD (18 ga. 33ksi)	HEAD	1/4"-14 SAE GR. 5 HEX/HWH HILTI KWIK FLEX OR DEWALT DRIL-FLEX	6	4"			
	SILL						

FOR ADDITIONAL ANCHOR REQUIREMENTS SUCH AS POSITION, EMBEDMENT, SUBSTRATE EDGE DISTANCE AND COMPONENT EDGE INSTALL DISTANCE, SEE TABLE ON SHEET 1 FOR THE SAME ANCHOR TYPE AND LOCATION.

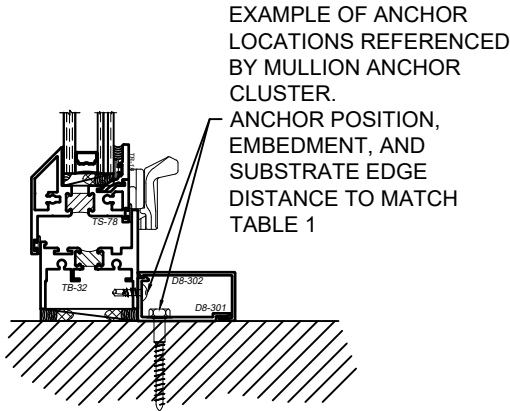


ANCHOR CLUSTER AT MULLIONS
(SEE SHEET 1 FOR ANCHORAGE
DETAILS AT ALL OTHER LOCATIONS)

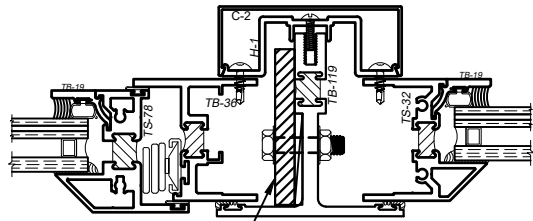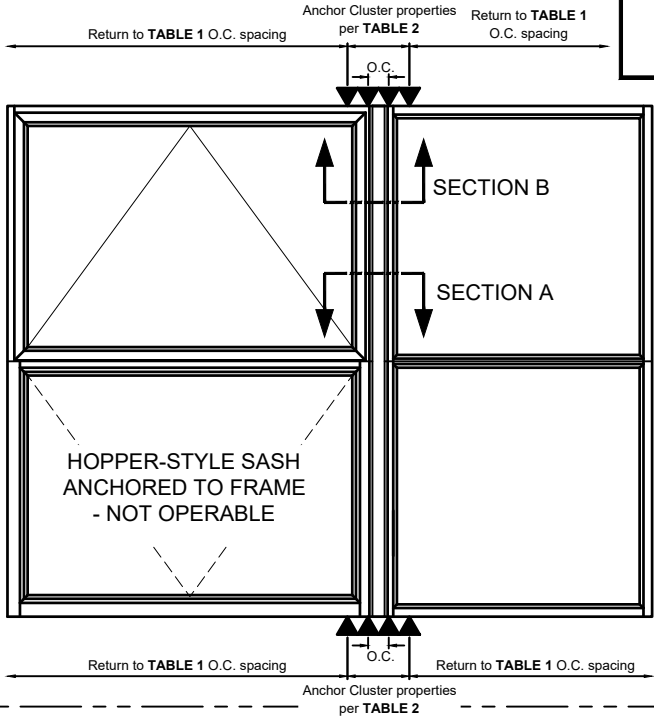

STEEL REINFORCEMENT AS TESTED
FOR MAX WINDOW SIZES AND DESIGN PRESSURE:
(1) 5/16" X 2-1/2" PRIMER COATED A36 STEEL FLAT BAR
ATTACHED WITH Ø1/4" SAE GR. 5 THRU BOLTS
AT 16" O.C. AND 3" FROM ENDS

SECTION A: STEEL REINFORCEMENT

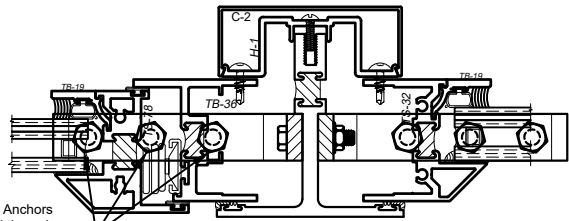


Non-Structural Mullion Installation Anchors
Mullion Loading Transferred through
adjacent window frames and resolved by
the anchor cluster in the installation trim

SECTION B: ANCH4 (SILL SIMILAR)

ATTACHMENTS AT MULLION

MULLION CLAMP
ANCHORAGE
TO MULLION & FRAME

#10-16 PAN HEAD
(WINCO # X-135)

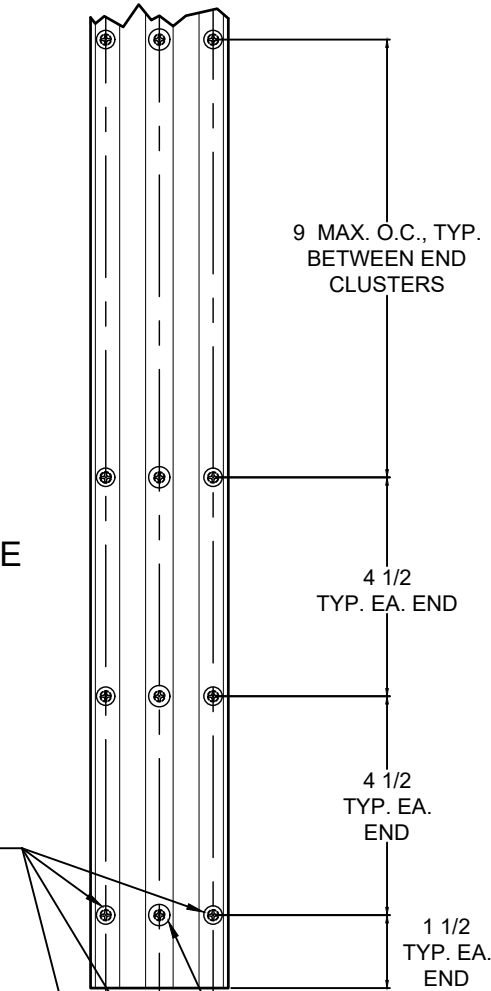

9 MAX. O.C., TYP.
BETWEEN END
CLUSTERS

4 1/2
TYP. EA. END


4 1/2
TYP. EA.
END

1 1/2
TYP. EA.
END

#10-24 TRUSS HEAD
MACHINE SCREW
(WINCO # X-326)

RICE
ENGINEERING

105 School Creek Trail
Luxemburg, WI 54217
Phone: (920) 617-1042
Fax: (920) 617-1100
www.rice-inc.com
Florida Firm No: F-01000005061
Certificate of Authorization: #9090
Wayne K. Helmila
Registration No: 59092

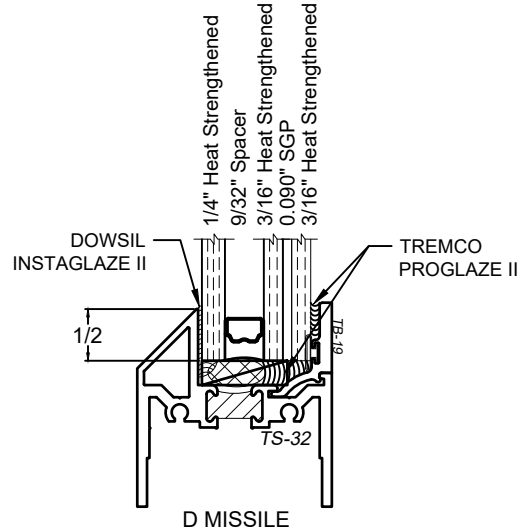

GLAZING DETAIL



10/24/2024
COA: 9090

Rev.	Description	Date
△		
△		
△		
△		

Scale: NONE Drawn by: B. FOOTE

Winco Window Co.
6200 Maple Ave.
St. Louis, MO 63130

PHONE: 314-725-8088

WINCO Product: 1150S AWNING - FX

Installation: ANCHORAGE: SNAP TRIM (SHT.2 OF 2)

Certification: LMI 1150S