

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

NOTES:


1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE.
2. WOOD FRAMING, METAL STRUCURE AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. WHERE SHIM OR BUCK THICKNESS IS LESS THAN 1-1/2" UNITS MUST BE ANCHORED THROUGH THE FRAME IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS. ANCHORS SHALL BE SECURELY FASTENED DIRECTLY INTO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE MATERIAL.
4. WHERE WOOD BUCK THICKNESS IS 1-1/2" OR GREATER, BUCK SHALL BE SECURELY FASTENED TO MASONRY, CONCRETE OR OTHER STRUCTURAL SUBSTRATE. UNITS MAY BE ANCHORED THROUGH FRAME TO SECURED WOOD BUCK IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS.
5. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
6. BUCKS SHALL EXTEND BEYOND UNIT FRAME INTERIOR FACE SO THAT FULL FRAME SUPPORT IS PROVIDED.
7. SHIM AS NEEDED AT EACH ANCHOR LOCATION WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
8. SHIMS SHALL BE LOCATED, APPLIED AND MADE FROM MATERIALS AND THICKNESS CAPABLE OF SUSTAINING APPLICABLE LOADS.
9. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
10. FRAME MATERIAL: EXTRUDED RIGID PVC.
11. UNITS MUST BE GLAZED PER ASTM E1300, SEE SHEET 15 FOR GLASS DETAILS.
12. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS UP TO WIND ZONE 3.

13. FOR ANCHORING THROUGH FIN INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
14. FOR ANCHORING THROUGH FIN INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
15. FOR ANCHORING THROUGH FRAME INTO WOOD FRAMING OR 2X BUCK USE #8 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
16. FOR ANCHORING THROUGH FRAME INTO MASONRY/CONCRETE USE 3/16" TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
17. FOR ANCHORING THROUGH FRAME INTO METAL STRUCTURE USE #8 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
18. ALL FASTENERS TO BE CORROSION RESISTANT.
19. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD: MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF 2,000 PSI.
 - C. MASONRY: HOLLOW/FILLED BLOCK PER ASTM C90 WITH Fm=2,000PSI MINIMUM.
 - D. METAL STRUCTURE: STEEL 18GA (.048") FY=33KSI/FU=52KSI OR ALUMINUM 6063-T5 FU=30KSI .125" THICK MINIMUM
20. GEOMETRIC SHAPES ARE ALSO APPROVED. APPROVED GEOMETRIC SHAPES DIMENSIONS SHALL NOT EXCEED INSCRIBED DIMENSIONS OF APPROVED RECTANGULAR ASSEMBLY SHOWN IN SHEETS 2 AND 3.

SIGNED: 07/15/2026


TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2 - 3	ELEVATIONS
4 - 14	INSTALLATION DETAILS
15	COMPONENTS AND GLAZING DETAIL

NT WINDOW, INC. 2900 WEST SEMINARY DR. FORT WORTH, TX 76133		
G250 PVC FIXED WINDOW IMPACT NOTES		
DRAWN: A.R.	DWG NO. 08-04151	REV -
SCALE NTS	DATE 05/01/2025	SHEET 1 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

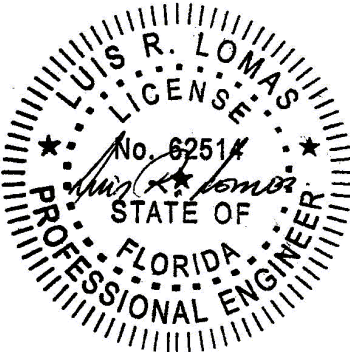


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

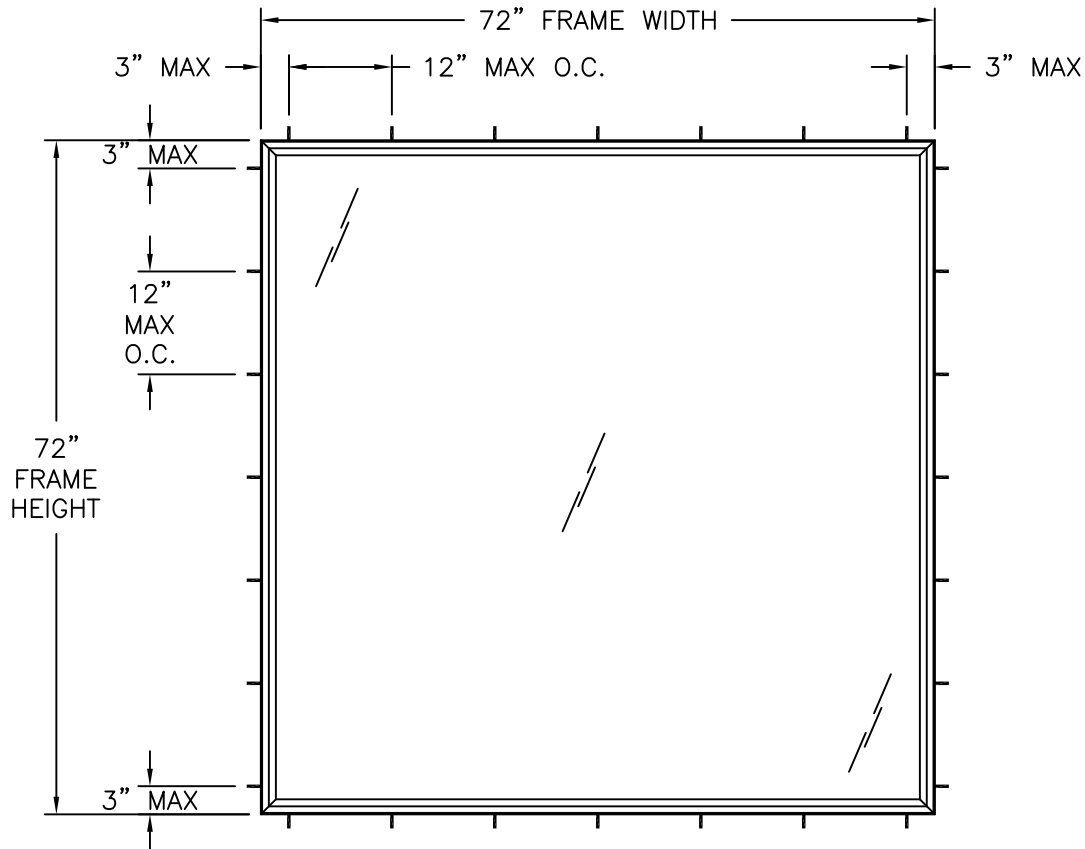

G250 PVC FIXED WINDOW
FINLESS, FLANGE AND STRAP INSTALLATION

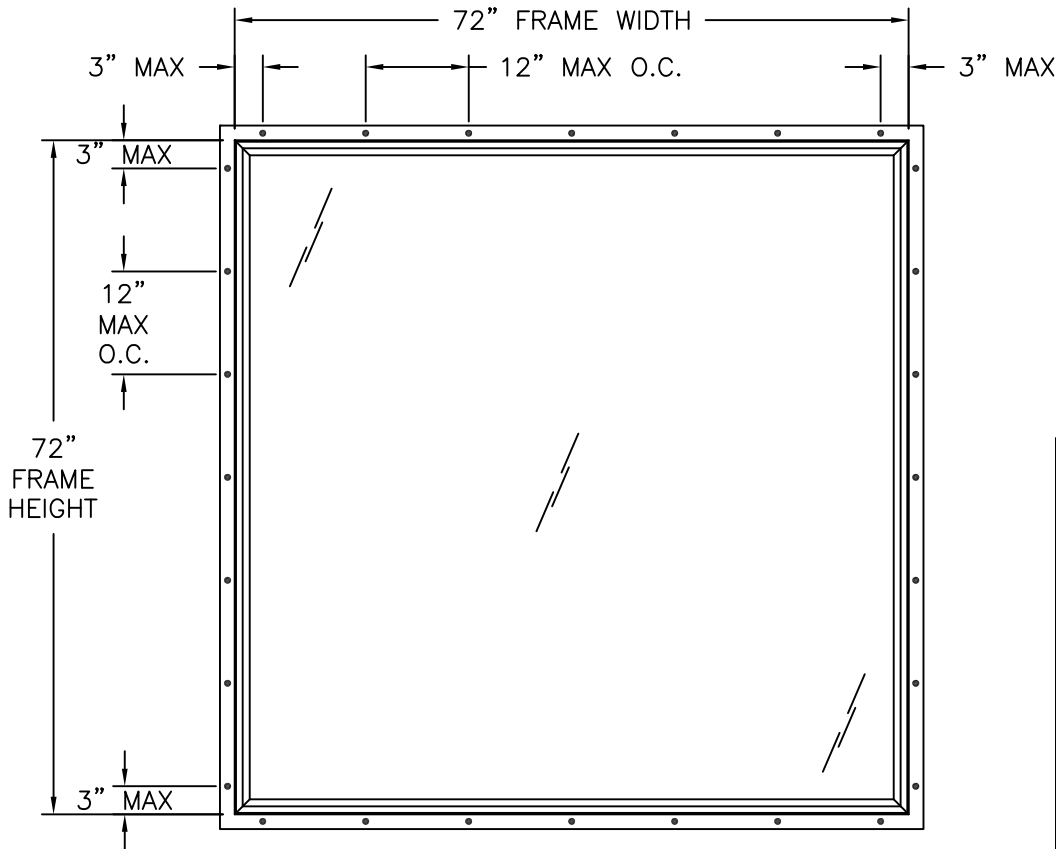

G250 PVC FIXED WINDOW
FIN INSTALLATION

NOTES:
1. D.L.O.: 68 3/4" X 68 3/4"

Chart #1
Rating (psf)


Frame Height (in)	Frame width (in)								
	42.00	48.00	52.00	54.00	60.00	66.00	72.00	78.00	84.00
24.00	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
30.00	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
36.00	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
42.00	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
48.00	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
54.00	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	57.8
60.00	60.0	60.0	60.0	60.0	60.0	60.0	60.0	56.0	51.8
66.00	60.0	60.0	60.0	60.0	60.0	60.0	55.2	50.4	-
72.00	60.0	60.0	60.0	60.0	60.0	55.2	50.0	-	-
78.00	60.0	60.0	60.0	60.0	56.0	50.4	-	-	-
84.00	60.0	60.0	60.0	57.8	51.8	-	-	-	-

DESIGN PRESSURE RATING	IMPACT RATING
±50.0PSF	LARGE AND SMALL MISSILE IMPACT


MISSILE LEVEL D, WIND ZONE 3
72" X 72" UNIT SHOWN. FOR OTHER SIZES RATINGS REFER TO CHART #1 THIS SHEET

SIGNED: 07/15/2026


NT WINDOW, INC. 2900 WEST SEMINARY DR. FORT WORTH, TX 76133		
G250 PVC FIXED WINDOW IMPACT ELEVATIONS AND GLAZING DETAIL		
DRAWN: A.R.	DWG NO. 08-04151	REV -
SCALE NTS	DATE 05/01/2025	SHEET 2 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

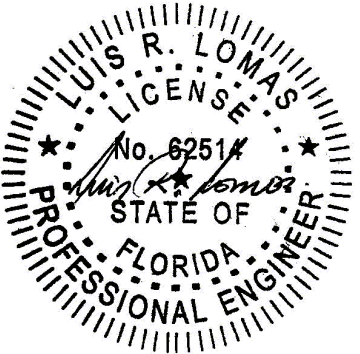

Luis R. Lomas P.E.
FL No.: 62514

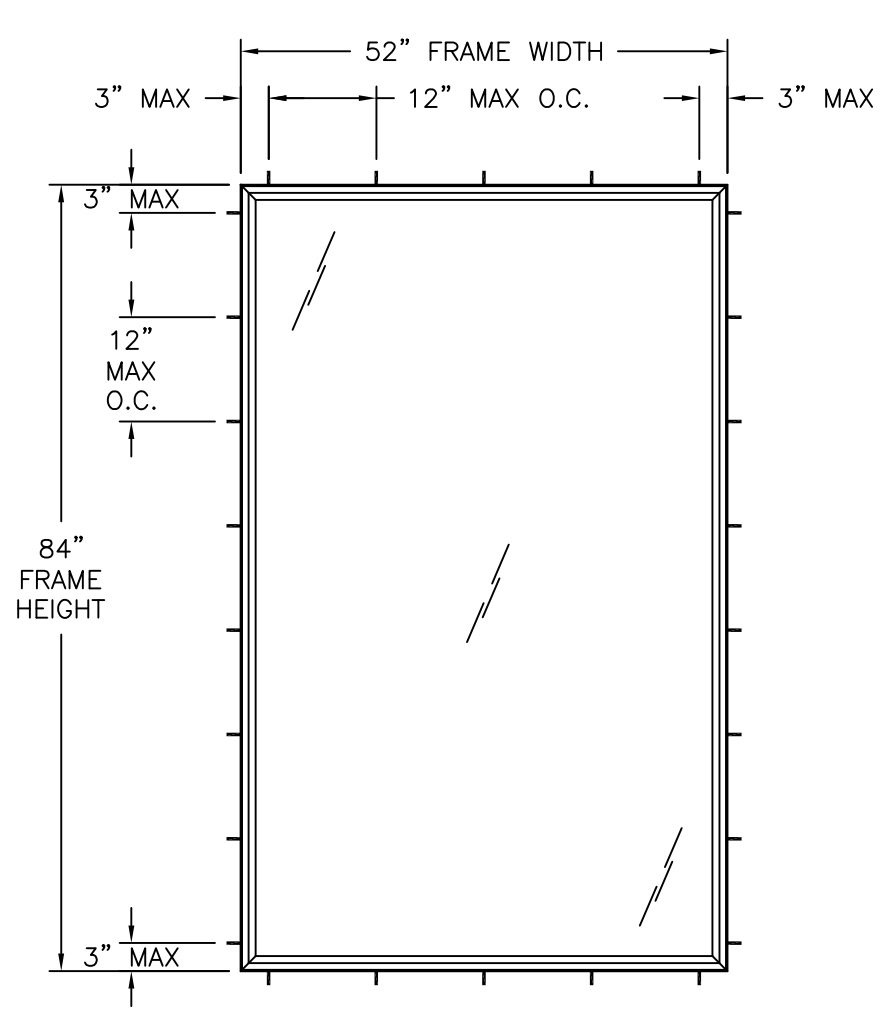

G250 PVC FIXED WINDOW
FINLESS, FLANGE AND STRAP INSTALLATION

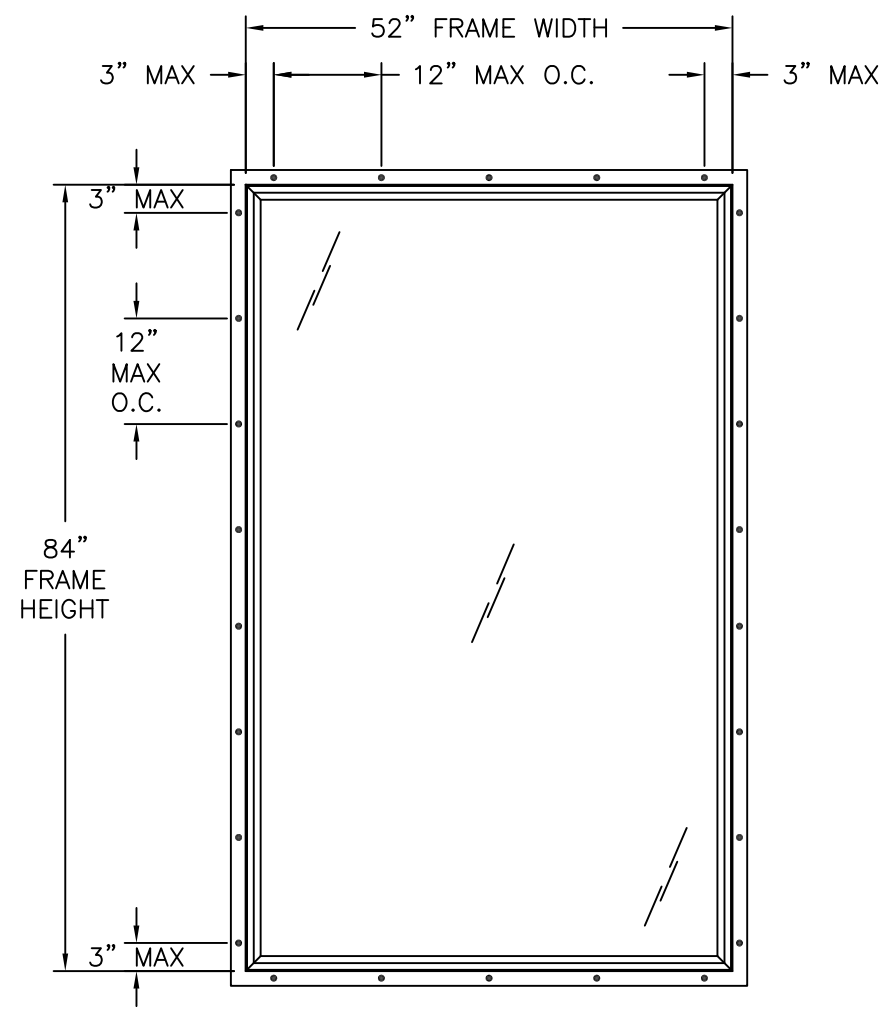

G250 PVC FIXED WINDOW
FIN INSTALLATION

NOTES:
1. D.L.O.: 48 3/4" X 80 3/4"

DESIGN PRESSURE RATING	IMPACT RATING
±60.0PSF	LARGE AND SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 3
52" X 84" UNIT SHOWN. FOR OTHER SIZES RATINGS REFER TO CHART #1 SHEET 1

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

NT WINDOW, INC.
2900 WEST SEMINARY DR.
FORT WORTH, TX 76133

G250 PVC FIXED WINDOW
IMPACT
ELEVATIONS



DRAWN: A.R.	DWG NO. 08-04151	REV -
SCALE NTS	DATE 05/01/2025	SHEET 3 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com


SIGNED: 07/15/2026

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

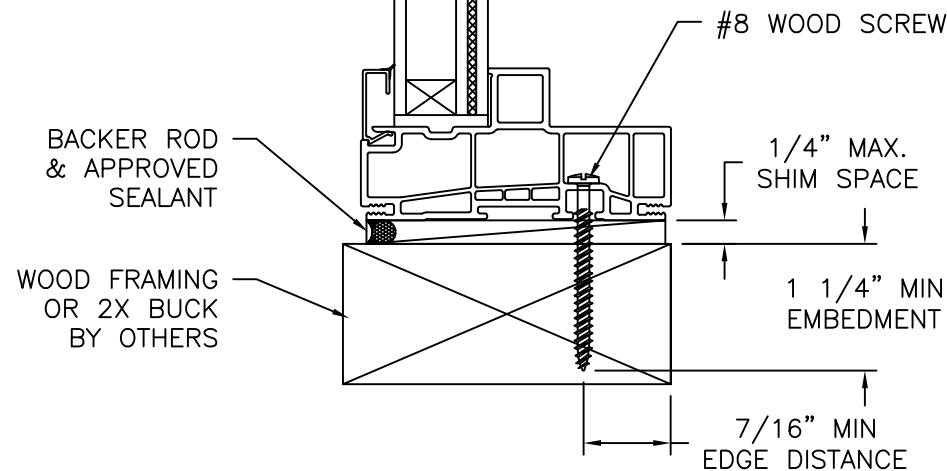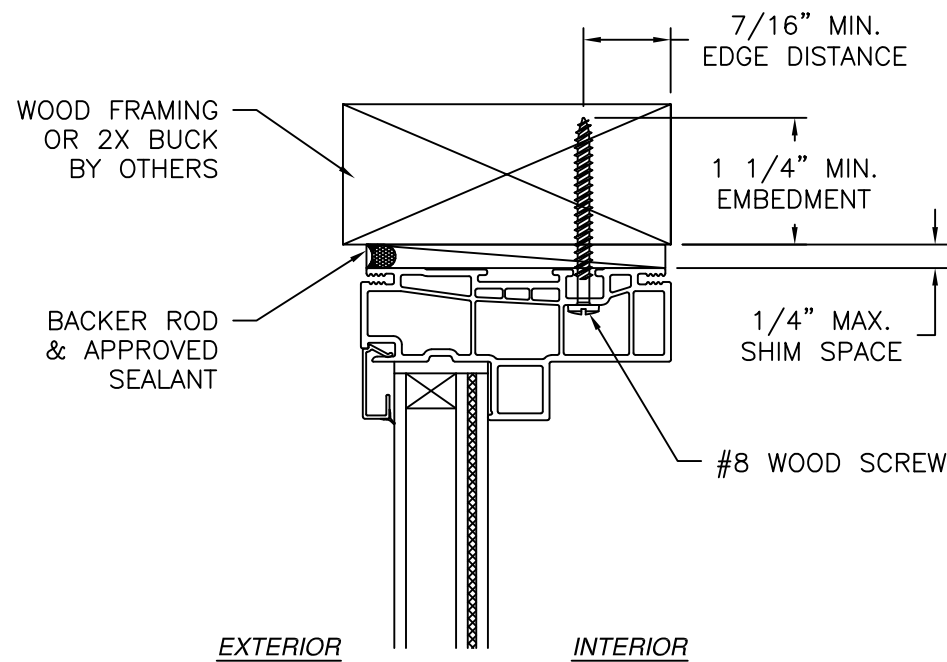

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

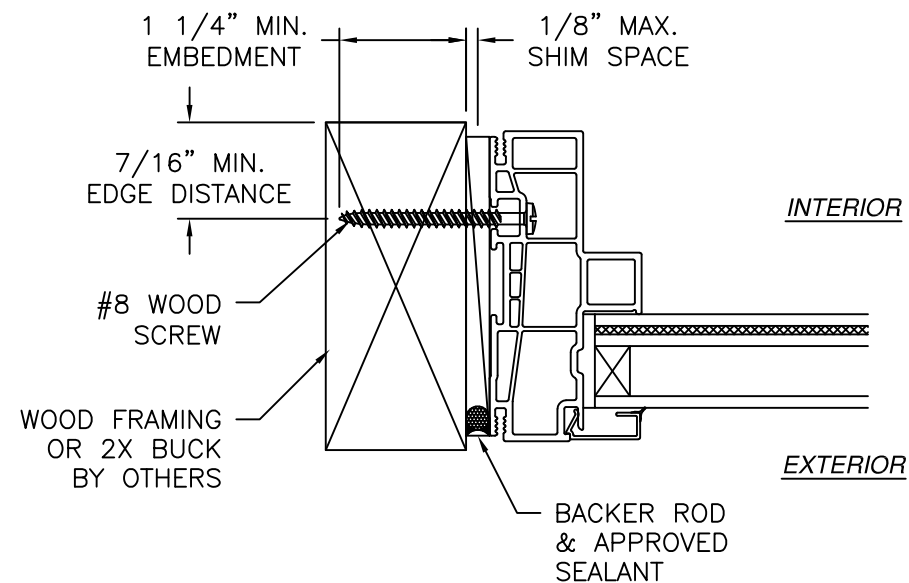


JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 07/15/2026

NT WINDOW, INC. 2900 WEST SEMINARY DR. FORT WORTH, TX 76133		
G250 PVC FIXED WINDOW IMPACT FINLESS INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-04151	REV -
SCALE NTS	DATE 05/01/2025	SHEET 4 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

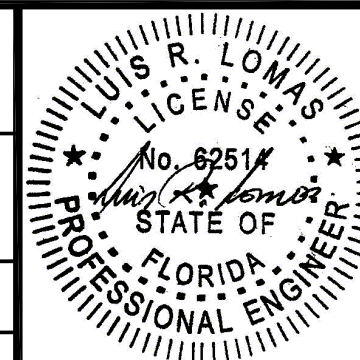


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

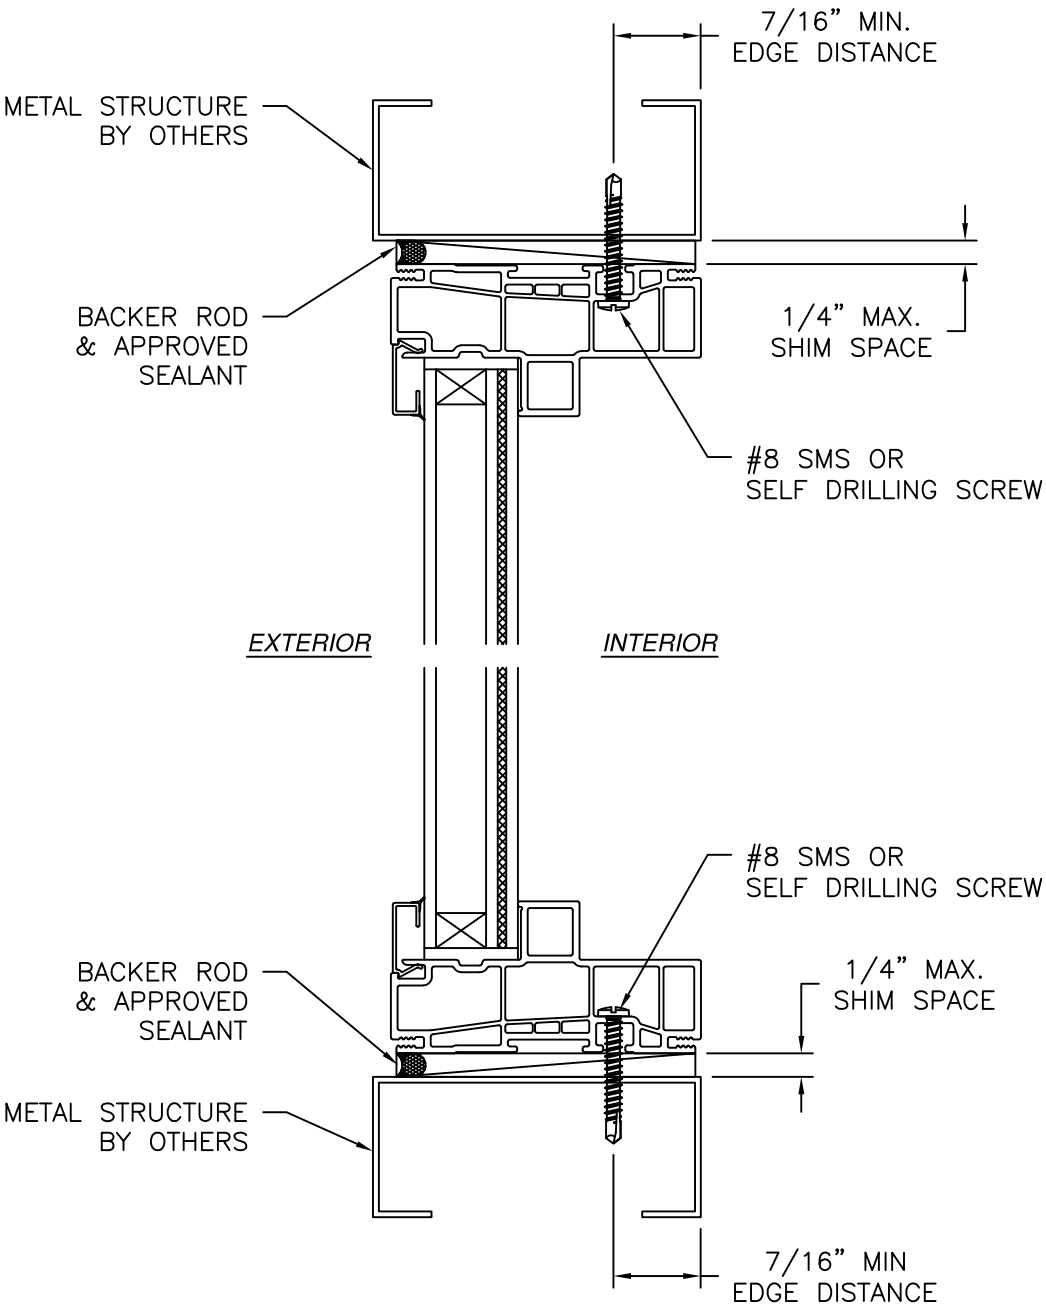

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

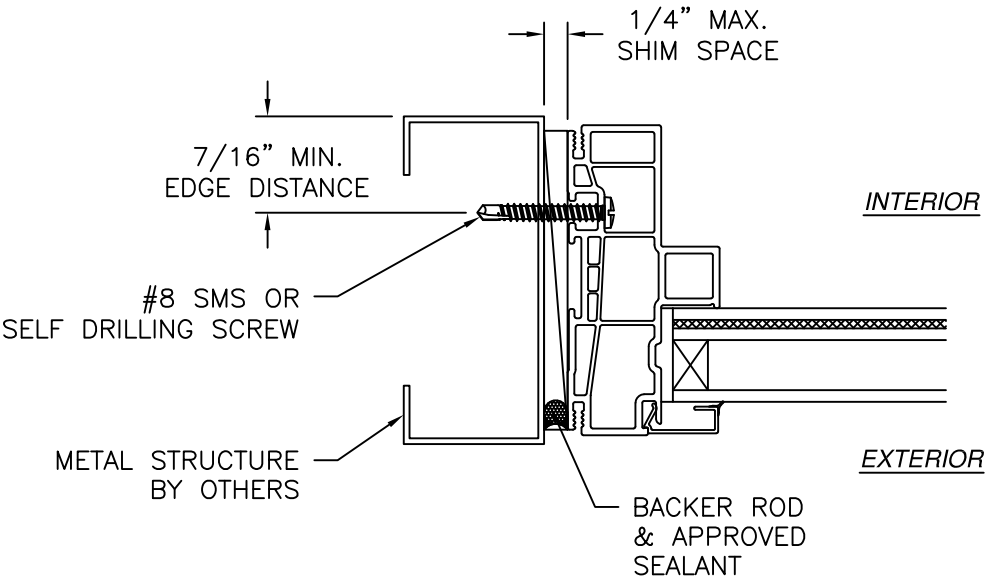

JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/15/2026

NT WINDOW, INC.
2900 WEST SEMINARY DR.
FORT WORTH, TX 76133

G250 PVC FIXED WINDOW
IMPACT
FINLESS INSTALLATION DETAILS

DRAWN:
A.R.

DWG NO.
08-04151


REV
-

SCALE
NTS

DATE
05/01/2025


SHEET
5 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

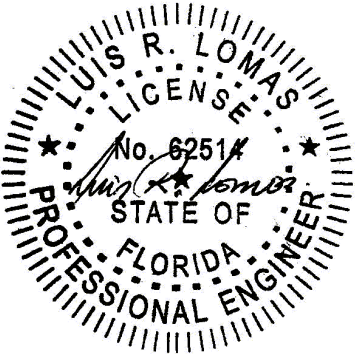


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

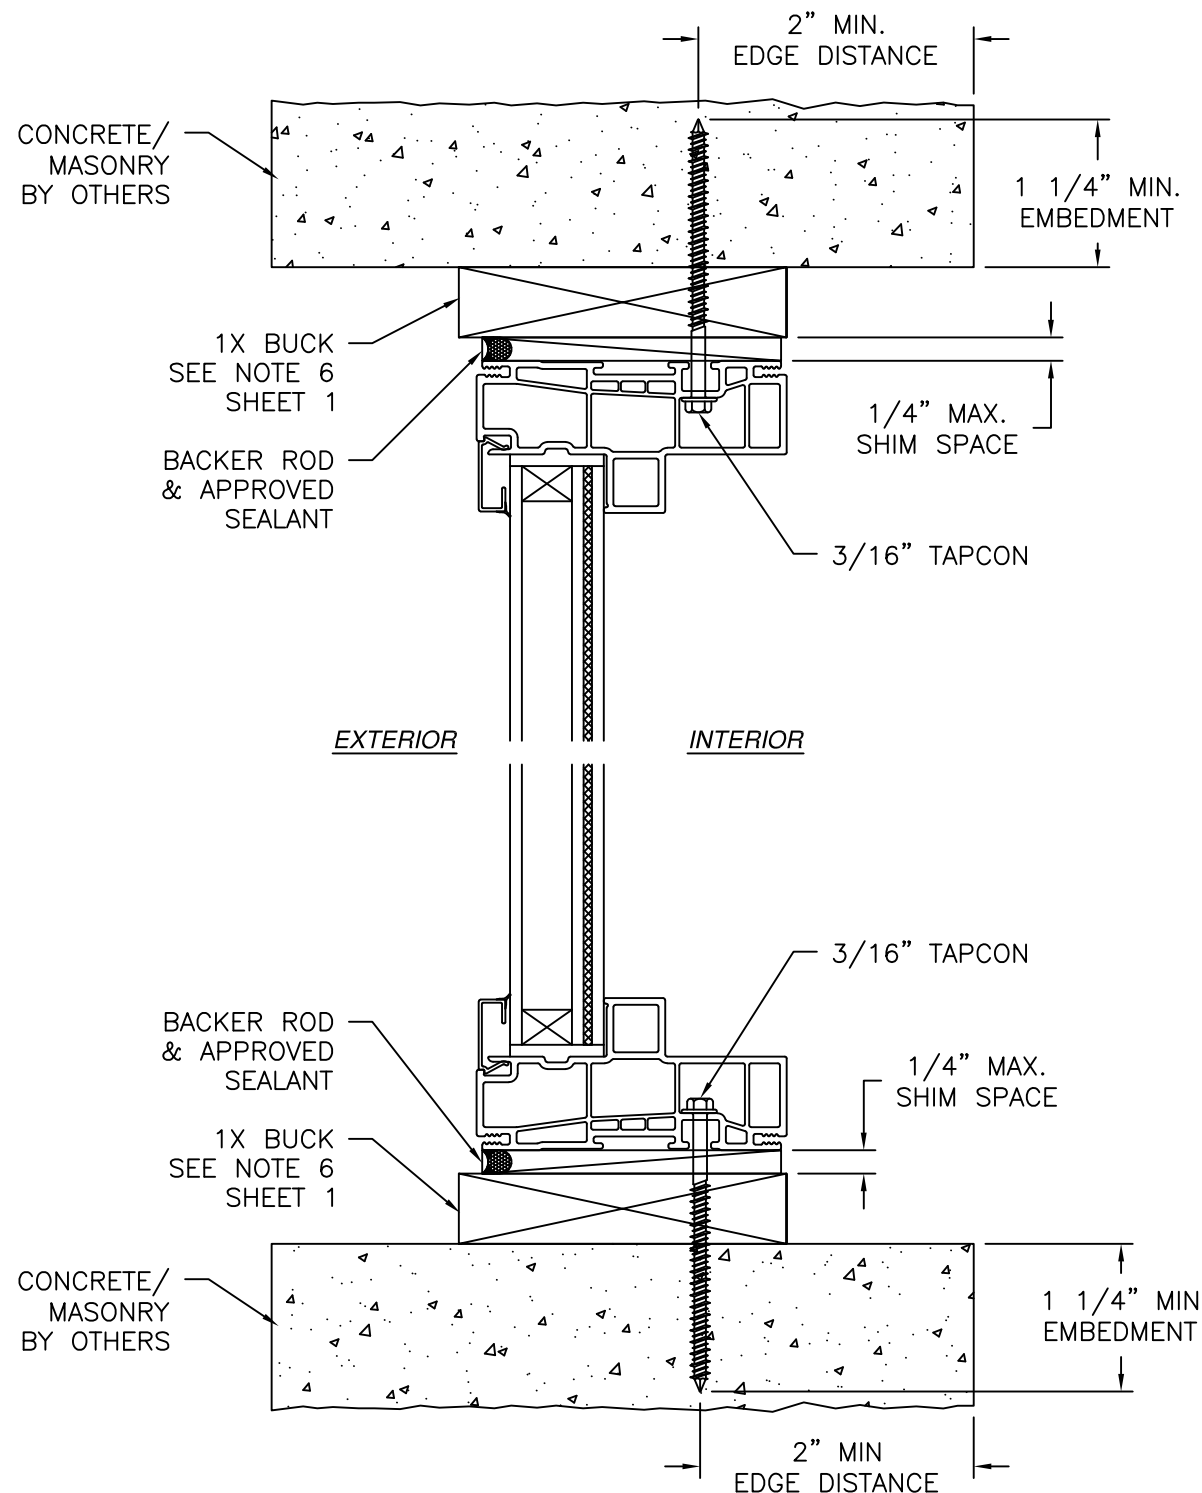

VERTICAL CROSS SECTION
 CONCRETE/MASONRY WITH 1X BUCK INSTALLATION
 FOR CONCRETE/MASONRY WITHOUT 1X BUCK REFER TO
 JAMB INSTALLATION DETAIL

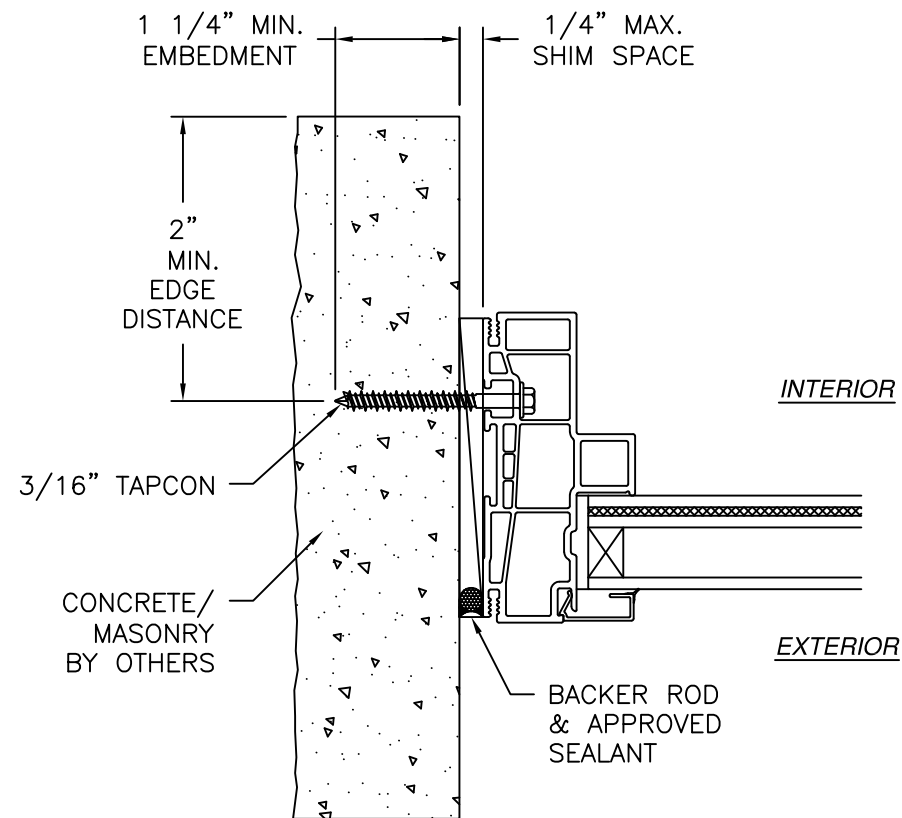


JAMB INSTALLATION DETAIL
 CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION
 FOR CONCRETE/MASONRY WITH 1X BUCK REFER TO
 HEAD AND SILL INSTALLATION DETAILS

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



SIGNED: 07/15/2026

NT WINDOW, INC. 2900 WEST SEMINARY DR. FORT WORTH, TX 76133		
G250 PVC FIXED WINDOW IMPACT FINLESS INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-04151	REV —
SCALE NTS	DATE 05/01/2025	SHEET 6 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

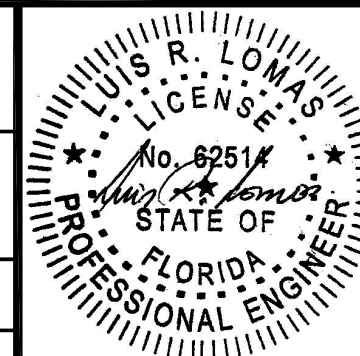


Luis R. Lomas P.E.
 FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

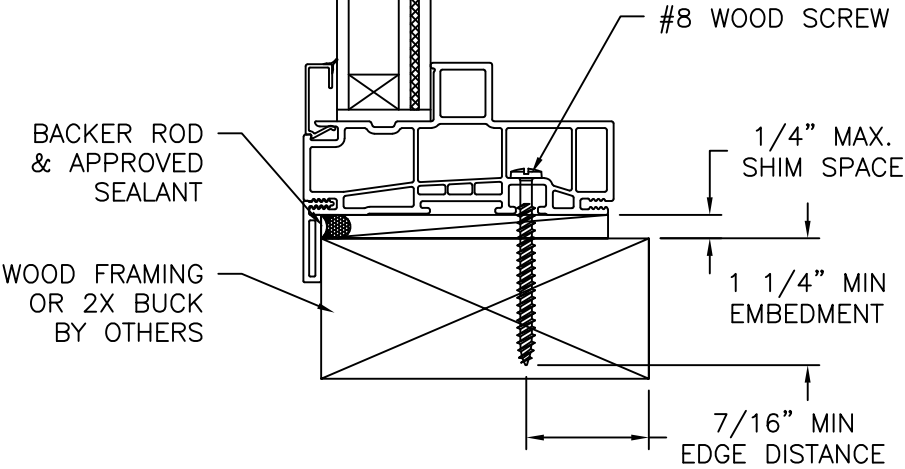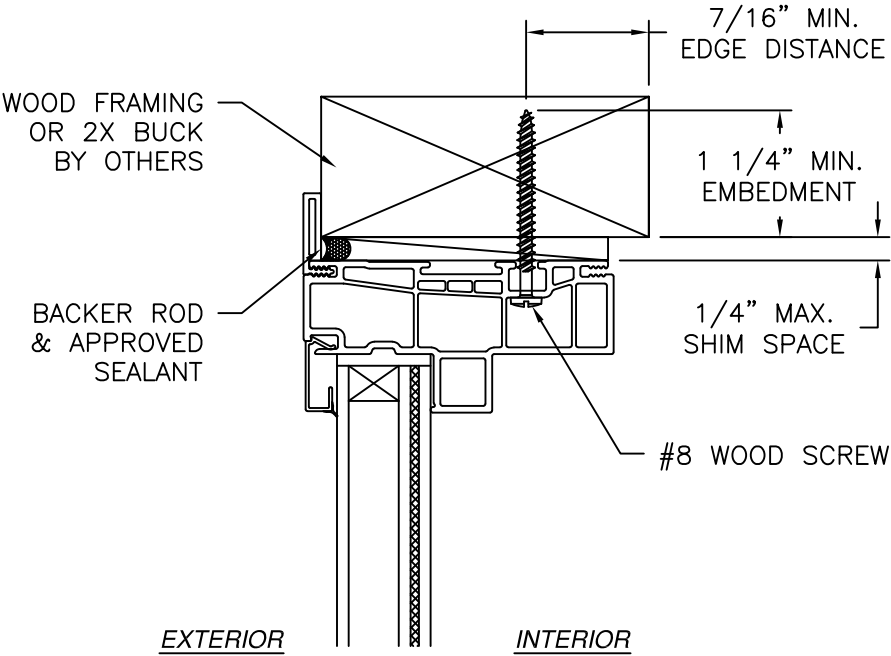

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

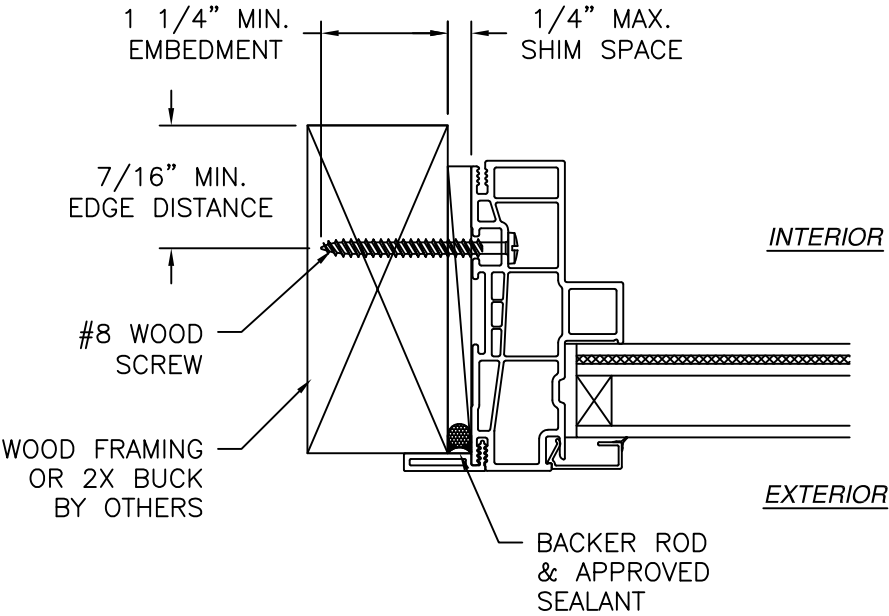

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/15/2026

NT WINDOW, INC.
2900 WEST SEMINARY DR.
FORT WORTH, TX 76133

G250 PVC FIXED WINDOW
IMPACT
FLANGE INSTALLATION DETAILS

DRAWN:
A.R.

DWG NO.
08-04151


REV
-

SCALE
NTS

DATE
05/01/2025



SHEET
7 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

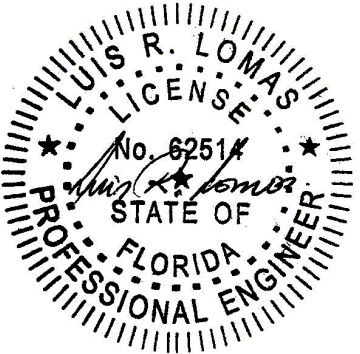


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

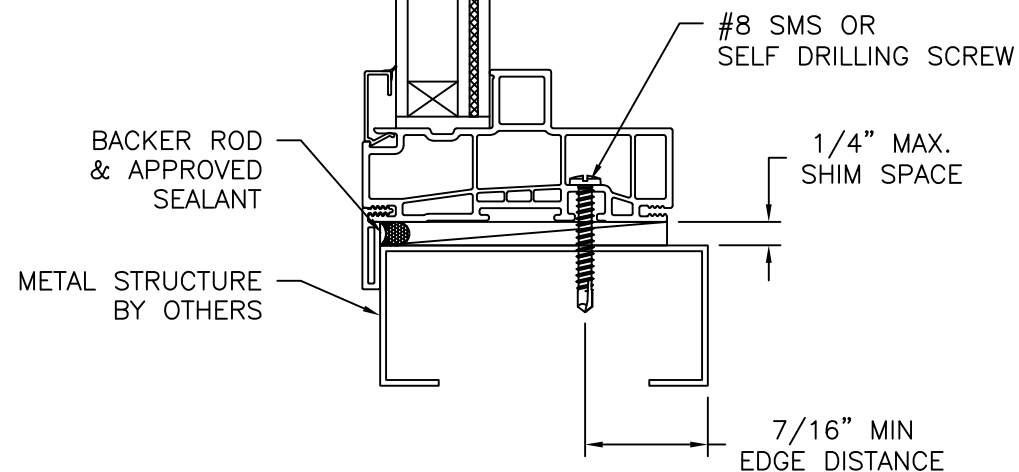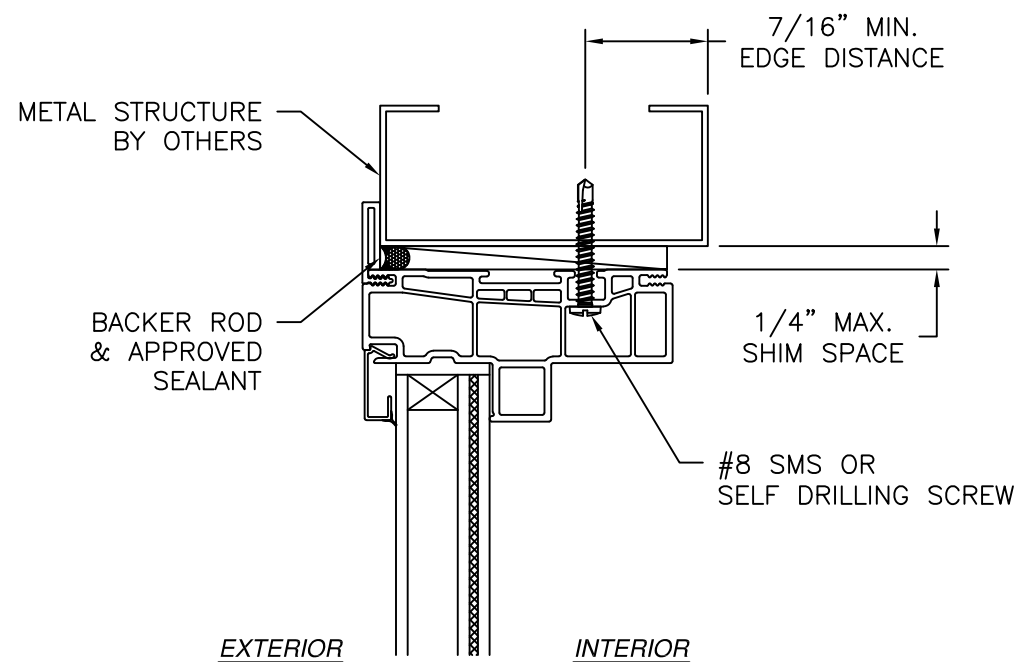

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

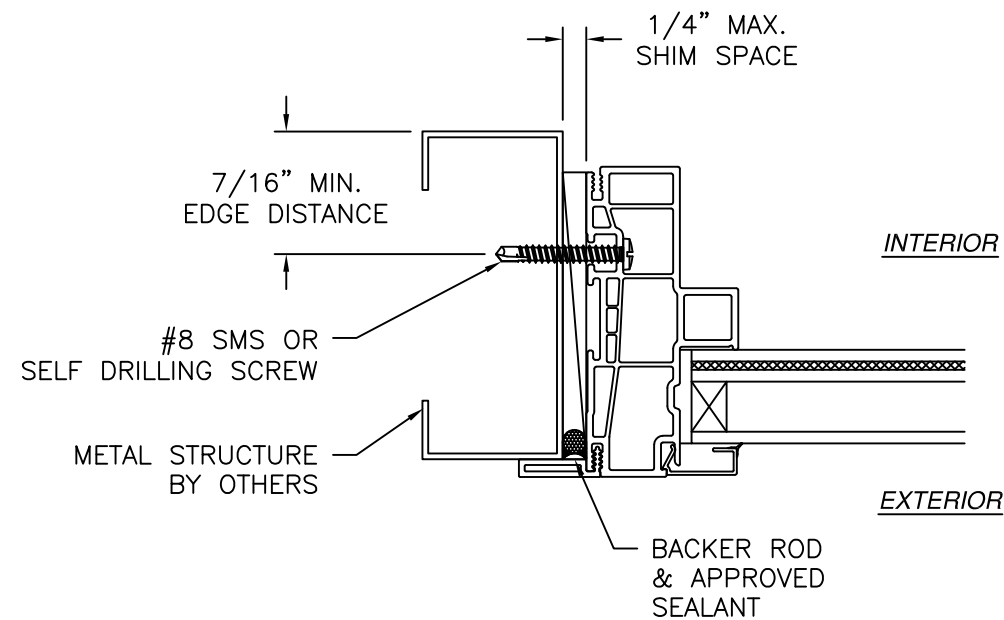


JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 07/15/2026

NT WINDOW, INC. 2900 WEST SEMINARY DR. FORT WORTH, TX 76133		
G250 PVC FIXED WINDOW IMPACT FLANGE INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-04151	REV —
SCALE NTS	DATE 05/01/2025	SHEET 8 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

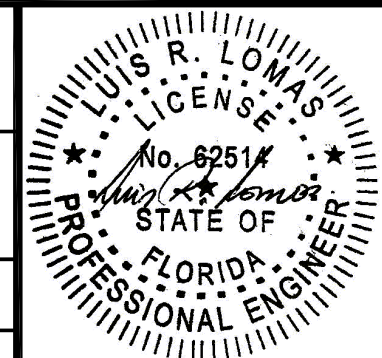


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

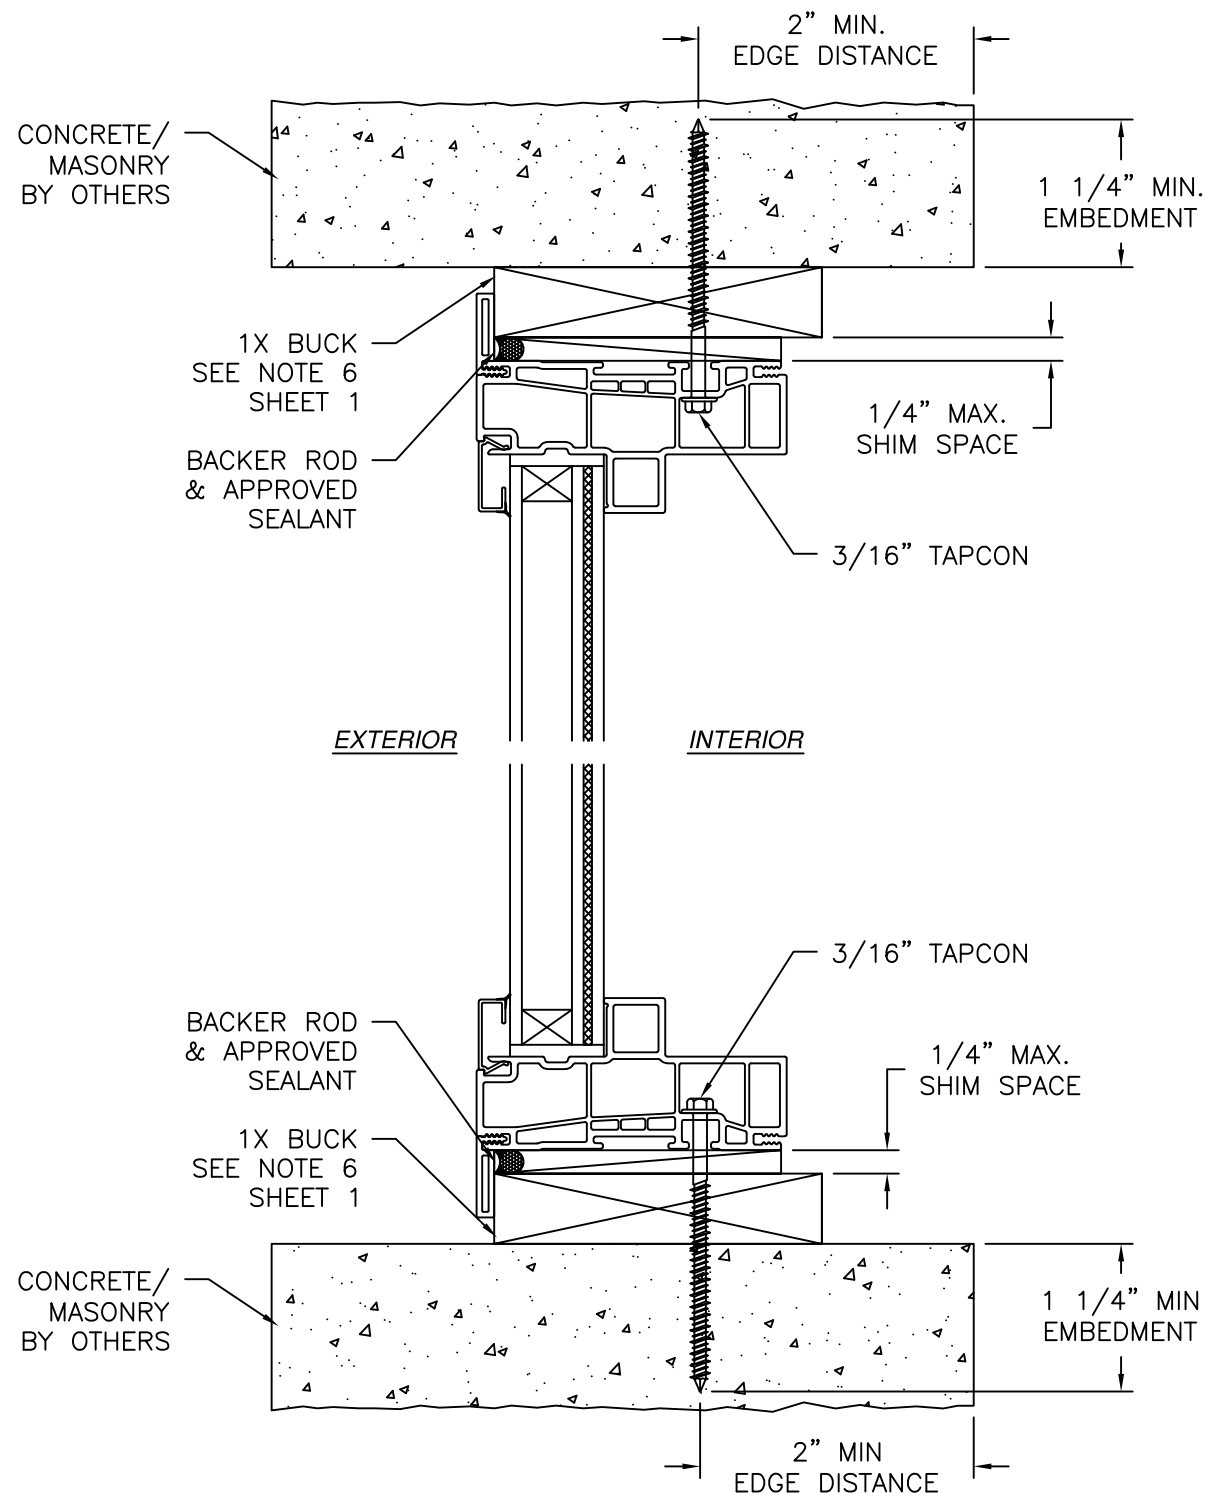

VERTICAL CROSS SECTION
 CONCRETE/MASONRY WITH 1X BUCK INSTALLATION
 FOR CONCRETE/MASONRY WITHOUT 1X BUCK REFER TO
 JAMB INSTALLATION DETAIL

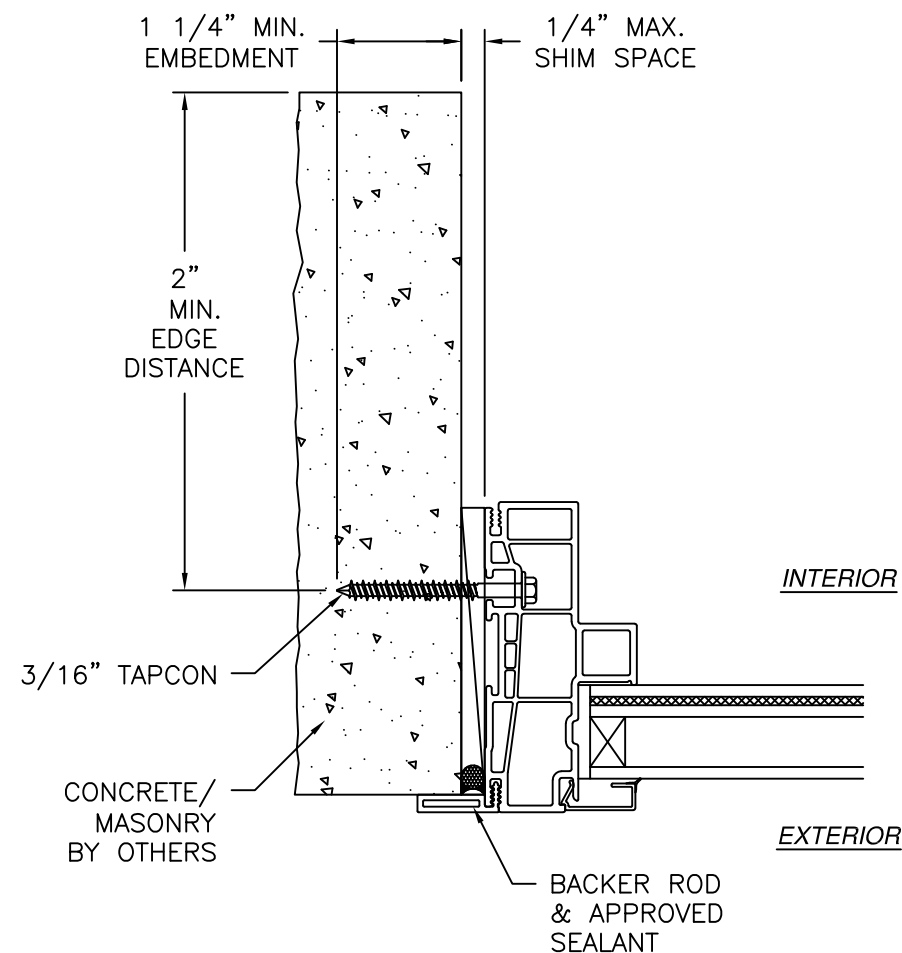


JAMB INSTALLATION DETAIL
 CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION
 FOR CONCRETE/MASONRY INSTALLATION WITH 1X BUCK REFER TO
 HEAD AND SILL INSTALLATION DETAILS

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



SIGNED: 07/15/2026

NT WINDOW, INC. 2900 WEST SEMINARY DR. FORT WORTH, TX 76133		
G250 PVC FIXED WINDOW IMPACT FLANGE INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-04151	REV -
SCALE NTS	DATE 05/01/2025	SHEET 9 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

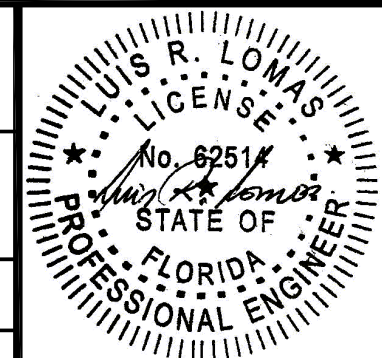


Luis R. Lomas P.E.
 FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

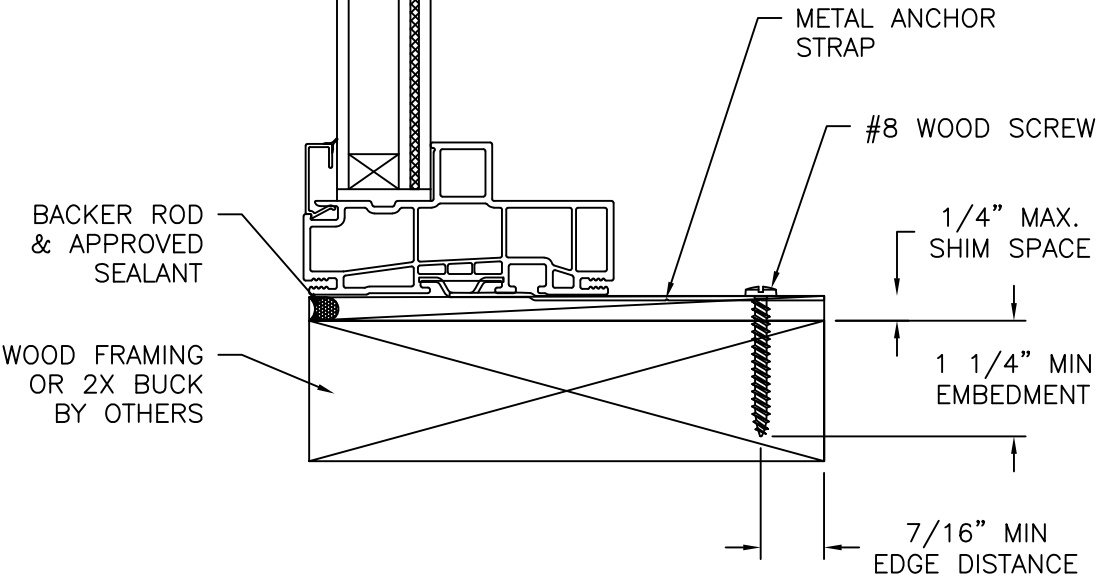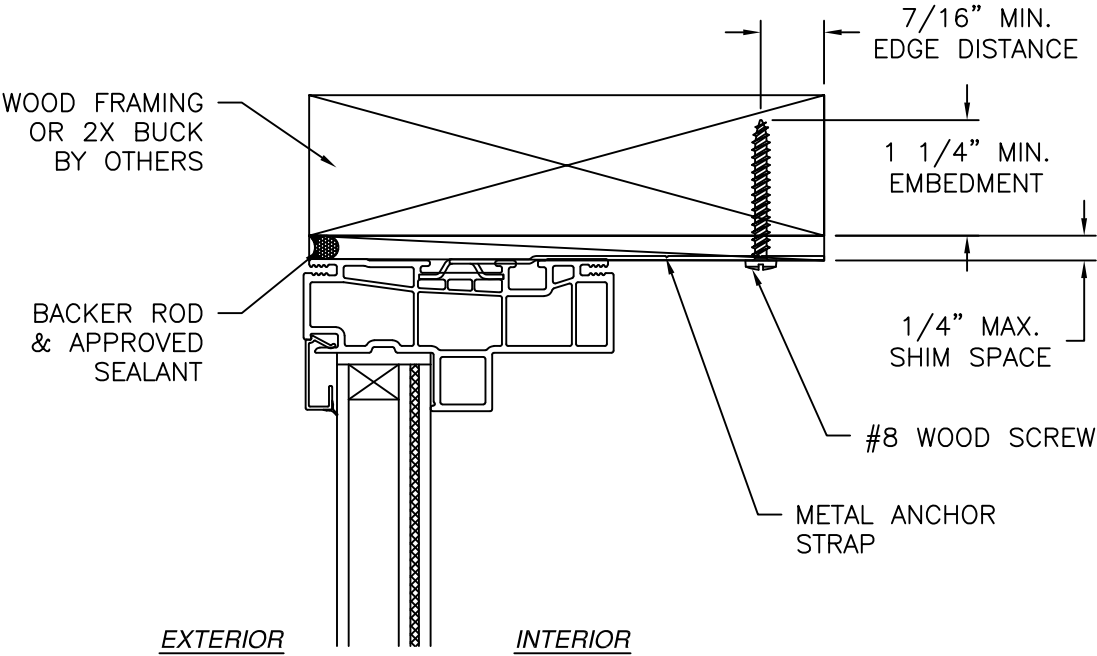

VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

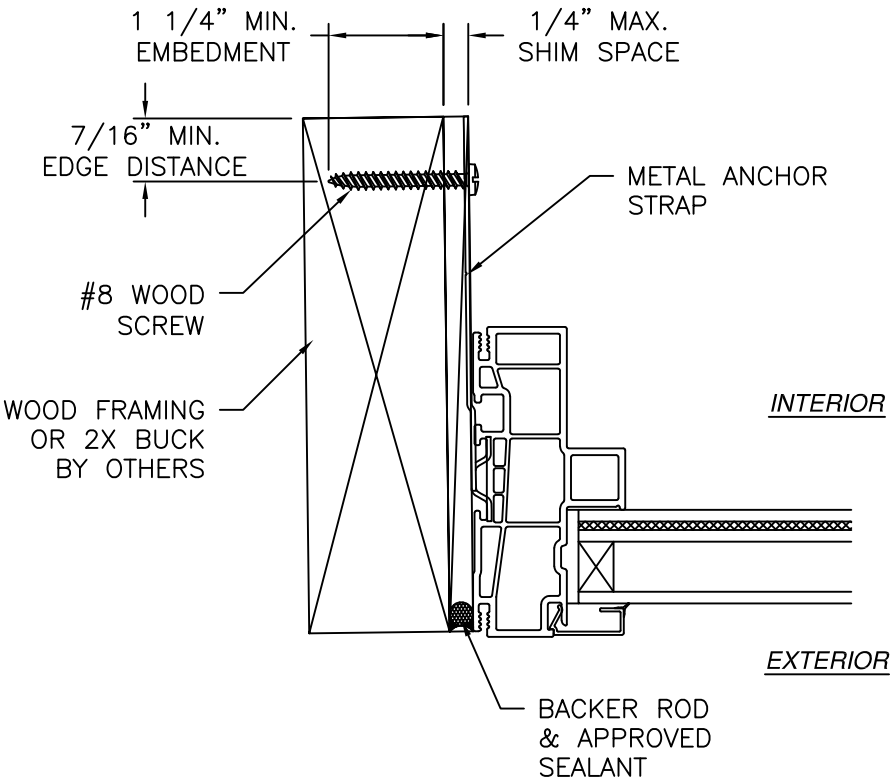

JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/15/2026

NT WINDOW, INC.
2900 WEST SEMINARY DR.
FORT WORTH, TX 76133

G250 PVC FIXED WINDOW
IMPACT
STRAP INSTALLATION DETAILS

DRAWN:
A.R.

DWG NO.
08-04151


REV
-

SCALE
NTS

DATE
05/01/2025



SHEET
10 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

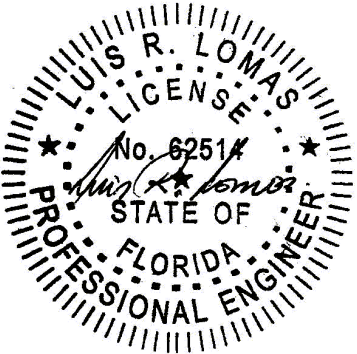


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

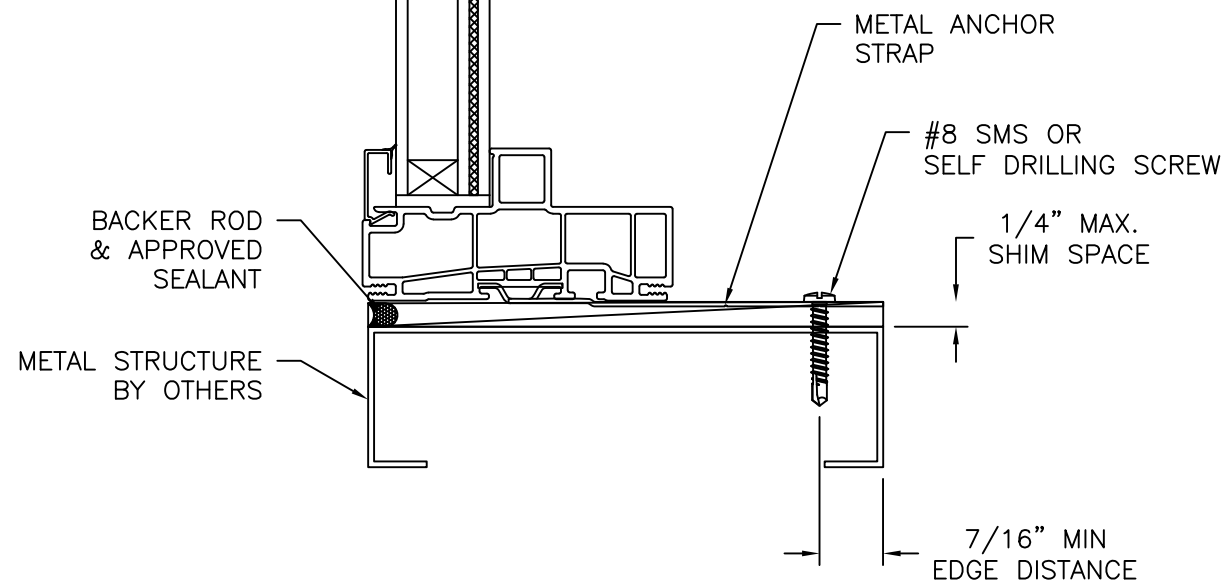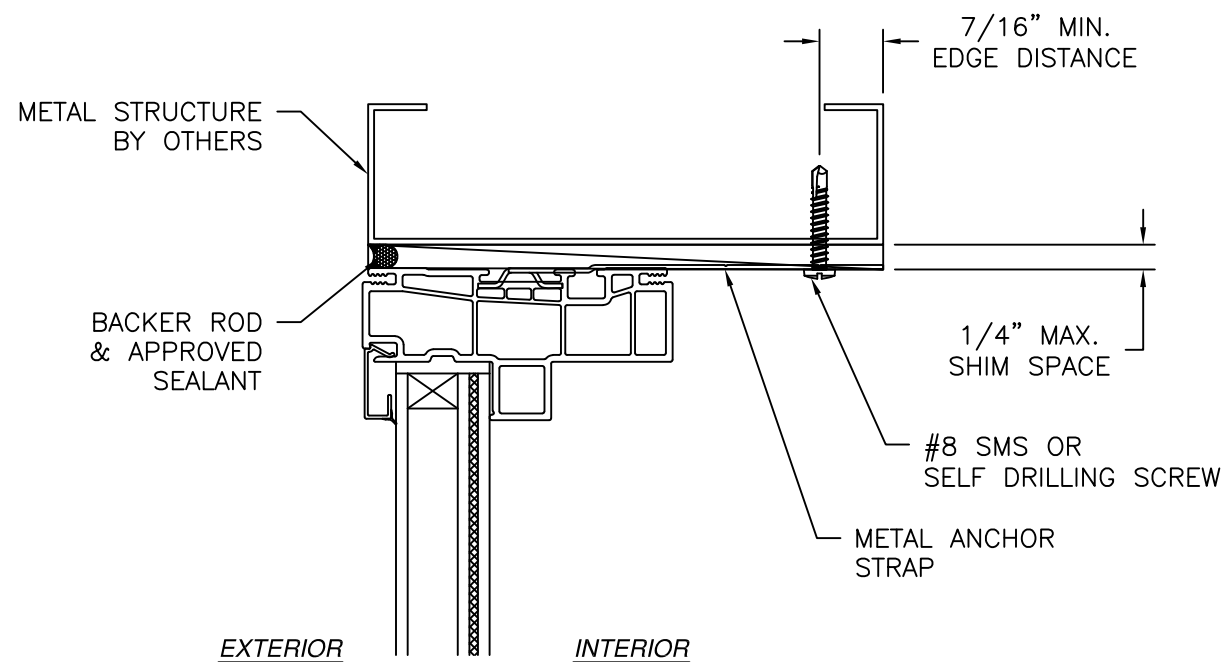

VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

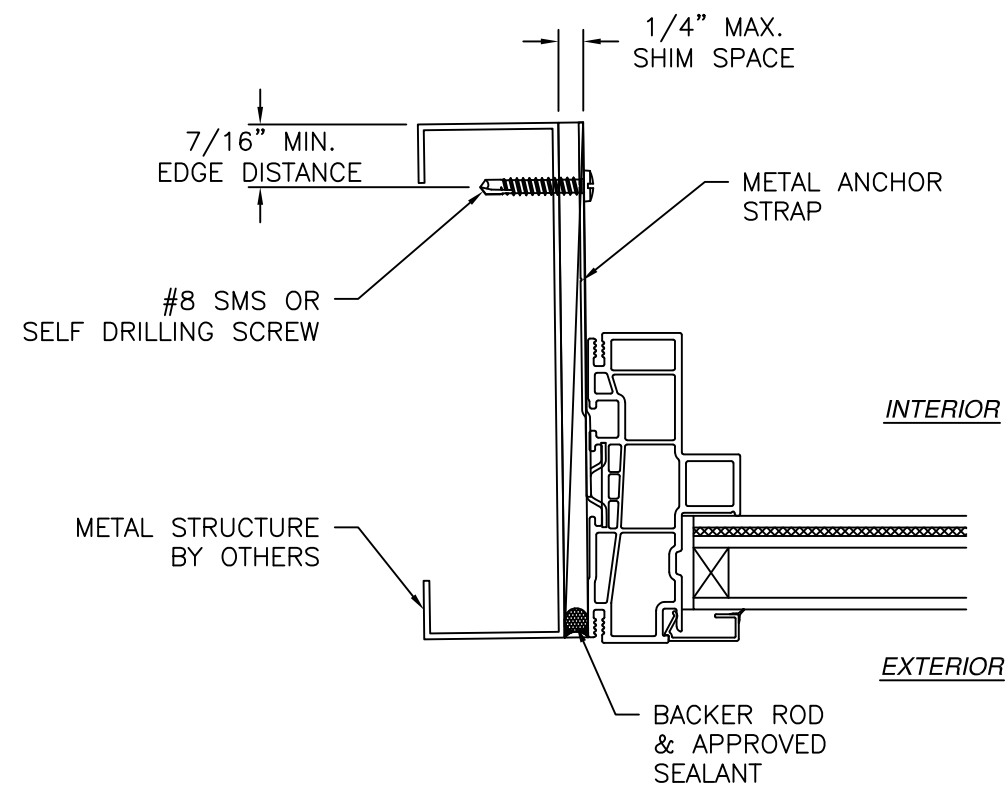


JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 07/15/2026

NT WINDOW, INC. 2900 WEST SEMINARY DR. FORT WORTH, TX 76133		
G250 PVC FIXED WINDOW IMPACT STRAP INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-04151	REV -
SCALE NTS	DATE 05/01/2025	SHEET 11 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

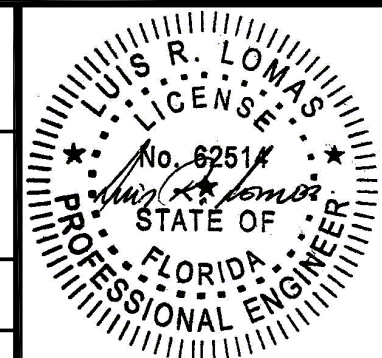


Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

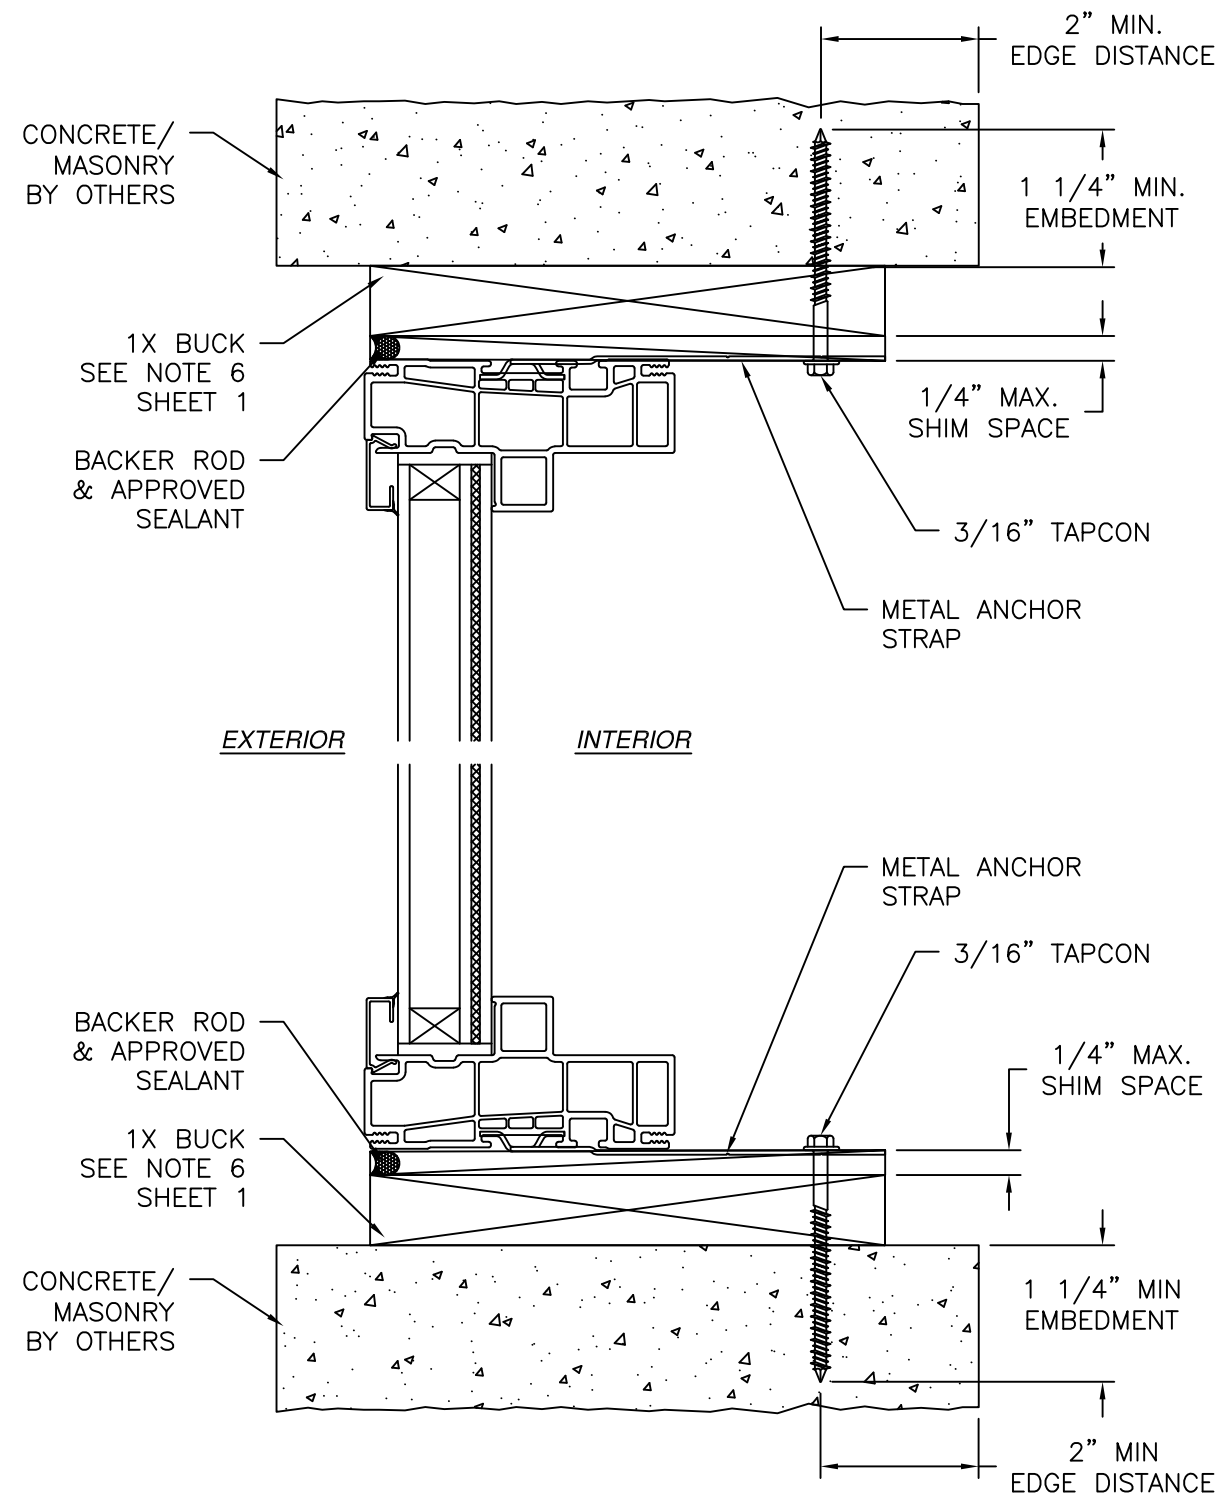

VERTICAL CROSS SECTION
 CONCRETE/MASONRY WITH 1X BUCK INSTALLATION
 FOR CONCRETE/MASONRY WITHOUT 1X BUCK REFER TO
 JAMB INSTALLATION DETAIL

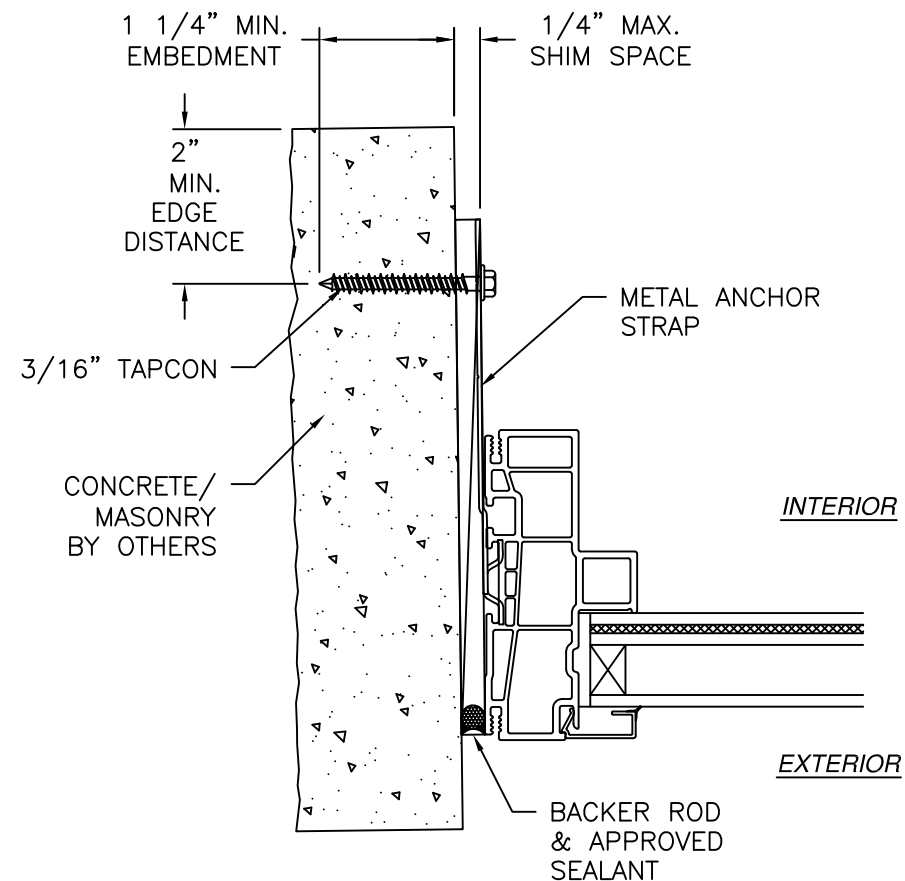


JAMB INSTALLATION DETAIL
 CONCRETE/MASONRY WITHOUT 1X BUCK INSTALLATION
 FOR CONCRETE/MASONRY INSTALLATION WITH 1X BUCK REFER TO
 HEAD AND SILL INSTALLATION DETAILS

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



SIGNED: 07/15/2026

NT WINDOW, INC. 2900 WEST SEMINARY DR. FORT WORTH, TX 76133		
G250 PVC FIXED WINDOW IMPACT STRAP INSTALLATION DETAILS		
DRAWN: A.R.	DWG NO. 08-04151	REV -
SCALE NTS	DATE 05/01/2025	SHEET 12 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

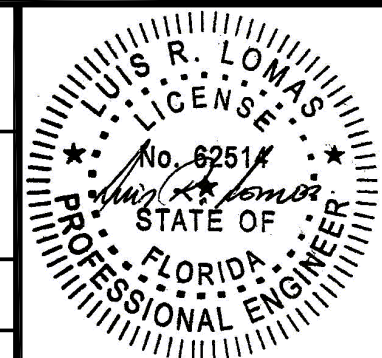

Luis R. Lomas P.E.
 FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

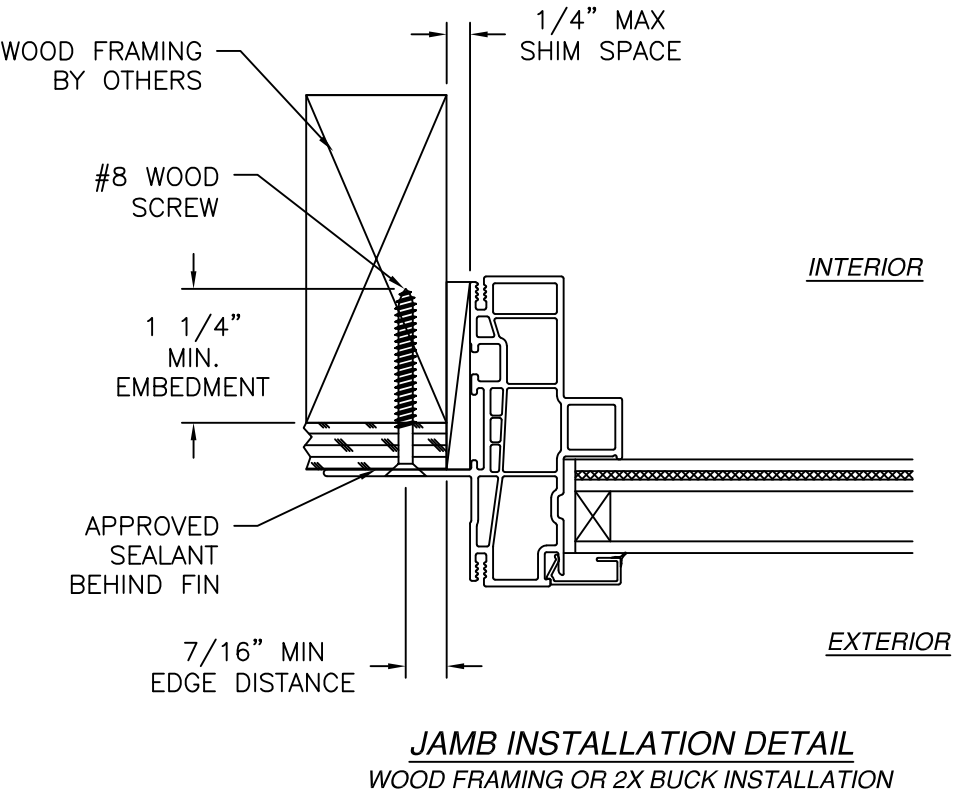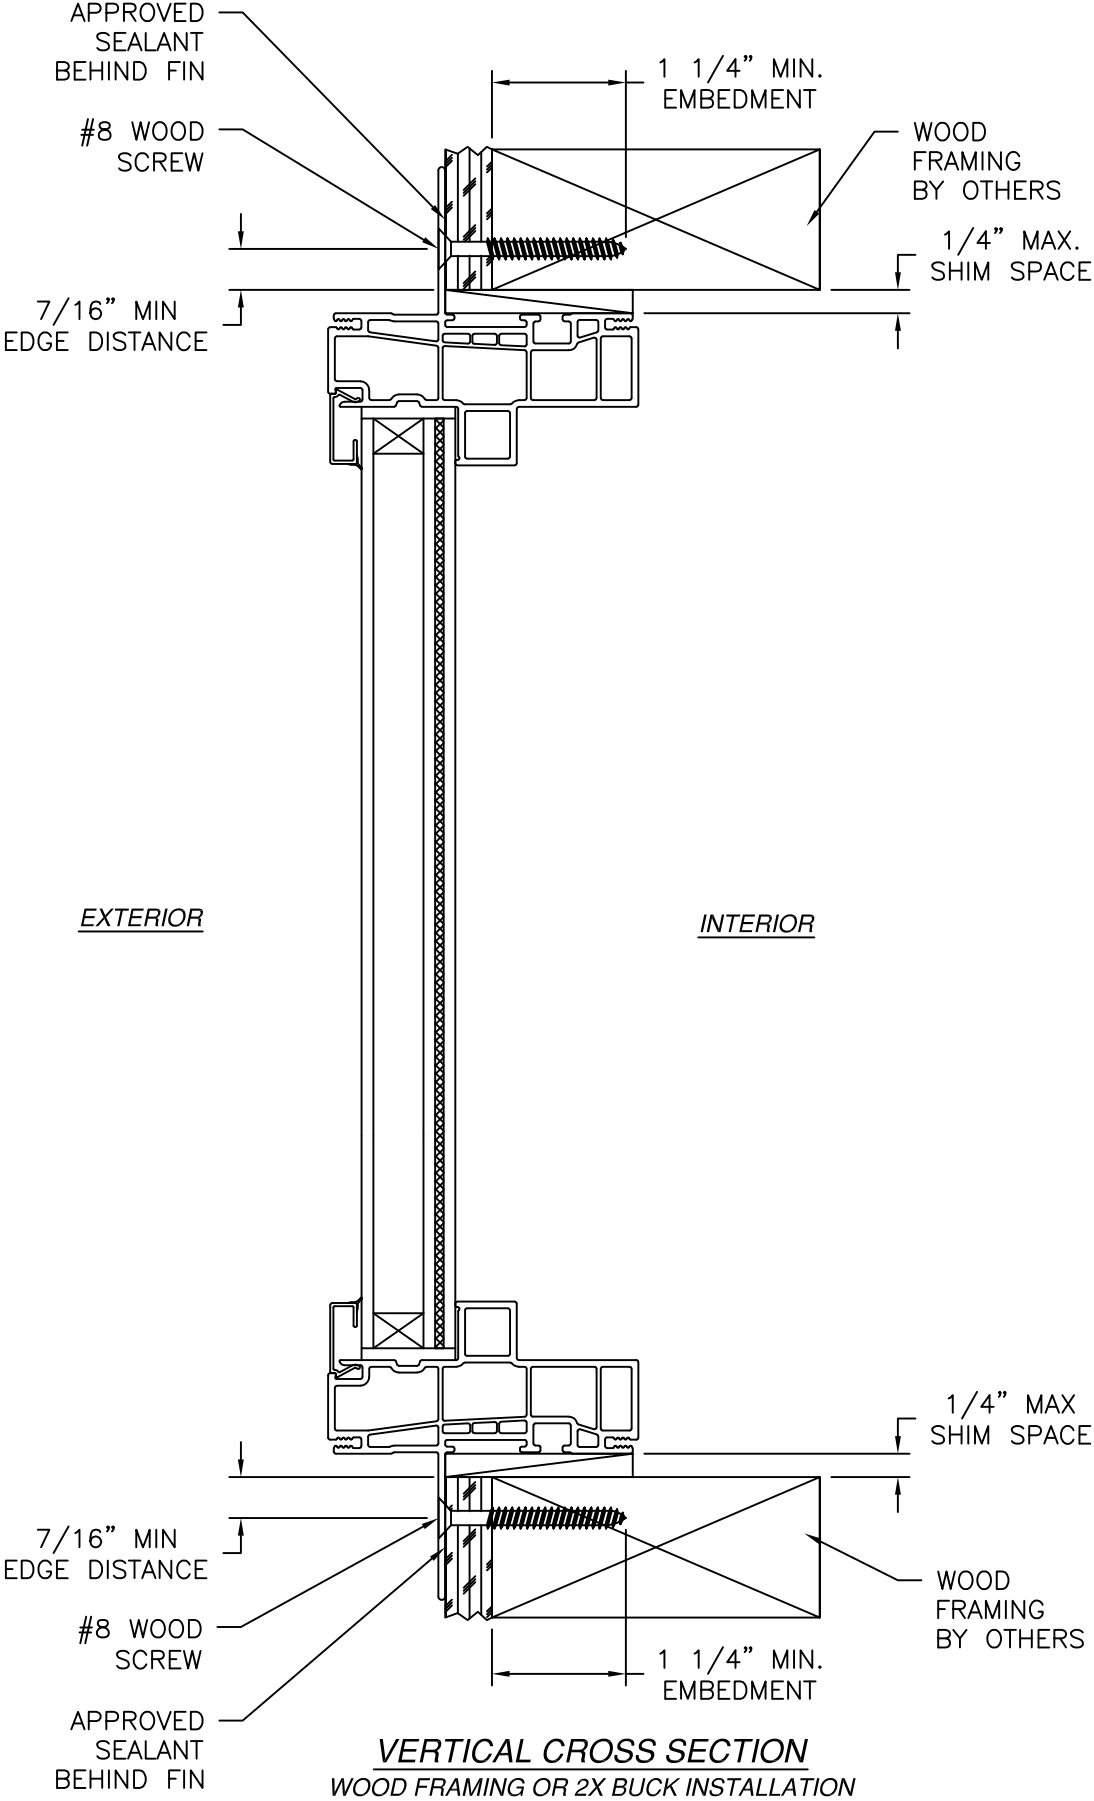

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/15/2026

NT WINDOW, INC.
2900 WEST SEMINARY DR.
FORT WORTH, TX 76133

G250 PVC FIXED WINDOW
IMPACT
FIN INSTALLATION DETAILS

DRAWN:
A.R.

DWG NO.
08-04151


REV
-

SCALE
NTS

DATE
05/01/2025



SHEET
13 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

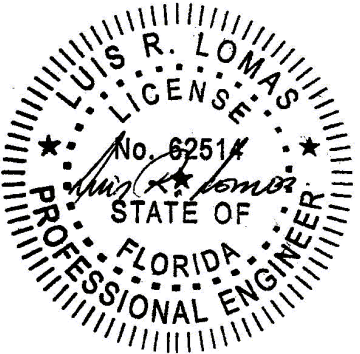

Luis R. Lomas P.E.
FL No.: 62514

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

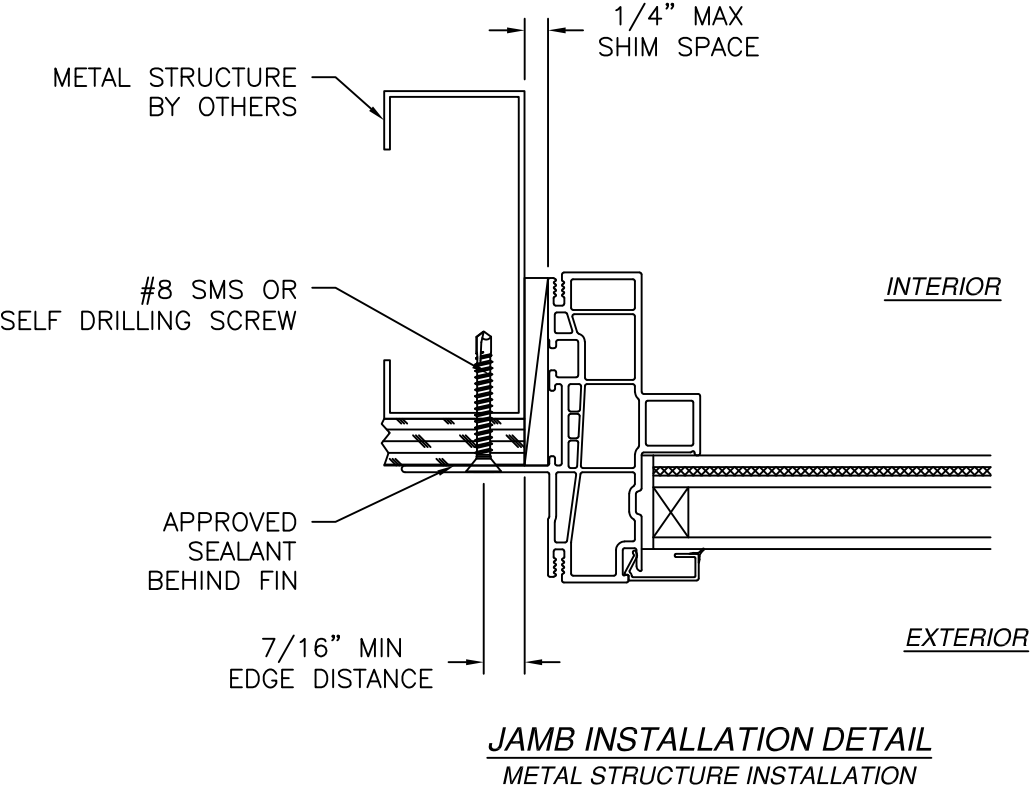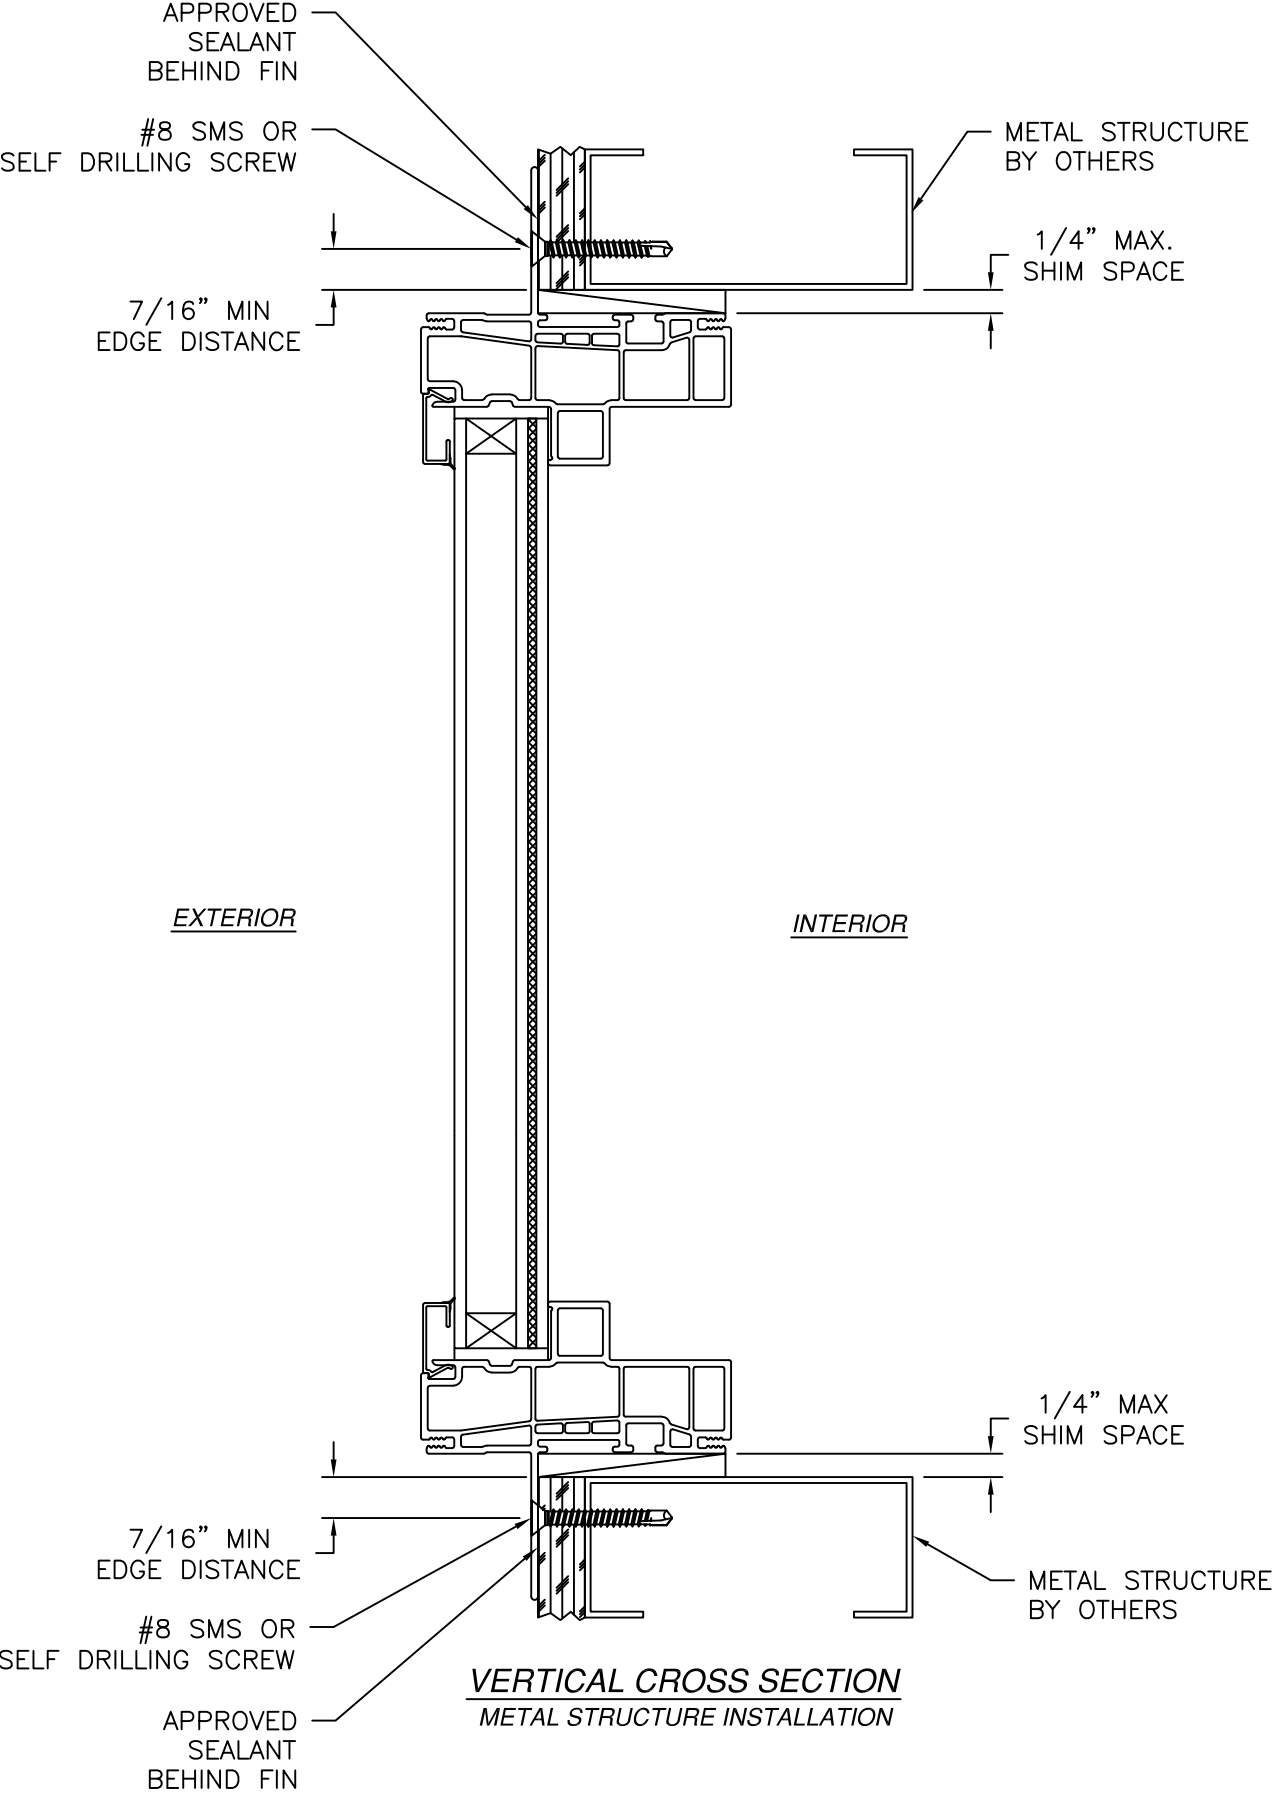

- NOTES:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
 2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

SIGNED: 07/15/2026

NT WINDOW, INC.
2900 WEST SEMINARY DR.
FORT WORTH, TX 76133

G250 PVC FIXED WINDOW
IMPACT
FIN INSTALLATION DETAILS

DRAWN:
A.R.

DWG NO.
08-04151


REV
-

SCALE NTS

DATE 05/01/2025


SHEET 14 OF 15

L. ROBERTO LOMAS P.E.
208 7th Ave, INDIALANTIC, FL 32903
434-688-0609 rllomas@lrlomaspe.com

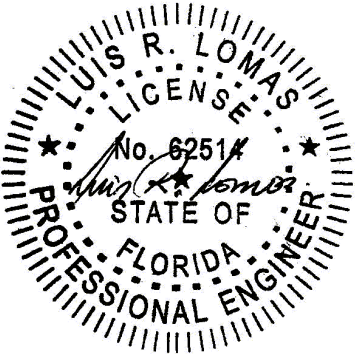


Luis R. Lomas P.E.
FL No.: 62514


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED

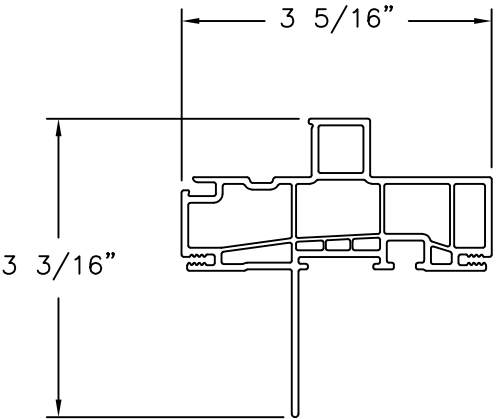


MAIN FRAME (1861AJ)
EXTRUDED PVC

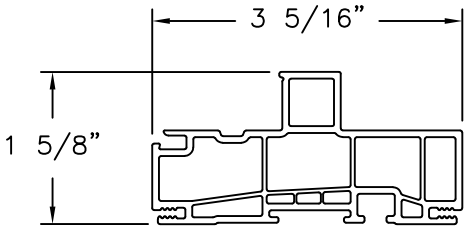


MAIN FRAME (1841A)
EXTRUDED PVC




GLAZING BEAD
EXTRUDED PVC



FLANGE
EXTRUDED PVC

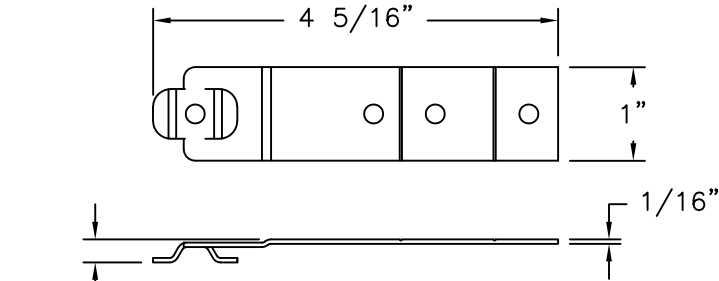


STRAP
18GA STEEL

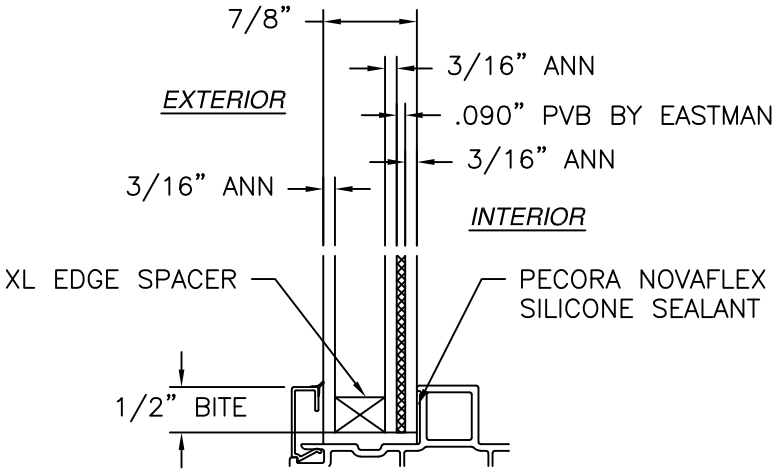

GLAZING DETAIL

SIGNED: 07/15/2026

NT WINDOW, INC. 2900 WEST SEMINARY DR. FORT WORTH, TX 76133		
G250 PVC FIXED WINDOW IMPACT COMPONENTS AND GLAZING BEAD		
DRAWN: A.R.	DWG NO. 08-04151	REV -
SCALE NTS	DATE 05/01/2025	SHEET 15 OF 15
L. ROBERTO LOMAS P.E. 208 7th Ave, INDIALANTIC, FL 32903 434-688-0609 rllomas@lrlomaspe.com		

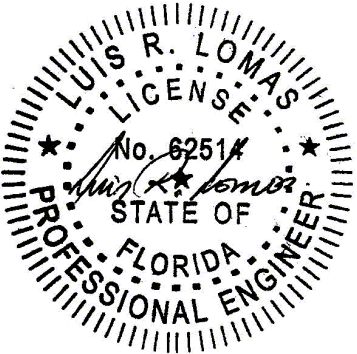

Luis R. Lomas P.E.
FL No.: 62514