

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION, UNLESS OTHERWISE SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH NOT TO EXCEED THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. **THROUGH FRAME:** FOR INSTALLATION INTO WOOD FRAMING USE #10 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6. **THROUGH FRAME:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE #10 GR. 5 SELF TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM PENETRATION OF 3 THREADS BEYOND METAL FRAME SUBSTRATE.
7. **THROUGH FRAME:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 3/16" DIAMETER ITW TAPCONS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4" MINIMUM EMBEDMENT.
8. CLIPS SHALL BE FASTENED TO THE WINDOW FRAME WITH (1) #8 X 3/4" SCREWS. CLIPS ARE 18 GAUGE (0.0478" THICKNESS) F'y=33 KSI MIN STEEL WITH OVERALL DIMENSIONS OF 1" WIDE, 4.327" ALONG THE LONG LEG, AND 0.246" ALONG THE SHORT LEG.
9. **CLIP ANCHOR:** FOR INSTALLATION INTO WOOD FRAMING USE (1) #10 WOOD SCREW PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
10. **CLIP ANCHOR:** FOR INSTALLATION INTO METAL STUD USE (1) #10 GR. 5 SELF-TAPPING SCREW PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM PENETRATION OF 3 THREADS BEYOND THE METAL STRUCTURE.
11. **CLIP ANCHOR:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE (1) 3/16" DIAMETER ITW TAPCON PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4" MINIMUM EMBEDMENT.
12. **NAIL FIN:** FOR INSTALLATION INTO WOOD FRAMING USE #8 WOOD SCREWS OR USE 2 1/2" ROOFING NAILS PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
13. **NAIL FIN:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE #8 GR. 5 SELF TAPPING SCREWS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM PENETRATION OF 3 THREADS BEYOND METAL FRAME SUBSTRATE.
14. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
15. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
16. FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.

INSTALLATION NOTES (CONTINUED):

17. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
18. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

C. GROUT- FILLED CMU-UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.

D. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.

E. ALUMINUM - MINIMUM ALLOY 6063-T5. MINIMUM WALL THICKNESS OF 1/8" (0.125").

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

AAMA/WDMA/CSA 101/I.S.2/A440-22
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT.
6. WINDOW FRAME MATERIAL: VINYL
REINFORCEMENT MATERIAL: ALUMINUM 6063-T6
7. GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 11 FOR GLAZING DETAIL.

WINDSOR WINDOWS & DOORS

NEXT DIMENSION SINGLE HUNG

TWIN/TRIPLE WINDOW

(NON-HVHZ)(NON-IMPACT)

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	TWIN ELEVATION & ANCHOR LAYOUTS
3	TWIN ELEVATION & ANCHOR LAYOUTS
4	TWIN ELEVATION & ANCHOR LAYOUTS
5	TRIPLE ELEVATION & ANCHOR LAYOUTS
6	TRIPLE ELEVATION & ANCHOR LAYOUTS
7	VERTICAL & HORIZONTAL SECTIONS - NAIL FIN
8	VERTICAL & HORIZONTAL SECTIONS - THROUGH FRAME
9	VERTICAL & HORIZONTAL SECTIONS - CLIP
10	MEETING RAIL & T-MULL DETAILS
11	GLAZING DETAIL & OPTIONAL FLUSH FINs

DESIGN PRESSURE TABLE						
TYP. OVERALL SIZE		DESIGN PRESSURE	REINFORCEMENT LOCATION	CONFIGURATION	INSTALLATION METHOD	MISSILE IMPACT RATING
WIDTH	HEIGHT					
107.5"	83.5"	+35/-35 PSF	MEETING RAIL, T-MULL, & SASH STILES	"O/X - O/X"	THROUGH FRAME, NAIL FIN & CLIP	NON-IMPACT
71.5"	71.5"	+50/-50 PSF	MEETING RAIL & T-MULL	"O/X - O/X"		
71.5"	83.5"	+50/-50 PSF	MEETING RAIL, T-MULL, & SASH STILES	"O/X - O/X"		
107.5"	71.5"	+50/-50 PSF	MEETING RAIL & T-MULL	"O/X - O/X - O/X"		
107.5"	83.5"	+50/-50 PSF	MEETING RAIL, T-MULL, & SASH STILES	"O/X - O/X - O/X"		



WINDSOR WINDOWS & DOORS

900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE:
NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)
INSTALLATION & GENERAL NOTES


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.21 16:18:21 -0400'

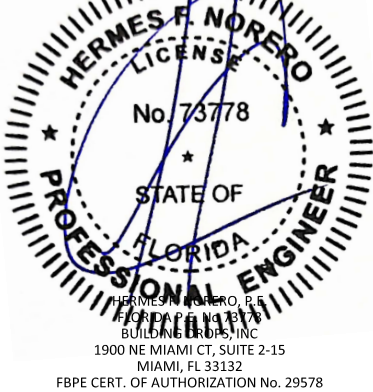

FL47167

DATE: 05.20.24

DWG. BY: RN
CHK. BY: HFN

SCALE: NTS

DWG. #: WWD078

SHEET: 1
REV. A

OF 11

TITLE:
NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)
TWIN ELEVATION & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL47167

DATE: **05.20.24**

DWG. BY: RN	CHK. BY: HFN
-----------------------	------------------------


SCALE: **NTS**

DWG. #: **WWD078**

SHEET:	REV. A
--------	------------------


2

OF 11

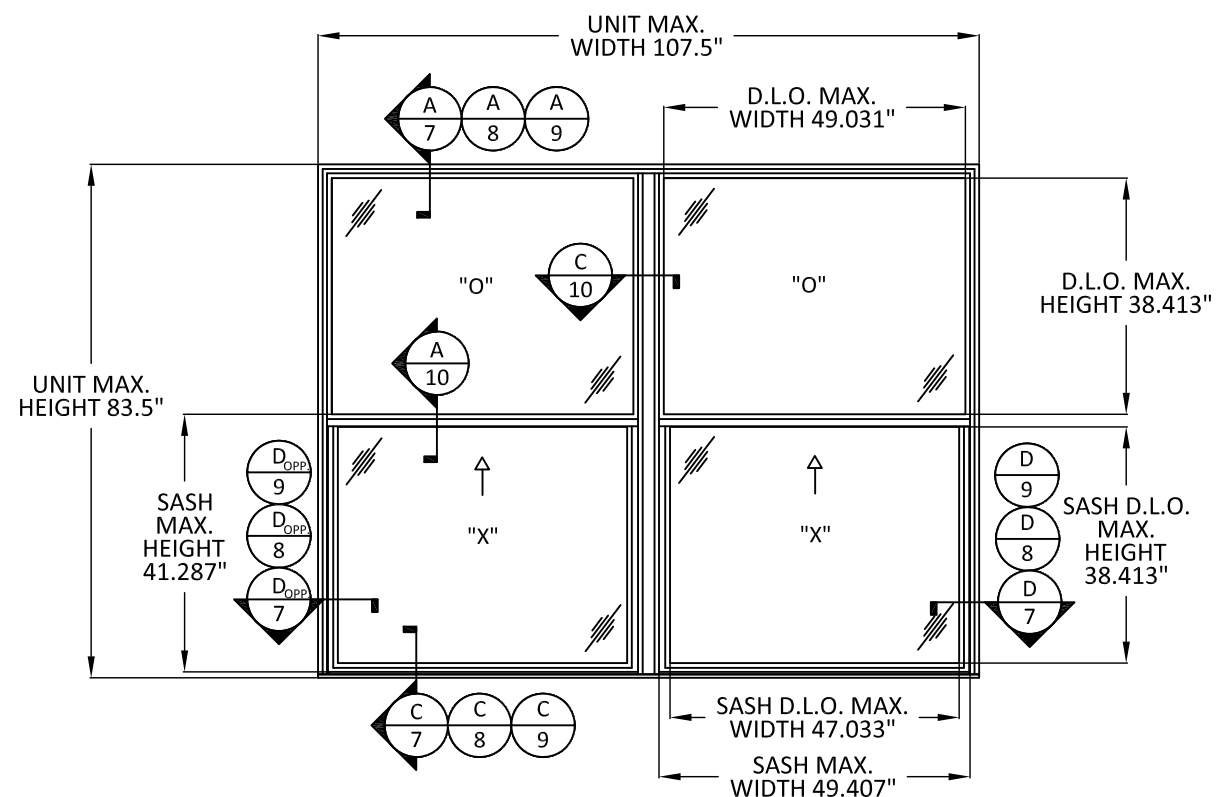


TYPICAL ELEVATION

SINGLE HUNG TWIN

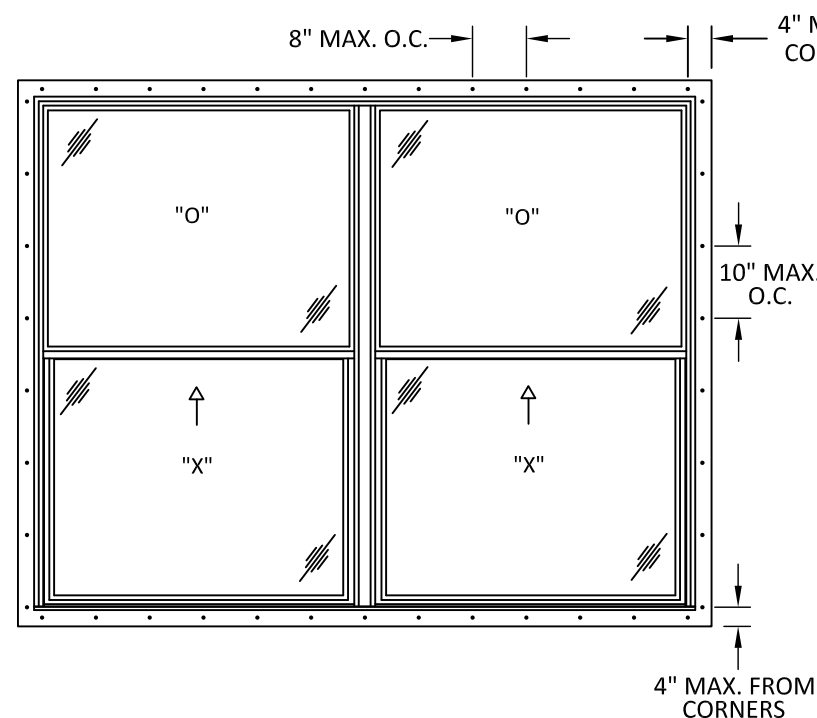


ANCHOR LAYOUT

NAIL FIN INSTALLATION

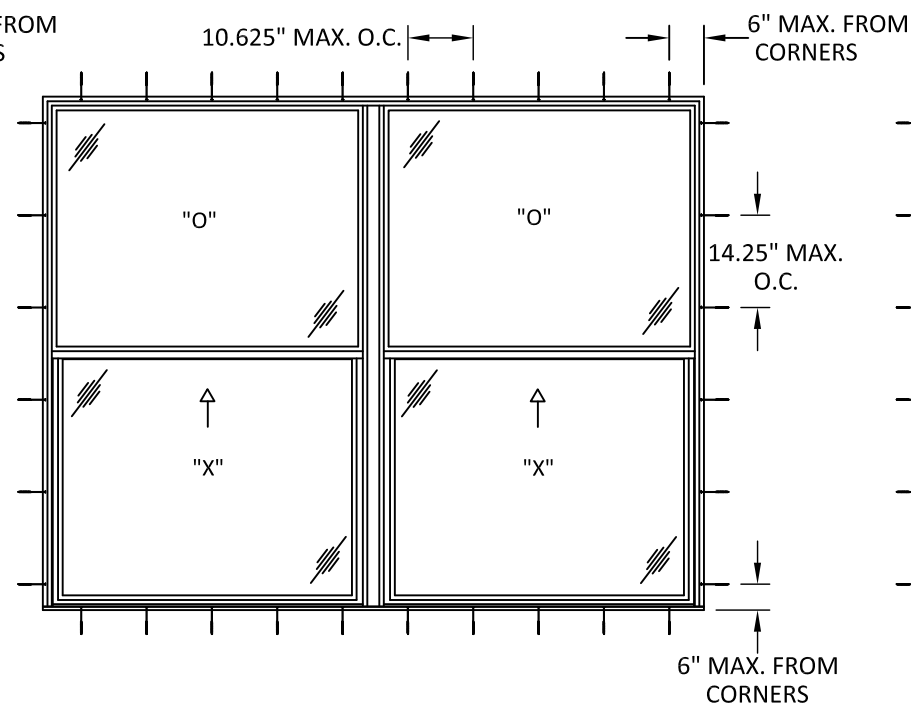


ANCHOR LAYOUT

THROUGH FRAME INSTALLATION

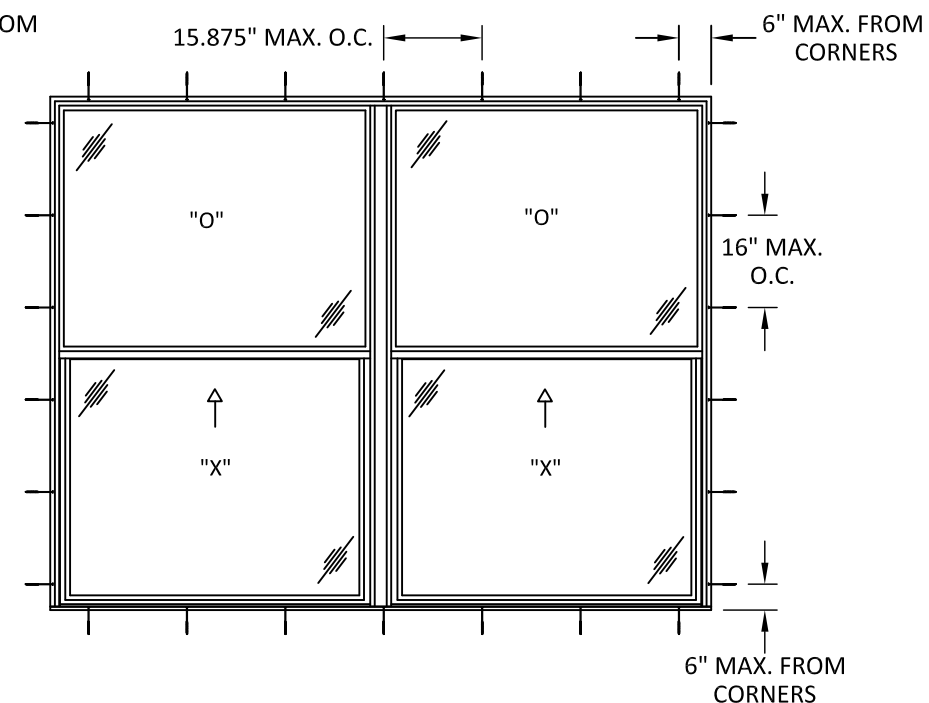


ANCHOR LAYOUT


CLIP INSTALLATION

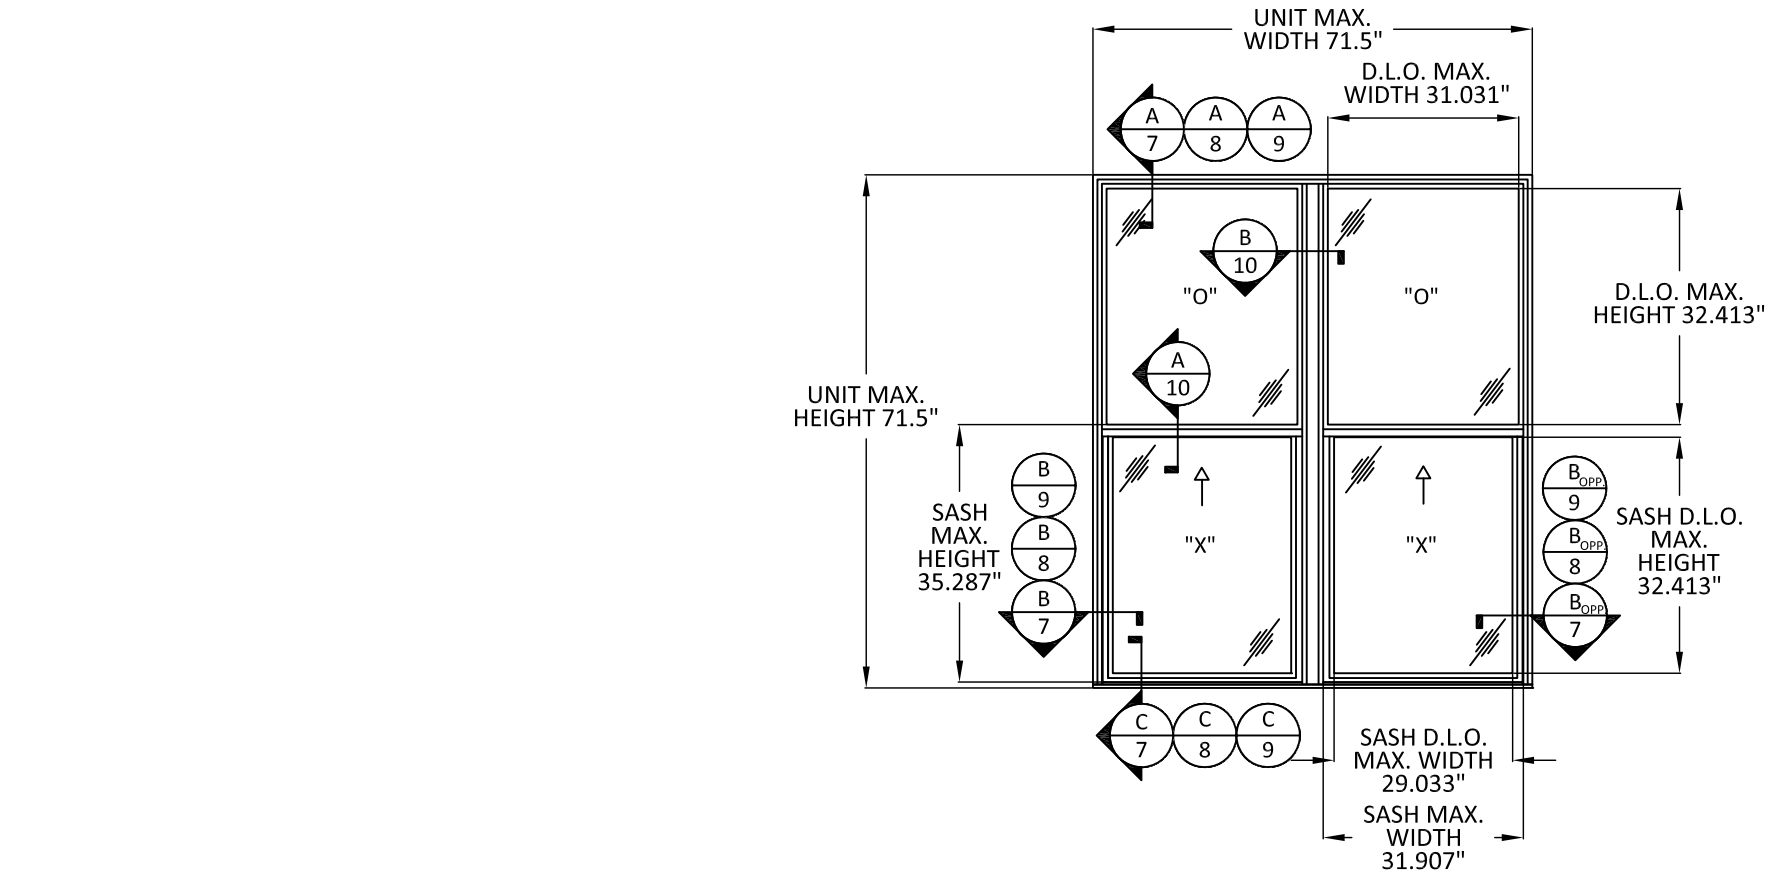


TYPICAL ELEVATION
SINGLE HUNG TWIN

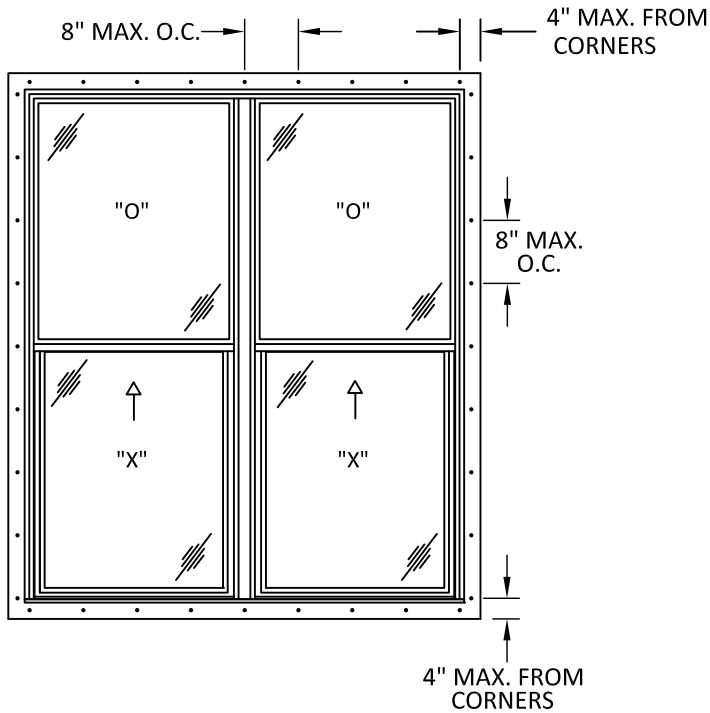

ANCHOR LAYOUT
NAIL FIN INSTALLATION

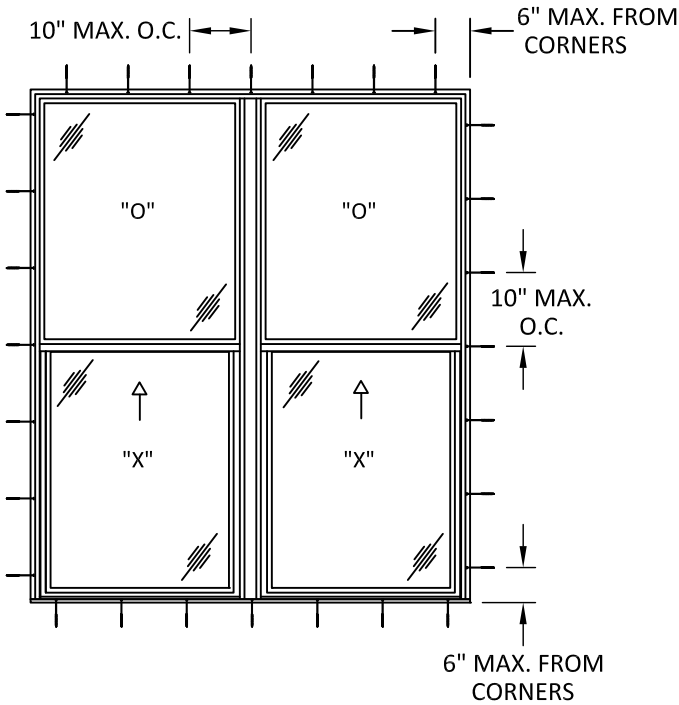

ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

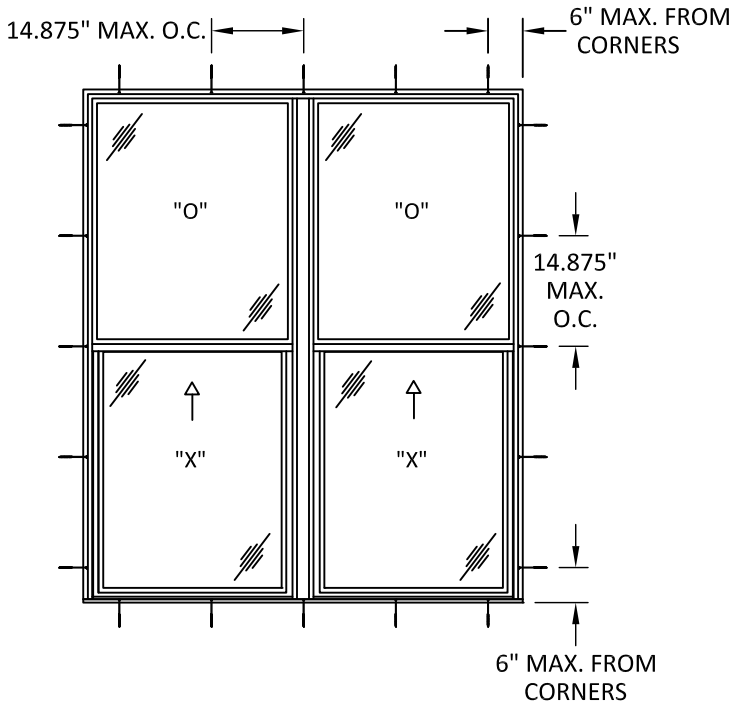

ANCHOR LAYOUT
CLIP INSTALLATION



**WINDSOR WINDOWS
& DOORS**

900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938


TITLE:
NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)
TWIN ELEVATION & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

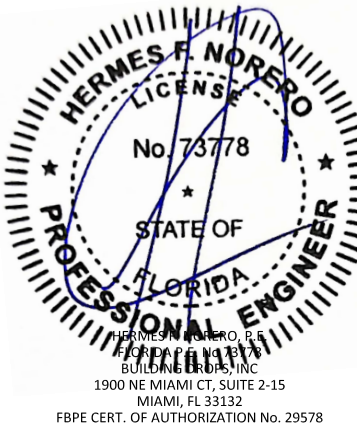

FL47167

DATE: **05.20.24**

DWG. BY:
RN

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **WWD078**

SHEET:

REV.

3

A

OF 11

**WINDSOR WINDOWS
& DOORS**

900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE:
NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)

TWIN ELEVATION & ANCHOR LAYOUTS

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

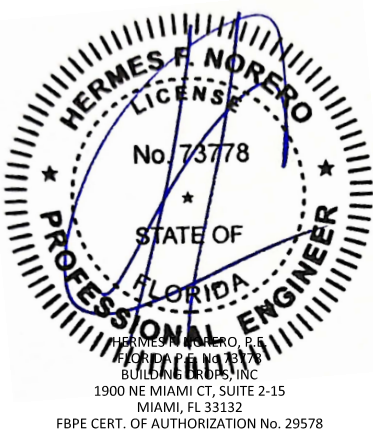

FL47167

DATE: **05.20.24**

DWG. BY:
RN

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **WWD078**


SHEET:

REV.

4


A

OF 11

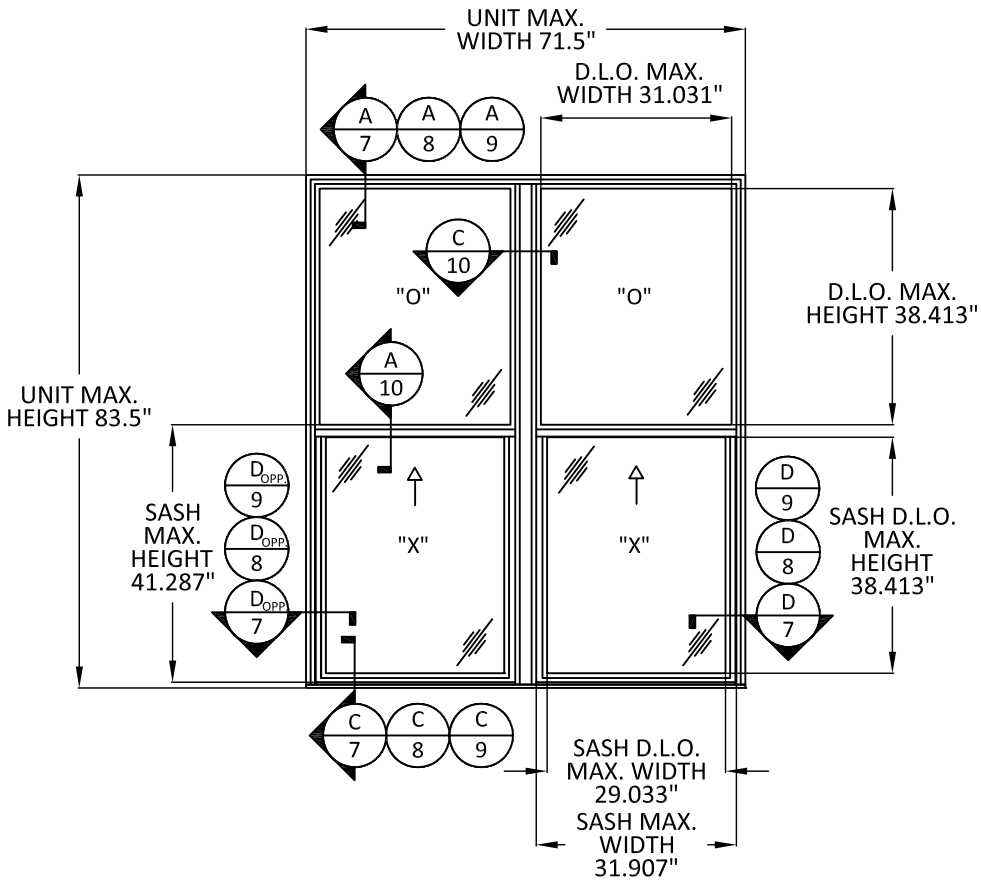


TYPICAL ELEVATION

SINGLE HUNG TWIN

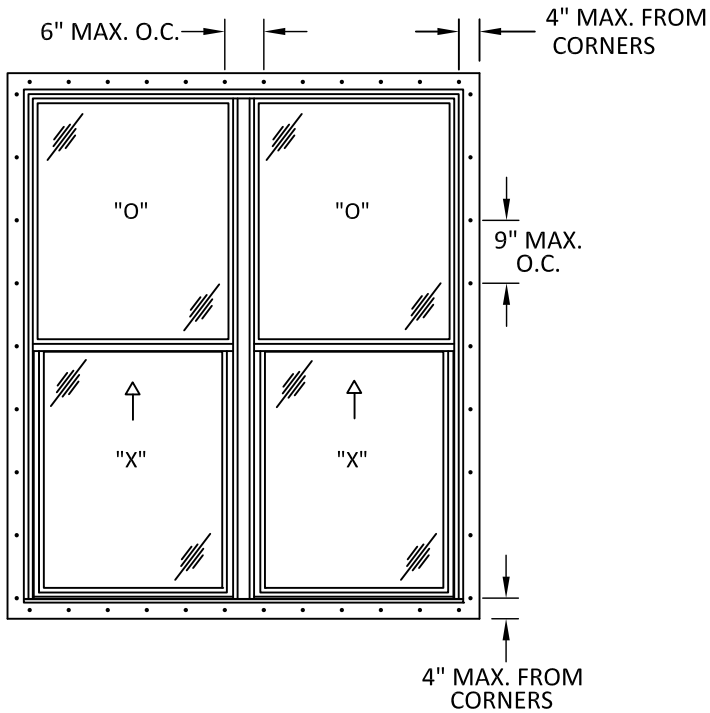


ANCHOR LAYOUT

NAIL FIN INSTALLATION

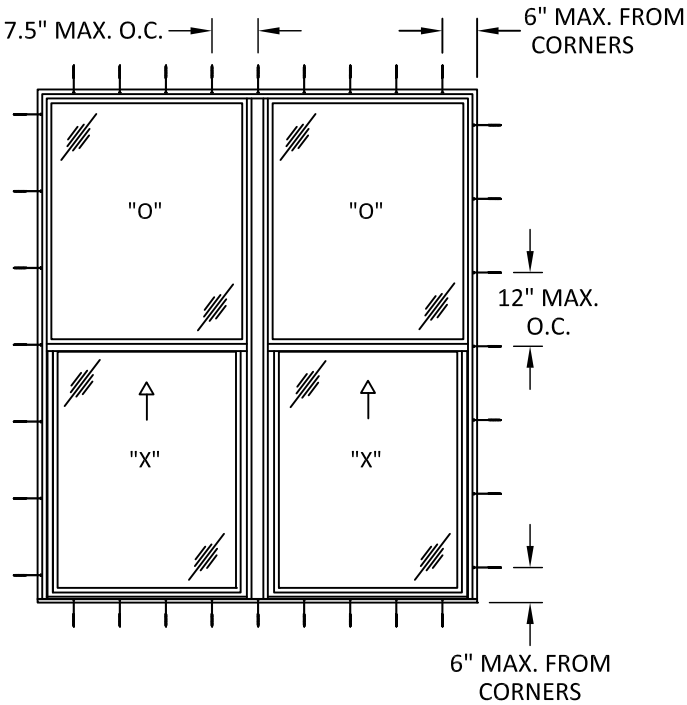

ANCHOR LAYOUT

THROUGH FRAME INSTALLATION

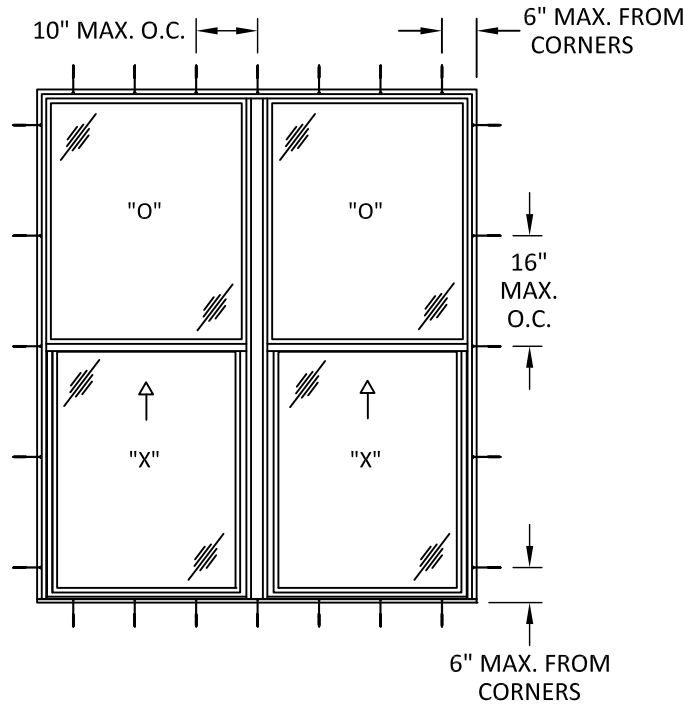


ANCHOR LAYOUT

CLIP INSTALLATION


TITLE:
NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)
TRIPLE ELEVATION & ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com


BD
BUILDING DROPS

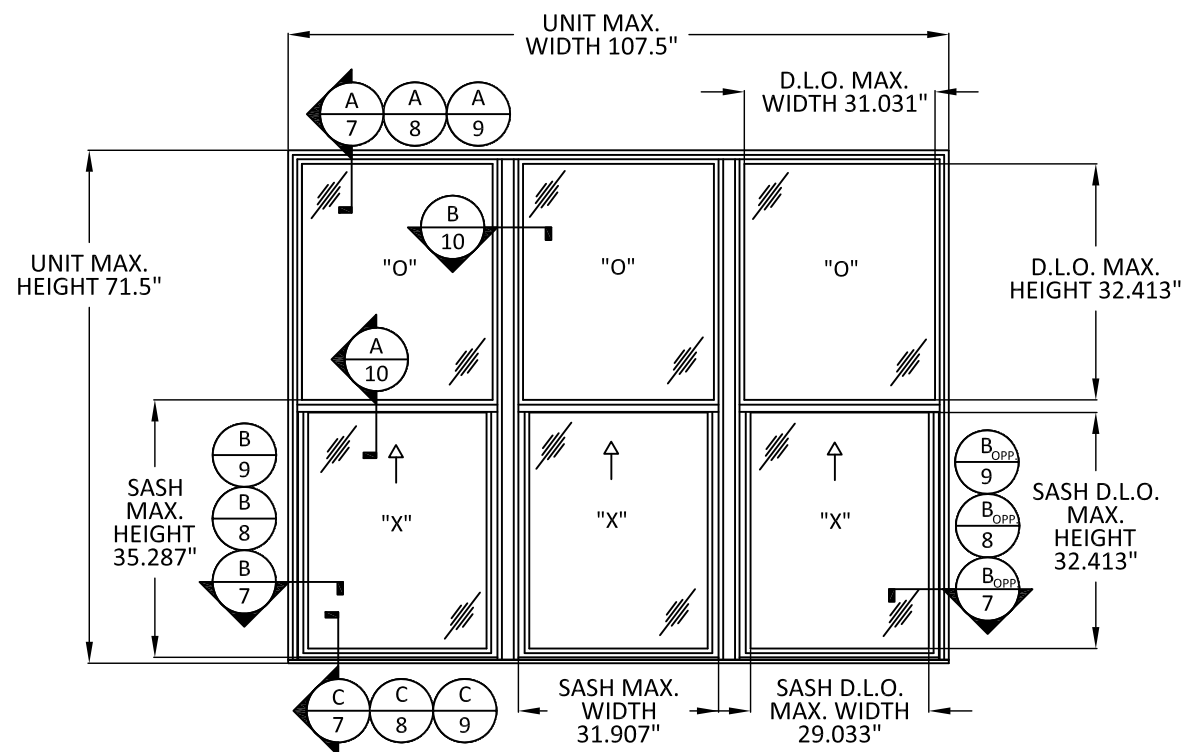


TYPICAL ELEVATION
SINGLE HUNG TRIPLE

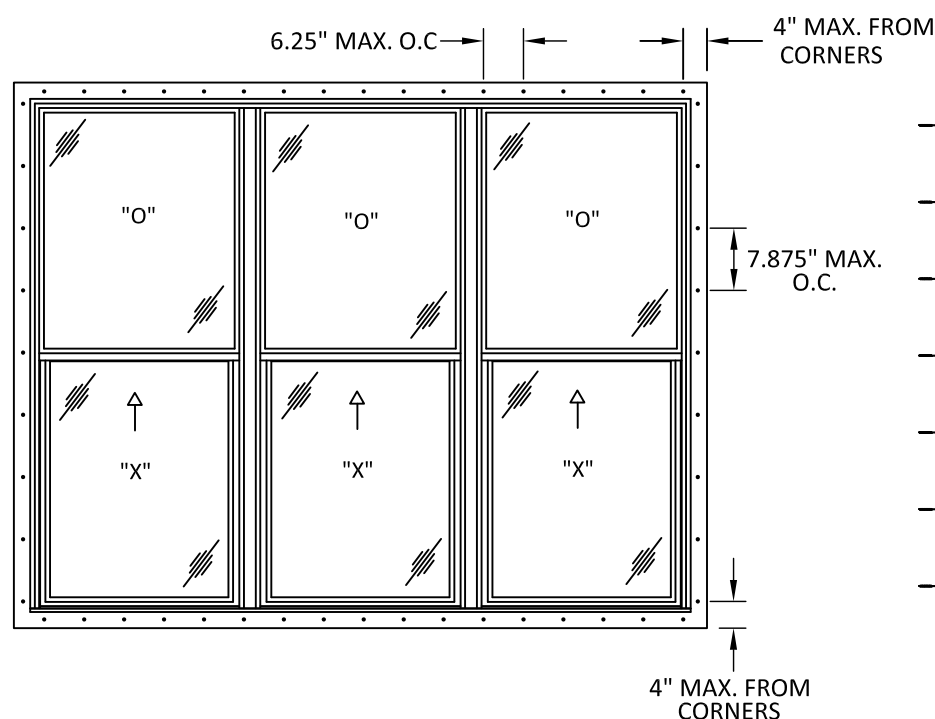

ANCHOR LAYOUT
NAILFIN INSTALLATION

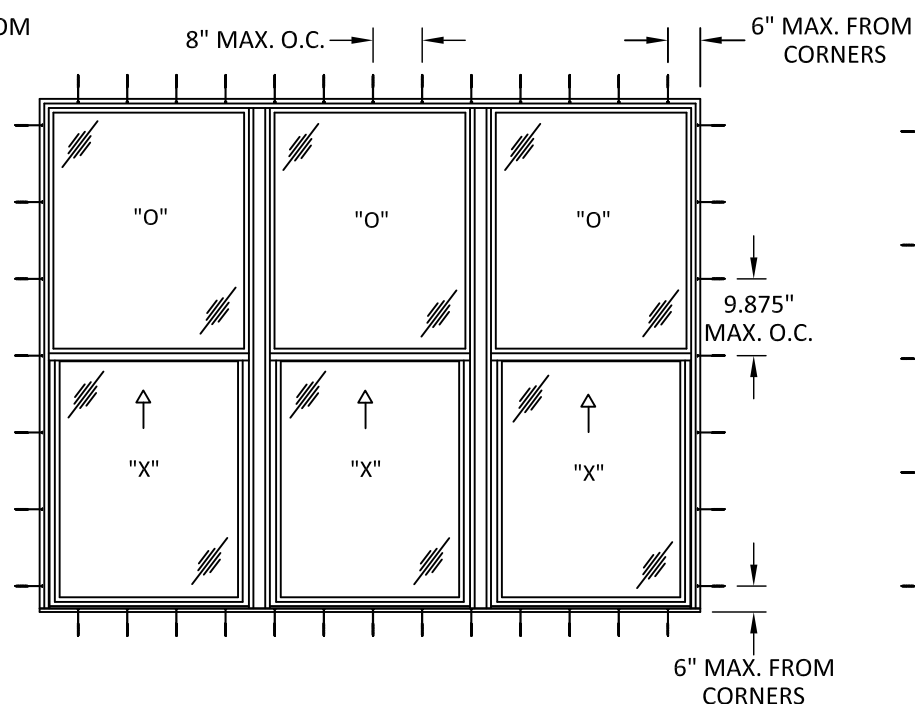


ANCHOR LAYOUT
THROUGH FRAME INSTALLATION

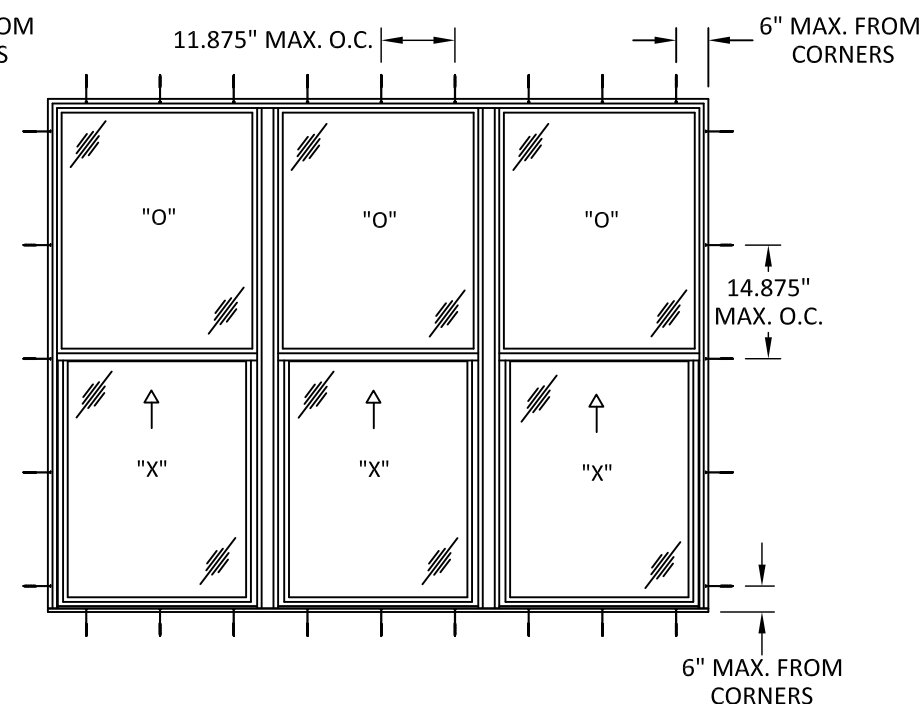

ANCHOR LAYOUT
CLIP INSTALLATION

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

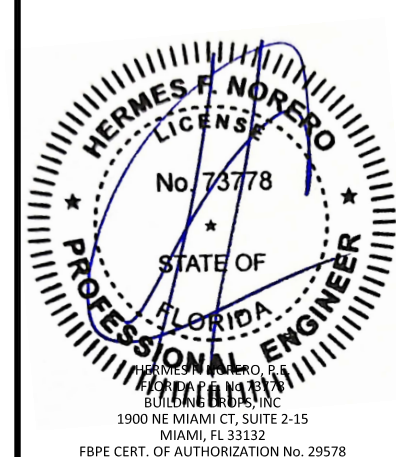

FL47167

DATE: **05.20.24**

DWG. BY: **RN** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WWD078**

SHEET: **5** REV. **A**

OF 11



WINDSOR WINDOWS
& DOORS

900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE:
NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)

TRIPLE ELEVATION & ANCHOR LAYOUTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132


PH: (954)399-8478
FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

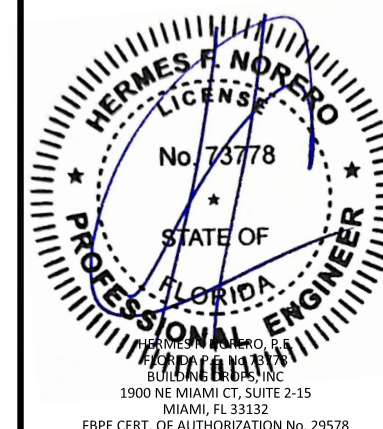

FL47167

DATE: 05.20.24

DWG. BY:
RN

CHK. BY:
HFN

SCALE: NTS

DWG. #: WWD078


SHEET:

REV.

A


6

OF 11

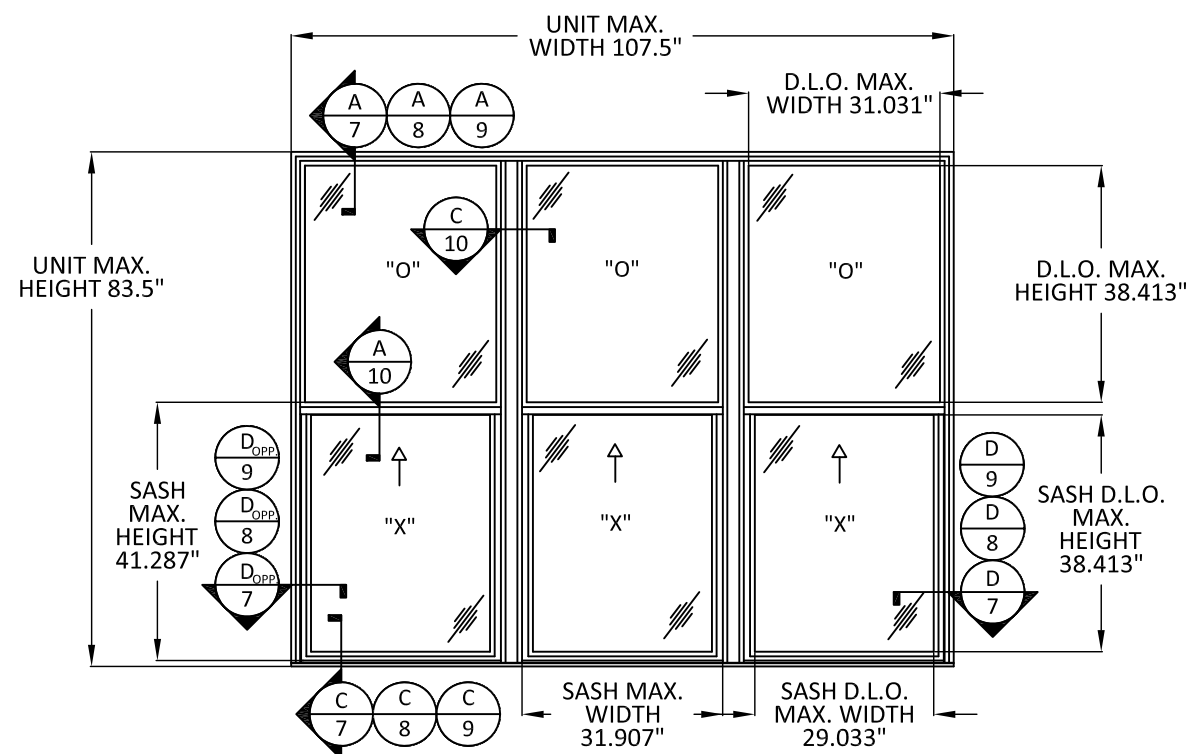


TYPICAL ELEVATION

SINGLE HUNG TRIPLE

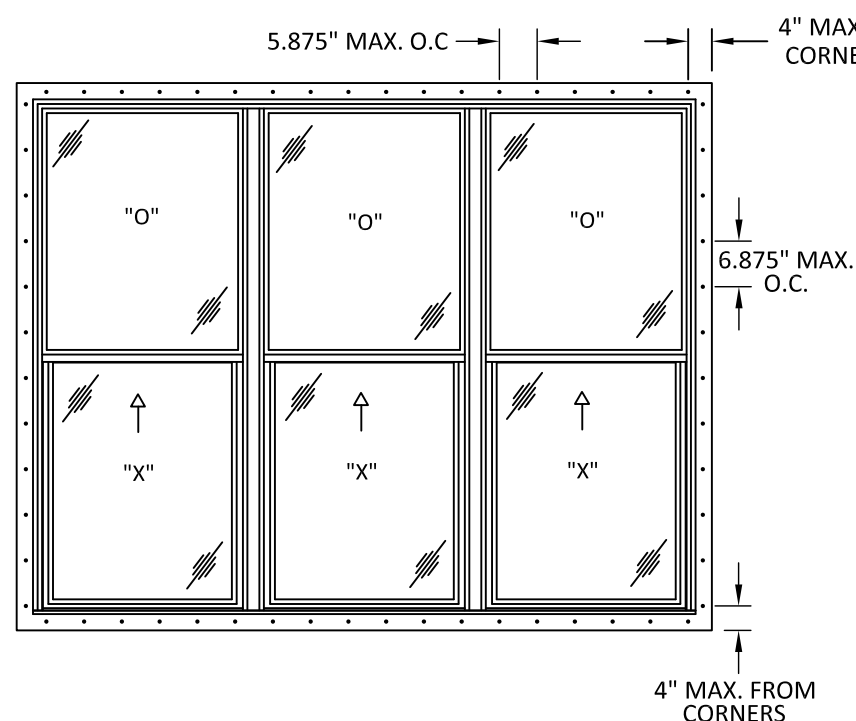


ANCHOR LAYOUT

NAILFIN INSTALLATION

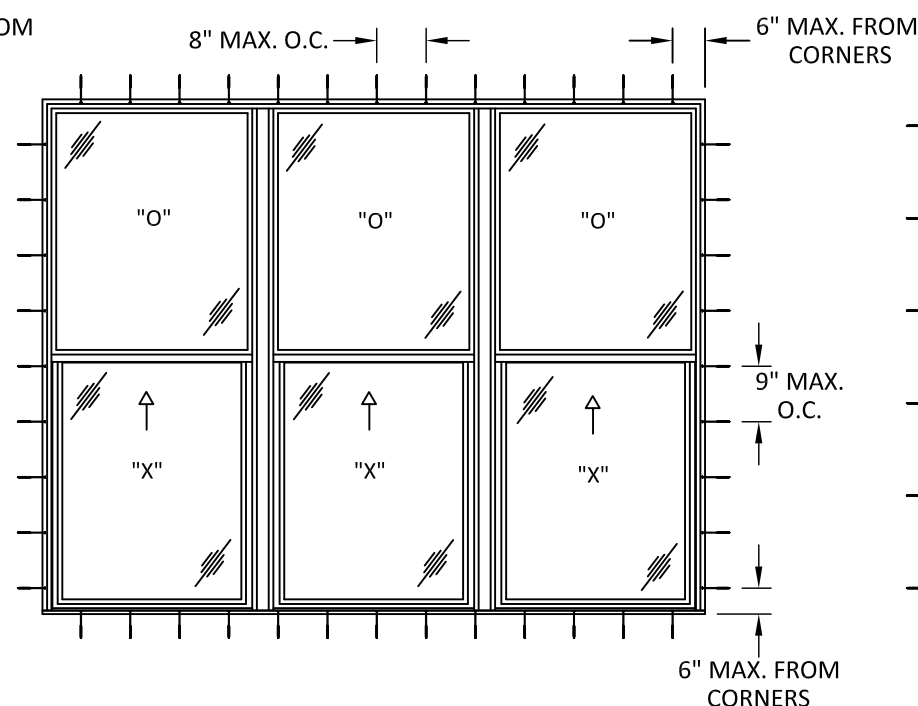

ANCHOR LAYOUT

THROUGH FRAME INSTALLATION

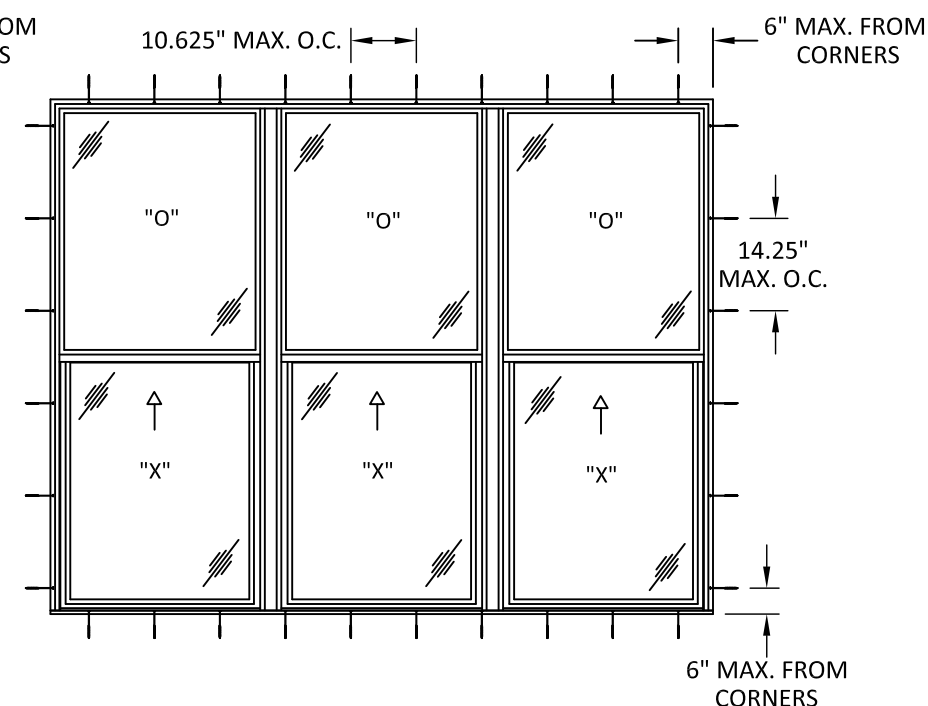

ANCHOR LAYOUT

CLIP INSTALLATION


TITLE: NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)
VERTICAL & HORIZONTAL
SECTIONS - NAIL FIN

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BD
BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

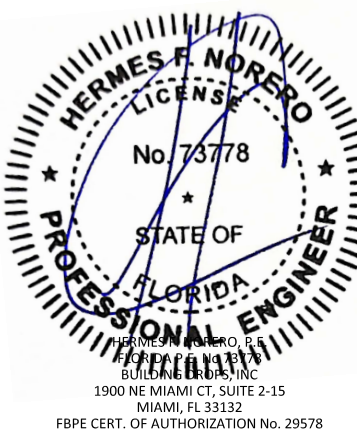

FL47167

DATE: **05.20.24**


DWG. BY: **RN** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **WWD078**

SHEET: **7** REV. **A**


OF 11

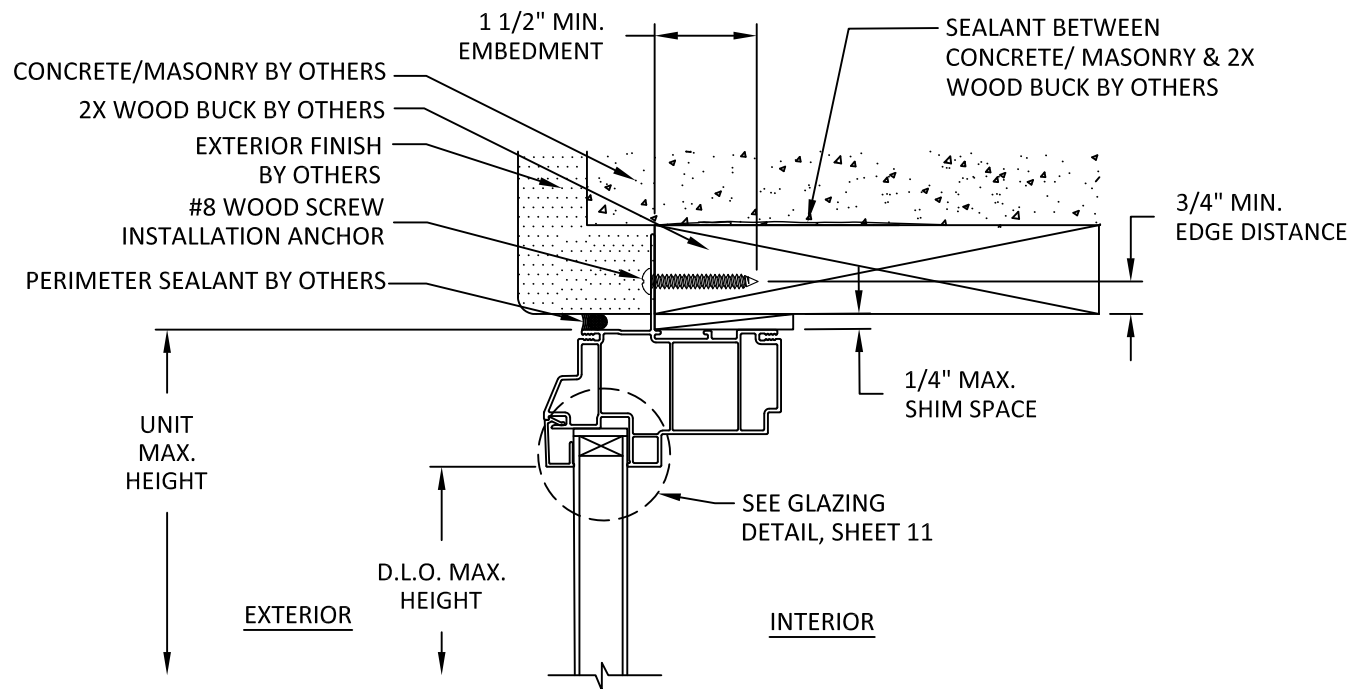


A
7 **VERTICAL SECTION**
NAIL FIN INSTALLATION
WOOD BUCK

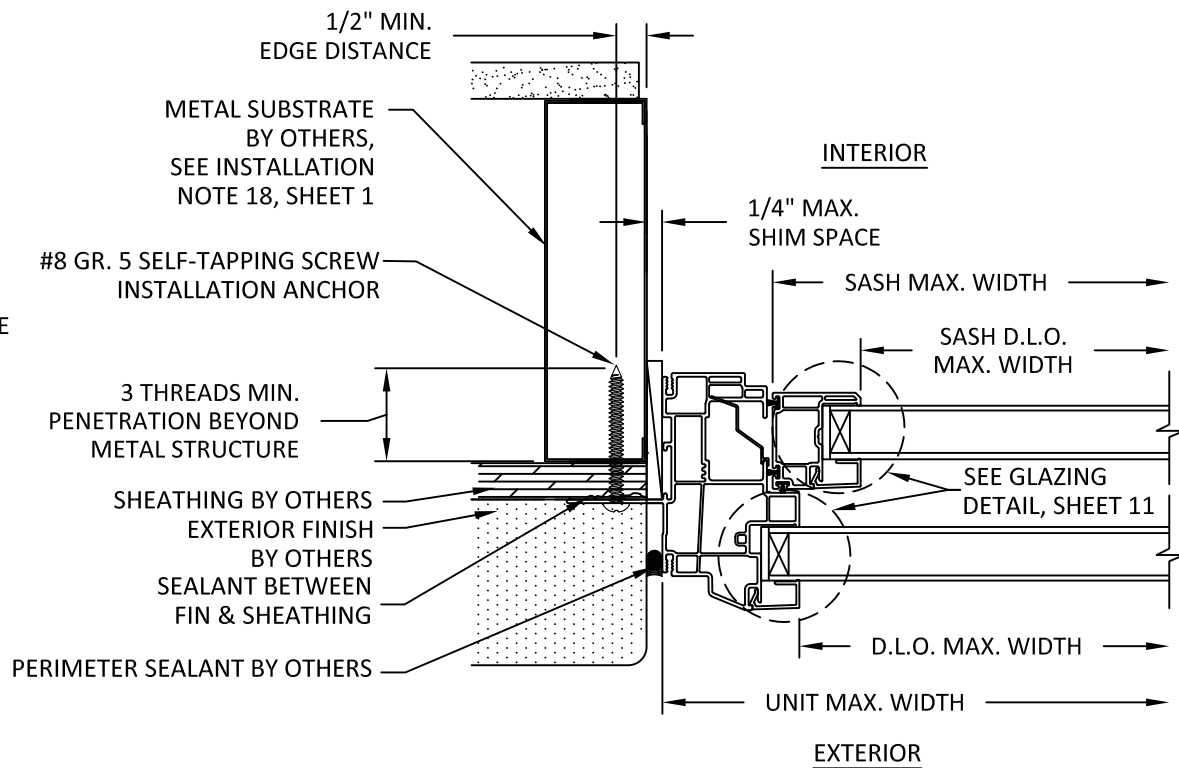

B
7 **HORIZONTAL SECTION**
NAIL FIN INSTALLATION
METAL STUD

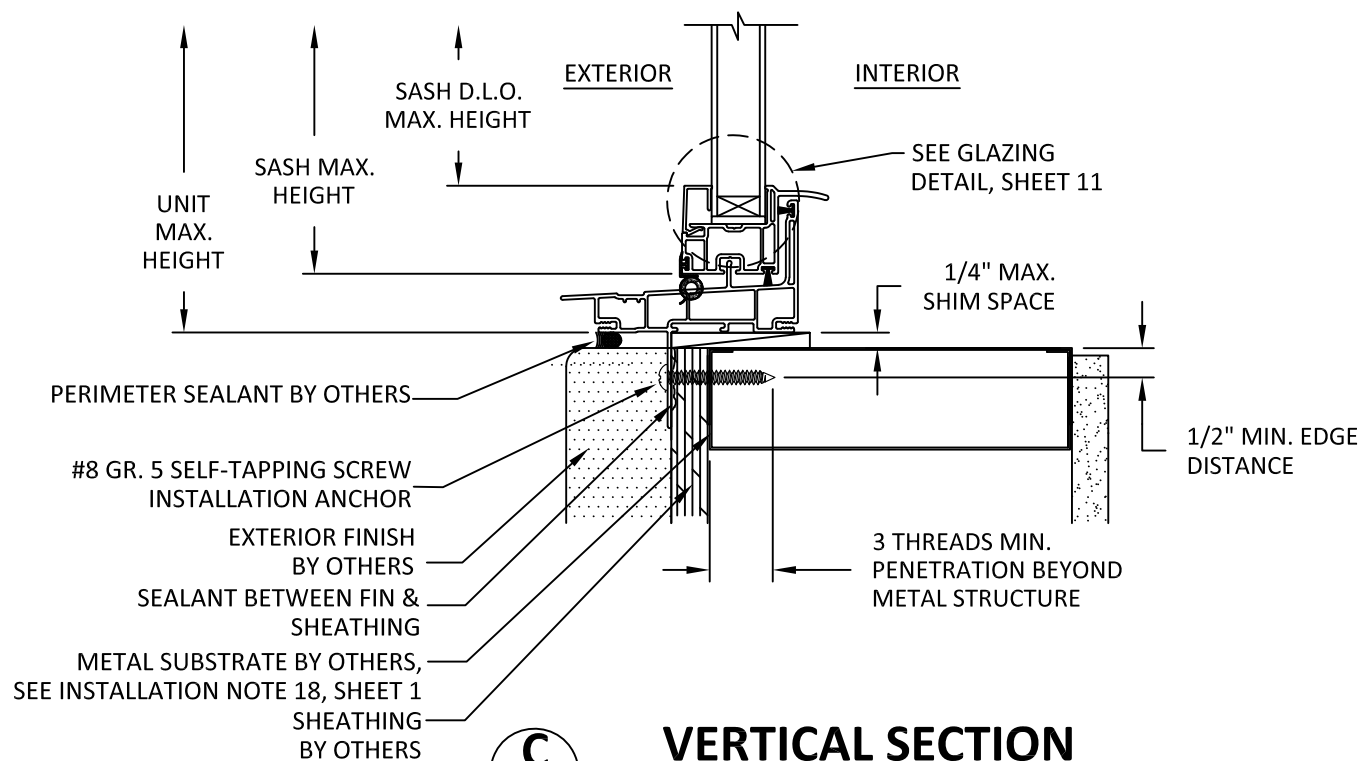

C
7 **VERTICAL SECTION**
NAIL FIN INSTALLATION
METAL STUD

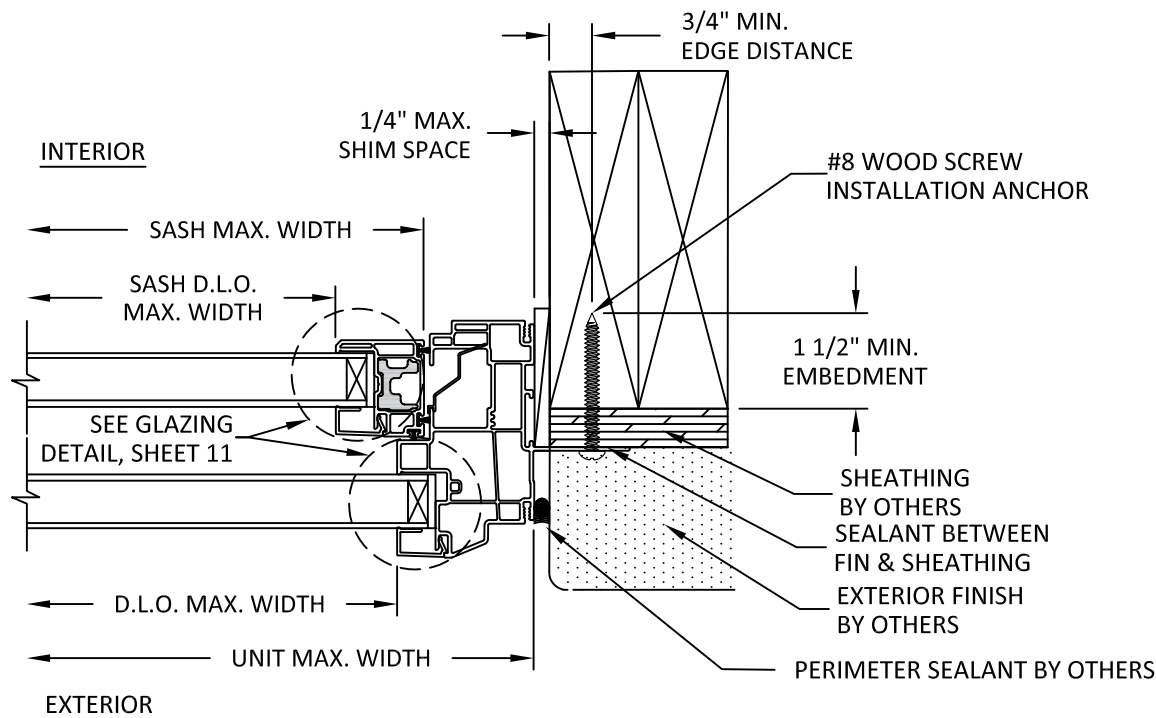


D
7 **HORIZONTAL SECTION**
NAIL FIN INSTALLATION
WOOD BUCK

TITLE:	NEXT DIMENSION SINGLE HUNG TWIN/TRIPLE WINDOW (NON-HVHZ)(NON-IMPACT) VERTICAL & HORIZONTAL SECTIONS - THROUGH FRAME	
	PREPARED BY: BUILDING DROPS, INC. 1900 NE MIAMI CT, SUITE 2-15 MIAMI, FL 33132 PH: (954)399-8478 FAX: (954)744-4738 WEB: www.buildingdrops.com	

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

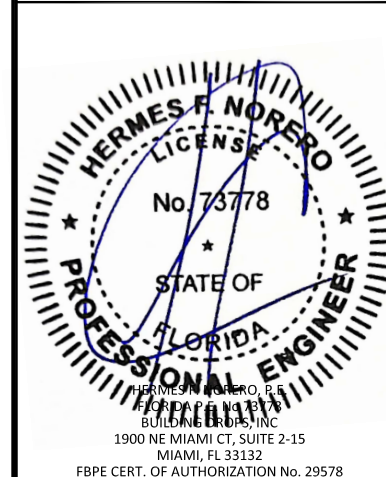
FL47167

 DATE: **05.20.24**


DWG. BY:	CHK. BY:
RN	HFN

 SCALE: **NTS**


 DWG. #: **WWD078**

SHEET:	REV.
8	A

OF 11

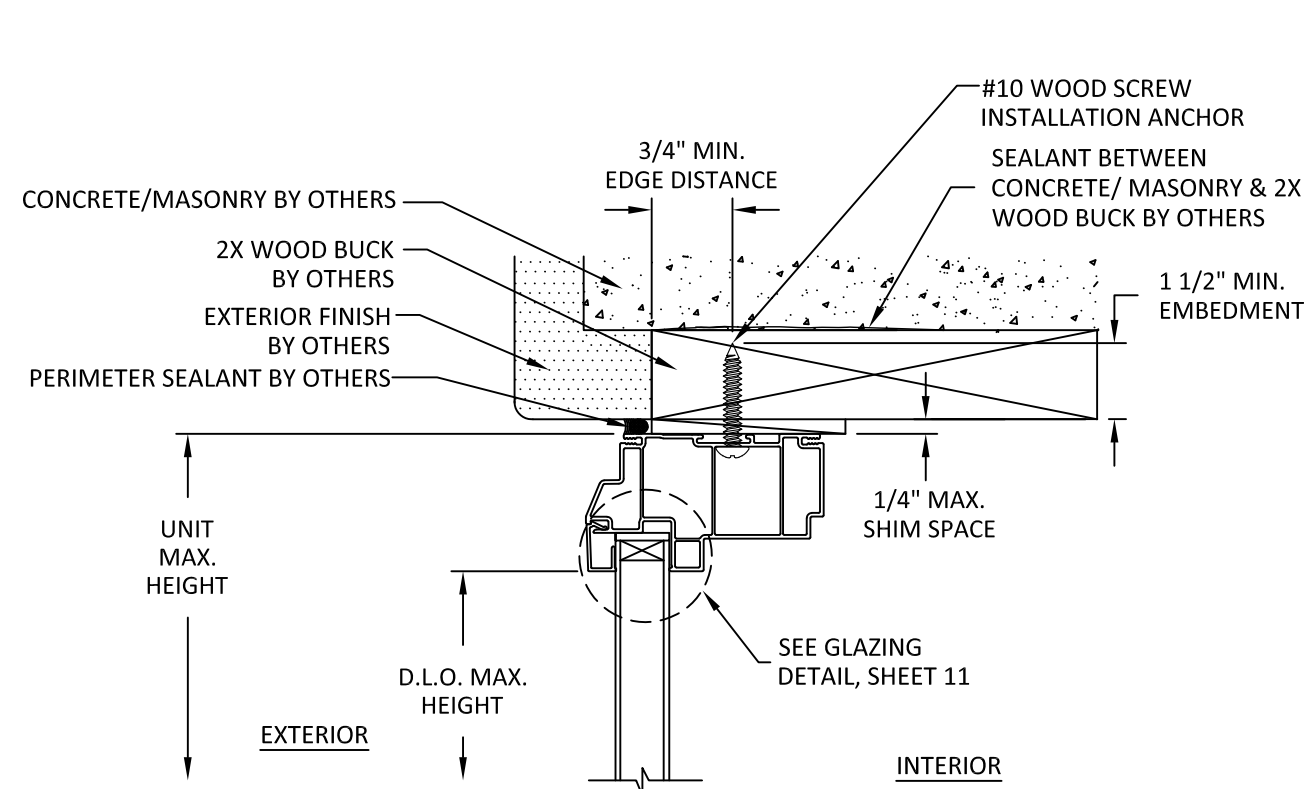


A
8 **VERTICAL SECTION**
THROUGH FRAME INSTALLATION
WOOD BUCK

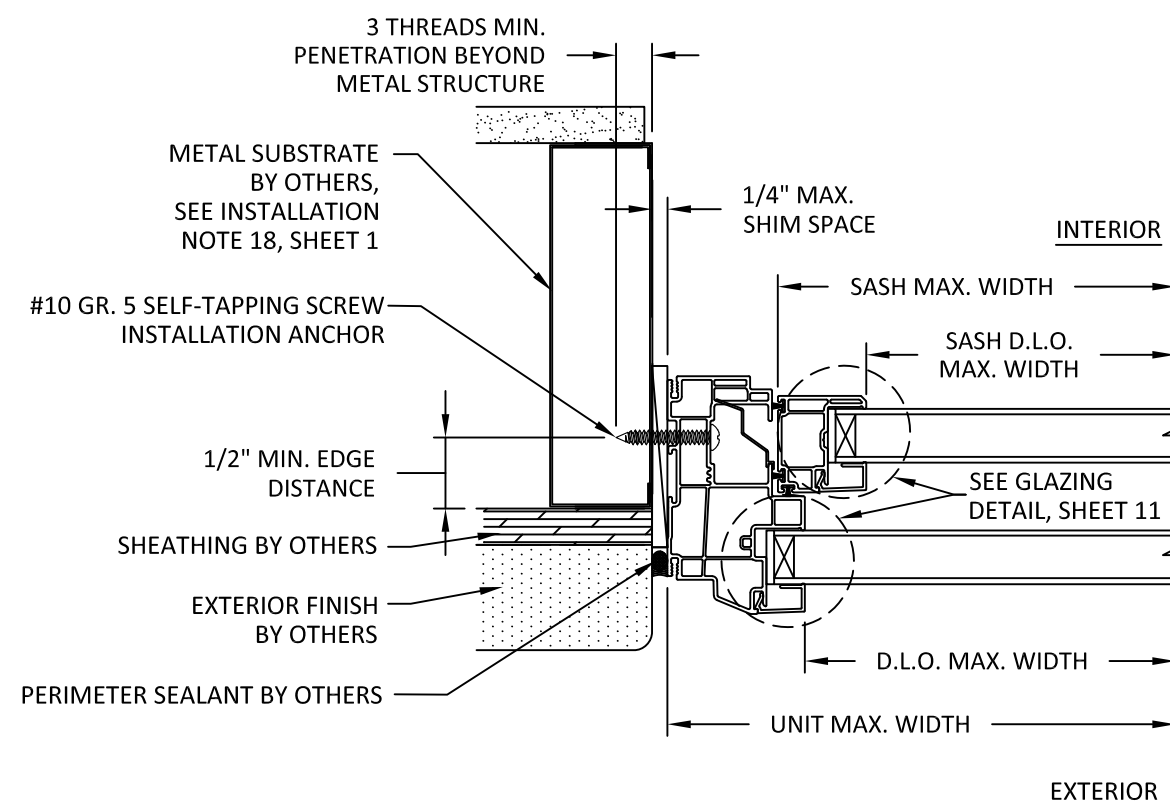


B
8 **HORIZONTAL SECTION**
THROUGH FRAME INSTALLATION
METAL STUD


SEE SHEET 11 FOR OPTIONAL
FLUSH NAIL FINIS AND
INSTALLATION REQUIREMENTS

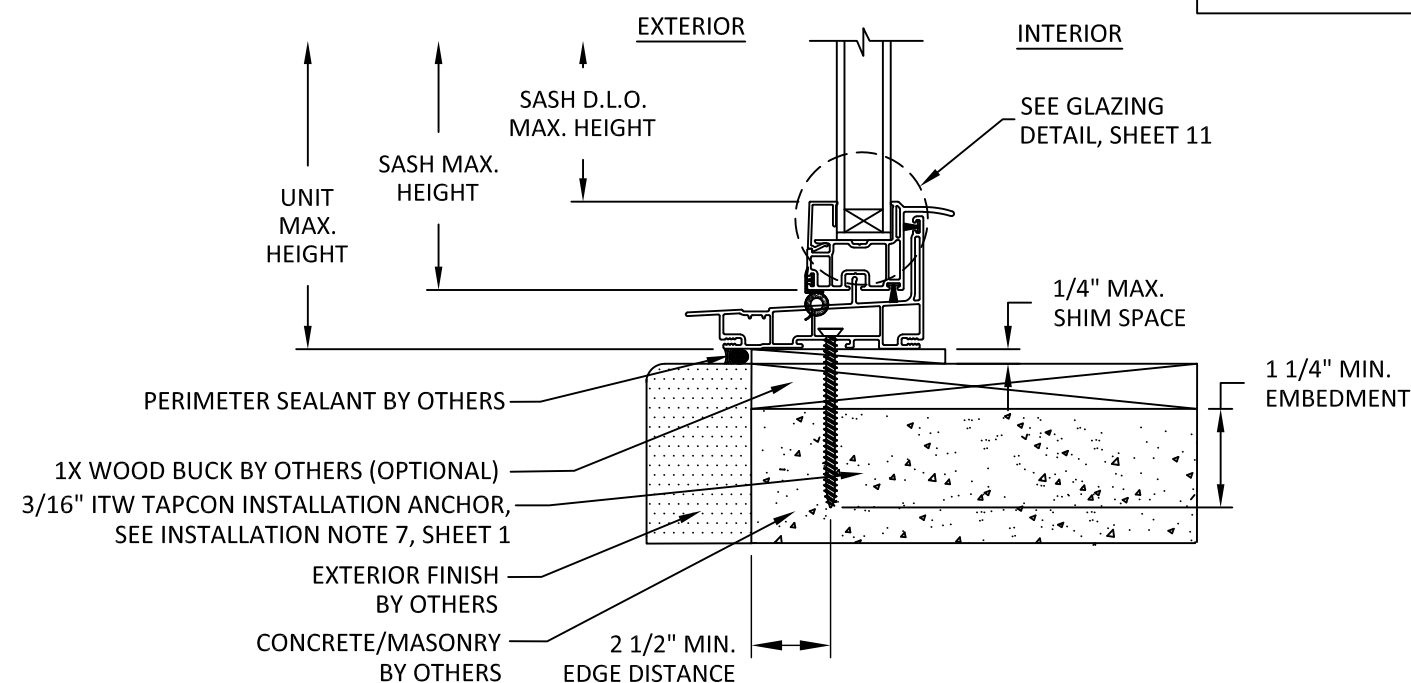

C
8 **VERTICAL SECTION**
THROUGH FRAME INSTALLATION
CONCRETE/CMU

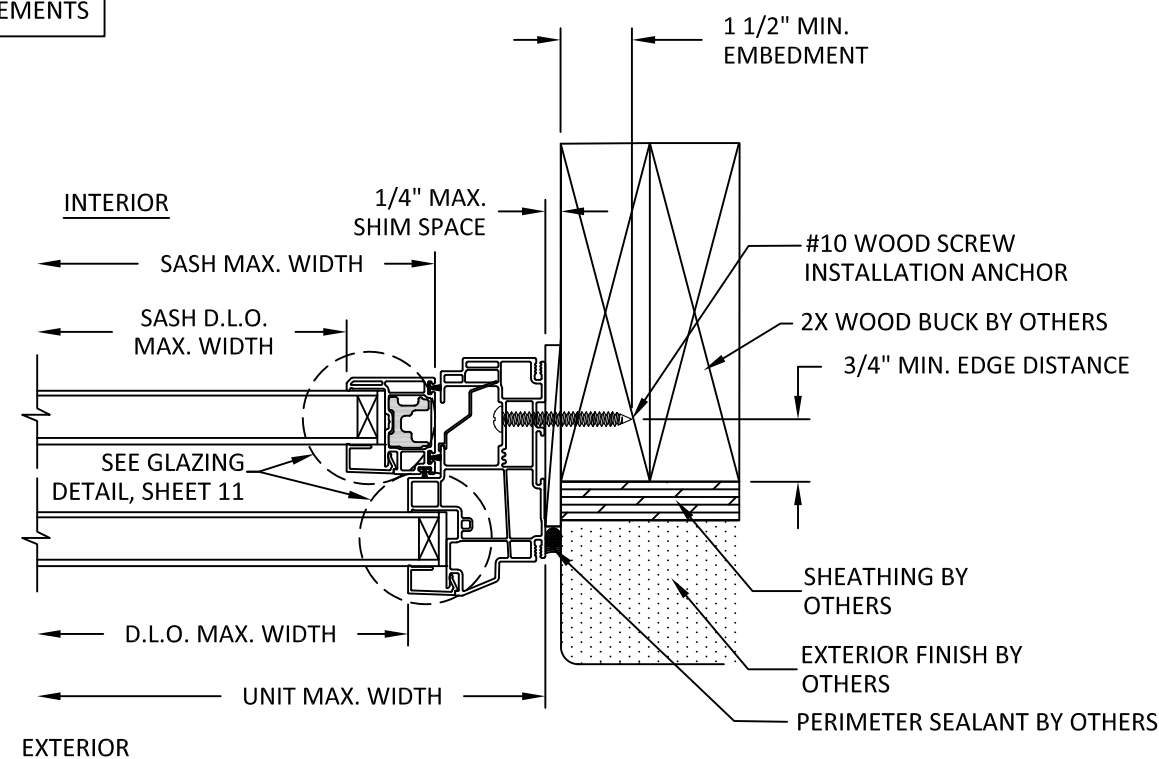


D
8 **HORIZONTAL SECTION**
THROUGH FRAME INSTALLATION
WOOD BUCK

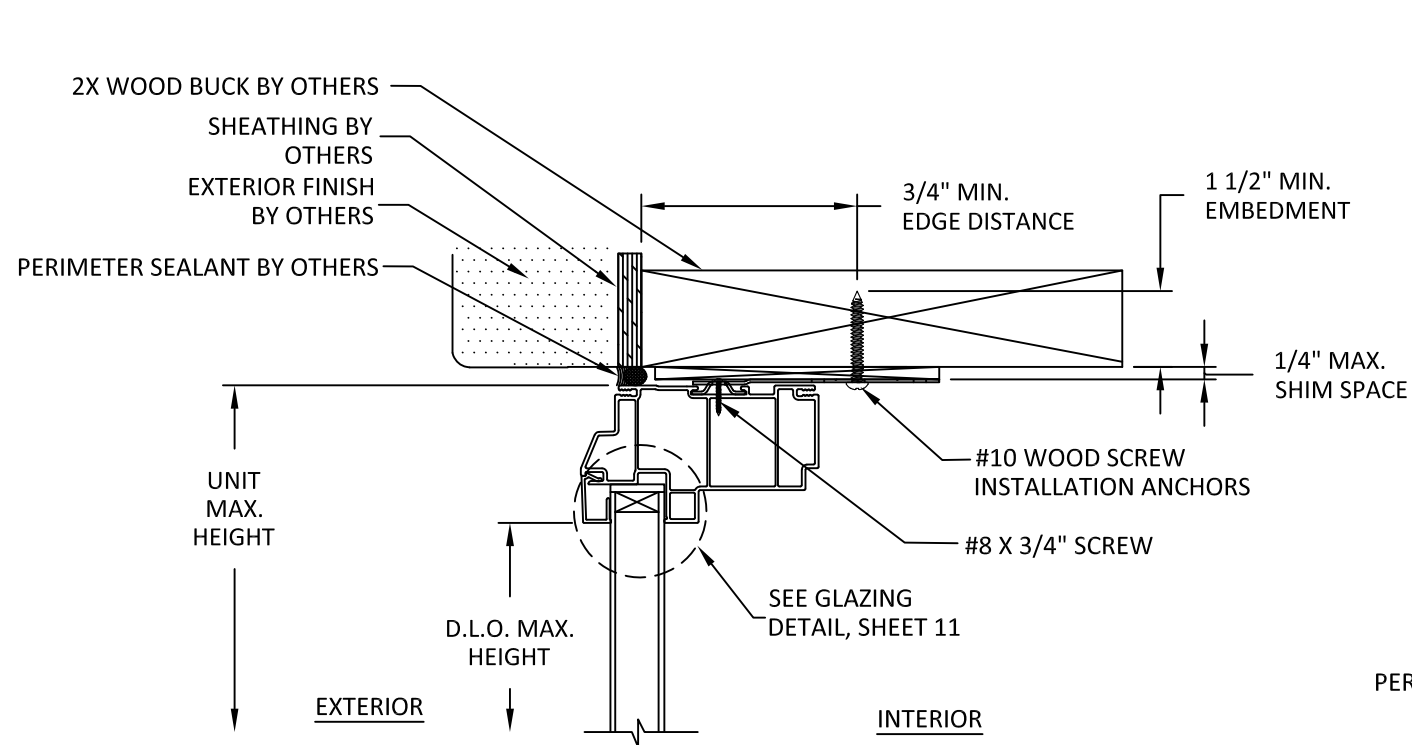


A
9 **VERTICAL SECTION**
CLIP INSTALLATION
WOOD BUCK


SEE SHEET 11 FOR OPTIONAL
FLUSH NAIL FINS AND
INSTALLATION REQUIREMENTS

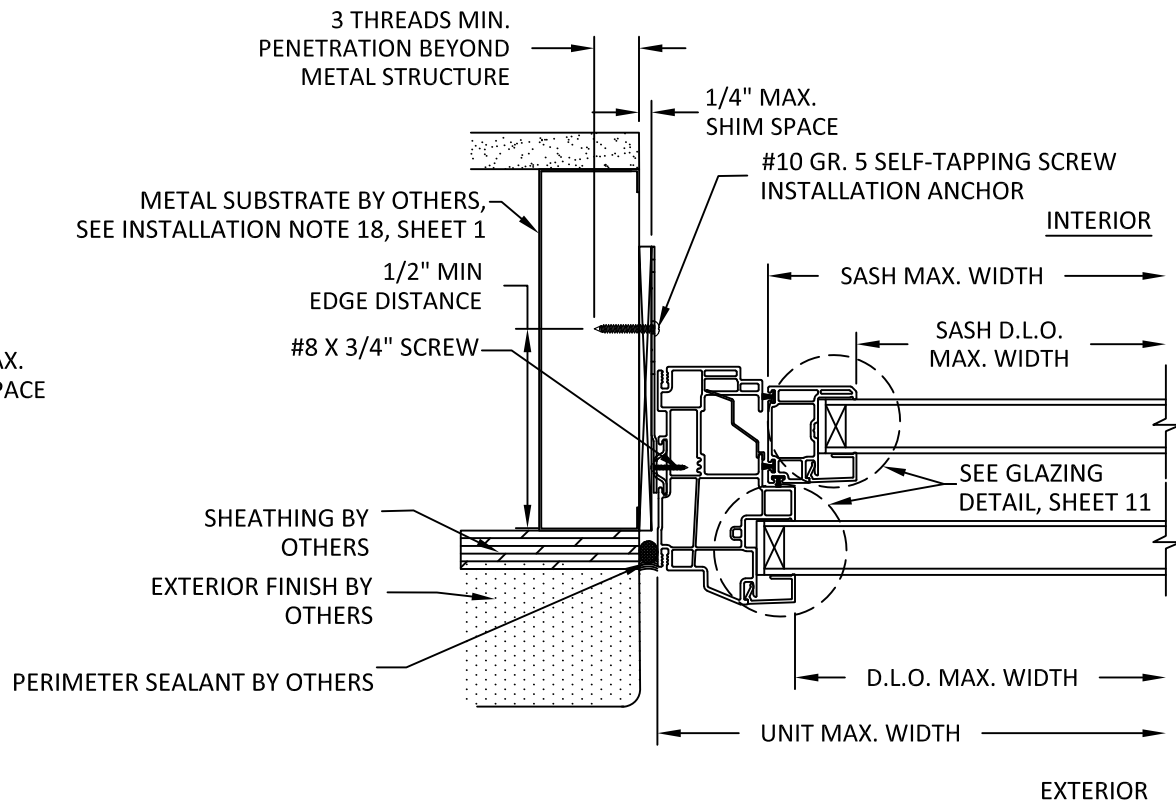

B
9 **HORIZONTAL SECTION**
CLIP INSTALLATION
METAL STUD

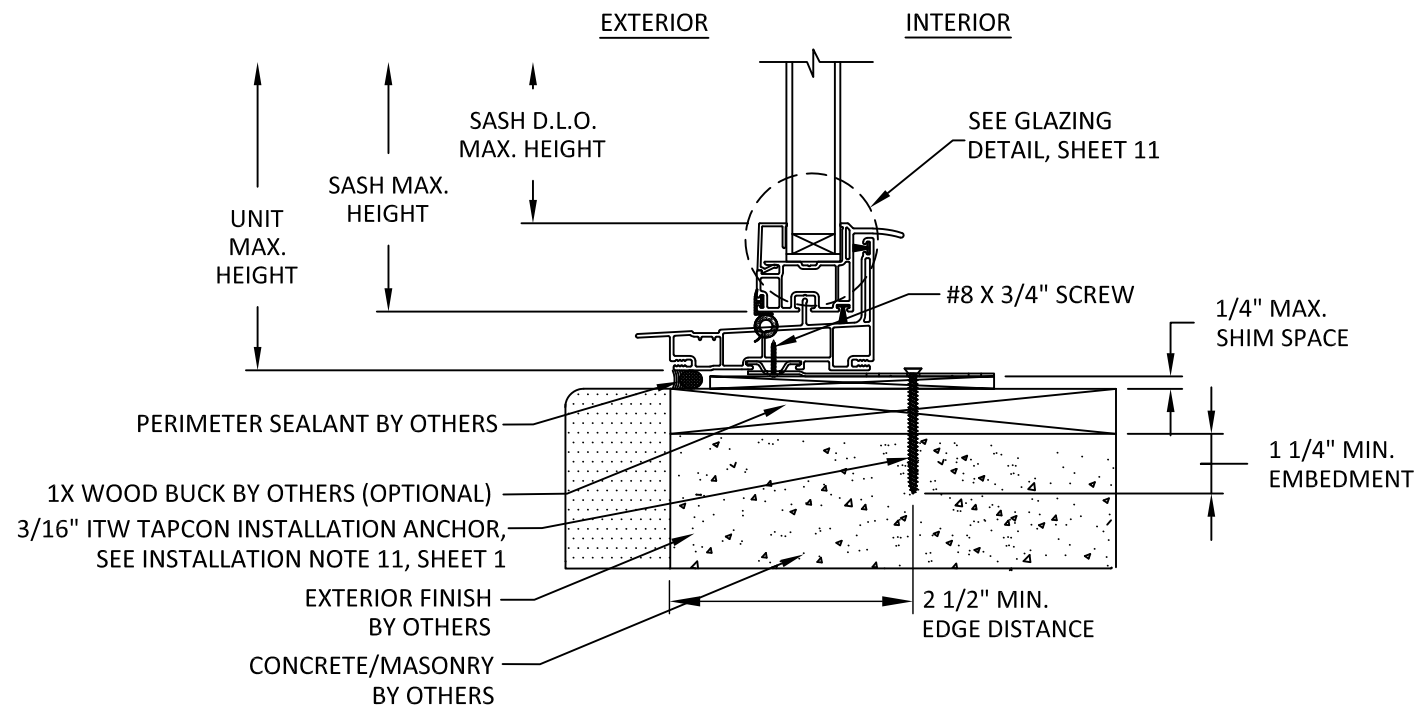

C
9 **VERTICAL SECTION**
CLIP INSTALLATION
CONCRETE/CMU

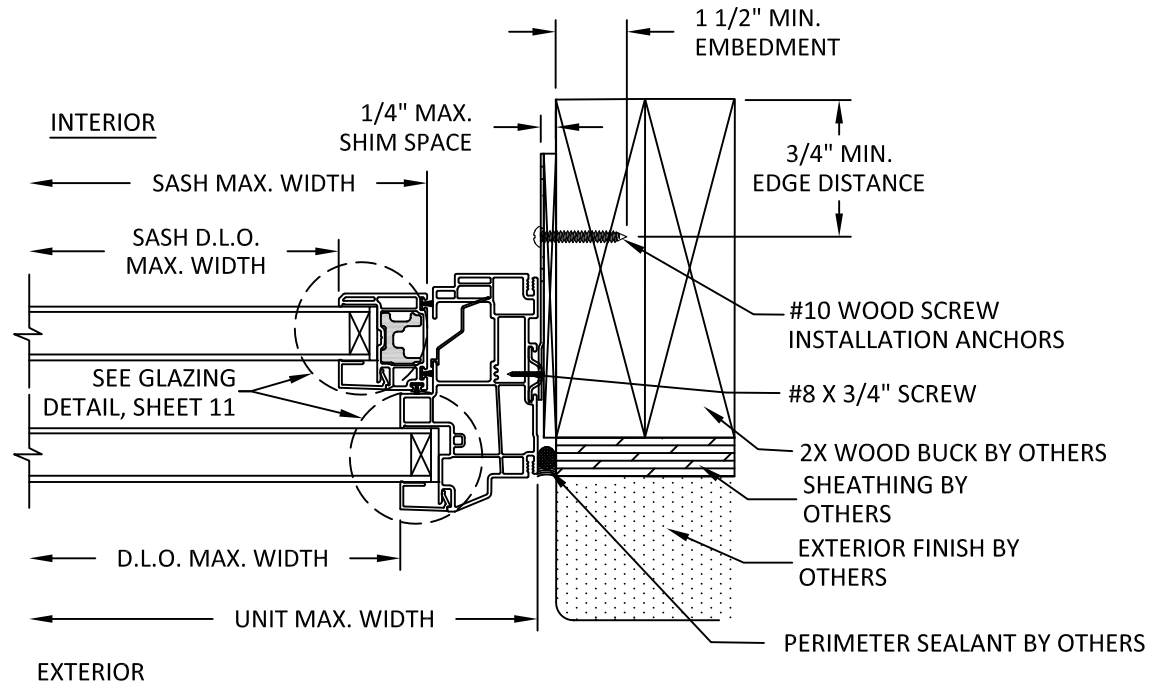

D
9 **HORIZONTAL SECTION**
CLIP INSTALLATION
WOOD BUCK



**WINDSOR WINDOWS
& DOORS**

900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE:
NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)
VERTICAL & HORIZONTAL
SECTIONS - CLIP

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132


PH: (954)399-8478
FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

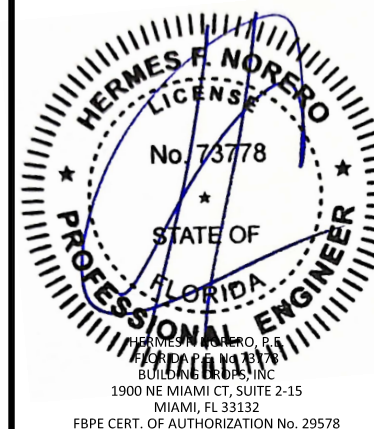

FL47167

DATE: **05.20.24**

DWG. BY:
RN

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **WWD078**


SHEET:

9


REV.

A


OF 11

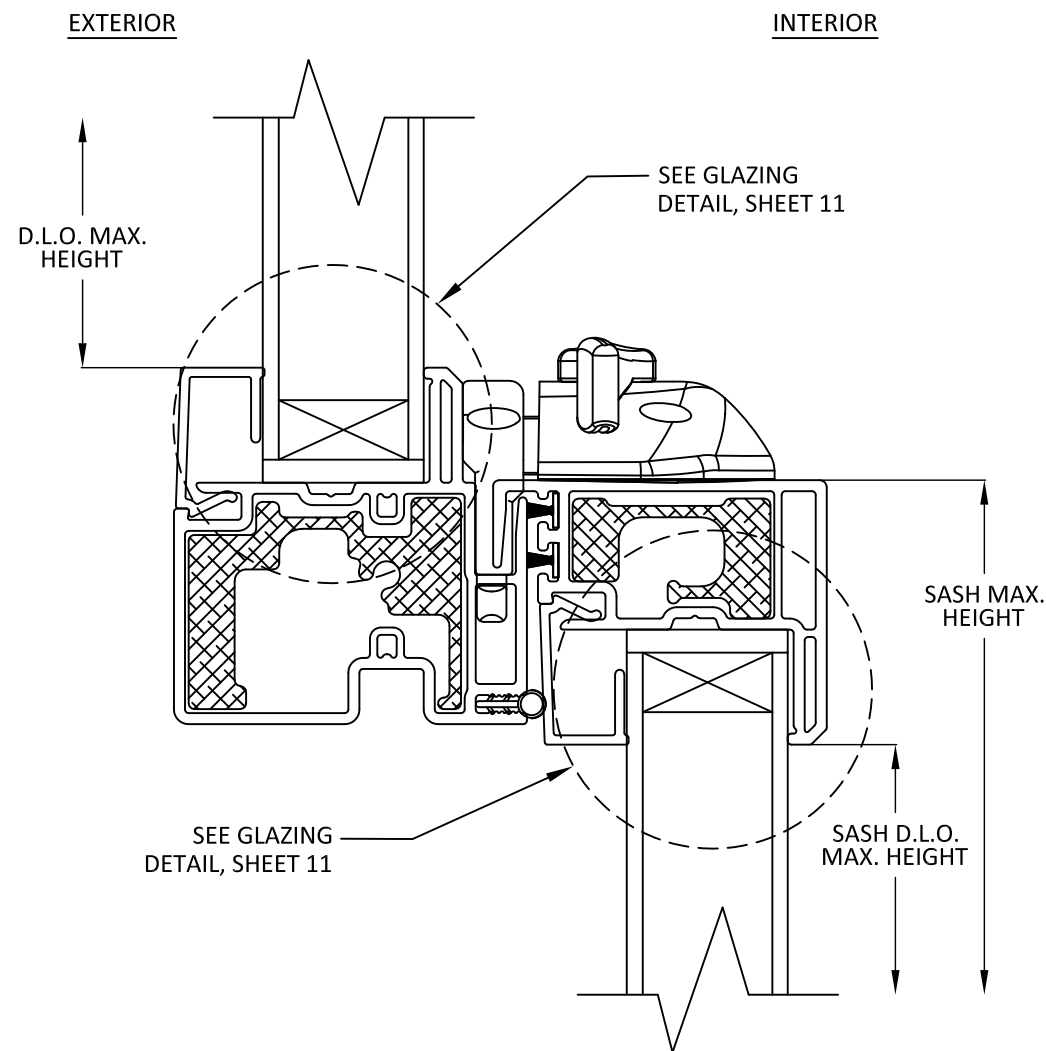

A
10 **VERTICAL SECTION**
MEETING RAIL

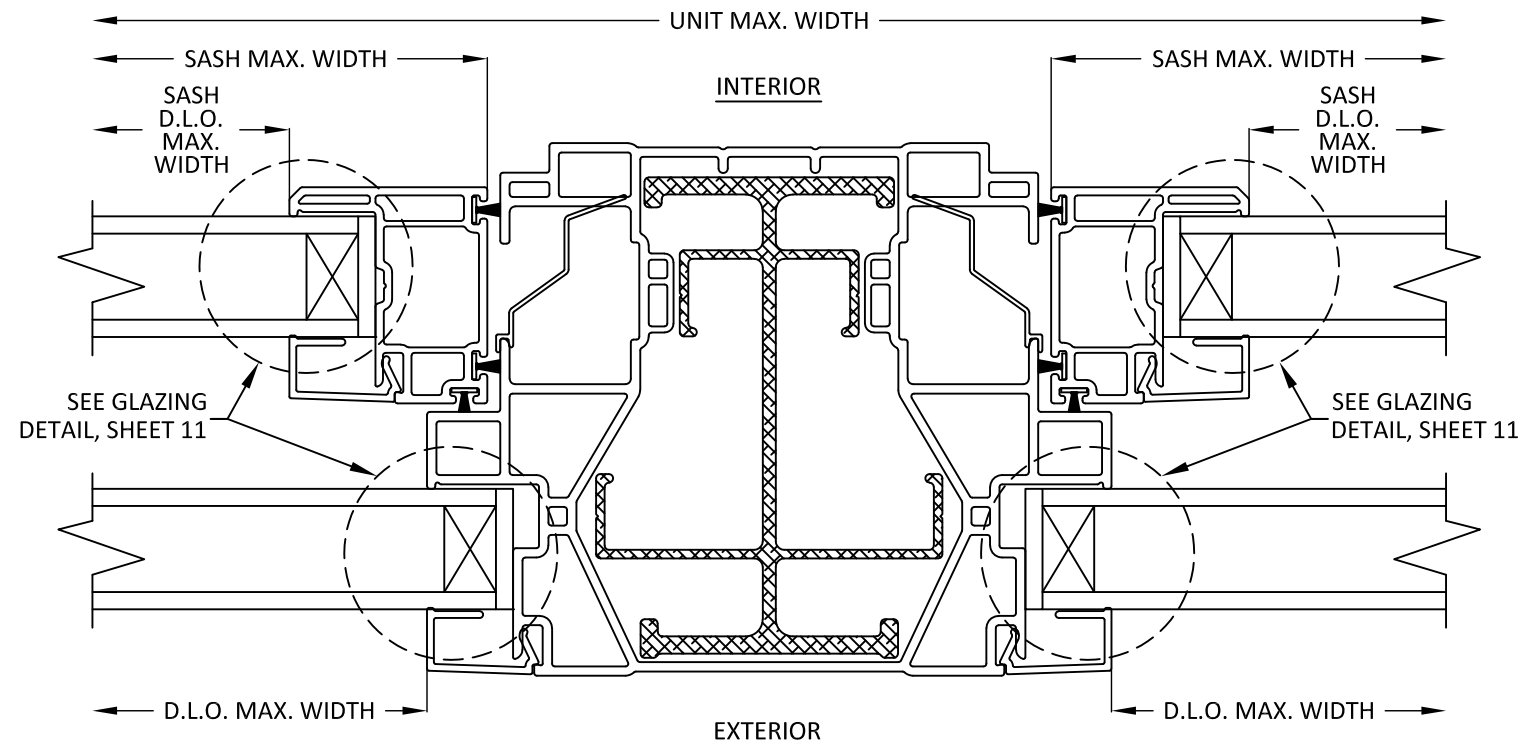

B
10 **HORIZONTAL SECTION**
T-MULL (REINFORCED)
SASH STILES (NON-REINFORCED)

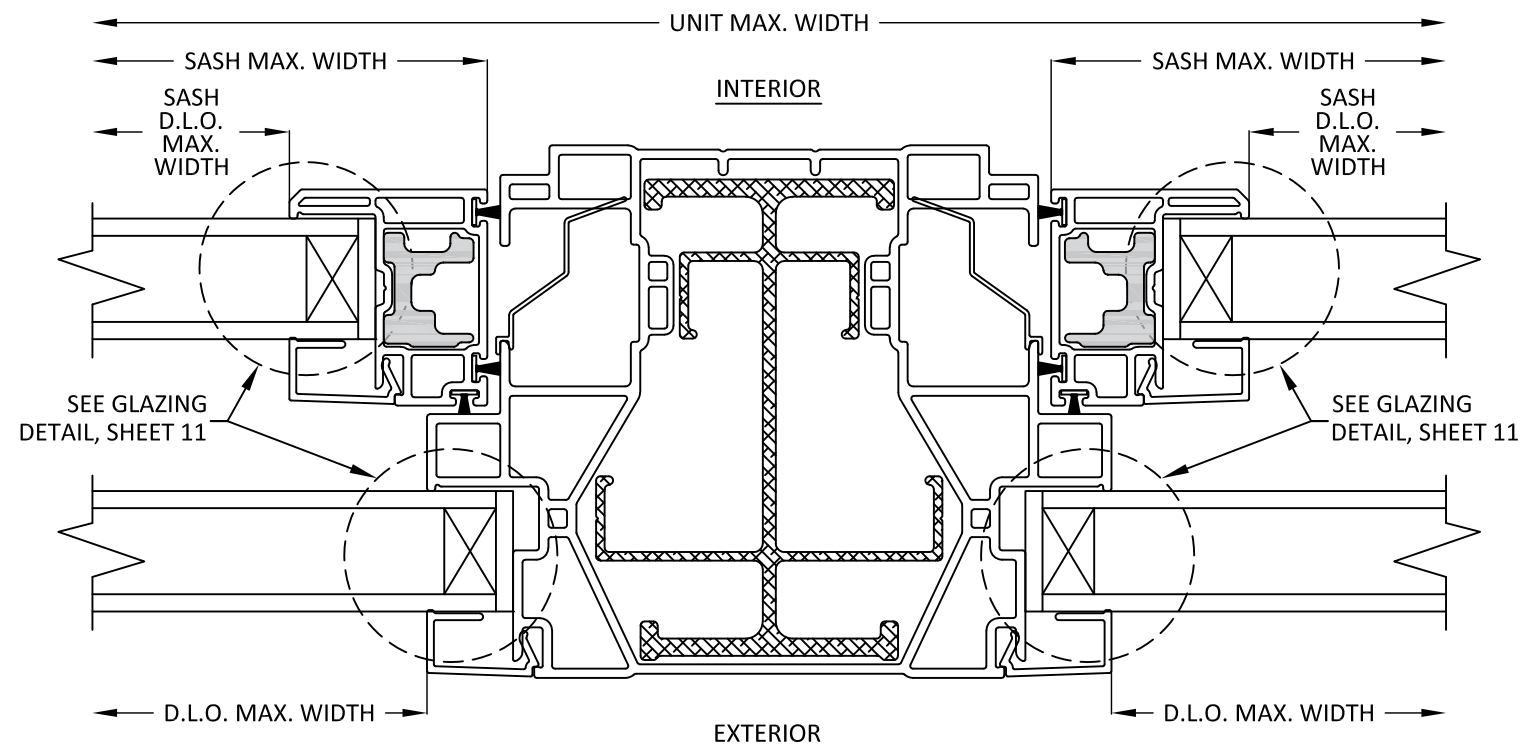

C
10 **HORIZONTAL SECTION**
T-MULL (REINFORCED)
SASH STILES (REINFORCED)



**WINDSOR WINDOWS
& DOORS**
900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938


TITLE:
NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)
MEETING RAIL & T-MULL DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26


THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

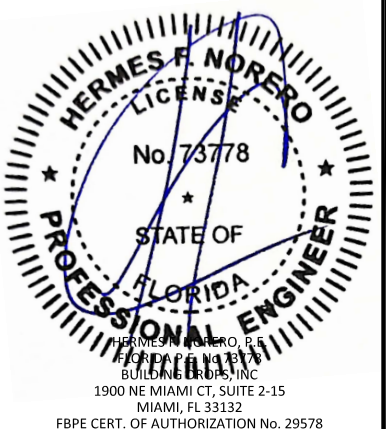

FL47167

DATE:	05.20.24
DWG. BY:	CHK. BY:
RN	HFN
SCALE:	NTS
DWG. #:	WWD078
SHEET:	REV.
10	A


OF 11

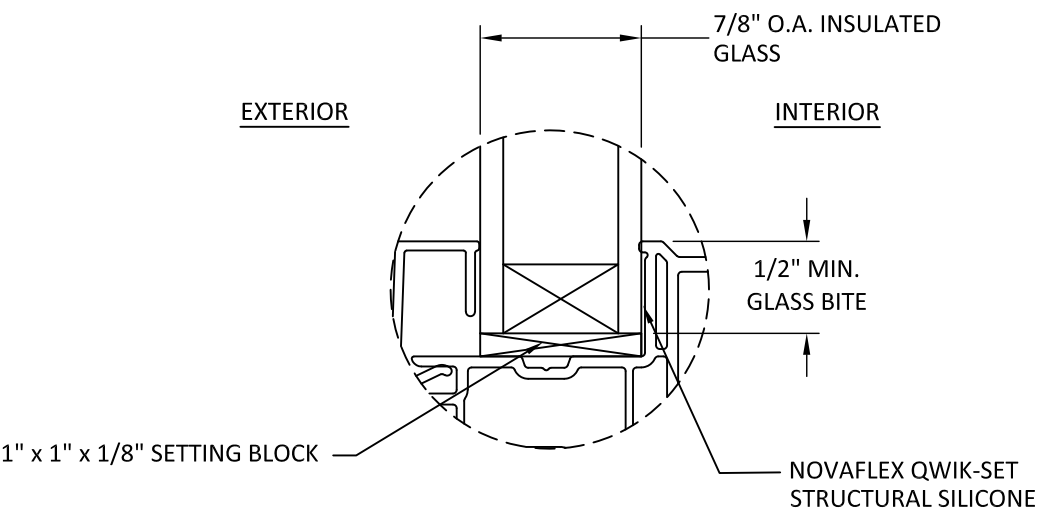

GLAZING DETAIL

- GLAZING NOTES:
1. GLASS TYPE AND THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 4. DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN DESIGN PRESSURE TABLES ON SHEET 1.

OPTIONAL FLUSH FINIS

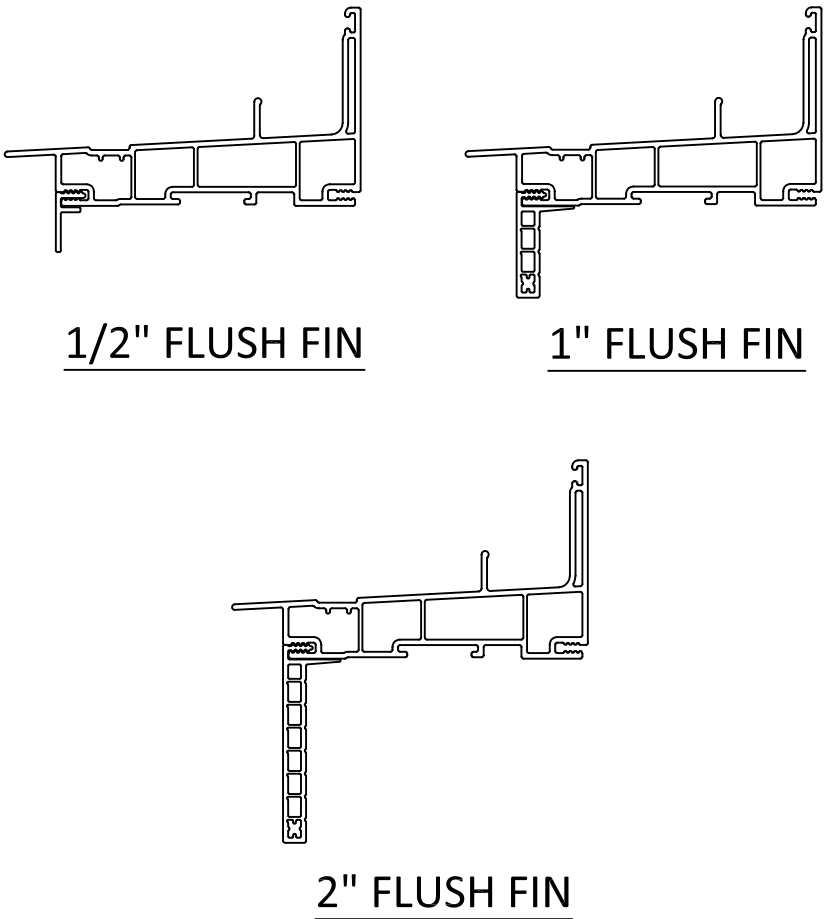

- FLUSH FIN NOTES:
1. FLUSH FIN OPTIONS ARE NON-STRUCTURAL AND TO BE USED FOR SEALING PURPOSES ONLY.
 2. WINDOW FRAMES USING OPTIONAL FLUSH FINIS SHALL BE INSTALLED USING THE THROUGH FRAME OR CLIP INSTALLATION METHOD.
 3. SILL SHOWN, HEAD AND JAMBS QUALIFIED.




WINDSOR WINDOWS
& DOORS
900 S. 19TH STREET.
WEST DES MOINES, IA 50265
PH: (515)223-6660 FAX: (515)224-1938

TITLE:
NEXT DIMENSION SINGLE HUNG
TWIN/TRIPLE WINDOW
(NON-HVHZ)(NON-IMPACT)
GLAZING DETAIL &
OPTIONAL FLUSH FINIS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HERE IN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

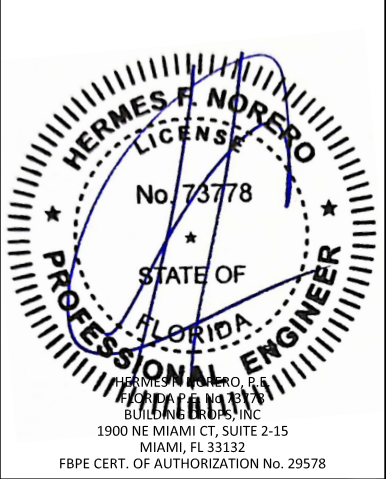

FL47167		
DATE: 05.20.24		
DWG. BY: RN		CHK. BY: HFN
SCALE: NTS		
DWG. #: WWD078		
SHEET: 11		REV. A
OF 11		