

RESIDENTIAL OUTSWING DOOR WITH SIDELITES

APPROVAL APPLIES TO SINGLE (X) AND DOUBLE (XX) LEAF DOORS WITH OR WITHOUT SIDELITES.
SIDE LITES CAN BE ON ONE OR BOTH SIDES OF DOOR.

DOORS APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.


ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

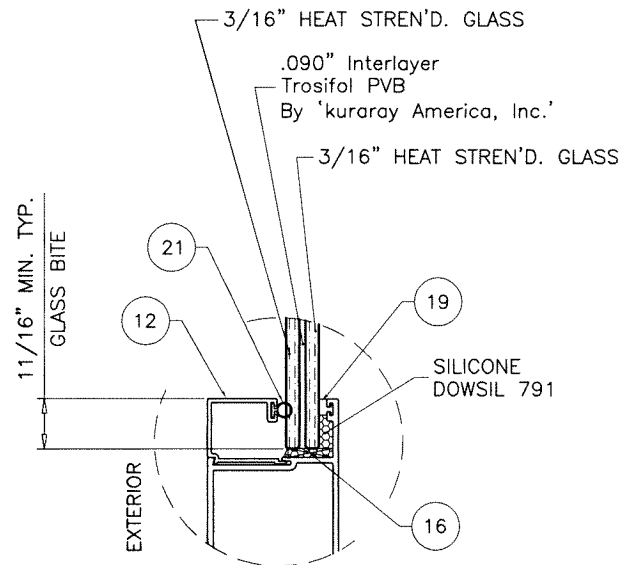

GLAZING DETAIL

INSTRUCTIONS:

USE CHARTS AS FOLLOWS.


- STEP 1** DETERMINE DESIGN WIND LOAD REQUIREMENT BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
- STEP 2** FOR SINGLE (X) AND DOUBLE (XX) DOOR CAPACITIES SEE SHEET 2.
- STEP 3** FOR SIDELITE PANEL (O) CAPACITY SEE SHEET 3.
- STEP 4** FOR SIDELITE COMBINATION WITH DOOR SEE MULLION CAPACITY CHART ON SHEET 4.
- STEP 5** THE LOWEST VALUE RESULTING FROM STEPS 2, 3 AND 4 SHALL APPLY TO ENTIRE SYSTEM.

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

Sealed: 12/19/2024

FL #47211


- A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
- B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

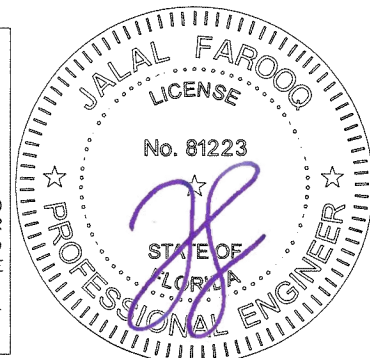

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538
COMP-ANL\24-94F-OSI

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)
Oasis Shutters, Inc.
226 West 24 Street
Hialeah, FL. 33010
Tel. (305) 558-5000
oasishurricanes shutters.com


revisions:
no date by description
date: 12-04-24
scale: -
dr. by: TARIQ
chk. by:
drawing no.
24-94F
sheet 1 of 10

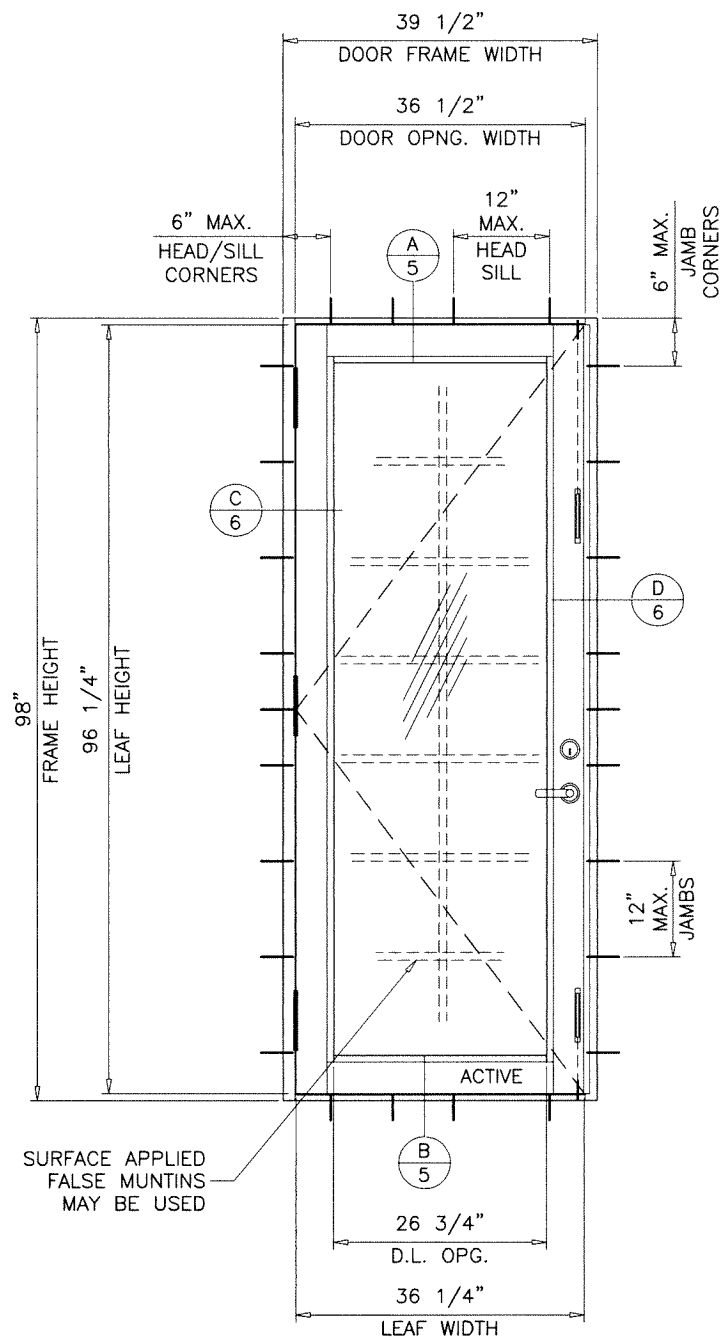

TYPICAL ELEVATION
(X)

SINGLE DOORS LOAD CAPACITY - PSF					
FRAME		LEAF		EXT.(+)	INT.(-)
WIDTH	HEIGHT	WIDTH	HEIGHT		
39-1/2"	98"	36-1/4"	96-1/4"	70.0	75.0

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

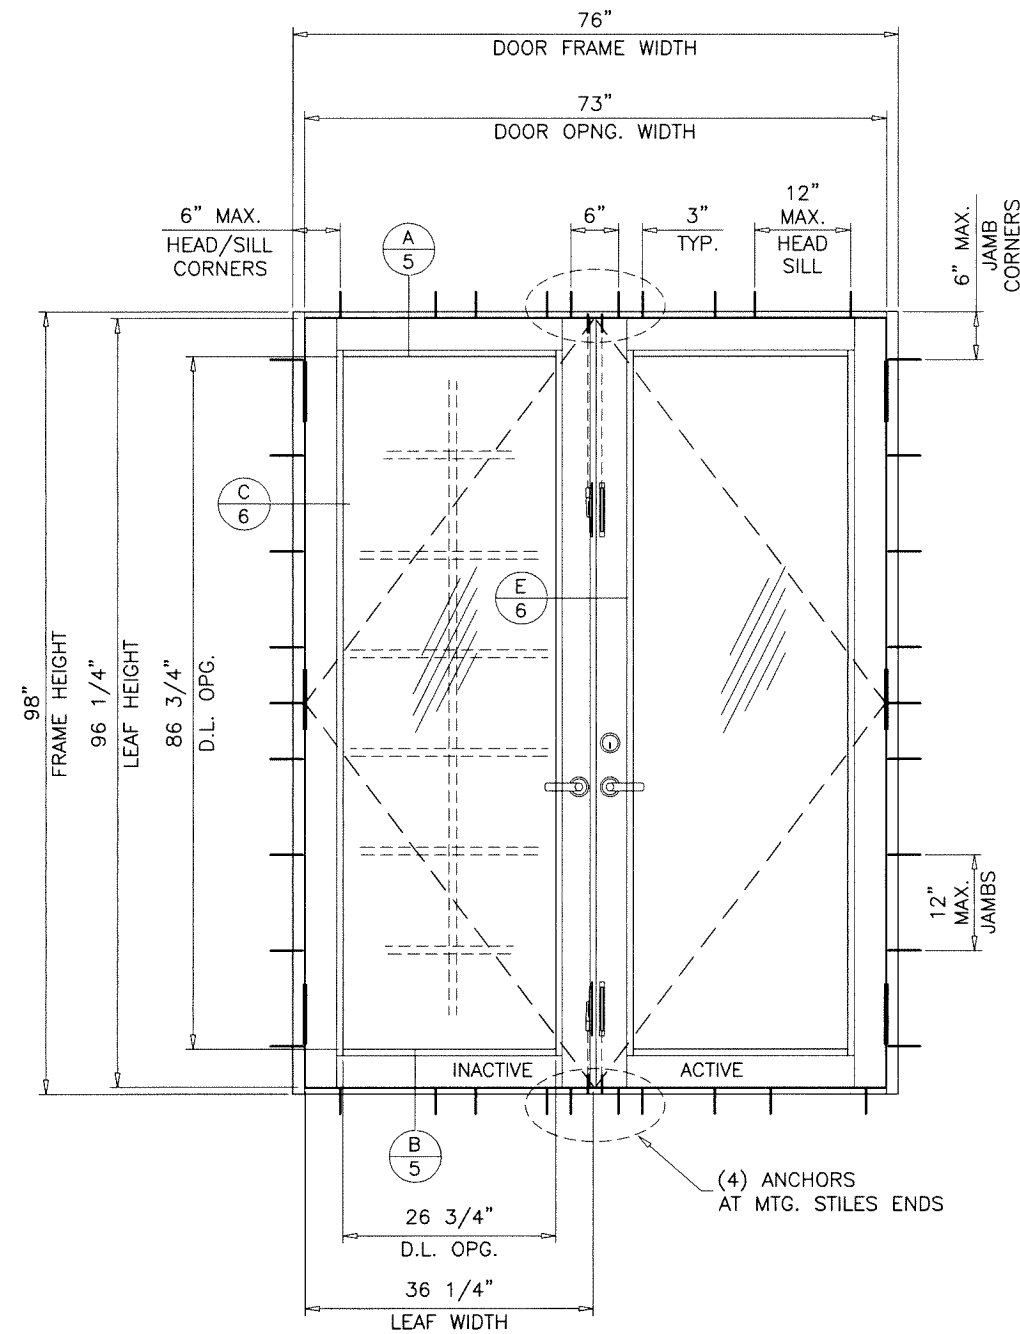


TYPICAL ELEVATION
(XX)

DOUBLE DOORS LOAD CAPACITY - PSF					
FRAME		LEAF		EXT.(+)	INT.(-)
WIDTH	HEIGHT	WIDTH	HEIGHT		
76"	98"	36-1/4"	96-1/4"	70.0	75.0

GLASS D.L.O. FORMULAE:
D.L.O. WIDTH = FRAME WIDTH - 12.75" (X DOORS)
= (FRAME WIDTH - 22.50")/2 (XX DOORS)
D.L.O. HEIGHT = FRAME HEIGHT - 11.25"

Sealed: 12/19/2024

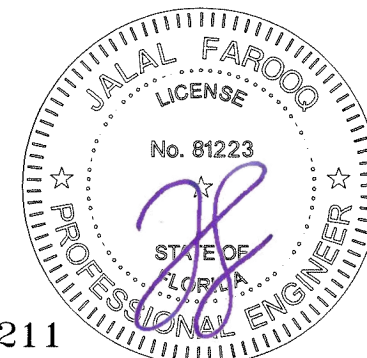


FL #47211

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)
Oasis Shutters, Inc.
226 West 24 Street
Hialeah, FL 33010
Tel. (305) 558-5000 oasisshutters.com


revisions:	no	date	by	description
date:	12-04-24	scale:	1/2"=1'-0"	
dr. by:	TARIQ	chk. by:		
drawing no.	24-94F	sheet	2 of 10	

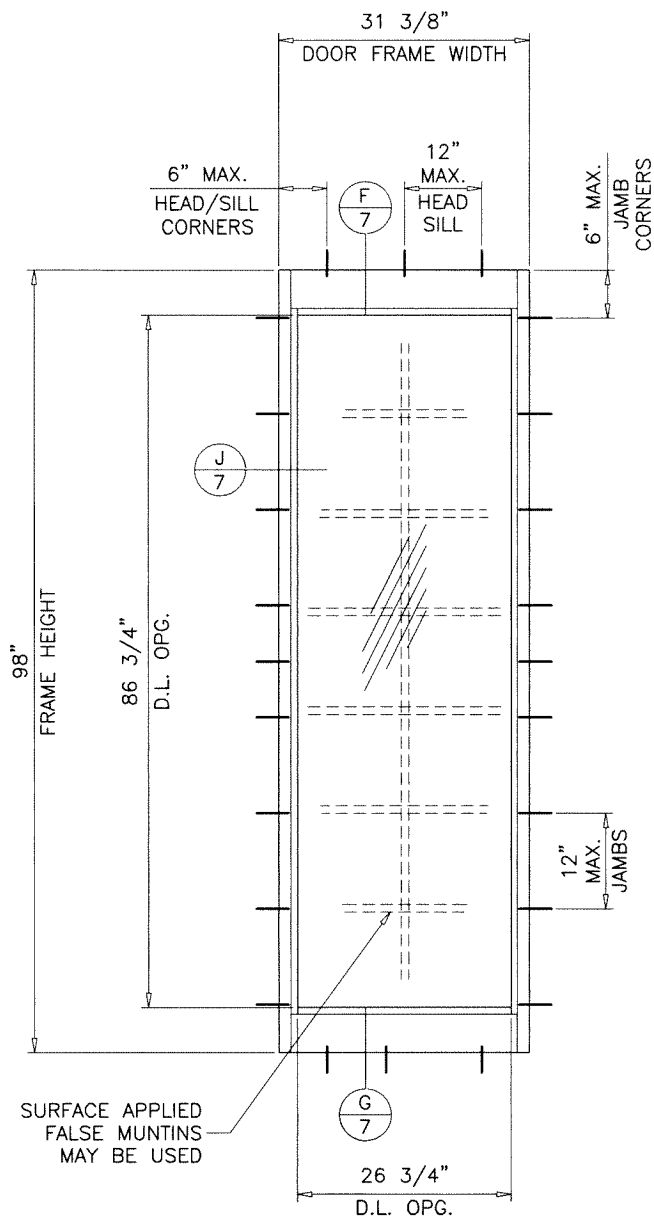

TYPICAL ELEVATION
(O)

SIDELITE LOAD CAPACITY - PSF OR STAND ALONE STATIONARY PANEL (O)			
FRAME		EXT.(+)	INT.(-)
WIDTH	HEIGHT		
24"	98"	70.0	75.0
30"		70.0	75.0

D.L.O. HEIGHT (SIDELITE) = FRAME HEIGHT - 11.25"
D.L.O. WIDTH (SIDE LITE) = FRAME WIDTH - 4.625"

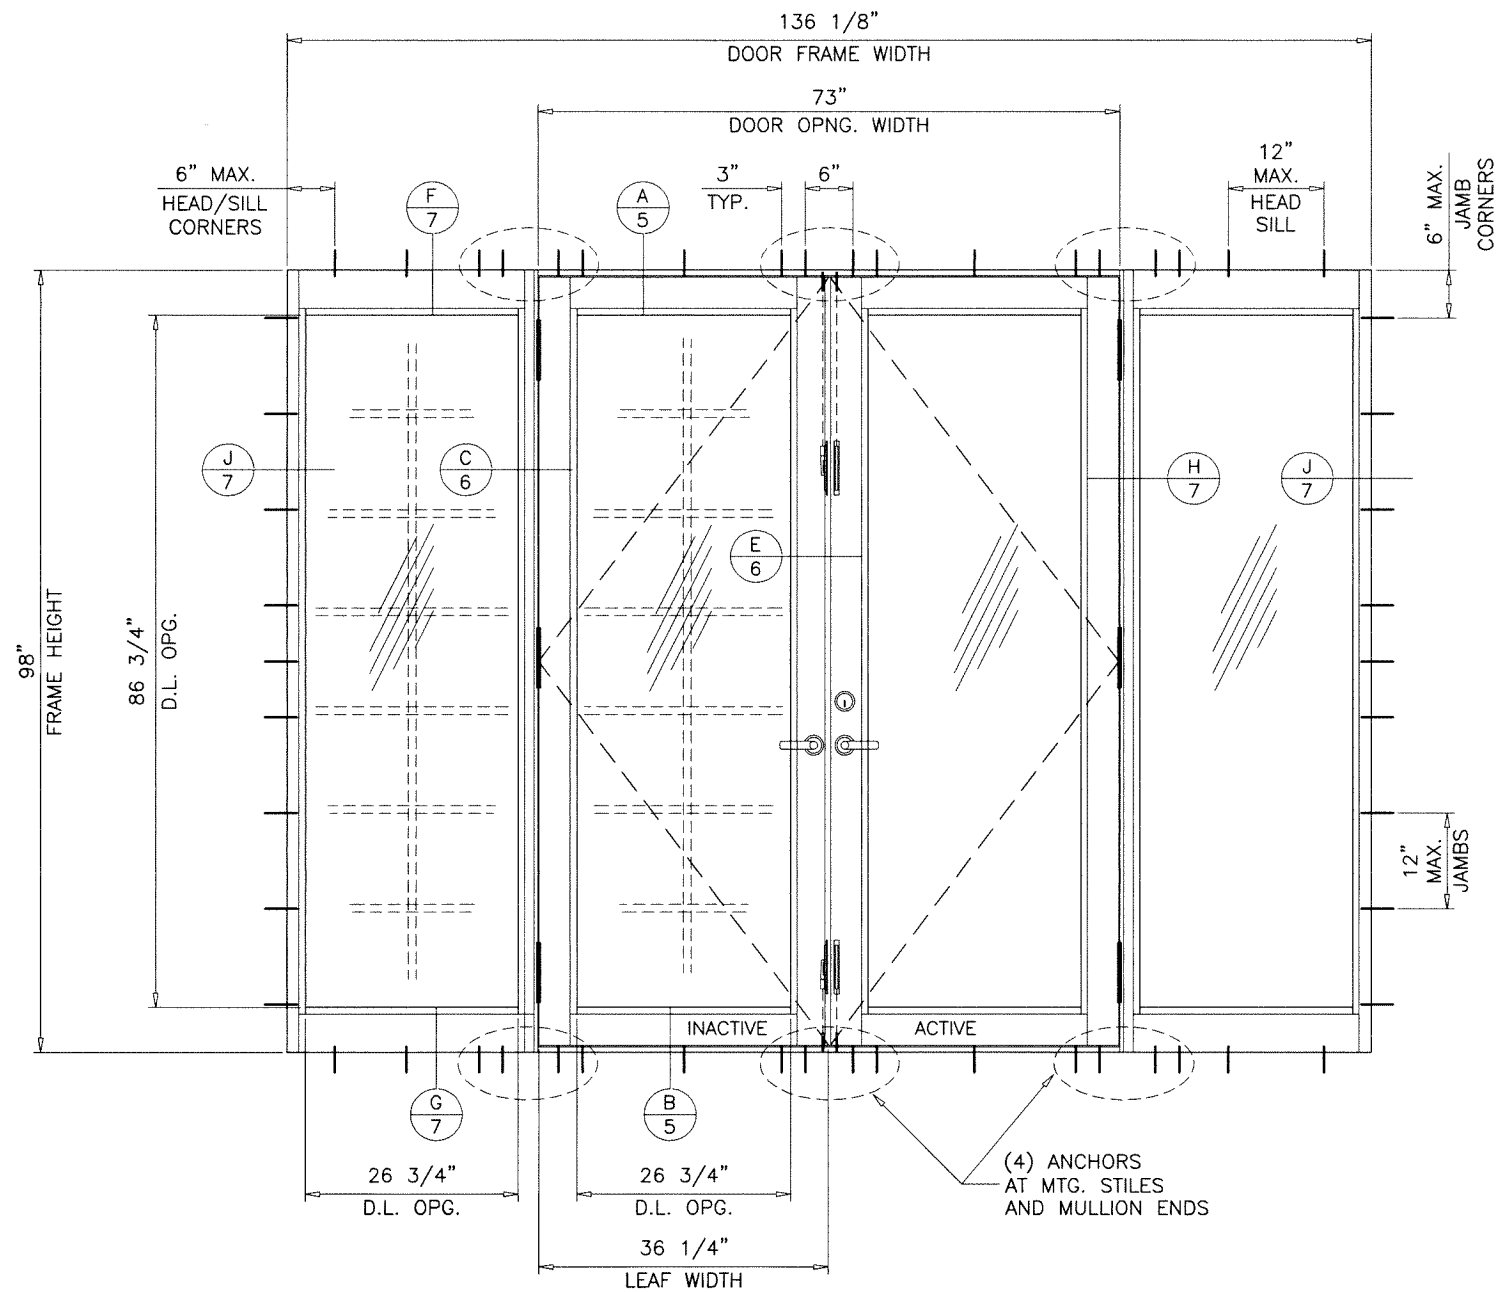


TYPICAL ELEVATION
(O-XX-O)

NOTE:
THE FRAME AREA OF ALTERNATE SIZE MUST NOT
EXCEED TESTED FRAME AREA = 92.6 SQ. FT.

Sealed: 12/19/2024

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

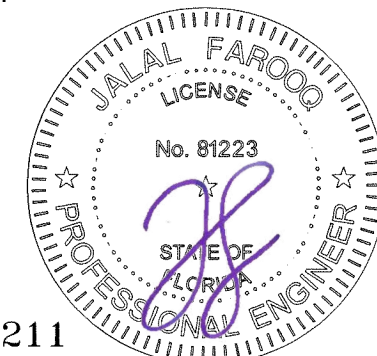

FL #47211

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

COMP-ANL\24-94F-OSI

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)

Oasis Shutters, Inc.
226 West 24 Street
Hialeah, FL 33010
Tel. (305) 558-5000 oasishurricanes shutters.com





date: 12-04-24
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:

revisions:

no	date	by	description

drawing no.
24-94F
sheet **3** of **10**


DESIGN LOAD CAPACITY – PSF DOOR TO SIDELITE MULLION					
SIDELITE WIDTH INCHES	FRAME HEIGHT INCHES	WITHOUT REINF.		WITH REINF.	
		EXT.(+)	INT.(–)		
24	84	70.0	75.0	70.0	75.0
30		70.0	75.0	70.0	75.0
38		70.0	75.0	70.0	75.0
42		70.0	75.0	70.0	75.0
24	90	70.0	75.0	70.0	75.0
30		70.0	75.0	70.0	75.0
38		70.0	75.0	70.0	75.0
24	96	70.0	73.5	70.0	75.0
30		67.6	67.6	70.0	75.0
38		61.3	61.3	70.0	75.0
24	98	69.0	69.0	70.0	75.0
30		63.4	63.4	70.0	75.0
38		57.5	57.5	70.0	75.0

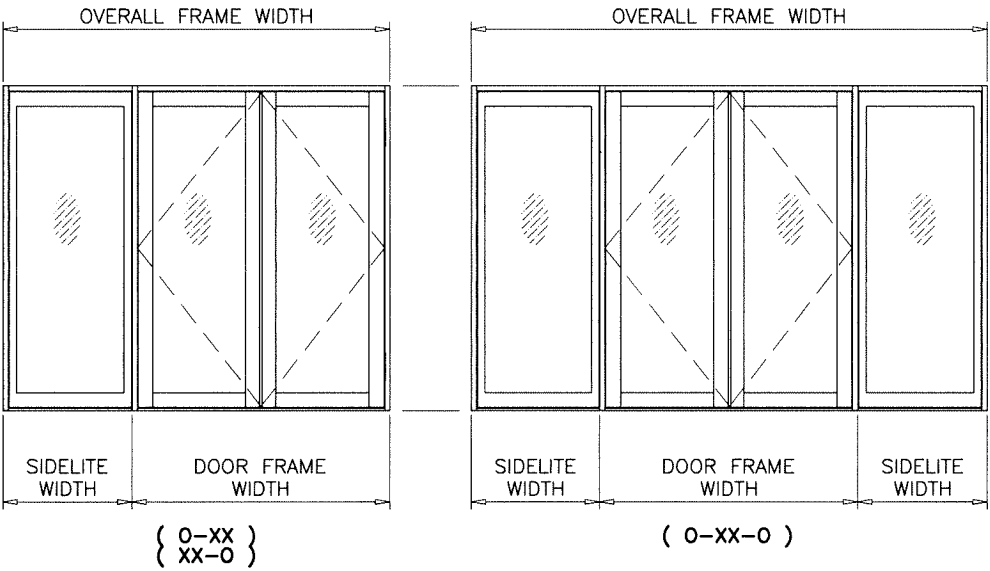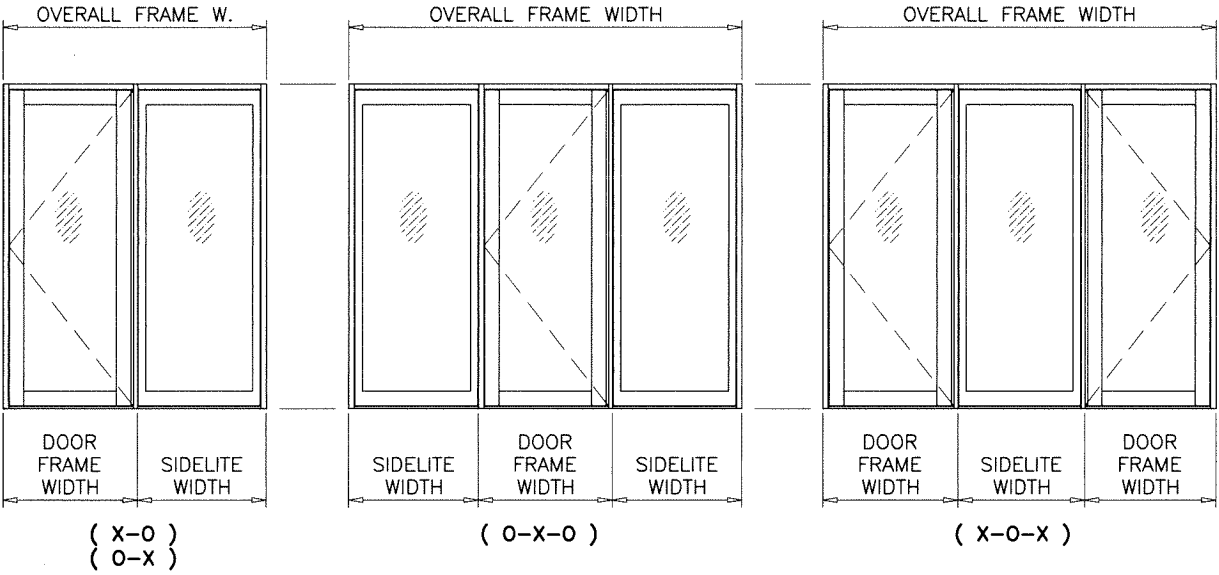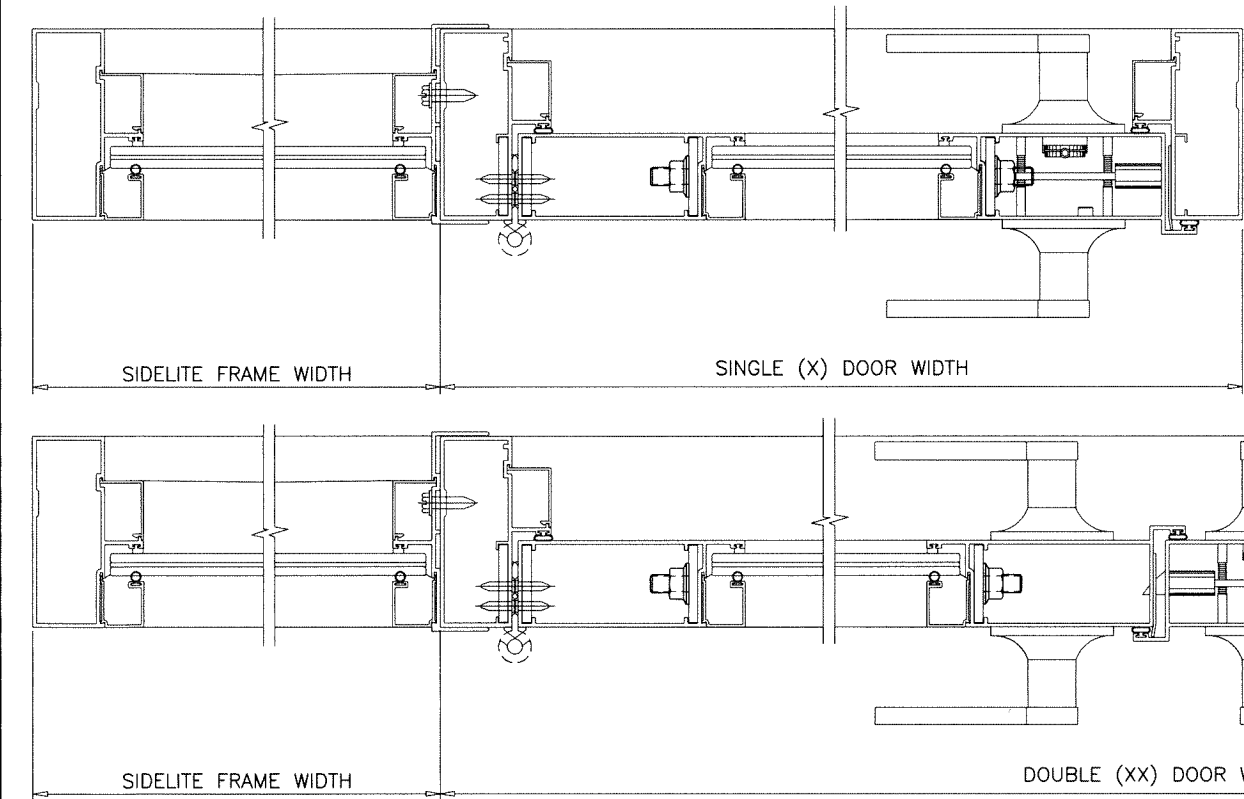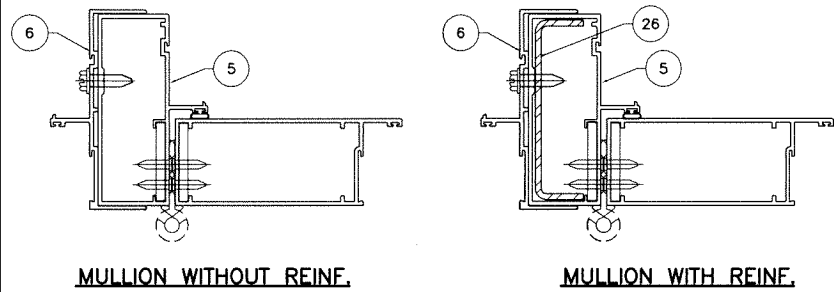

APPROVED CONFIGURATIONS

NOTE:
FOR DOORS CAPACITY SEE SHEET 2
FOR SIDELITE CAPACITIES SEE SHEET 3.
FOR SIDELITE MULLION CAPACITY SEE CHART ABOVE
LOWER VALUES FROM DOORS, SIDELITE OR DOOR/SIDELITE
MULLION CHART WILL APPLY TO ENTIRE SYSTEM.

Sealed: 12/19/2024




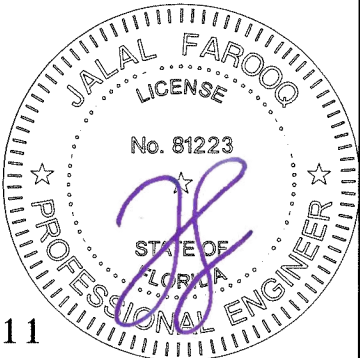


FL #47211

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538
COMP-ANL 24-94F-OSI

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)
Oasis Shutters, Inc.
226 West 24 Street
Hialeah, FL 33010
Tel. (305) 558-5000
oasishurricanes shutters.com

revisions:		no date by description	
date:	12-04-24	scale:	–
dr. by:	TARIQ	chk. by:	
drawing no.		24-94F	
sheet		4 of 10	

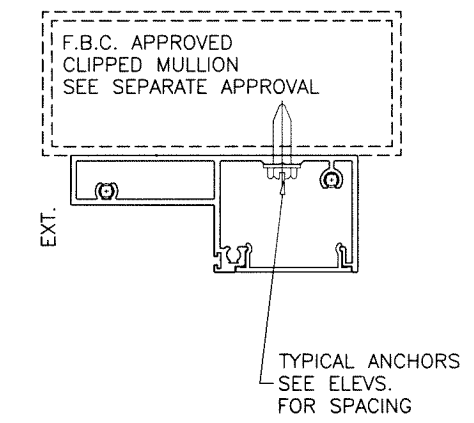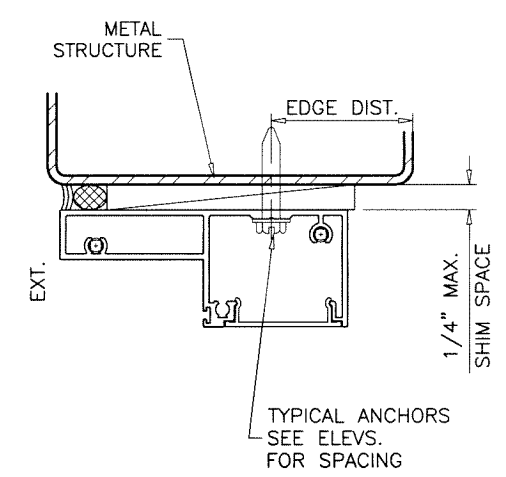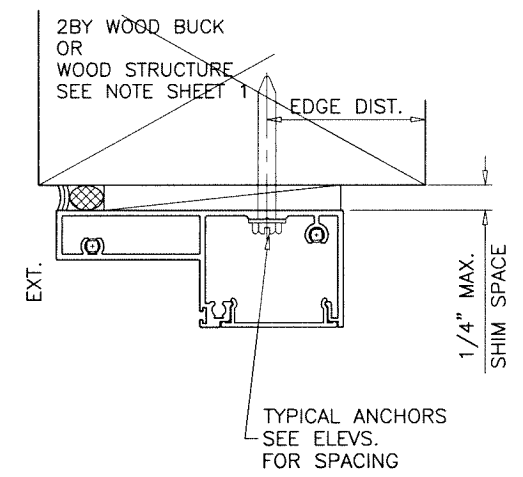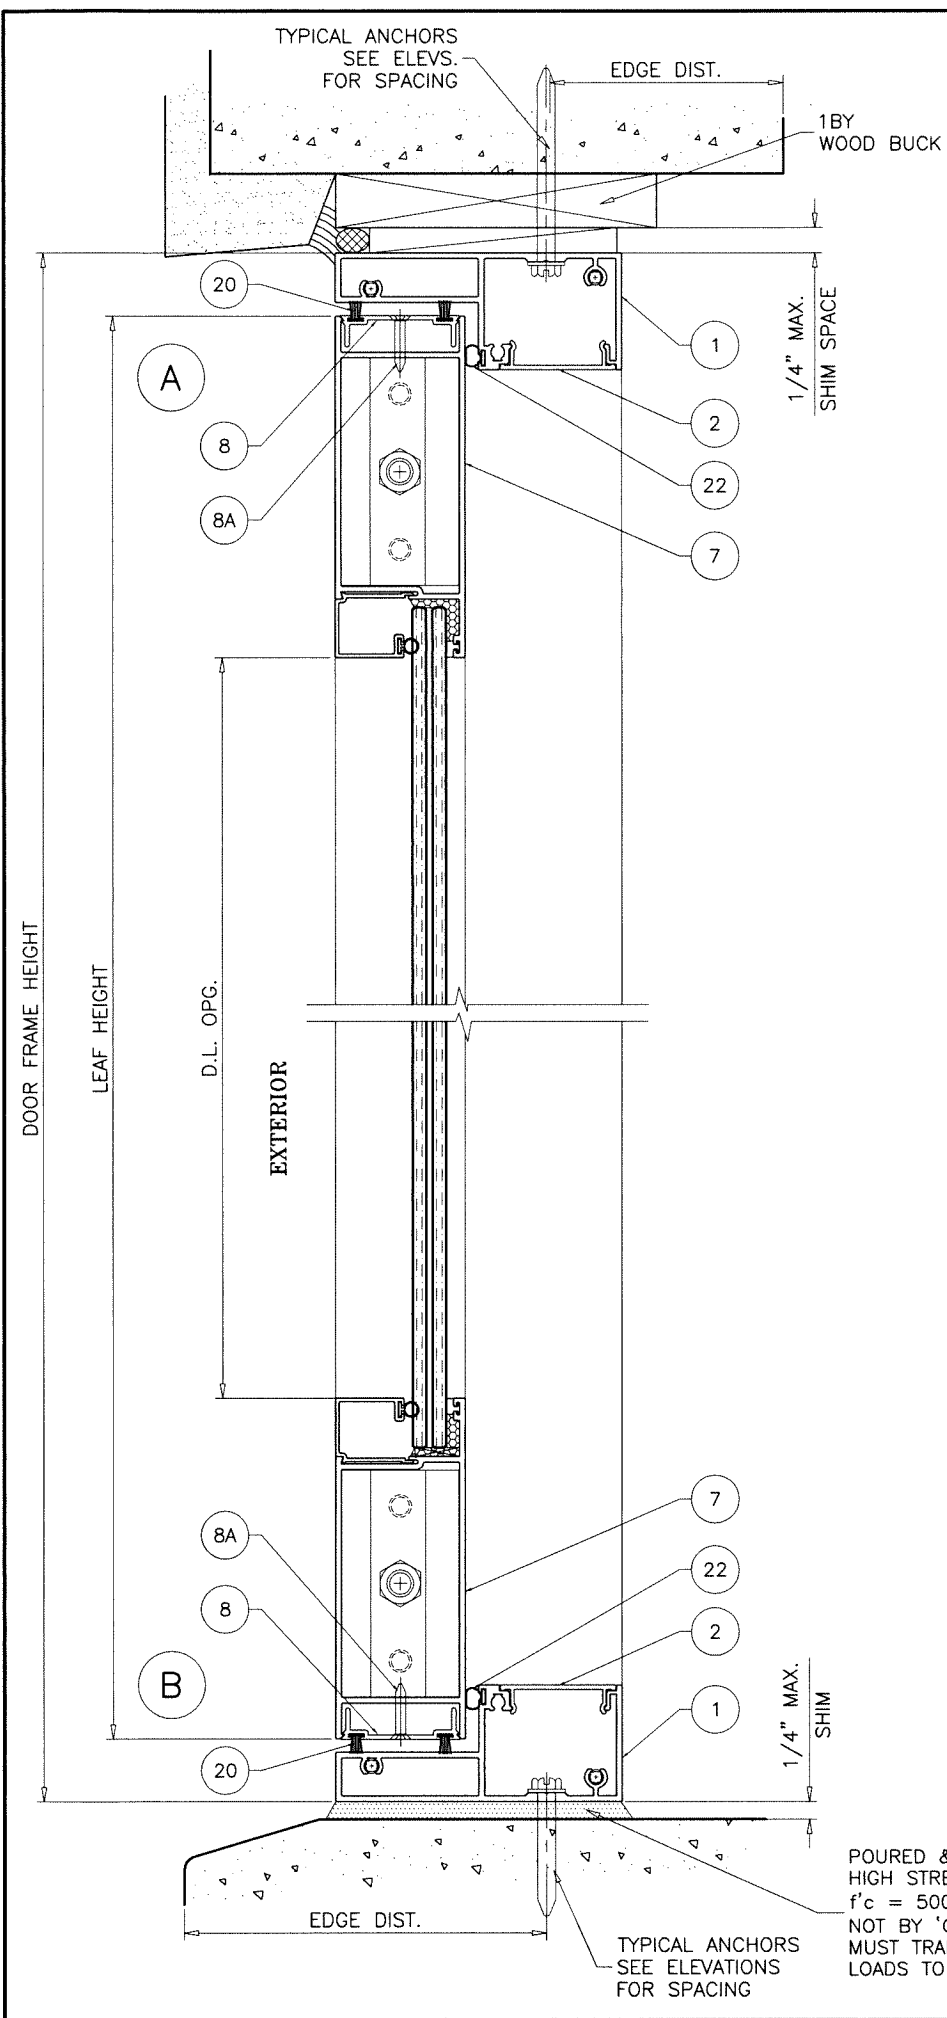

WOOD BUCKS AND METAL STRUCTURE NOT BY 'OASIS SHUTTERS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)
 THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-3/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)
 DIRECTLY INTO CONCRETE OR GROUT FILLED BLOCKS
 1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
 1-3/4" MIN. EMBED INTO GROUT FILLED BLOCKS (JAMBS)
1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
 INTO F.B.C. APPROVED MULLIONS
 OR
 INTO METAL STRUCTURES (HEAD/JAMBS)
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


TYPICAL EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 GROUT FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

POURED & HARDENED
 HIGH STRENGTH GROUT
 f'c = 5000 PSI MIN.
 NOT BY 'OASIS SHUTTERS'
 MUST TRANSFER SHEAR
 LOADS TO STRUCTURE

Sealed: 12/19/2024

DOOR DETAILS

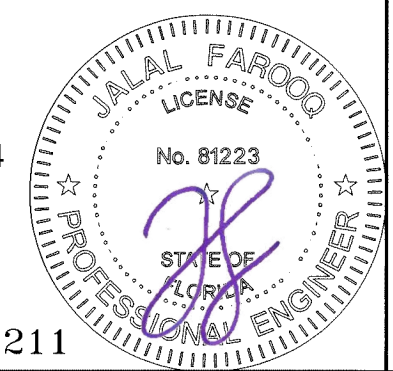

FL #47211

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100
 WWW.AFCENG.COM
 FBPE #3538

COMP-ANL\24-94F-OSI

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)

Oasis Shutters, Inc.
 226 West 24 Street
 Hialeah, FL 33010
 Tel. (305) 558-5000
 oasishurricanes shutters.com



revisions:

no	date	by	description

date: 12-04-24
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
24-94F

sheet 5 of 10

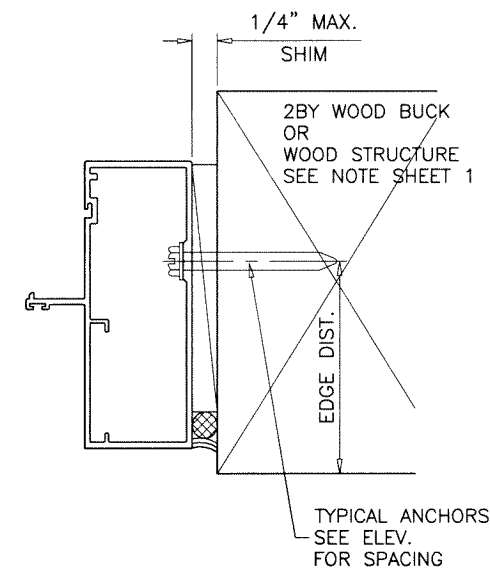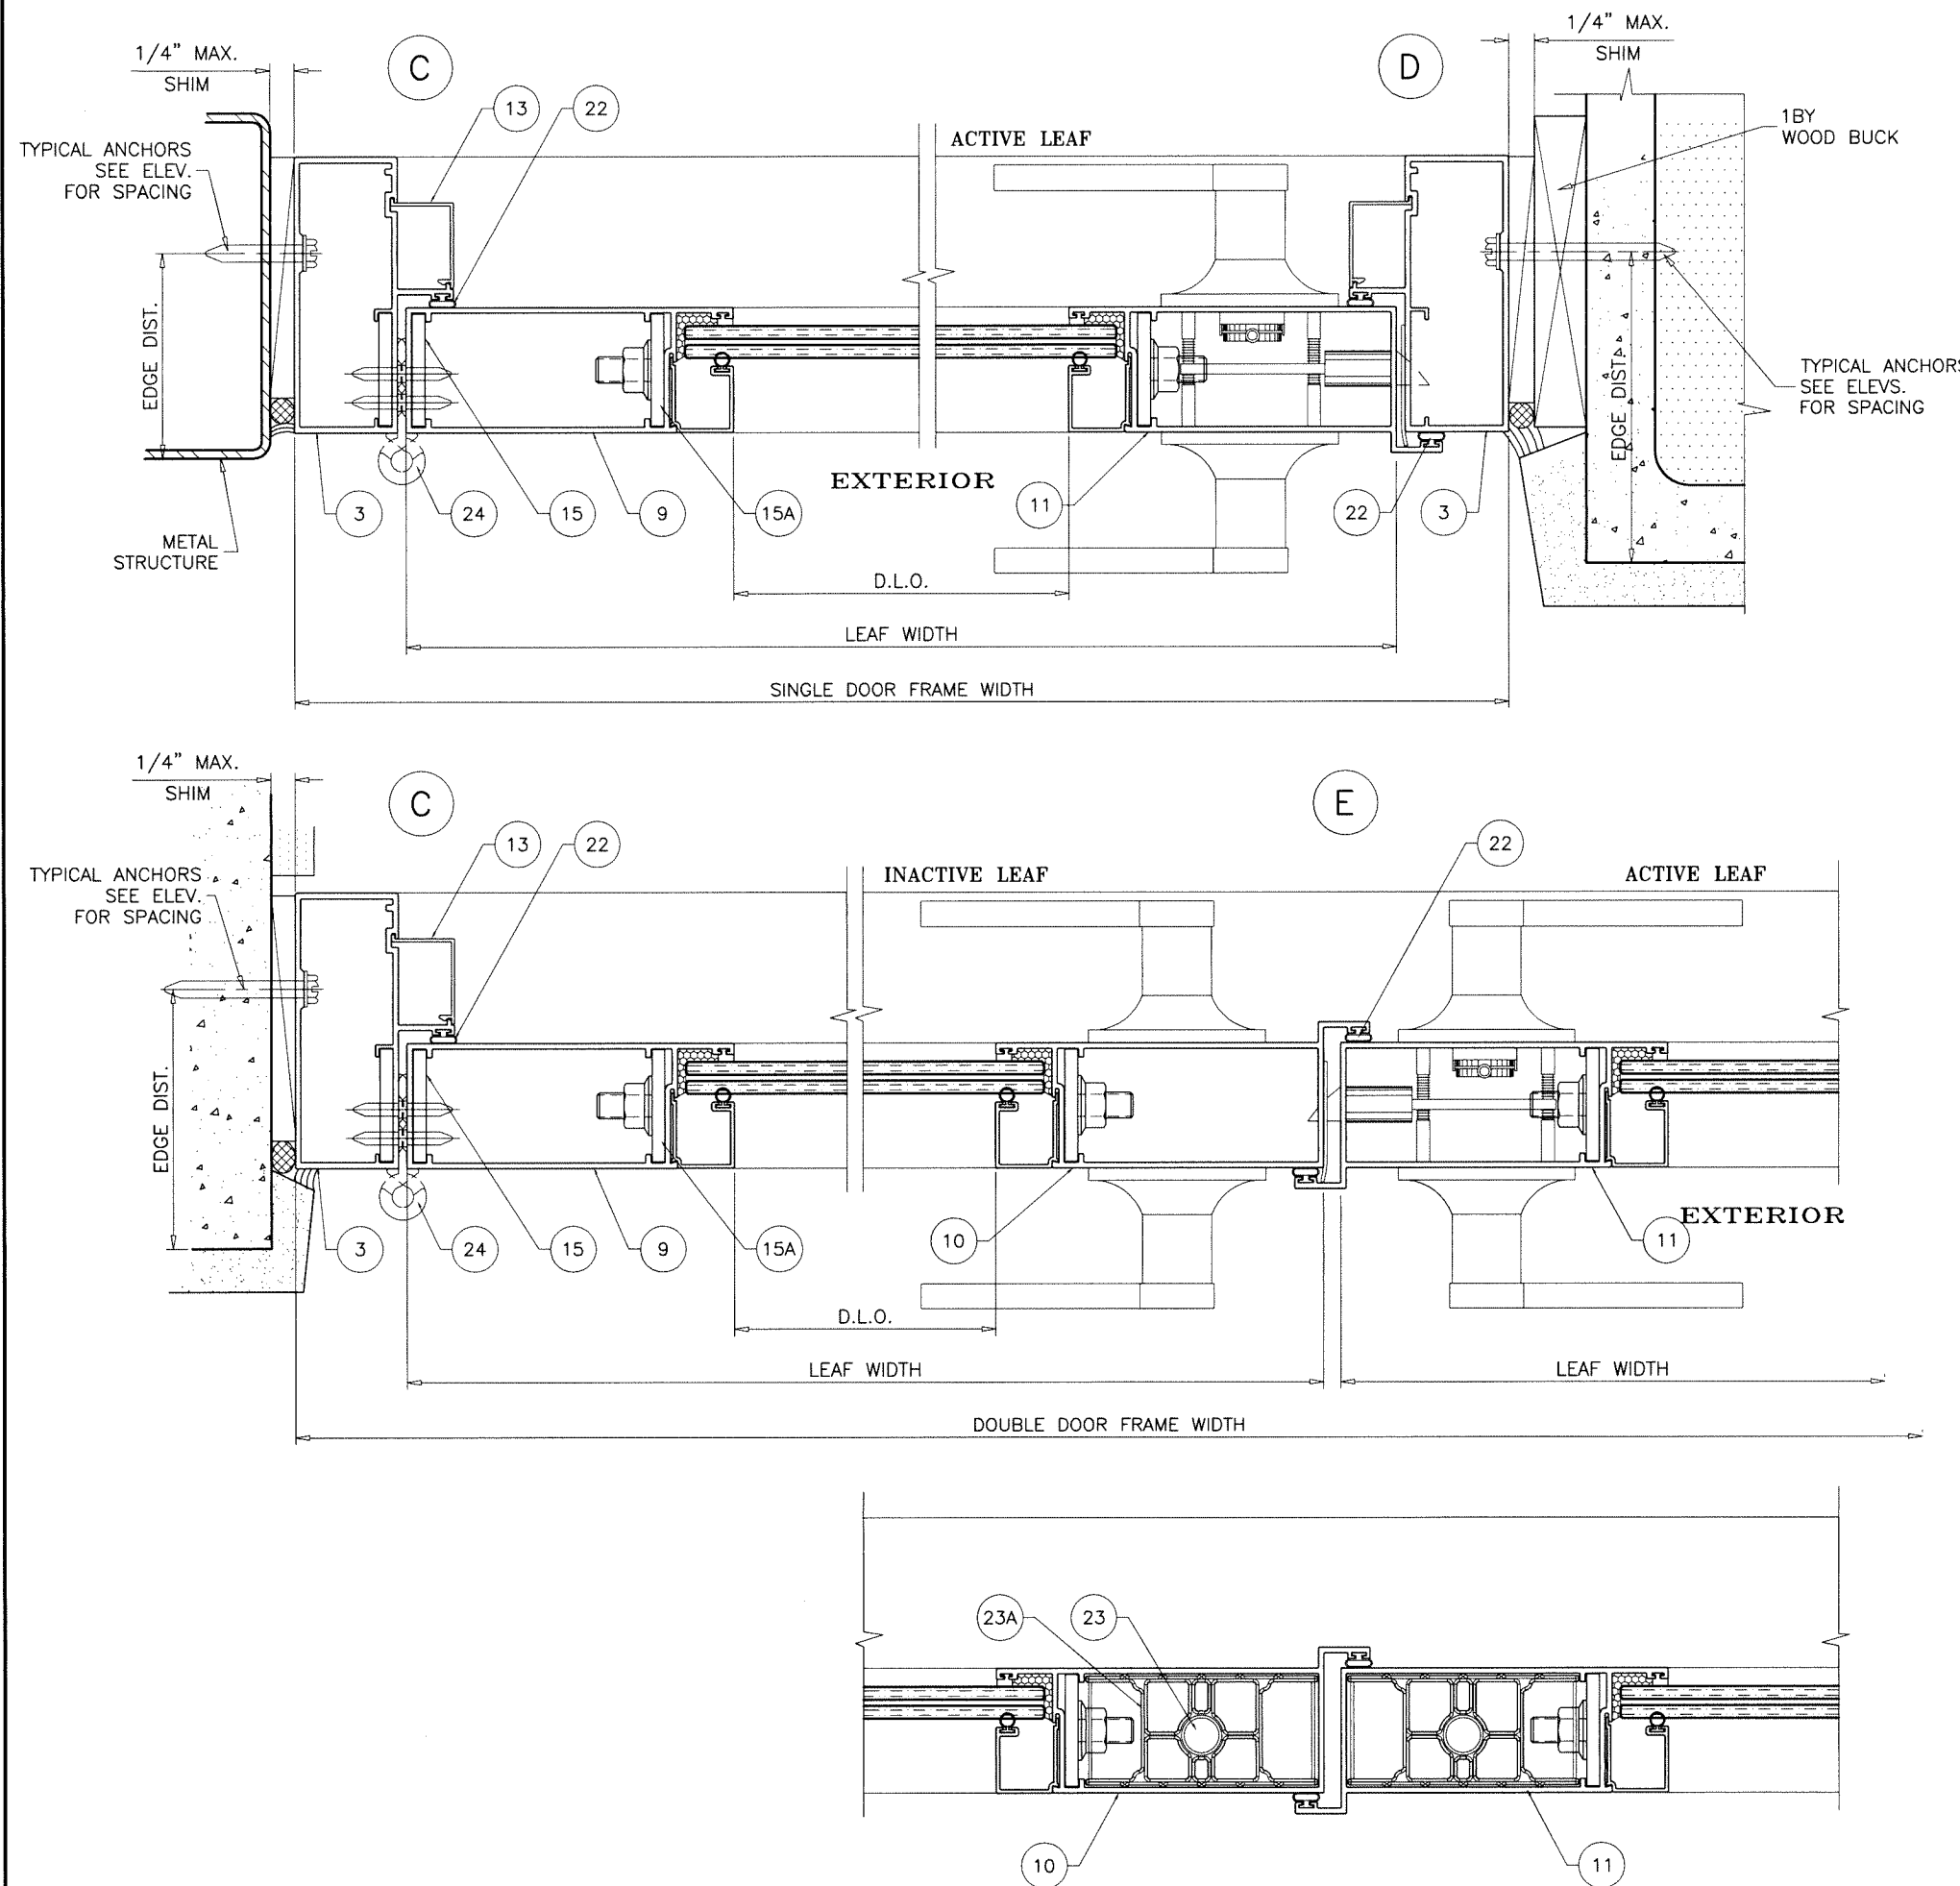

Sealed: 12/19/2024

DOOR DETAILS



FL #47211

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)

Oasis Shutters, Inc.
226 West 24 Street
Hialeah, FL 33010
Tel. (305) 558-5000 oasishurricanes shutters.com

revisions:	
no	date by description

date: 12-04-24


scale: 3/8" = 1"

dr. by: TARIQ


chk. by:

drawing no.
24-94F

sheet 6 of 10

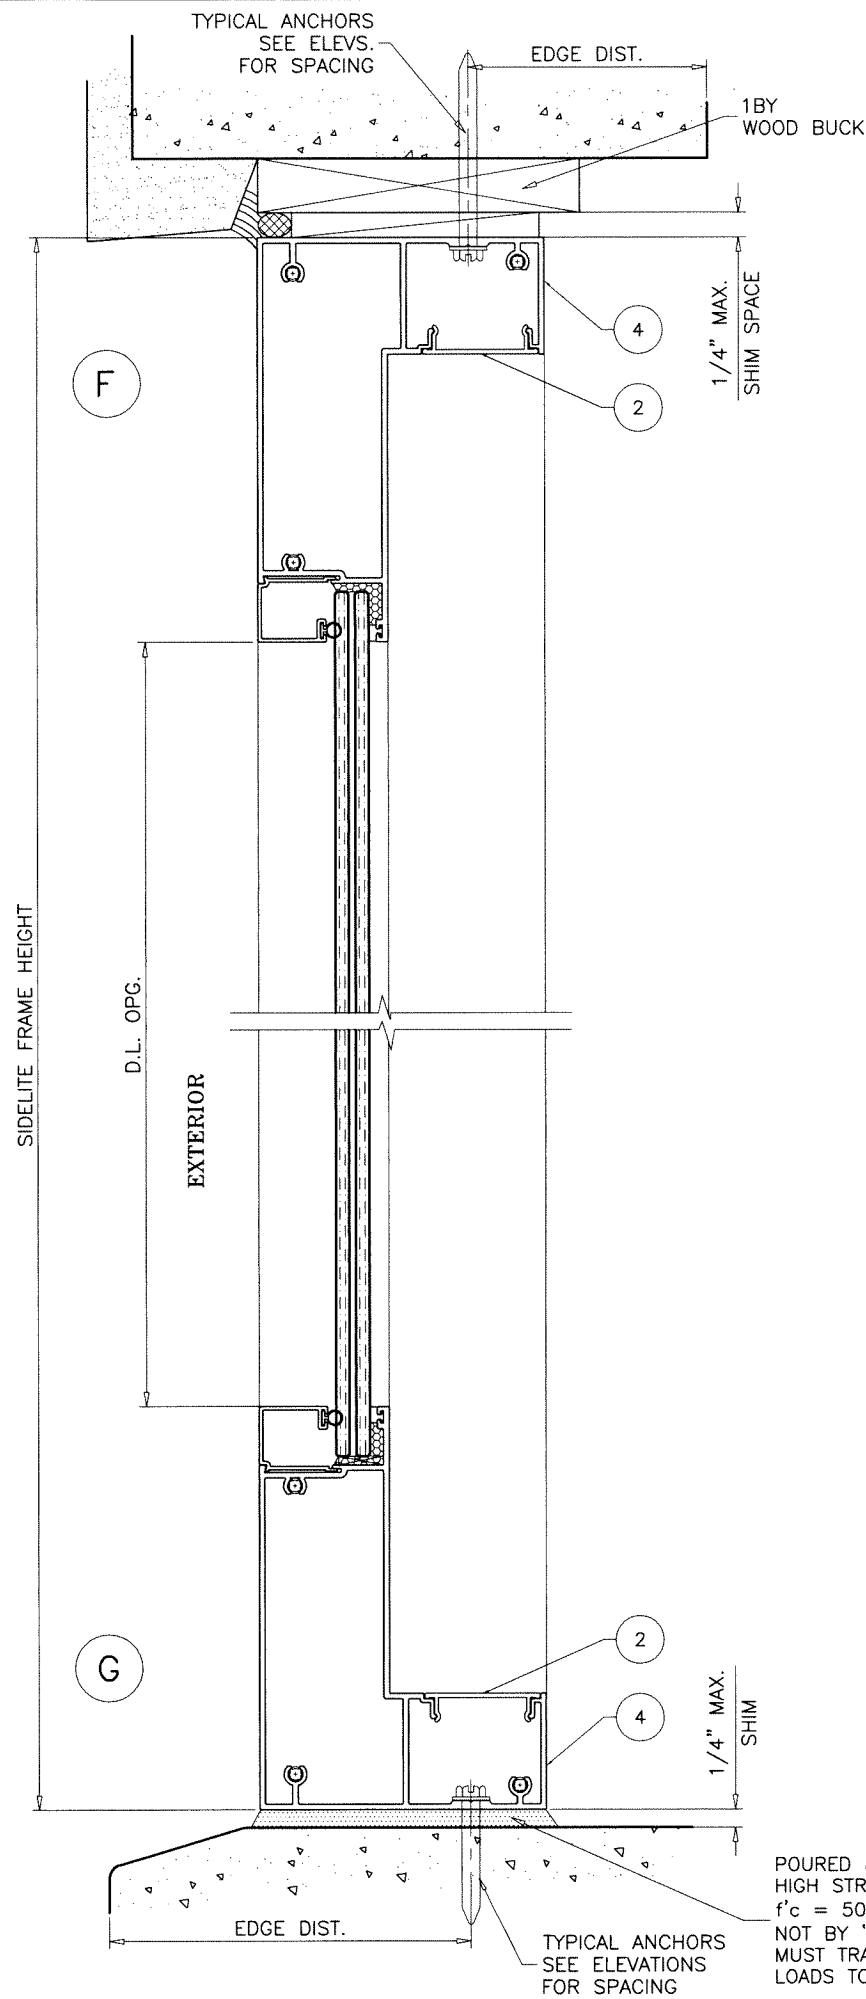


SIDELITES CAN BE INSTALLED IN ALL SUBSTRATES SHOWN ON SHEETS 5 AND 6.

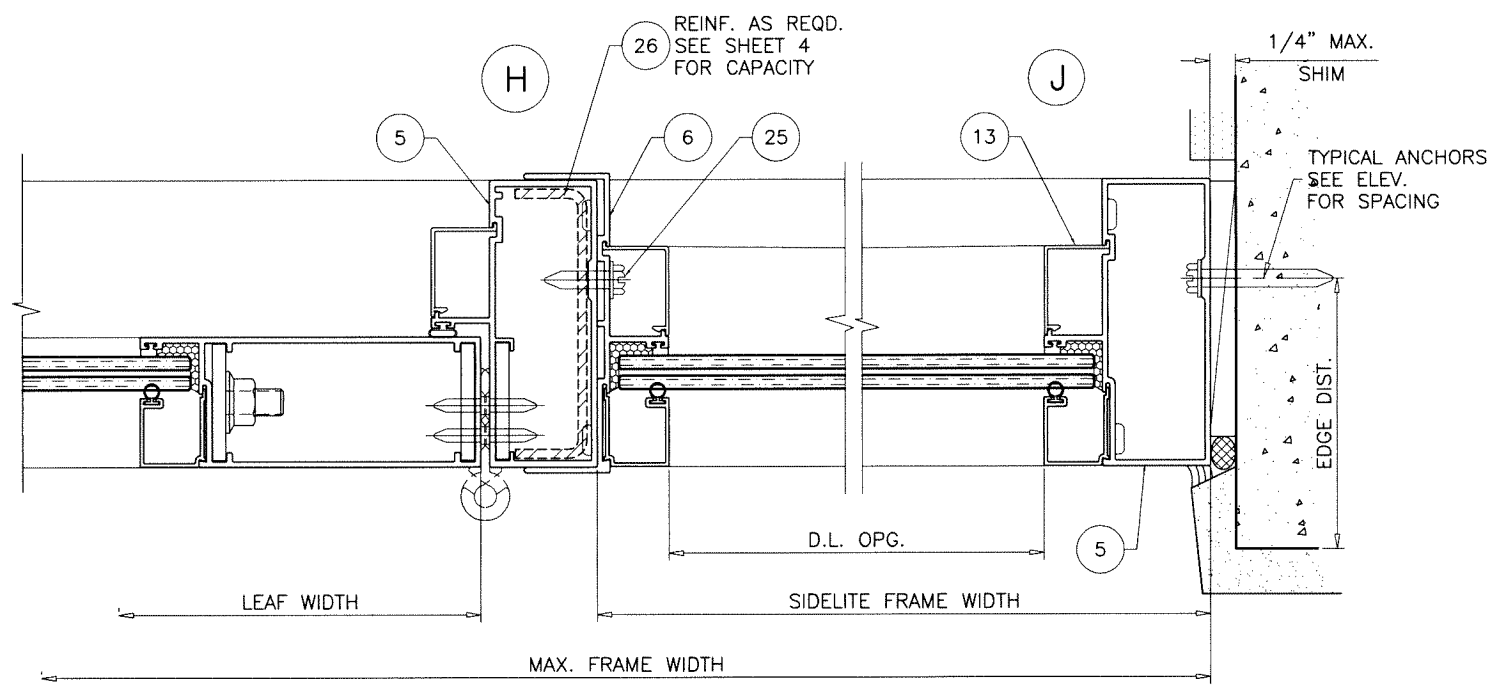

SIDELITE DETAILS

Sealed: 12/19/2024

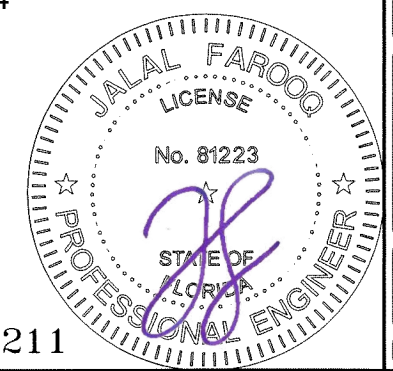

FL #47211

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

COMP-ANL\24-94F-OSI

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)

Oasis Shutters, Inc.
226 West 24 Street
Hialeah, FL. 33010
Tel. (305) 558-5000
oasishurricanes shutters.com


















revisions:

no	date	description

date: 12-04-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
24-94F

sheet 7 of 10

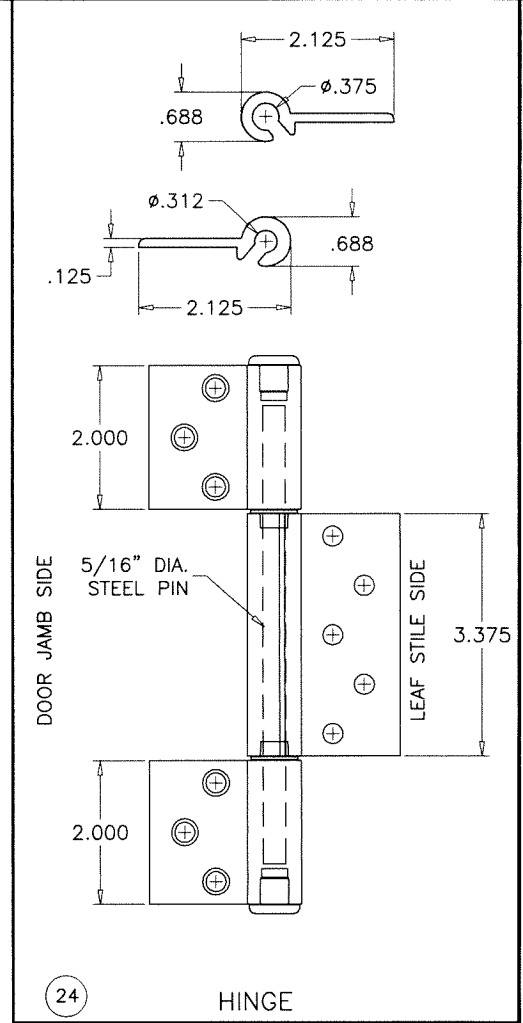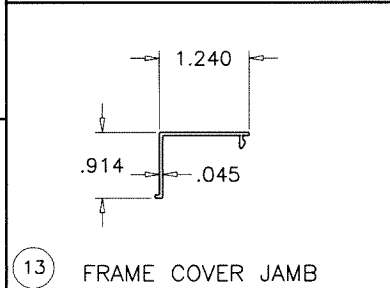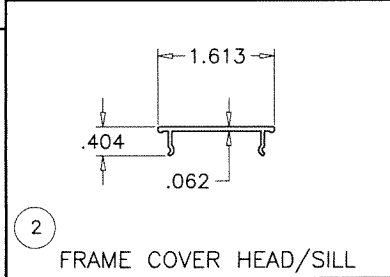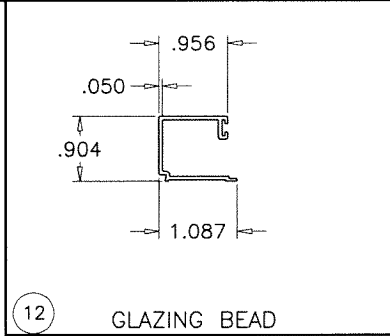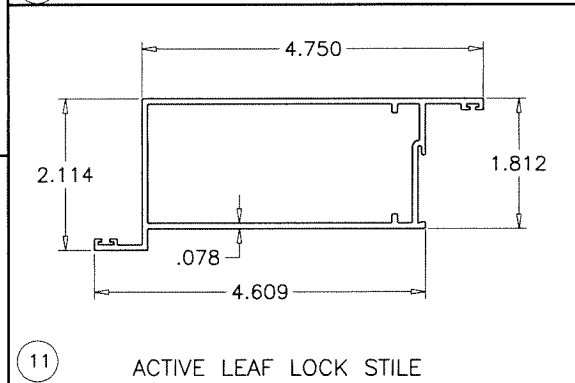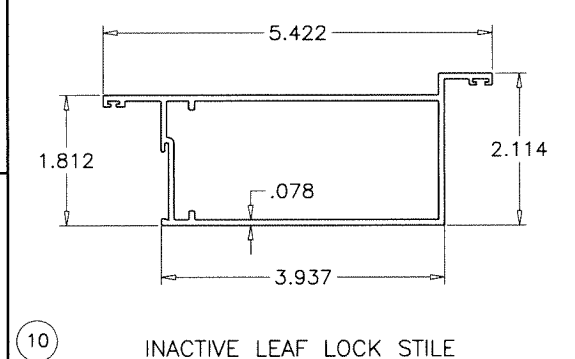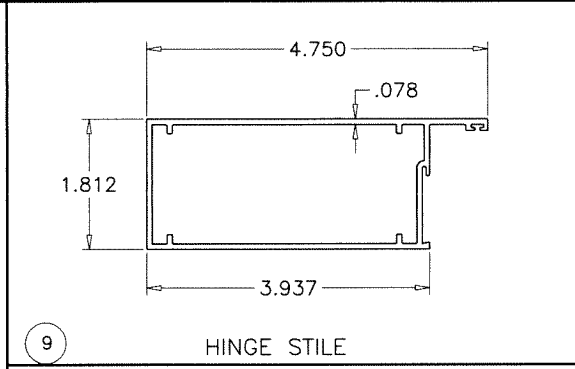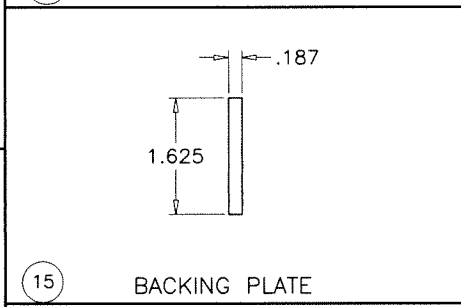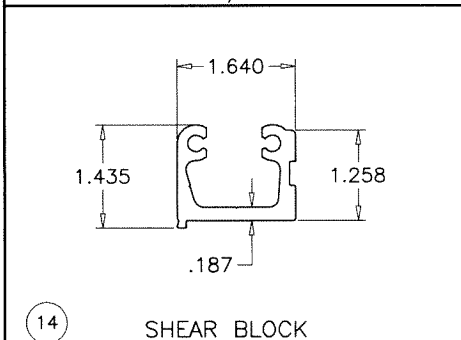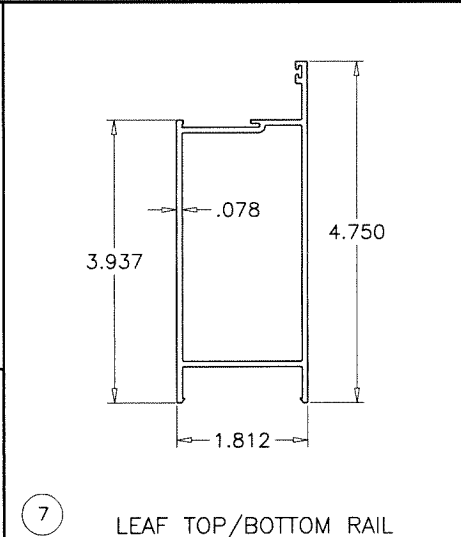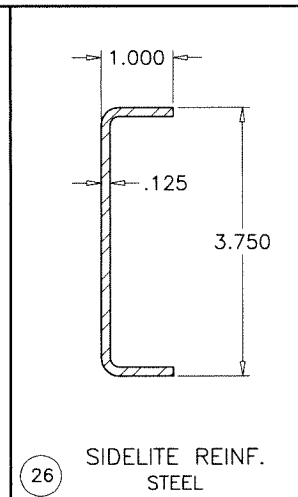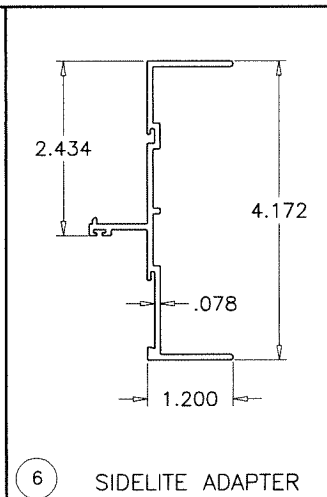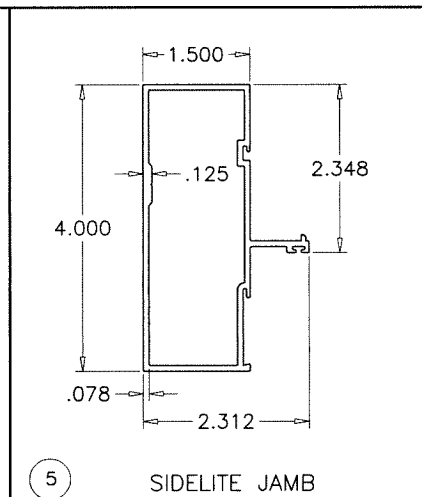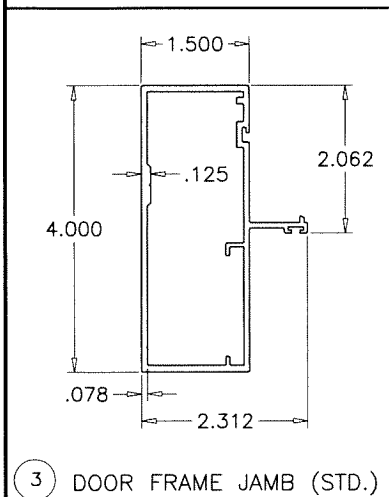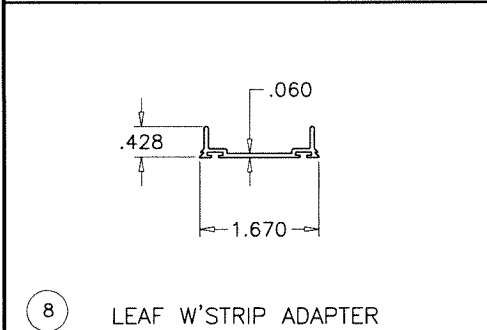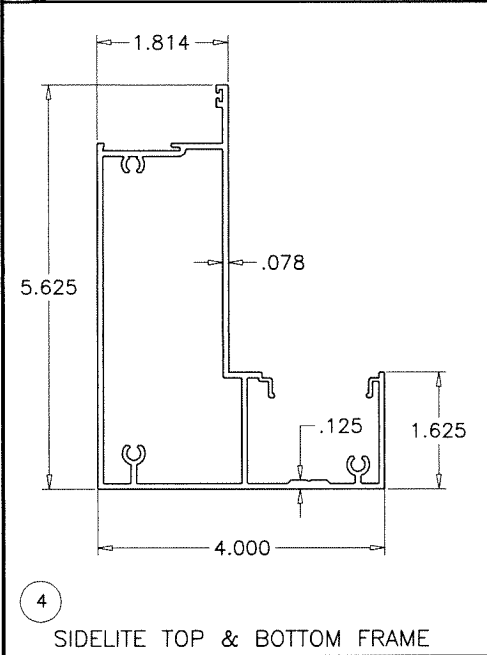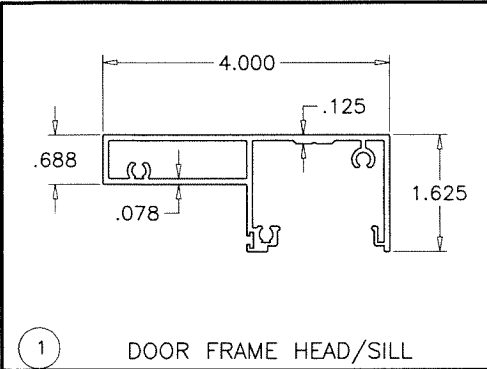

Sealed: 12/19/2024



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)

Oasis Shutters, Inc.
226 West 24 Street
Hialeah, FL 33010
Tel. (305) 558-5000 oasishurricanes shutters.com

revisions:	
no	description

date: 12-04-24

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:

drawing no.

24-94F

sheet 8 of 10

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	OS-120	AS REQD.	DOOR FRAME HEAD/SILL	6063-T6	-
2	OS-122	AS REQD.	FRAME COVER HEAD/SILL	6063-T6	-
3	OS-124	AS REQD.	DOOR FRAME JAMB	6063-T6	-
4	OS-121	AS REQD.	SIDELITE FRAME HEAD/SILL	6063-T6	-
5	OS-009	AS REQD.	SIDELITE JAMB	6063-T6	-
6	OS-010	AS REQD.	SIDELITE ADAPTER	6063-T6	-
7	OS-006	AS REQD.	PANEL LEAF TOP/BOTTOM	6063-T6	-
8	OS-013	AS REQD.	LEAF W'STRIP ADAPTER	6063-T6	-
8A	#8 X 3/4"	AS REQD.	ADAPTER FASTENERS AT EACH END	CRS/ZINC	FH SELF DRILLING
9	OS-004	AS REQD.	HINGE STILE	6063-T6	-
10	OS-011	AS REQD.	INACTIVE LEAF LOCK STILE	6063-T6	-
11	OS-012	AS REQD.	ACTIVE LEAF LOCK STILE	6063-T6	-
12	OS-123	AS REQD.	GLAZING BEAD	6063-T6	-
13	OS-003	AS REQD.	DOOR JAMB/SIDELITE COVER	6063-T6	-
14	OS-014	AS REQD.	SHEAR BLOCK	6063-T6	-
14A	#10 X 1-1/2"	AS REQD.	SHEAR BLOCK FASTENERS	CRS/ZINC	HH SMS
15	-	AS REQD.	BACKING PLATE AT HINGE, 8" LONG	6063-T6	-
15A	-	AS REQD.	BACKING PLATE AT CORNER, 4" LONG	6063-T6	-
16	-	2/ LITE	SETTING BLOCK, 1/8" X 5/8" X 4" LONG , AT QUARTER POINTS	EPDM	DUROMETER 80±5, SHORE A
17	#12 X 1-1/2"	AS REQD.	FRAME ASSEMBLY FASTENERS	CRS/ZINC	HH SMS
18	-	2/PANEL	3/8" DIA. THREADED ROD WITH HEX WASHER HEAD NUT	STEEL	-
19	86262	AS REQD.	INTERIOR GLAZING GASKET	EPDM	MELTPPOINT
20	W3321N6000	AS REQD.	FIN SEAL W'STRIPPING (.187" X .320")	WOOL	ULTRAFAB
21	83040	AS REQD.	EXTERIOR BULB GASKET	TPV/POLYPROPYLENE	MELTPPOINT
22	83040	AS REQD.	BULB W'STRIPPING	TPV/POLYPROPYLENE	MELTPPOINT
23	-	2/ LEAF	FLUSH BOLTS AT TOP & BOTTOM	-	SULLIVAN & ASSOC.
23A	-	2/ LEAF	FLUSH BOLT GUIDE, AT TOP AND BOTTOM	NYLON	-
24	-	3/ LEAF	HINGES	ALUMINUM	SULLIVAN & ASSOC.
25	#12 X 1"	AS REQD.	SIDELITE ADAPTER FASTENERS, AT 6" FROM ENDS & 12" O.C. MAX.	CRS/ZINC	HH SELF DRILLING
26	-	AS REQD.	SIDELITE REINF. CHANNEL	STEEL	A36, Fu MIN. = 58 KSI

LOCKS:

ACTIVE LEAF:

SURFACE MOUNT DEAD BOLT LOCK BY 'SCHLAGE' AT 44" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR FASTENED TO ACTIVE LEAF LOCK STILE WITH (2) #10-32-28 X 2-3/8" OH MS LEVER TYPE METALLIC HANDLE AT 38-1/2" FROM BOTTOM, FASTENED TO ACTIVE LEAF LOCK STILE WITH (2) #8-32 X 1" PH MS.

SURFACE BOLTS BY 'SULLIVAN & ASSOC.' MANUALLY OPERATED LEVERS MOUNTED ON STILE FACE, LOCATED AT 12" AND 68" FROM BOTTOM FASTENED TO LOCK STILE WITH #8 X 3/4" FH SMS (2) SCREWS PER BOLT

INACTIVE LEAF

CONCEALED FLUSH BOLTS BY 'SULLIVAN & ASSOC.' MANUALLY OPERATED LEVERS MOUNTED ON INSIDE FACE OF LEAF STILE LOCATED AT 28" FROM TOP AND 12" FROM BOTTOM FASTENED TO LOCK STILE WITH #8 X 3/4" FH SMS (2) PER BOLT


HINGES:

(3) 7-1/2" LONG ALUMINUM BUTT HINGES F107 BY 'SULLIVAN & ASSOC.' TOP AND BOTTOM HINGES AT 8" FROM ENDS INTERMEDIATE HINGES EQUALLY SPACED FASTENED TO FRAME WITH (6) #10 X 3/4" FH SELF DRILLING SCREWS FASTENED TO LEAF WITH (5) #10 X 3/4" PH SELF DRILLING SCREWS

SEALANTS:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.

Sealed: 12/19/2024

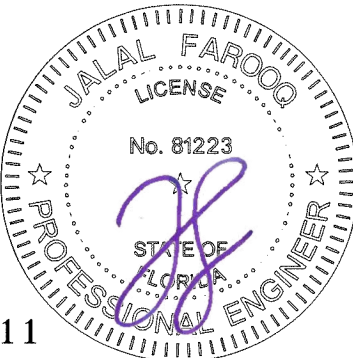

FL #47211



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)

Oasis Shutters, Inc.
226 West 24 Street
Hialeah, FL. 33010
Tel. (305) 558-5000 oasishurricanes shutters.com

revisions:

no	date	by	description

date: 12-04-24

scale: 3/8" = 1"


dr. by: TARIQ

chk. by:


drawing no.

24-94F


sheet 9 of 10

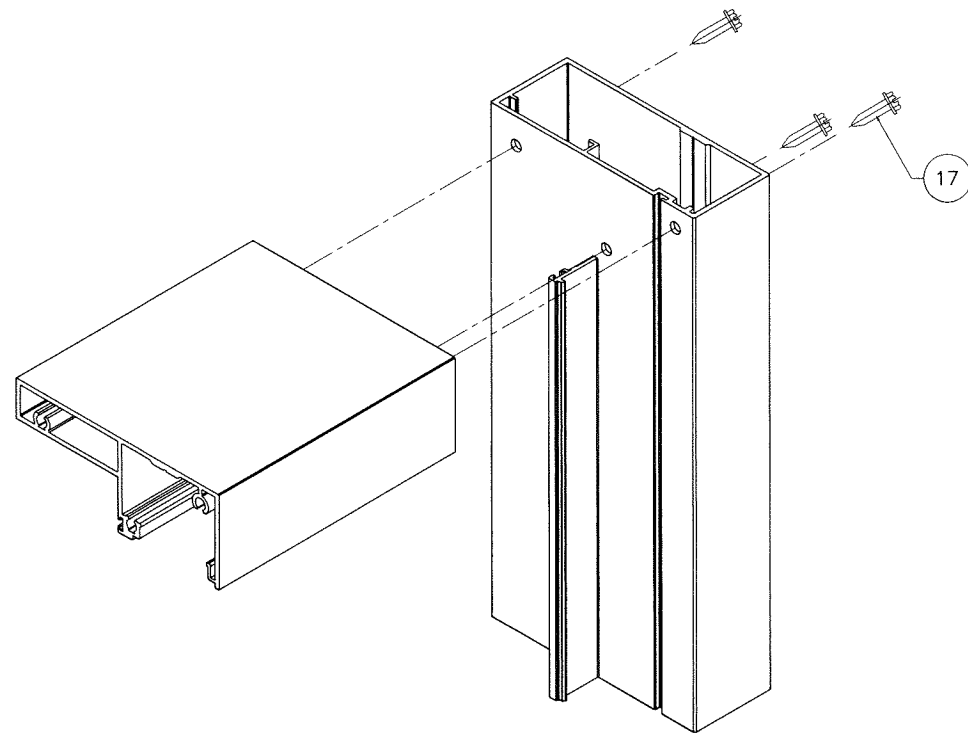

DOOR FRAME CORNER

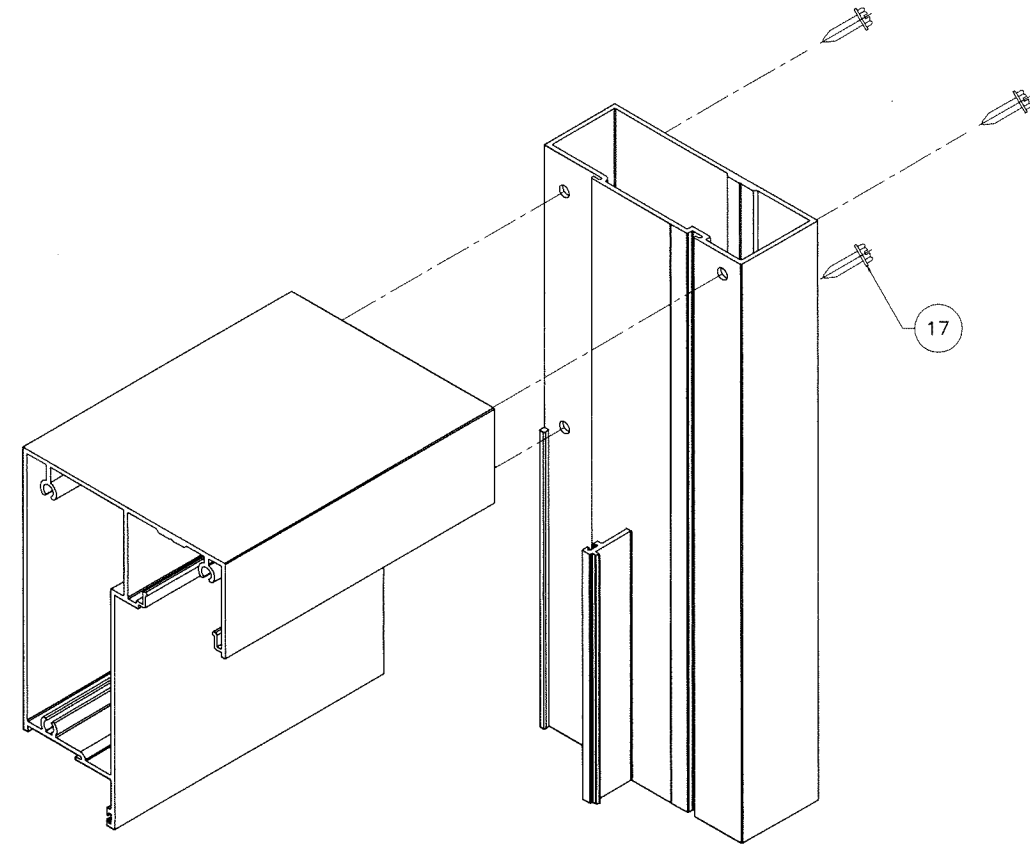


SIDELITE FRAME CORNER

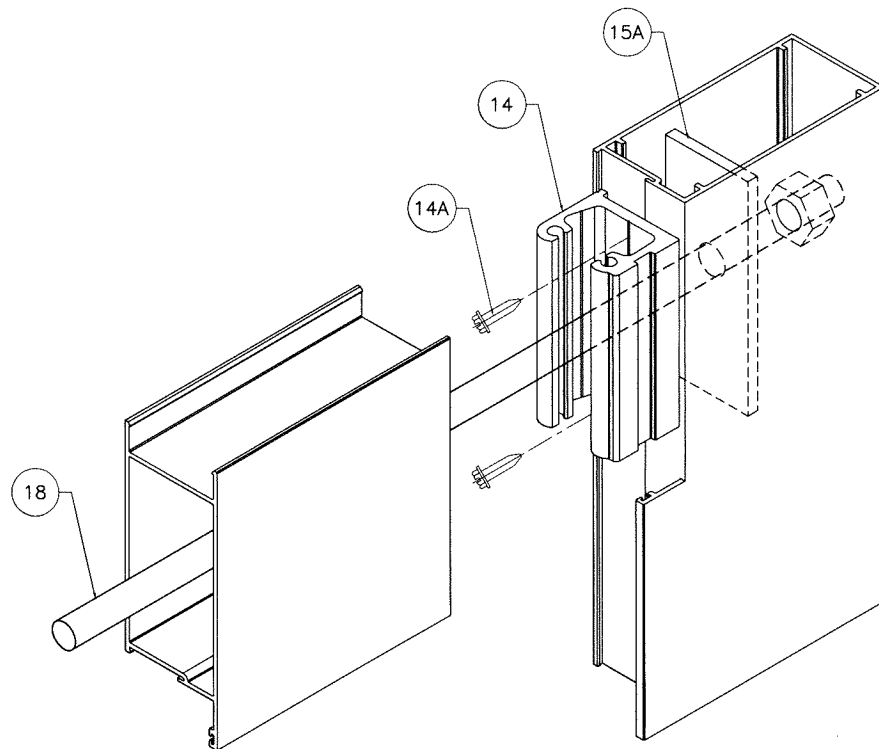

LEAF CORNER

Sealed: 12/19/2024

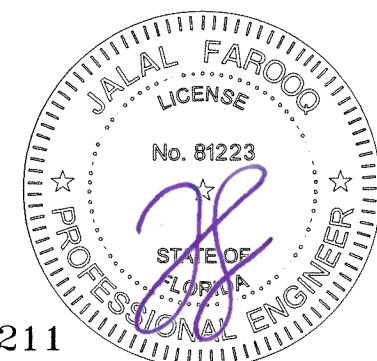

FL #47211

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

COMP-ANL\24-94F-OSI

RESIDENTIAL OUTSWING DOOR W/ SIDELITES (L.M.I.)

Oasis Shutters, Inc.
226 West 24 Street
Hialeah, FL. 33010
Tel. (305) 558-5000 oasishurricanes shutters.com

revisions:	
no	date by description

date: 12-04-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
24-94F
sheet 10 of 10