

FASTENERS AND CONNECTORS (AS APPLICABLE) SHOWN IN THIS APPROVAL MAY NOT MEET CORROSION RESISTANCE REQUIREMENTS FOR COASTAL OR SALT WATER EXPOSURE ZONES. COMPLIANCE WITH THESE CONDITIONS TO BE CHECKED PER FBC 1711.

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

MG-5500
ALUMINUM OUTSWING ENTRANCE DOOR

SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF SINGLE (X) AND DOUBLE (XX) DOORS.
SEE SHEET 3 FOR SINGLE (O/X) AND DOUBLE (O/XX) DOORS WITH TRANSOM.

DOORS CAN ALSO BE USED WITH 'MR. GLASS' SERIES-5500 WINDOW WALL SYSTEM UNDER SEPARATE APPROVAL.
SEE SEPARATE NOA FOR 'MR. GLASS' SERIES-5500 WINDOW WALL DOOR MULLION CAPACITIES.
LOWER VALUES FROM DOOR CAPACITY CHARTS OR WINDOW WALL APPROVAL WILL APPLY TO ENTIRE SYSTEM.

DOORS WITH HIGH SILL APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.
DOORS WITH ADA SILL NOT APPROVED FOR WATER INFILTRATION RESISTANCE.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION)/2026 (9TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.


ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.
ALL SHIMS TO BE LOAD-BEARING, (HIGH DENSITY PLASTIC/COMPOSITE, METAL OR OTHER RIGID MATERIALS).


MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023/2026 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.


DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.
MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

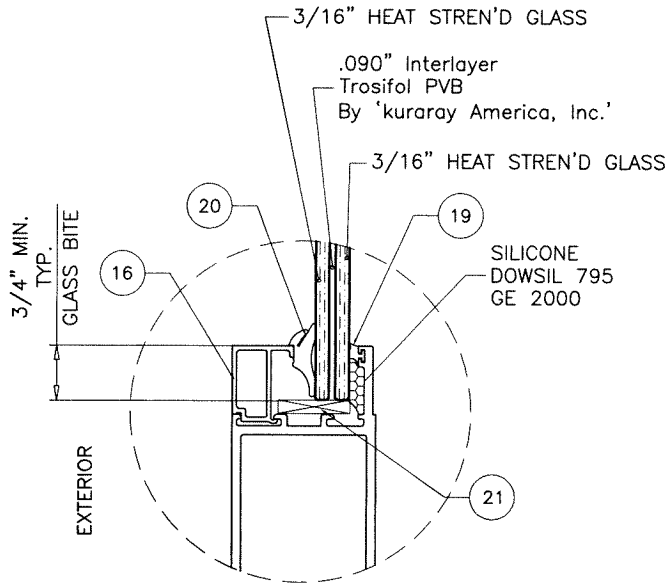

GLASS TYPE 'A' (DOOR)
7/16" INSUL. LAM. GLASS

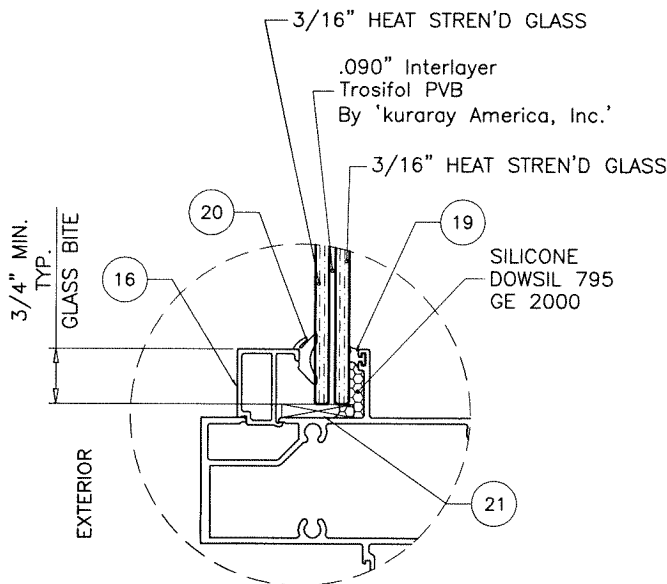

GLASS TYPE 'A' (TRANSOM)
7/16" INSUL. LAM. GLASS

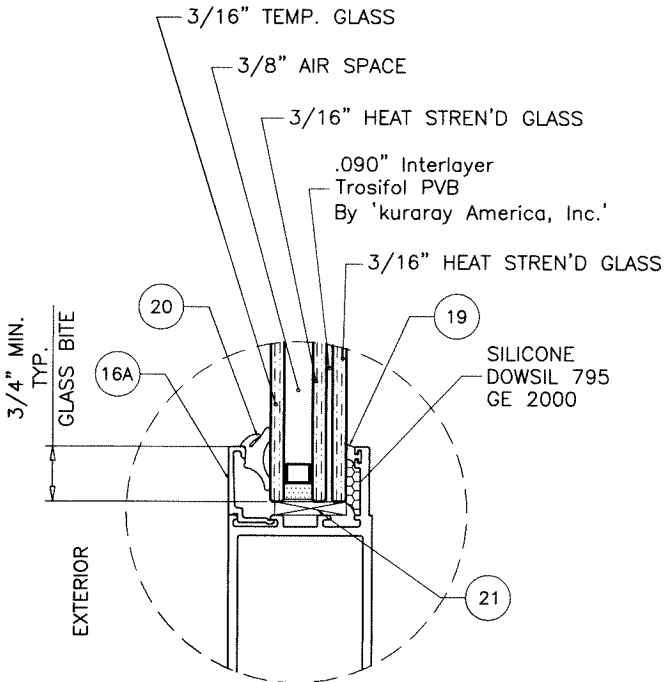

GLASS TYPE 'Ai' (DOOR)
1-1/16" INSUL. LAM. GLASS

GLAZING OPTIONS

Sealed: 09/01/2026

FL #47222


A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT.
B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.



af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538
COMP-ANL\24-97F-MG

MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)
MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963
www.mrglasswindows.com


revisions:
no. date by description
A 09.01.26 UPDATED TO 2026 FBC
date: 12-06-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:
drawing no.
24-97F
sheet 1 of 11

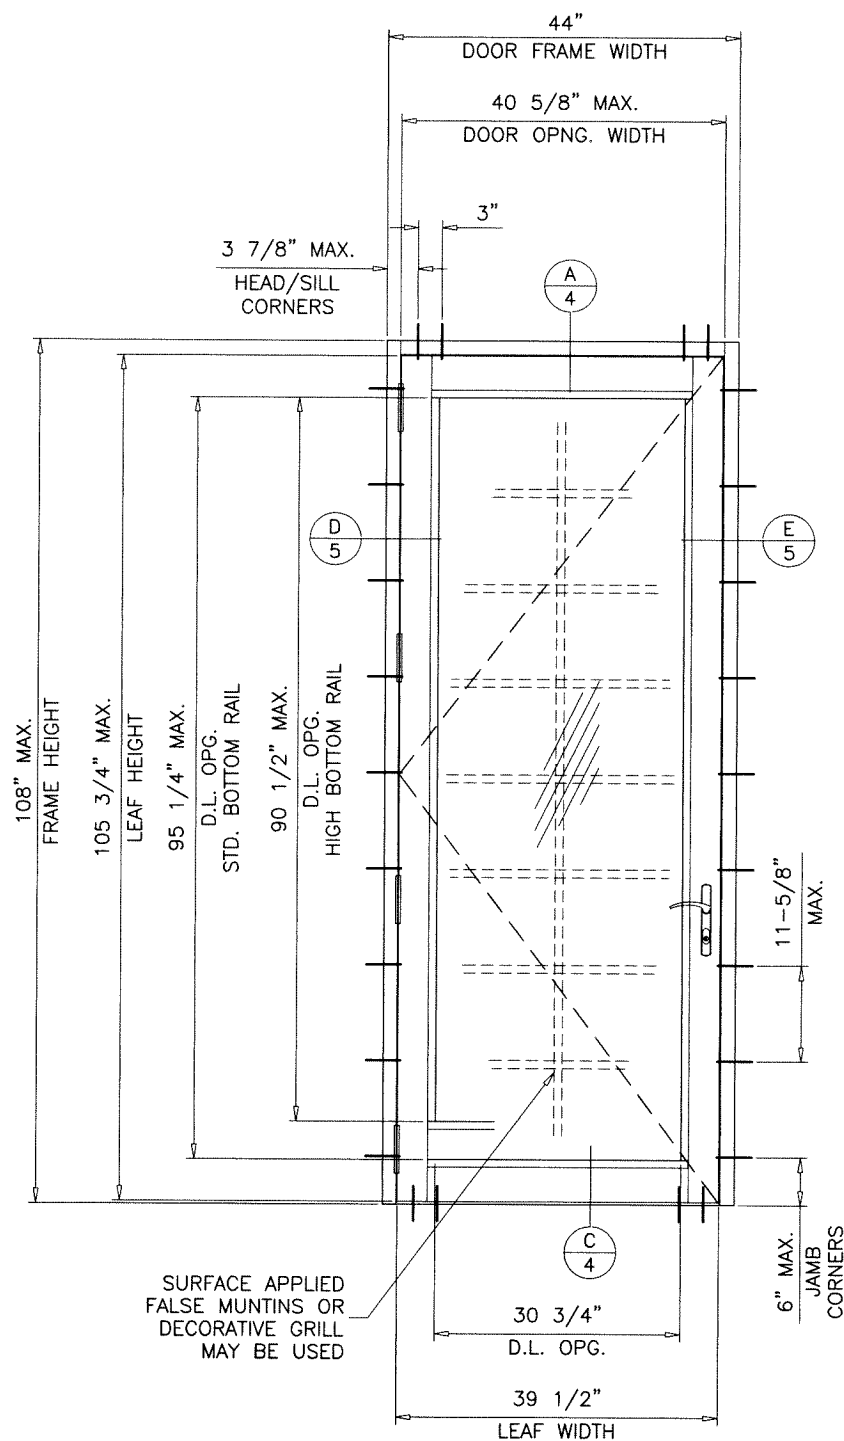

SINGLE (X) DOORS LOAD CAPACITY - PSF						
FRAME DIMS.			LEAF DIMS.		EXT.(+)	INT.(-)
WIDTH	HEIGHT		WIDTH	HEIGHT		
	ADA SILL	HIGH SILL				
44"	108"	109-1/8"	39-1/2"	105-3/4"	80.0	80.0


GLASS D.L.O. FORMULAE: (DOOR)

D.L.O. WIDTH = FRAME WIDTH - 13.25" (X DOORS)
= (FRAME WIDTH - 26.50")/2 (XX DOORS)
D.L.O. HEIGHT = LEAF HEIGHT - 10.50" (STD. BOTTOM RAIL)
LEAF HEIGHT - 15.25" (HIGH BOTTOM RAIL)
DOOR LEAF HEIGHT = FRAME HEIGHT - 2.250" (ADA SILL)
FRAME HEIGHT - 3.375" (HIGH SILL)

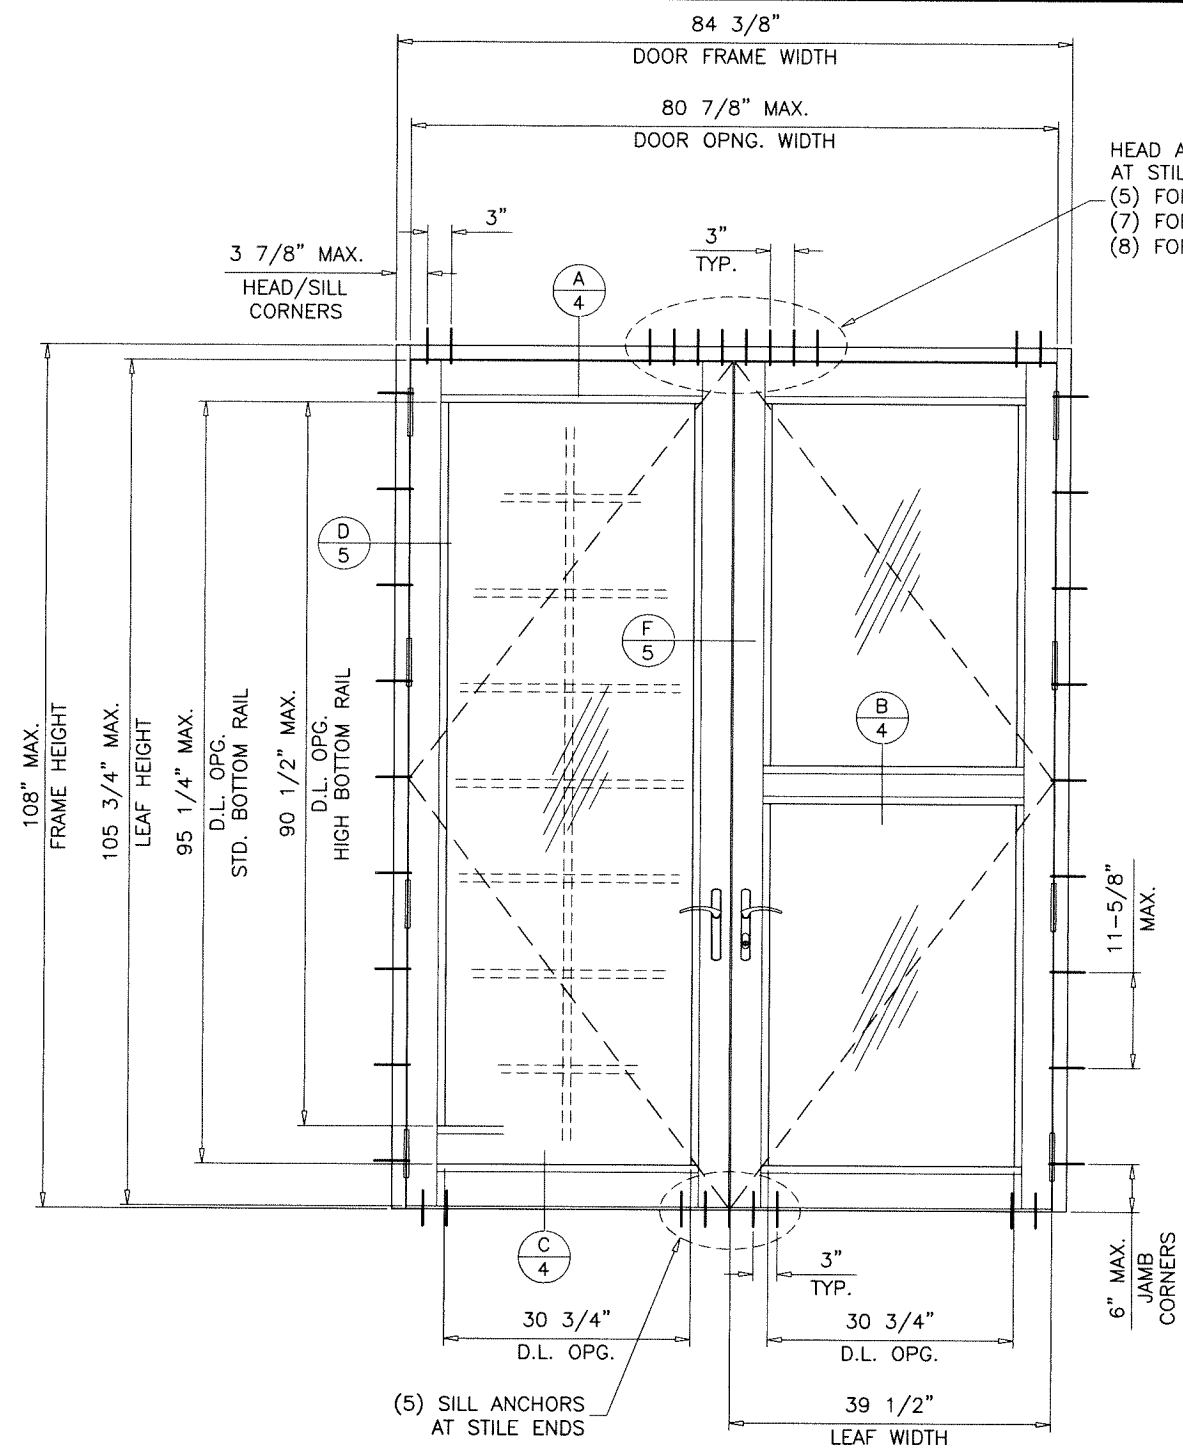


DOUBLE (XX) DOORS LOAD CAPACITY - PSF						
FRAME DIMS.			LEAF DIMS.		EXT.(+)	INT.(-)
WIDTH	HEIGHT		WIDTH	HEIGHT		
	ADA SILL	HIGH SILL				
84-3/8"	108"	109-1/8"	39-1/2"	105-3/4"	80.0	80.0

NOTE:
GLASS CAPACITIES ARE
BASED ON ASTM E1300-16 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

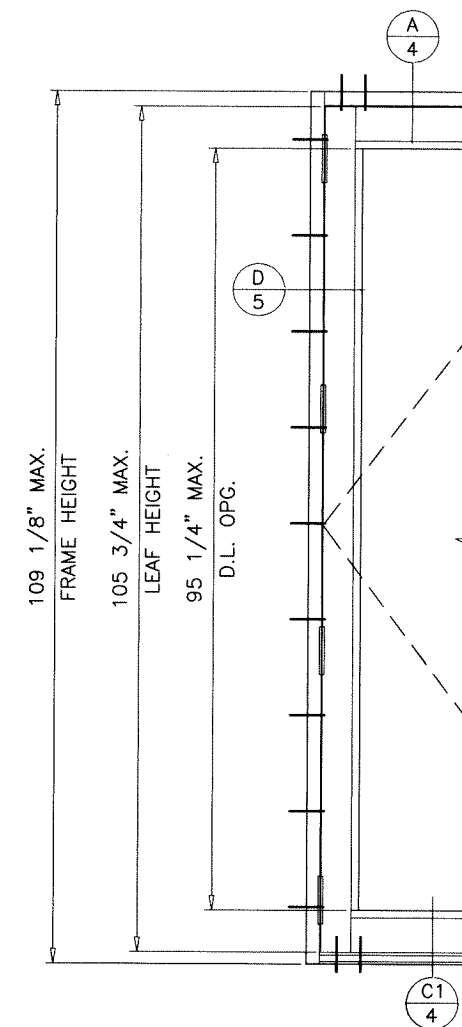

Sealed: 09/01/2026

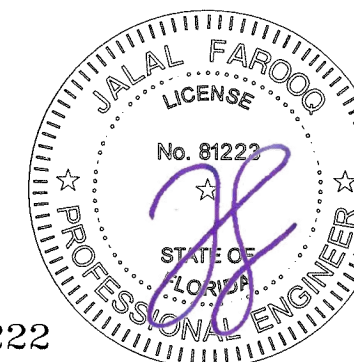


FL #47222

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM

MC-5500 ALUMINUM OUTSWING DOOR (L.M.I.)


MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL 33166
Tel. (305) 764-3963 www.mrglasswindows.com

date: 12-06-24	revisions:
scale: 1/2"=1'-0"	no date by description
dr. by: TARIQ	
chk by:	
drawing no. 24-97F	
sheet 2 of 1	

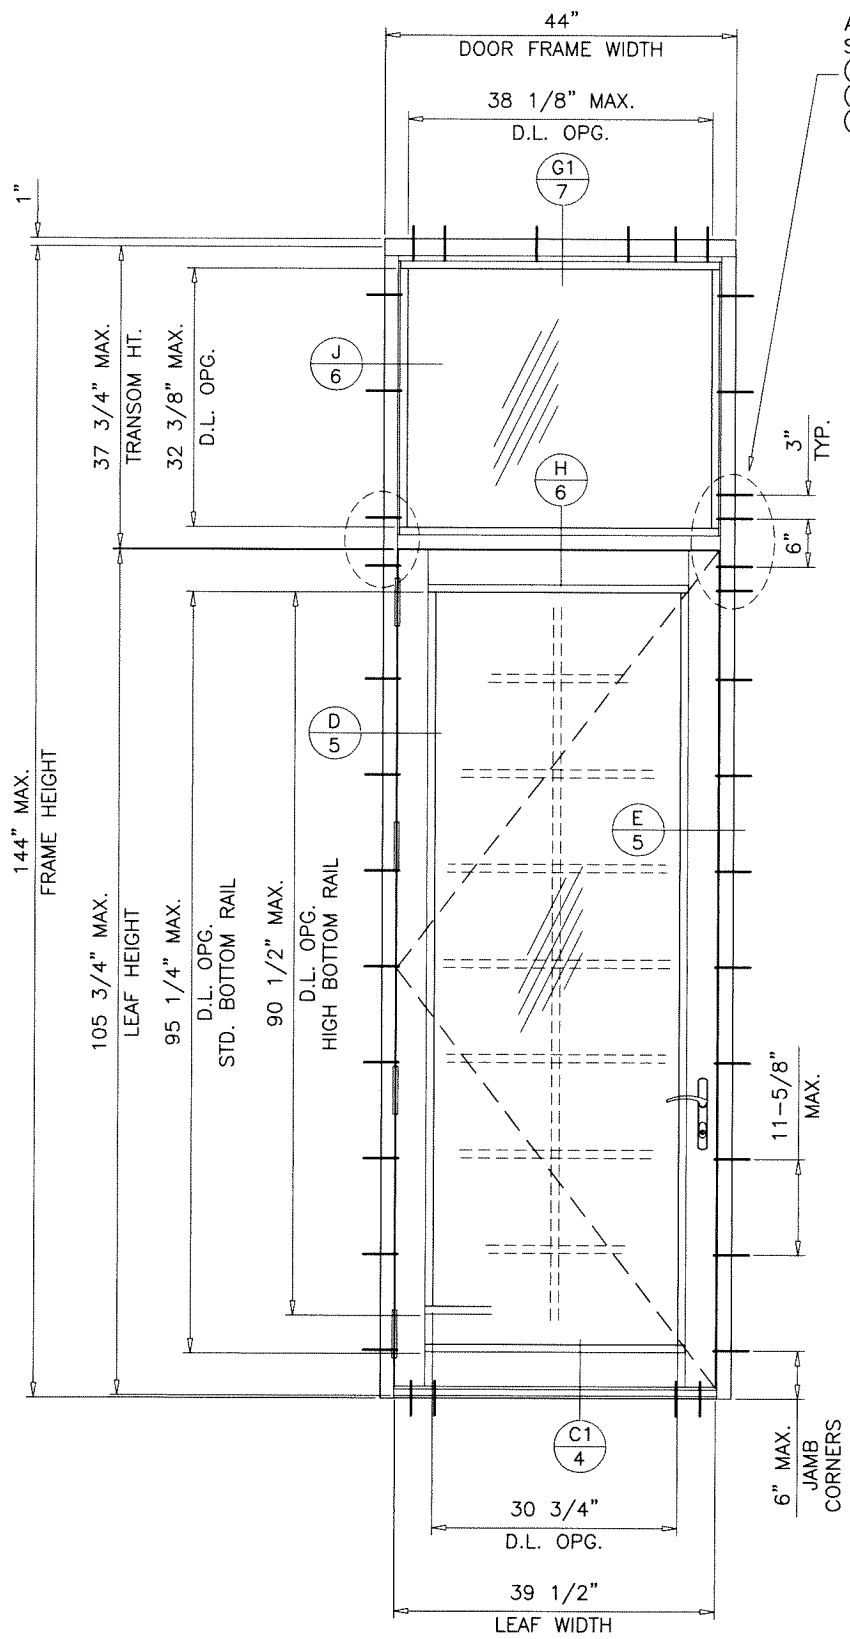


TYPICAL ELEVATION
(O/X)

SINGLE (O/X) DOORS WITH TRANSOM LOAD CAPACITY - PSF						
FRAME DIMS.			LEAF DIMS.		TRANSOM HEIGHT	EXT.(+)
WIDTH	HEIGHT		WIDTH	HEIGHT		
	ADA SILL	HIGH SILL				
44"	108"	109-1/8"	39-1/2"	105-3/4"	37-3/4"	80.0

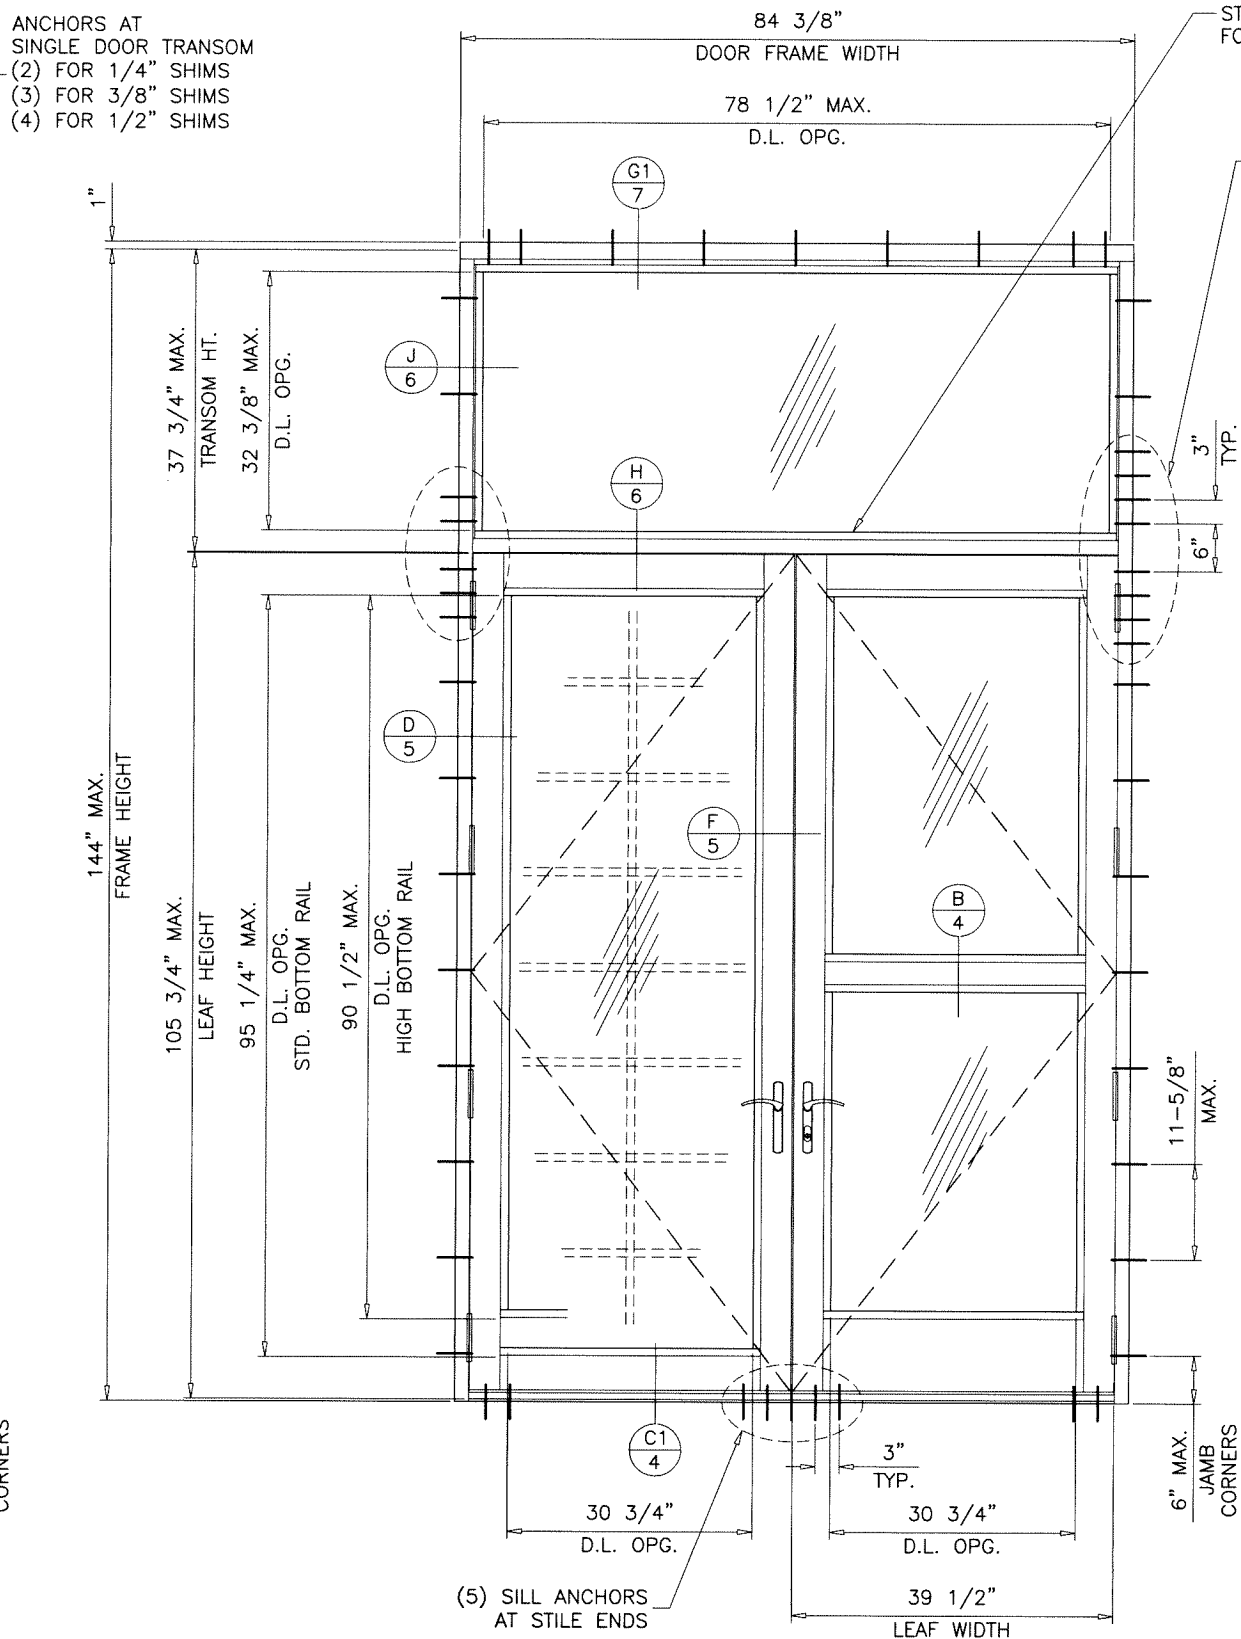


TYPICAL ELEVATION
(O/XX)

DOUBLE (O/XX) DOORS WITH TRANSOM LOAD CAPACITY - PSF							
FRAME DIMS.			LEAF DIMS.		TRANSOM HEIGHT	EXT.(+)	INT.(-)
WIDTH	HEIGHT		WIDTH	HEIGHT			
	ADA SILL	HIGH SILL					
84-3/8"	108"	109-1/8"	39-1/2"	105-3/4"	37-3/4"	80.0	80.0

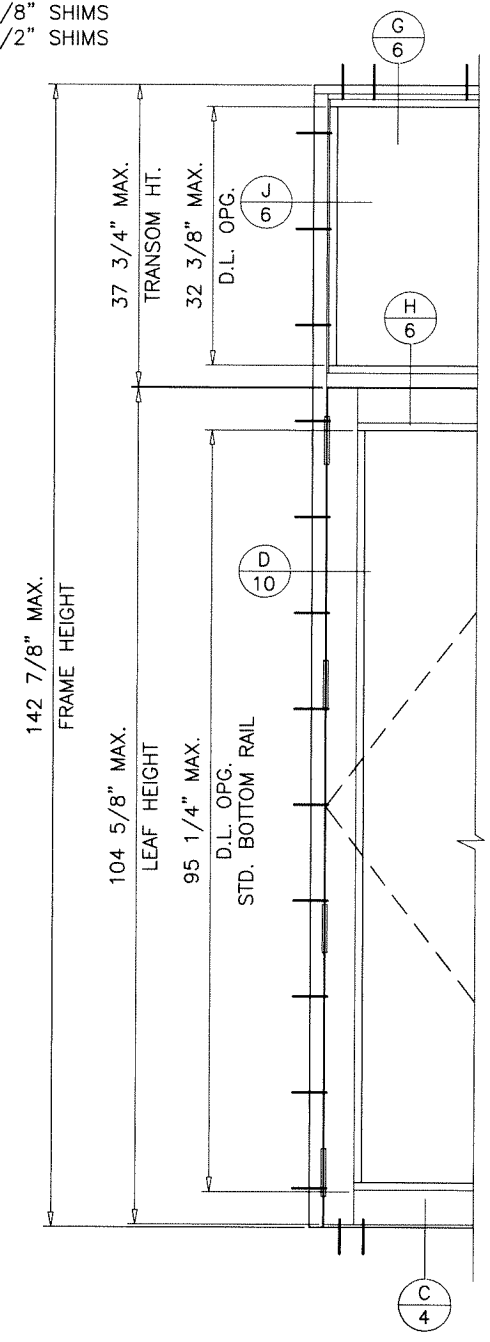

Sealed: 09/01/2026

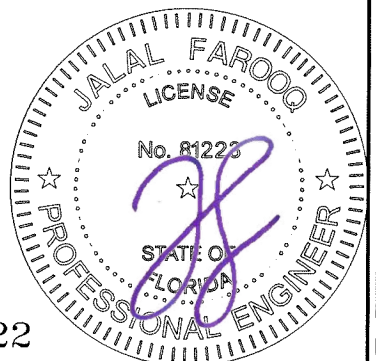

FL #47222

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM

COMP-ANL\24-97F-MG

MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963
www.mrglasswindows.com

FBPE #3538


revisions:

no	date	by	description

date: 12-06-24
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:



drawing no.
24-97F

sheet 3 of 11

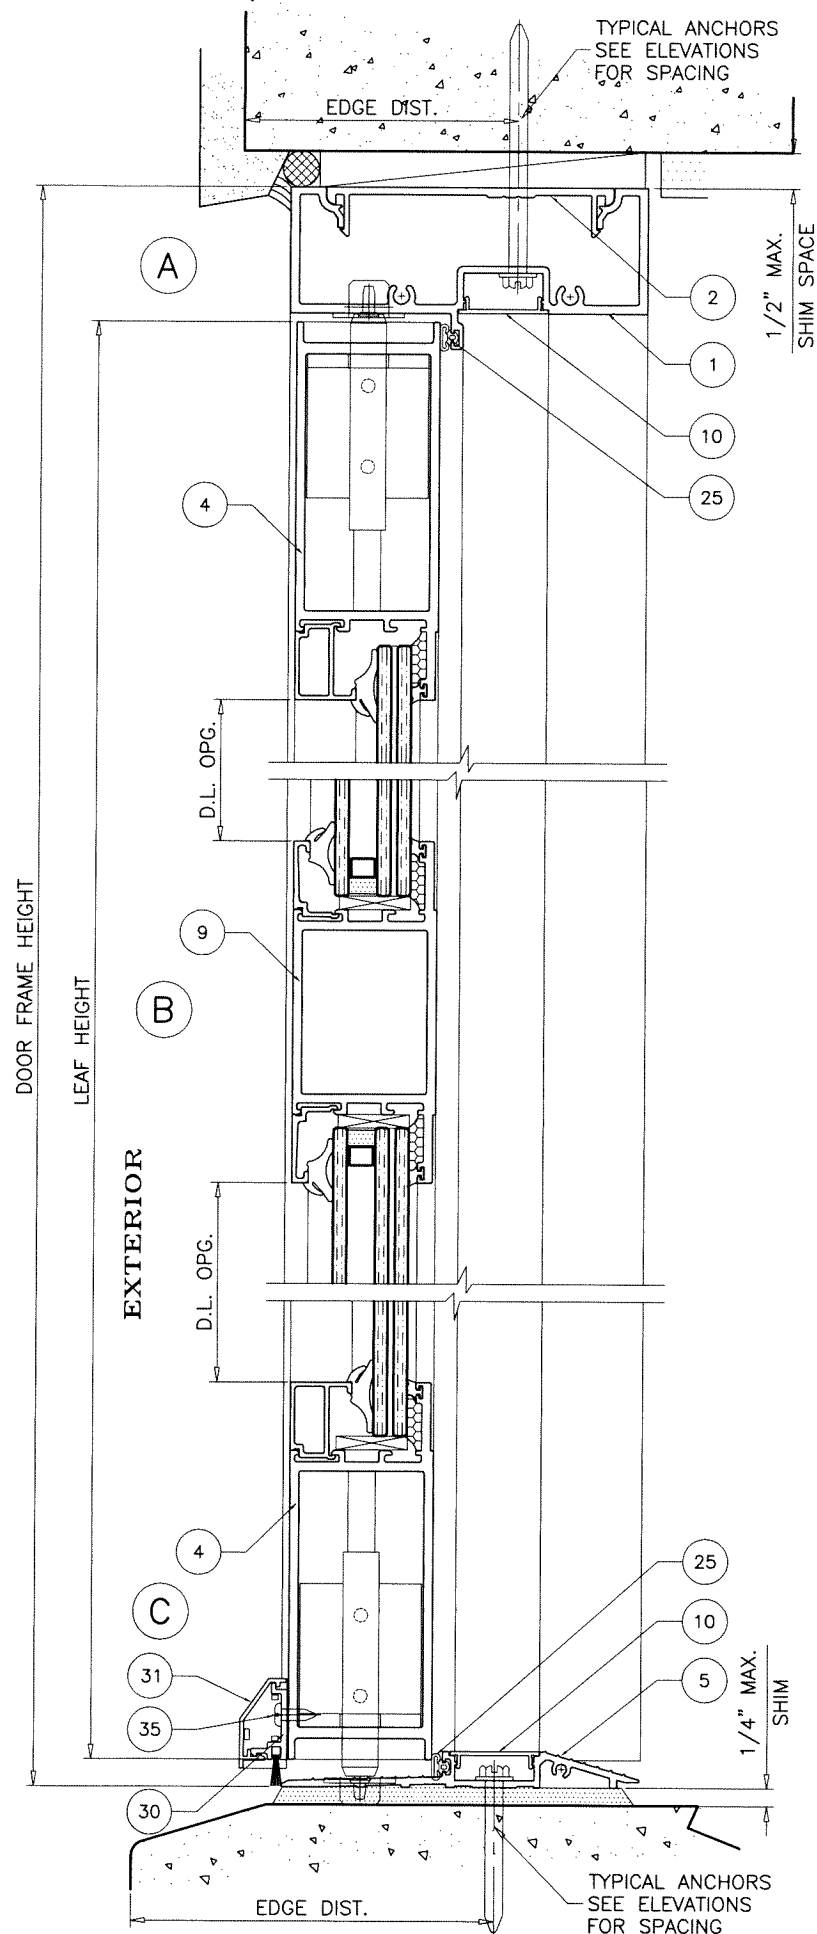

ADA SILL

NOT APPROVED FOR WATER INFILTRATION RESISTANCE

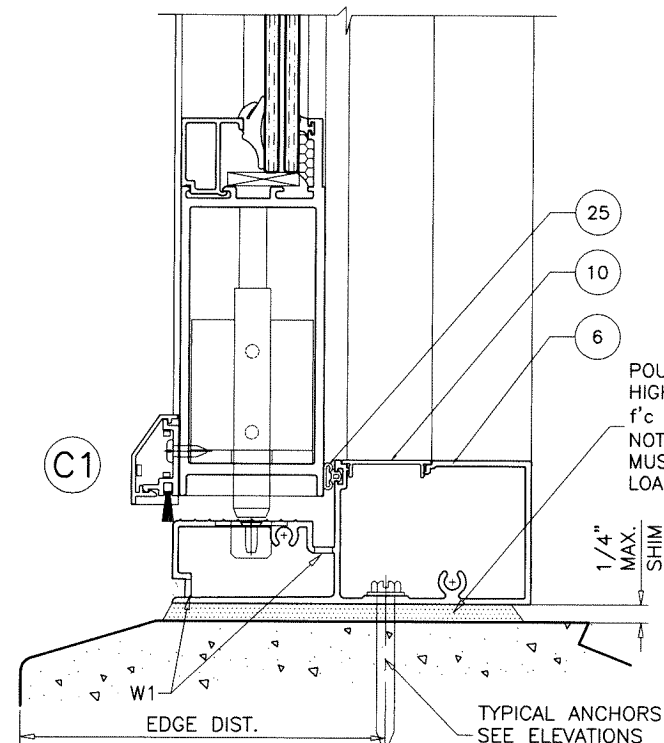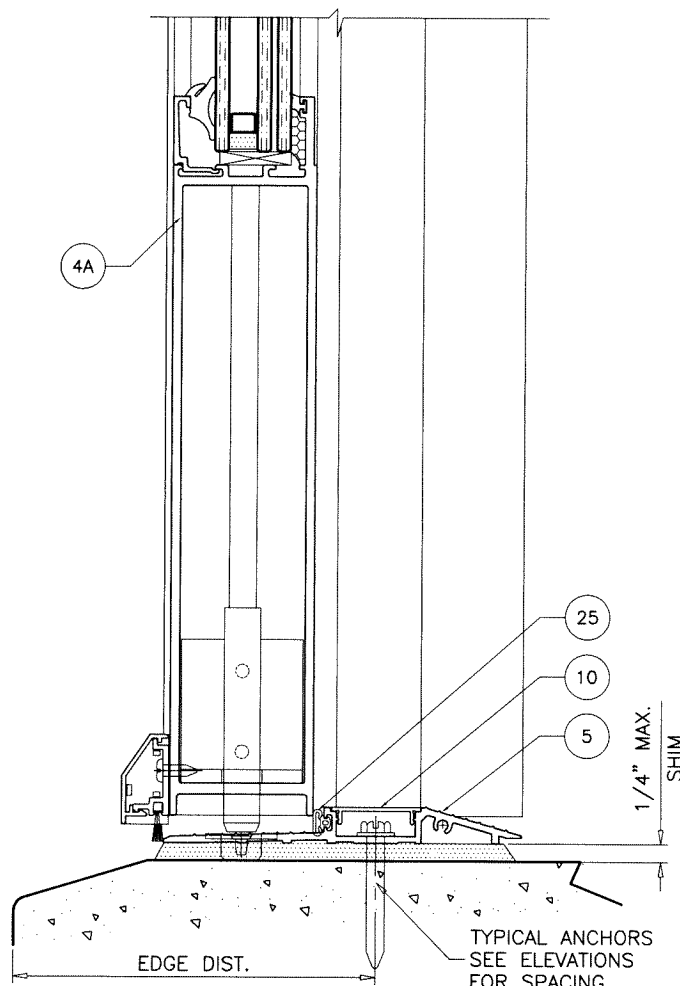

HIGH SILL


APPROVED FOR WATER INFILTRATION RESISTANCE

WEEPHOLES:

W1 = 5/16" X 1-3/4" LONG WEEP SLOTS
(2) PER LITE AT 8" FROM EACH END.

Sealed: 09/01/2026




FL #47222

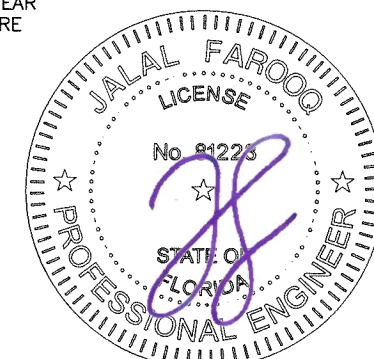

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538
COMP-ANL\24-97F-MG

MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)
MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963
www.mrglasswindows.com

revisions:		no date by description	
date:	12-06-24	no	date
scale:	3/8" = 1"	by	description
dr. by:	TARIQ		
chk. by:			
drawing no.	24-97F		
sheet	4 of 11		

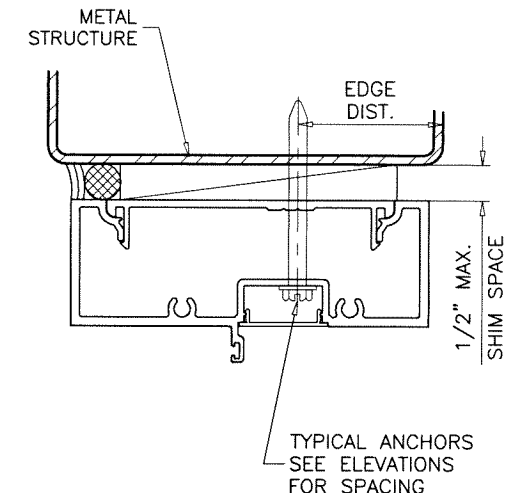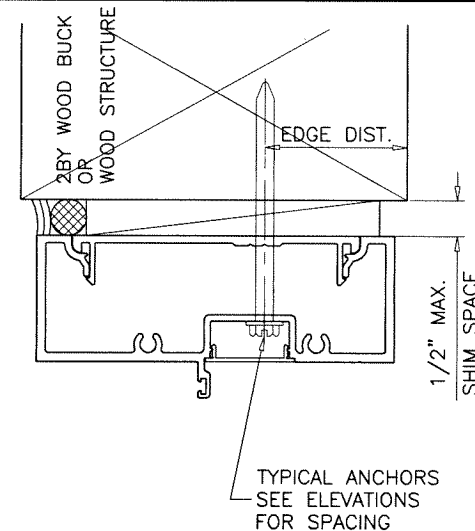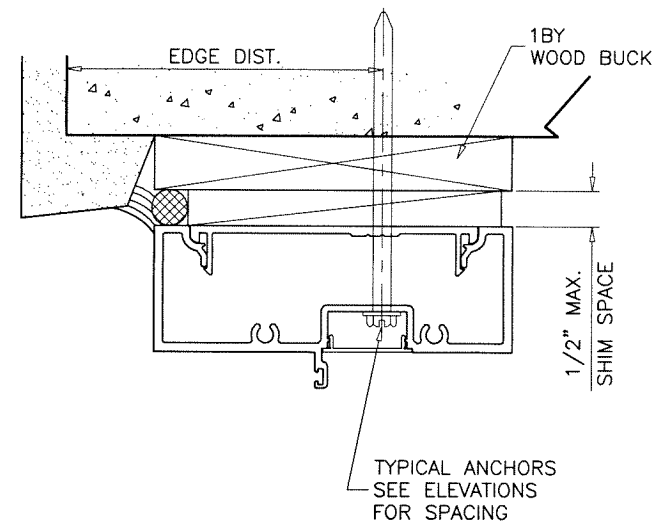

WOOD BUCKS AND METAL STRUCTURE NOT BY 'MR-GLASS'
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS AT DOOR FRAMES: SEE ELEV. FOR SPACING

1/4" X 2-3/4" ULTRACON BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
INTO WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)
THRU 1BY OR 2BY WOOD BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO GROUT FILLED BLOCKS (JAMBS)

ANCHOR EDGE DISTANCES

INTO CONCRETE AND BLOCKS = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.

1/4" X 2-3/4" ULTRACON BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
DIRECTLY INTO CONCRETE OR BLOCKS
1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-3/4" MIN. EMBED INTO GROUT FILLED BLOCKS (JAMBS)

ANCHOR EDGE DISTANCES

INTO CONCRETE AND BLOCKS = 2-1/2" MIN.

1/4" DIA. SMS OR SELF-DRILLING SCREWS (GRADE 2 CRS)


INTO F.B.C. APPROVED MULLIONS
AND
INTO METAL STRUCTURES (HEAD/SILL/JAMBS)
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES

INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

Sealed: 09/01/2026



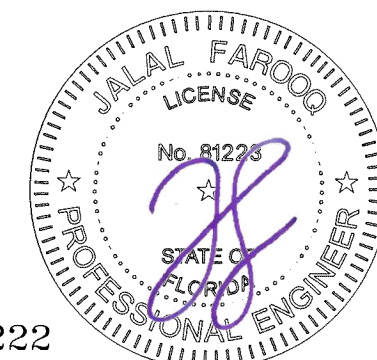


FL #47222


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538
COMP - ANL 24-97F-MG

MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)
MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963
www.mrglasswindows.com

revisions:	no	date	by	description
date:	12-06-24	scale:	3/8" = 1"	
dr. by:	TARIQ	chk. by:		
drawing no.	24-97F			
sheet	4.1 of 11			

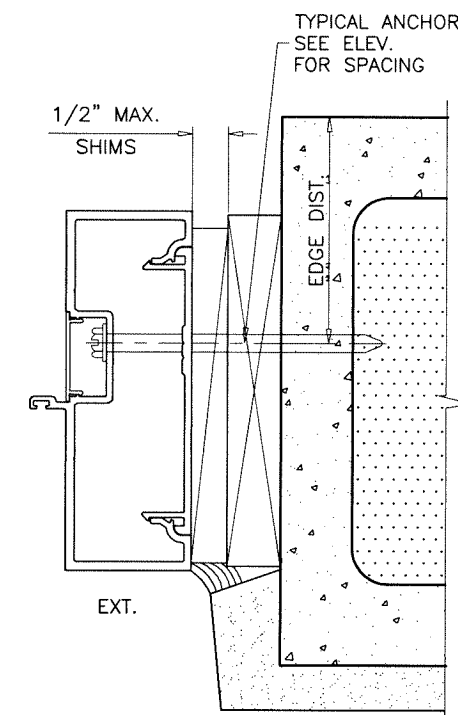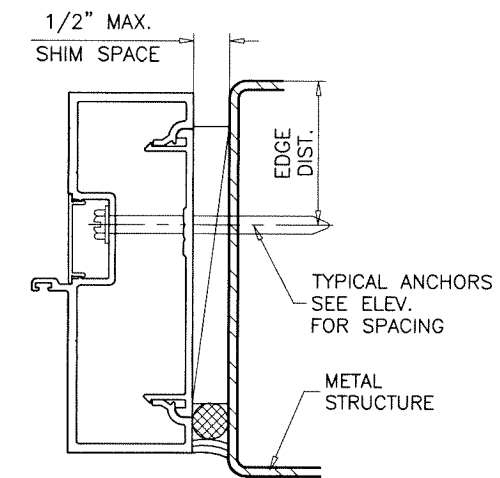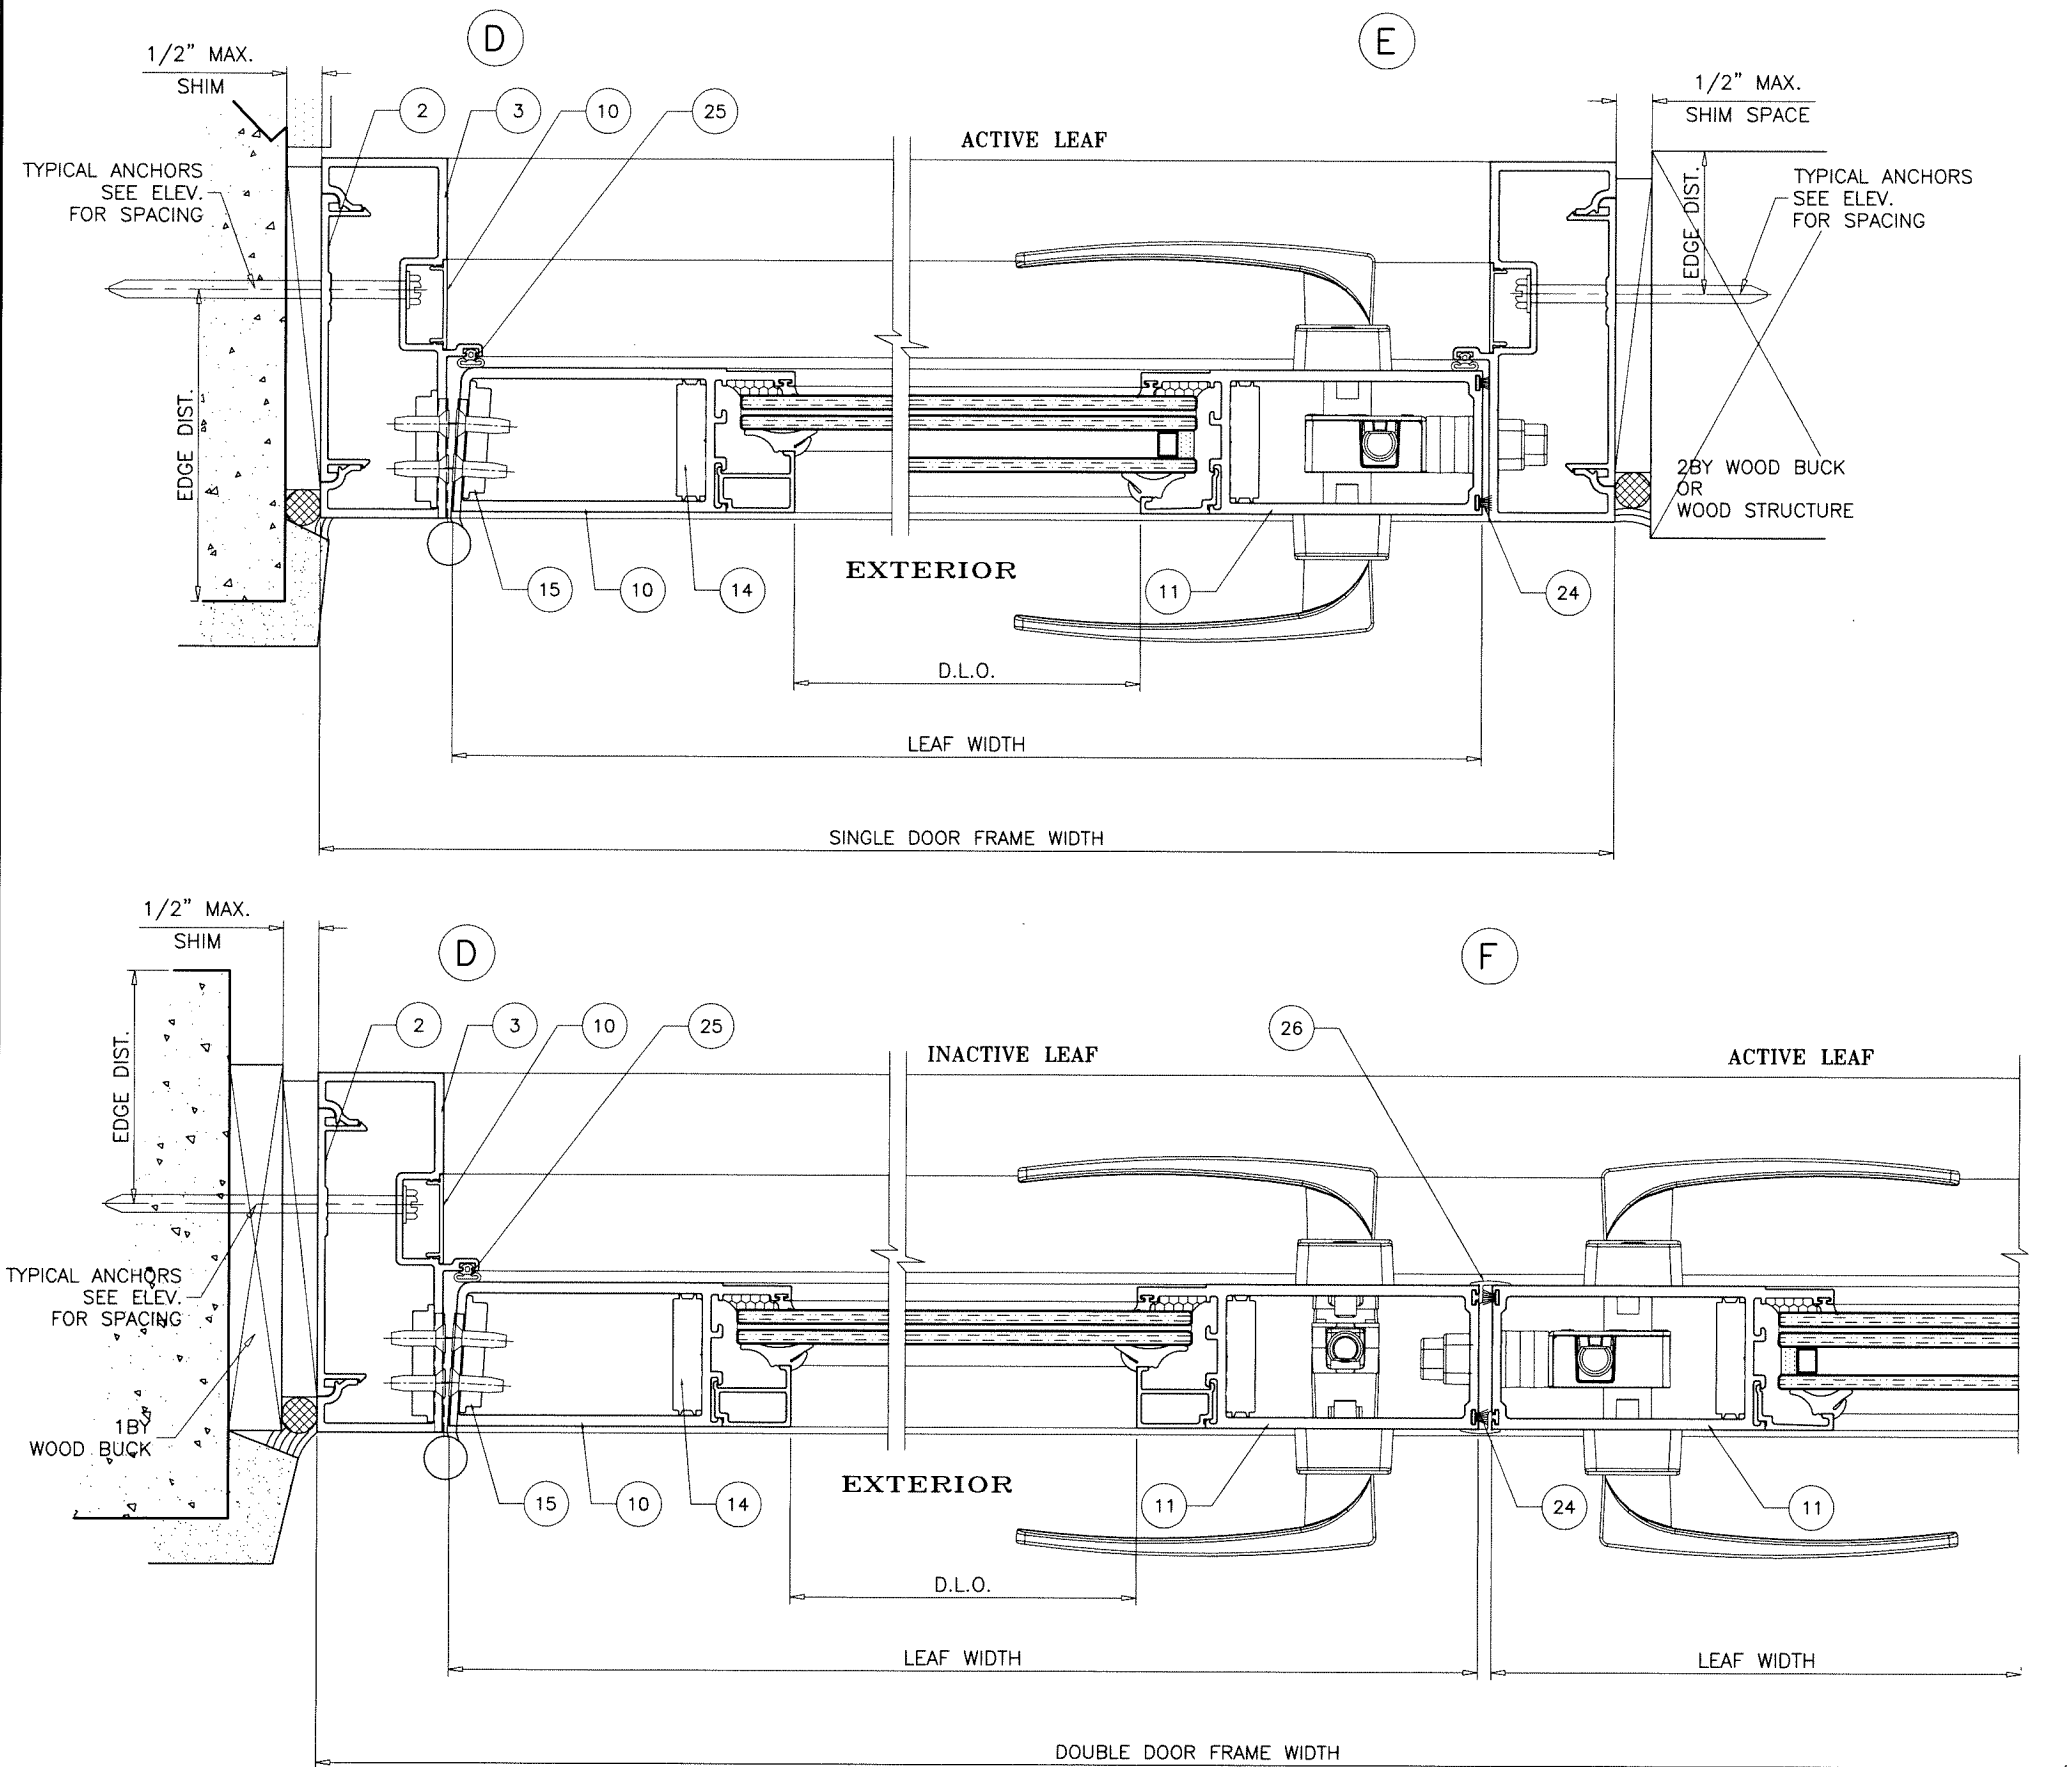

Sealed: 09/01/2026







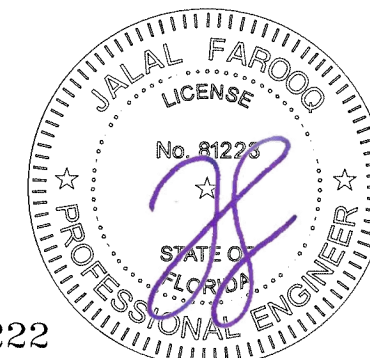


FL #47222

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100
 WWW.AFCENG.COM
 FBPE #3538
 COMP-ANL\24-97F-MG

MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)
MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
 8051 N.W. 79th Place
 Medley, FL. 33166
 Tel. (305) 764-3963
 www.mrglasswindows.com

revisions:		no date by description	
date:	12-06-24	no	date
scale:	3/8" = 1"	by	description
dr. by:	TARIQ		
chk. by:			
drawing no.		24-97F	
sheet		5 of 11	

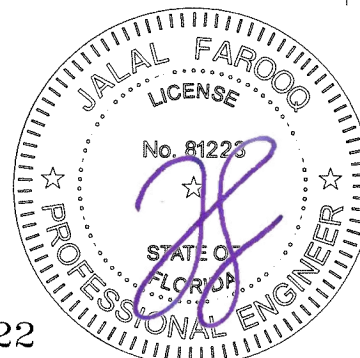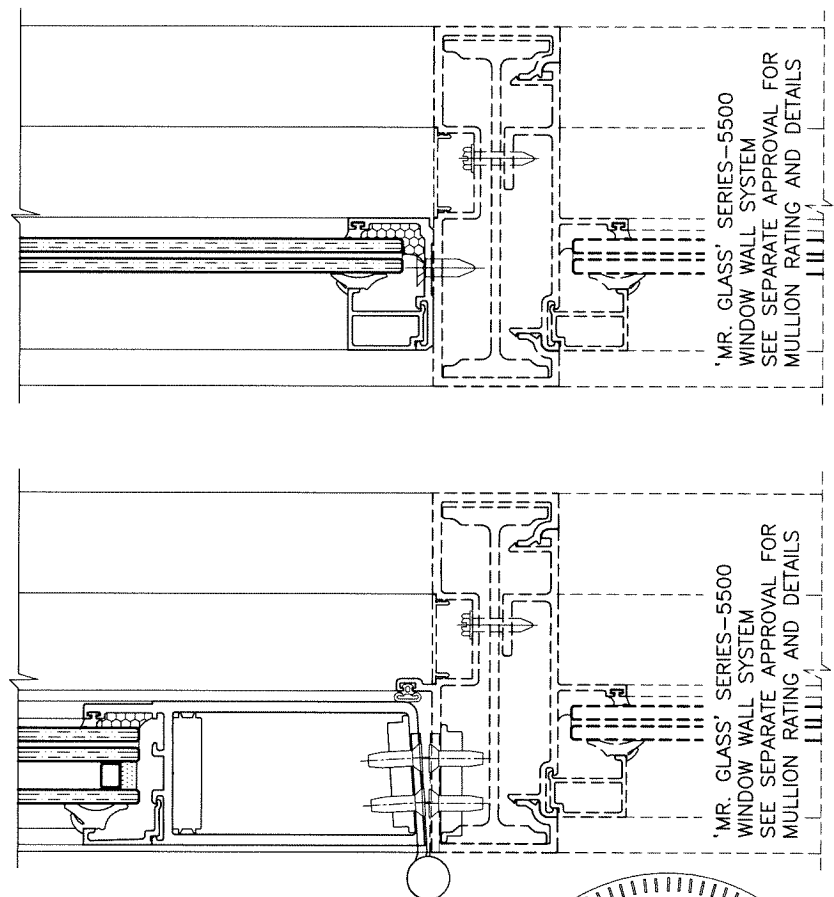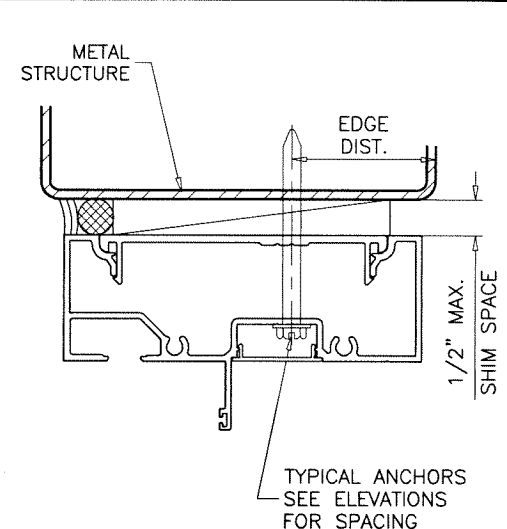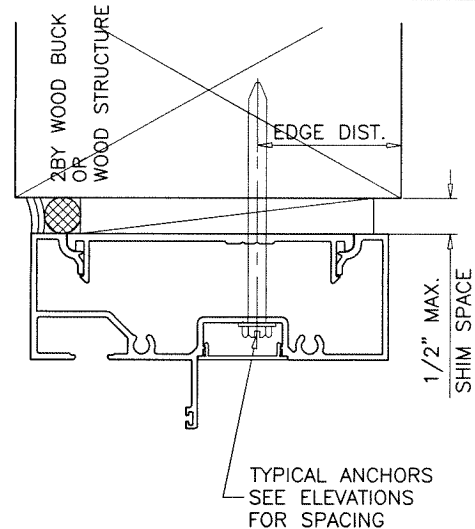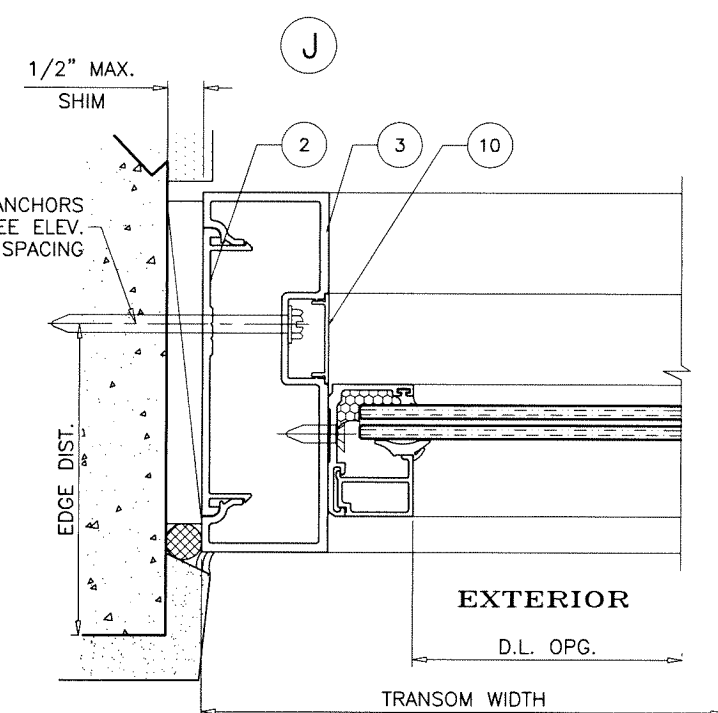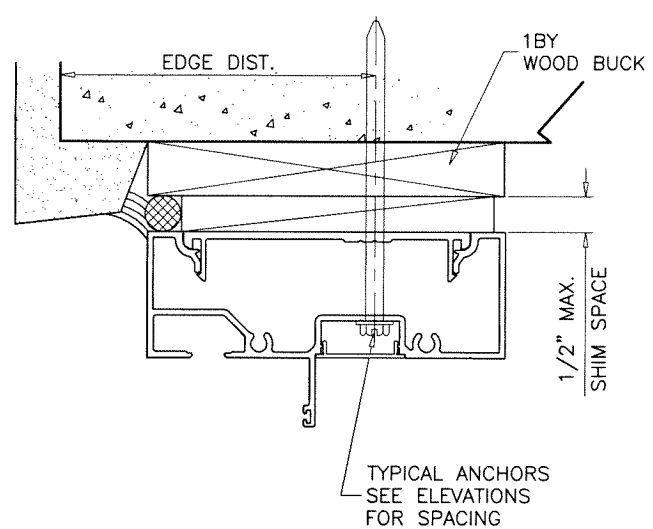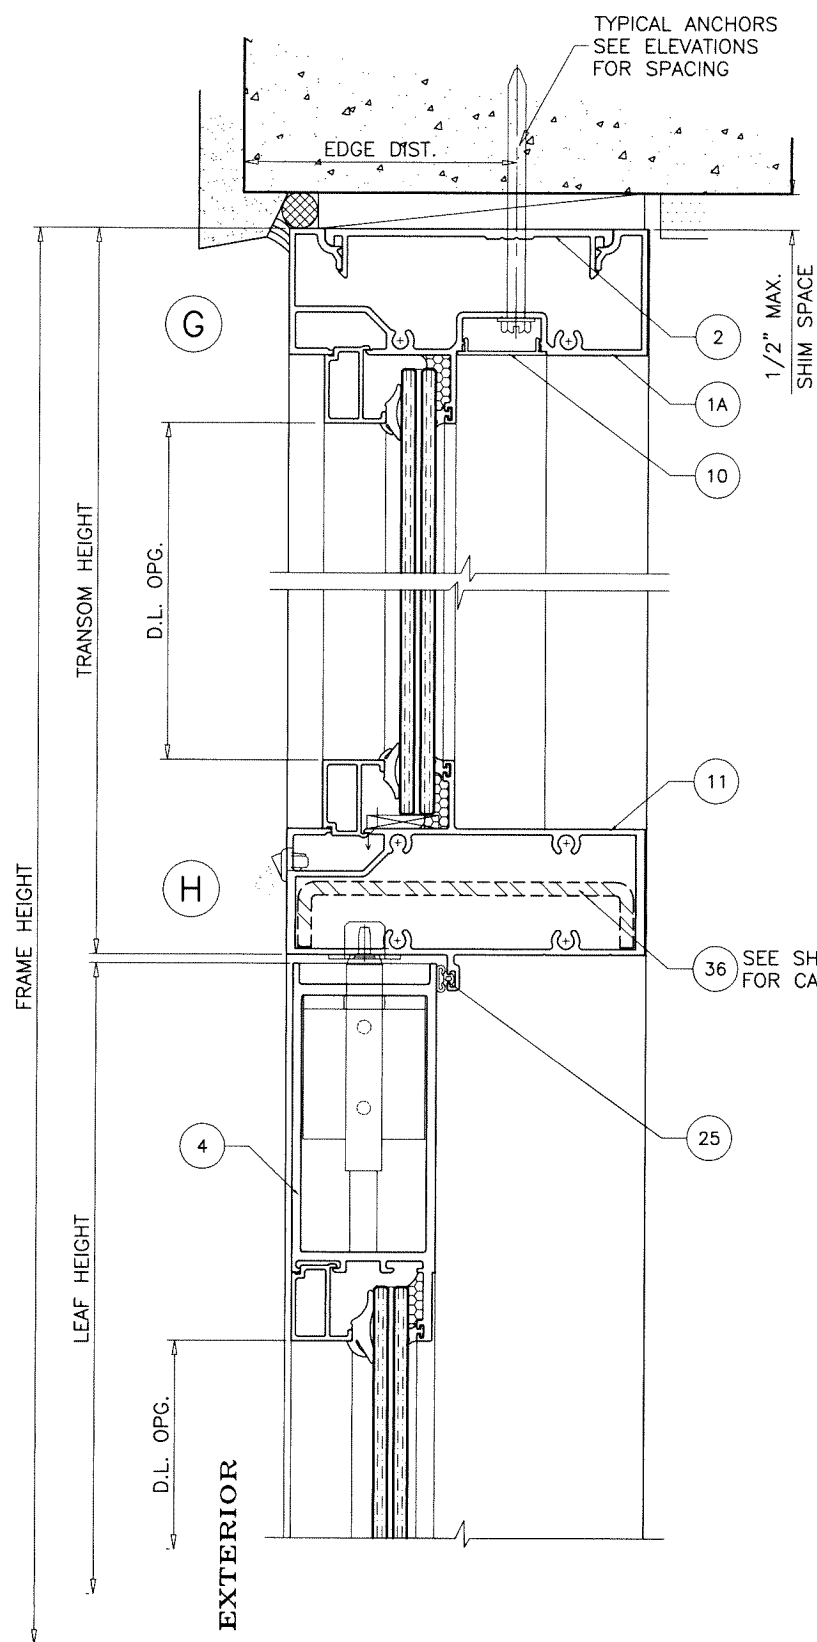

Sealed: 09/01/2026

FL #47222

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
FBPE #3538





COMP-ANL\24-97F-MG

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963
www.mrglasswindows.com

MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)

revisions:	
no	date by description

date: 12-06-24	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
drawing no. 24-97F			
sheet 6 of 11			

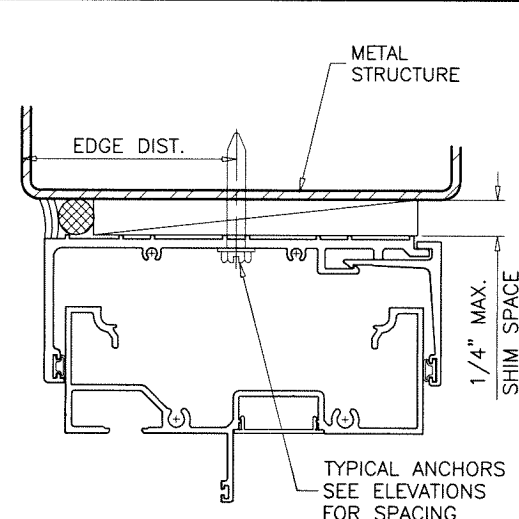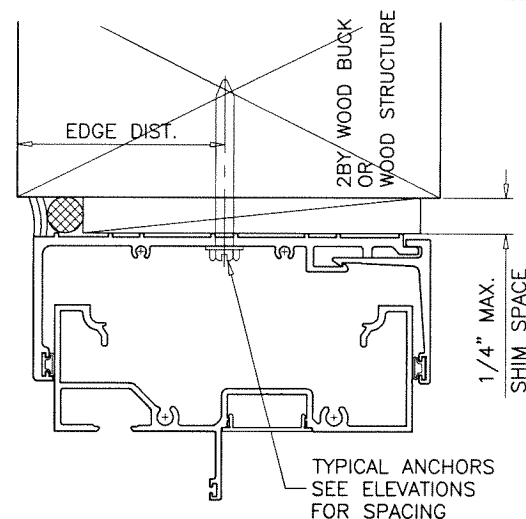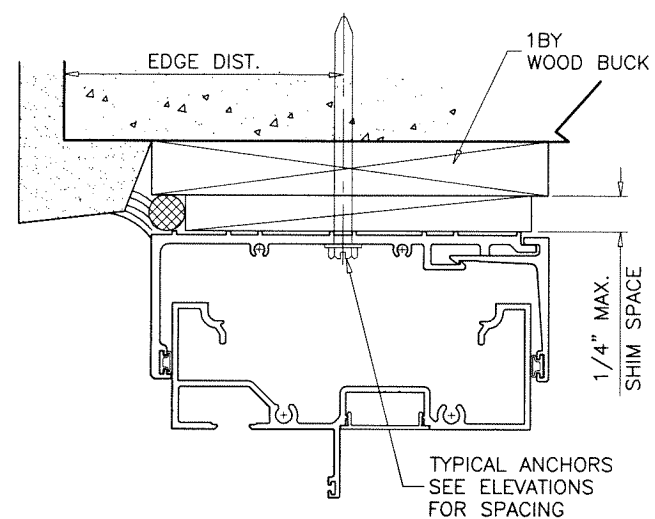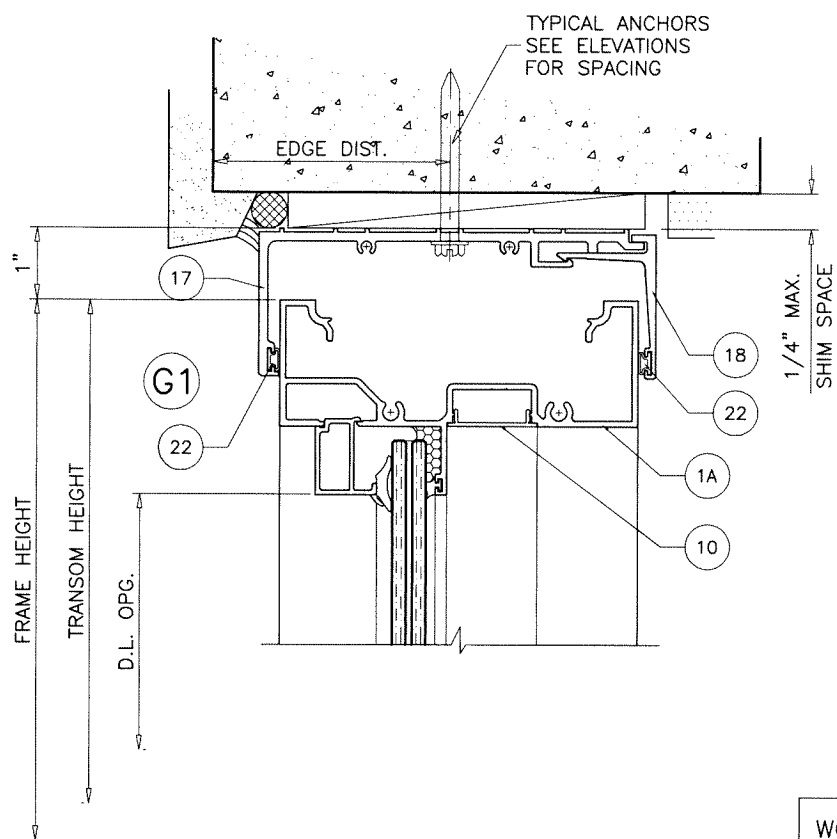

WOOD BUCKS AND METAL STRUCTURE NOT BY 'MR-GLASS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

NOTE:
SEALANT APPLICATION AT HEAD AND JAMB RECEPTORS TO BE DETERMINED ON CASE BY CASE PROJECT DEPENDING ON THE APPLICATION.

TYPICAL ANCHORS AT RECEPTORS: SEE ELEV. FOR SPACING

5/16" DIA. ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI)
INTO WOOD STRUCTURES
1-7/8" MIN. PENETRATION INTO WOOD
THRU 1BY OR 2BY WOOD BUCKS INTO CONC.
1-1/2" MIN. EMBED INTO CONCRETE

ANCHOR EDGE DISTANCES

INTO CONCRETE = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1-1/4" MIN.

5/16" DIA. ULTRACON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI)
DIRECTLY INTO CONCRETE
2" MIN. EMBED INTO CONCRETE

ANCHOR EDGE DISTANCES

INTO CONCRETE = 3-1/8" MIN.

5/16" DIA. SMS OR SELF-DRILLING SCREWS (GRADE 2 CRS)
INTO F.B.C. APPROVED MULLIONS
AND
INTO METAL STRUCTURES
(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES

INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

Sealed: 09/01/2026



FL #47222

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538
COMP-ANL\24-97F-MG

MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)
MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963
www.mrglasswindows.com

revisions:		no. date		by description	
date:	12-06-24	no.	date	by	description
scale:	3/8" = 1"				
dr. by:	TARIQ				
chk. by:					
drawing no.	24-97F				
sheet	7 of 11				

LOCK OPTIONS:


MULTI POINT LOCK OPTION #1:

ACTIVE LEAF:

3 POINT LOCK SYSTEM BY 'INTERLOCK' AT 34-1/2" FROM BOTTOM
HANDLE ACTIVATES DEAD BOLT AND SHOOT BOLTS ENGAGING AT HEAD AND SILL
KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR
11/16" MIN. DEAD BOLT PENETRATION
9/16" MIN. SHOOT BOLT PENETRATION AT HEAD
1/2" MIN. SHOOT BOLT PENETRATION AT SILL
FASTENED TO ACTIVE LEAF LOCK STILE WITH
(2) #8-32 X 2" OH MS

INACTIVE LEAF:

2 POINT LOCK SYSTEM BY 'INTERLOCK' AT 34-1/2" FROM BOTTOM
HANDLE ACTIVATES SHOOT BOLTS ENGAGING AT HEAD AND SILL
9/16" MIN. SHOOT BOLT PENETRATION AT HEAD
1/2" MIN. SHOOT BOLT PENETRATION AT SILL
FASTENED TO INACTIVE LEAF LOCK STILE WITH
(2) #8-32 X 2" OH MS

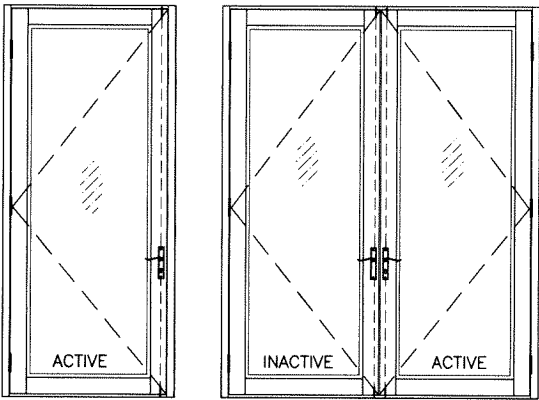


MULTI POINT LOCK OPTION #2:

ACTIVE LEAF:

3 POINT LOCK SYSTEM BY 'REGENT HARDWARE' AT 40-1/2" FROM BOTTOM
HANDLE ACTIVATES DEAD BOLT AND SHOOT BOLTS ENGAGING AT HEAD AND SILL
KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR
11/16" MIN. DEAD BOLT PENETRATION
9/16" MIN. SHOOT BOLT PENETRATION AT HEAD
1/2" MIN. SHOOT BOLT PENETRATION AT SILL
FASTENED TO ACTIVE LEAF LOCK STILE WITH
(2) #8-32 X 2" OH MS

INACTIVE LEAF:


2 POINT LOCK SYSTEM BY 'REGENT HARDWARE' AT 40-1/2" FROM BOTTOM
HANDLE ACTIVATES SHOOT BOLTS ENGAGING AT HEAD AND SILL
9/16" MIN. SHOOT BOLT PENETRATION AT HEAD
1/2" MIN. SHOOT BOLT PENETRATION AT SILL
FASTENED TO INACTIVE LEAF LOCK STILE WITH
(2) #8-32 X 2" OH MS

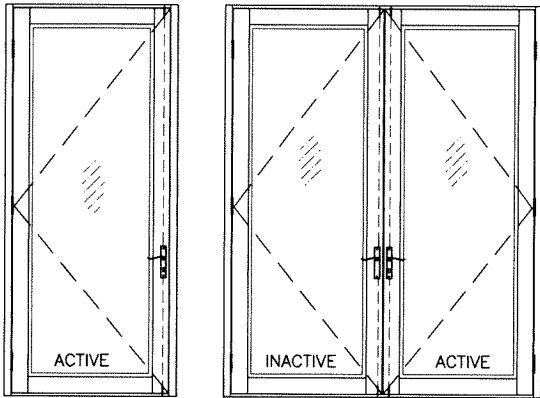

CVR PANIC DEVICE OPTION #1:

ACTIVE & INACTIVE LEAF:



CONCEALED VERTICAL ROD PANIC EXIT DEVICE BY 'JACKSON PANIC SYSTEM'
LOCATED AT 41" FROM SILL AT EACH LEAF.
FASTENED WITH
(1) #14 X 1" HH SELF DRILLING SCREW AT ONE END AND
(2) #12-24 X 1/2" OH MACHINE SCREWS AT OTHER END

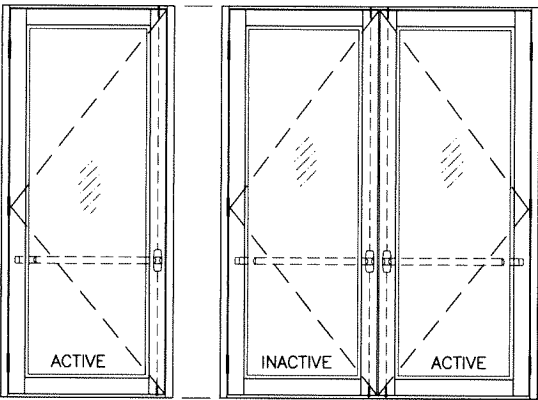

CVR PANIC DEVICE OPTION #2:

ACTIVE & INACTIVE LEAF:

CONCEALED VERTICAL ROD PANIC EXIT DEVICE '1690' BY 'FALCON'
LOCATED AT 40" FROM SILL AT EACH LEAF.
FASTENED WITH
(1) #14 X 1" HH SELF DRILLING SCREW AT ONE END AND
(2) #12-24 X 1/2" OH MACHINE SCREWS AT OTHER END

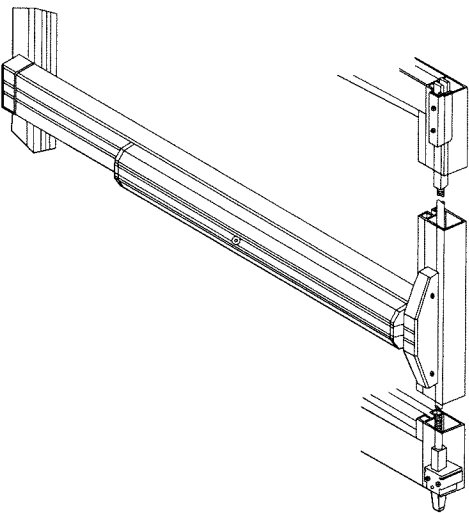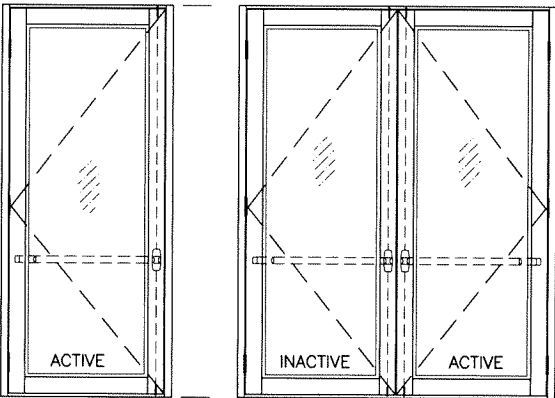


HINGES:

4" X 4-1/2" ST. STEEL BALL BEARING HINGES BY 'REGENT/IDH'
(3) FOR DOORS UPTO 98" HEIGHTS
(4) FOR DOORS UPTO 108" HEIGHTS
TOP AND BOTTOM HINGES AT 6-5/8" FROM ENDS
INTERMEDIATE HINGES EQUALLY SPACED
FASTENED TO FRAME WITH
(4) #12 X 1/2" FH SELF DRILLING SCREWS
FASTENED TO LEAF WITH
(4) #12 X 1/2" FH SELF DRILLING SCREWS

SEALANTS:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.

Sealed: 09/01/2026

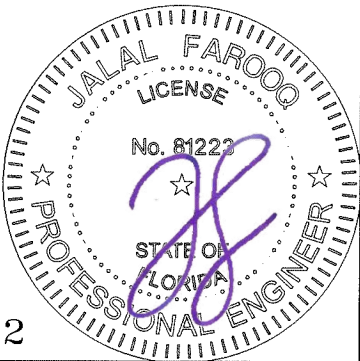


FL #47222

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #9538
COMP-ANL\24-97F-MG


MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)
MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963
www.mrglasswindows.com

revisions:		no.		description	
date	12-06-24	no.	date	by	description
date:	12-06-24	no.:	date:	by:	description:
scale:	-	dr. by:	TARIQ	chk. by:	
drawing no.	24-97F	sheet	8 of 11		

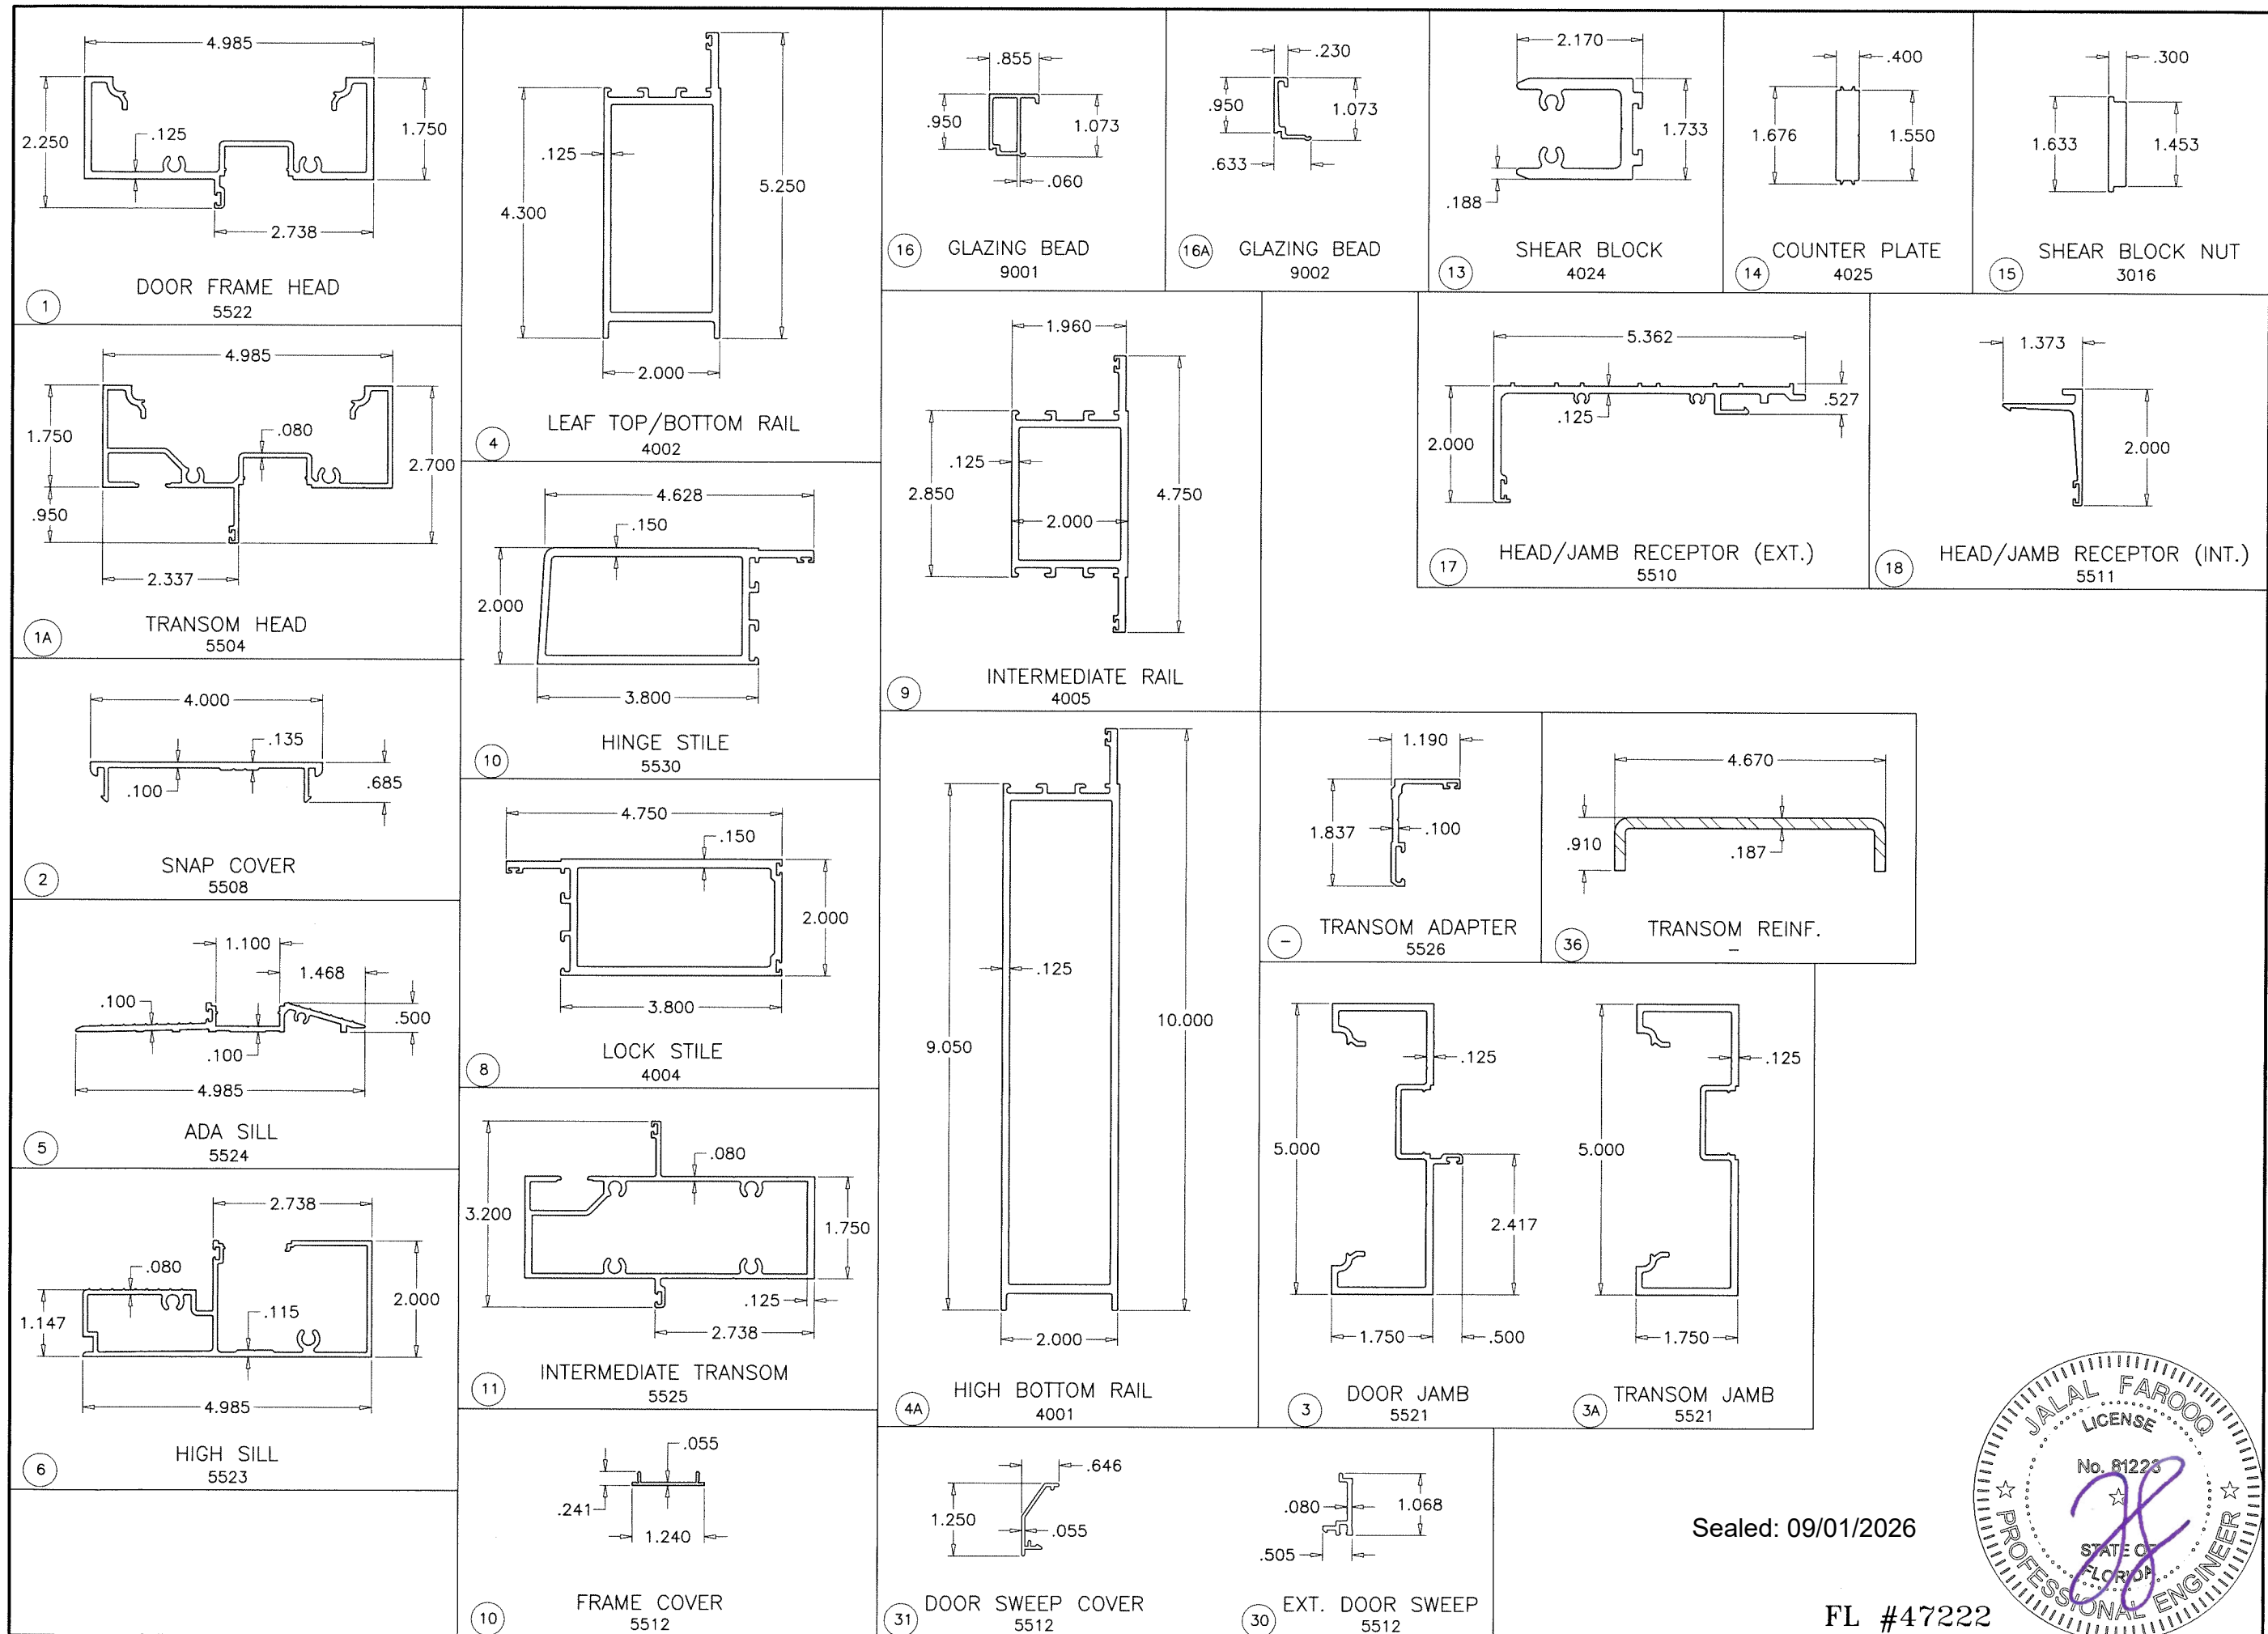

Sealed: 09/01/2026

FL #47222

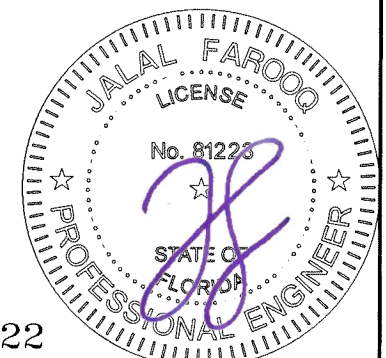

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100
WWW.AFCENG.COM
FBPE #3538

MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)

MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC
8051 N.W. 79th Place
Medley, FL. 33166
Tel. (305) 764-3963
www.mrglasswindows.com

revisions:	
no	date by description


date: 12-06-24
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
24-97F
sheet 9 of 11

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	5522	AS REQD.	DOOR FRAME HEAD	6063-T6	-
1A	5504	AS REQD.	TRANSOM HEAD	6063-T6	-
2	5508	AS REQD.	FRAME COVER	6063-T6	-
3	5521	AS REQD.	DOOR FRAME JAMB	6063-T6	-
3A	5521	AS REQD.	TRANSOM JAMB	6063-T6	-
4	4002	AS REQD.	LEAF TOP & BOTTOM RAIL	6063-T6	-
4A	4001	AS REQD.	HIGH BOTTOM RAIL	6063-T6	-
5	5524	AS REQD.	ADA SILL	6063-T6	-
6	5523	AS REQD.	HIGH SILL	6063-T6	-
7	5530	AS REQD.	HINGE STILE	6063-T6	-
8	4004	AS REQD.	LOCK STILE	6063-T6	-
9	4005	AS REQD.	INTERMEDIATE RAIL	6063-T6	-
10	5512	AS REQD.	FRAME COVER	6063-T5	-
11	5525	AS REQD.	INETRMEDIATE TRANSOM	6063-T6	-
12	5526	AS REQD.	TRANSOM ADAPTER	6063-T5	-
13	4024	AS REQD.	SHEAR BLOCK	6063-T6	-
14	4025	AS REQD.	COUNTER PLATE	6063-T6	-
15	3016	AS REQD.	HINGE BACKING PLATE, 9" LONG	6063-T6	-
16	E9001	AS REQD.	GLAZING BEAD (LAM. GLASS)	6063-T6	-
16A	E9002	AS REQD.	GLAZING BEAD (INSUL. LAM. GLASS)	6063-T6	-
17	5510	AS REQD.	HEAD/JAMB RECEPTOR (EXTERIOR)	6063-T6	-
18	5511	AS REQD.	HEAD/JAMB RECEPTOR (INTERIOR)	6063-T6	-
19	G30-01	AS REQD.	INTERIOR GLAZING GASKET	EPDM	DUROMETER 70±5 SHORE A
20	G6-01	AS REQD.	EXTERIOR GLAZING GASKET	EPDM	DUROMETER 70±5 SHORE A
21	-	2/ LITE	SETTING BLOCK, 1/8" X 1" X 4" LONG, AT 3" FROM EACH END	EPDM	DUROMETER 80±5 SHORE A
22	G60-03	AS REQD.	RECEPTOR GASKET	EPDM	DUROMETER 70±5 SHORE A
23	G30-02	AS REQD.	DOUBLE FIN AIR SEAL W'STRIPPING	SANTOPRENE	DUROMETER 70±5 SHORE A
24	G25-02	AS REQD.	PILE W'STRIPPING	WOOL	ULTRAFAB
25	G60-03	AS REQD.	BULB W'STRIPPING	EPDM	-
26	G55-12	AS REQD.	LOCK STILE GASKET	EPDM	DUROMETER 78±5 SHORE A
27	G40-03	AS REQD.	DOOR SWEEPER	WOOL	ULTRAFAB
28	M30-02	AS REQD.	BALL BEARING HINGES	ST. STEEL	-
29	-	AS REQD.	MULTI POINT LOCK	-	-
30	4022	AS REQD.	EXTERIOR DOOR SWEEP	6063-T5	-
31	4023	AS REQD.	DOOR SWEEP COVER	6063-T5	-
32	#12 X 1-1/2"	AS REQD.	FRAME ASSEMBLY SCREWS	ST. STEEL	HWH SMS
33	3/8 X 1"	AS REQD.	SHEAR BLOCK FASTENERS	ST. STEEL	HEX SOCKET HEAD SCREWS
34	#12 X 1-1/2"	AS REQD.	SHEAR BLOCK FASTENERS	ST. STEEL	HWH SMS
35	#10 X 3/4"	AS REQD.	DOOR SWEEP FASTENERS	-	PH SELF DRILLING
36	-	AS REQD.	TRANSOM REINFORCING CHANNEL	STEEL	A36, Fu MIN. = 58 KSI
37	-	-	-	-	-


SEALANTS:

ALL FRAME CORNERS, JOINTS, MULLION SEAMS AND PERIMETER OF GLAZING BEAD TO FRAME TO BE SEALED WITH GE 2000 SILICONE.

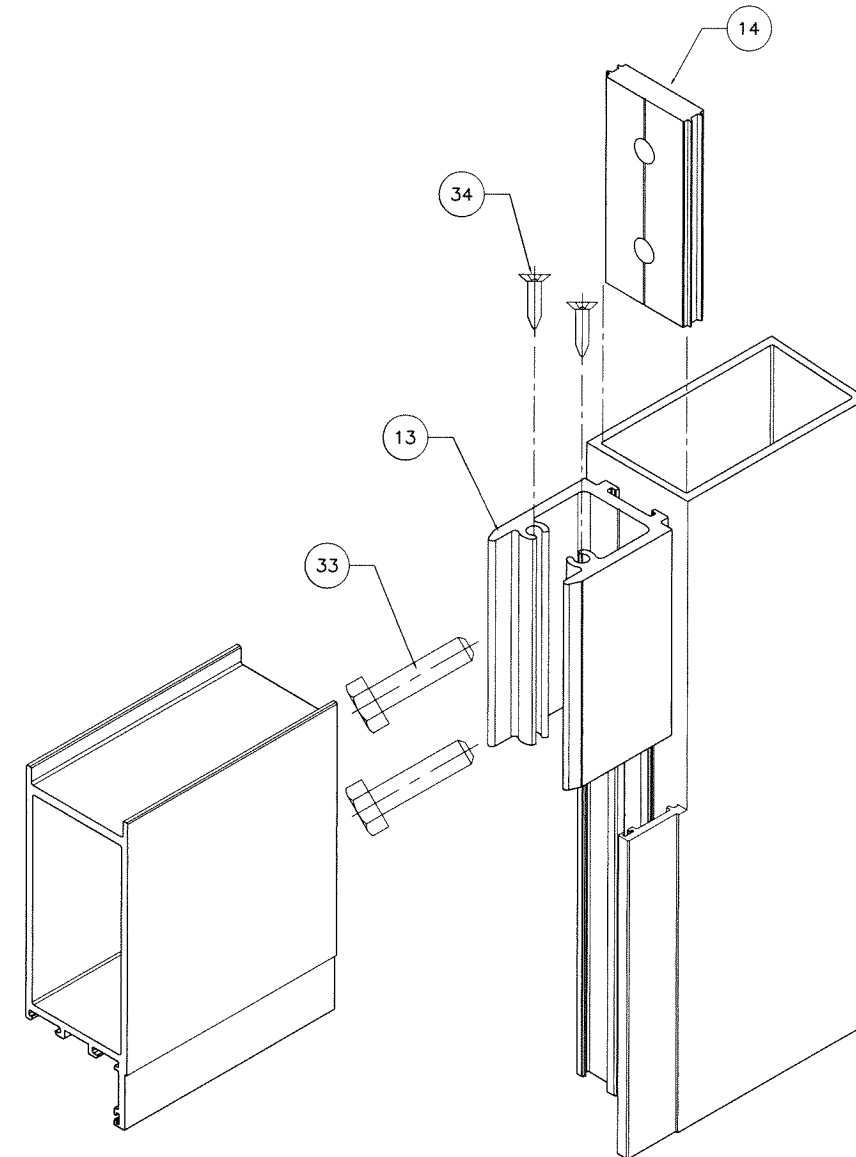

LEAF CORNER
INTERMEDIATE RAIL CORNER

Sealed: 09/01/2026

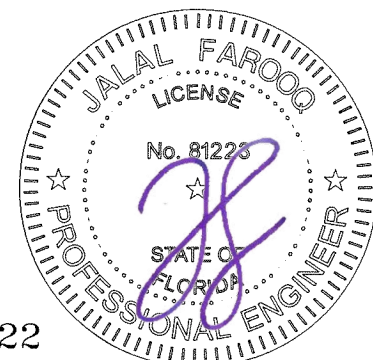

FL #47222

af c	
AL-FAROOQ CORPORATION ENGINEERS & PRODUCT DEVELOPMENT 9360 SUNSET DRIVE, SUITE 220 MIAMI, FLORIDA 33173 TEL. (305) 264-8100 WWW.AFCENG.COM COMP - ANL \ 24 - 97F - MG FBPE #3538	
MG-5500 ALUMINUM OUTSWING DOOR (L.M.I.)	
MR-GLASS DOORS & WINDOWS MANUFACTURING, LLC 8051 N.W. 79th Place Medley, FL. 33166 Tel. (305) 764-3963 www.mrglasswindows.com	
revisions:	no date by description
date: 12-06-24	scale: 3/8" = 1"
dr. by: TARIQ	chk. by:
drawing no. 24-97F	
sheet 10 of 11	

