

"Direct Glaze"

Single Fiberglass Door


INSWING/OUTSWING

"NON-IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 9th Edition (2026) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection, this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures & general notes
2	Door panel details
3	Flush Glazing details
4	Horizontal & vertical cross sections (2X buck)
5	Horizontal & vertical cross sections (1X buck)
6	Horizontal & vertical cross sections (Direct to Masonry)
7	Vertical cross sections
8	Frame anchoring & hardware details
9	Bill of materials

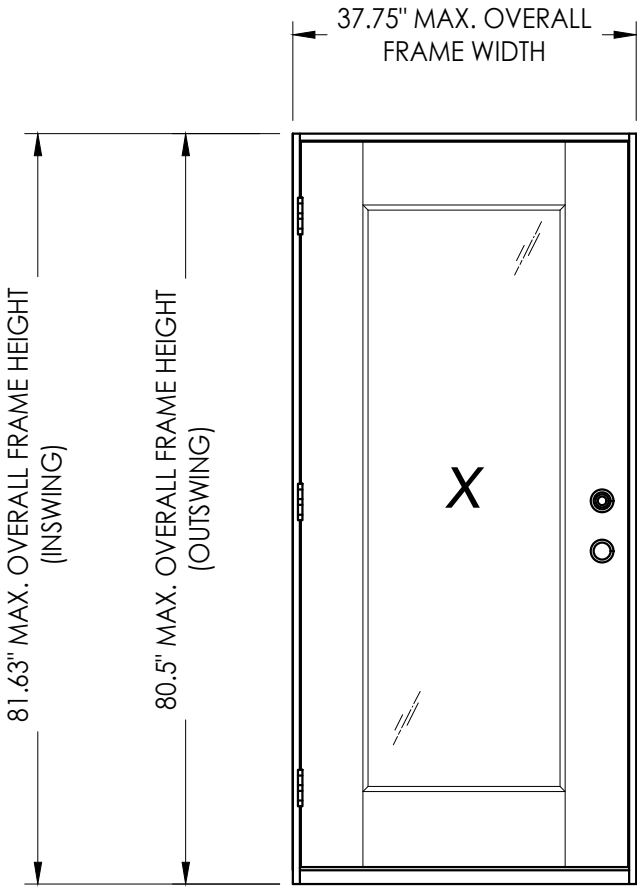

CONFIGURATION	MAX. FRAME DIMENSION	DESIGN PRESSURE (PSF) INSWING		DESIGN PRESSURE (PSF) OUTSWING	
		POSITIVE	NEGATIVE	POSITIVE	NEGATIVE
X	37.75" x 81.63"	+55.0	-55.0	+55.0	-55.0

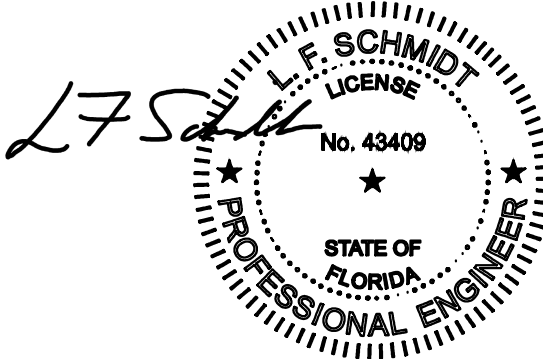

Digitally signed by
Lyndon F Schmidt
Date: 2026.07.02
07:45:19 -04'00'

This item has been digitally signed and sealed by
L. F. Schmidt, P.E. on the date adjacent to the seal.
Printed copies of this document are not
considered signed and sealed and the signature
must be verified on any electronic copies.

THIS PRODUCT APPROVAL IS VALID
ONLY FOR THE STATE OF FLORIDA

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

TRINITY
FIBERGLASS DOOR

DATE: 1/30/25
SCALE: N.T.S.
DWG. BY: RW
CHK. BY: LFS
DRAWING NO.: FL-47284.1
SHEET 1 OF 9

Part or Assembly:
TYPICAL ELEVATION, DESIGN
PRESSURES & GENERAL NOTES



1 7/01/26 UPDATE TO 9TH ED. (2026) FBC
NO. DATE

REVISIONS


1 7/01/26 UPDATE TO 9TH ED. (2026) FBC
NO. DATE

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


Z:\2023 FBC Drawings\Trinity Glass Int\FL-47284 R2\FL-47284.1.dwg

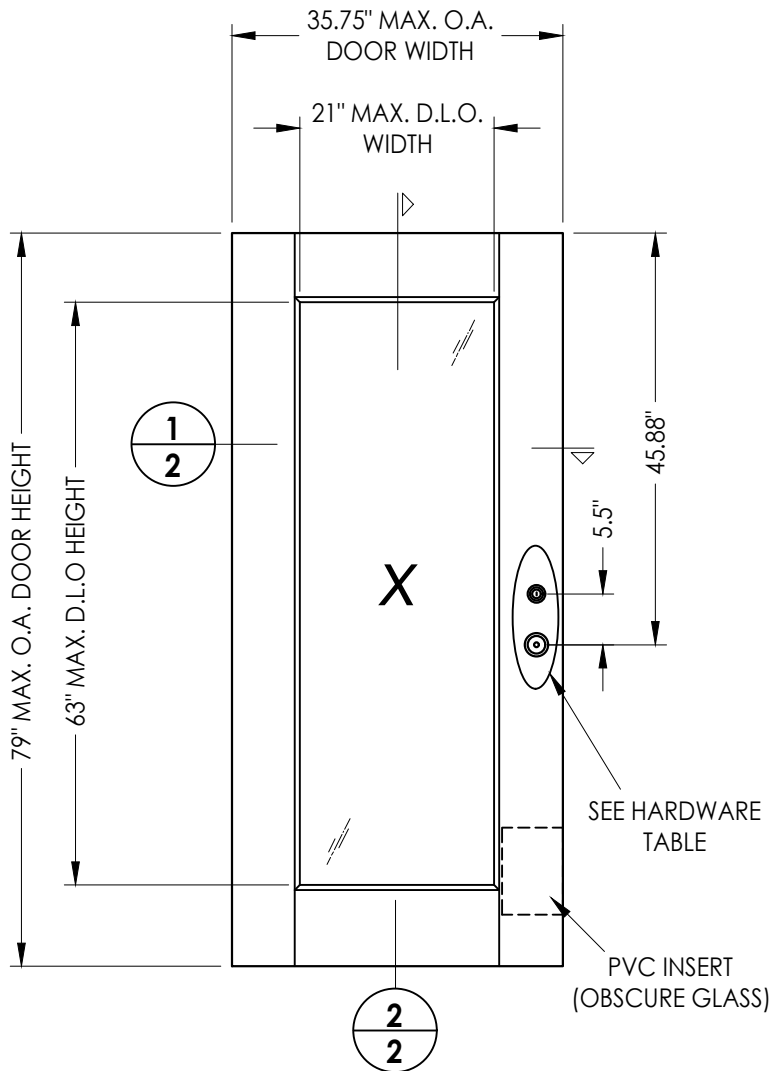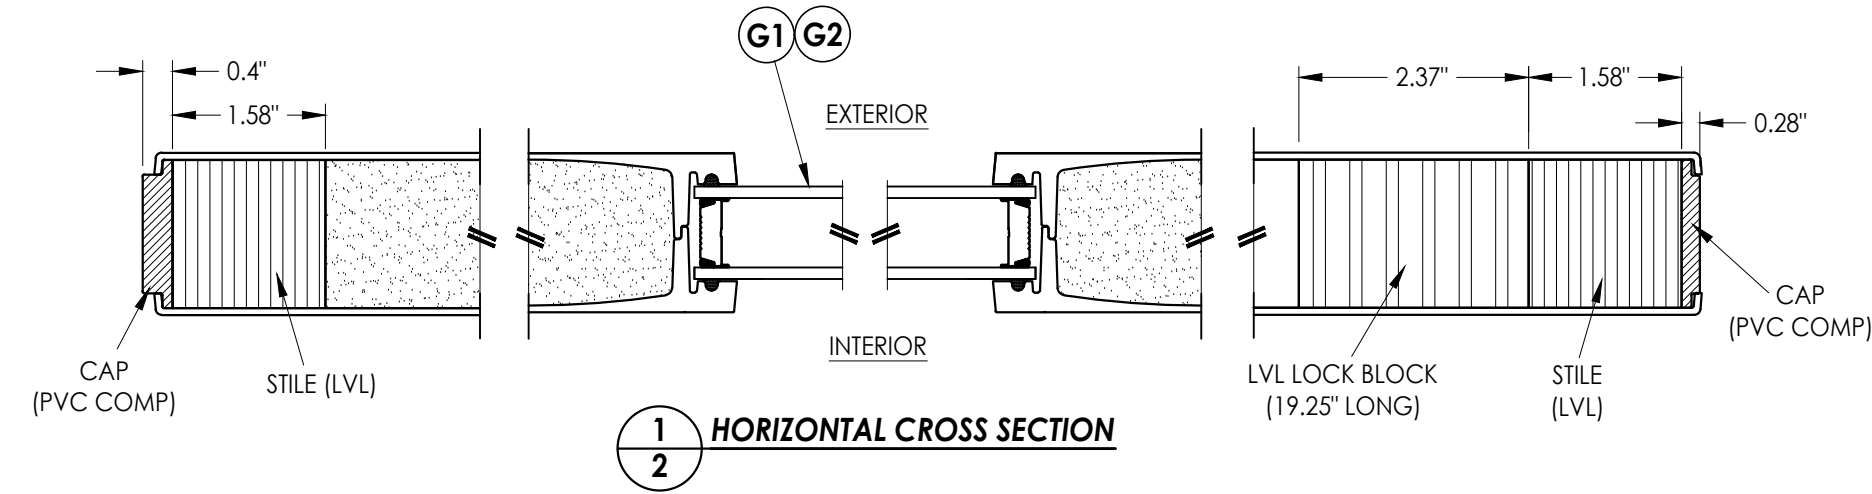


HARDWARE CHART		
MANUFACTURER	MODEL	
KWIKSET	Knob:	SIGNATURE SERIES
	DEADBOLT:	SIGNATURE SERIES (980)
SCHLAGE	Knob:	F SERIES
	DEADBOLT:	B60 SERIES

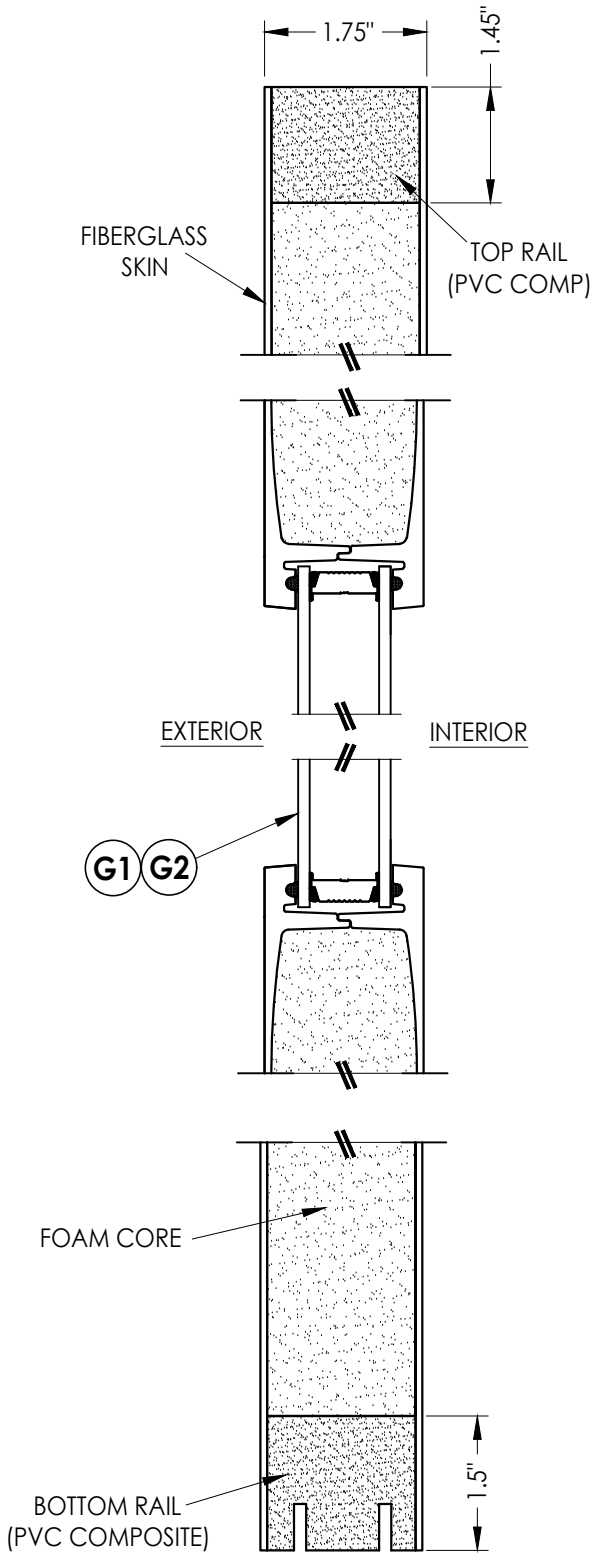

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409				BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813			
PRODUCT:		TRINITY FIBERGLASS DOOR		PART OR ASSEMBLY:		DOOR PANEL DETAILS	
DATE: 1/30/25							
SCALE: N.T.S.							
DWG. BY: RW							
CHK. BY: LFS							
DRAWING NO.: FL-47284.1							
SHEET 2		OF 9					

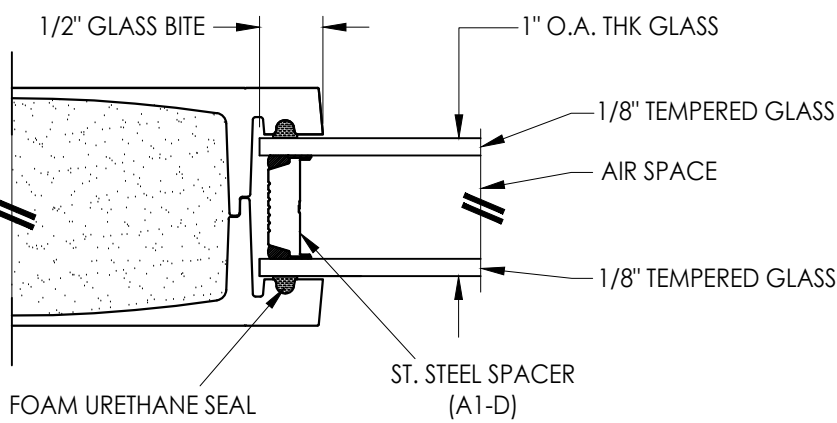

G1 GLAZING DETAIL
CLEAR GLASS

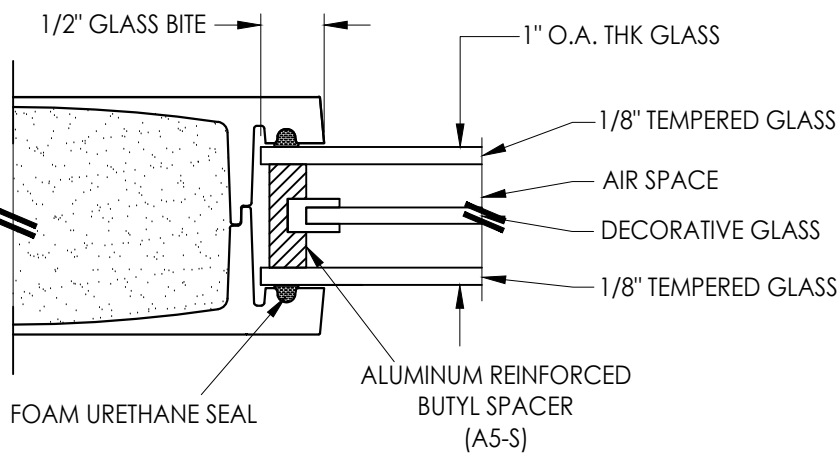

G2 **GLAZING DETAIL**
DECORATIVE GLASS

[illegible]

DATE: 1/30/25

SCALE: N.T.S.

DWG. BY: *RW*

CHK. BY: LFS

DRAWING NO.:

FL-47284.1

SHEET 3 OF 9

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409



RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT: TRINITY
FIBERGLASS DOOR


PART OR ASSEMBLY:
FLUSH GLAZING DETAILS

© 2025 R.W. BUILDING CONSULTANTS INC.


Z:\2023 FBC Drawings\Trinity Glass Int\FL-47284 R2\FL-47284.1.dwg

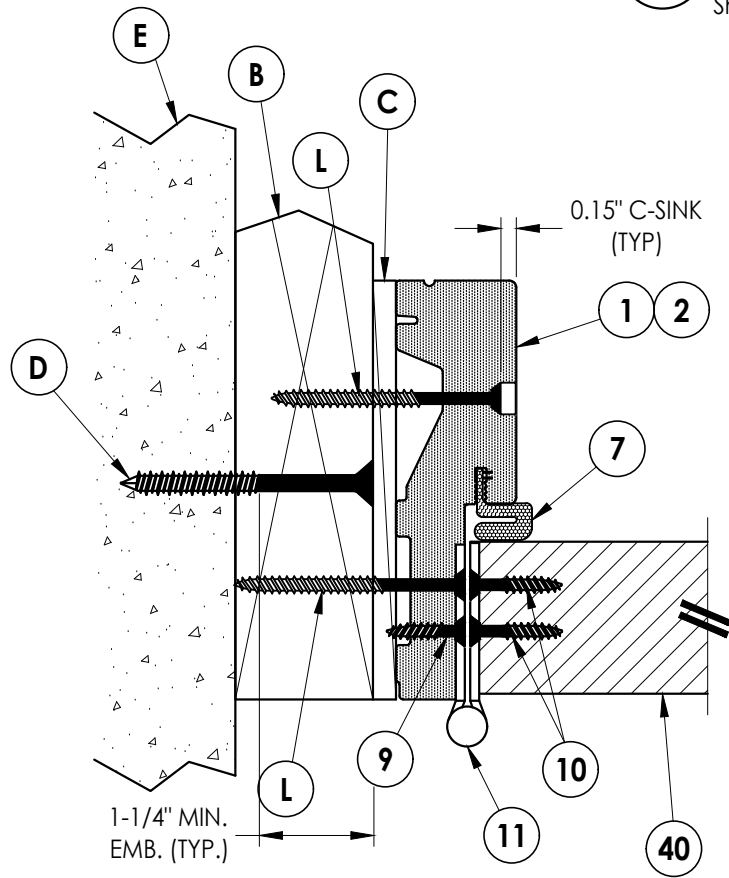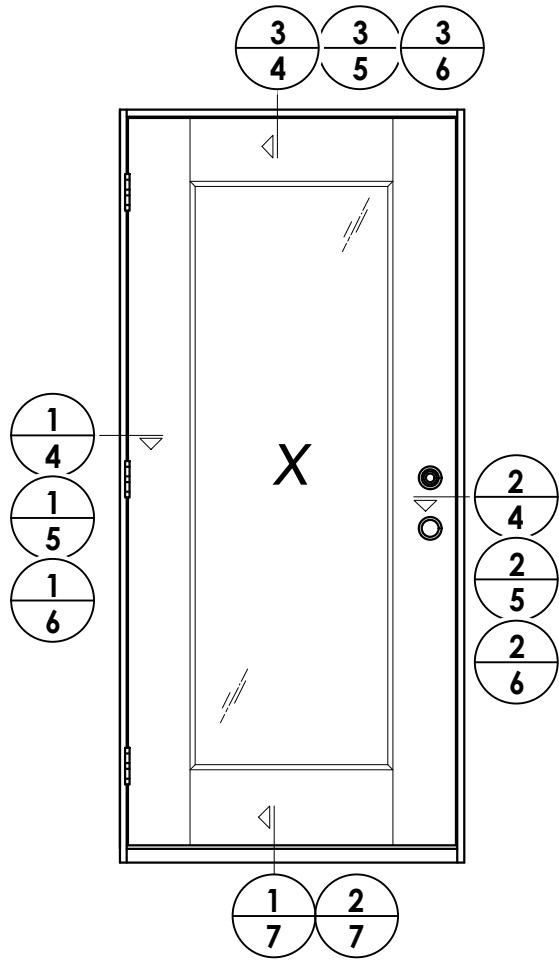

1
4 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ 2X Buck

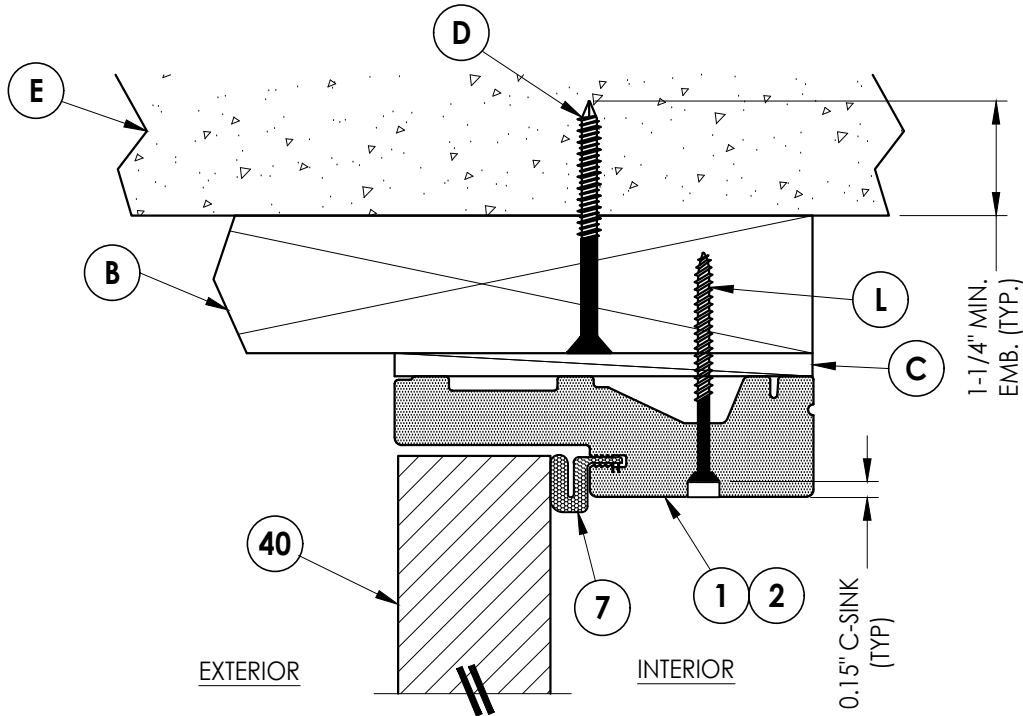

3
4 **VERTICAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ 2X Buck

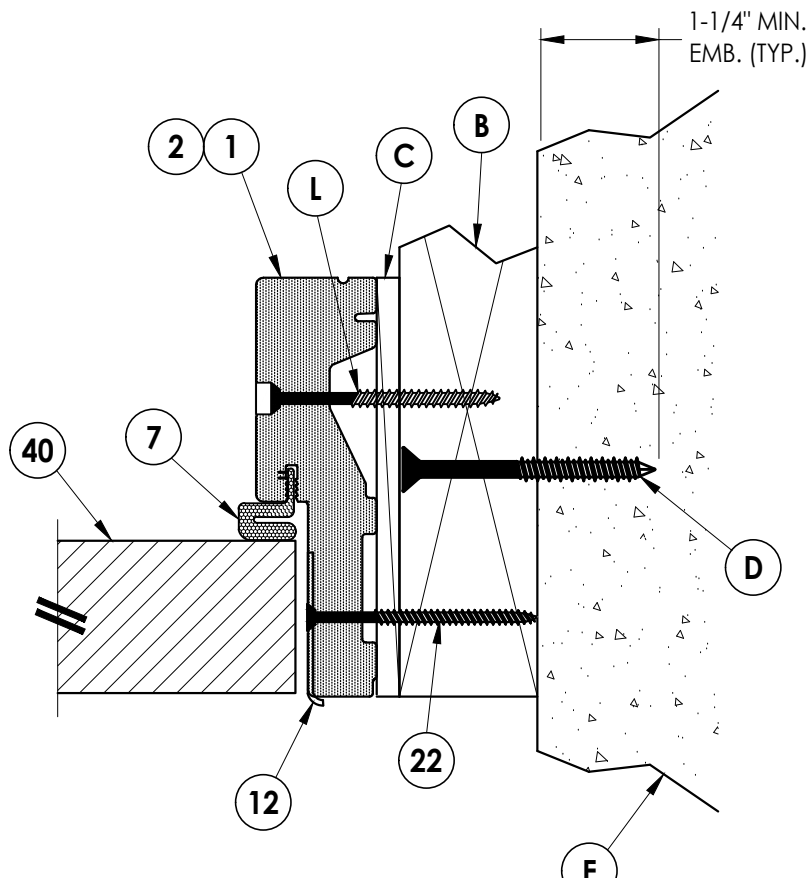

2
4 **HORIZONTAL CROSS SECTION**
Outswing Shown (Inswing Similar)
Shown w/ 2X Buck


PRODUCT: TRINITY FIBERGLASS DOOR		PART OR ASSEMBLY: HORIZONTAL & VERTICAL CROSS SECTIONS (2X BUCK)	
		LFS	BY
		UPDATE TO 9TH ED. (2026) FBC	
		NO. DATE	REVISIONS
		1 7/01/26	
DATE: 1/30/25			
SCALE: N.T.S.			
DWG. BY: RW			
CHK. BY: LFS			
DRAWING NO.: FL-47284.1			
SHEET 4 OF 9			

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW


BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

© 2025 R.W. BUILDING CONSULTANTS INC.

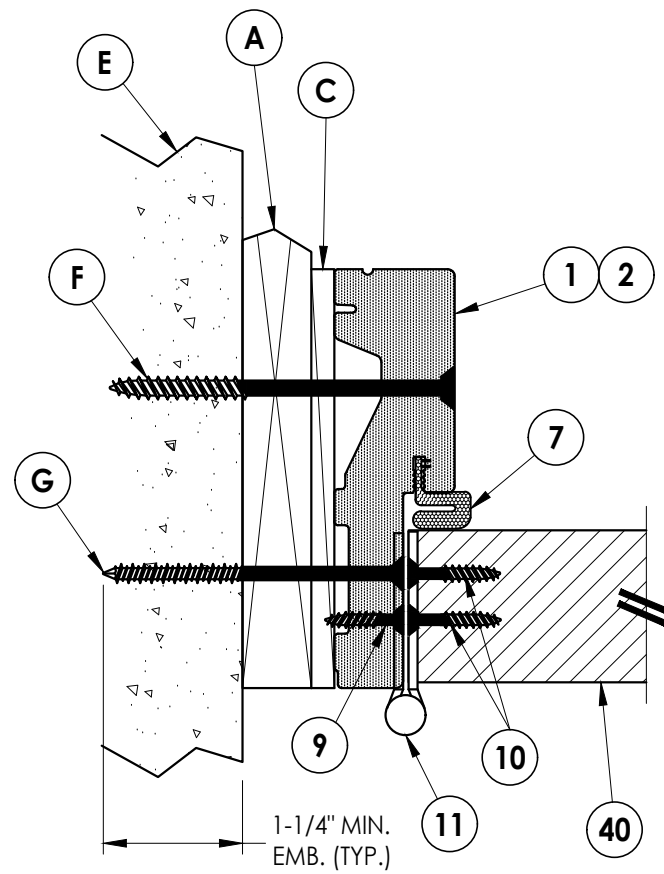


1 HORIZONTAL CROSS SECTION

5 Outswing Shown (Inswing Similar) Shown w/ 1X Buck

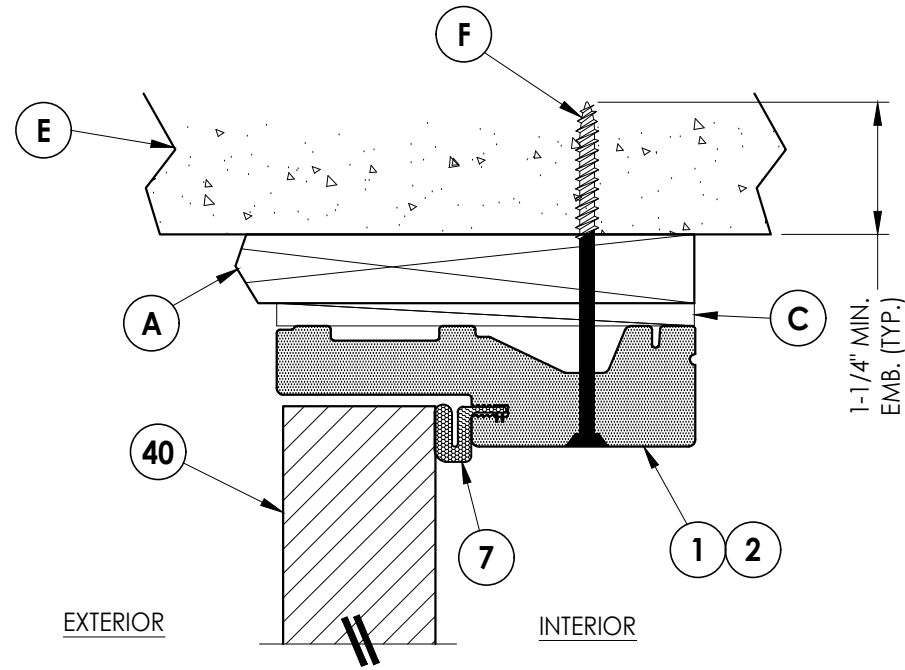

3 VERTICAL CROSS SECTION
5 Outswing Shown (Inswing Similar)
 Shown w/ 1X Buck

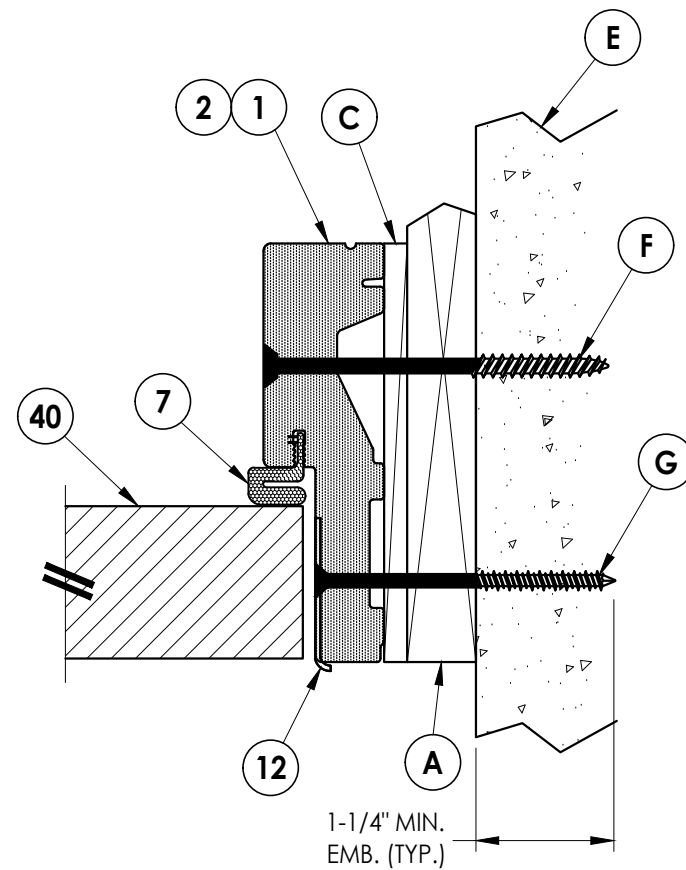


2 **HORIZONTAL CROSS SECTION**
5 Outswing Shown (Inswing Similar)
 Shown w/ 1X Buck

[illegible]

PRODUCT:	TRINITY FIBERGLASS DOOR
PART OR ASSEMBLY:	HORIZONTAL & VERTICAL CROSS SECTIONS (1X BUCK)


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

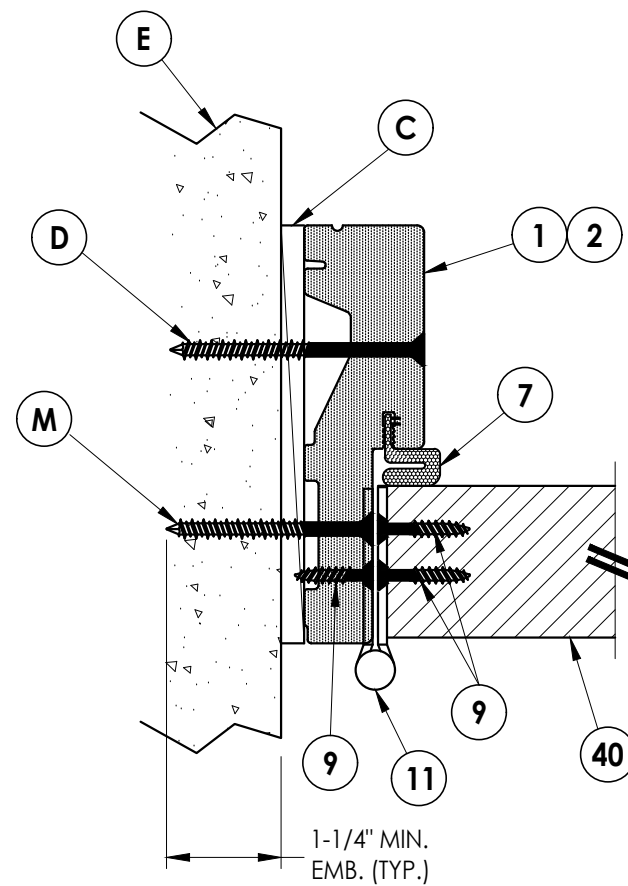


1 **HORIZONTAL CROSS SECTION**

6 Outswing Shown (Inswing Similar)
Shown Direct to Masonry

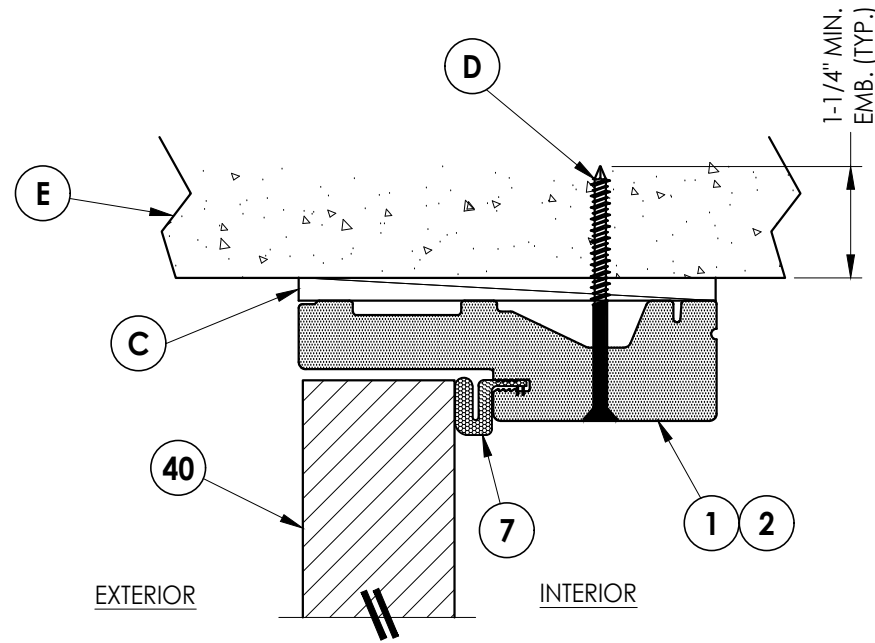

3 **VERTICAL CROSS SECTION**
6 Outswing Shown (Inswing Similar)
Shown Direct to Masonry

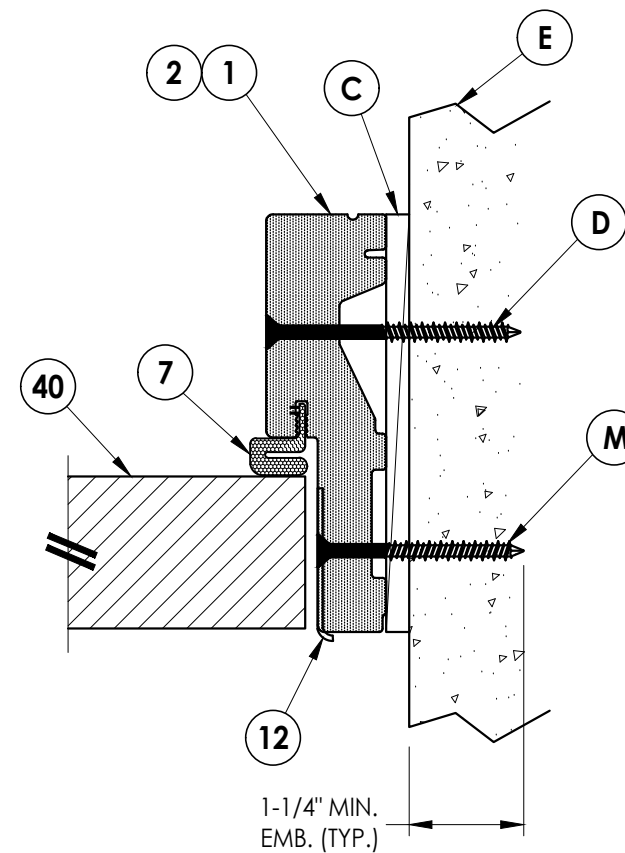

2 **HORIZONTAL CROSS SECTION**
6 Outswing Shown (Inswing Similar)
 Shown Direct to Masonry


[illegible]

PRODUCT:	TRINITY FIBERGLASS DOOR
PART OR ASSEMBLY:	HORIZONTAL & VERTICAL CROSS SECTIONS (DIRECT TO MASONRY)


Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

Z:\2023 FBC Drawings\Trinity Glass Int\FL-47284 R2\FL-47284.1.dwg

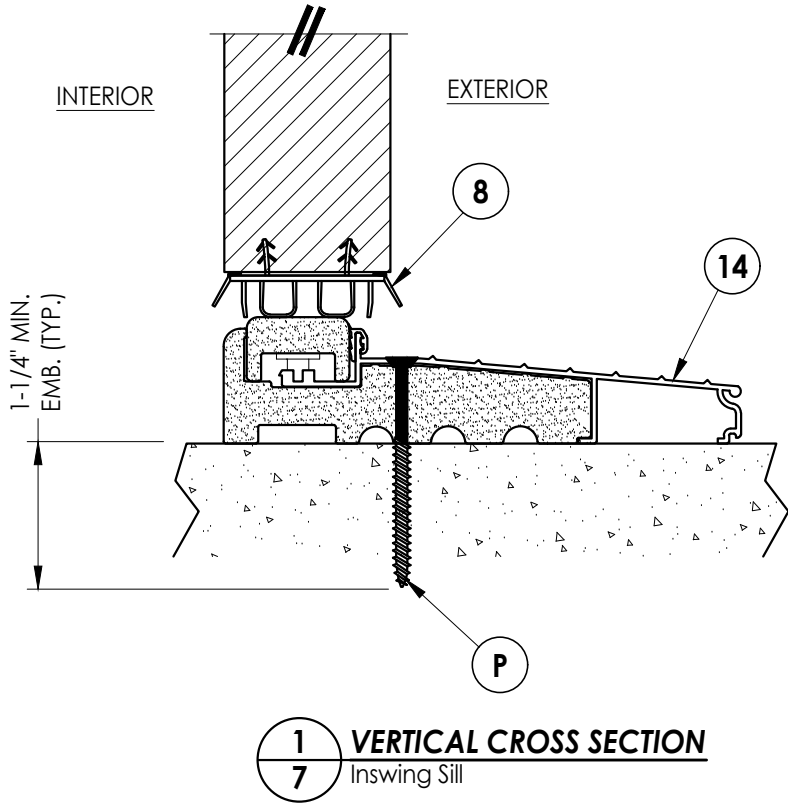

1
7 VERTICAL CROSS SECTION
Inswing Sill

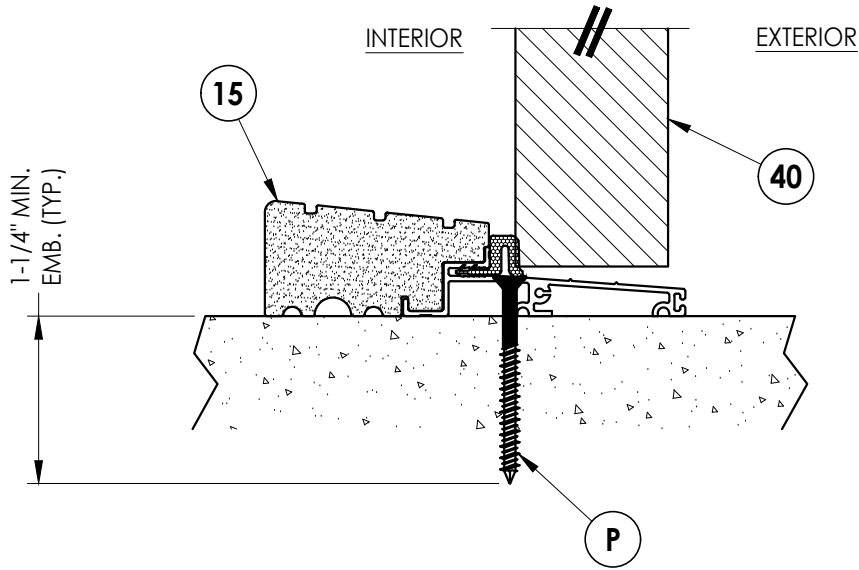

2
7 VERTICAL CROSS SECTION
Outswing Sill

DATE: 1/30/25	
SCALE: N.T.S.	
DWG. BY:	RW
CHK. BY:	LFS
DRAWING NO.: FL-47284.1	
SHEET 7	OF 9

1	7/01/26	UPDATE TO 9TH ED. (2026)	FBC	LFS	
NO.	DATE			BY	
REVISIONS					

PRODUCT:	TRINITY FIBERGLASS DOOR
PART OR ASSEMBLY:	VERTICAL CROSS SECTIONS (THRESHOLDS)

Documents Prepared By: Lyndon F. Schmidt P.E. No. 43409		BUILDING CONSULTANTS, INC. P.O. Box 230, Valrico, FL 33595 Phone No.: 813.659.9197 FBPE Registry No. 9813



HARDWARE DETAILS

[illegible]

Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33486
Phone No.: 813.659.9197
FBPE Registry No. 9813

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK (G >= 0.42)	WOOD
B	2X BUCK (G >= 0.42)	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	1/4" X 3-3/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
G	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
L	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMB.)	STEEL
M	3/16" X 2-1/4" PFH ITW CONCRETE SCREW	STEEL
P	1/4" X 2-1/4" PFH DeWALT OR ITW CONCRETE SCREW	STEEL
1	PVC JAMB	PVC
2	WOOD JAMB	WOOD
7	WEATHERSTRIP	FOAM
8	DOOR SWEEP	VINYL
9	#9 X 3/4" PFH WOOD SCREW	STEEL
10	#9 X 1" PFH WOOD SCREW	STEEL
11	4" X 4" HINGE	STEEL
12	LATCH STRIKE PLATE	STEEL
13	DEADBOLT STRIKE PLATE	STEEL
14	INSWING THRESHOLD	ALUM/COMP
15	OUTSWING THRESHOLD	ALUM/COMP
20	#8 X 1/2" PFH WOOD SCREW	STEEL
22	#8 X 2-1/2" PFH WOOD SCREW	STEEL
30	#12 X 2-1/2" PFH WOOD SCREW	STEEL
40	DOOR PANEL	-





CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW BUILDEX TAPCON®	3/16"	1-1/4"	3"	1-1/2"
	1/4"	1-1/4"	2"	4"
DeWALT ULTRAON®+	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

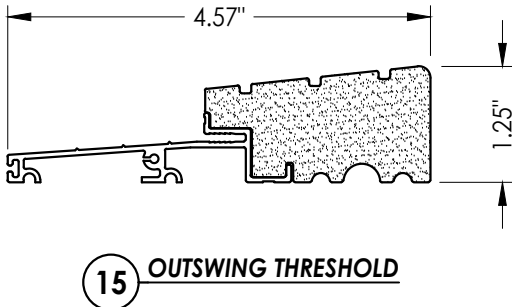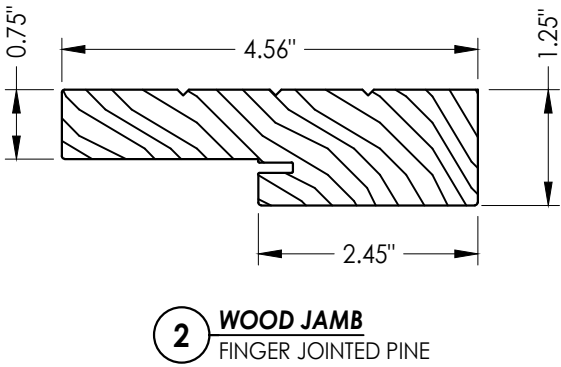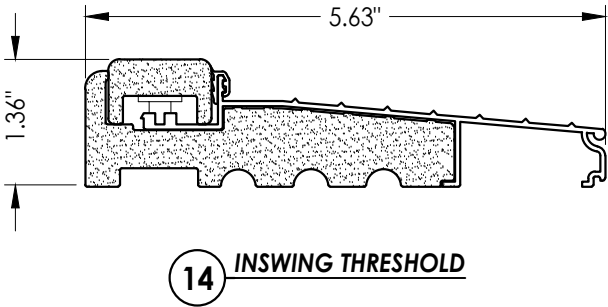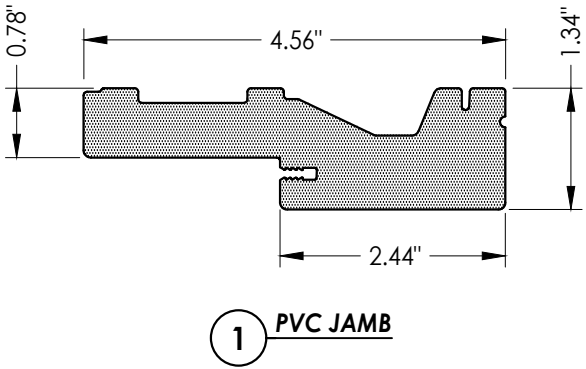[illegible]