

c:\users\msun\building drops, inc\building drops\landing - common\projects\vision hollow metal limited\fbc-24-0157.2 - fbc submittal - hollow metal doors\dwgs\vhm003.dwg 2/25/2025 3:21 PM

VISION HOLLOW METAL LIMITED

LS18/LS1875 STEEL DOOR

(HVHZ) (IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC) **INCLUDING** HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- ASTM E283-19
 - ASTM E330-14(21)
 - ASTM E1886-19
 - ASTM E1996-20
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. FRAME AND DOOR SKIN MATERIAL: STEEL.
7. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND TABLE OF CONTENTS
2	ELEVATIONS AND DOOR SCHEDULE
3	ELEVATIONS
4	DOOR LEAF DETAILS
5	VERTICAL SECTIONS
6	VERTICAL SECTIONS
7	HORIZONTAL SECTIONS
8	HORIZONTAL SECTIONS
9	ANCHOR LAYOUTS AND INSTALLATION NOTES
10	ANCHOR LAYOUTS
11	BILL OF MATERIALS AND COMPONENTS
12	COMPONENTS

FRAME SIZE	DESIGN PRESSURE	IMPACT MISSILE RATING
SEE SHEET 2		LARGE & SMALL MISSILE IMPACT



400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121

TITLE:

LS18/LS1875 STEEL DOOR
(HVHZ) (IMPACT)
GENERAL NOTES &
TABLE OF CONTENTS

PREPARED BY:



BUILDING DROPS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E
Reason: I am approving this document
Date: 2025.02.26 07:13:40 -08'00'



HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL47318

DATE:

01.27.2025

DWG. BY:

MS

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

VHM003


SHEET:

1

OF 12



***NOTE: FOR ELEVATIONS THAT HAVE NOT BEEN RATED FOR WATER INFILTRATION. IF AUTHORITY HAVING JURISDICTION REQUIRES THAT PRODUCT MEETS THIS REQUIREMENT, PRODUCT SHALL BE USED WHEN INSTALLED AT LOCATION PROTECTED BY OVERHANG SUCH THAT OVERHANG (OH) RATIO = OH LENGTH ÷ OH HEIGHT IS ≥1.0**

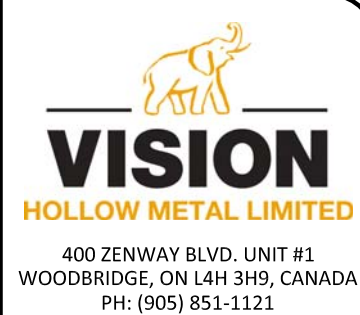

VARIATIONS & DOOR SCHEDULE


PREPARED BY:

BUILDING DROPS, INC.
1000 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

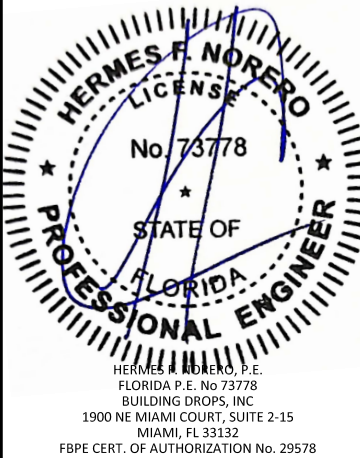

FL #: **FL47318**

DATE: 01.27.2025

DWG. BY:
MS

CHK. BY:
HFN


SCALE: **NTS**

DWG. #: **VHM003**


SHEET:

2


c:\users\msun\building drops, inc\building drops landing - common\projects\vision hollow metal limited\hmc-24-0157.2 - fbc submittal - hollow metal doors\dwgs\hmm003.dwg 2/25/2025 3:21 PM

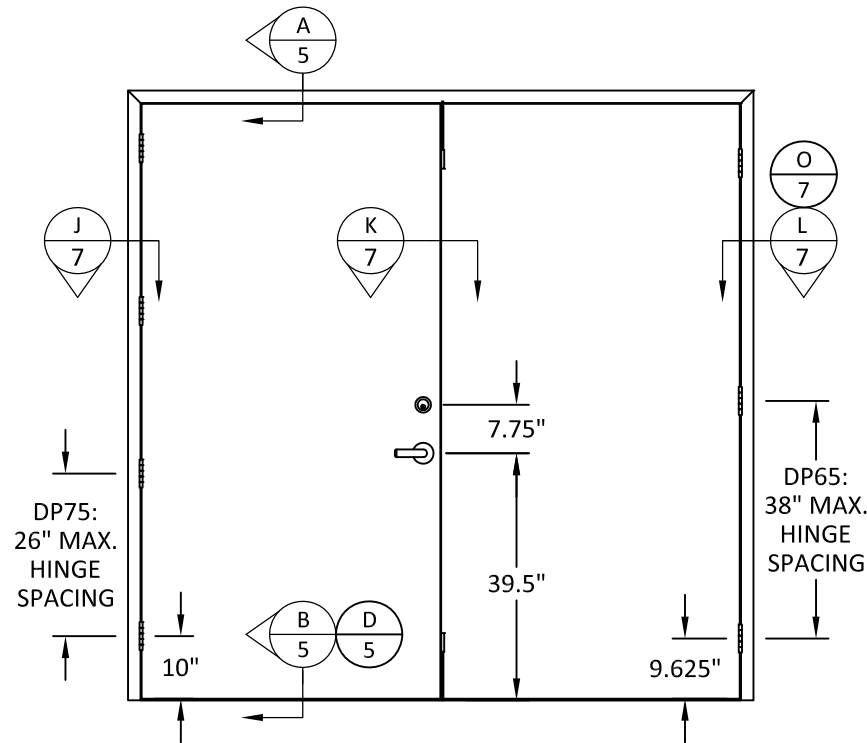


ELEVATION #4
OUTSWING DOUBLE DOOR

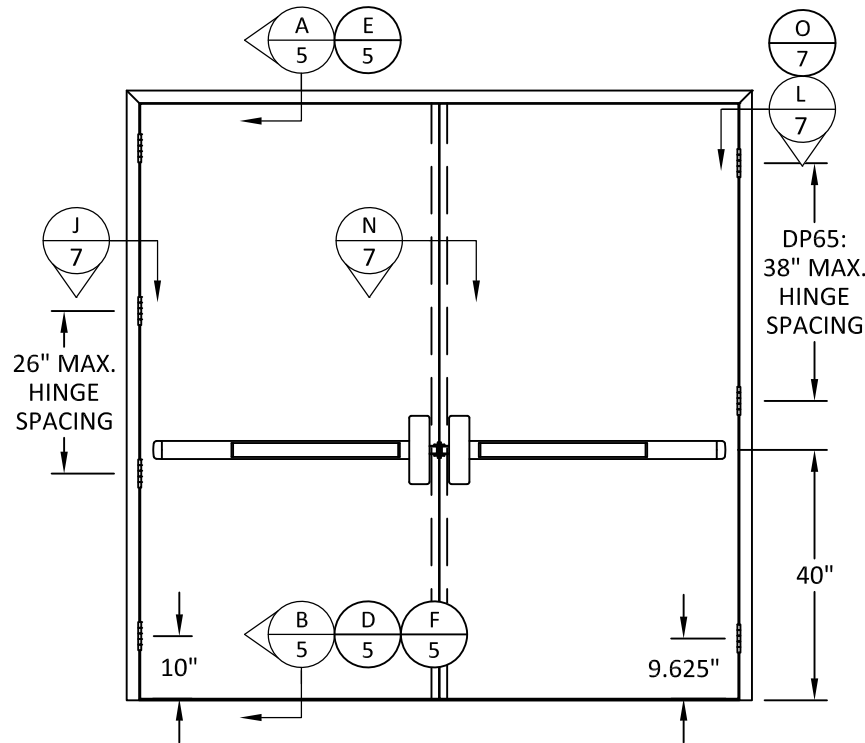


ELEVATION #5
OUTSWING DOUBLE DOOR

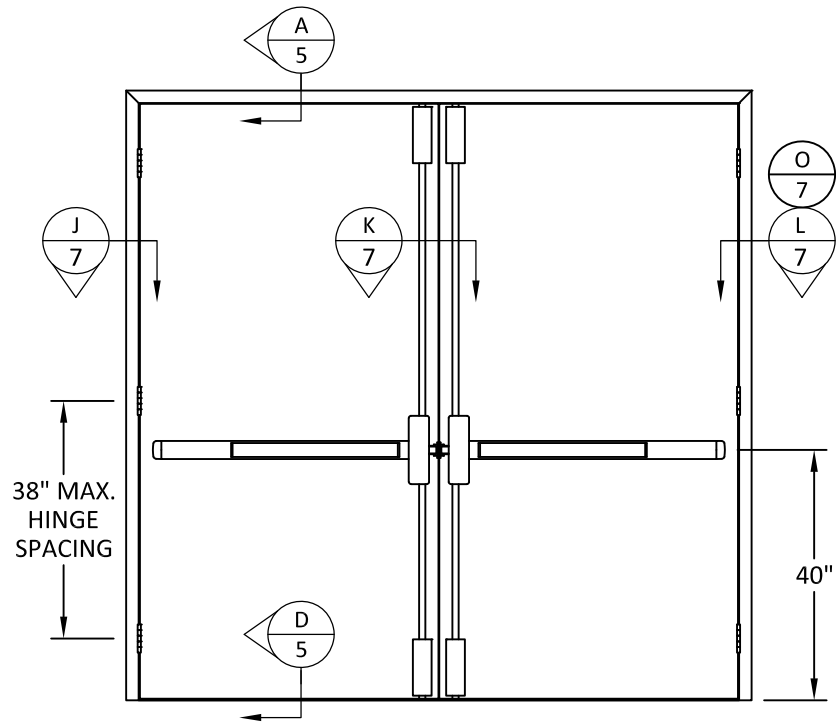


ELEVATION #6
OUTSWING DOUBLE DOOR

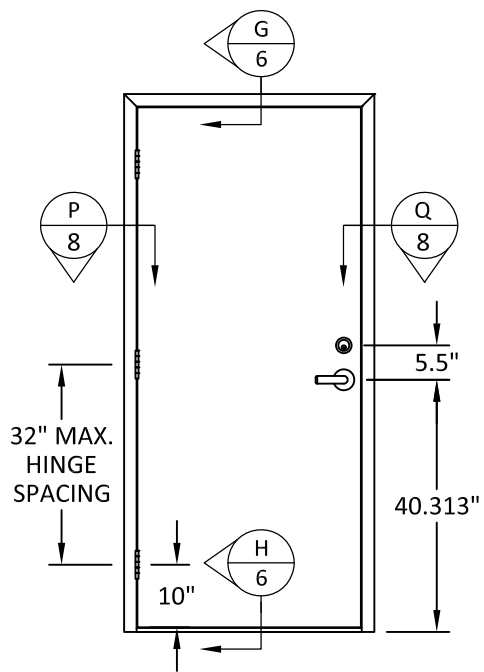


ELEVATION #7
INSWING SINGLE DOOR

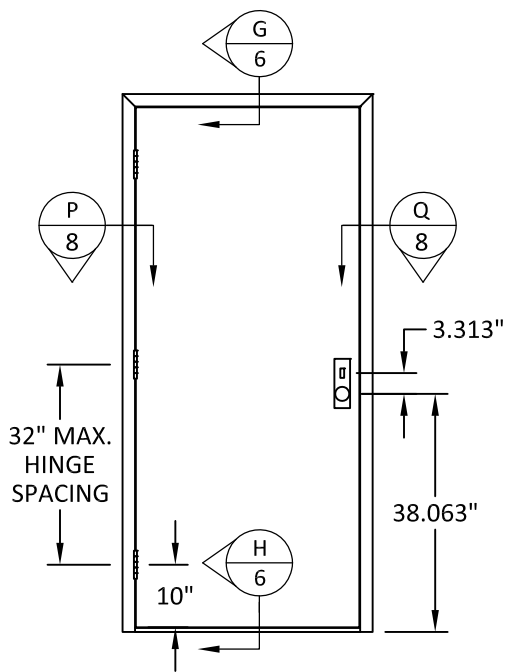

ELEVATION #8
INSWING SINGLE DOOR

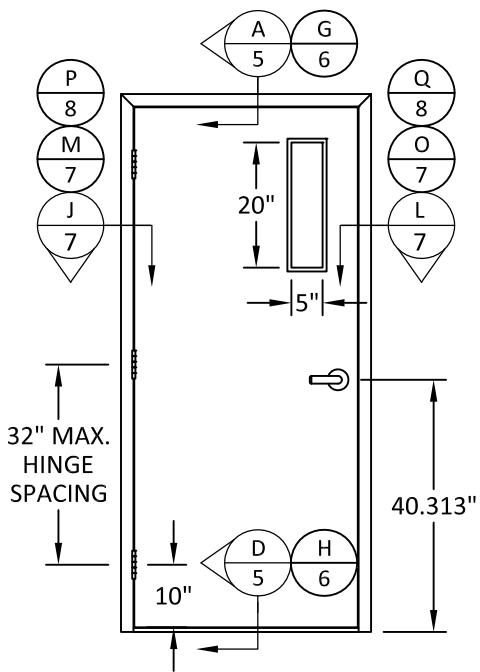

ELEVATION #9
INSWING/OUTSWING SINGLE DOOR

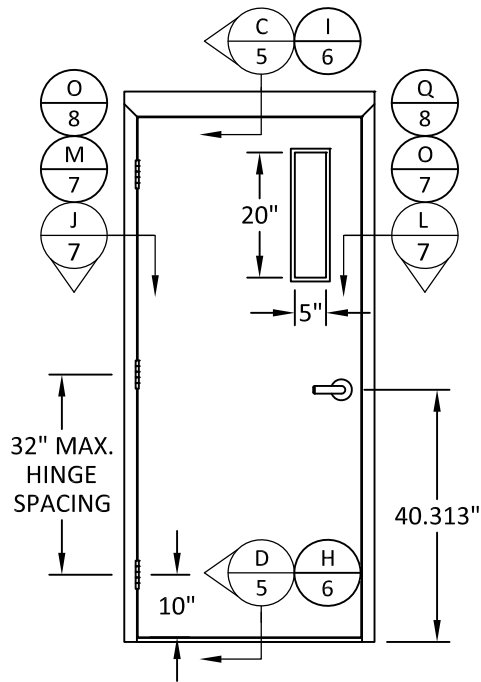


ELEVATION #10
INSWING/OUTSWING SINGLE DOOR
W/ 4" HEADER


VISION
HOLLOW METAL LIMITED
400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121

TITLE: LS18/LS1875 STEEL DOOR (HVHZ) (IMPACT) ELEVATIONS
PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

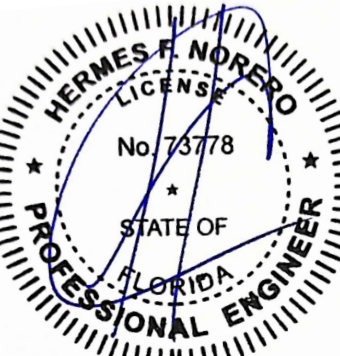
HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578


FL #: **FL47318**
DATE: **01.27.2025**
DWG. BY: **MS** CHK. BY: **HFN**
SCALE: **NTS**
DWG. #: **VHM003**
SHEET: **3**
OF 12

c:\users\msun\building drops, inc\building drops landing - common\projects\vision hollow metal limited\hbc-24-0157.2 - fbc submittal - hollow metal doors\dwgs\hbm003.dwg 2/25/2025 3:21 PM

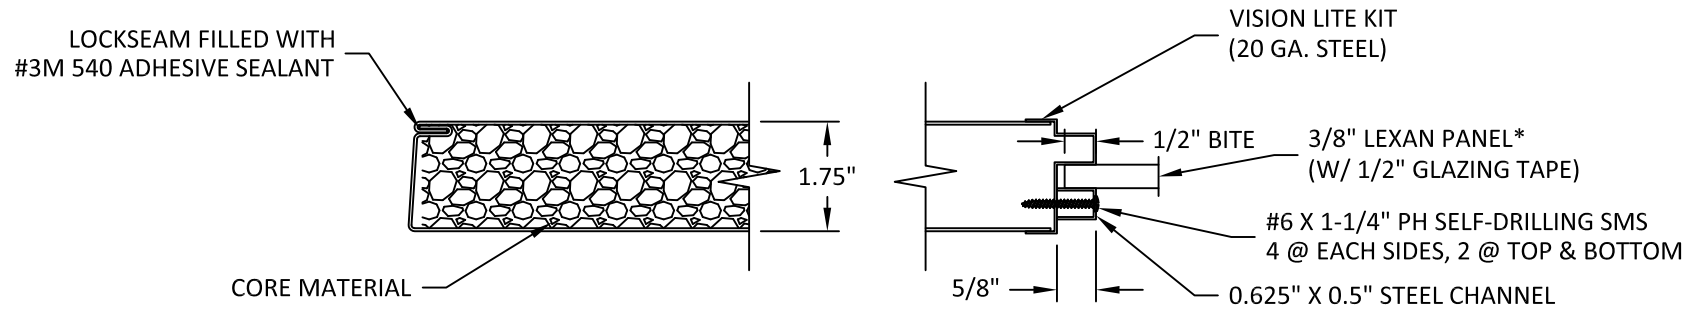


1
4 HORIZONTAL SECTION

* FOR ALTERNATE INFILL OPTION, SEE SEPARATE APPROVAL FOR DETAILS.

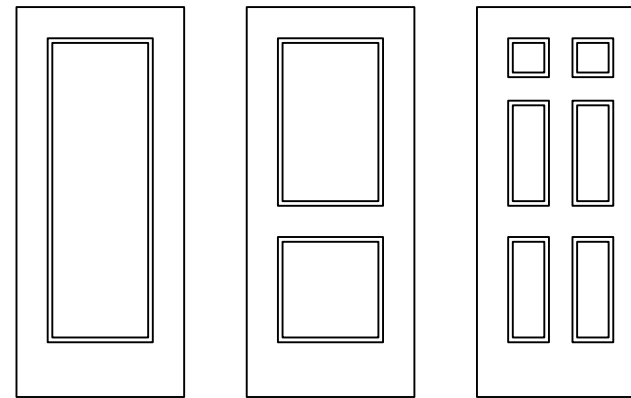

OPTIONAL EMBOSSEMENTS

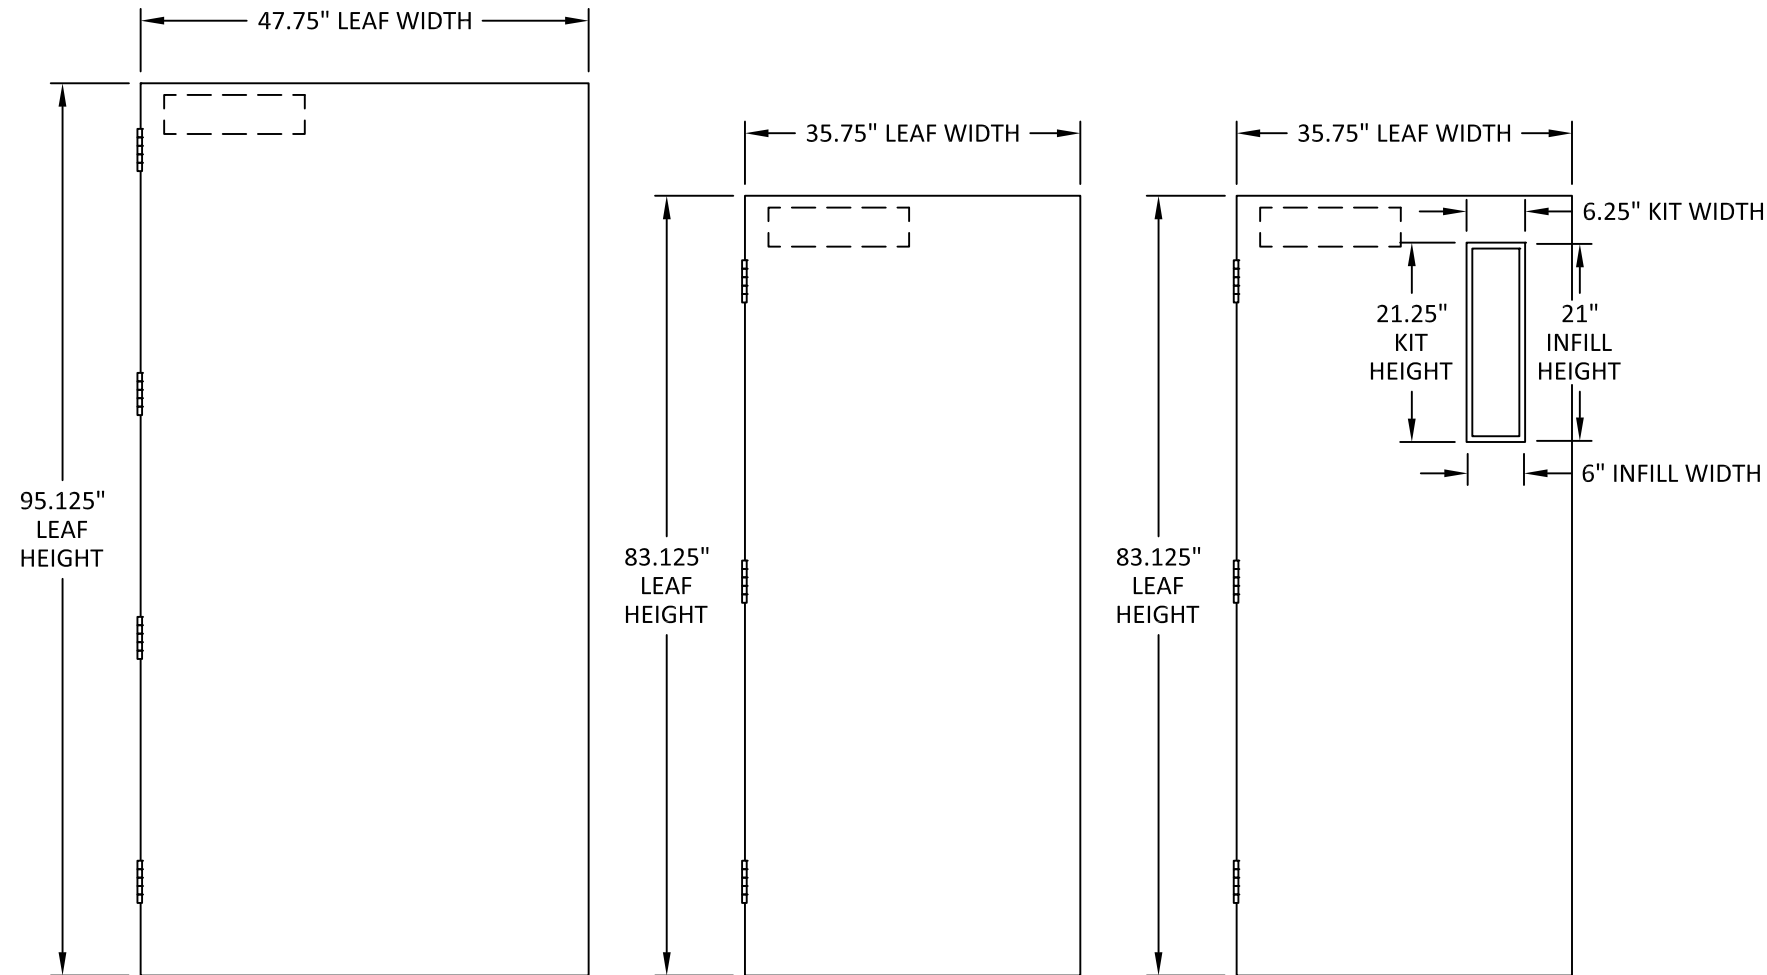





8'-0" DOOR LEAF
ELEVATIONS # 1, 2, 3, 4, 5, & 6

7'-0" DOOR LEAF
ELEVATIONS # 7 & 8

7'-0" DOOR LEAF
ELEVATIONS # 9 & 10

STEEL DOOR SKIN: 18 GA. (MIN. 0.042" THK.) GALV. STEEL
CORE MATERIAL: HONEYCOMB OR EPS FOAM (POLYSTYRENE - 1.0 PCF MIN. DENSITY)

2
4 VERTICAL SECTION

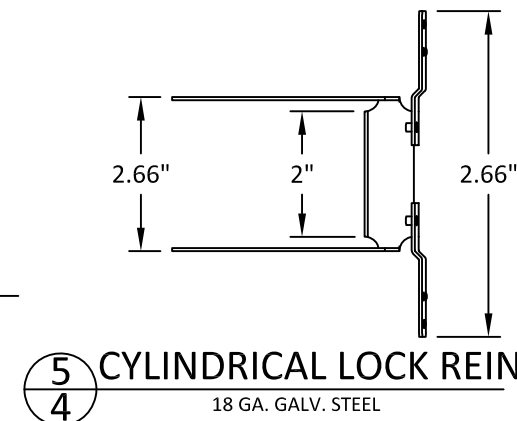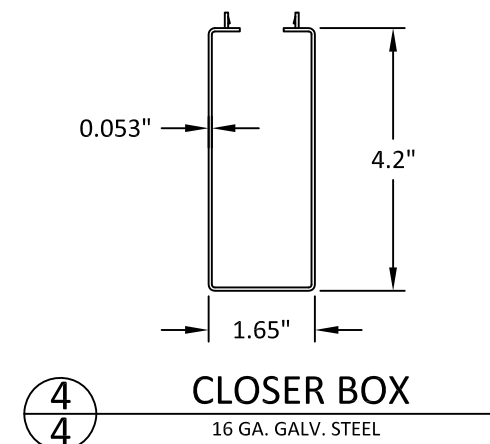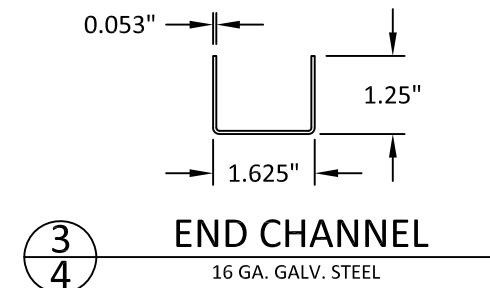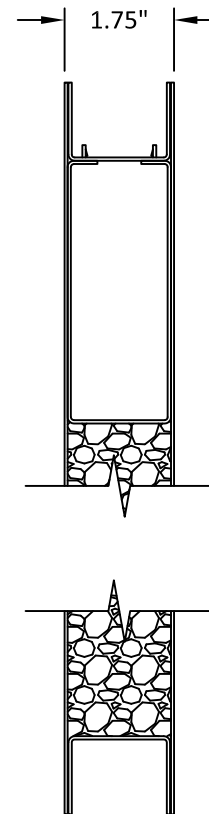


VISION
HOLLOW METAL LIMITED

400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121


TITLE: LS18/LS1875 STEEL DOOR (HVHZ) (IMPACT)
DOOR LEAF DETAILS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com


BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

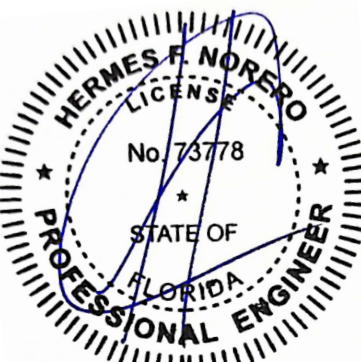
HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47318**

DATE: **01.27.2025**

DWG. BY: **MS** CHK. BY: **HFN**







SCALE: **NTS**

DWG. #: **VHM003**

SHEET: **4**

OF 12

c:\users\msun\building drops, inc\building drops landing - common\projects\vision hollow metal limited\fb-24-0157.2 - fbc submittal - hollow metal doors\dwgs\vhm003.dwg 2/25/2025 3:21 PM

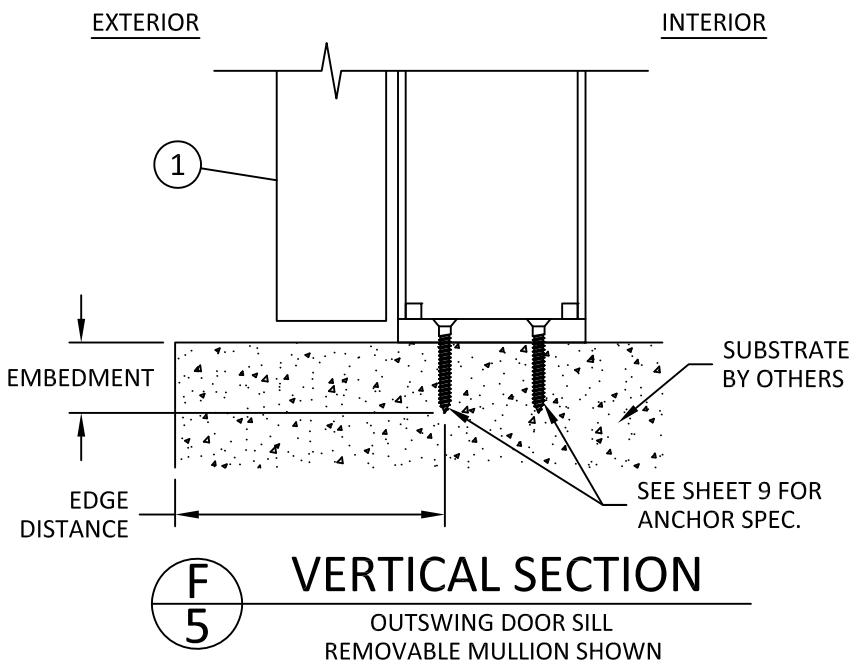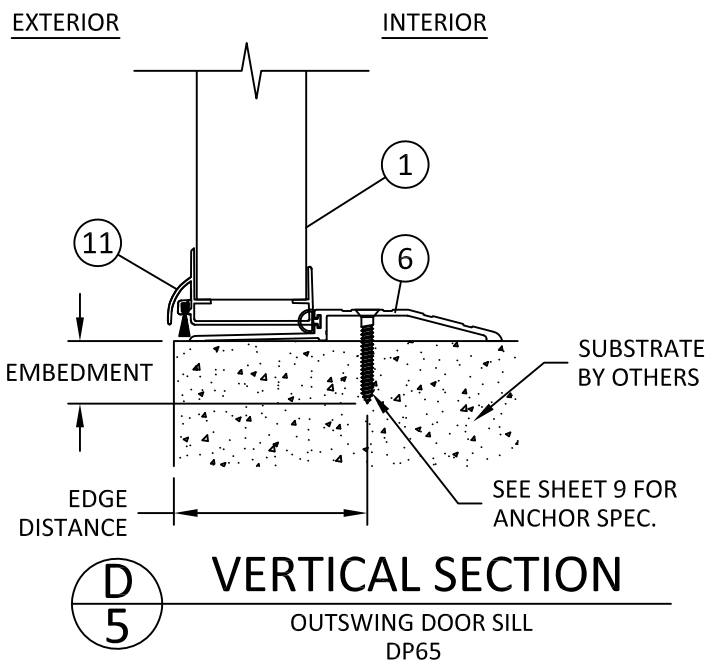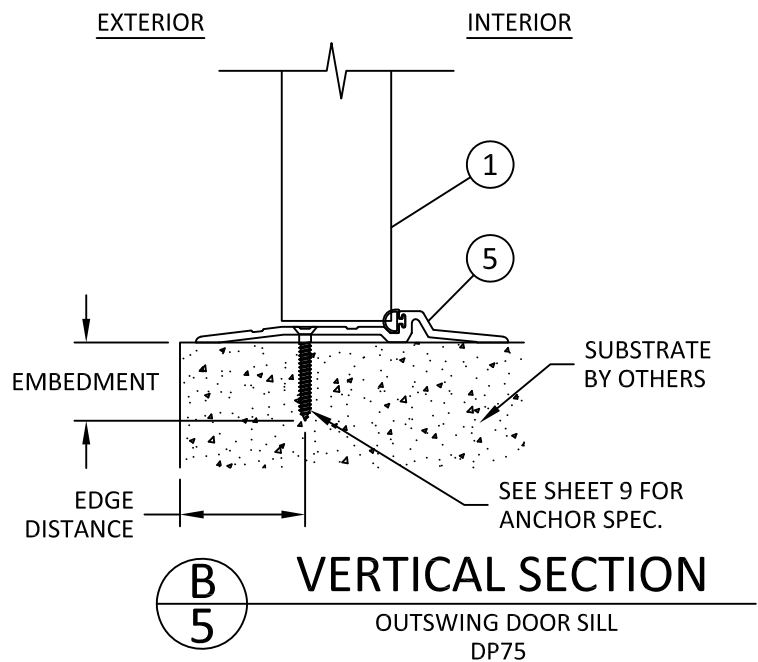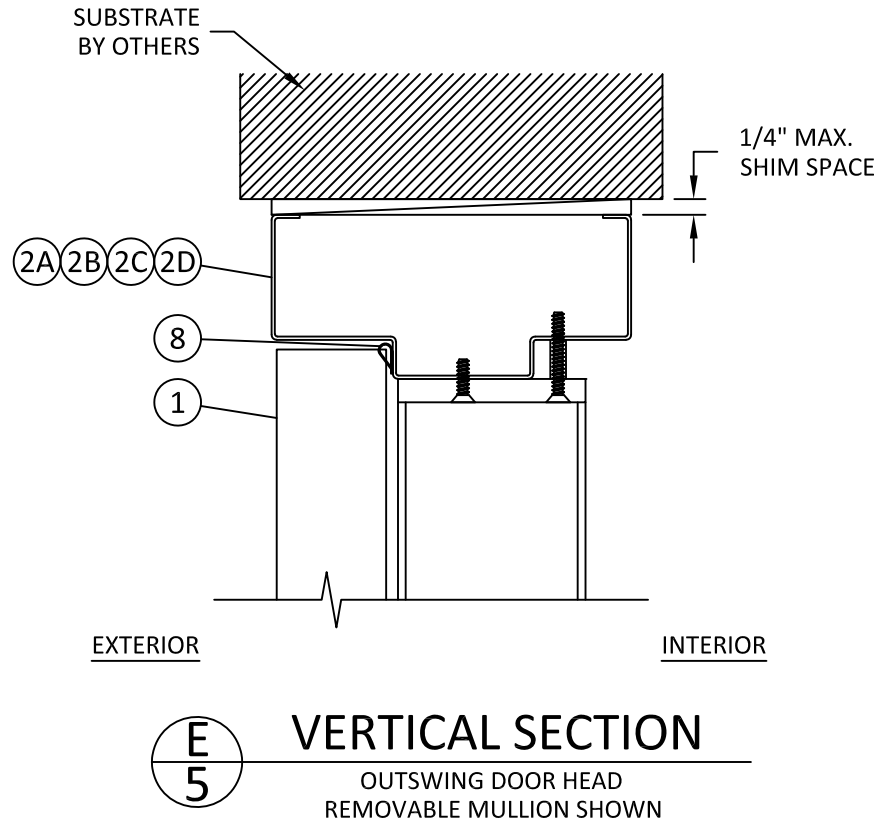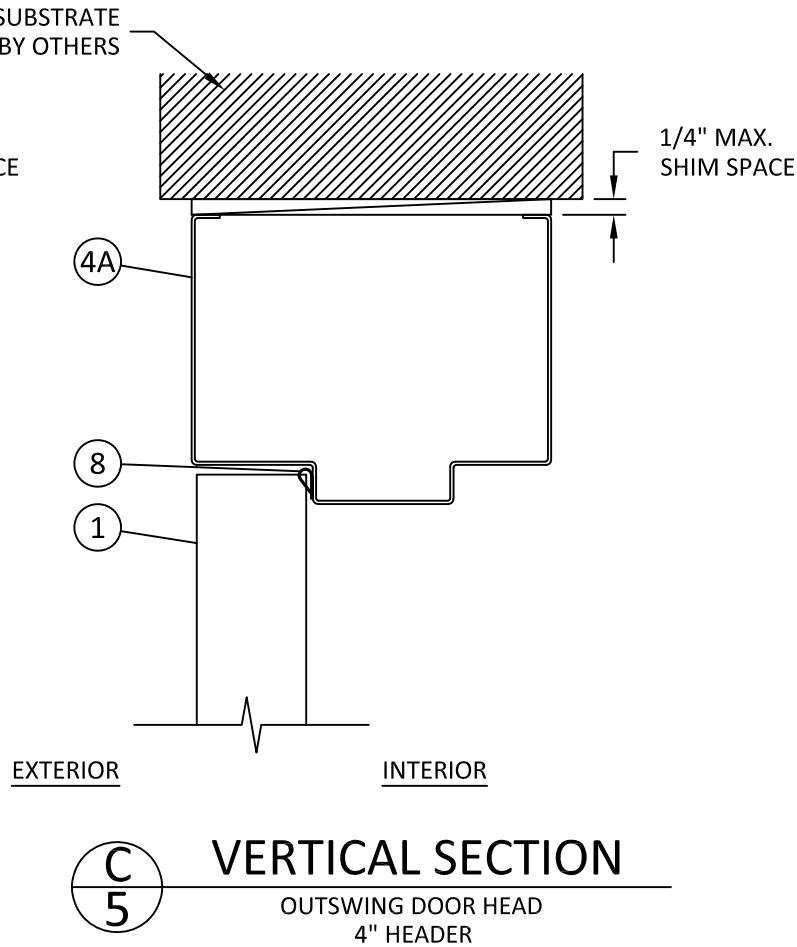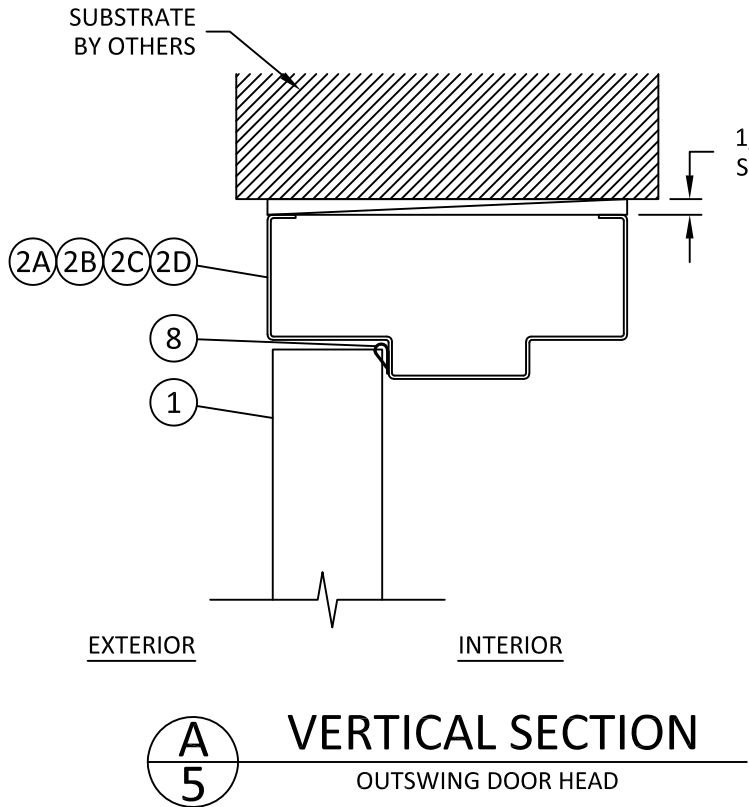



VISION
HOLLOW METAL LIMITED

400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121

TITLE:
LS18/LS1875 STEEL DOOR
(HVHZ) (IMPACT)
VERTICAL SECTIONS


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



BUILDING DROPS

REMARKS	BY	DATE


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

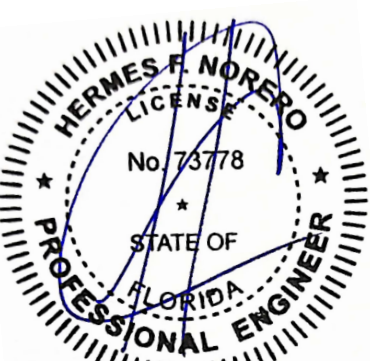


HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL47318
DATE:	01.27.2025
DWG. BY:	MS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	VHM003
SHEET:	5


c:\users\msun\building drops, inc\building drops landing - common\projects\vision hollow metal limited\lbc-24-0157.2 - fbc submittal - hollow metal doors\dwgs\vhm003.dwg 2/25/2025 3:21 PM

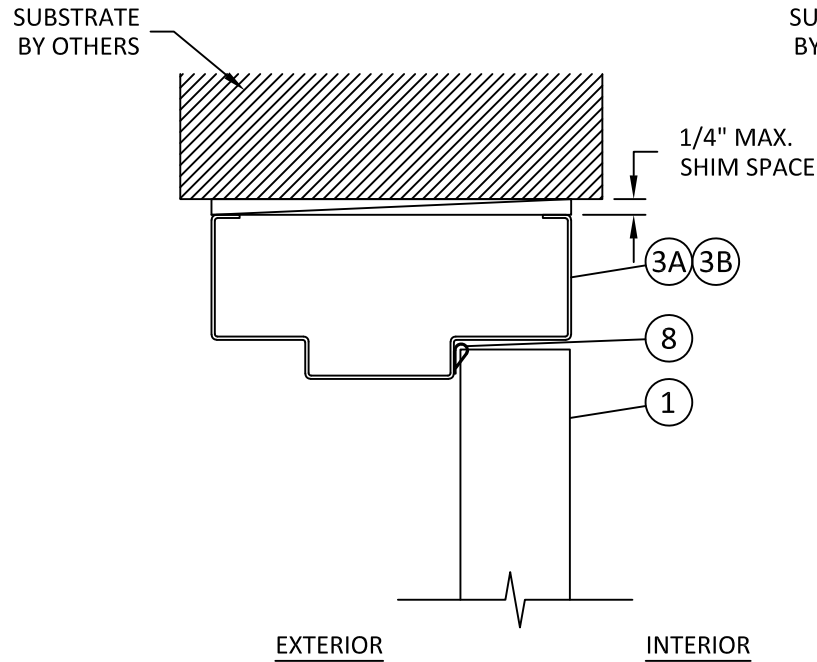


G
6 VERTICAL SECTION
INSWING DOOR HEAD

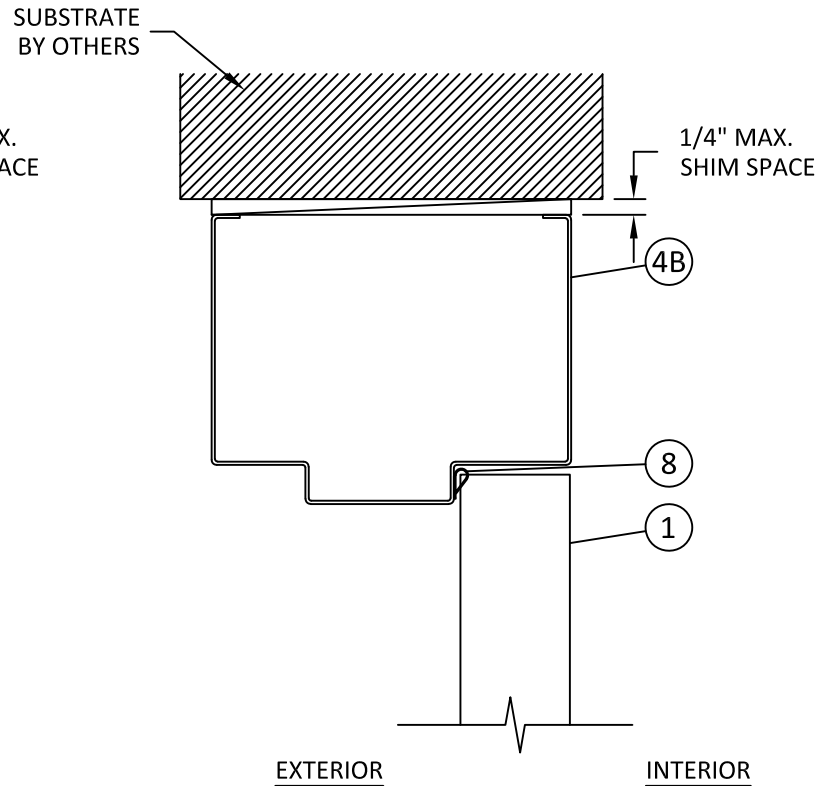


I
6 VERTICAL SECTION
INSWING DOOR HEAD
4" HEADER

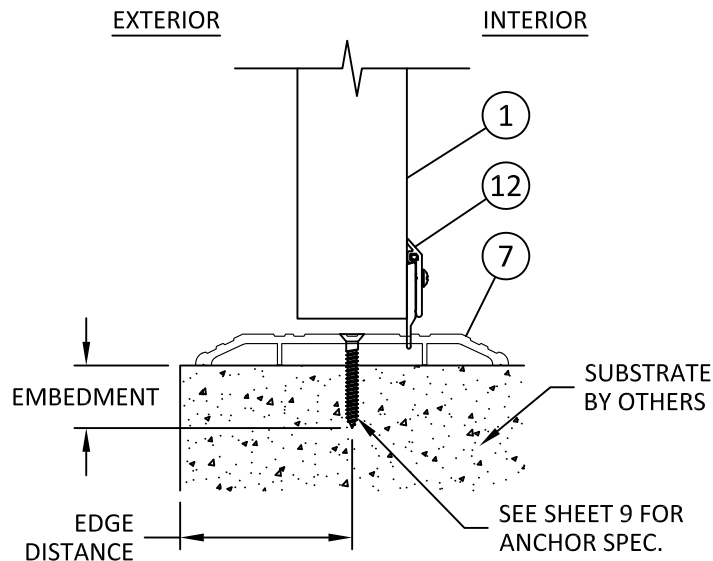

H
6 VERTICAL SECTION
INSWING DOOR SILL

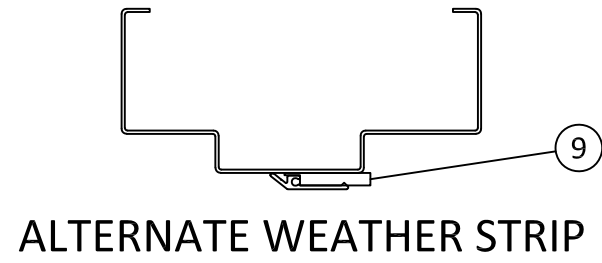

ALTERNATE WEATHER STRIP

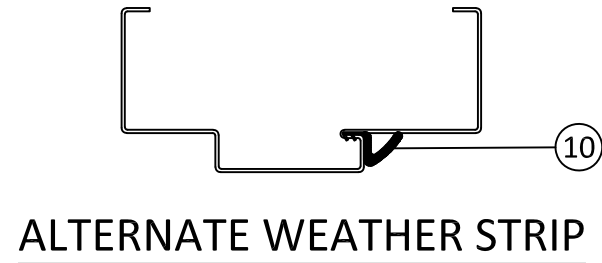

ALTERNATE WEATHER STRIP



VISION
HOLLOW METAL LIMITED

400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121

TITLE:

LS18/LS1875 STEEL DOOR
(HVHZ) (IMPACT)

VERTICAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

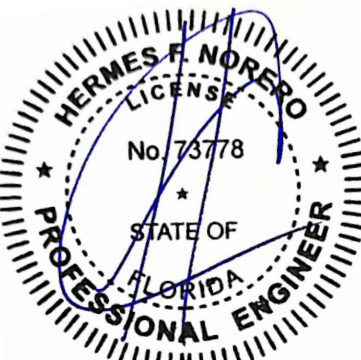

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL47318

DATE:

01.27.2025

DWG. BY:

MS

CHK. BY:

HFN

SCALE:

NTS

DWG. #:







VHM003

SHEET:

6

OF 12

c:\users\msun\building drops, inc\building drops landing - common\projects\vision hollow metal limited\hbc-24-0157.2 - fbc submittal - hollow metal doors\dwgs\hmm003.dwg 2/25/2025 3:22 PM

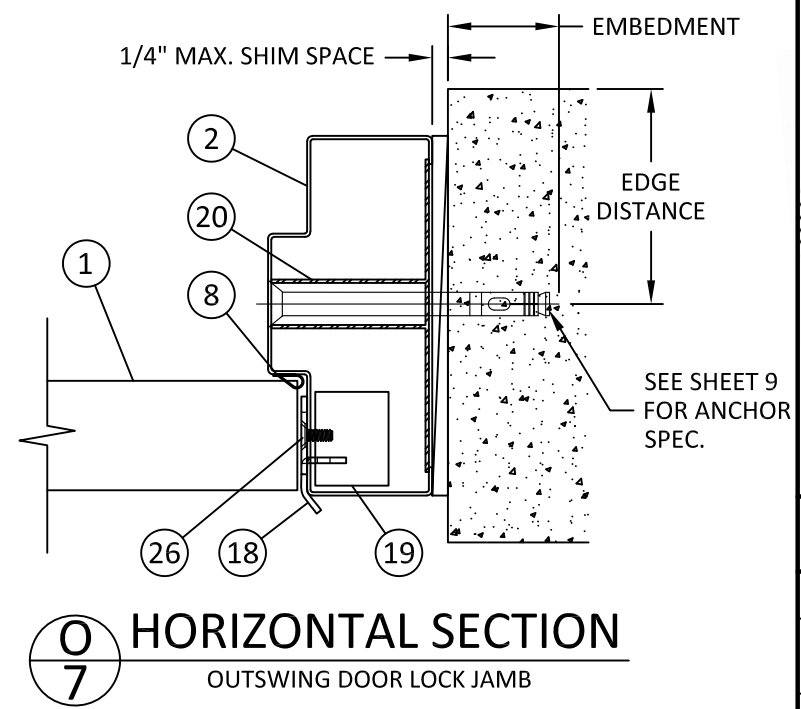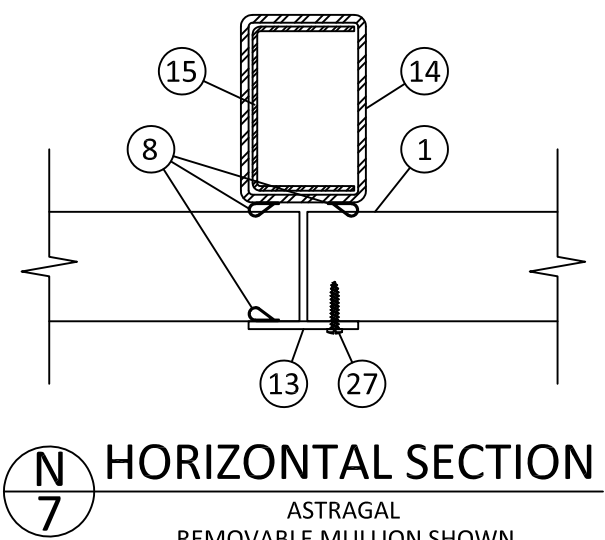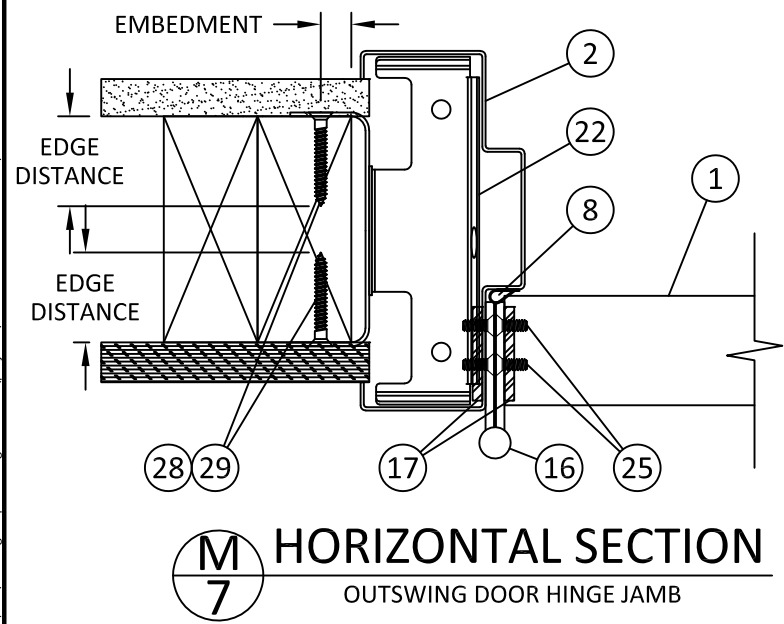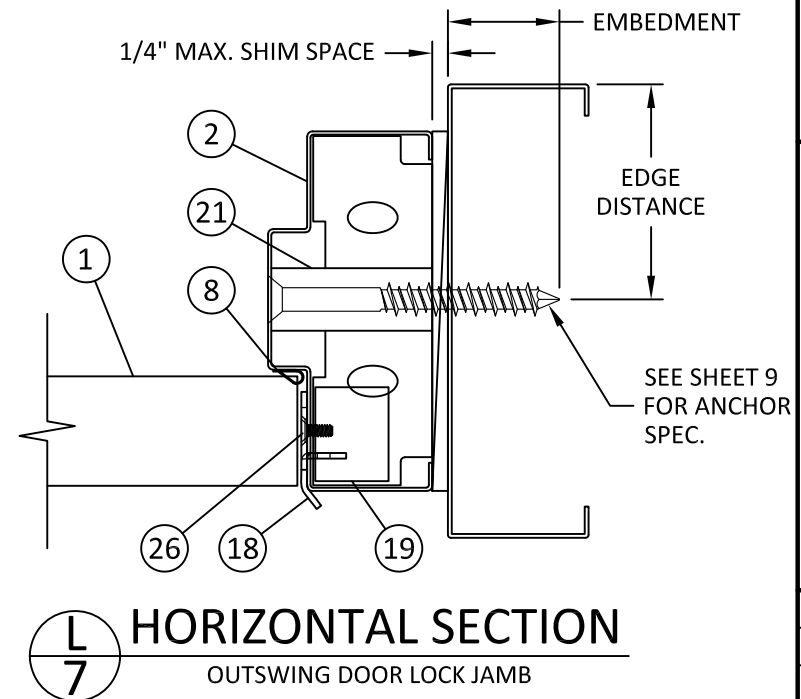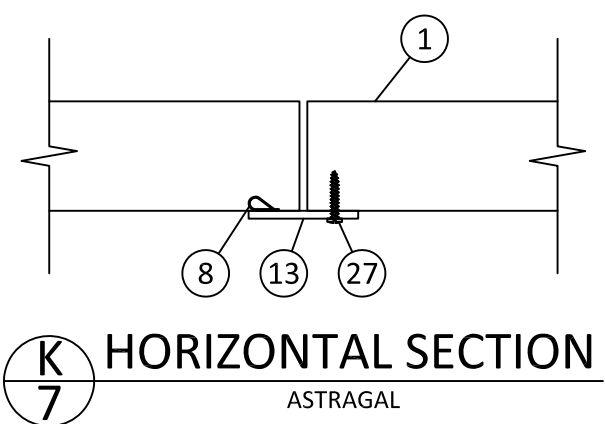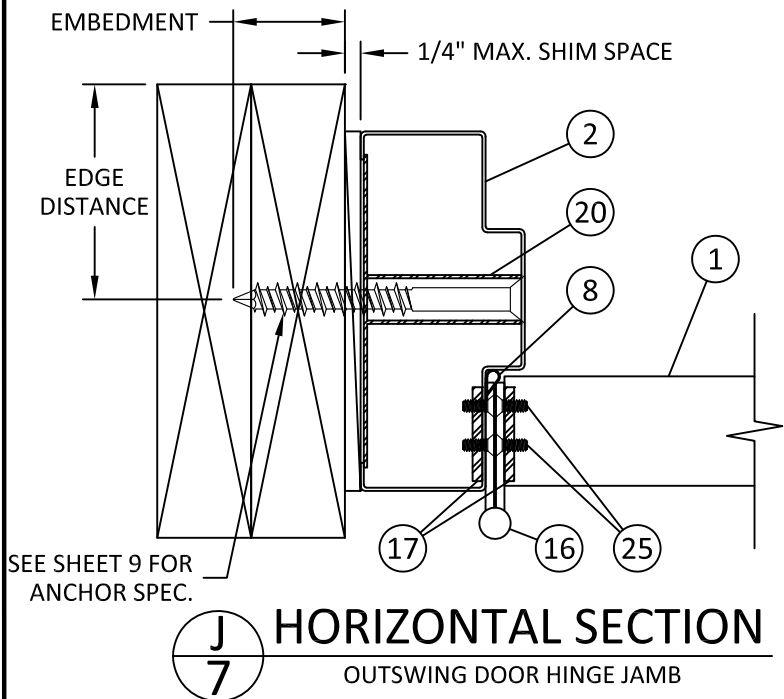

NOTE:
1. INSTALLATION SHOWN ON THIS SHEET ALSO APPLIES TO INSWING DETAILS.
2. STUD STRAP ANCHOR (M/7) IS LIMITED TO +65/-75 PSF AND NOT QUALIFIED FOR USE IN HVHZ.



400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121

TITLE: LS18/LS1875 STEEL DOOR (HVHZ) (IMPACT) HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47318**

DATE: **01.27.2025**

DWG. BY: MS	CHK. BY: HFN
--------------------	---------------------


SCALE: **NTS**

DWG. #: **VHM003**


SHEET: **7**

OF 12

c:\users\msun\building drops, inc\building drops landing - common\projects\vision hollow metal limited\hbc-24-0157.2 - fbc submittal - hollow metal doors\dwgs\hmm003.dwg 2/25/2025 3:22 PM

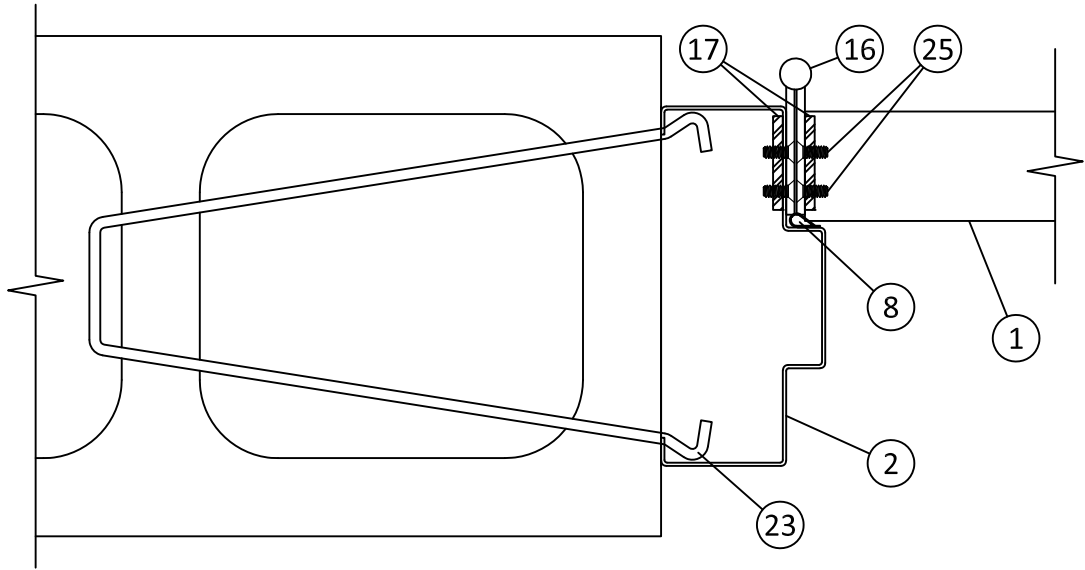

P
8 HORIZONTAL SECTION
IN SWING DOOR HINGE JAMB

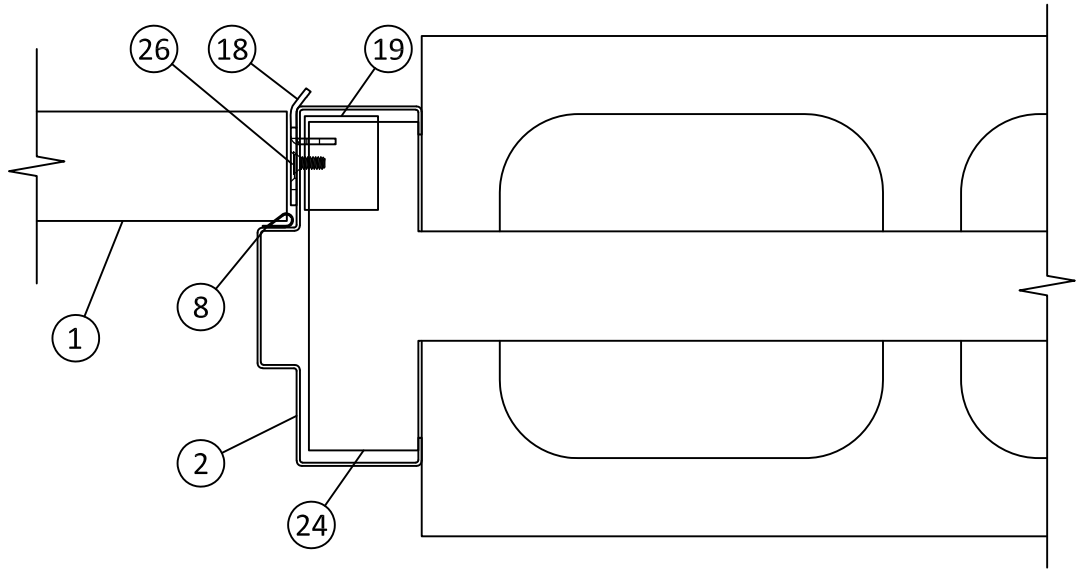

Q
8 HORIZONTAL SECTION
IN SWING DOOR LOCK JAMB

- NOTE:
1. INSTALLATION SHOWN ON THIS SHEET ALSO APPLIES TO OUTSWING DETAILS.
 2. T ANCHOR (Q/8) IS LIMITED TO DP65.



VISION
HOLLOW METAL LIMITED

400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121

TITLE:

LS18/LS1875 STEEL DOOR
(HVHZ) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL47318

DATE:

01.27.2025

DWG. BY:

MS

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

VHM003


SHEET:

8


OF 12

2/25/2025 3:22 PM


c:\users\msun\building drops, inc\building drops landing - common\projects\vision hollow metal limited\fbc-24-0157.2 - fbc submittal - hollow metal doors\dwgs\vhm003.dwg

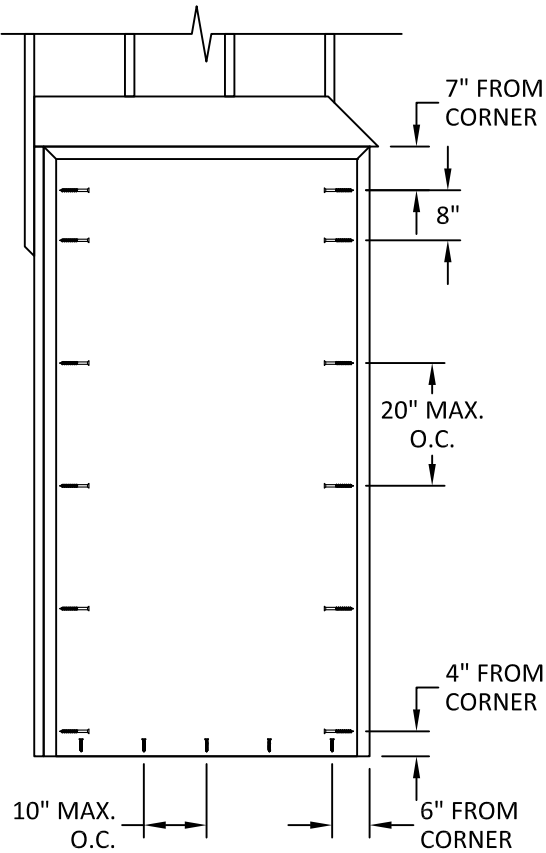


ANCHOR LAYOUT
WOOD/METAL STUDS
TUBE/BUTTERFLY ANCHOR
ELEVATION # 1, 2, & 3

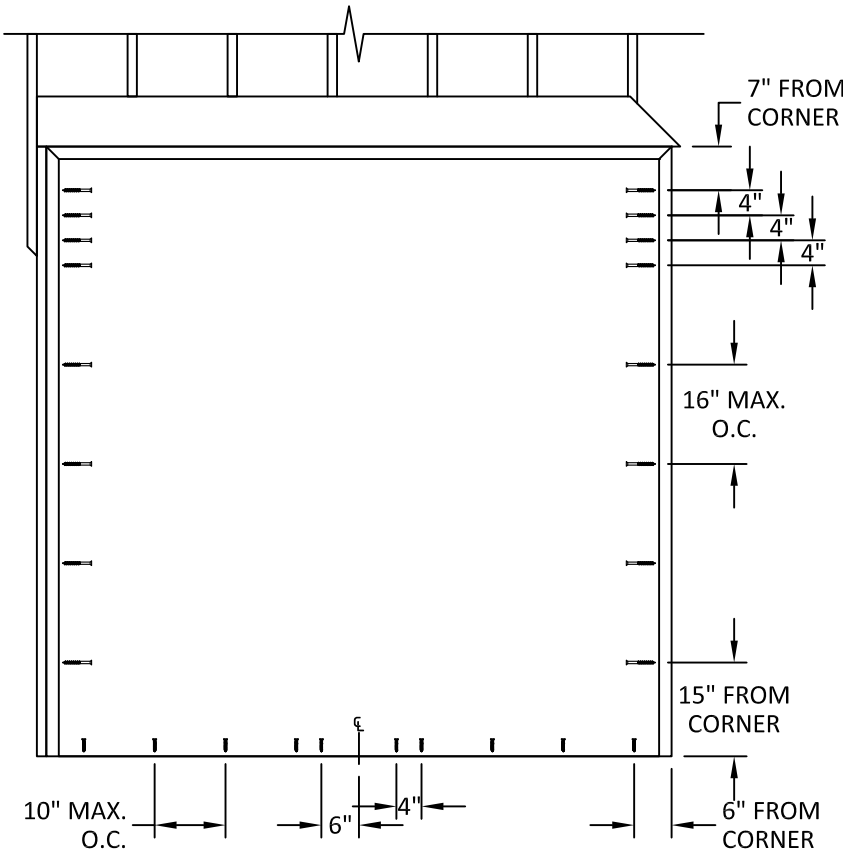

ANCHOR LAYOUT
WOOD/METAL STUDS
TUBE/BUTTERFLY ANCHOR
ELEVATION # 4, 5, & 6

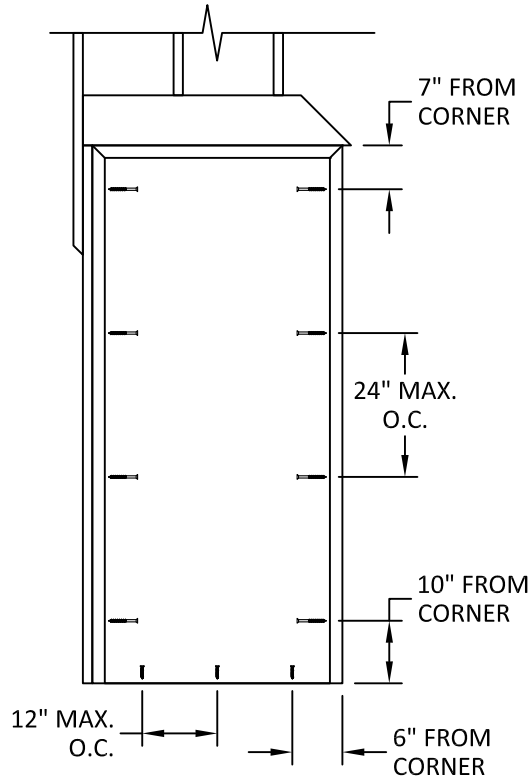

ANCHOR LAYOUT
WOOD/METAL STUDS
TUBE/BUTTERFLY ANCHOR
ELEVATION # 7, 8, 9, & 10

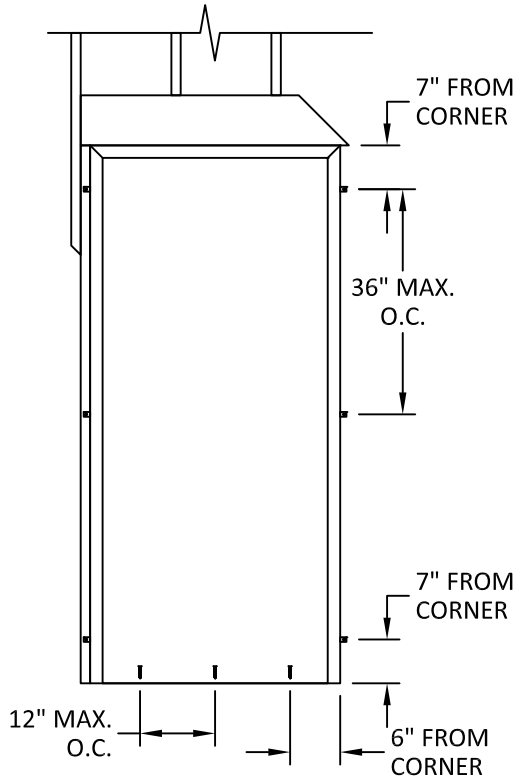

ANCHOR LAYOUT
WOOD/METAL STUDS
STUD STRAP ANCHOR
ELEVATION # 7, 8, 9, & 10

STUD STRAP ANCHOR IS LIMITED
TO +65/-75 PSF AND NOT
QUALIFIED FOR USE IN HVHZ.

ANCHOR SCHEDULE				
LOCATION	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
HEAD/ JAMB	WOOD: MIN. S.G. = 0.55	3/8" LAG SCREW	2-1/8"	1"
	STEEL: MIN. 16 GA. MIN. Fy = 33 ksi	3/8" GRADE 5 SELF-DRILLING/ SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	3/4"
	ALUMINUM: MIN. 1/8" THICK MIN. 6063-T5			
	CONCRETE: MIN. f'c = 3000 psi	3/8" ITW LDT	1-1/2"	2"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	WIRE ANCHOR, OR T-ANCHOR	-	-
SILL	WOOD: MIN. S.G. = 0.55	#14 WOOD SCREW	1-1/2"	1"
	STEEL: MIN. 16 GA. MIN. Fy = 33 ksi	1/4" GRADE 5 SELF-DRILLING/ SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
	ALUMINUM: MIN. 1/8" THICK MIN. 6063-T5			
	CONCRETE: MIN. f'c = 3000 psi	1/4" ITW TAPCON	1-1/2"	1-1/2"
MULLION BASE PLATE	CONCRETE: MIN. f'c = 3000 psi	1/4" DEWALT ULTRACON+	1-3/4"	2-1/2"

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF WOOD OR BETTER.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.



VISION
HOLLOW METAL LIMITED

400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121

TITLE:
LS18/LS1875 STEEL DOOR
(HVHZ) (IMPACT)
ANCHOR LAYOUTS &
INSTALLATION NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL47318

DATE:
01.27.2025

DWG. BY:
MS


CHK. BY:
HFN

SCALE:
NTS


DWG. #:
VHM003

SHEET:
9


OF 12

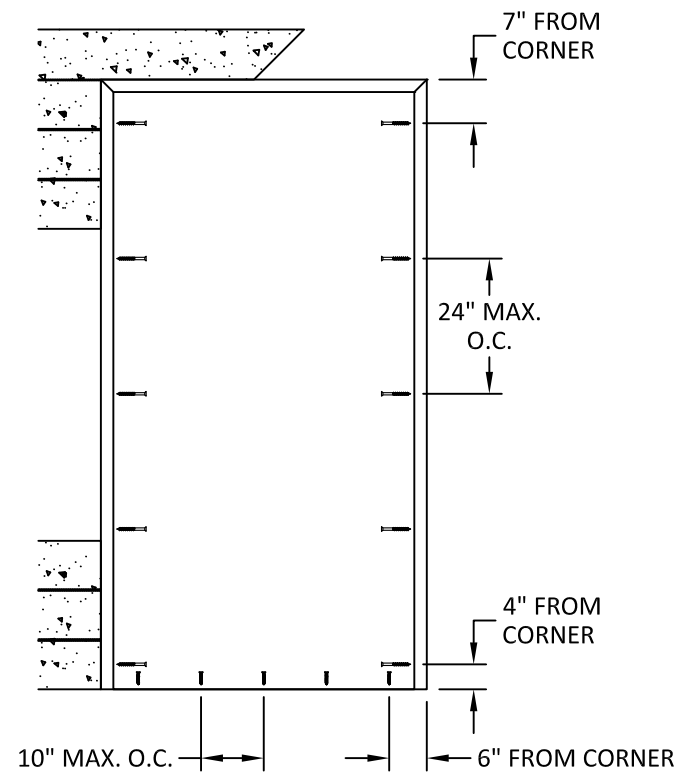


ANCHOR LAYOUT
CONCRETE SUBSTRATE
TUBE/BUTTERFLY ANCHOR
ELEVATION # 1, 2, & 3

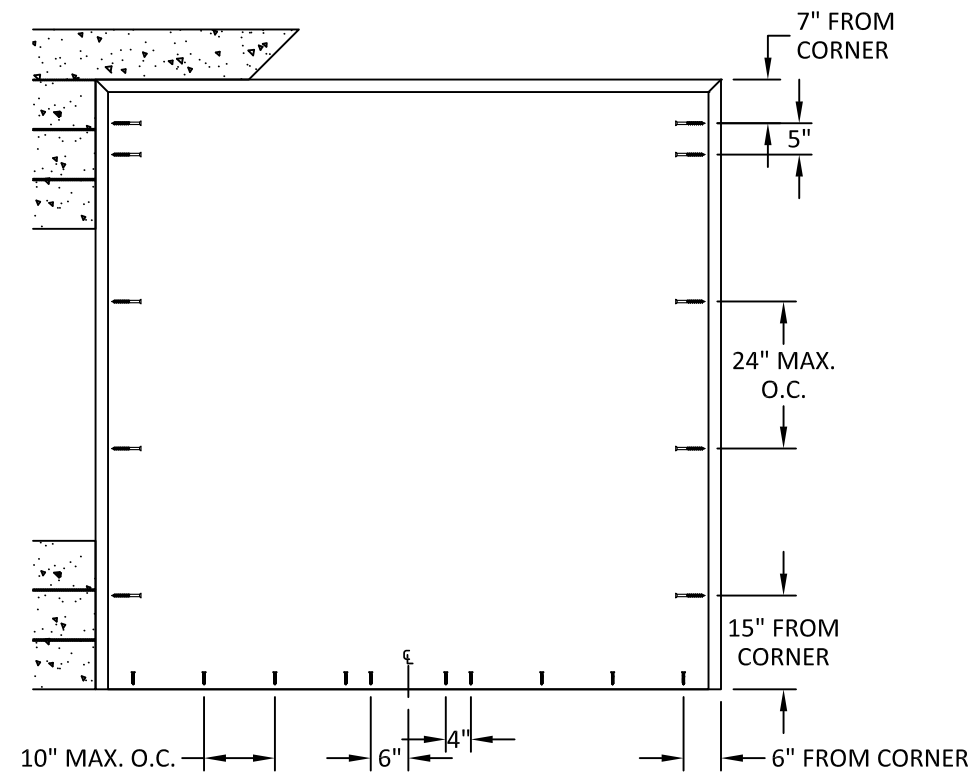

ANCHOR LAYOUT
CONCRETE SUBSTRATE
TUBE/BUTTERFLY ANCHOR
ELEVATION # 4, 5, & 6

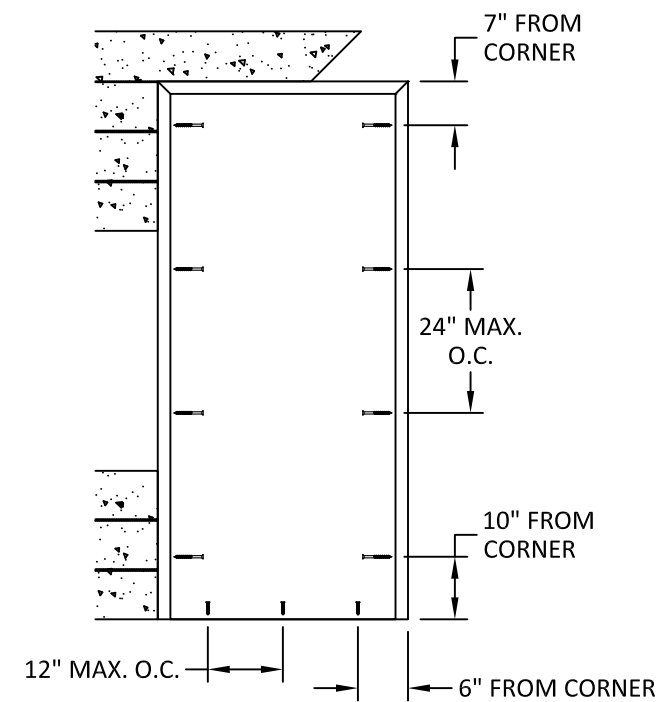


ANCHOR LAYOUT
CONCRETE SUBSTRATE
TUBE/BUTTERFLY ANCHOR
ELEVATION # 7, 8, 9, & 10

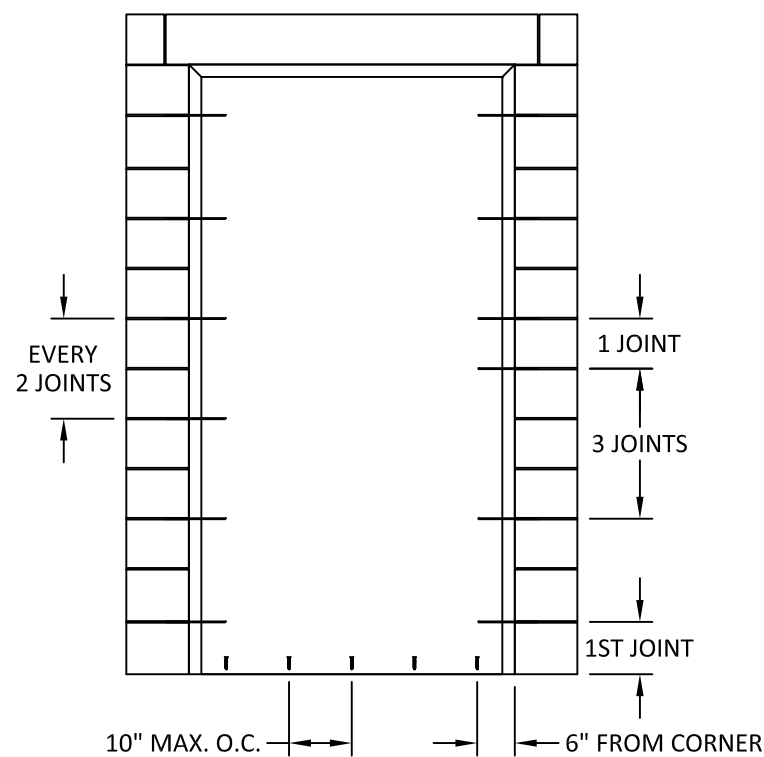


ANCHOR LAYOUT

CONCRETE SUBSTRATE
WIRE ANCHOR
ELEVATION # 1, 2, & 3

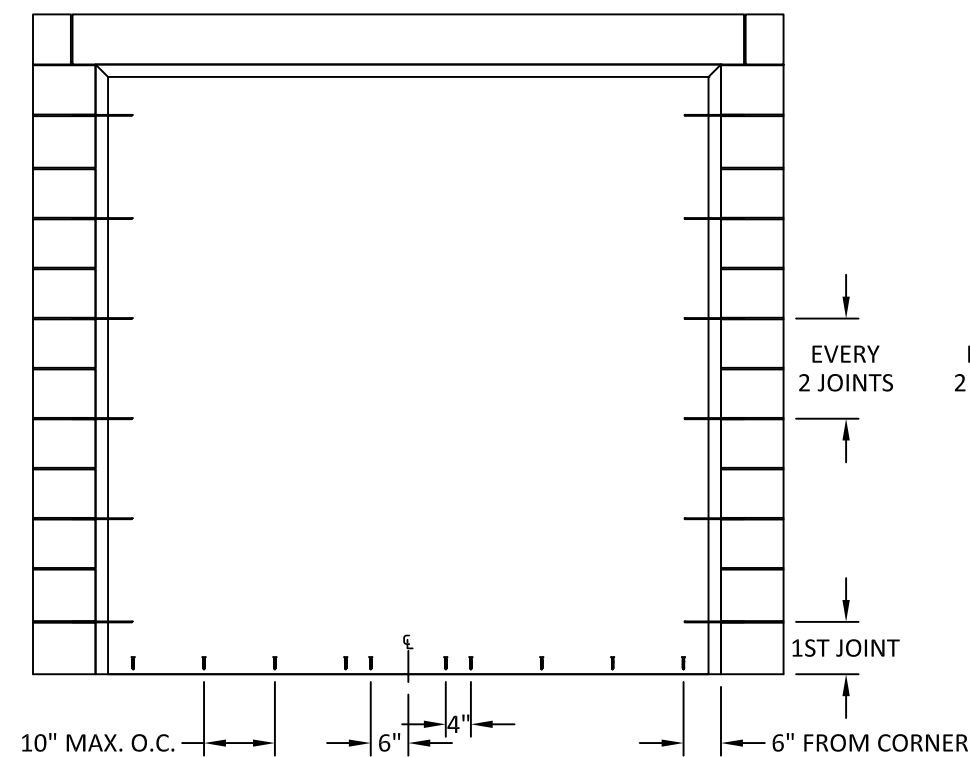

ANCHOR LAYOUT

CONCRETE SUBSTRATE
WIRE ANCHOR
ELEVATION # 4, 5, & 6

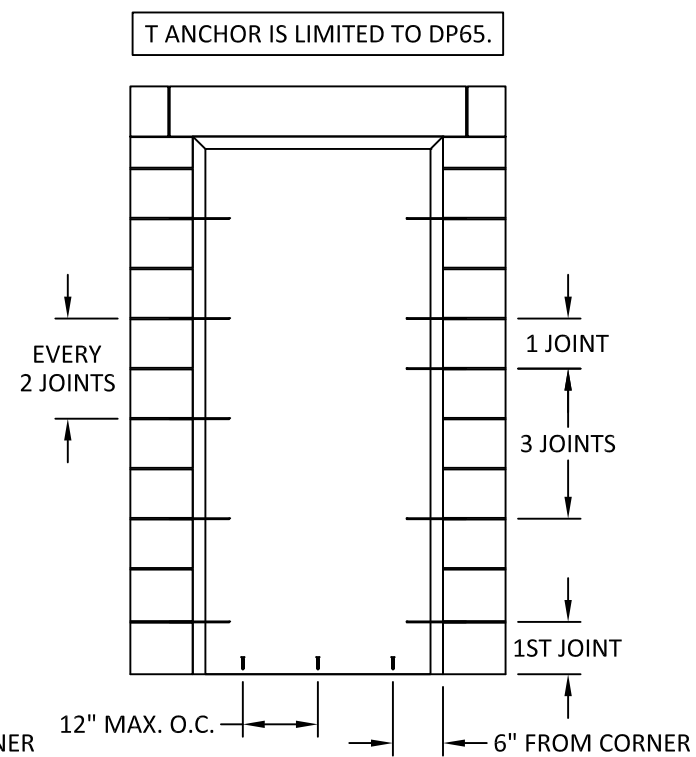

ANCHOR LAYOUT
CONCRETE SUBSTRATE
WIRE/T ANCHOR
ELEVATION # 7, 8, 9, & 10



LS18/LS1875 STEEL DOOR
(HVHZ) (IMPACT)
ANCHOR LAYOUTS

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL47318**

DATE: 01.27.2025

DWG. BY: MS	CHK. BY: HFN
-----------------------	------------------------











SCALE: NTS

DWG. #: **VHM003**

SHEET: 10 OF 12

c:\users\msun\building drops, inc\building drops landing - common\projects\vision hollow metal limited\lbc-24-0157.2 - lbc submittal - hollow metal doors\dwgs\lhm003.dwg 2/25/2025 3:22 PM

BILL OF MATERIALS		
ITEM#	DESCRIPTION	MATERIAL
1	STEEL DOOR PANEL	-
2A	HOLLOW METAL FRAME (OUTSWING, 16 GA., DP75)	STEEL
2B	HOLLOW METAL FRAME (OUTSWING, 18 GA., DP65)	STEEL
2C	HOLLOW METAL FRAME (OUTSWING, KERF, 16 GA., DP75)	STEEL
2D	HOLLOW METAL FRAME (OUTSWING, KERF, 18 GA., DP65)	STEEL
3A	HOLLOW METAL FRAME (INSWING, 18 GA.)	STEEL
3B	HOLLOW METAL FRAME (INSWING, KERF, 18 GA.)	STEEL
4A	4" HOLLOW METAL HEADER (OUTSWING, 18 GA.)	STEEL
4B	4" HOLLOW METAL HEADER (INSWING, 18 GA.)	STEEL
5	THRESHOLD (OUTSWING, HAGER 520S)	ALUMINUM
6	THRESHOLD (OUTSWING, HAGER 477S)	ALUMINUM
7	ADA THRESHOLD	ALUMINUM
8	WEATHERSTRIP (HAGER 736 PRESS ON)	-
9	WEATHERSTRIP (HAGER 875S)	-
10	WEATHERSTRIP (Q-LON)	-
11	DOOR SWEEP (NGP 95WH)	-
12	DOOR SWEEP	-
13	ASTRAGAL	STEEL
14	REMOVABLE MULLION	STEEL
15	MULLION REINFORCEMENT	STEEL
16	4.5" X 4.5" HINGE	STEEL
17	HINGE REINFORCEMENT (10 GA.)	STEEL
18	STRIKE PLATE	STEEL
19	LOCK REINFORCEMENT	STEEL
20	EMA TUBE ANCHOR	STEEL
21	EMA BUTTERFLY ANCHOR	STEEL
22	STUD STRAP ANCHOR	STEEL
23	WIRE ANCHOR	STEEL
24	T ANCHOR	STEEL
25	#12-24 X 1/2" FH MACHINE SCREW	STEEL
26	#12 X 1" FH SCREW	STEEL
27	#6 X 5/8" PHSMS	STEEL
28	#10 X 1-1/2" SELF-DRILLING SMS (MIN. 3 THREAD EMBEDMENT)	STEEL
29	#8 X 1-1/2" PFH WOOD SCREW (MIN. 1-3/8" EMBEDMENT)	STEEL

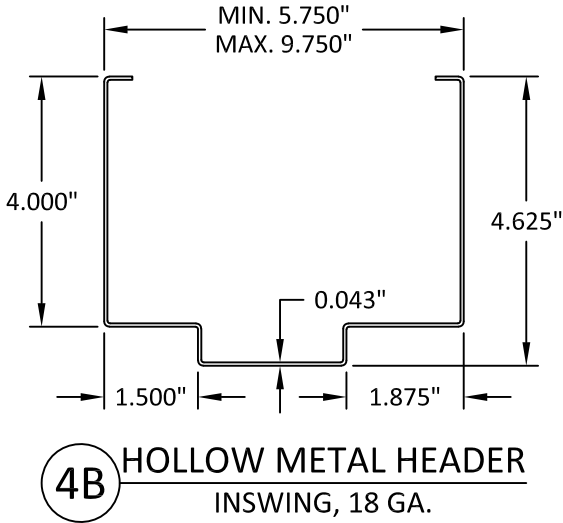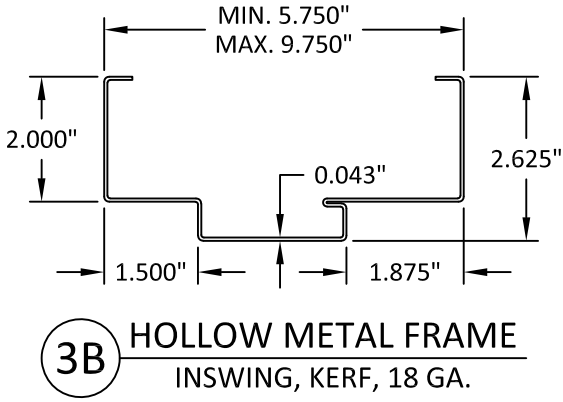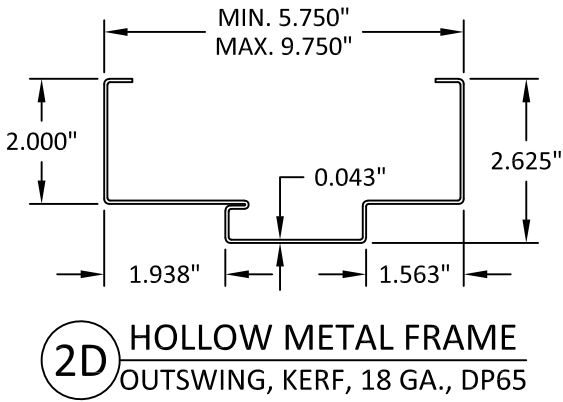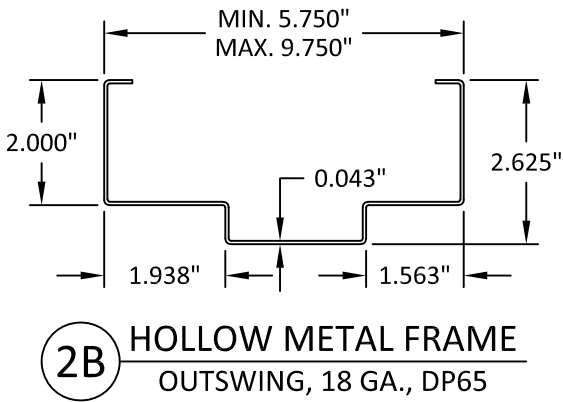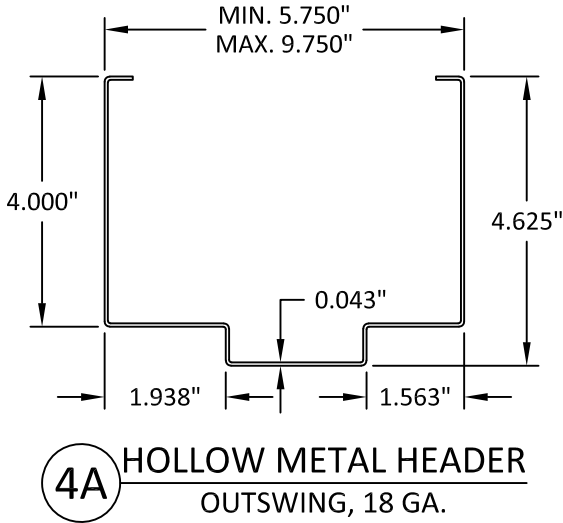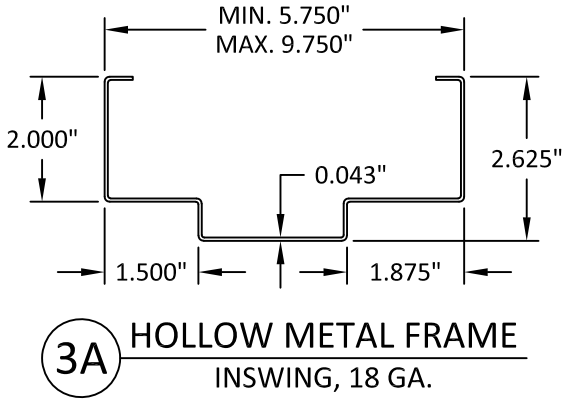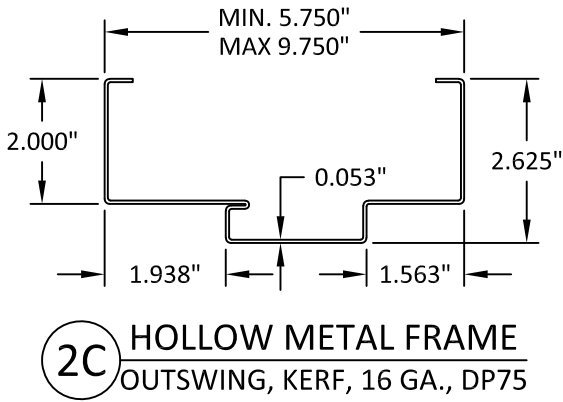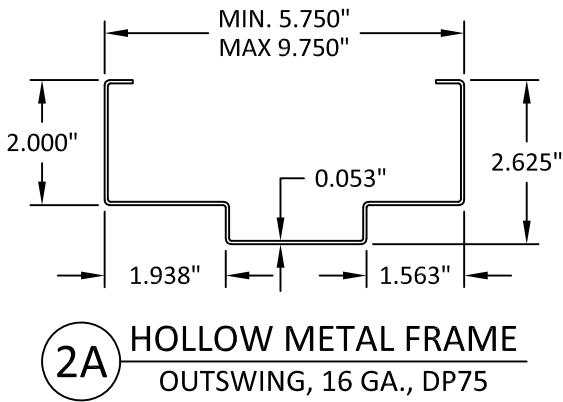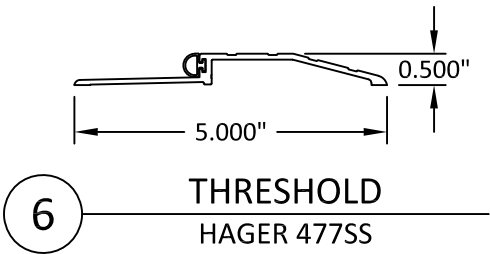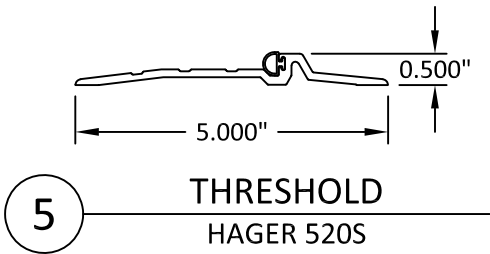



VISION
HOLLOW METAL LIMITED

400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121

TITLE:
LS18/LS1875 STEEL DOOR
(HVHZ) (IMPACT)

BILL OF MATERIALS & COMPONENTS


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

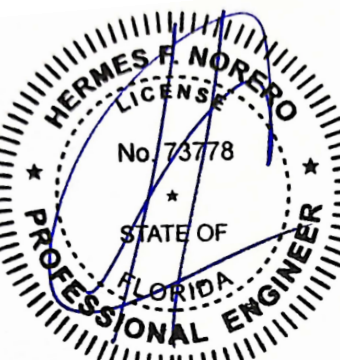

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL47318

DATE:
01.27.2025

DWG. BY:
MS


CHK. BY:
HFN

SCALE:
NTS


DWG. #:
VHM003

SHEET:
11


c:\users\msun\building drops, inc\building drops landing - common\projects\vision hollow metal limited\lbc-24-0157.2 - fbc submittal - hollow metal doors\dwgs\vhm003.dwg 2/25/2025 3:22 PM

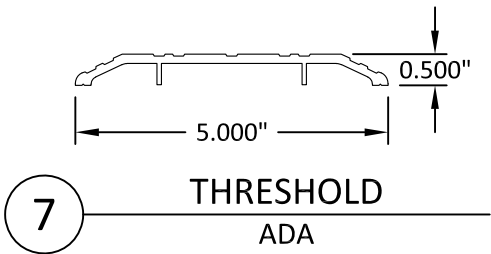


7 THRESHOLD
ADA

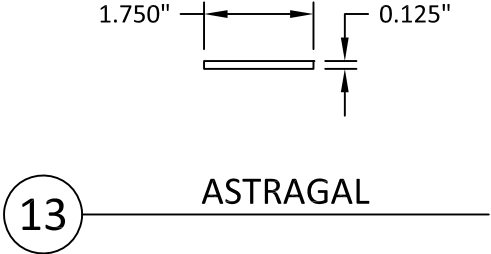

13 ASTRAGAL

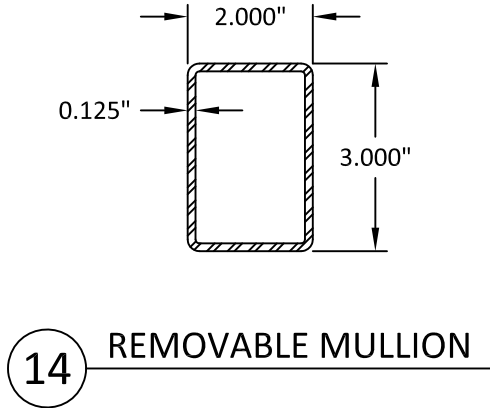

14 REMOVABLE MULLION

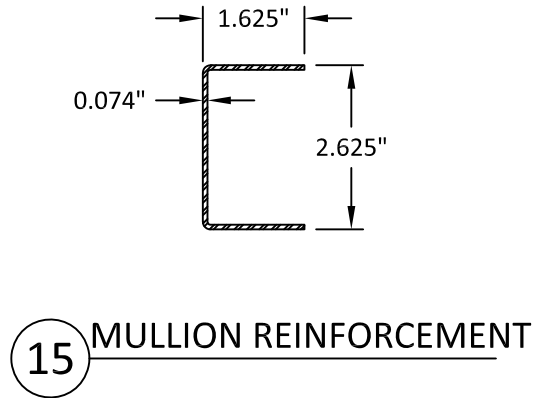

15 MULLION REINFORCEMENT



VISION
HOLLOW METAL LIMITED

400 ZENWAY BLVD. UNIT #1
WOODBIDGE, ON L4H 3H9, CANADA
PH: (905) 851-1121

TITLE:

LS18/LS1875 STEEL DOOR
(HVHZ) (IMPACT)


COMPONENTS

PREPARED BY:

 BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

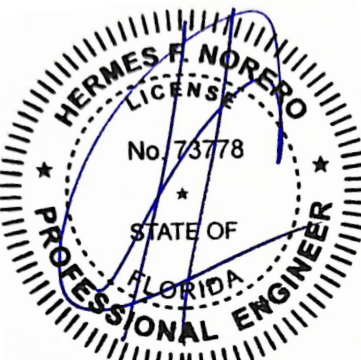

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPCE CERT. OF AUTHORIZATION No. 29578

FL #:

FL47318

DATE:

01.27.2025

DWG. BY:

MS

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

VHM003

SHEET:

12

OF 12