

EUROLINE STEEL WINDOWS & DOORS

SERIES 900 THERMAL STEEL CASEMENT


(WZ4) (IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC) **EXCLUDING** HVHZ. ALL PRODUCTS UNDER THE SCOPE OF THIS DOCUMENT HAVE BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- AAMA/WDMA/CSA 101/I.S.2/A440-22
 - ASTM E283/E283M-19
 - ASTM E330/E330M-14(21)
 - ASTM E331-00(23)
 - ASTM E1886-19
 - ASTM E1996-23
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
5. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
6. FRAME MATERIAL: STEEL (MIN. $F_y = 33$ ksi).
7. ALL STRUCTURAL MATERIALS & DISSIMILAR METALS SHALL BE PROTECTED, TREATED, PAINTED, COATED, AND/OR ISOLATED AS REQUIRED IN THE APPLICABLE SECTIONS OF THE CURRENT FLORIDA BUILDING CODE AND REFERENCED DESIGN SPECIFICATIONS.
8. GLASS MEET THE REQUIREMENTS OF ASTM E 1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	TYPICAL ELEVATIONS AND DESIGN PRESSURE TABLE
3	ANCHOR LAYOUTS
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	INSTALLATION DETAILS AND NOTES

DESIGN PRESSURE RATING		
FRAME SIZE	DESIGN PRESSURE	MISSILE RATING
SEE SHEET 2		LARGE AND SMALL MISSILE IMPACT

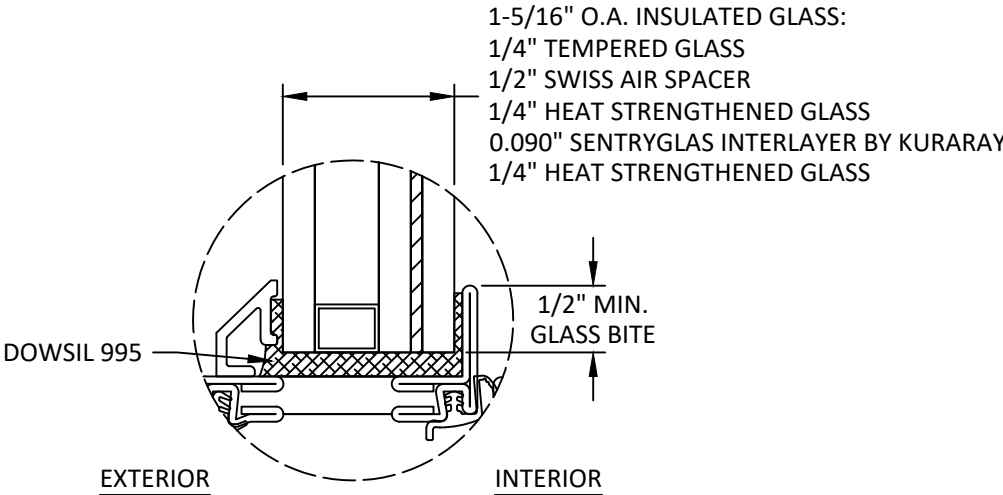

GLAZING DETAIL

- GLAZING NOTES:
- GLASS TYPE & THICKNESS COMPLIES WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN SHEET 2.



22600 SAVI RANCH PKWY
YORBA LINDA, CA 92887
PH: (877) 590-2714

TITLE:
SERIES 900 THERMAL STEEL CASEMENT
(WZ4) (IMPACT)

GENERAL NOTES & GLAZING DETAIL

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
A. 2026 FBC UPDATE	MS	7/21/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.01 19:07:49 -0400

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47335**

DATE: **10.20.2025**


DWG. BY: **MS** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **ELS005**

SHEET: **1** REV. **A**


c:\users\mengqisun\building drops - common\projects\2026 code change projects\euroline steel windows & doors\cc-26-0522.2 - 2026 code change\dwg\le6005 - a.dwg 7/27/2026 4:38 PM

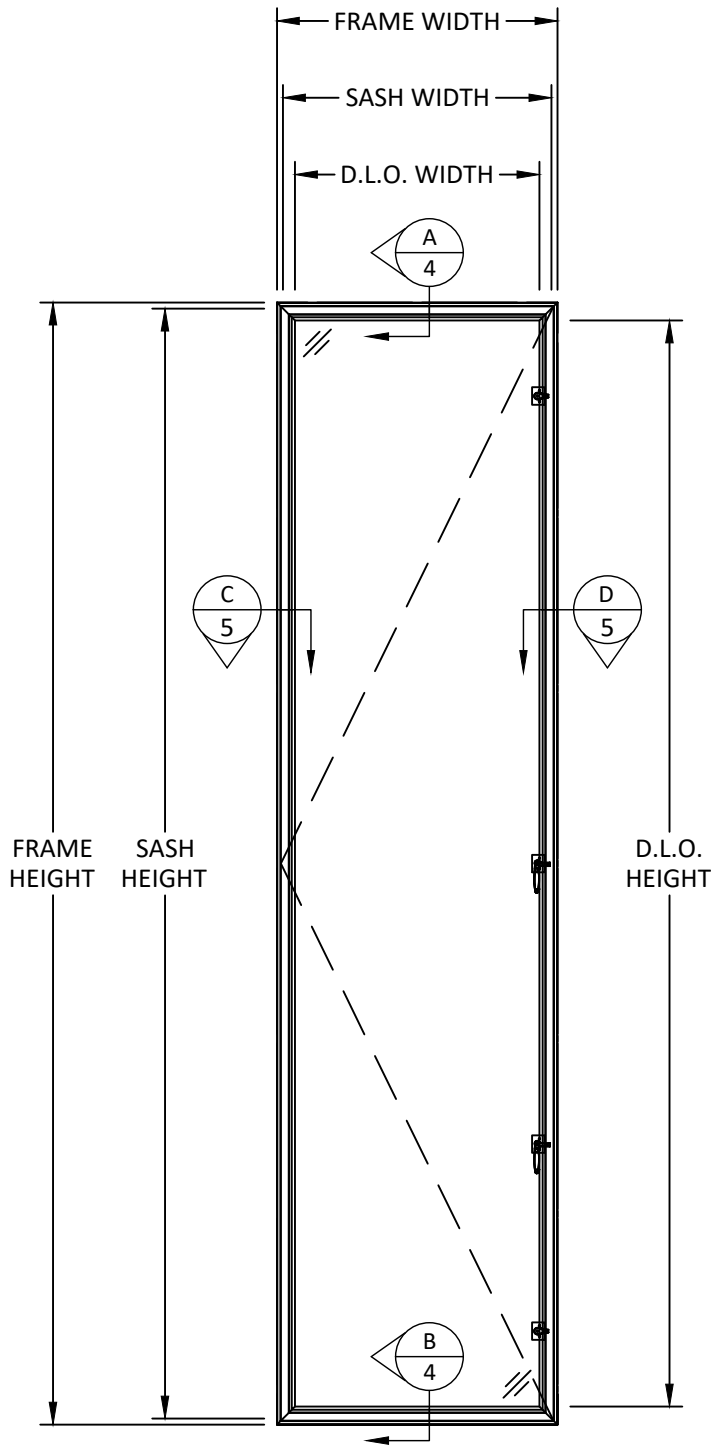

TYPICAL ELEVATION

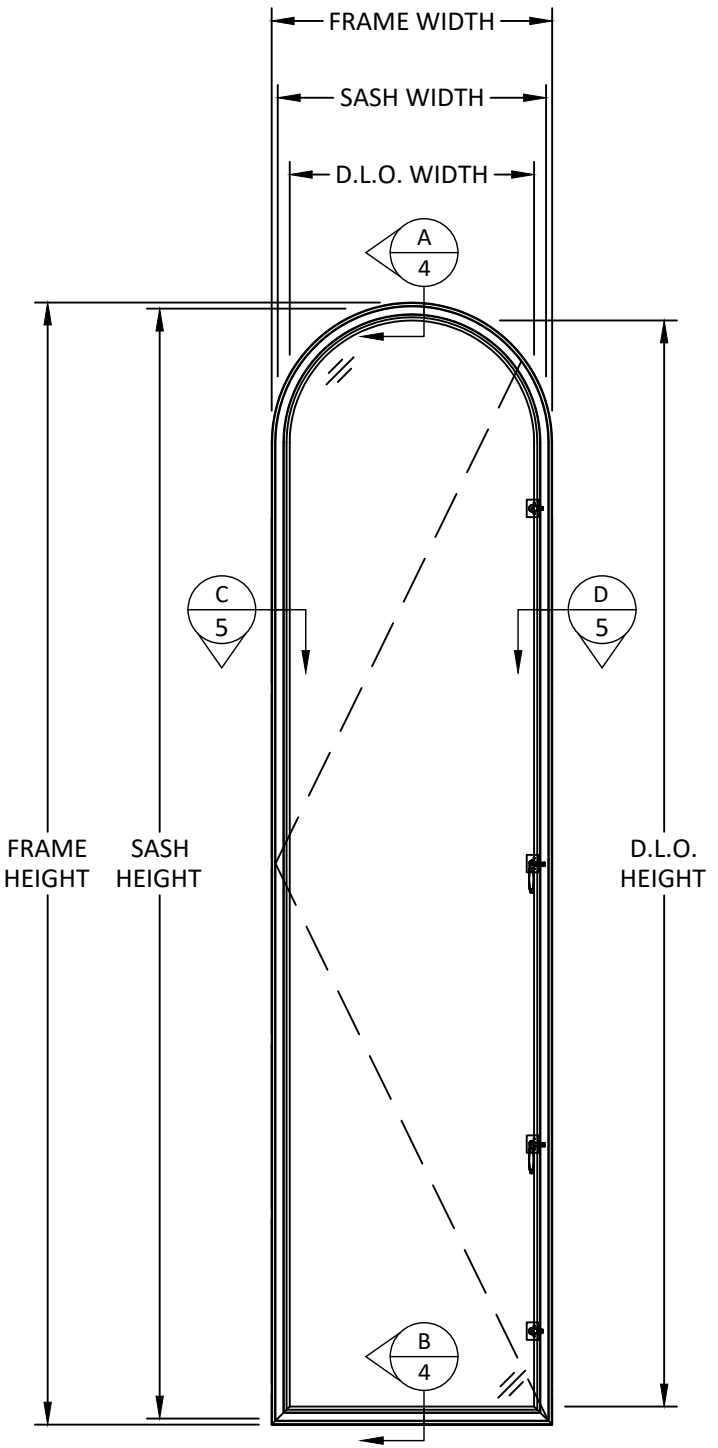

TYPICAL ELEVATION
ROUND TOP

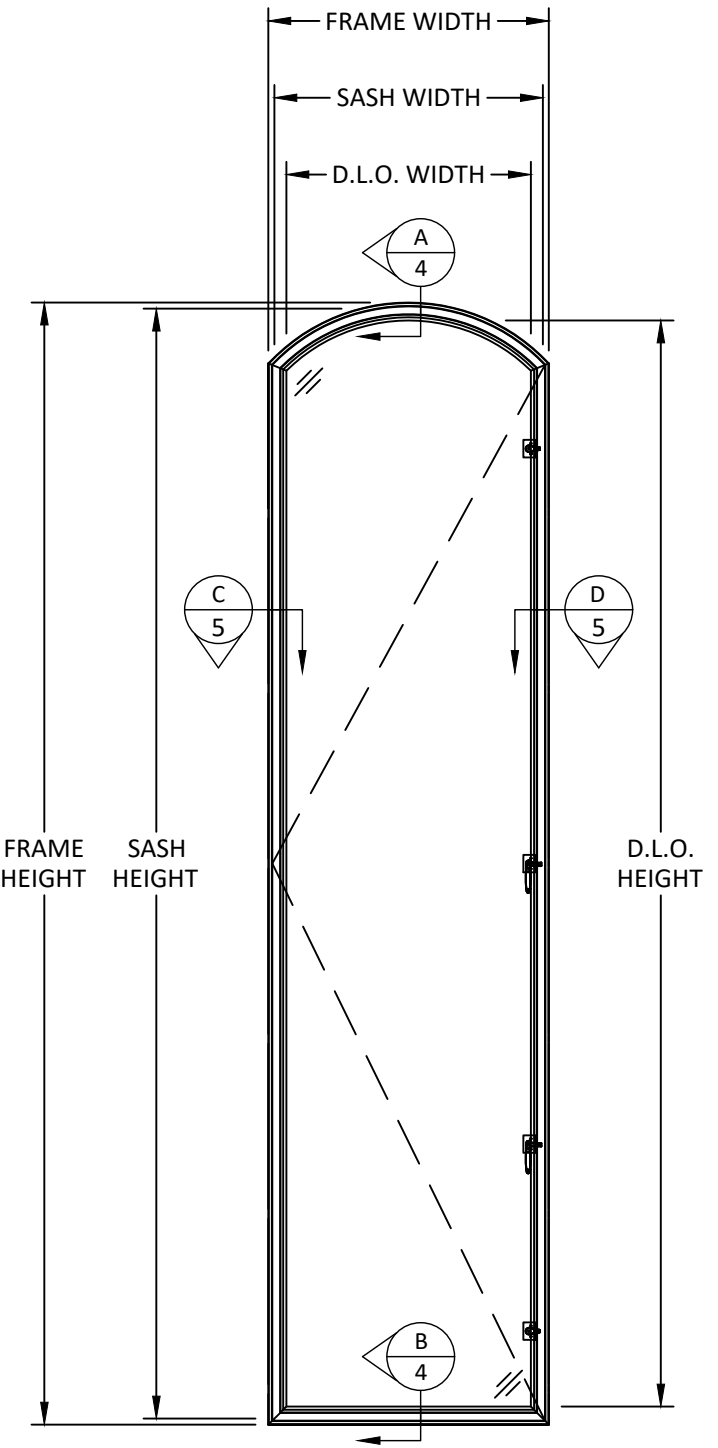

TYPICAL ELEVATION
ARCH TOP

SASH HEIGHT = FRAME HEIGHT - 7/8"
SASH WIDTH = FRAME WIDTH - 13/16"

D.L.O. HEIGHT = FRAME HEIGHT - 4 3/16"
D.L.O. WIDTH = FRAME WIDTH - 4 11/16"

FRAME HEIGHT (IN.)	DESIGN PRESSURE TABLE (+/- PSF)									
	FRAME WIDTH (IN.)									
	27	30	33	36	39	42	45	48	51	
96	65.00	65.00	65.00	65.00	47.19	35.09	26.62	20.57	16.14	
102	65.00	65.00	65.00	65.00	47.19	35.09	26.62	20.57	-	
108	65.00	65.00	65.00	65.00	47.19	35.09	26.62	-	-	
114	65.00	65.00	65.00	65.00	47.19	35.09	-	-	-	
120	65.00	65.00	65.00	65.00	47.19	35.09	-	-	-	
126	65.00	65.00	65.00	65.00	47.19	-	-	-	-	
144	65.00	65.00	65.00	65.00	-	-	-	-	-	
156	65.00	65.00	65.00	-	-	-	-	-	-	
174	65.00	65.00	-	-	-	-	-	-	-	
198	65.00	-	-	-	-	-	-	-	-	

NOTE: CASEMENT WITH THE HEIGHT LESS THAN THE
TABLE SHOWN LEFT IS QUALIFIED TO THE SAME
DESIGN PRESSURE AS THE UNIT AT THE MAXIMUM
HEIGHT OF EACH WIDTH.

* ADDITIONAL HINGES AND LOCK POINTS SHALL BE
REQUIRED FOR CASEMENT TALLER THAN 144" TO
MAINTAIN THE SAME MAXIMUM SPACING BETWEEN
HINGES AND LOCK POINTS AS THE 144" TALL CASEMENT.



22600 SAVI RANCH PKWY
YORBA LINDA, CA 92887
PH: (877) 590-2714

TITLE:
SERIES 900 THERMAL STEEL CASEMENT
(WZ4) (IMPACT)

TYPICAL ELEVATIONS & DESIGN
PRESSURE TABLE

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A. 2026 FBC UPDATE	MS	7/21/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47335**

DATE: **10.20.2025**


DWG. BY: **MS** CHK. BY: **HFN**

SCALE: **NTS**



DWG. #: **ELS005**

SHEET: **2** REV. **A**


c:\users\mengqisun\building drops, inc\building drops landing - common\projects\2026 code change projects\euroline steel windows & doors\cc-26-0522.2 - 2026 code change\dwg\6005 - a.dwg 7/21/2026 4:38 PM

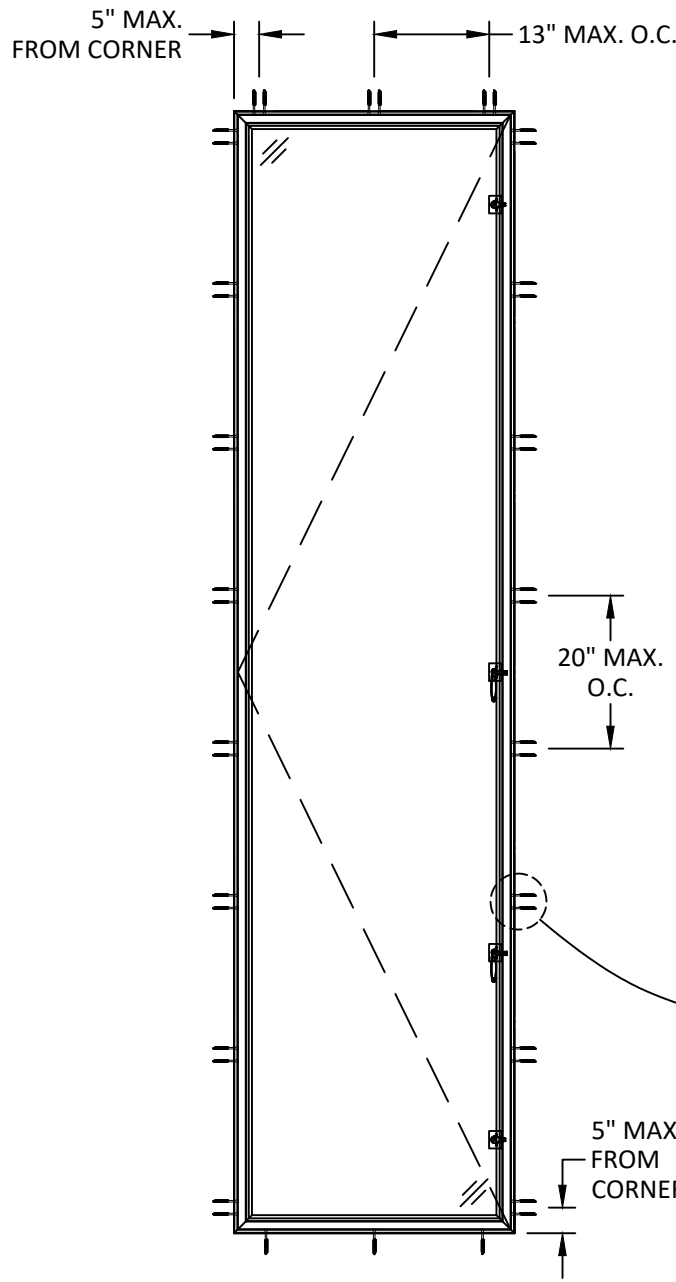

ANCHOR LAYOUT

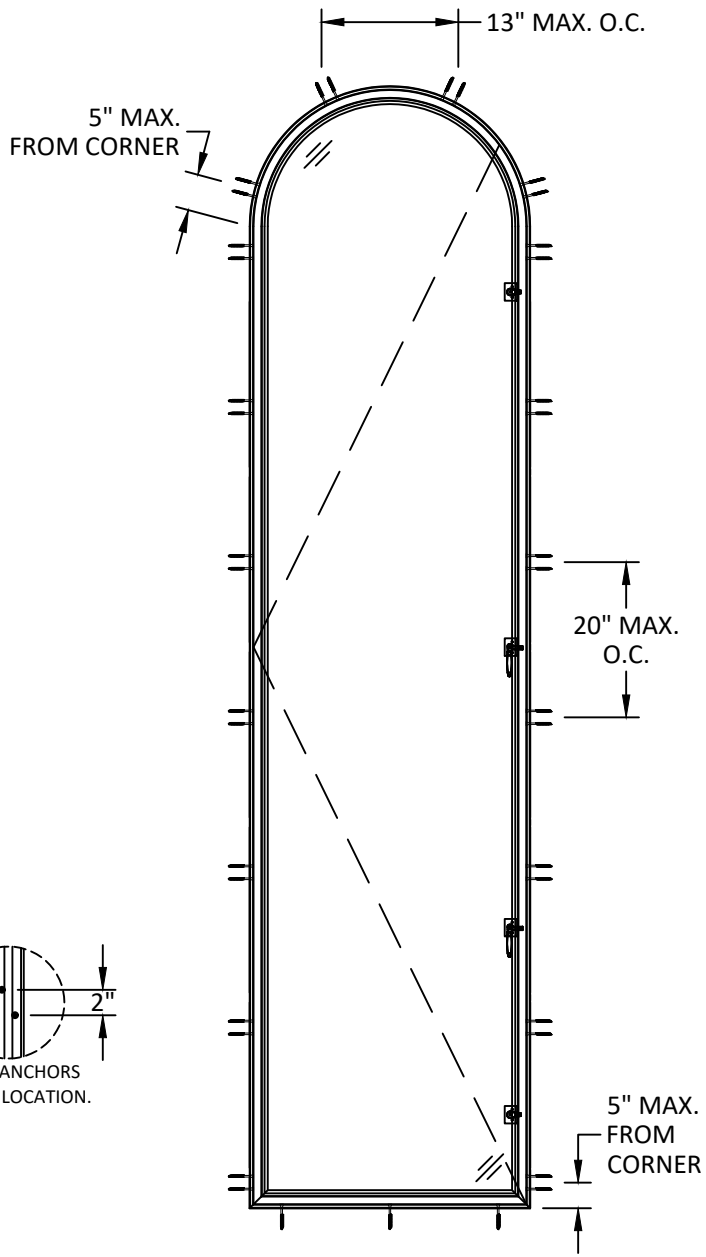

ANCHOR LAYOUT
ROUND TOP

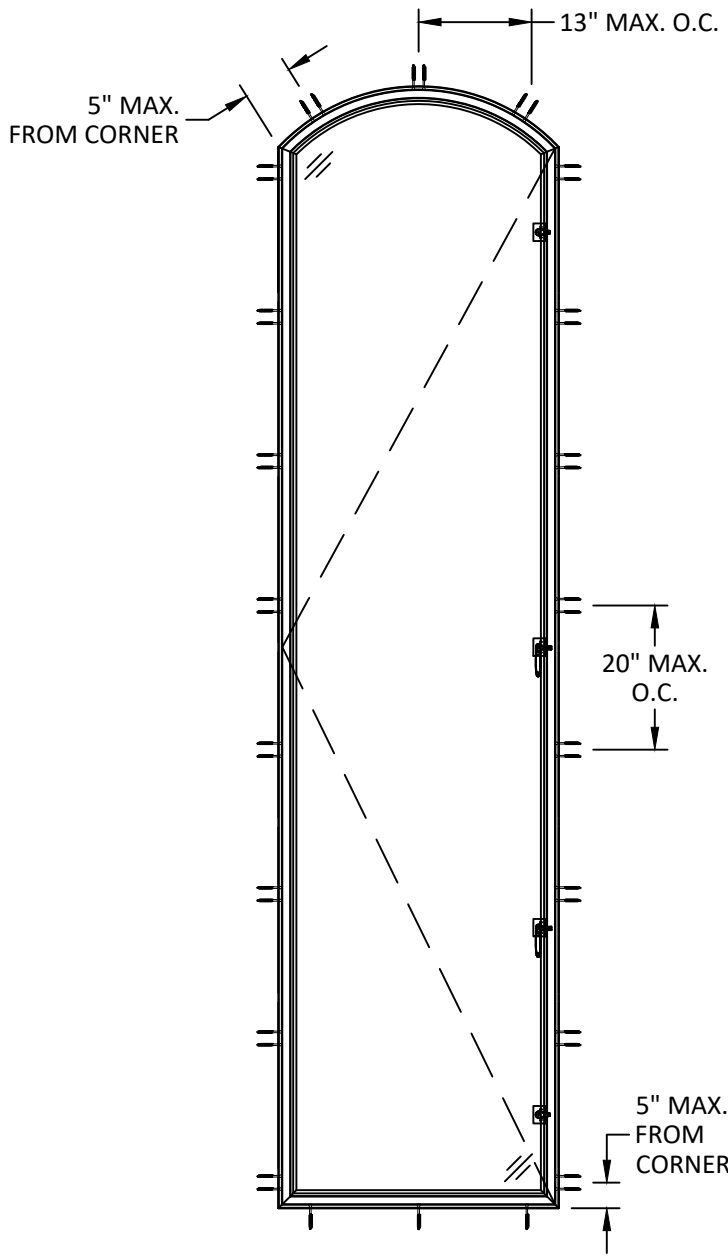

ANCHOR LAYOUT
ARCH TOP



22600 SAVI RANCH PKWY
YORBA LINDA, CA 92887
PH: (877) 590-2714

TITLE:
SERIES 900 THERMAL STEEL CASEMENT
(WZ4) (IMPACT)

ANCHOR LAYOUTS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A. 2026 FBC UPDATE	MS	7/21/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

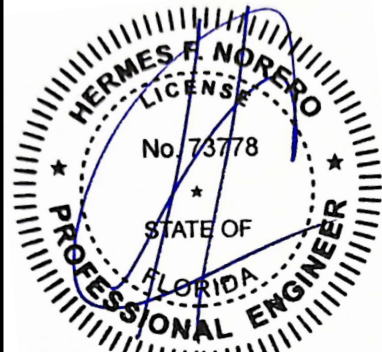

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47335**

DATE: **10.20.2025**

DWG. BY:
MS

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **ELS005**

SHEET:


3

REV.


A

OF 6

c:\users\mengqisun\building drops, inc\building drops landing - common\projects\2026 code change projects\euronline steel windows & doors\cc-26-0522.2 - 2026 code change\dwg\set6005 - a.dwg 7/21/2026 4:38 PM

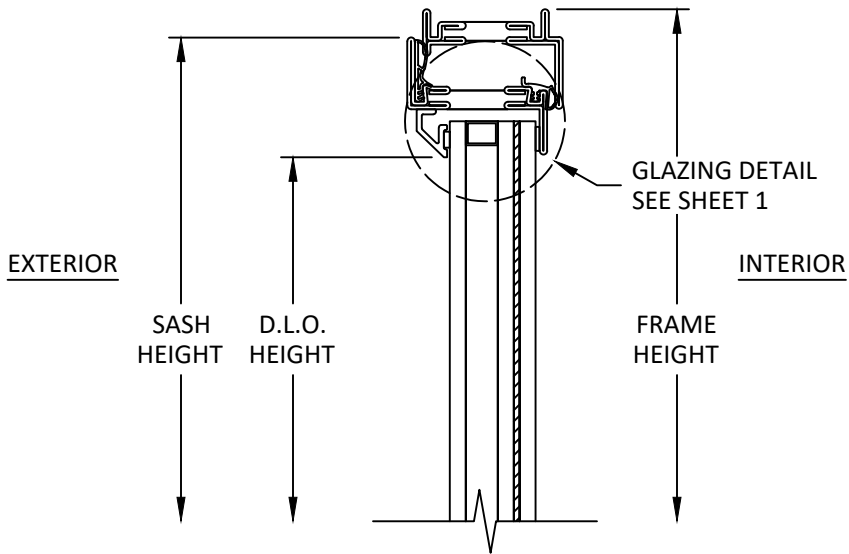

A
4 VERTICAL SECTION
HEAD

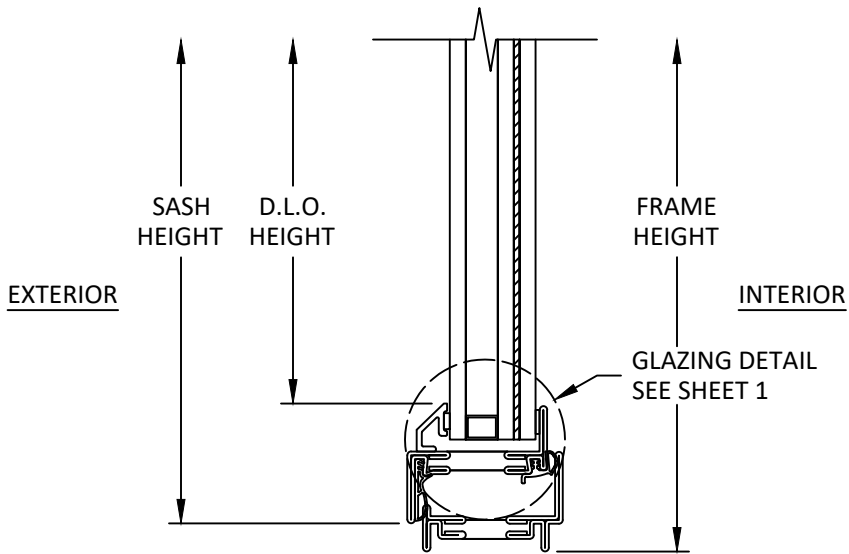

B
4 VERTICAL SECTION
SILL



22600 SAVI RANCH PKWY
YORBA LINDA, CA 92887
PH: (877) 590-2714

TITLE:
SERIES 900 THERMAL STEEL CASEMENT
(WZ4) (IMPACT)


VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A. 2026 FBC UPDATE	MS	7/21/2026



THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

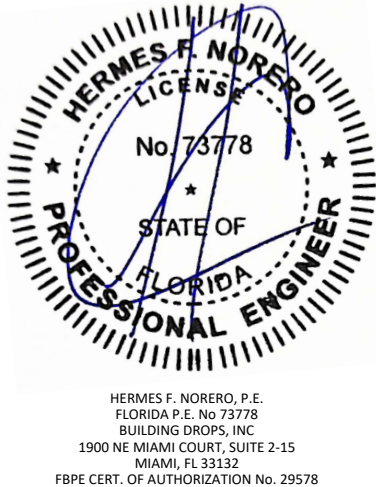

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL47335	
DATE:	10.20.2025	
DWG. BY:	MS	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	ELS005	
SHEET:	4	REV. A

c:\users\mengqisun\building drops - common\projects\2026 code change projects\euronline steel windows & doors\cc-26-0522.2 - 2026 code change\dwg\series\els005 - a.dwg 7/21/2026 4:38 PM

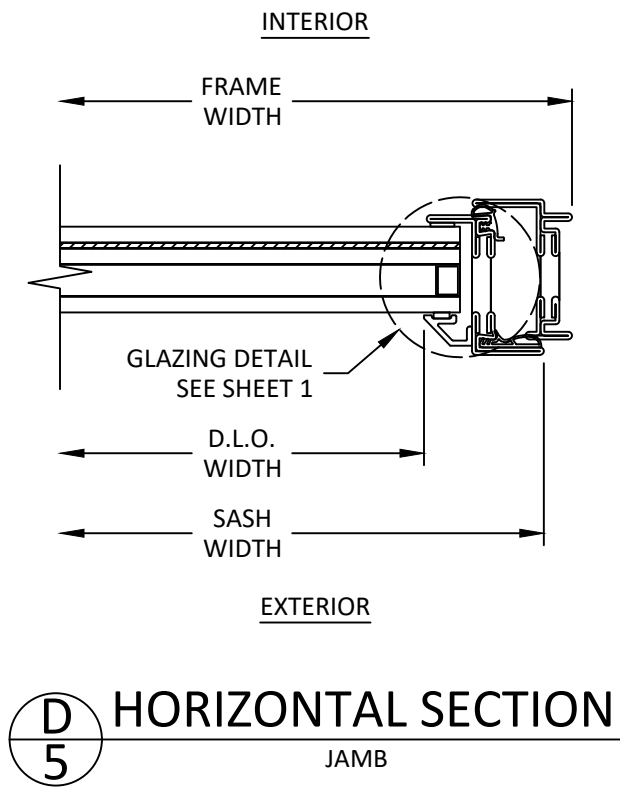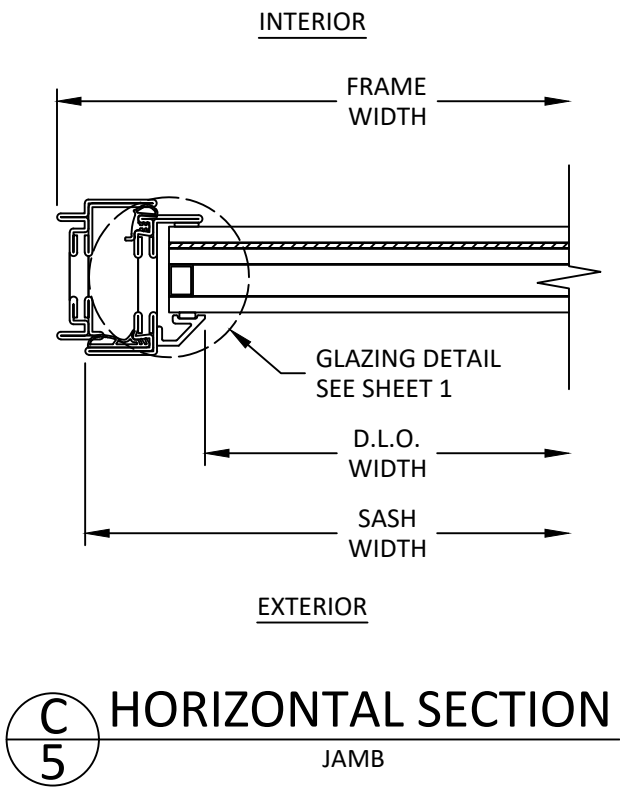

22600 SAVI RANCH PKWY
YORBA LINDA, CA 92887
PH: (877) 590-2714

TITLE:
SERIES 900 THERMAL STEEL CASEMENT
(WZ4) (IMPACT)

HORIZONTAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A. 2026 FBC UPDATE	MS	7/21/2026


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

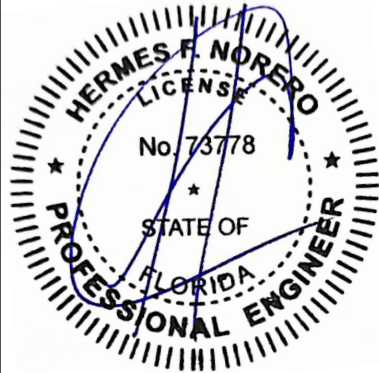

HERMES F. NORERO, P.E.
FLORIDA P.E. No. 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL47335
DATE:	10.20.2025
DWG. BY:	MS
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	ELS005
SHEET:	5
REV.	A

c:\users\mengqium\building drops - common\projects\2026 code change projects\euroline steel windows & doors\cc-26-0522.2 - 2026 code change\dwg\el6005 - a.dwg 7/27/2026 4:38 PM

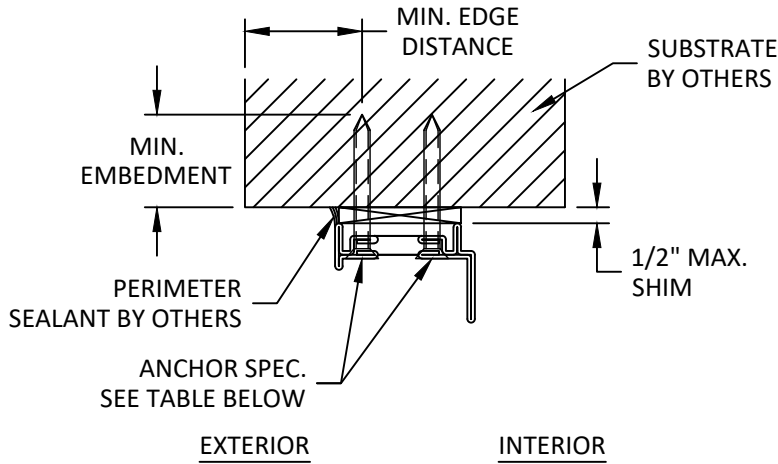

E

6

INSTALLATION DETAILS

HEAD SHOWN
JAMB & SILL SIMILAR

INSTALLATION NOTES:

1. TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN ON SHEET 3.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/2 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5. FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
7. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.

7.1. FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

7.2. CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
8. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
9. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE			
SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
WOOD: MIN. S.G. = 0.55	#14 WOOD SCREW	1-1/2"	3/4"
STEEL: MIN. 18 GA. MIN. Fy = 33 ksi	1/4" GRADE 5 SELF-DRILLING/ SELF-TAPPING SCREW	3 THREADS MIN PENETRATION BEYOND METAL	1/2"
ALUMINUM: MIN. 1/8" THICK MIN. 6063-T5			
CONCRETE: MIN. f'c = 3000 psi	1/4" ITW TAPCON	1-1/2"	1-1/2"
MASONRY: HOLLOW OR GROUT- FILLED BLOCK per ASTM C90, MIN. 2000 PSI		1"	2"



22600 SAVI RANCH PKWY
YORBA LINDA, CA 92887
PH: (877) 590-2714

TITLE:
SERIES 900 THERMAL STEEL CASEMENT
(WZ4) (IMPACT)

INSTALLATION DETAILS & NOTES


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
A. 2026 FBC UPDATE	MS	7/21/2026

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

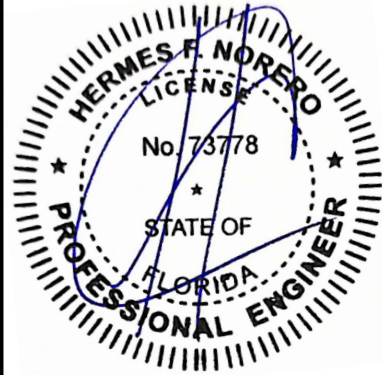

HERMES F. NORERO, P.E.
FLORIDA P.E. No 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, SUITE 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL47335

DATE:

10.20.2025

DWG. BY:

MS

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

ELS005

SHEET:

6

REV. A