


SHEET INDEX	
01	COVER PAGE
02	TYPICAL ELEVATIONS
03	ANCHOR / GLASS COMPOSITION
04	CONFIGURATIONS DETAIL
05	SECTION DETAILS
06	SECTION DETAILS
07	PROFILES DETAILS
08	PROFILES DETAILS / BOM
09	INSTALLATION DETAIL
10	INSTALLATION DETAIL

TO OBTAIN AUTOCAD/REVIT COMPATIBLE DETAILS OF THIS PRODUCT, KINDLY GET IN TOUCH WITH US CONTACTING US VIA OUR OFFICIAL EMAIL ADDRESS: CONTACT@JA-PE.COM.

SERIES 'TITAN 120' ALUMINUM SLIDING GLASS DOOR

(SMALL MISSILE IMPACT)

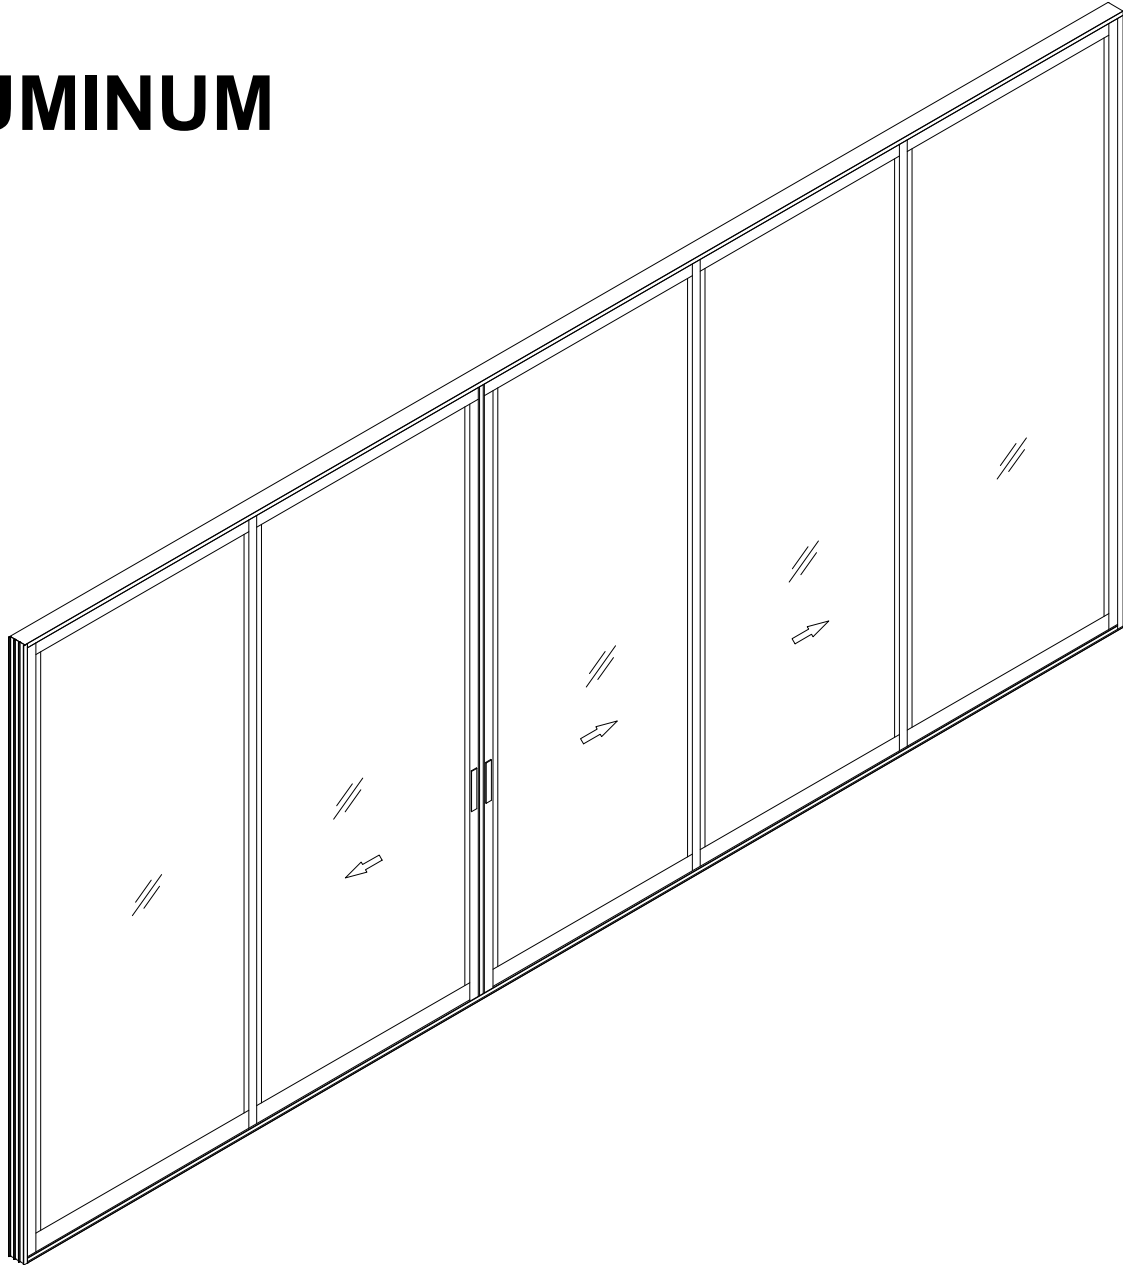

GENERAL NOTES

1. THIS SYSTEM PRESENTED HEREIN HAS UNDERGONE DESIGN AND TESTING IN FULL COMPLIANCE WITH THE FLORIDA BUILDING CODE EIGHTH EDITION (2023) AND IS INTENDED FOR USE IN HIGH VELOCITY HURRICANE ZONE PER TAS 201/202/203.

2. THE DESIGN PRESSURES OUTLINED IN THIS DOCUMENT ARE DERIVED FROM MAXIMUM TESTED PRESSURES AND INCORPORATE A 1.5 SAFETY FACTOR.

3. THE PRESSURES PROVIDED IN THIS CERTIFICATION ARE DETERMINED USING THE ALLOWABLE STRESS DESIGN METHOD (ASD).

4. THIS PRODUCT HAS BEEN RIGOROUSLY TESTED IN ACCORDANCE WITH THE STANDARDS DESCRIBED IN NOTE 1 OF THE GENERAL NOTES. IT IS CONFIRMED TO BE RESISTANT TO LARGE MISSILE IMPACT, THEREBY NOT NECESSITATING THE USE OF IMPACT-RESISTANT SHUTTERS.

5. THE DESIGN OF THIS SYSTEM DOES NOT INCORPORATE A 33-1/3% INCREASE IN ALLOWABLE STRESS. FOR WOOD ANCHOR DESIGN, A WIND LOAD DURATION FACTOR OF CD=1.6 HAS BEEN EMPLOYED.

6. THE ARCHITECT/ENGINEER OF RECORD RESPONSIBLE FOR THE PROJECT'S SUPERSTRUCTURE, WITH WHICH THIS DESIGN IS ASSOCIATED, SHALL ENSURE THE INTEGRITY OF ALL SUPPORTING SURFACES. COORDINATION WITH THE PERMITTING CONTRACTOR IS REQUIRED, AND PROPER ANCHORING OF WOOD BUCKS (BY OTHERS) MUST FACILITATE LOAD TRANSFER TO THE EXISTING STRUCTURE.
7. THE DETAILS OF THE SYSTEM PROVIDED HEREIN ARE OF A GENERIC NATURE AND DO NOT OFFER SPECIFIC SITE INFORMATION. FOR SITE CONDITIONS THAT DIFFER FROM THOSE SPECIFIED HERE, A LICENSED ENGINEER OR REGISTERED ARCHITECT MUST PREPARE SITE-SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS CERTIFICATION.

8. THE CONTRACTOR IS ACCOUNTABLE FOR INSULATING ALL MEMBERS FROM DISSIMILAR MATERIALS TO PREVENT ELECTROLYSIS (E.G., STEEL WITH ALUMINUM).

9. THE SUBSTITUTION OF FASTENERS DESCRIBED IN THIS CERTIFICATION IS PERMISSIBLE, PROVIDED THE ALTERNATIVE ANCHOR EXHIBITS STRENGTH EQUAL TO OR GREATER THAN THE ORIGINALLY SPECIFIED FINAL APPROVAL OF SUBSTITUTED ANCHORS SHALL BE GRANTED BY RELEVANT AUTHORITIES.

10. THE WOOD SCREWS REFERENCED IN THIS CERTIFICATION MUST MEET A MINIMUM GRADE OF 2 (FU = 74,000 PSI).

11. THE ENGINEER'S SEAL AFFIXED HERE VALIDATES THE STRUCTURAL DESIGN AS PRESENTED SOLELY. ANY USE OF THIS SPECIFICATION BY THE CONTRACTOR OR OTHERS INDEMNIFIES AND SAVES THE ENGINEER HARMLESS FROM ALL COSTS AND DAMAGES, INCLUDING LEGAL FEES AND APPELLATE FEES ARISING FROM MATERIAL FABRICATION, SYSTEM ERECTION, AND CONSTRUCTION PRACTICES BEYOND THE SCOPE CALLED FOR BY LOCAL, STATE, AND FEDERAL CODES OR DEVIATIONS FROM THE PLAN.

12. NO ADDITIONAL CERTIFICATIONS OR AFFIRMATIONS ARE INTENDED BEYOND WHAT IS EXPRESSLY PROVIDED IN THIS DOCUMENT.


13. ALTERATIONS, ADDITIONS, OR ANY MARKINGS TO THIS DOCUMENT ARE STRICTLY PROHIBITED AND WILL INVALIDATE THIS CERTIFICATION.

14. PROPER SAFETY MEASURES MUST BE OBSERVED DURING THE INSTALLATION AND USE OF THIS SYSTEM, EVEN THOUGH THEY ARE NOT EXPLICITLY LISTED IN THIS CERTIFICATION.

15. EACH PRODUCT SHALL BE PERMANENTLY LABELED WITH A MINIMUM OF ONE LABEL PER SYSTEM, CONTAINING THE FOLLOWING REQUIRED INFORMATION:
PLAZA DOOR COMPANY
4425 SW CARGO WAY
PALM CITY , FL 34990
PH: (561) 578-5450
info@plazadoorcompany.com

16. THE MAXIMUM FRAME AREA OF THE UNIT SHALL NOT EXCEED 1.5 TIMES THE TESTED FRAME AREA, PER FBC 2411.3.2.4.


FL# 47347.1

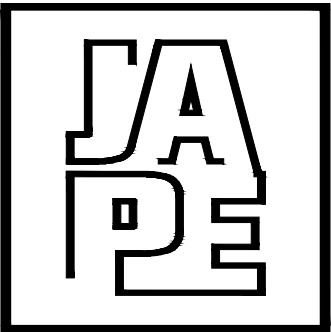

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS


PROJECT :			
SERIES 'TITAN 120' ALUMINUM SLIDING GLASS DOOR (SMALL MISSILE IMPACT)			
CLIENT :			
NUEVO FLORIDA VENTURE, LLC D/B/A PLAZA DOOR 4425 SW CARGO WAY, PALM CITY FL 34990, UNITED STATES			
REVISION			
No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE
date:		2/12/2025	
scale:		N/A	
drawn by:		M.S.	
check by:			
Drawing no.		JA-1463-24	
Eng: JAVAD AHMAD, PE CIVIL FLA. PE # 70592 – C.A.N. 34254			

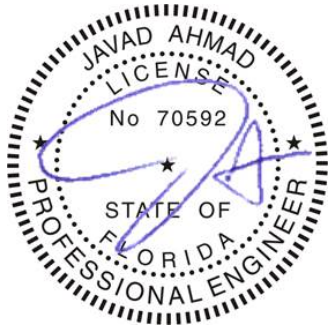

SEALED: 02/12/2025

COVER PAGE

SHEET No.
1 OF 10

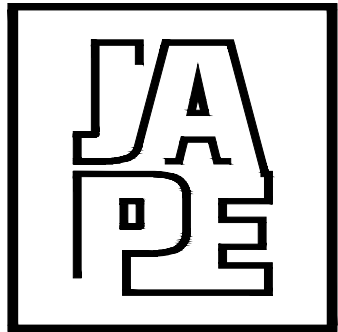

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :

SERIES 'TITAN 120' ALUMINUM
SLIDING GLASS DOOR
(SMALL MISSILE IMPACT)

CLIENT :

NUEVO FLORIDA VENTURE, LLC
D/B/A PLAZA DOOR


4425 SW CARGO WAY, PALM CITY
FL 34990, UNITED STATES

REVISION

No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE


date:	2/12/2025
scale:	N/A
drawn by:	M.S.
check by:	
Drawing no.	JA-1463-24

Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 - C.A.N. 34254

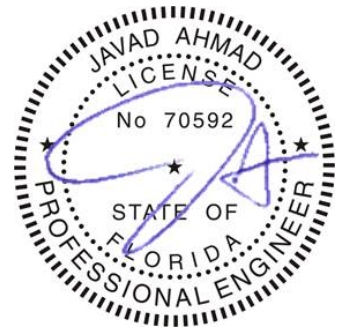

SEALED: 02/12/2025

TYP. ELEVATION SHEET No. 2 OF 10

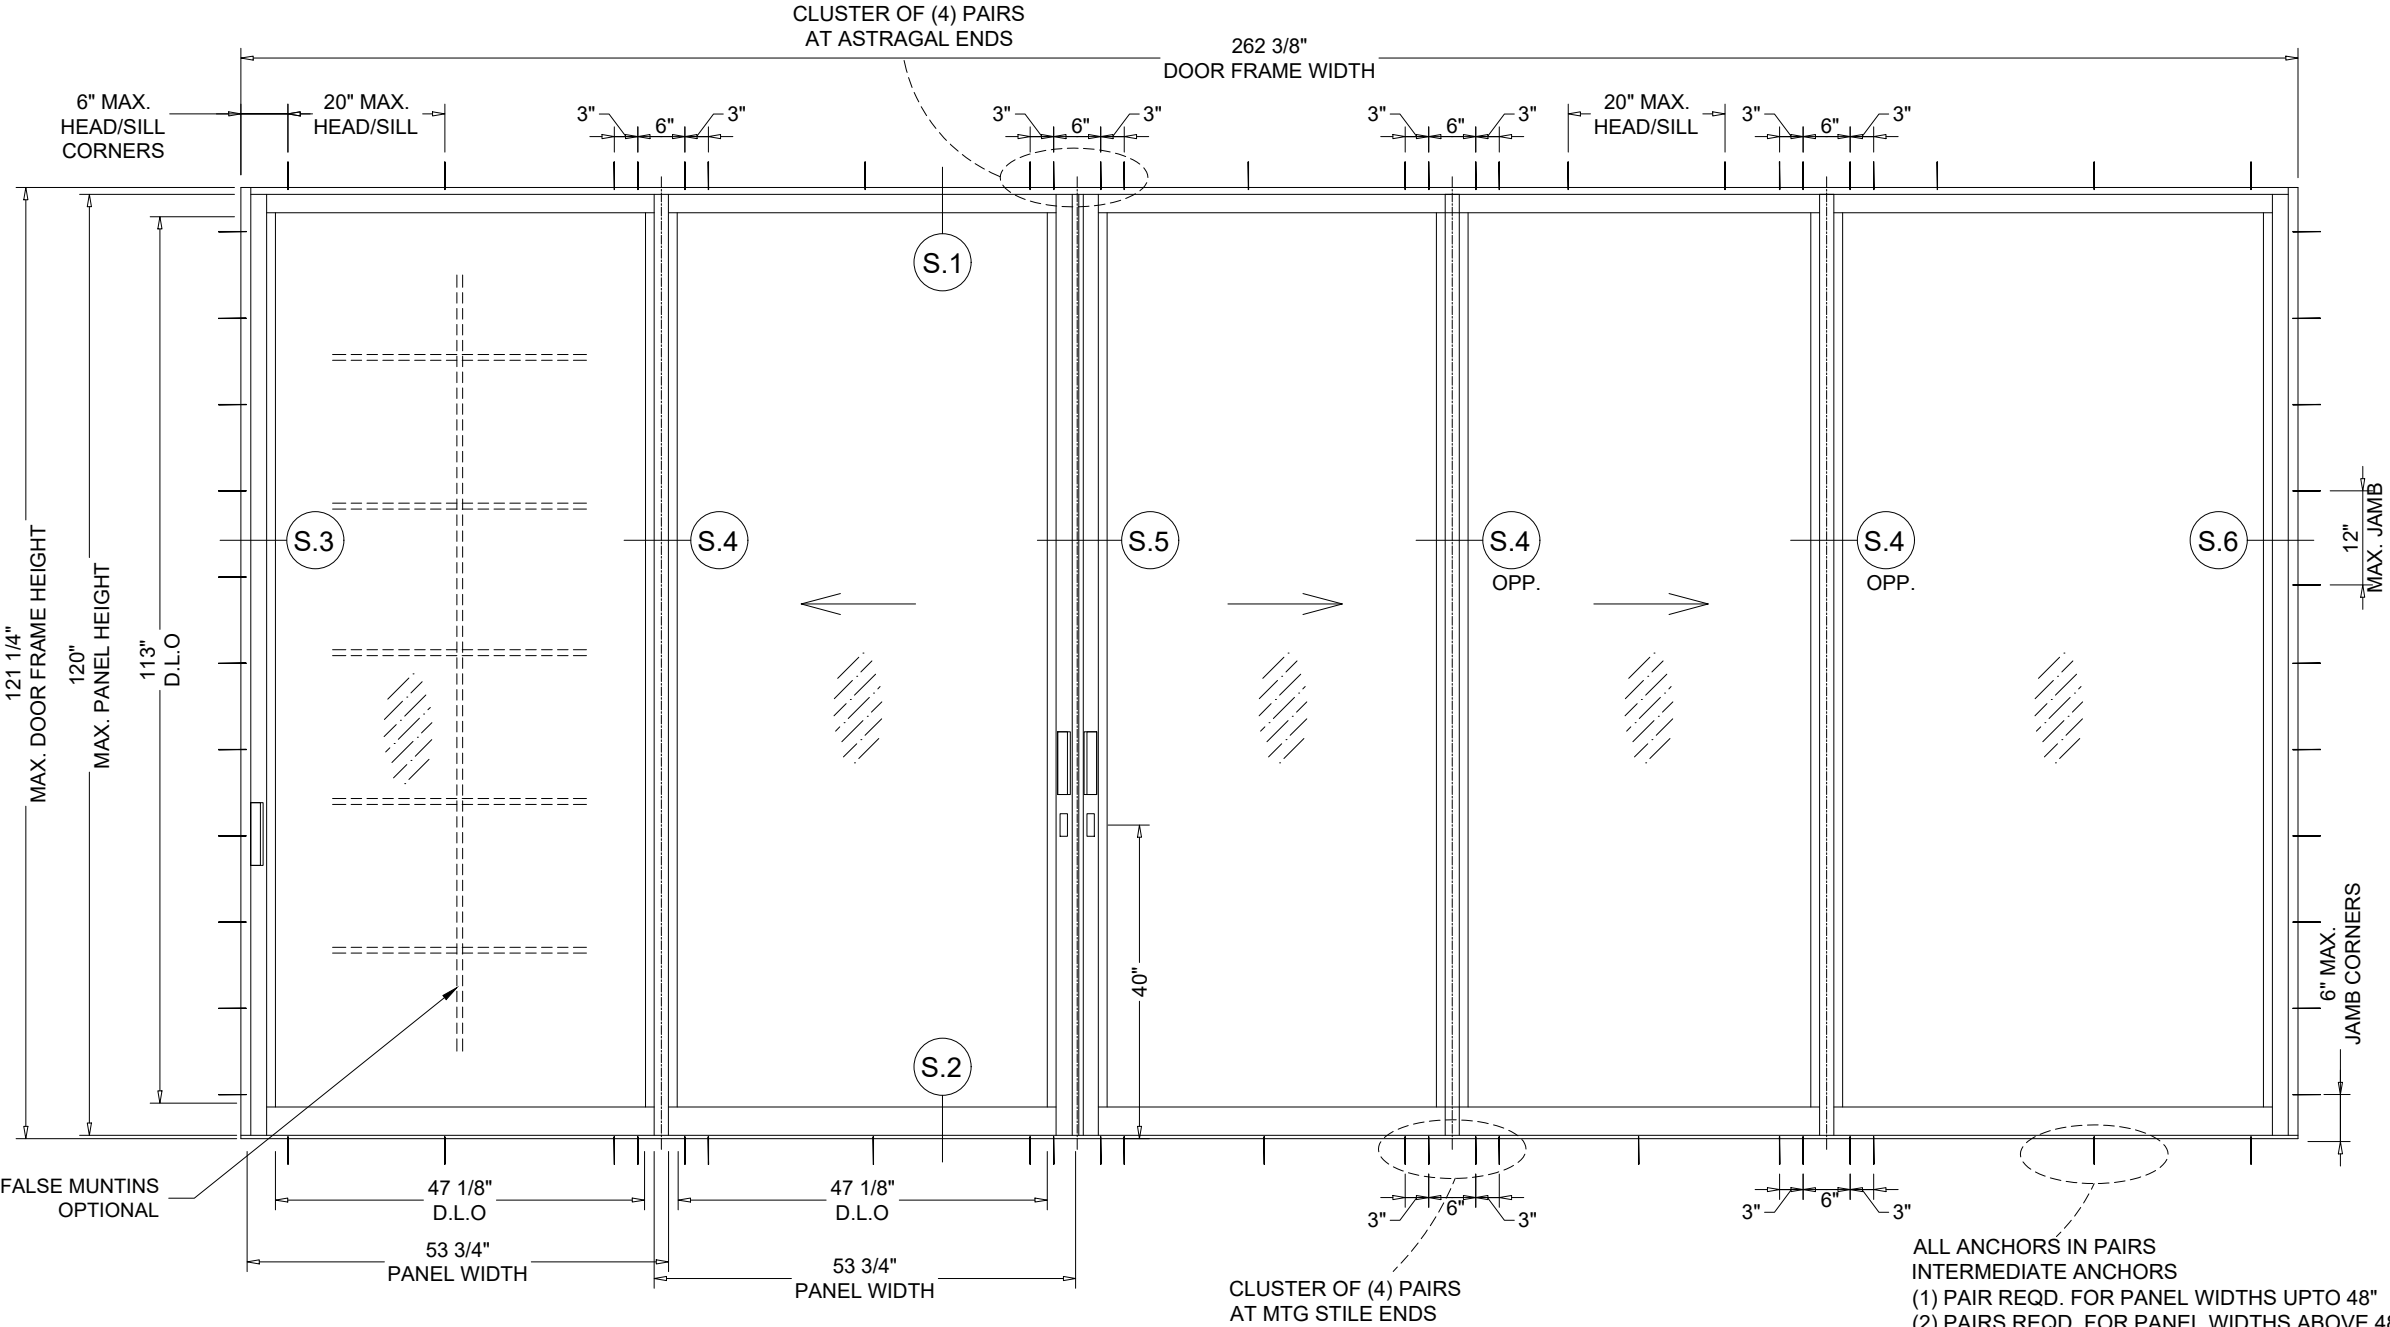


TYPICAL ELEVATION

LAMINATED GLASS
SMALL MISSILE IMPACT

THESE DOORS ARE RATED FOR SMALL IMPACT.
MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS
REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE.
SHUTTERS NOT REQUIRED FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

DAYLITE OPENINGS:
D.L.O. HEIGHT = PANEL HEIGHT - 7.000"
D.L.O. WIDTH = PANEL WIDTH - 6.625"
DOOR HEIGHT = PANEL HEIGHT + 1.250"

FL# 47347.1

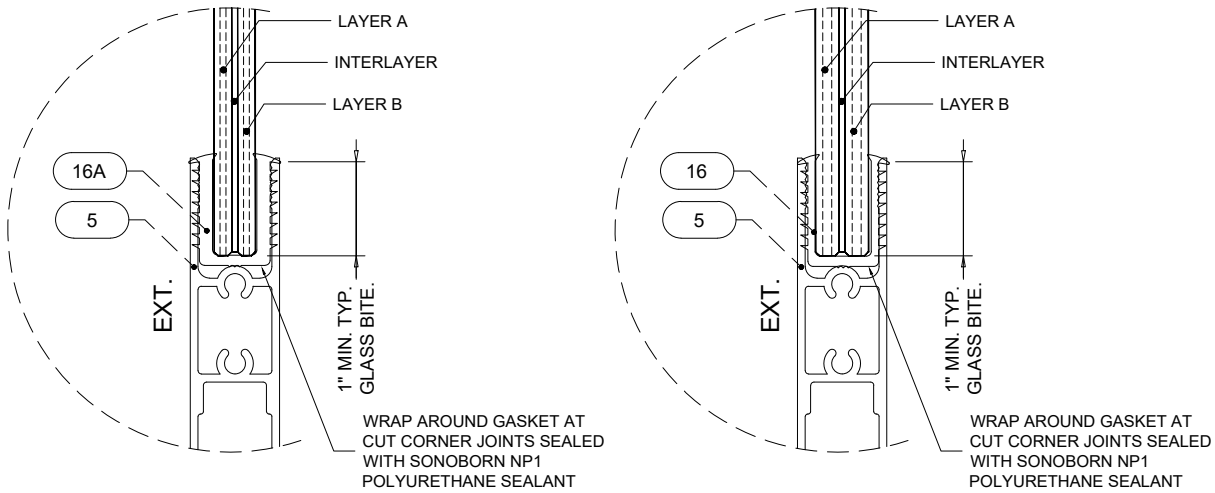

GLASS TYPE 'A'
7/16" OVERALL GLASS

GLASS TYPE 'B'
9/16" OVERALL GLASS

GLASS OPTIONS / DETAILS			
GLASS TYPE	LAYER A	INTERLAYER	LAYER B
A	3/16" HEAT STREN'D GLASS	0.060" INTERLAYER TROSIFOL PVB BY 'KURARAY AMERICA, INC.'	3/16" HEAT STREN'D GLASS
B	1/4" HEAT STREN'D GLASS	0.060" INTERLAYER TROSIFOL PVB BY 'KURARAY AMERICA, INC.'	1/4" HEAT STREN'D GLASS

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-09 (3 SEC.GUSTS)
AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

SUBSTRATE ANCHORS:

- A

1/4" DIA ULTRAACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD (HEAD / JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/4" MIN. EMBED INTO CONCRETE (HEAD / JAMBS)
1-1/2" MIN. EMBED INTO GROUT FILLED - BLOCKS (JAMBS)

DIRECTLY INTO CONC.OR BLOCKS
1-1/2" MIN. EMBED INTO CONC. (HEAD / SILL)
2" MIN. EMBED INTO CONC. OR FILLED-BLOCKS (JAMBS)
- B

1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO F.B.C. APPROVED MULLIONS
OR
INTO METAL STRUCTURES (HEAD/JAMBS)
(3) THREAD MIN. PENETRATION BEYOND METAL SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES
INTO CONCRETE AND BLOCKS = 2-1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.


DESIGN LOAD CAPACITY - PSF							
PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	STD. REINFORCING GLASS TYPES 'A' OR 'B'		HP REINFORCING GLASS TYPE 'B' (HI-RISE ADAPTER)			
		ANCHORS 'A', 'B' OR 'C'		ANCHOR 'A'		ANCHORS 'B' OR 'C'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
36	97-1/4	90.0	90.0	100.0	120.0	100.0	120.0
42		90.0	90.0	100.0	120.0	100.0	120.0
48		90.0	90.0	100.0	113.5	100.0	120.0
52		90.0	90.0	96.7	96.7	100.0	120.0
54		90.0	90.0	97.2	116.6	97.2	116.6
60		87.5	87.5	87.5	104.9	87.5	104.9
36	103-1/4	90.0	90.0	100.0	120.0	100.0	120.0
42		90.0	90.0	100.0	120.0	100.0	120.0
48		90.0	90.0	100.0	113.5	100.0	120.0
52		90.0	90.0	96.7	96.7	100.0	120.0
54		90.0	90.0	97.2	116.6	97.2	116.6
60		87.5	87.5	87.5	104.9	87.5	104.9
36	109-1/4	90.0	90.0	100.0	120.0	100.0	120.0
42		90.0	90.0	100.0	120.0	100.0	120.0
48		90.0	90.0	100.0	113.5	100.0	120.0
52		90.0	90.0	96.7	96.7	100.0	120.0
54		89.0	89.0	97.2	116.6	97.2	116.6
60		90.0	90.0	100.0	120.0	100.0	120.0
36	115-1/4	90.0	90.0	100.0	120.0	100.0	120.0
42		90.0	90.0	100.0	120.0	100.0	120.0
48		90.0	90.0	100.0	113.5	100.0	120.0
52		90.0	90.0	96.7	96.7	100.0	120.0
54		89.0	89.0	97.2	111.3	97.2	116.6
60		90.0	90.0	100.0	120.0	100.0	120.0
36	121-1/4	90.0	90.0	100.0	120.0	100.0	120.0
42		90.0	90.0	100.0	120.0	100.0	120.0
48		90.0	90.0	100.0	113.5	100.0	120.0
52		90.0	90.0	96.7	96.7	100.0	120.0
60		90.0	90.0	100.0	120.0	100.0	120.0
66		90.0	90.0	100.0	120.0	100.0	120.0

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY EGRESS REQUIREMENTS PER FBC.

SUBSTRATE STRENGTHS:


WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 GROUT FILLED - BLOCK AT JAMBS f'm = 2000 PSI MIN.

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT
BY 'PLAZA DOOR' MUST SUSTAIN LOADS IMPOSED BY
GLAZING SYSTEM AND TRANSFER THEM TO THE
BUILDING STRUCTURE.

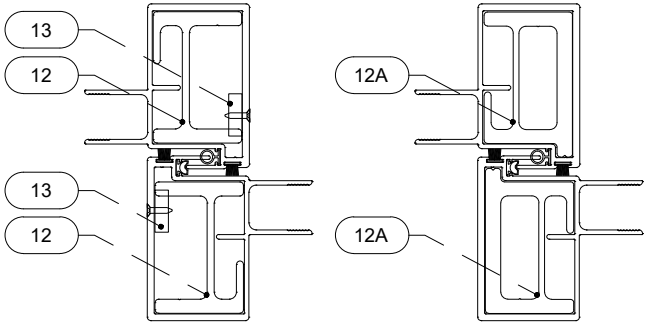

STD. REINF. INTERLOCK HP REINF. INTERLOCK


FL# 47347.1

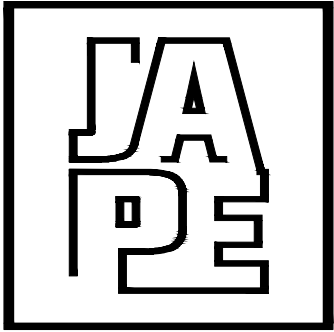


JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS


PROJECT :			
SERIES 'TITAN 120' ALUMINUM SLIDING GLASS DOOR (SMALL MISSILE IMPACT)			
CLIENT :			
NUEVO FLORIDA VENTURE, LLC D/B/A PLAZA DOOR			
4425 SW CARGO WAY, PALM CITY FL 34990, UNITED STATES			
REVISION			
No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE
date:		2/12/2025	
scale:		N/A	
drawn by:		M.S.	
check by:			
Drawing no.		JA-1463-24	
Eng: JAVAD AHMAD, PE CIVIL FLA. PE # 70592 – C.A.N. 34254			
			
SEALED: 02/12/2025			
ANCHOR / GLASS DET.			SHEET No. 3 OF 10

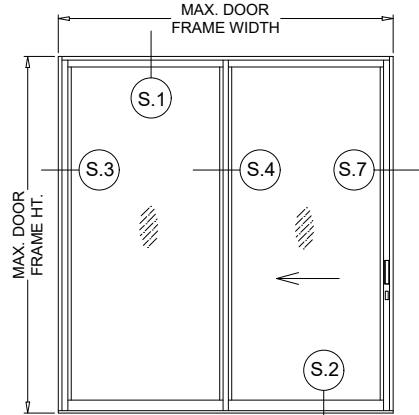


OX / XO / XX

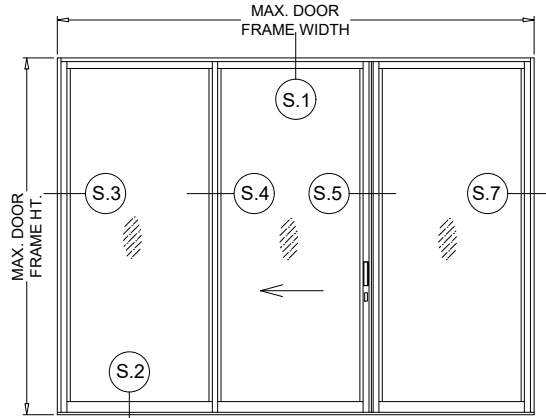

OXX / OXO / XXO

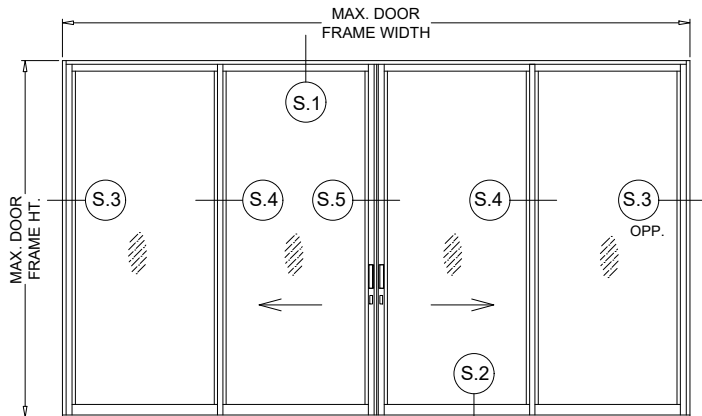


OXXO / OXXX / XXXX

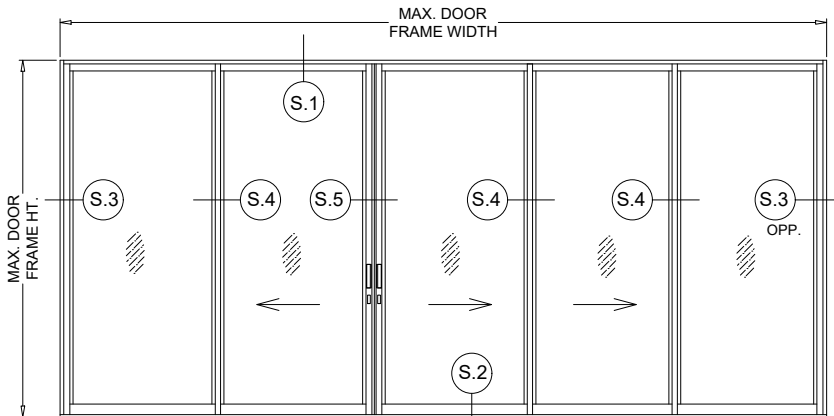

OXXXO


APPROVED CONFIGURATIONS

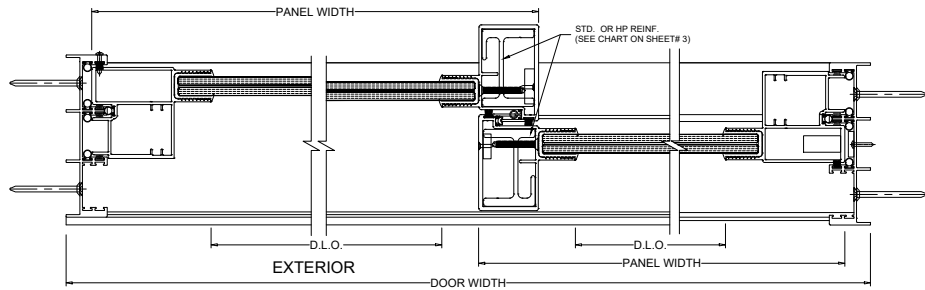

S3 JAMB DETAIL

S4 INTERLOCK DETAIL

S7 JAMB DETAIL

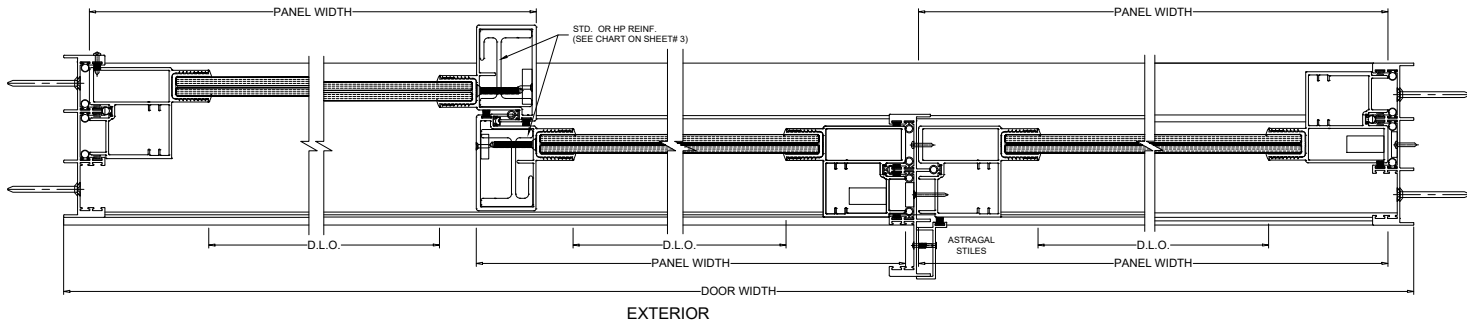


S3 JAMB DETAIL

S4 INTERLOCK DETAIL

S5 MEETING STILE DETAIL

S7 JAMB DETAIL

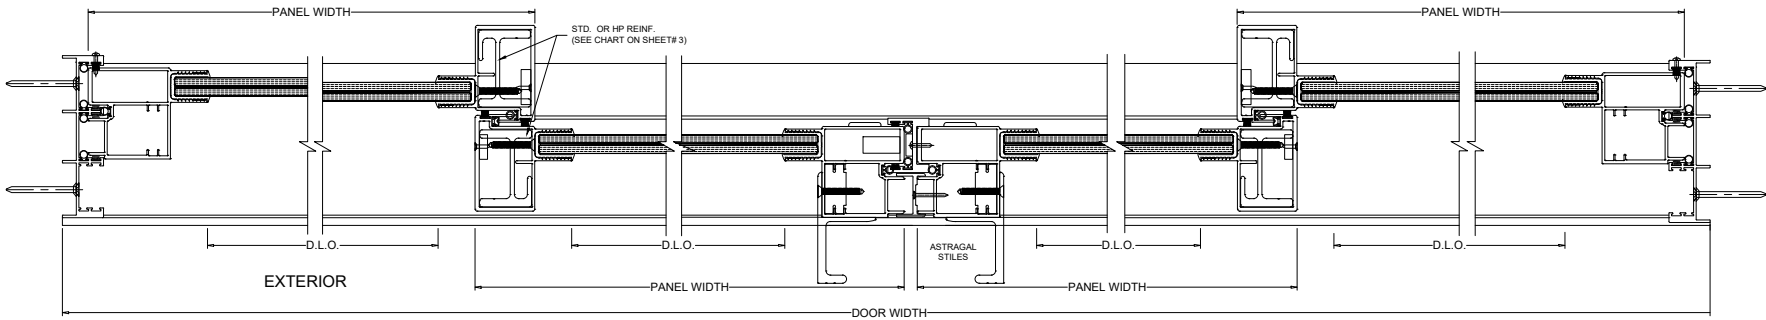


S3 JAMB DETAIL

S4 INTERLOCK DETAIL

S5 MEETING STILE DETAIL

S4 INTERLOCK DETAIL (OPP.)

S3 JAMB DETAIL (OPP.)

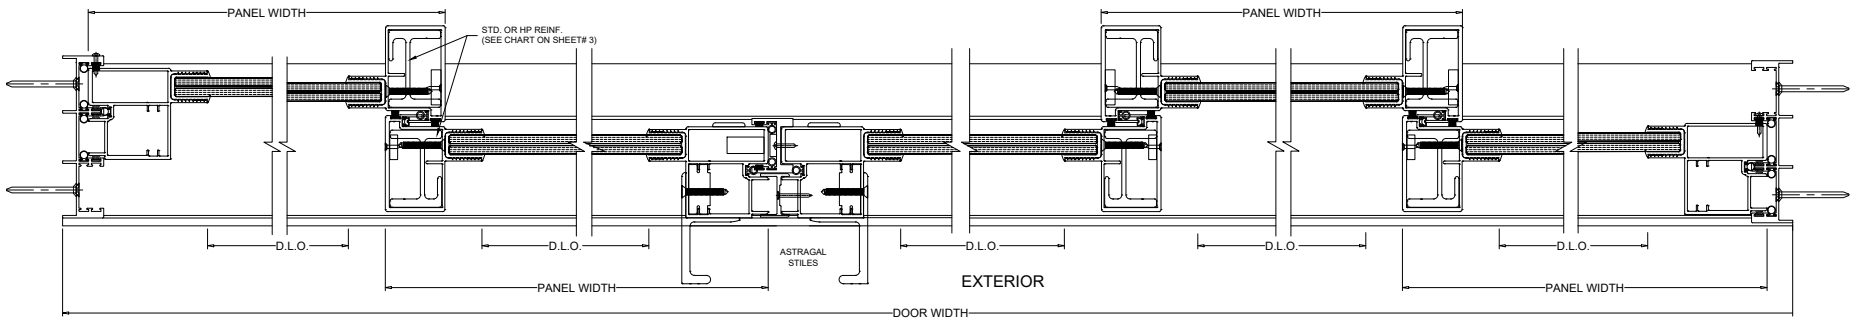

S3 JAMB DETAIL

S4 INTERLOCK DETAIL


S5 MEETING STILE DETAIL

S4 INTERLOCK DETAIL & OPP.

S3 JAMB DETAIL (OPP.)

FL# 47347.1

NOTE:
CONFIGURATIONS SHOWN FOR
ILLUSTRATION PURPOSE ONLY
(SEE APPLICABLE ANCHOR
INSTALLATIONS IN SHEET 3)

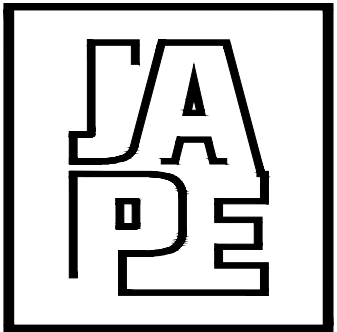

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com

CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :

SERIES 'TITAN 120' ALUMINUM
SLIDING GLASS DOOR
(SMALL MISSILE IMPACT)

CLIENT :

NUEVO FLORIDA VENTURE, LLC
D/B/A PLAZA DOOR

4425 SW CARGO WAY, PALM CITY
FL 34990, UNITED STATES

REVISION

No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE

date: 2/12/2025


scale: N/A

drawn by: M.S.

check by:

Drawing no. JA-1463-24

Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 - C.A.N. 34254

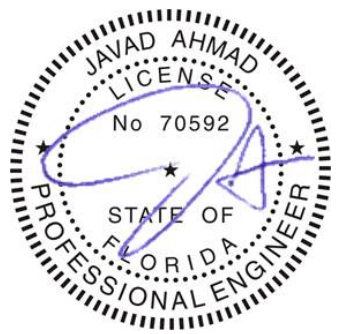


SEALED: 02/12/2025







CONFIG. DETAILS

SHEET No.
4 OF 10

S1 HEAD DETAIL

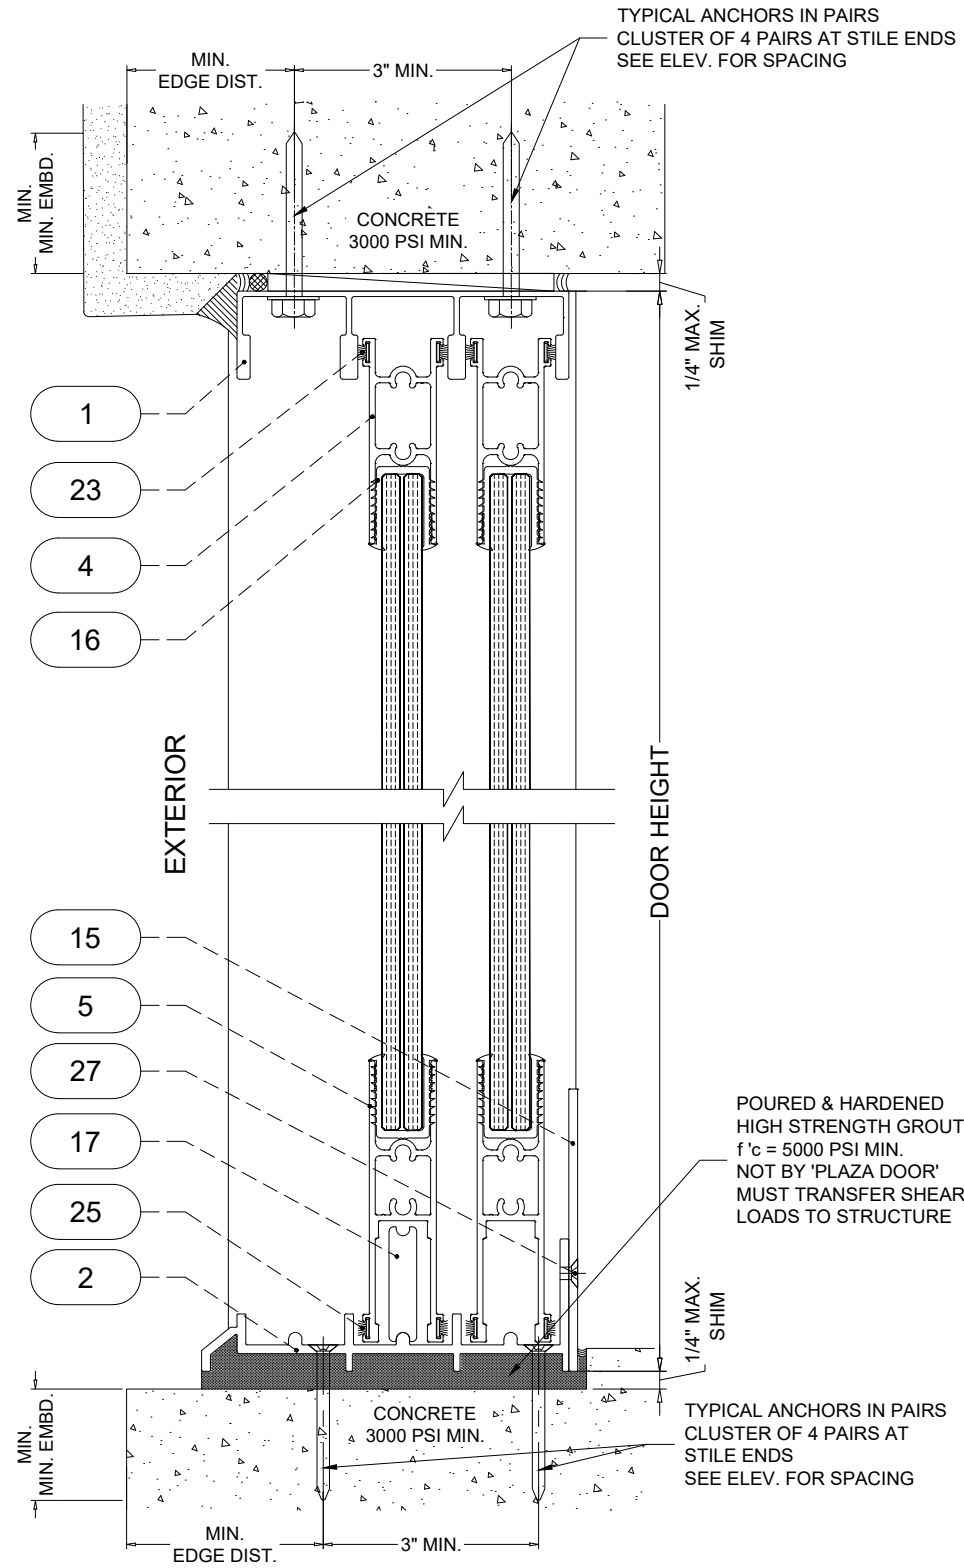

S2 SILL DETAIL

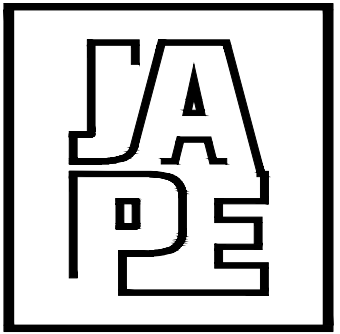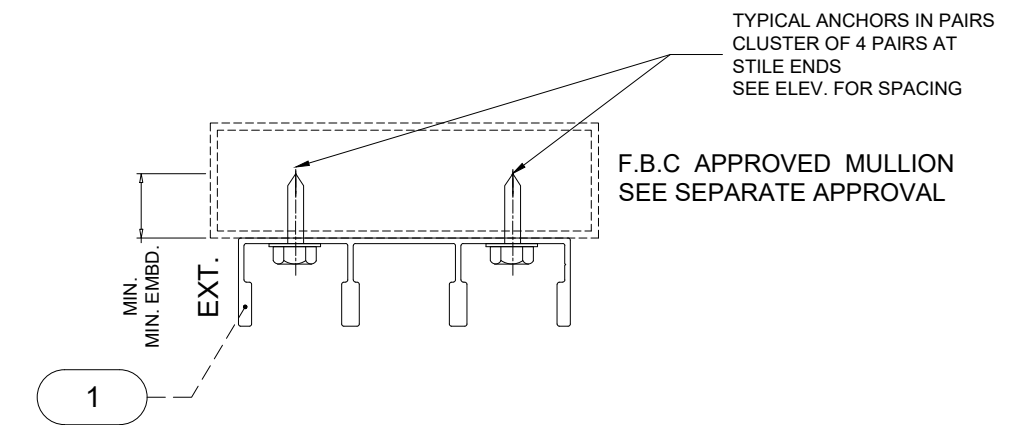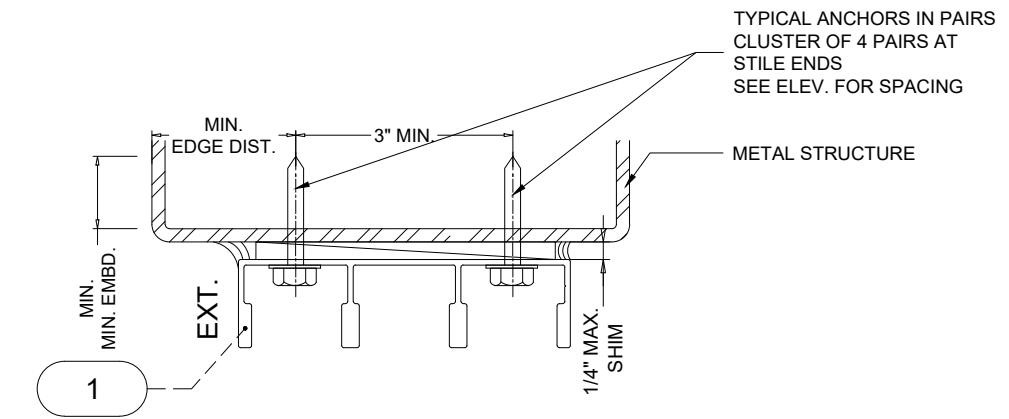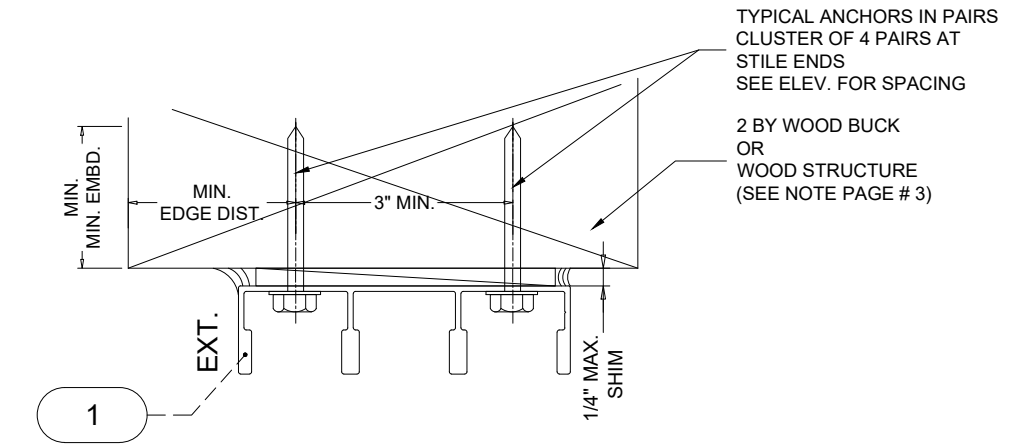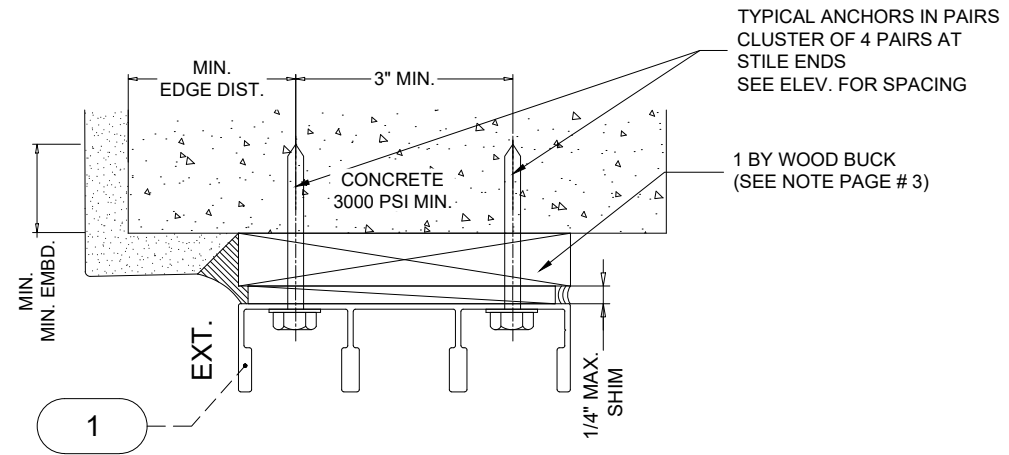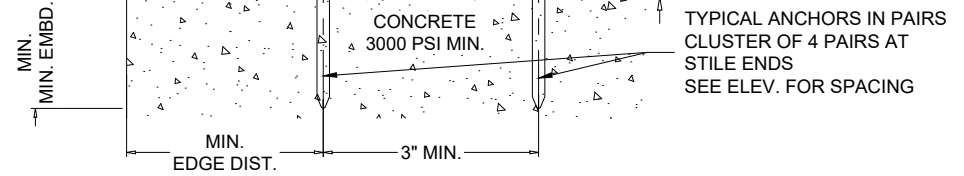

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com

CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :

SERIES 'TITAN 120' ALUMINUM
SLIDING GLASS DOOR
(SMALL MISSILE IMPACT)

CLIENT :

NUEVO FLORIDA VENTURE, LLC
D/B/A PLAZA DOOR

4425 SW CARGO WAY, PALM CITY
FL 34990, UNITED STATES

REVISION

No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE

date: 2/12/2025

scale: N/A

drawn by: M.S.

check by:

Drawing no. JA-1463-24

Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 - C.A.N. 34254




SEALED: 02/12/2025

SEC. DETAILS

SHEET No.
05 OF 10


FL# 47347.1

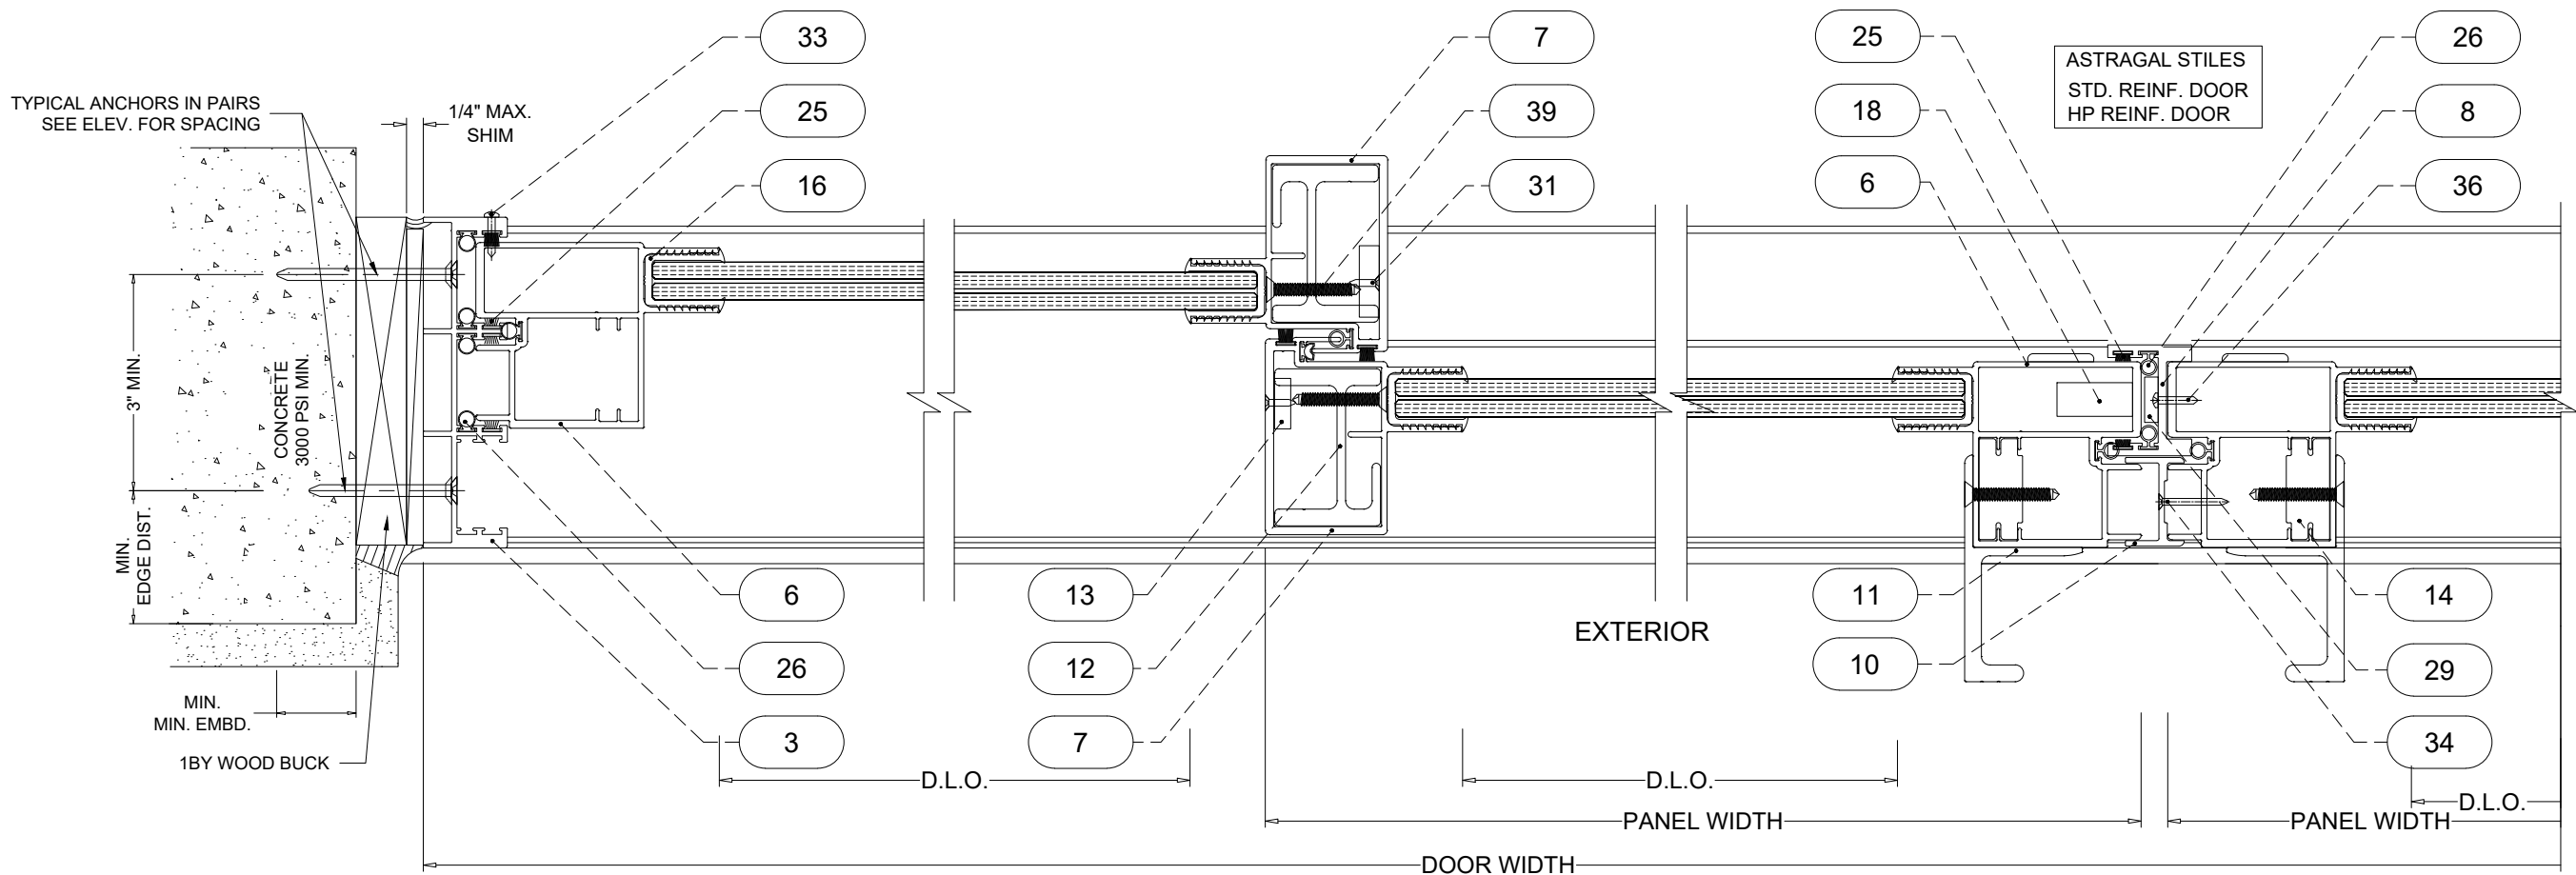

S3 JAMB DETAIL


S4 INTERLOCK DETAIL

S5 MEETING STILE DETAIL

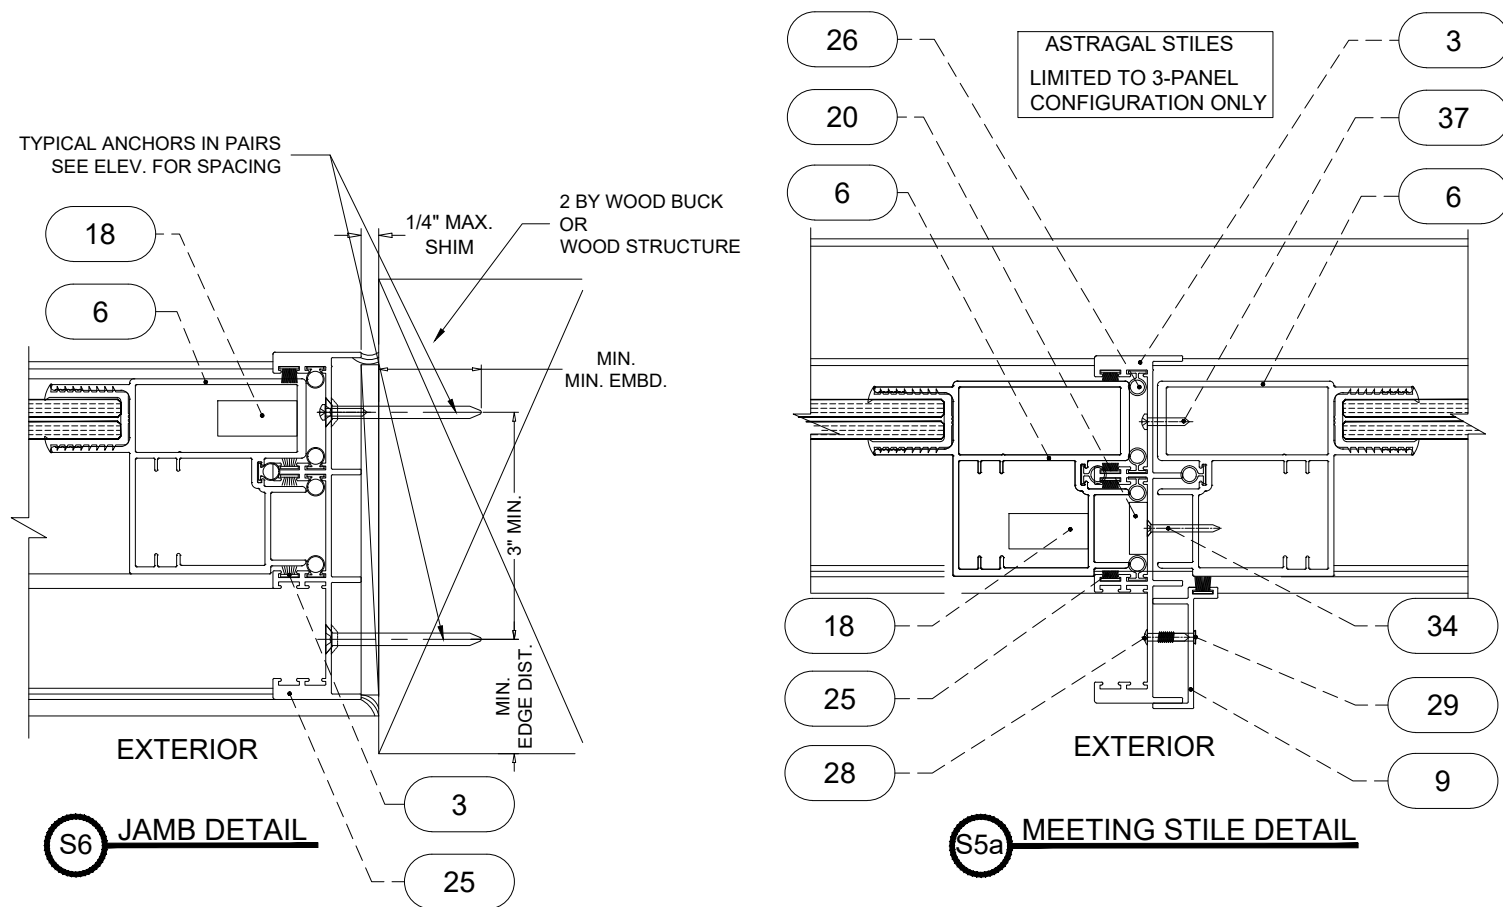

S6 JAMB DETAIL


S5a MEETING STILE DETAIL

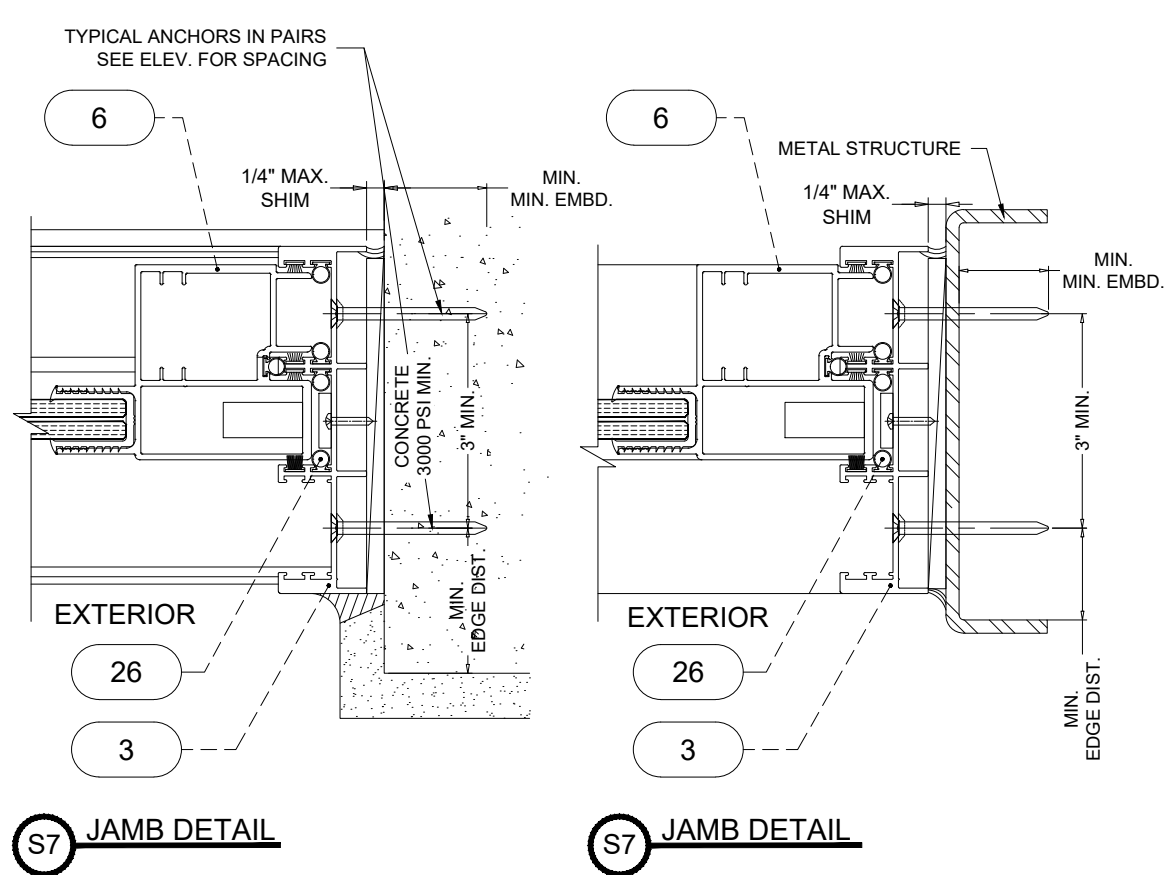

S7 JAMB DETAIL

S7 JAMB DETAIL

FL# 47347.1

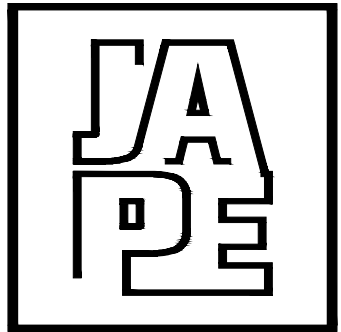

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126

Ph: (305) 424-8001

support@ja-pe.com

CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :

**SERIES 'TITAN 120' ALUMINUM
SLIDING GLASS DOOR
(SMALL MISSILE IMPACT)**

CLIENT :

**NUEVO FLORIDA VENTURE, LLC
D/B/A PLAZA DOOR**

4425 SW CARGO WAY, PALM CITY
FL 34990, UNITED STATES

REVISION

No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE

date: 2/12/2025


scale: N/A

drawn by: M.S.

check by:

Drawing no. JA-1463-24


Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 - C.A.N. 34254

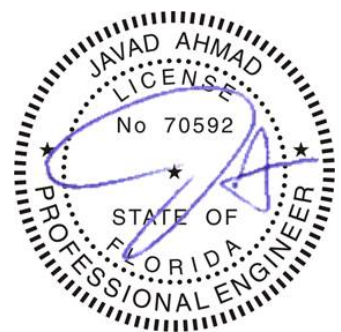


SEALED: 02/12/2025

SEC. DETAILS


**SHEET No.
6 OF 10**

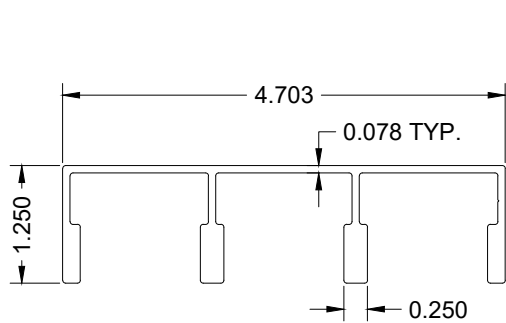


1 **FRAME HEAD**
SCALE = 6" = 1'-0"

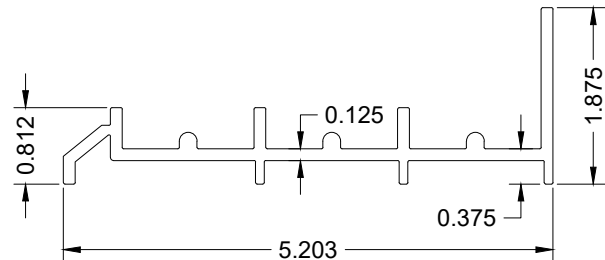


2 **FRAME SILL**
SCALE = 6" = 1'-0"

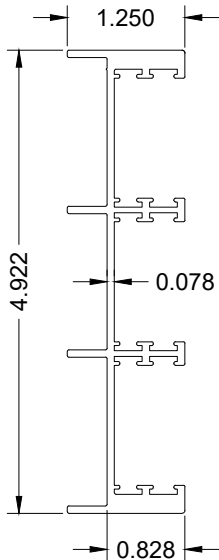


3 **FRAME JAMB**
SCALE = 6" = 1'-0"

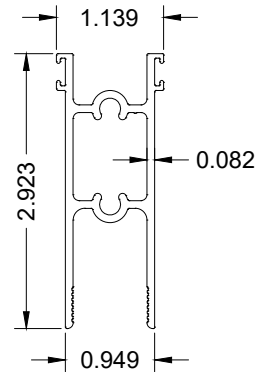


4 **PANEL TOP RAIL**
SCALE = 6" = 1'-0"

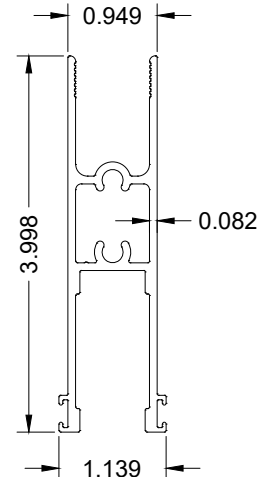


5 **PANEL BOTTOM RAIL**
SCALE = 6" = 1'-0"

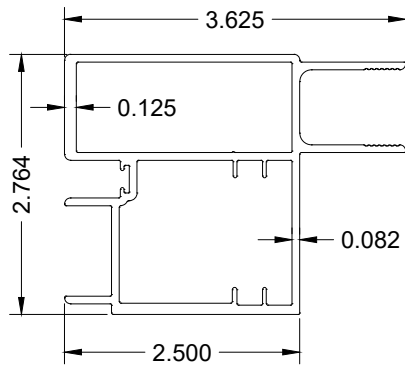


6 **JAMB / LOCK STILE**
SCALE = 6" = 1'-0"

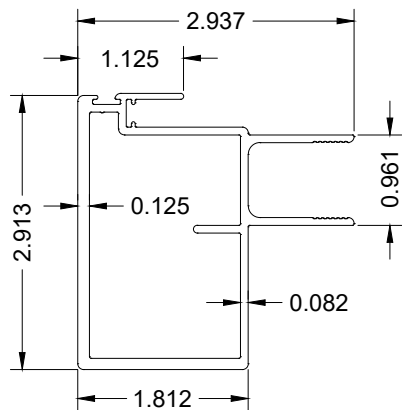


7 **INTERLOCK STILE**
SCALE = 6" = 1'-0"




8 **ASTRAGAL STILE**
SCALE = 6" = 1'-0"




9 **ADAPTER**
SCALE = 6" = 1'-0"




10 **SCREEN ASTRAGAL**
SCALE = 6" = 1'-0"



13 **INTERLOCK REINF.**
SCALE = 6" = 1'-0"




14 **STILE REINF.**
SCALE = 6" = 1'-0"

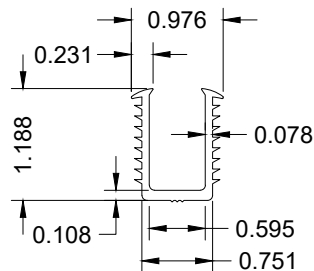


16 **GLAZING GASKET**
SCALE = 6" = 1'-0"

PVC MATERIAL BY 'POLYONE'
EXTRUDED BY 'CENTRAL PLASTICS'
HARDNESS = 75 SHORE A
TENSILE STRENGTH (100% STRAIN) = 800 PSI
TENSILE STRENGTH (BREAK) = 1900 PSI
ELONGATION AT BREAK = 380%
TEAR STRENGTH = 250 LBF / IN
SPECIFIC GRAVITY = 1.27



16A **GLAZING GASKET**
SCALE = 6" = 1'-0"

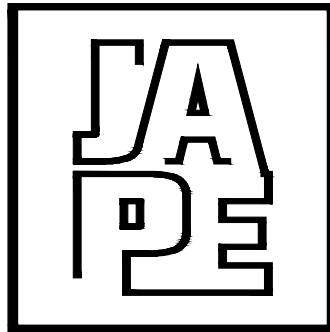

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com

CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :

SERIES 'TITAN 120' ALUMINUM
SLIDING GLASS DOOR
(SMALL MISSILE IMPACT)

CLIENT :

NUEVO FLORIDA VENTURE, LLC
D/B/A PLAZA DOOR

4425 SW CARGO WAY, PALM CITY
FL 34990, UNITED STATES

REVISION

No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE

date: 2/12/2025

scale: N/A

drawn by: M.S.

check by:

Drawing no. JA-1463-24

Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 - C.A.N. 34254




SEALED: 02/12/2025

PROFILES

SHEET No.
7 OF 10

FL# 47347.1

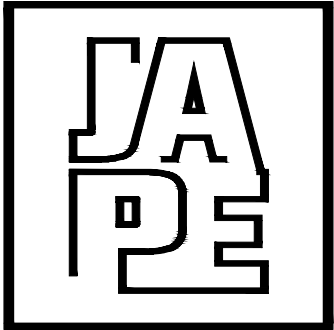

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001

support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :

SERIES 'TITAN 120' ALUMINUM
SLIDING GLASS DOOR
(SMALL MISSILE IMPACT)

CLIENT :

NUEVO FLORIDA VENTURE, LLC
D/B/A PLAZA DOOR

4425 SW CARGO WAY, PALM CITY
FL 34990, UNITED STATES

REVISION

No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE

date: 2/12/2025

scale: N/A

drawn by: M.S.

check by:

Drawing no. JA-1463-24

Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 – C.A.N. 34254




SEALED: 02/12/2025

PROFILES / BOM

SHEET No.
8 OF 10

BILL OF MATERIALS


ITEM #	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF. / SUPPLIER / REMARKS
1	PDC-009	1	FRAME HEAD	6063-T6	-
2	PDC-012	1	FRAME SILL	6063-T6	-
3	PDC-010	2	FRAME JAMB	6063-T6	-
4	PDC-058	1/ PANEL	PANEL TOP RAIL	6063-T6	-
5	PDC-059	1/ PANEL	PANEL BOTTOM RAIL	6063-T6	-
6	PDC-060	1/PANEL	JAMB / LOCK STILE	6063-T6	-
7	PDC-061	1/PANEL	INTERLOCK STILE	6063-T6	-
8	PDC-002	AS REQD.	ASTRAGAL STILE	6063-T6	-
9	PDC-067	AS REQD.	ADAPTER	6063-T6	-
10	PDC-022	AS REQD.	SCREEN ASTRAGAL	6063-T6	-
11	PDC-041	AS REQD.	HAND RAIL	6063-T6	-
12	PDC-062	1/ PANEL	STD. INTERLOCK STILE REINFORCEMENT, LENGTH = PANEL HT. - 18"	6063-T6	-
12A	PDC-099	1/ PANEL	HP INTERLOCK STILE REINFORCEMENT, LENGTH = PANEL HT. - 18"	6063-T6	-
13	PDC-092	2/ PANEL	INTERLOCK REINFORCEMENT, 12" LONG	6063-T6	-
14	PDC-093	1/ PANEL	STILE REINFORCEMENT,LENGTH = PANEL HT.-18"	6063-T6	-
15	PDC-085	1	HI-RISE ADAPTER	6063-T6	-
16	2-270-0	AS REQD.	GLAZING SUSPENSION CLAMP (X-1842) (9/16" GLASS)	FLEXIBLE PVC	MELTPPOINT PLASTICS
16A	2-271-0	AS REQD.	GLAZING SUSPENSION CLAMP (X-1842) (7/16" GLASS)	FLEXIBLE PVC	MELTPPOINT PLASTICS
17	3-310-0	2/ MOV. PANEL	ADJUSTABLE ROLLER ASSEMBLY ALUMINUM HOUSING,DELTRIN TIRE,ST.STEEL BEARING	-	IIBP
18	2-322-0	-	DEADLOCK # 1847-02 SS	-	ADAMS RITE
19	2-351-0	-	LOCK ESCUTCHEON # 4430	-	ADAMS RITE
20	3-001-0	-	LOCK KEEPER	-	IIBP
21	3-008-0	-	TRACK RAIN PAN	-	IIBP
22	3-009-0	-	H.P. WEATHER TAB	-	IIBP
23	2-400-0	AS REQD.	.270 WIDE POLY-BOND FINSEAL #PB-8425-2211-0	-	SCHLEGAL
24	2-402-0	AS REQD.	.270 WIDE POLY-BOND WOOLPILE # PB-7525-6011-6	-	SCHLEGAL
25	2-407-0	AS REQD.	.270 WIDE POLY-BOND FINSEAL #PB-7531-6011-2	-	SCHLEGAL
26	2-222-0	AS REQD.	BULB W'STRIPPING (EV-277)	-	ULTRAFAB
27	2-025-0	-	# 10-24 X 1/4" PFH UC SMS	-	AT 2" FROM ENDS & 14" O.C.
28	2-038-0	-	# 8-32 X 1-1/2" MS	-	AT 6" FROM ENDS & 14" O.C.
29	2-060-0	-	# 8-32 X 5/8" ALUMINUM SEX BOLTS	-	AT 6" FROM ENDS & 14" O.C.
30	2-010-0	-	# 12 X 1-1/4" PPH SS SMS	-	1 PER DOOR ROLLER
31	2-040-0	-	# 8 X 1" FH SMS	-	2 PER 12" REINF. BAR
32	2-007-0	-	# 14 X 1-1/4" PH SMS	-	2 PER DOOR PANEL CORNERS
33	2-019-0	-	# 8 X 1/2" PH SMS	-	AT 3" FROM ENDS & 18" O.C.
34	2-069-0	-	# 8 X 1-1/4" SMS	-	AT 3" FROM ENDS & 18" O.C.
35	2-027-0	-	# 10 X 1-1/4" MS TYPE F FH	-	AT 6" FROM ENDS & 12" O.C.
36	2-042-0	-	# 8 X 3/4" PH SMS	-	AT 6" FROM ENDS & 18" O.C.
37	2-022-0	-	# 10 X 1-1/4" FH SMS	-	AT 6" FROM ENDS & 14" O.C.
39	2-027-0	1	# 10 X 1-1/4" MS TYPE F FH	-	(1) AT 9" FROM BOTTOM
40	-	AS REQD.	JAMB SHEAR CLIP, 3" LONG MIN. OR CONTINOUS	6063-T6	-

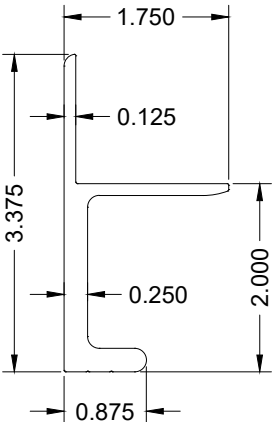

11

HAND RAIL


SCALE = 6" = 1'-0"

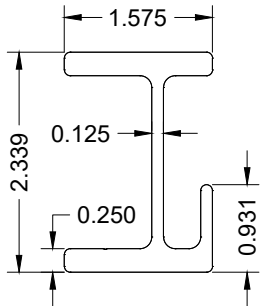

12

INTERLOCK STILE STIFFENER


SCALE = 6" = 1'-0"

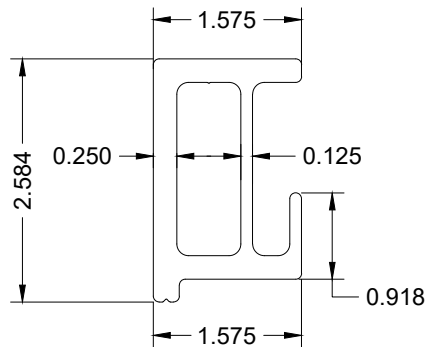

12A

INTERLOCK STILE STIFFENER


SCALE = 6" = 1'-0"

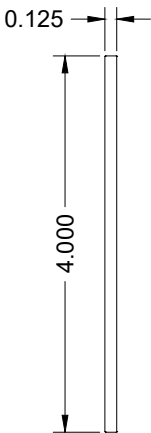

15

HI-RISE ADAPTER

SCALE = 6" = 1'-0"




40

SHEAR CLIP

SCALE = 6" = 1'-0"

FL# 47347.1

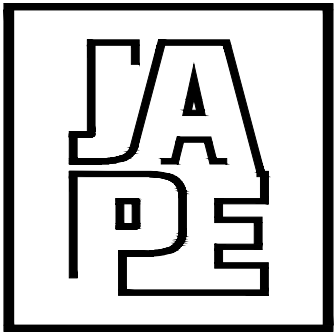

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :

SERIES 'TITAN 120' ALUMINUM
SLIDING GLASS DOOR
(SMALL MISSILE IMPACT)

CLIENT :

NUEVO FLORIDA VENTURE, LLC
D/B/A PLAZA DOOR

4425 SW CARGO WAY, PALM CITY
FL 34990, UNITED STATES

REVISION

No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE

date: 2/12/2025


scale: N/A

drawn by: M.S.

check by:

Drawing no. JA-1463-24

Eng: JAVAD AHMAD, PE
CIVIL FLA. PE # 70592 - C.A.N. 34254

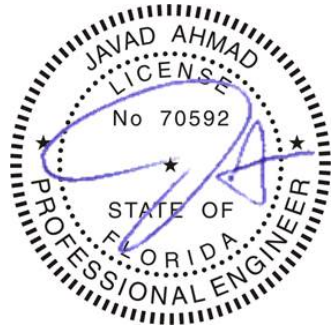

SEALED: 02/12/2025

INSTALL. DETAIL

SHEET No.
9 OF 10

PANEL TOP CORNER

SCALE = 6" = 1'-0"


4

32

6

32

5

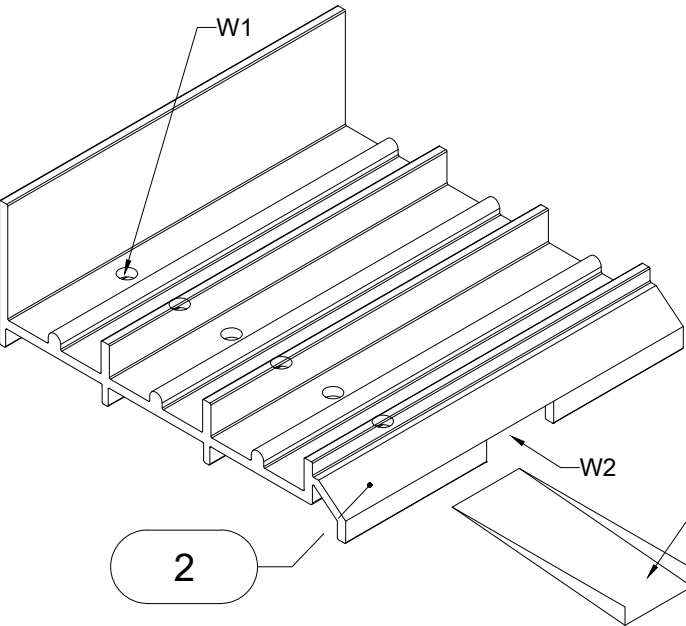

WEEP HOLES

SCALE = 6" = 1'-0"


W1 = CLUSTER OF (6) 3/8" DIA WEEP HOLES AT EACH
DRAIN PAN LOCATED AT 17" FROM EA. END AND 20" OC.

W2 = 1 1/2" X 1/4" FACTORY APPLIED DRAIN PAN
LOCATED 17" FROM ENDS AND MAX. 20" OC (3-008)


PANEL BOTTOM CORNER

SCALE = 6" = 1'-0"

FL# 47347.1

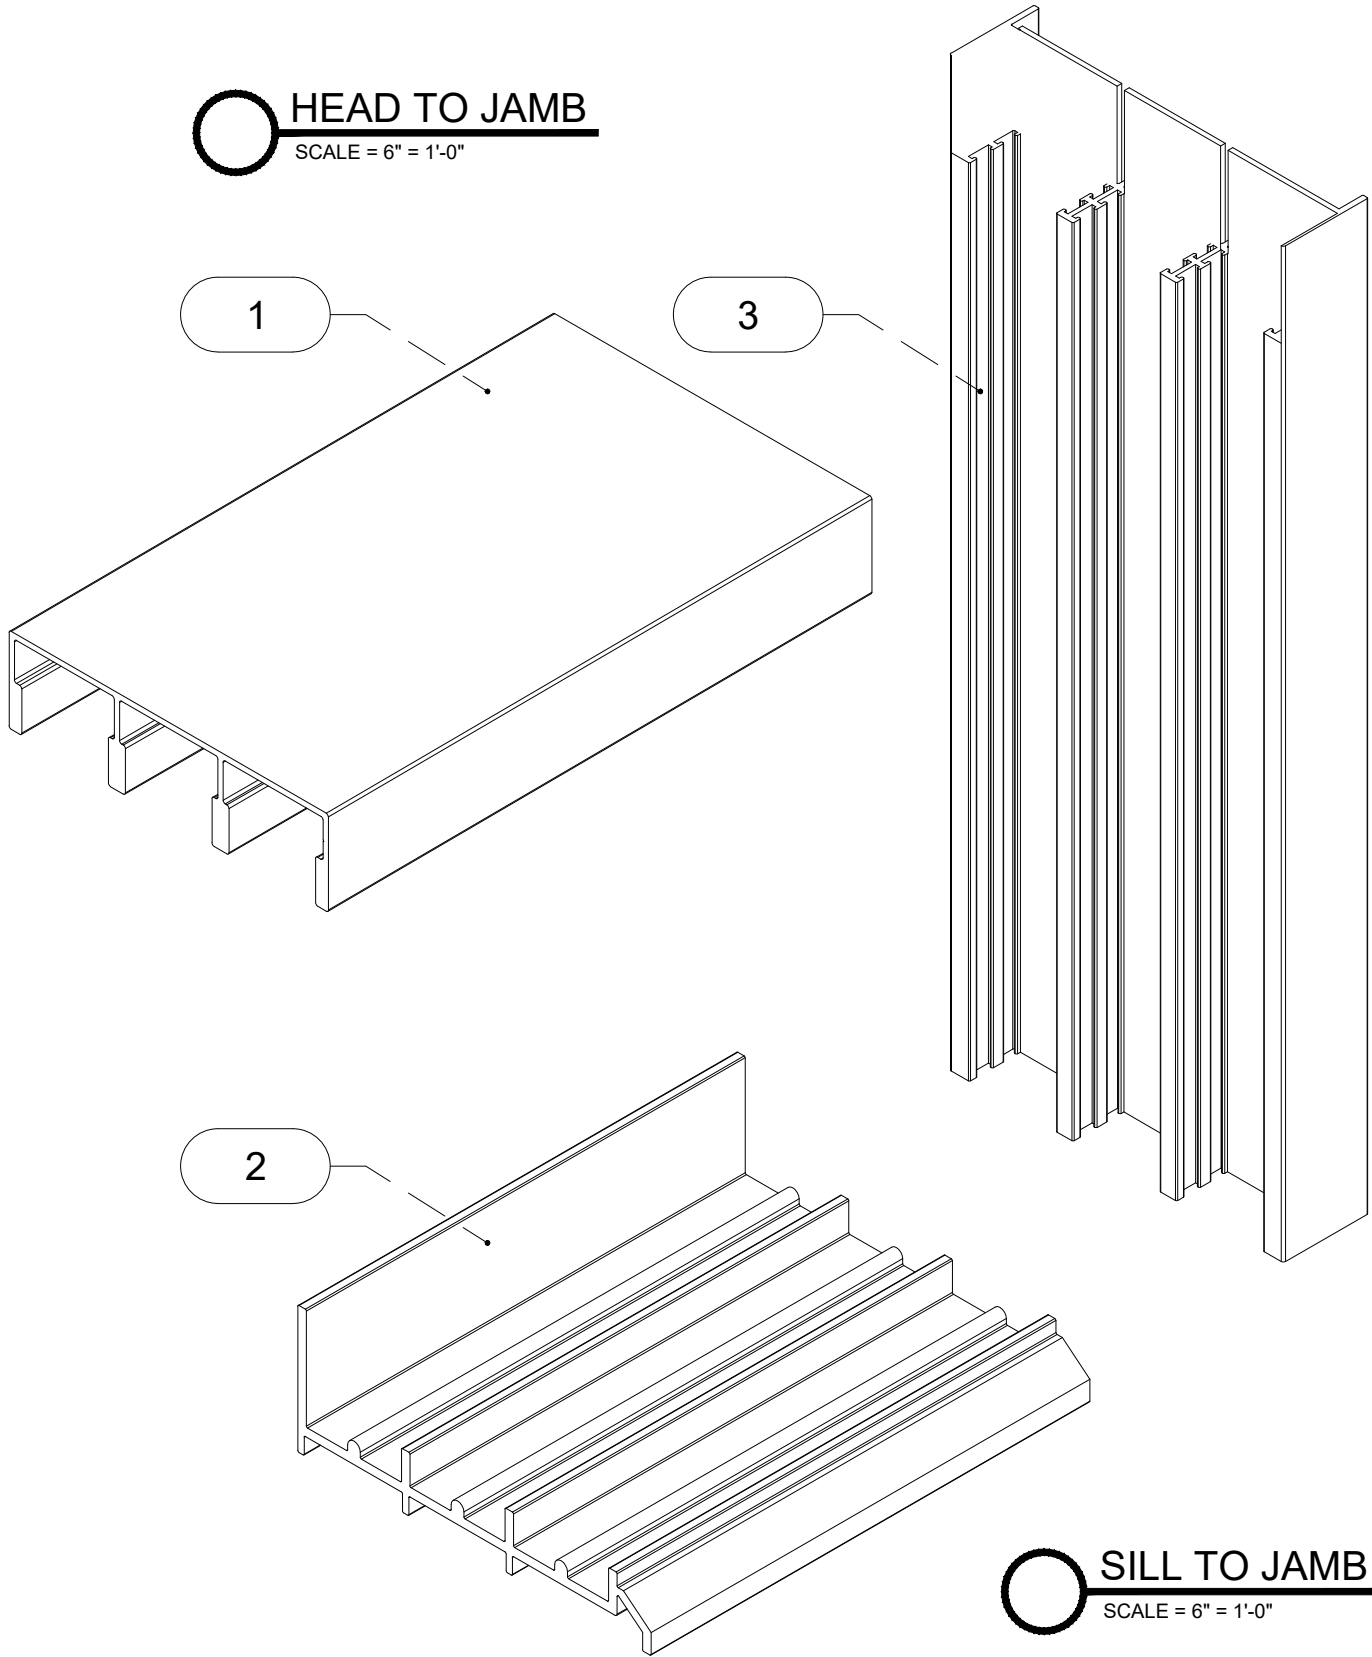

FL# 47347.1

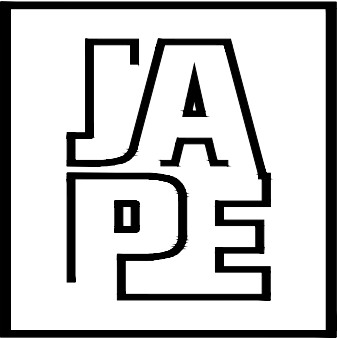

JAVAD AHMAD PE, inc

7875 NW 12 Street, Suite 102
Doral, FL 33126
Ph: (305) 424-8001
support@ja-pe.com
CONSULTING • STRUCTURAL DESIGN • FACADES • BUILDING
ENVELOPE • SYSTEM DESIGN • PRODUCT APPROVALS

PROJECT :			
SERIES 'TITAN 120' ALUMINUM SLIDING GLASS DOOR (SMALL MISSILE IMPACT)			
CLIENT :			
NUEVO FLORIDA VENTURE, LLC D/B/A PLAZA DOOR			
4425 SW CARGO WAY, PALM CITY FL 34990, UNITED STATES			
REVISION			
No.	DATE	BY	DESCRIPTION
0	02/12/25		INITIAL ISSUE
date:		2/12/2025	
scale:		N/A	
drawn by:		M.S.	
check by:			
Drawing no.		JA-1463-24	
Eng: JAVAD AHMAD, PE CIVIL FLA. PE # 70592 — C.A.N. 34254			



SEALED: 02/12/2025

INSTALL. DETAIL	SHEET No. 10 OF 10
-----------------	-----------------------