

ANDERSEN CORPORATION

100 SERIES DOUBLE HUNG WINDOW (NON-HVHZ) (NON-IMPACT)

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INC. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- THROUGH FRAME/INSTALLATION CLIP: FOR INSTALLATION INTO 2X WOOD FRAME USE TWO (2) #8 WOOD SCREWS PER INSTALLATION CLIP OR ONE (1) #8 WOOD SCREW THROUGH FRAME PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- THROUGH FRAME/INSTALLATION CLIP: FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/ MASONRY, USE ONE (1) 3/16 INCH ITW TAPCON PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT.
- THROUGH FRAME/INSTALLATION CLIP: FOR INSTALLATION THROUGH METAL STUD USE TWO (2) #8 SELF-TAPPING SCREWS PER INSTALLATION CLIP OR ONE (1) #8 SELF TAPPING SCREW THROUGH FRAME PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND METAL STRUCTURE.
- NAILING FIN: FOR INSTALLATION THROUGH 2X WOOD FRAME USE ONE (1) #8 WOOD SCREW OR 8D COMMON NAIL PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- NAILING FIN: FOR INSTALLATION THROUGH METAL STUD USE ONE (1) #8 SELF-TAPPING SCREW OF SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM PENETRATION BEYOND METAL STRUCTURE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE -MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - MASONRY - STRENGTH CONFORMANCE TO ASTM C-90. MIN. COMPRESSIVE STRENGTH OF 1500 PSI.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 33 MILS. (20 GAUGE)
 - ALUMINUM - 1/8" MINIMUM THICKNESS (6063-T5).

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** TO PROTECT THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: FIBREX
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
X: OPERABLE SASH
O: FIXED SASH
- CUSTOM SIZES AVAILABLE UPON REQUEST.
- ALL FULL UNIT ELEVATIONS SHOWN IN THIS DRAWING ARE SHOWN AS VIEWED FROM THE INTERIOR.

GLAZING NOTES:

1.

GLASS TYPE SHALL COMPLY WITH ASTM E1300 & FBC SAFETY REQUIREMENTS.

2.

SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.

3.


SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.

4.

D.L.O. MAY NOT EXCEED MAX DIMENSIONS SHOWN ON ELEVATIONS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES, INSTALLATION NOTES, & GLAZING DETAIL
2	ELEVATIONS
3	NAIL FIN ANCHOR LAYOUTS
4	THROUGH FRAME/INSTALLATION CLIP ANCHOR LAYOUTS
5	VERTICAL SECTIONS
6	HORIZONTAL SECTIONS
7	INSTALLATION DETAILS AND ANCHOR SCHEDULE
8	ALTERNATE FRAME OPTIONS

DESIGN PRESSURE TABLE		
SIZE & CONFIGURATION	DESIGN PRESSURE	MISSILE IMPACT RATING
47.5" x 77.5" EQUAL SASH	+30/-30 PSF	NON-IMPACT
47.5" x 77.5" COTTAGE	+30/-30 PSF	
47.5" x 77.5" REVERSE COTTAGE	+30/-30 PSF	
37.5" x 89.5" EQUAL SASH	+30/-30 PSF	
37.5" x 89.5" COTTAGE	+30/-30 PSF	
37.5" x 89.5" REVERSE COTTAGE	+30/-30 PSF	

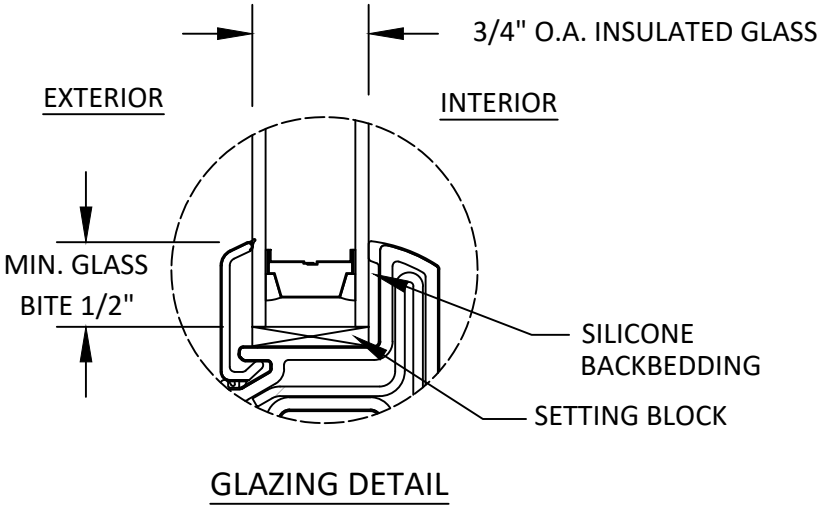

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE:

100 SERIES
DOUBLE HUNG WINDOW
(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES, INSTALLATION NOTES,
& GLAZING DETAIL

PREPARED BY:


BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.06.23 09:48:04 -04'00'

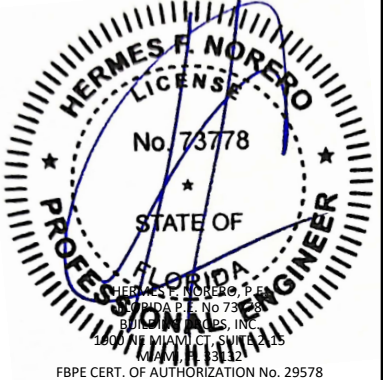

FL #:

FL47424

DATE:

06.18.25

DWG. BY:

DB

CHK. BY:

HFN

SCALE:

NTS

DWG. #:


AWD356

SHEET:


1

OF 8


c:\users\sebastianhereros\building drops - common\projects\andersen windows\100 series double hung window\dwg\awd356.dwg 6/19/2025 4:24 PM

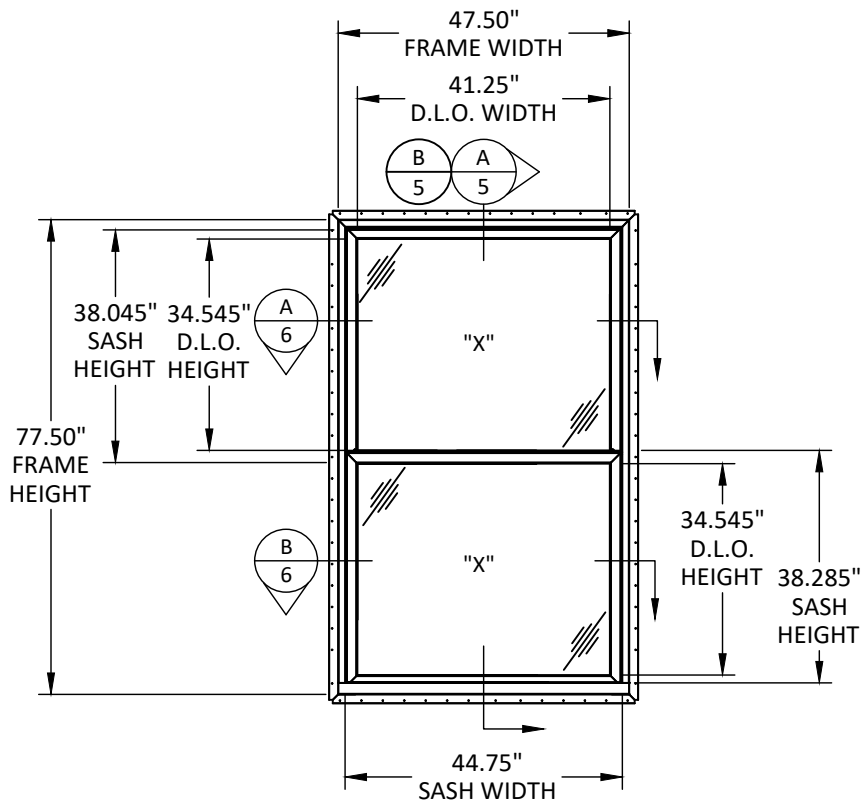


ELEVATION

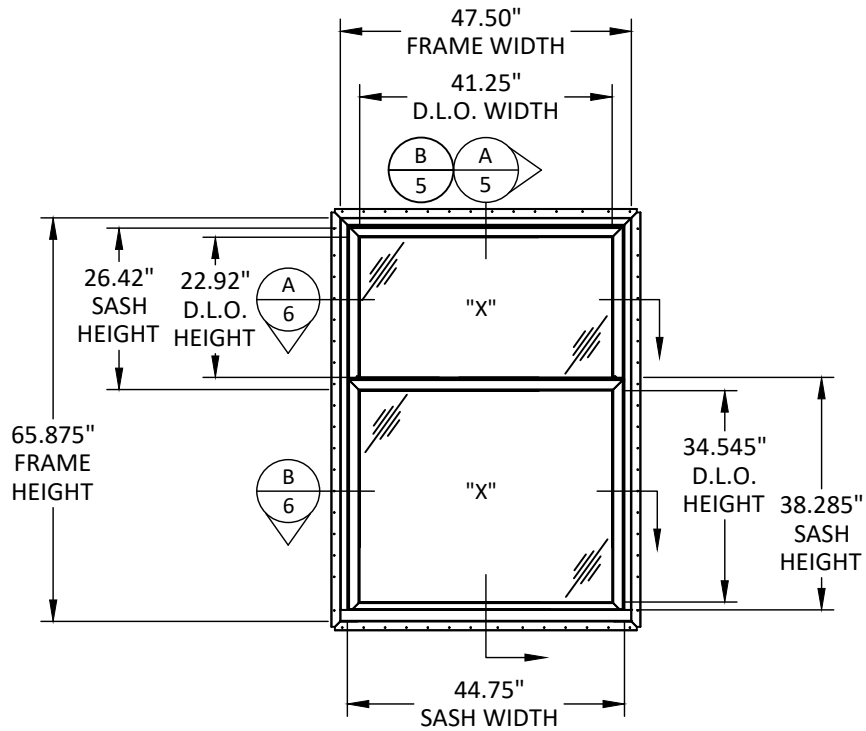


ELEVATION

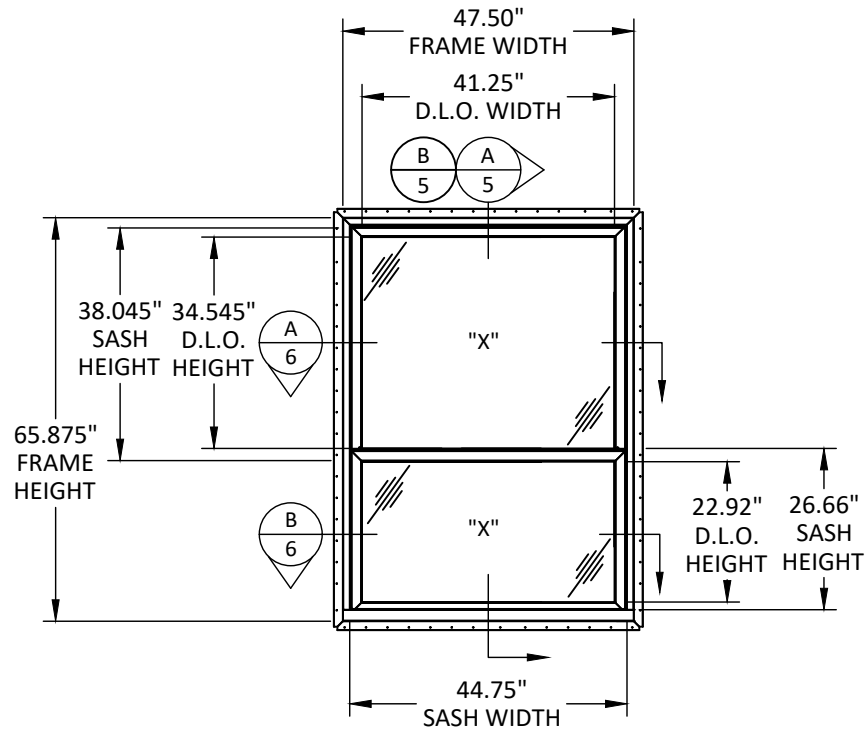


ELEVATION

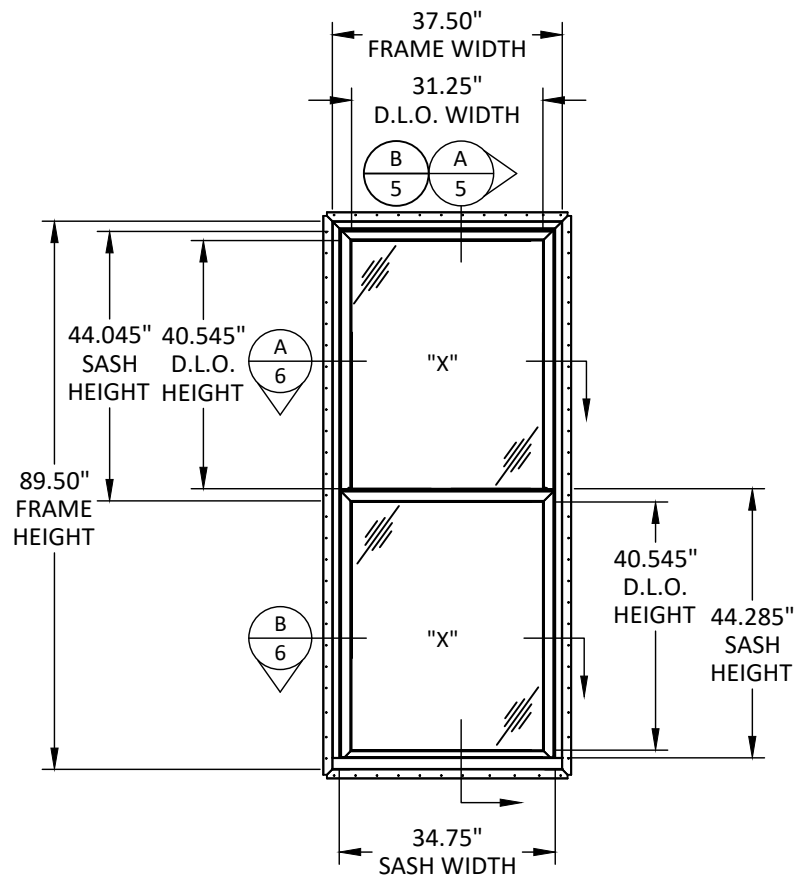

ELEVATION

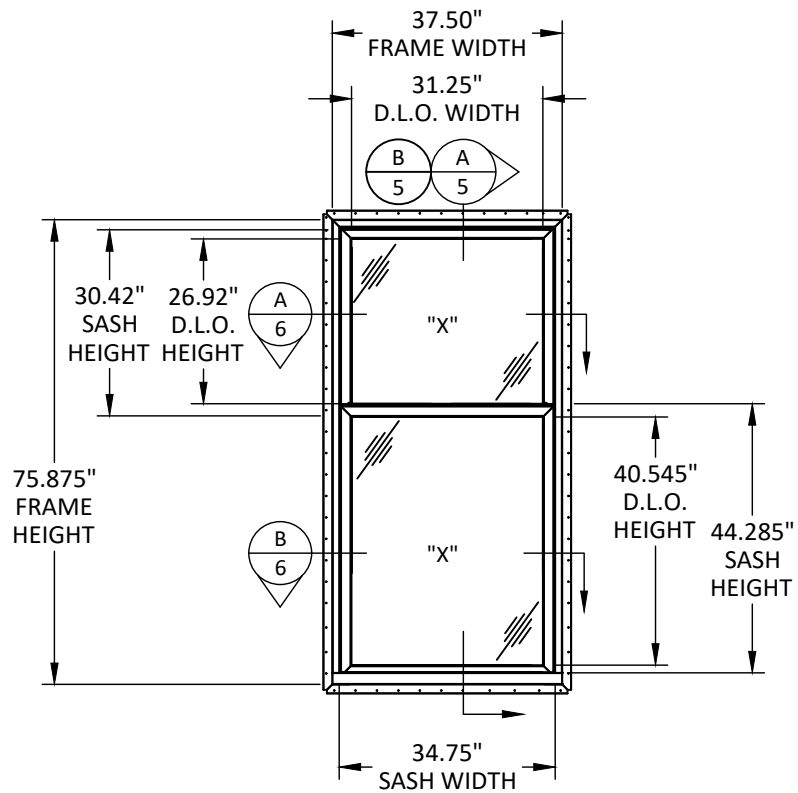

ELEVATION

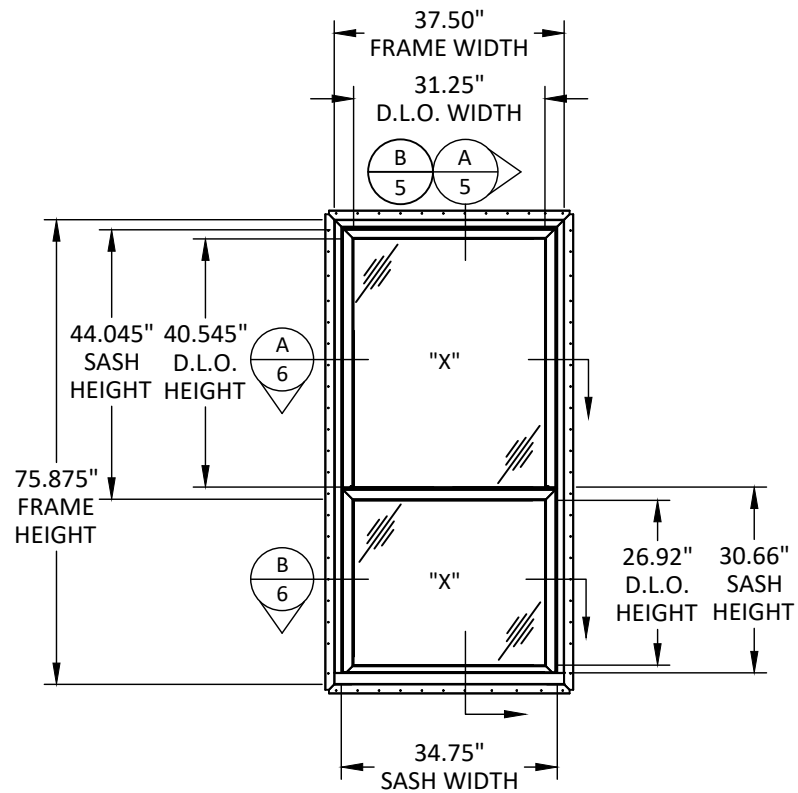

ELEVATION



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE:
100 SERIES
DOUBLE HUNG WINDOW
(NON-HVHZ)(NON-IMPACT)

ELEVATION & ANCHOR LAYOUT

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132


PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

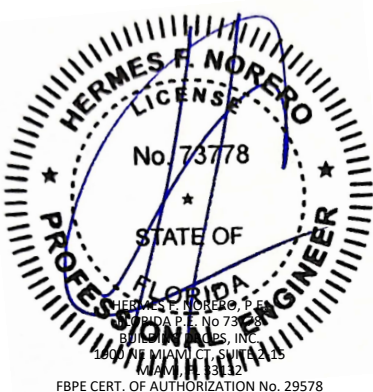


FL #:	FL47424
DATE:	06.18.25
DWG. BY:	DB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	AWD356
SHEET:	2


c:\users\sebastianh\documents\projects\andersen windows\100 series double hung window\dwgs\awd356.dwg 6/19/2025 4:24 PM

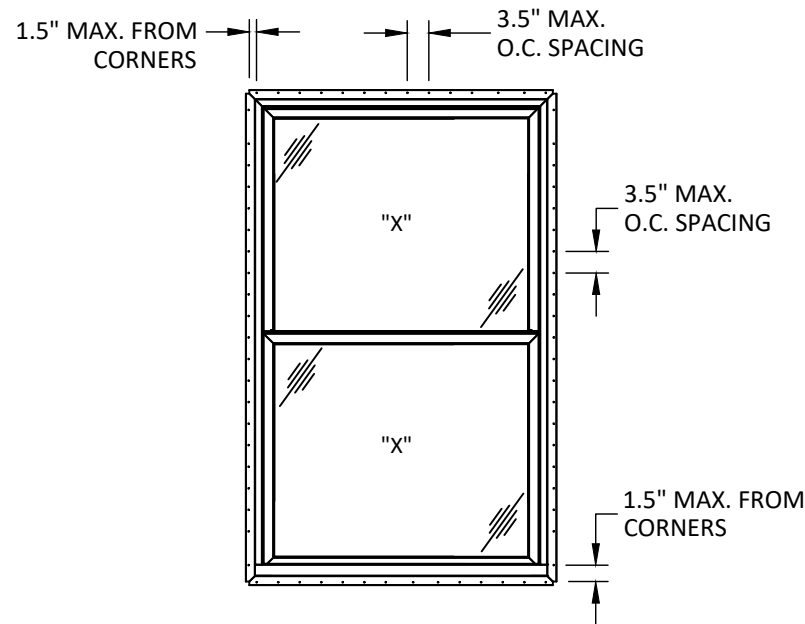

TYPICAL ANCHOR LAYOUT
NAIL FIN INSTALLATION

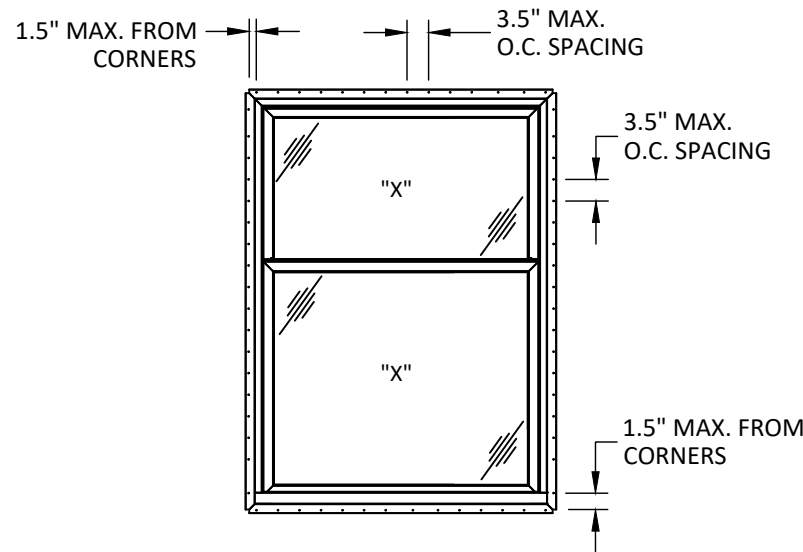

TYPICAL ANCHOR LAYOUT
NAIL FIN INSTALLATION

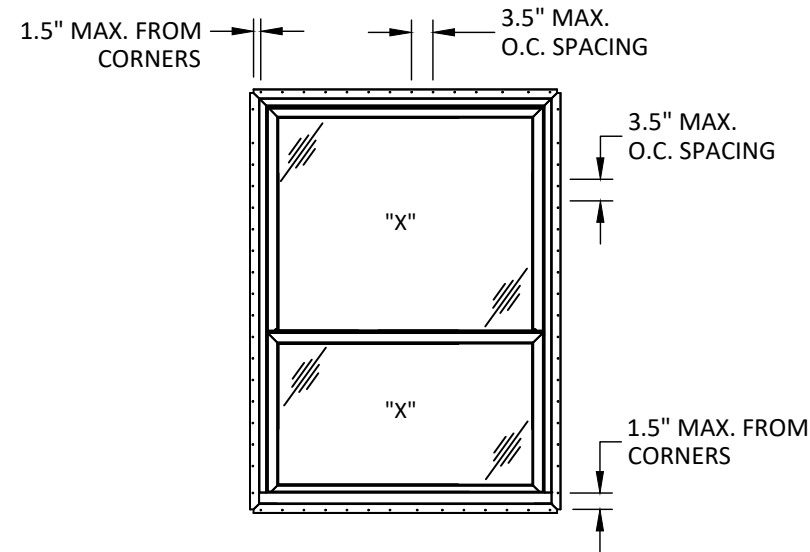

TYPICAL ANCHOR LAYOUT
NAIL FIN INSTALLATION

ANCHOR SCHEDULE								
INSTALLATION TYPE	QTY PER LOCATION	SUBSTRATE	ANCHOR TYPE	EMBEDMENT (IN.)	EDGE DISTANCE (IN.)	HEAD/SILL O.C. DISTANCE (IN.)	JAMB O.C. DISTANCE (IN.)	CORNER DISTANCE (IN.)
NAIL FIN	1	WOOD	#8 WOOD ANCHOR	1.50	0.75	3.50	3.50	3.50
NAIL FIN	1	WOOD	8D COMMON NAIL	1.50	0.75	3.50	3.50	3.50
NAIL FIN	1	METAL STUD	#8 SELF-TAPPING SCREW	3 THREADS	0.50	3.50	3.50	3.50



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE:
100 SERIES
DOUBLE HUNG WINDOW
(NON-HVHZ)/(NON-IMPACT)

NAIL FIN
ANCHOR LAYOUTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132


PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

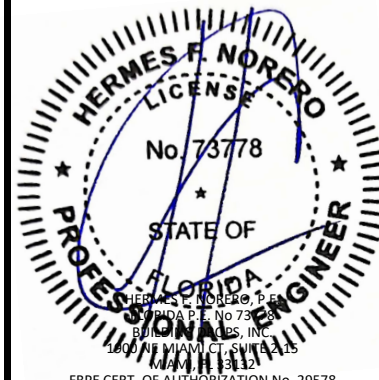

FL #:
FL47424

DATE: **06.18.25**

DWG. BY:
DB

CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **AWD356**

SHEET:


3

OF 8

c:\users\sebastianh\documents\projects\andersen windows\100 series double hung window\dwgs\awd356.dwg 6/19/2025 4:24 PM

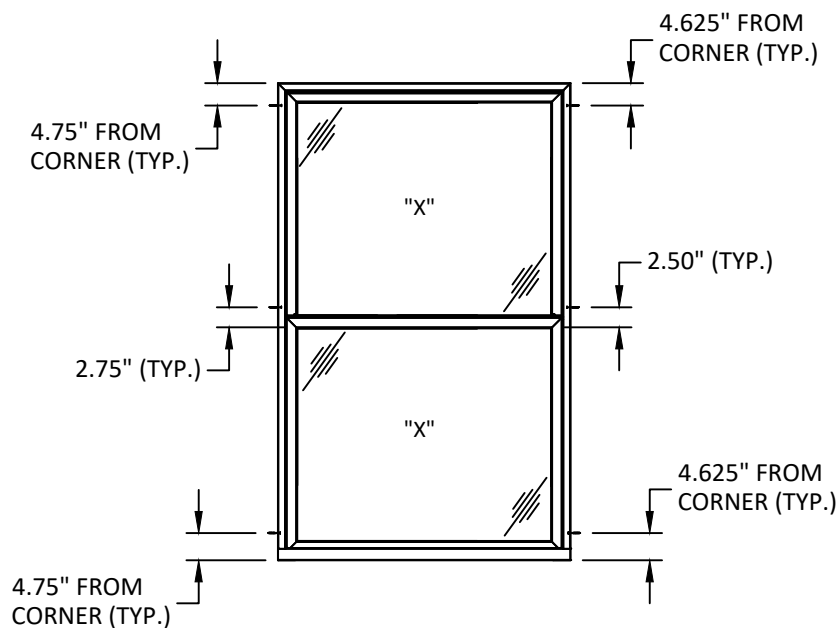


ANCHOR LAYOUT
THROUGH FRAME/
INSTALLATION CLIP

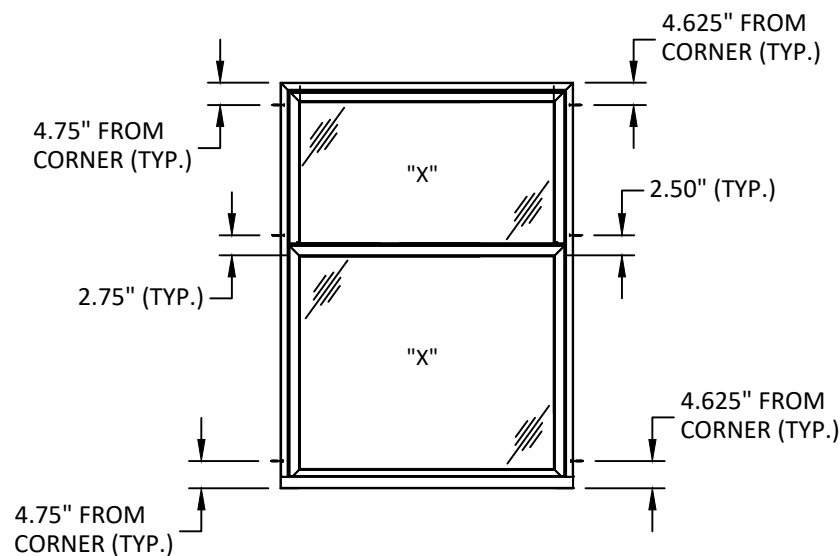

ANCHOR LAYOUT
THROUGH FRAME/
INSTALLATION CLIP

NOTE: AN ADDITIONAL INSTALLATION HOLE WILL
BE PRESENT WHEN THE SPAN BETWEEN ANCHOR
LOCATIONS IS GREATER THAN 28.785".

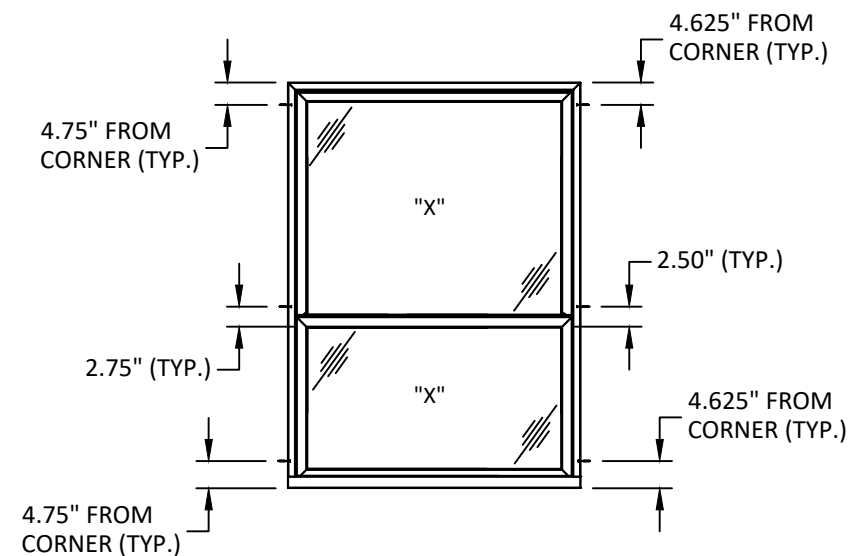

ANCHOR LAYOUT
THROUGH FRAME/
INSTALLATION CLIP



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE:
100 SERIES
DOUBLE HUNG WINDOW
(NON-HVHZ)/(NON-IMPACT)
THROUGH FRAME/INSTALLATION
CLIP ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

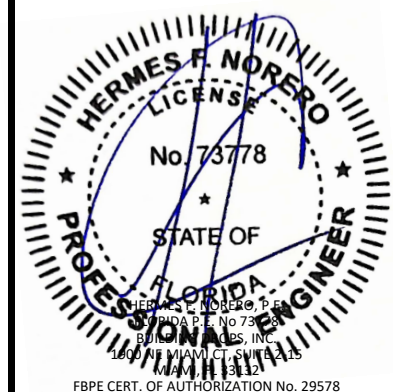


FL #:	FL47424
DATE:	06.18.25
DWG. BY:	CHK. BY:
DB	HFN
SCALE:	NTS
DWG. #:	AWD356
SHEET:	4

c:\users\sebastianh\documents\projects\andersen windows\100 series double hung window\dwg\awd356.dwg 6/19/2025 4:24 PM

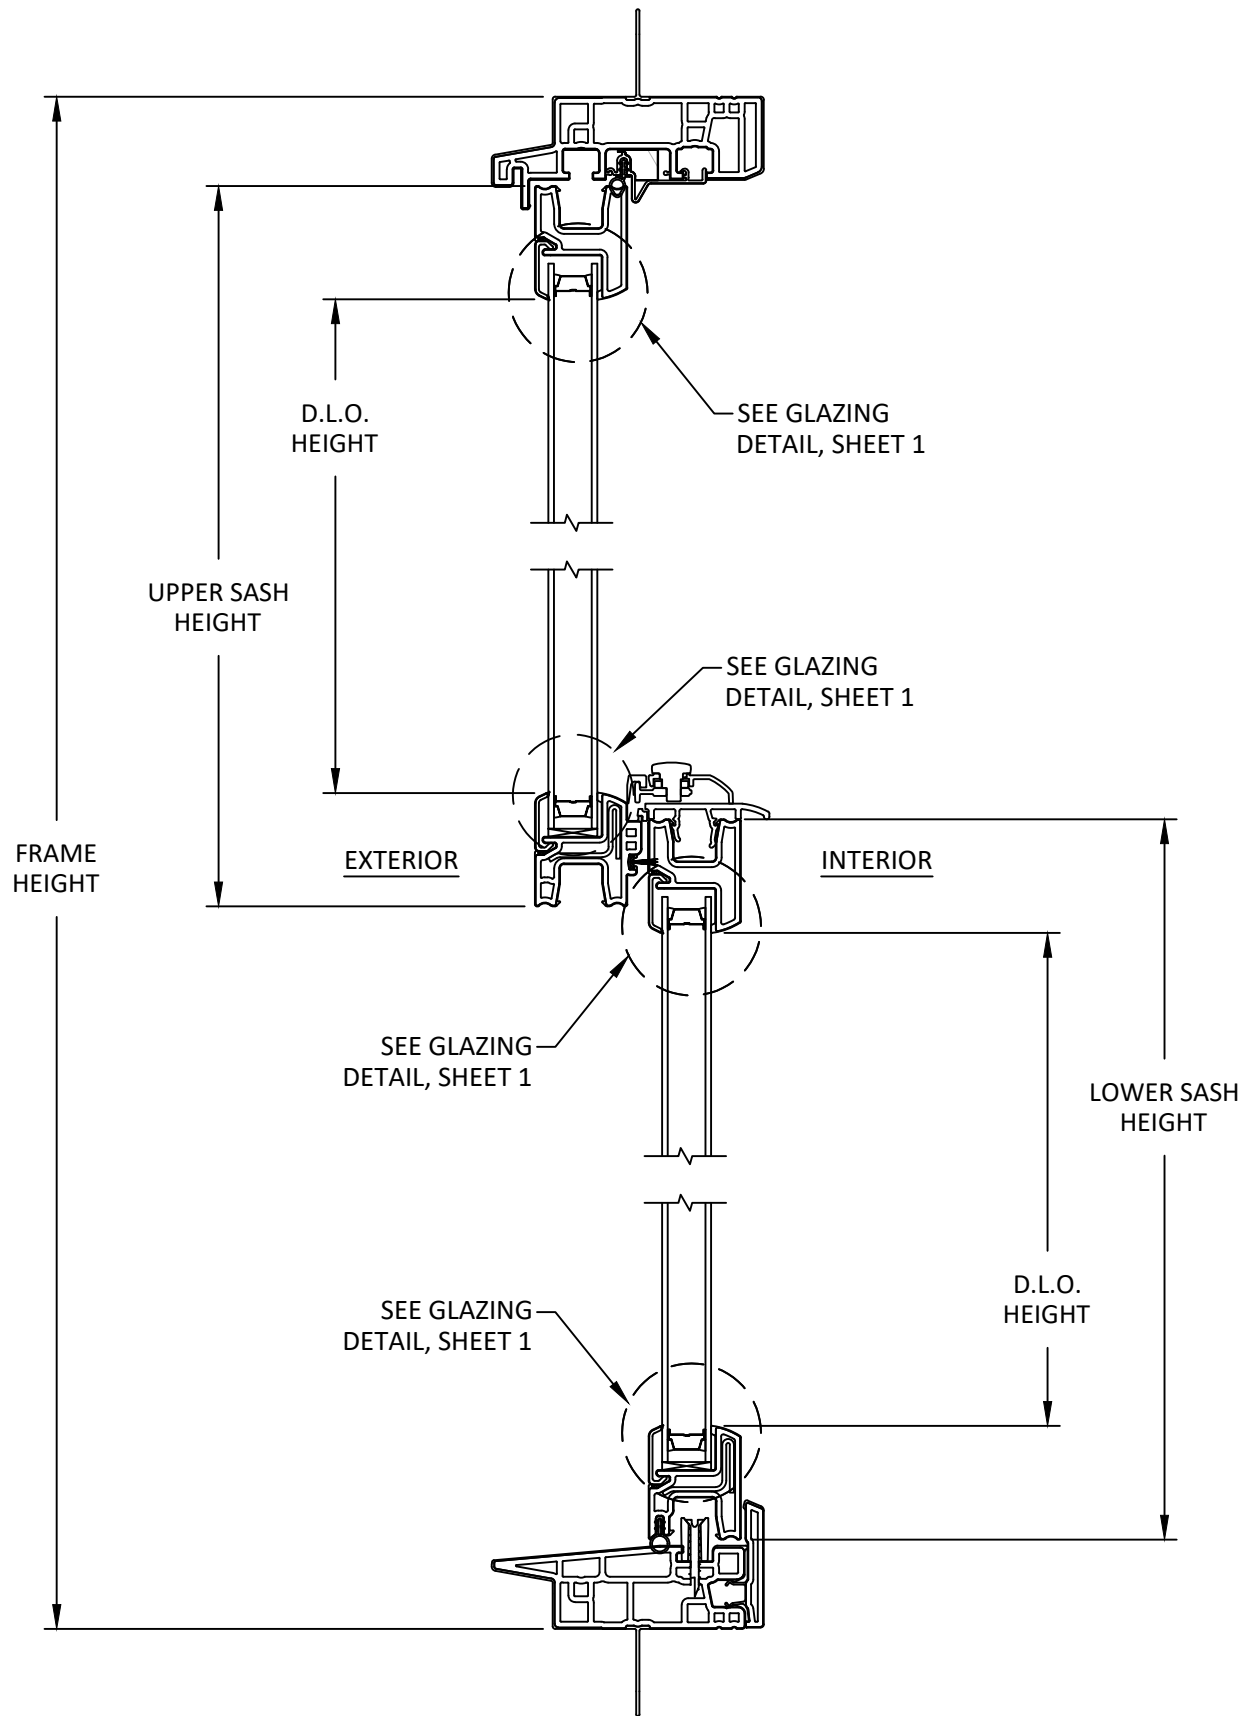

A
5

VERTICAL SECTION
FLANGED

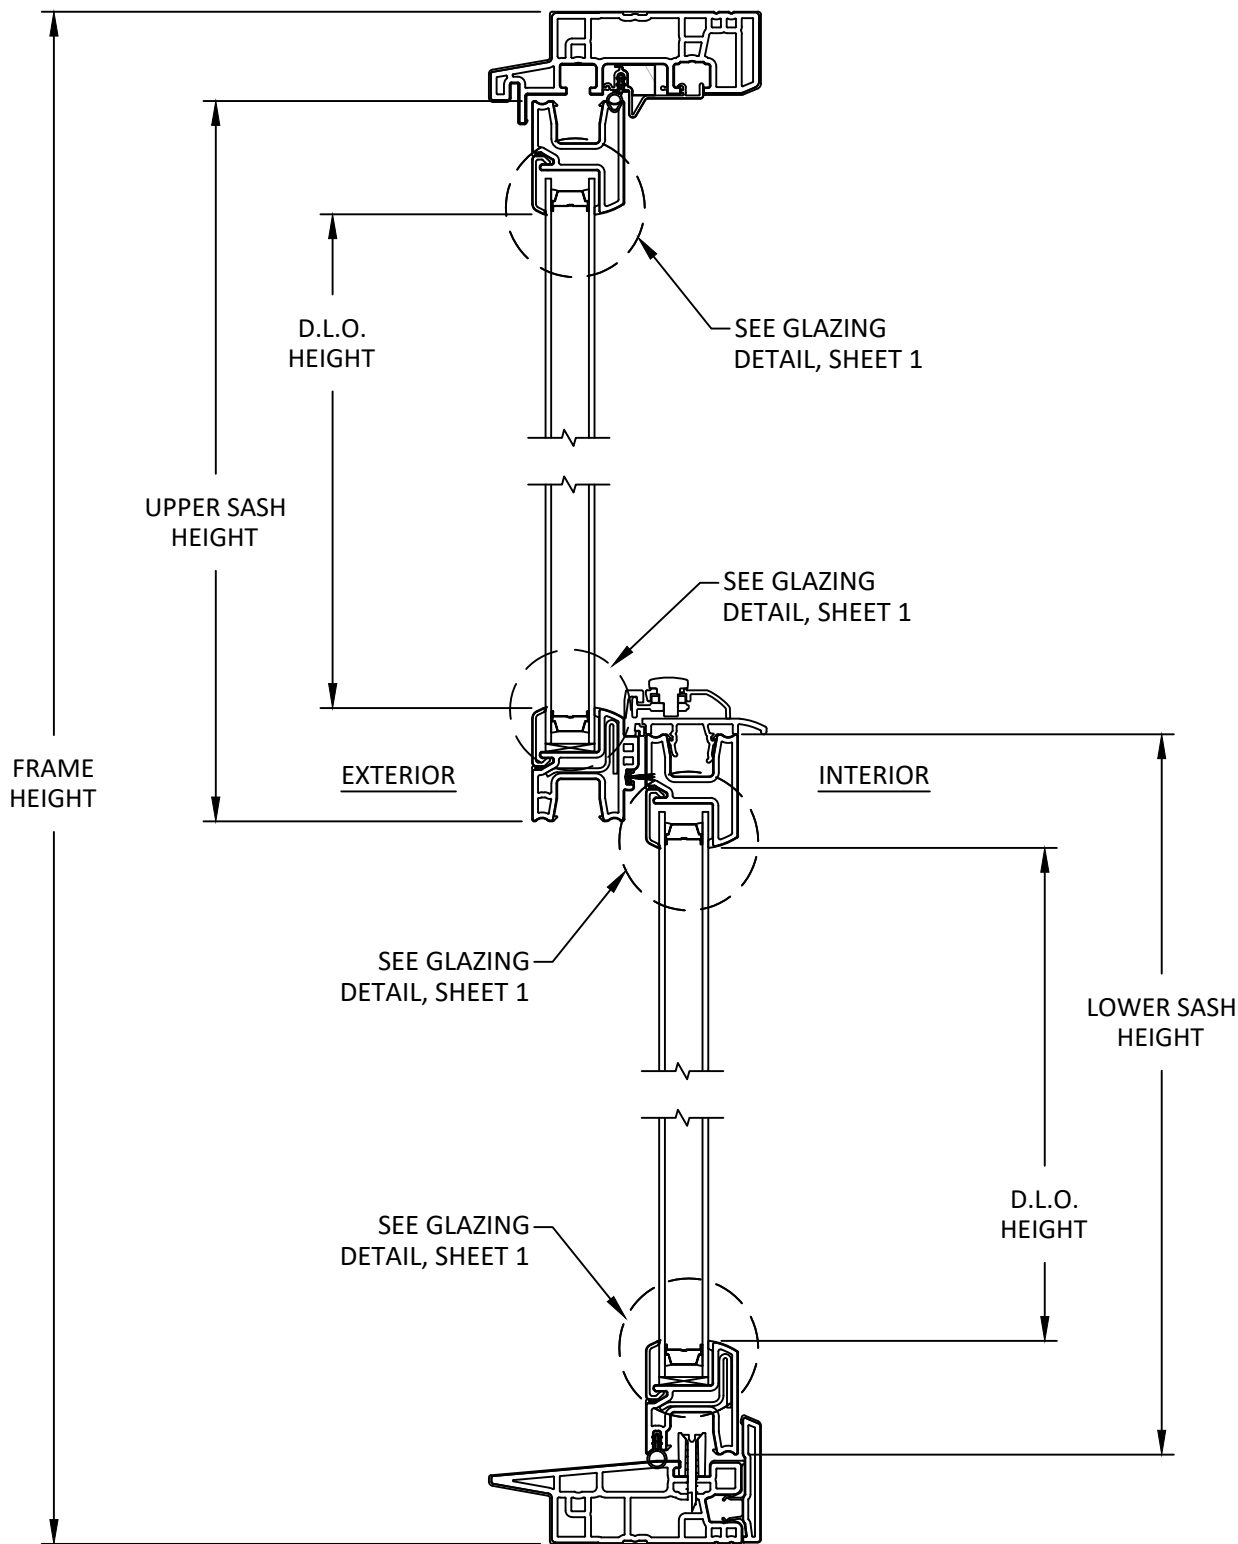

B
5

VERTICAL SECTION
FLANGELESS



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE:
100 SERIES
DOUBLE HUNG WINDOW
(NON-HVHZ)(NON-IMPACT)

VERTICAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132

PH: (954) 399-8478


FAX: (954) 744-4738

WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

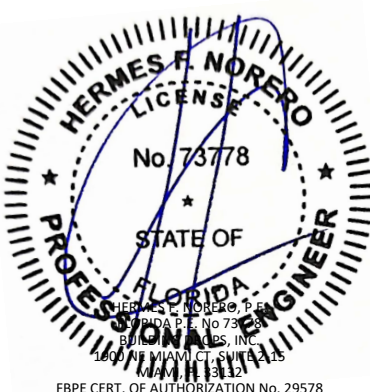


FL #:	FL47424
DATE:	06.18.25
DWG. BY:	DB
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	AWD356
SHEET:	5

c:\users\sebastianhereros\building drops - common\projects\ Andersen windows\fbc-24-1152 - fbc submittal - 100 series double hung window\dwgs\awd356.dwg 6/19/2025 4:24 PM

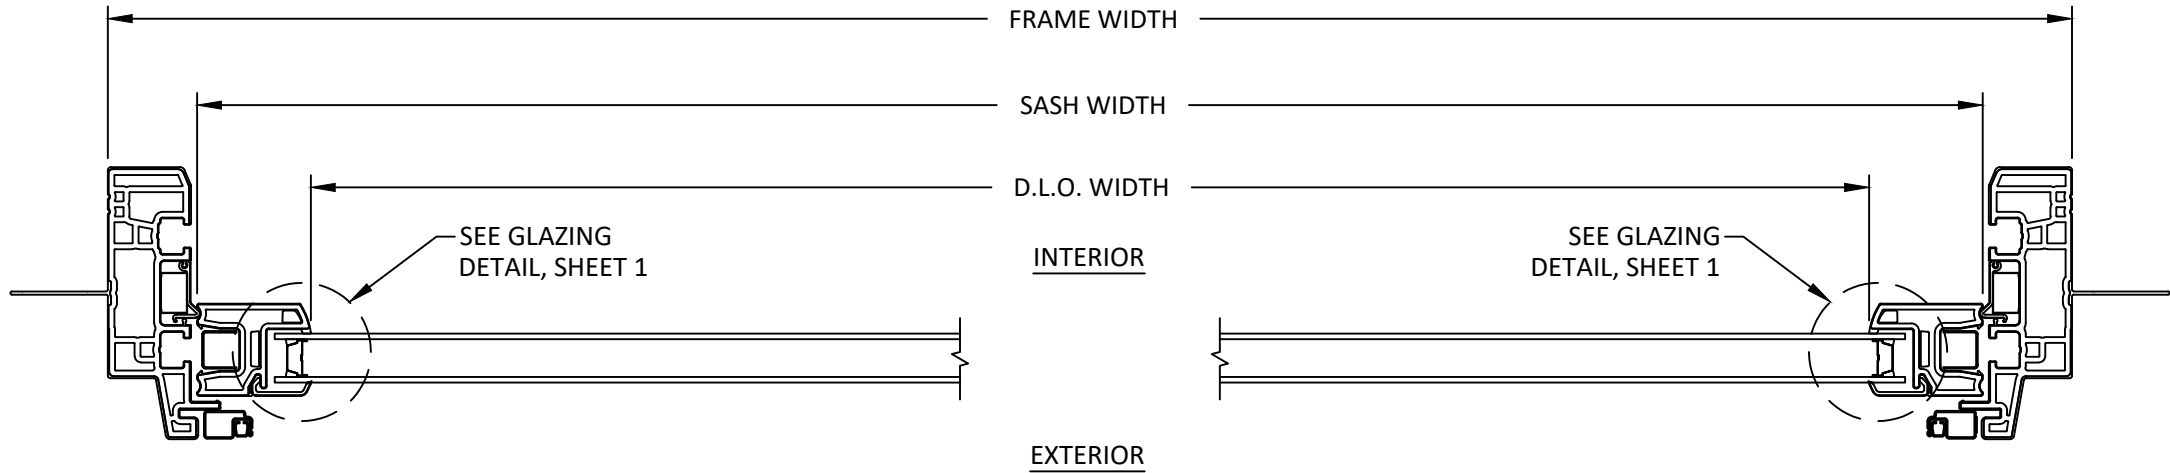

A
6 HORIZONTAL SECTION
UPPER SASH
FLANGED SHOWN, FLANGELESS SIM.

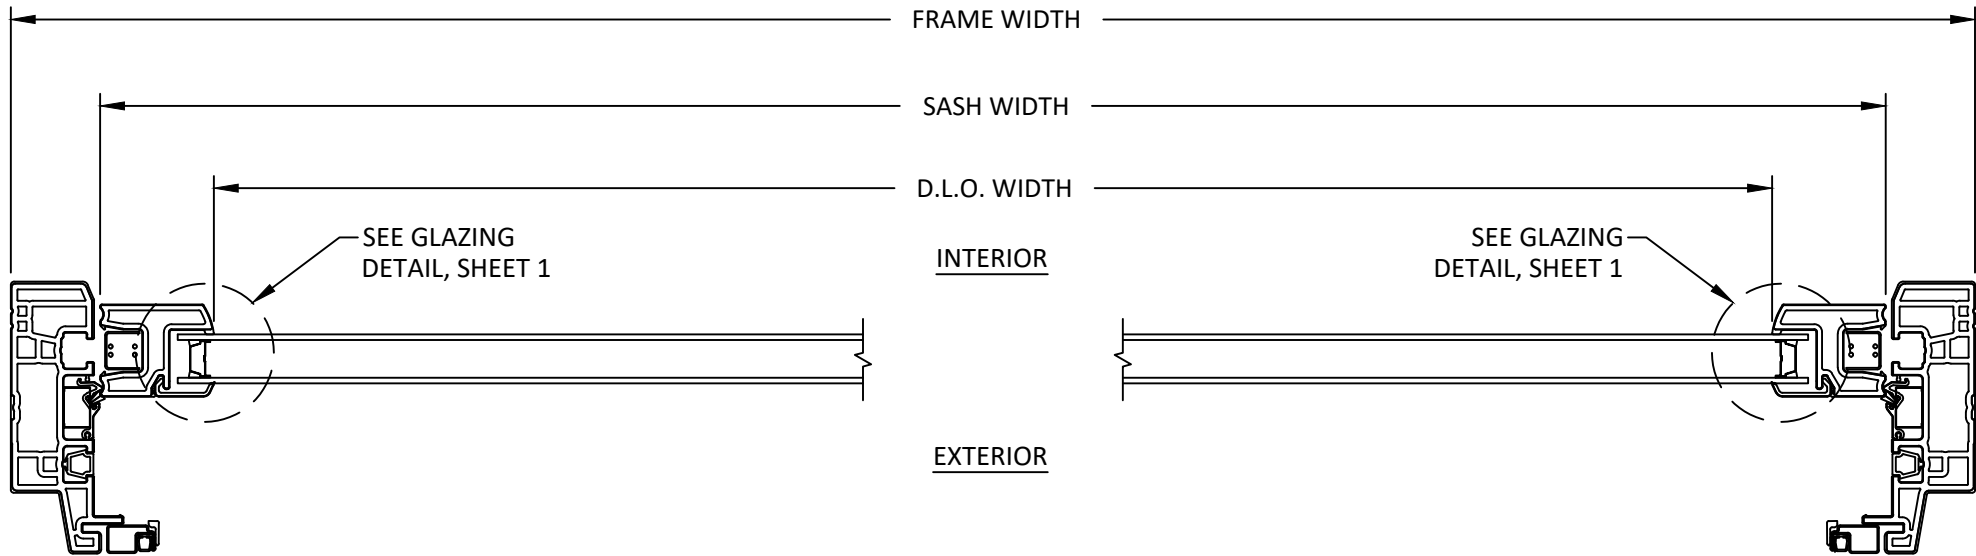

B
6 HORIZONTAL SECTION
LOWER SASH
FLANGELESS SHOWN, FLANGED SIM.



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485

TITLE:
100 SERIES
DOUBLE HUNG WINDOW
(NON-HVHZ)(NON-IMPACT)

HORIZONTAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132


PH: (954) 399-8478
FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

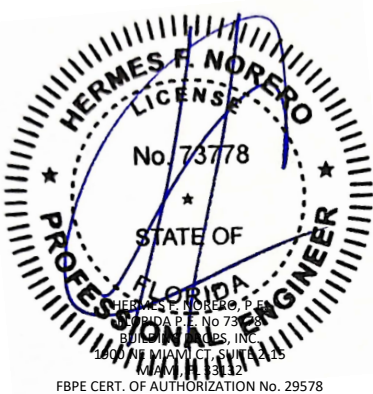

FL #:
FL47424

DATE: **06.18.25**

DWG. BY:
DB

CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **AWD356**

SHEET:

6


OF 8

c:\users\sebastianh\appdata\local\temp\project\anderson windows\100 series double hung window\dwgs\awd356.dwg 6/19/2025 4:24 PM

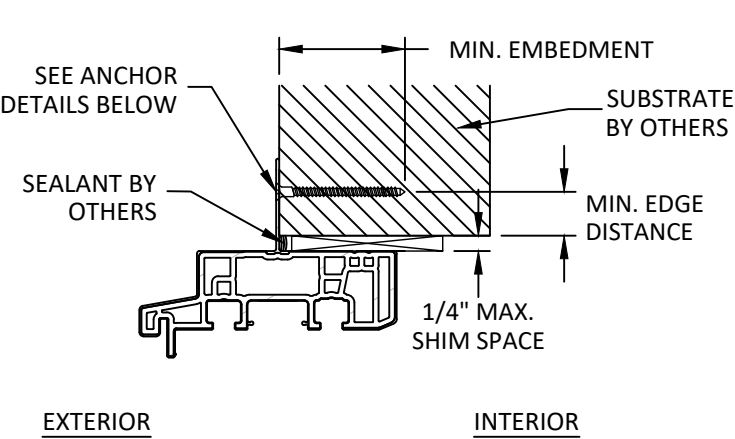


EXTERIOR INTERIOR

A
7
ANCHOR DETAIL
NAIL FIN (HEAD)
SILL AND JAMB SIMILAR

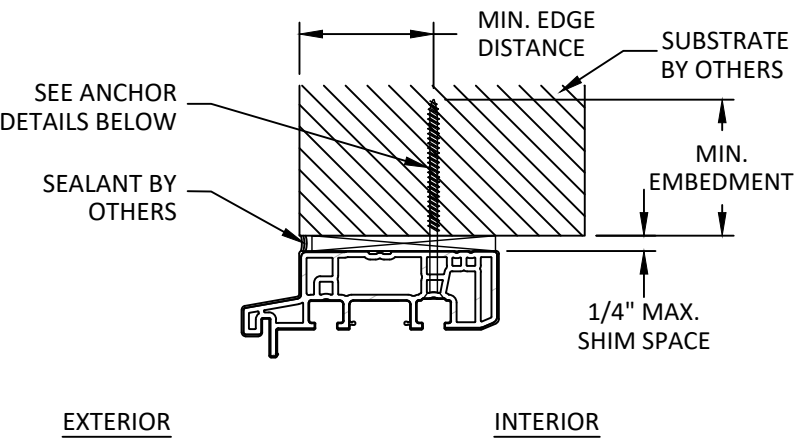

EXTERIOR INTERIOR

B
7
ANCHOR DETAIL
THROUGH FRAME (HEAD)
SILL AND JAMB SIMILAR

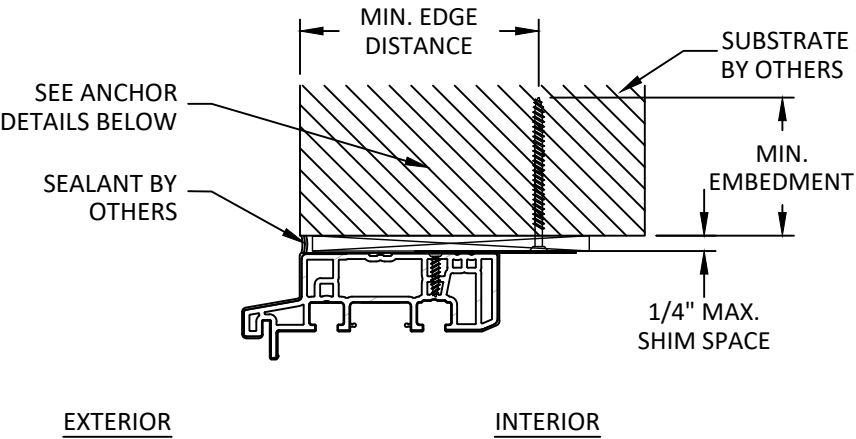

EXTERIOR INTERIOR

C
7
ANCHOR DETAIL
INSTALLATION CLIP (HEAD)
SILL AND JAMB SIMILAR

ANCHOR SCHEDULE					
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE	QUANTITY
NAIL FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"	1
		8D COMMON NAIL	1.50"	0.75"	1
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	#8 SELF-DRILLING OR SELF-TAPPING SCREW	3 THREADS MIN. PENETRATION BEYOND METAL	0.50"	1
	ALUMINUM 6063-T5, MIN. WALL THICKNESS 1/8"				
THROUGH FRAME	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"	1
		8D COMMON NAIL	1.50"	0.75"	1
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	#8 SELF-DRILLING OR SELF-TAPPING SCREW	3 THREADS MIN. PENETRATION BEYOND METAL	0.50"	1
	ALUMINUM 6063-T5, MIN. WALL THICKNESS 1/8"				
INSTALLATION CLIP	CONCRETE: MIN. F'C = 3000PSI, MASONRY: CMU PER ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.25"	2.00"	1
	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"	2
		8D COMMON NAIL	1.50"	0.75"	2
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI	#8 SELF-DRILLING OR SELF-TAPPING SCREW	3 THREADS MIN. PENETRATION BEYOND METAL	0.50"	2
	ALUMINUM 6063-T5, MIN. WALL THICKNESS 1/8"				
	CONCRETE: MIN. F'C = 3000PSI, MASONRY: CMU PER ASTM C90 MIN. 2000 PSI	3/16" ITW TAPCON	1.25"	2.00"	1



ANDERSEN
WINDOWS & DOORS

100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE:
100 SERIES
DOUBLE HUNG WINDOW
(NON-HVHZ)(NON-IMPACT)
INSTALLATION DETAILS
& ANCHOR SCHEDULE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

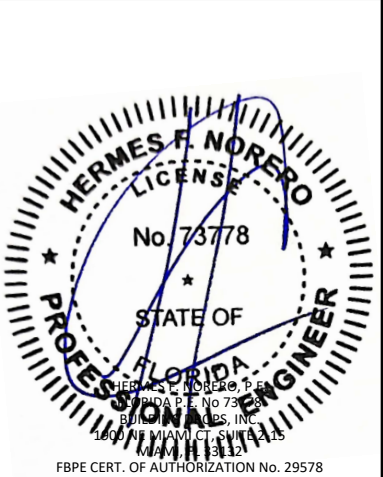

FL #:
FL47424

DATE: **06.18.25**


DWG. BY: DB	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **AWD356**

SHEET:
7
OF 8


c:\users\sebastianh\appdata\local\temp\project\anderson windows\100 series double hung window\dwgs\awd356.dwg 6/19/2025 4:24 PM

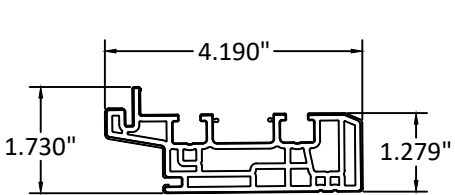


INSERT FRAME
JAMB/HEAD

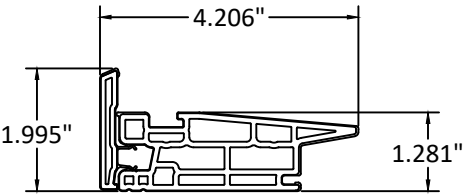


INSERT FRAME
SILL

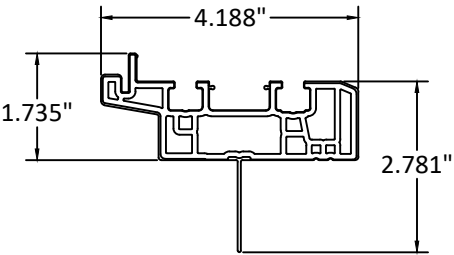


1-3/8" SETBACK FRAME
JAMB/HEAD

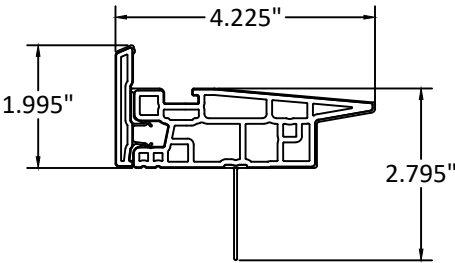


1-3/8" SETBACK FRAME
SILL

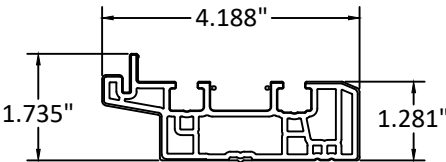

FLANGELESS
JAMB/HEAD

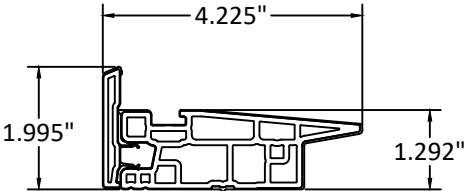

FLANGELESS
SILL

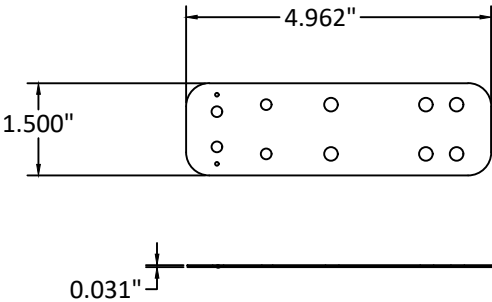

INSTALLATION CLIP



100 FOURTH AVE NORTH
BAYPORT, MN 55003-1096
PH: (651) 264-5150 FX: (651) 264-5485


TITLE:
100 SERIES
DOUBLE HUNG WINDOW
(NON-HVHZ)(NON-IMPACT)
ALTERNATE FRAME
OPTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI CT, SUITE 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

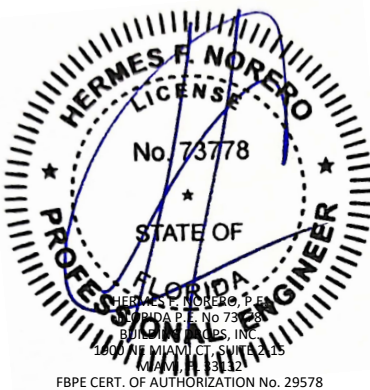

FL #:
FL47424

DATE: **06.18.25**

DWG. BY: DB	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**

DWG. #: **AWD356**

SHEET:

8

OF 8