


CANTERA DOORS AND MORE INC.


FIXED STEEL IMPACT WINDOW (HVHZ)(IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **INCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: STEEL
- GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

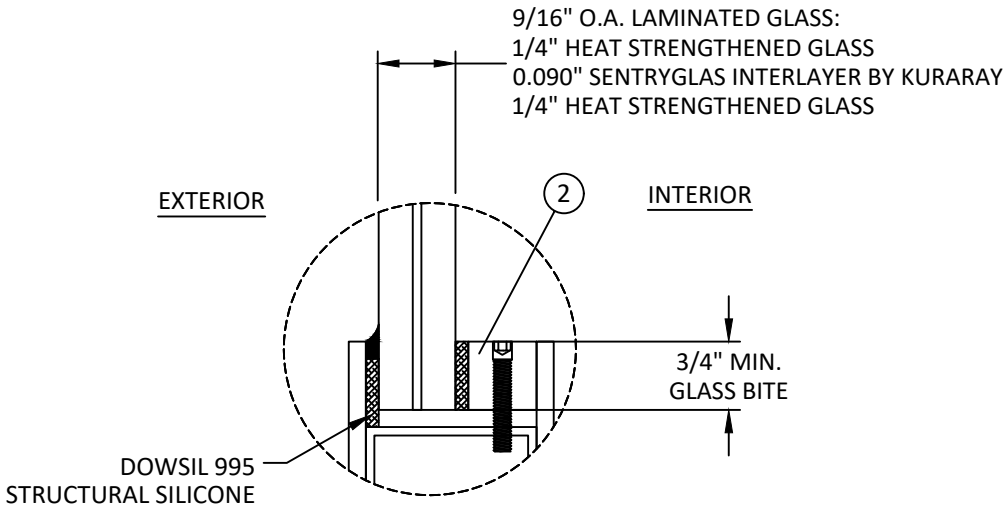

GLAZING DETAIL 1

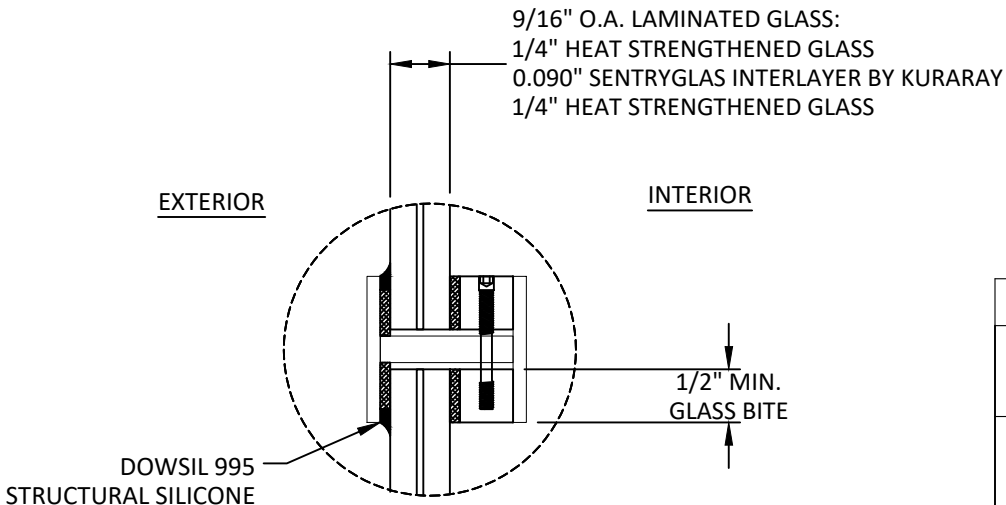

GLAZING DETAIL 2

GLAZING NOTES:

- GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	ELEVATION
3	ELEVATION
4	ELEVATION
5	ANCHOR LAYOUT
6	ANCHOR LAYOUT
7	ANCHOR LAYOUT
8	VERTICAL SECTIONS
9	HORIZONTAL SECTIONS
10	ANCHOR DETAILS AND INSTALLATION NOTES
11	BILL OF MATERIALS & COMPONENTS

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
OOO	207"	120"	+/-65 PSF	LARGE & SMALL MISSILE IMPACT
O	120"	60"	+/-65 PSF	
O	69"	120"	+/-65 PSF	
O	18"	86"	+/-65 PSF	
OO	76"	88"	+/-65 PSF	



22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

GENERAL NOTES &
GLAZING DETAIL

PREPARED BY:

BUILDING DROPS, INC.


1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.15 12:14:30 -0400

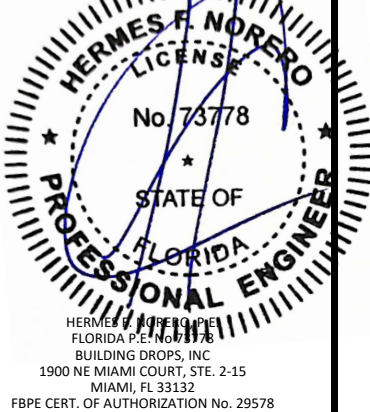

FL #: **FL47427**


DATE: **05.05.25**

DWG. BY: **HJ** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **CND001**

SHEET: **1** REV. **B**

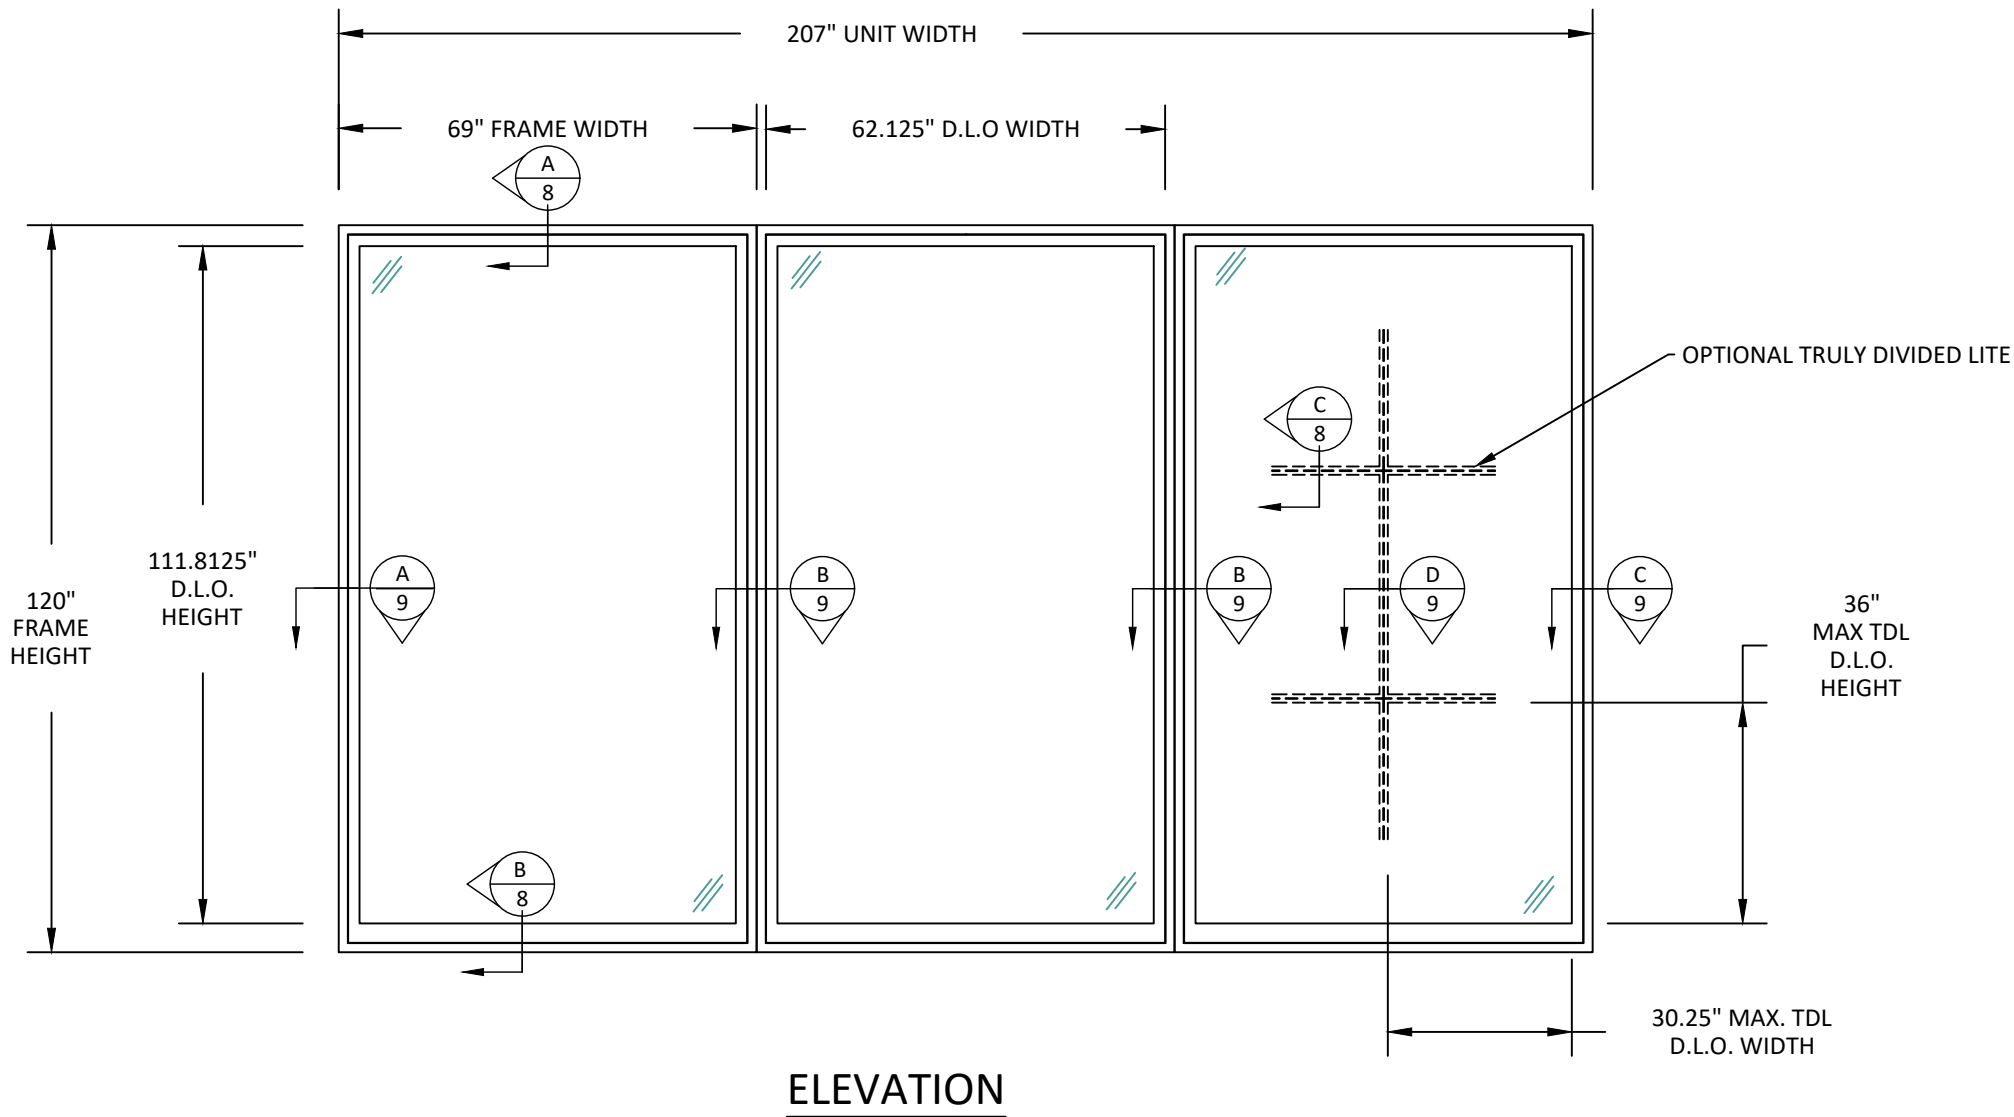

22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

ELEVATION


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

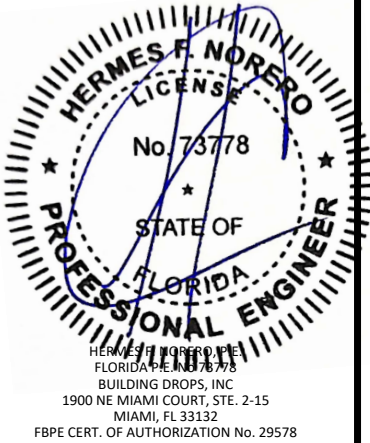

FL #:
FL47427

DATE: **05.05.25**

DWG. BY:
HJ


CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **CND001**


SHEET:
2

REV.
B

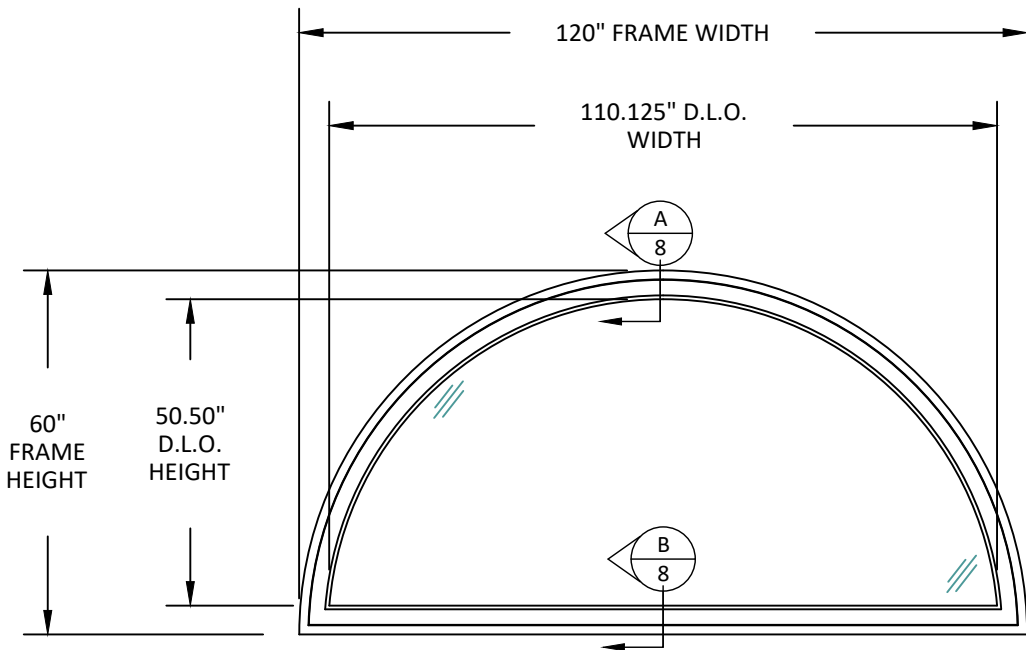

ELEVATION

NOTE:
WINDOW WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FOOT AREA. ANCHOR SPACING SHALL NOT EXCEED THOSE SHOWN FOR LONG OR SHORT LEG OF UNIT, SEE TABLE ABOVE AND SHEET 2.

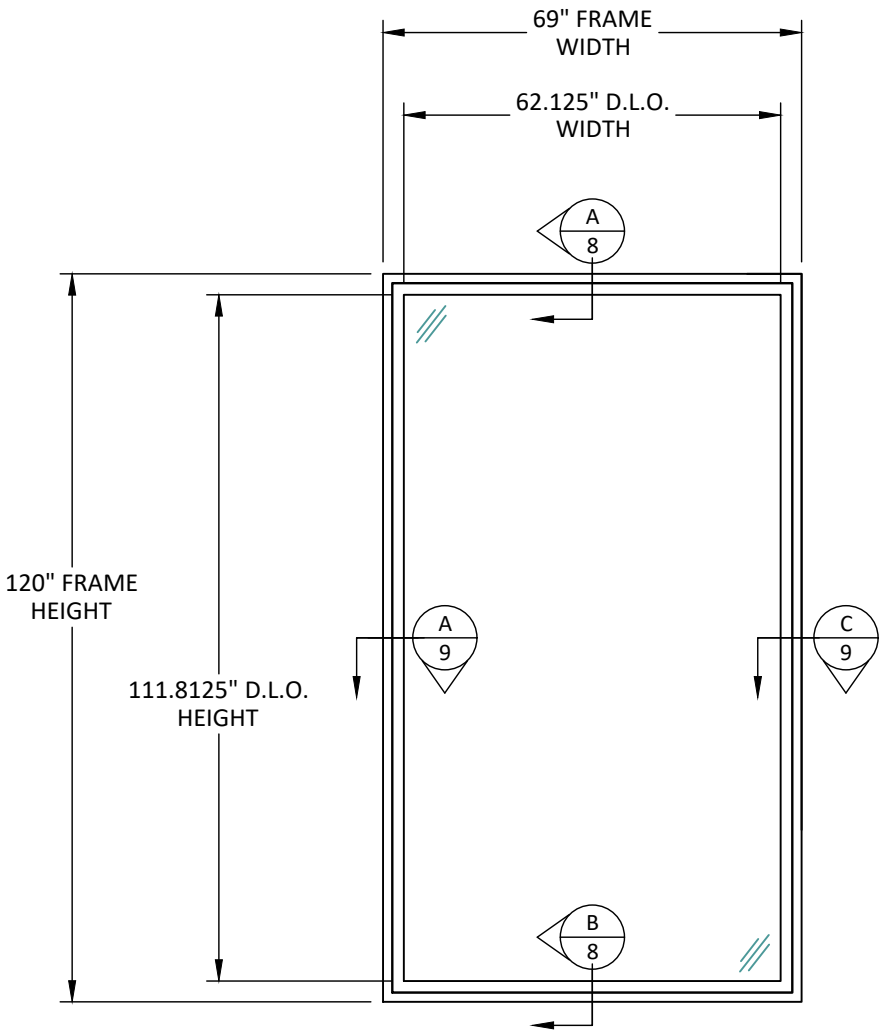

ELEVATION



22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

ELEVATION


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

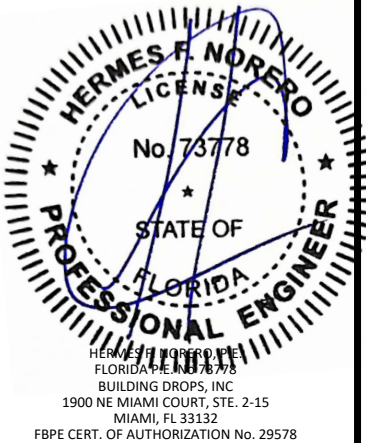

FL #:
FL47427

DATE: **05.05.25**

DWG. BY:
HJ


CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **CND001**

SHEET:
3

REV.
B

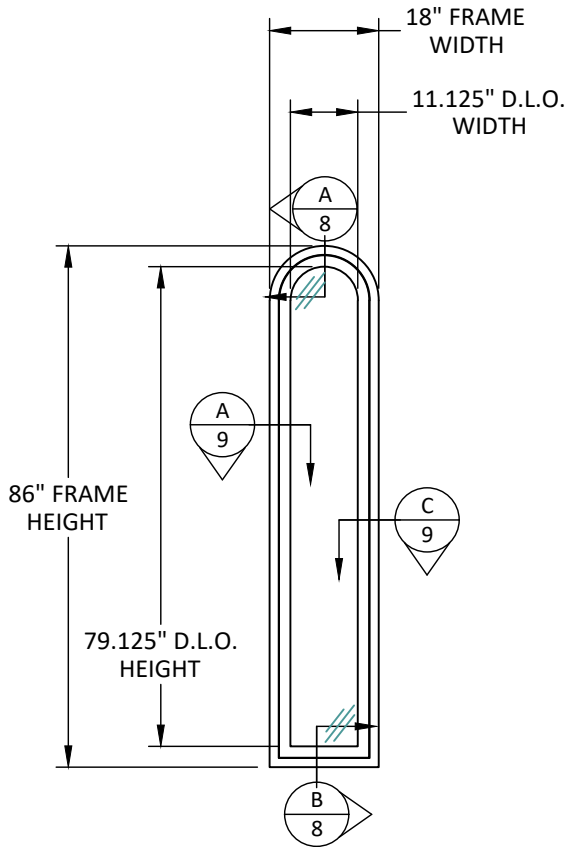

ELEVATION

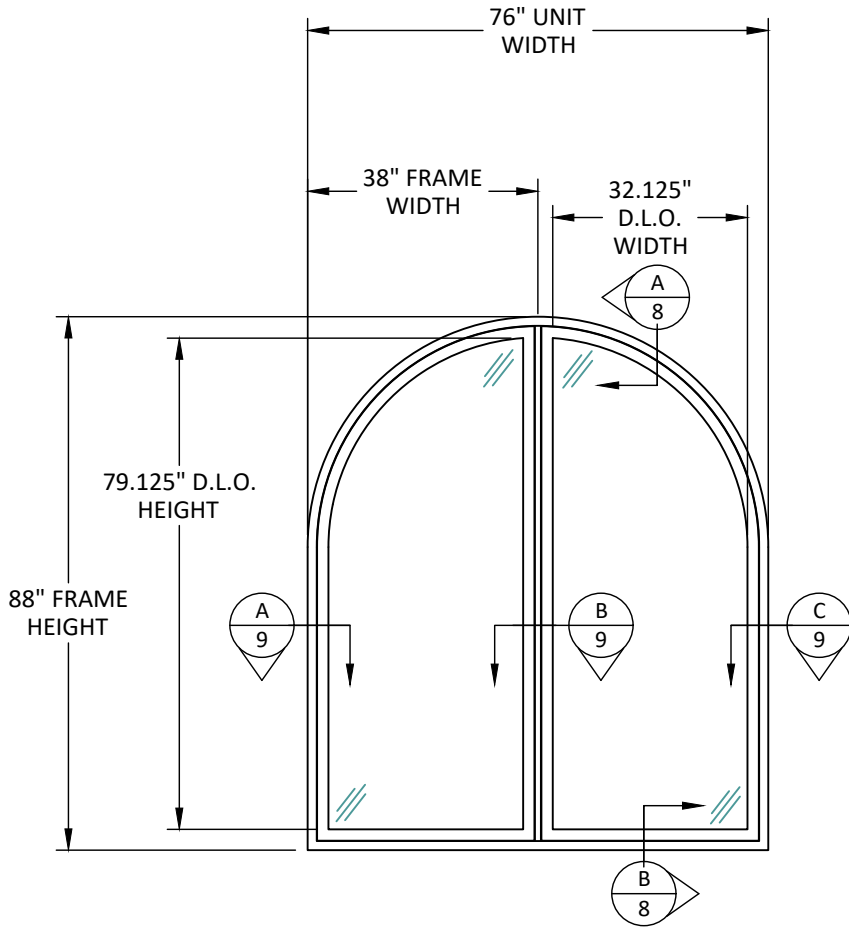

ELEVATION



22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

ELEVATION

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL47427

DATE: **05.05.25**

DWG. BY:
HJ


CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **CND001**

SHEET:
4

REV.
B

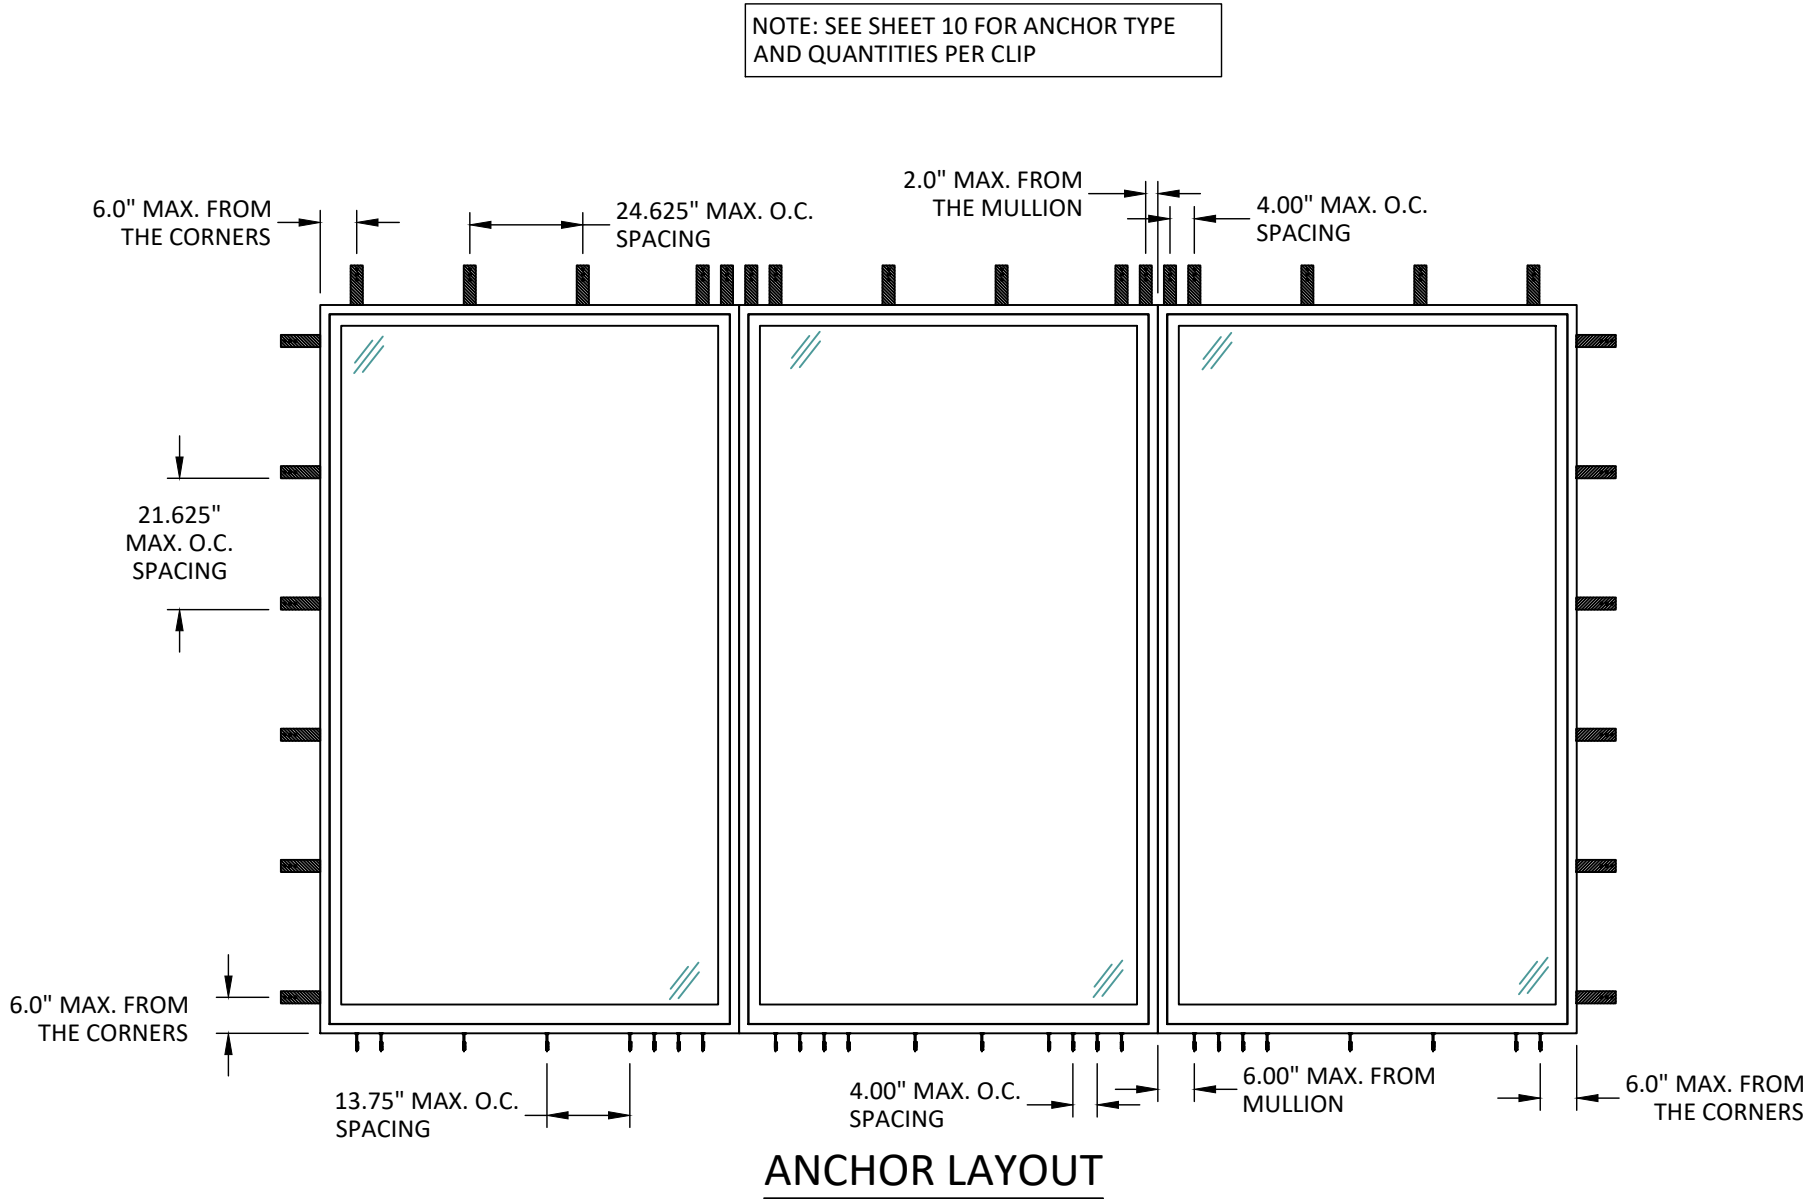

22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: **FIXED STEEL IMPACT WINDOW (HVHZ) (IMPACT)**

ANCHOR LAYOUT

PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: **FL47427**

DATE: **05.05.25**


DWG. BY: HJ	CHK. BY: HFN
-----------------------	------------------------

SCALE: **NTS**


DWG. #: **CND001**

SHEET: 5	REV. B
--------------------	------------------

NOTE: SEE SHEET 10 FOR ANCHOR TYPE
AND QUANTITIES PER CLIP

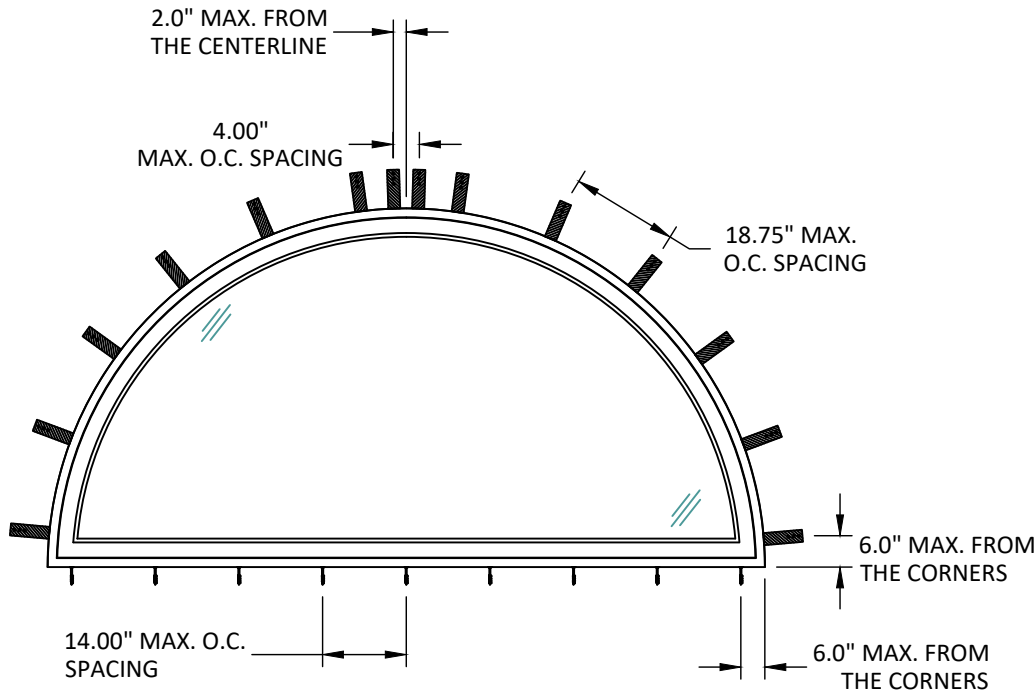

ANCHOR LAYOUT

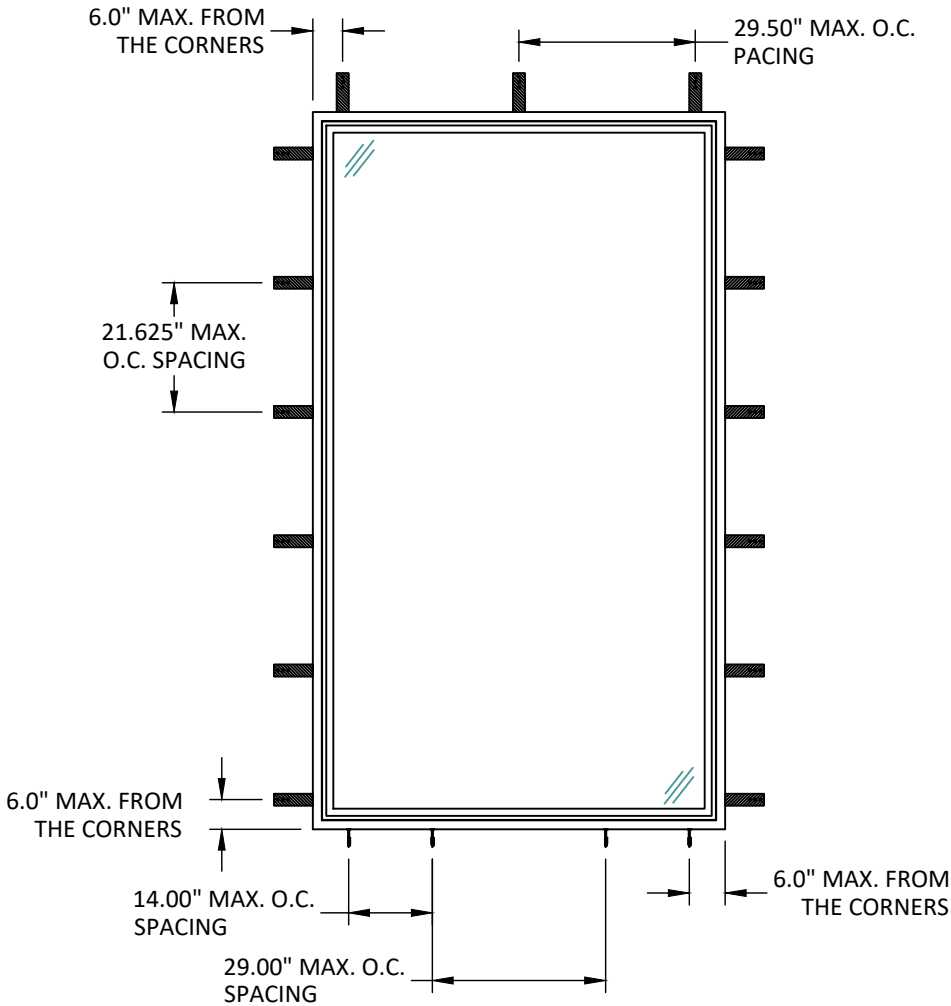

ANCHOR LAYOUT



22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

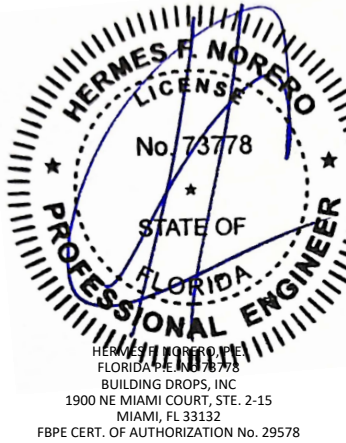

FL #:
FL47427

DATE: **05.05.25**

DWG. BY:
HJ

CHK. BY:
HFN


SCALE: **NTS**

DWG. #: **CND001**


SHEET:
6

REV.
B

NOTE: SEE SHEET 10 FOR ANCHOR TYPE
AND QUANTITIES PER CLIP

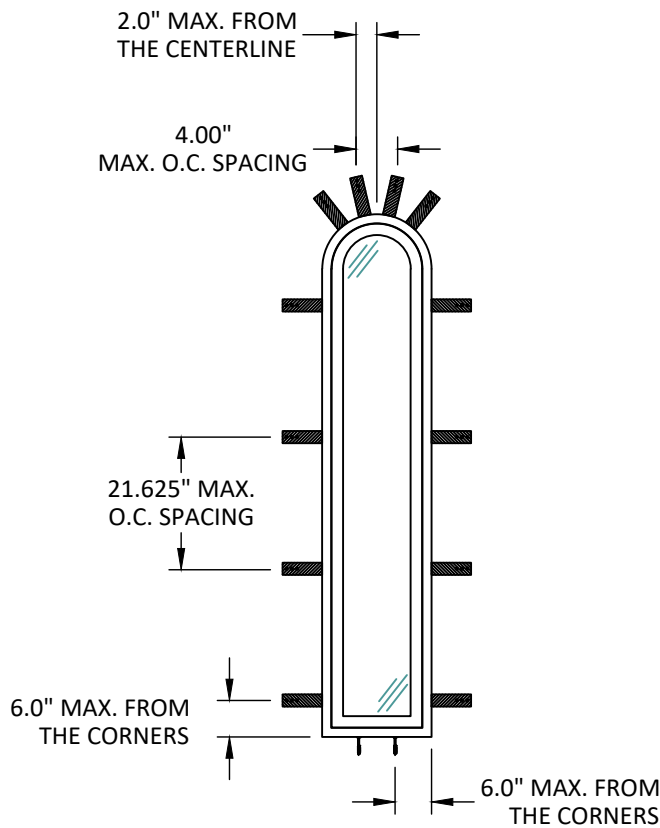

ELEVATION

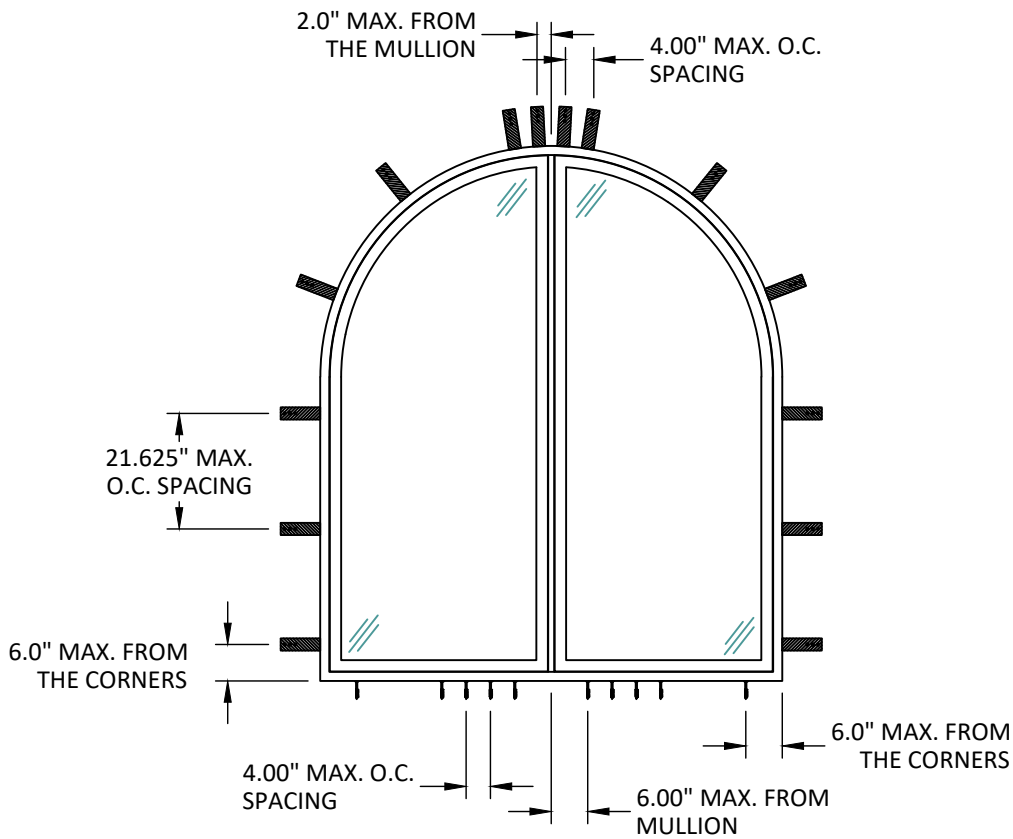

ELEVATION



22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

ANCHOR LAYOUT


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

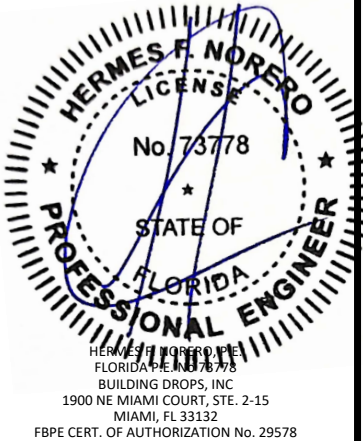

FL #:
FL47427

DATE: **05.05.25**

DWG. BY:
HJ


CHK. BY:
HFN

SCALE: **NTS**


DWG. #: **CND001**

SHEET:
7


REV.
B

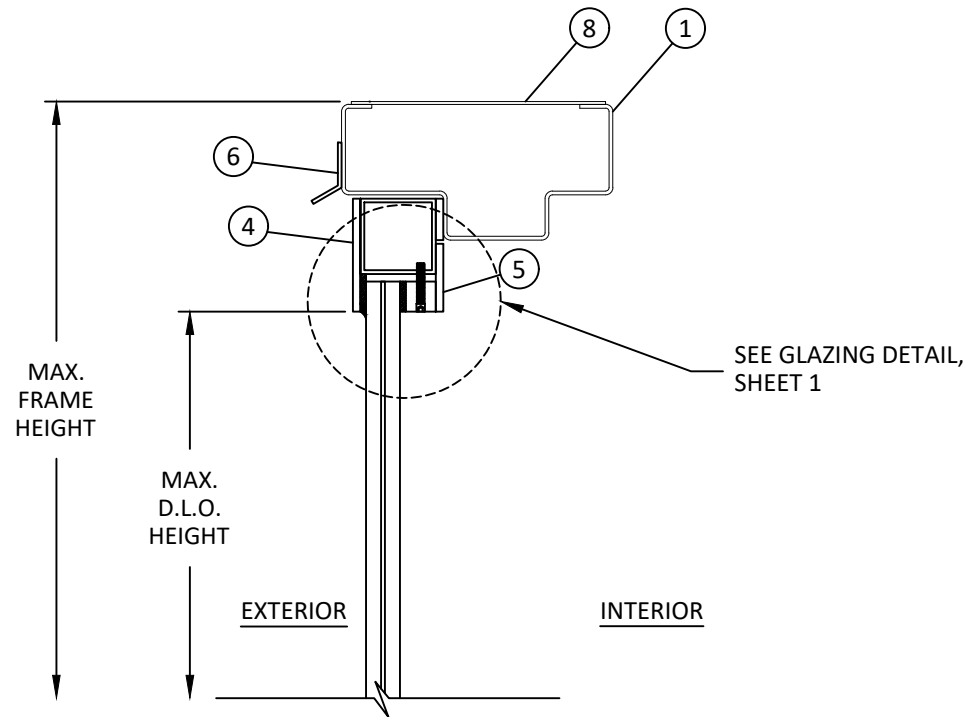

A
8
VERTICAL SECTION
HEAD

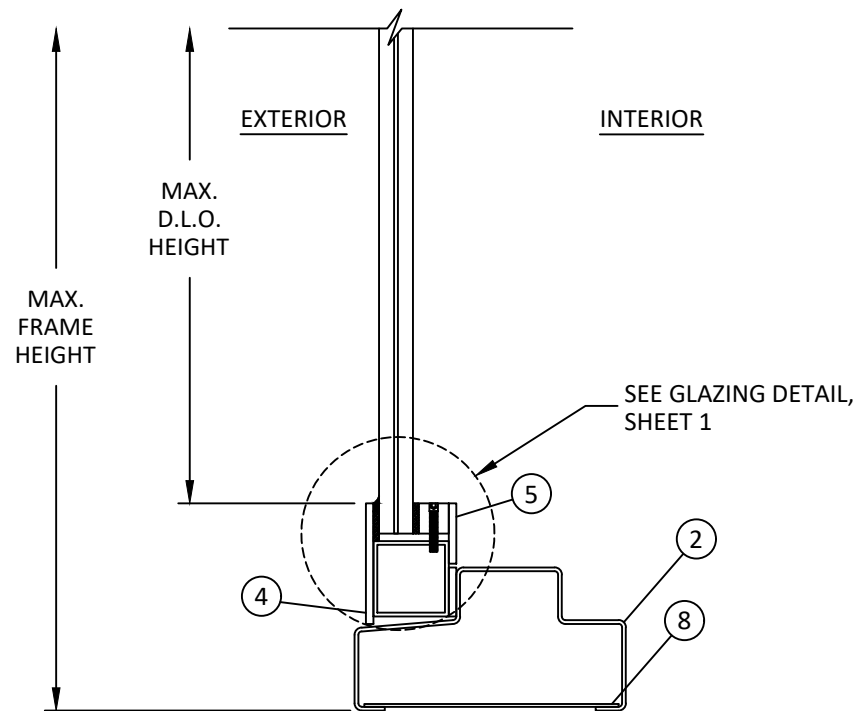

B
8
VERTICAL SECTION
SILL

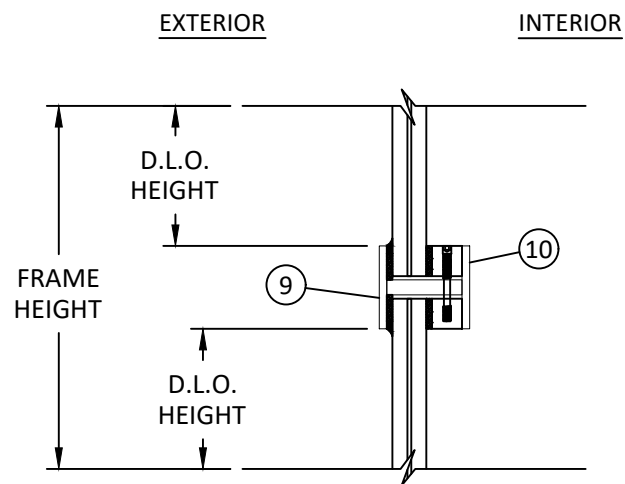

C
8
VERTICAL SECTION
TYP. TDL



22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

VERTICAL SECTIONS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

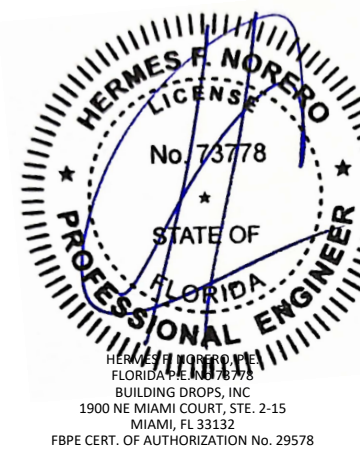

FL #:	FL47427
DATE:	05.05.25
DWG. BY:	CHK. BY:
HJ	HFN
SCALE:	NTS
DWG. #:	CND001
SHEET:	REV.
8	B
OF 11	

9/17/2026 9:38 AM


c:\users\harley\mybuilding drops - common\projects\2026 code change projects\cantera doors\cc-26-0634 - 2026 code change\dwg\cnd001-b.dwg

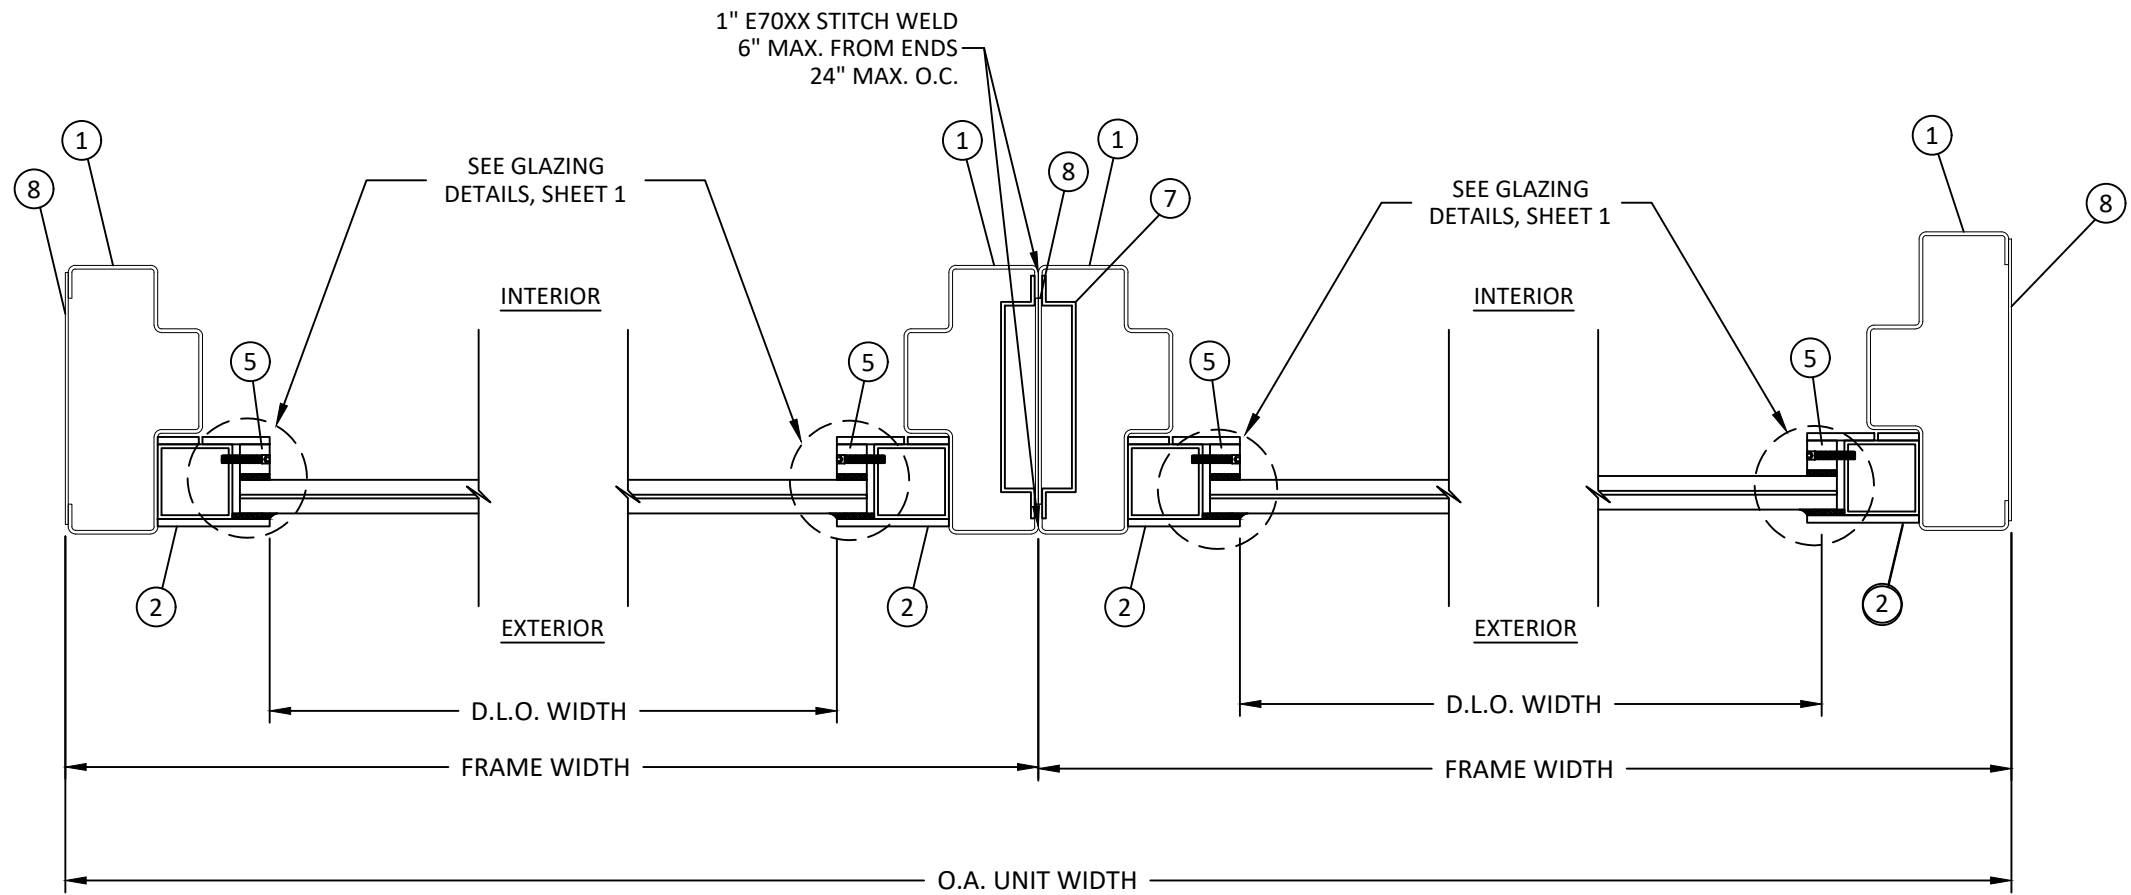

A
9 HORIZONTAL SECTION
JAMB

B
9 HORIZONTAL SECTION
MULLION

C
9 HORIZONTAL SECTION
JAMB

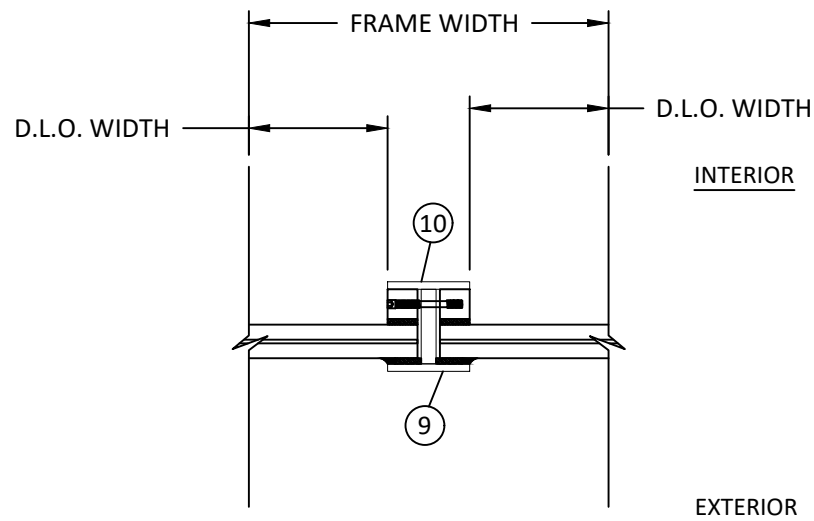

D
9 HORIZONTAL SECTION
TYP. TDL



22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

HORIZONTAL SECTIONS


PREPARED BY:
BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

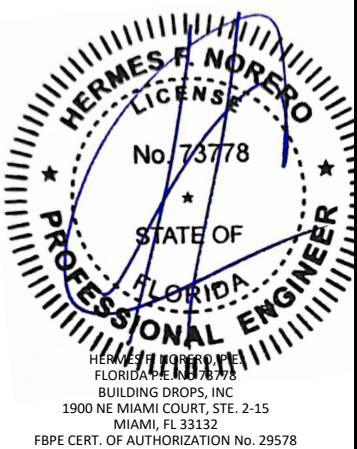


FL #:	FL47427
DATE:	05.05.25
DWG. BY:	CHK. BY:
HJ	HFN
SCALE:	NTS
DWG. #:	CND001
SHEET:	REV.
9	B
OF 11	

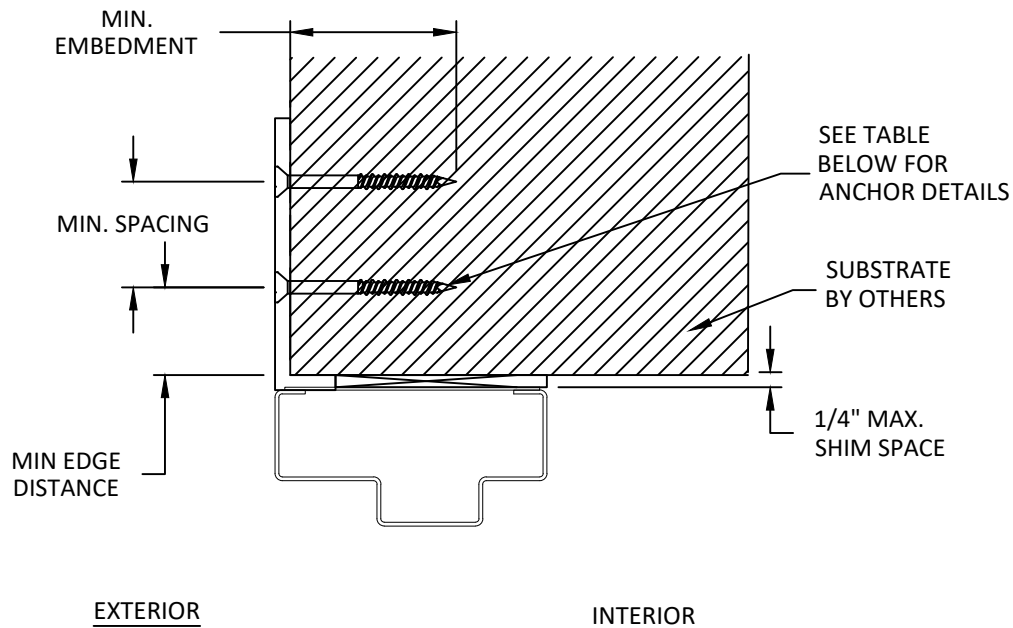

A
10 VERTICAL SECTION
HEAD - STRAP

NOTE: JAMB SIMILAR

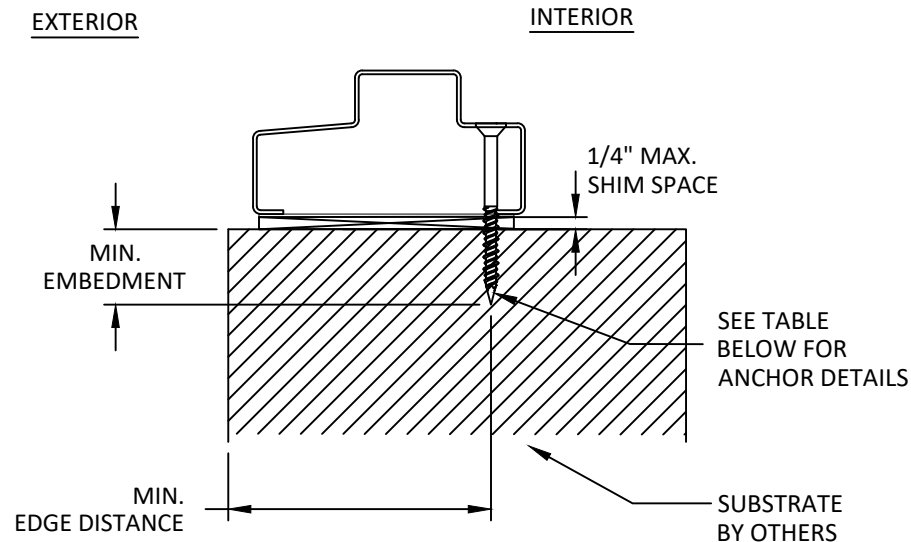

B
10 VERTICAL SECTION
SILL - THROUGH FRAME

INSTALLATION NOTES:

- TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN FOR THE STRAP AND ONE (1) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION FOR THROUGH FRAME, UNLESS OTHERWISE STATED ON SHEETS 4 & 5.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE					
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE	MIN. SPACING
STRAP	WOOD: MIN. SG = 0.55	3/8" LAG SCREW	1.50"	1.00"	1.00"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	3/8" SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"	0.50"
	CONCRETE: f'c=3000PSI	1/4" ITW TAPCON	1.25"	2.00"	2.00"
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	1/4" DEWALT ULTRA CON	1.25"	2.00"	2.00"
THROUGH FRAME	WOOD: MIN. SG = 0.55	#14 WOOD SCREW	1.50"	0.75"	-
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#14 SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"	-
	CONCRETE: f'c=3000PSI	1/4" ITW TAPCON	1.00"	3.00"	-
	MASONRY: CMU per ASTM C90 MIN. 2000 PSI	1/4" ITW TAPCON	1.00"	3.00"	-



22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

ANCHOR DETAILS
AND INSTALLATION NOTES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-8478


FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

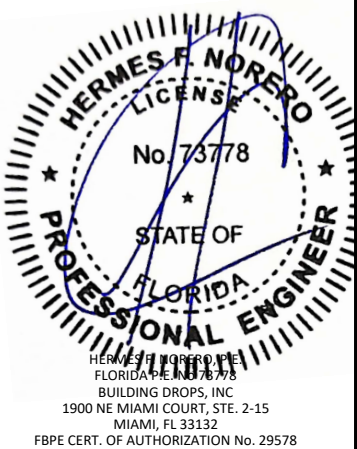


FL #:	FL47427
DATE:	05.05.25
DWG. BY:	CHK. BY:
HJ	HFN
SCALE:	NTS
DWG. #:	CND001
SHEET:	REV.
10	B
OF 11	

9/17/2026 9:38 AM


c:\users\harley\mybuilding drops - common\projects\2026 code change projects\cantera doors\cc-26-0634 - 2026 code change\dwgs\cnd001-b.dwg

BILL OF MATERIALS			
ITEM	PART NO.	DESCRIPTION	MATERIAL
1	-	FRAME HEAD/JAMB	STEEL
2	-	FRAME SILL	STEEL
3	-	STRAP	STEEL
4	-	SASH	STEEL
5	-	GLAZING BEAD	STEEL
6	-	RAIN GUARD	STEEL
7	-	MULLION REINFORCEMENT	STEEL
8	-	SHEAR PLATE	STEEL
9	-	TDL	STEEL
10	-	TDL GLAZING BEAD	STEEL


1 FRAME HEAD/JAMB
STEEL

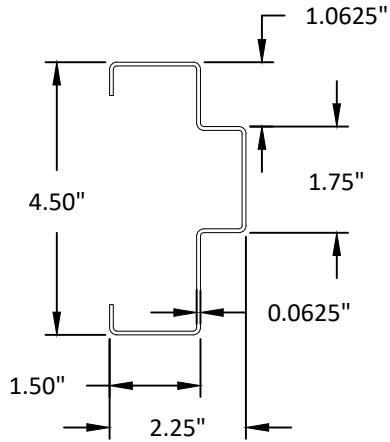


2 FRAME SILL
STEEL

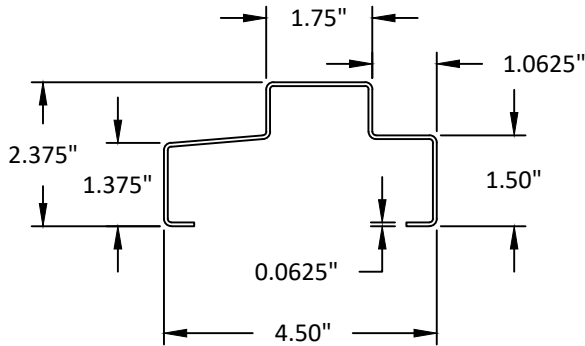


3 STRAP
STEEL

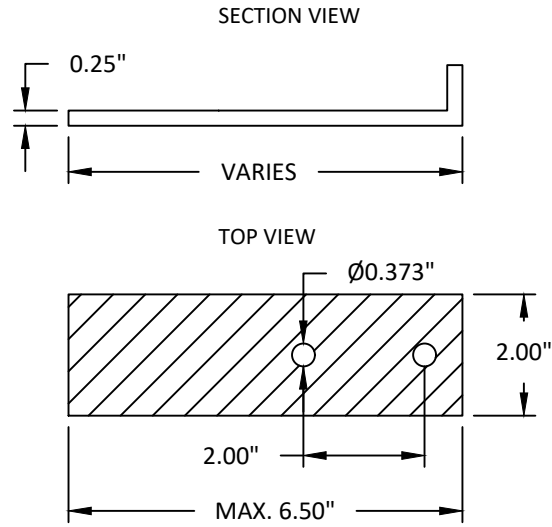


4 SASH
STEEL

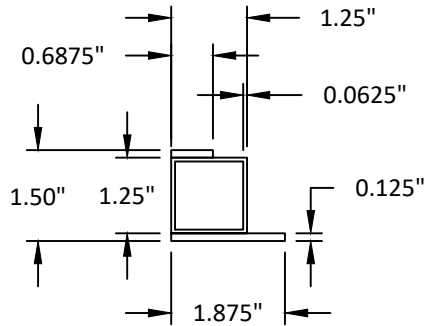


5 GLAZING BEAD
STEEL

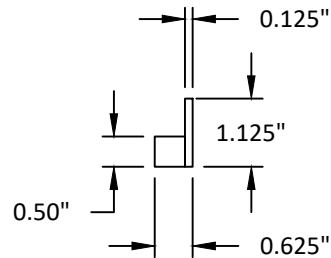


6 RAIN GUARD
STEEL




7 MULLION REINFORCEMENTS
STEEL

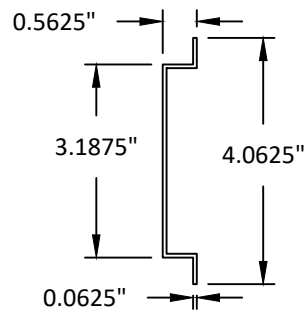


8 SHEAR PLATE
STEEL

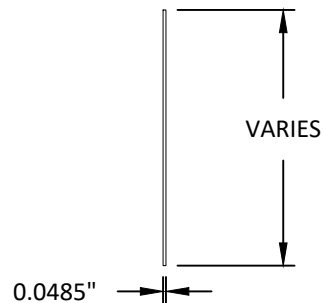

9 TDL
STEEL

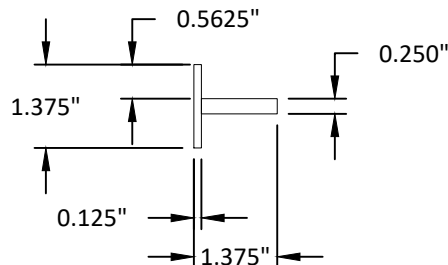

10 TDL GLAZING BEAD
STEEL

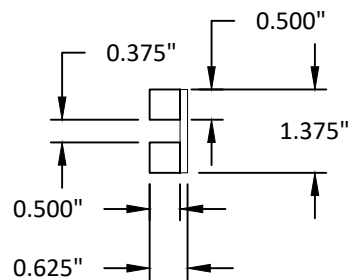

22108 HWY-71 WEST SUITE 4-404
SPICEWOOD, TX 78669
Ph: +1(512)263-8881

TITLE: FIXED STEEL IMPACT WINDOW
(HVHZ) (IMPACT)

BILL OF MATERIALS & COMPONENTS


PREPARED BY:

BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
TDL UPDATE	DI	4/26
2026 CODE CHANGE	HJ	08/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

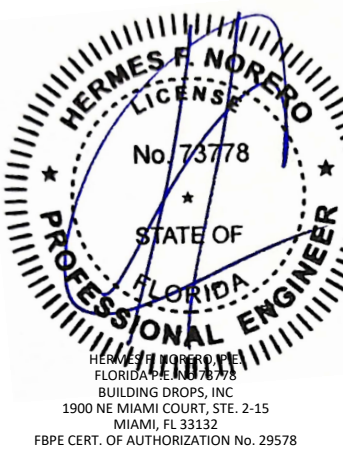

FL #:	FL47427
DATE:	05.05.25
DWG. BY:	CHK. BY:
HJ	HFN
SCALE:	NTS
DWG. #:	CND001
SHEET:	REV.
11	B
OF 11	