


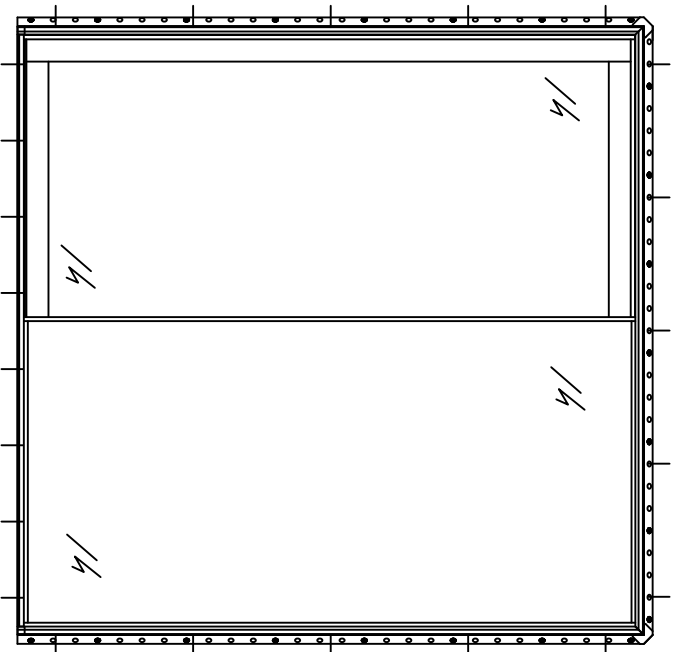

MAX. FRAME SIZE (IN.)	IMPACT
95.864" x 98.625"	NO

EXTERIOR ELEVATION

FRAME ANCHOR REQUIREMENTS TABLE			Installation Method	
FRAME/CLIP TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.	Installation Clips	Screws thru the Frame
#8x3/4" PFH Zinc treated screws into clip and wood substrate at an angle	—	See pg. 2	N/A	Sides = #10x2.5" T25 Deck screws spaced 4-1/4" from corners and on center Head = #9x3" PFH screws spaced 2-3/4" from corners and on center
#8 PFH Zinc treated screws into clip and wood substrate at an angle	—	See pg. 2		& Sill = #8x2" PFH WS SS screws
	—	—		



GENERAL NOTES

1. These units have been tested/analyzed, Hallmark certified, and FBC approved.
2. Bucking, openings, and bucking fasteners must be properly designed and installed to transfer wind loads to the structure. The unit was tested with 1/2" rough opening gap.
3. These units were tested with ponderosa pine bucks. Florida building code requires preservative treated southern pine bucks.
4. All hardware and fasteners shall be in accordance with these drawings and may not vary unless specifically mentioned on the drawings.
5. These units have been tested in accordance with and meet the requirements of the Florida Building Code.
6. Impact shutters are required only with non-impact units.
7. All anchors shall be installed as specified on these drawings. Specified embedment base material shall be beyond wall finish or stucco.
8. Testing of one wood species covers all other species with an equal or higher modulus of elasticity and modulus of rupture.
9. Testing of primed covers testing of clad as long as cladding is not structural (extruded), or wraps around the gasket.
10. Testing of windows and doors with a given width and thickness of solid sills and rails, covers products with wider and thicker solid sills and rails provided that construction details are consistent.
11. Any fixed geometric shape that fits within the tested/approved size for a particular product type is qualified by the rectangular shape(s) provided that the frame, sash, panels, components, and construction remain the same.
12. All fixed shaped units must fit inscribed into the allowable rectangular units and be governed by allowable design pressure or the respective rectangular unit.
13. Shutters need to be located a maximum of 4" from each corner and a maximum of 4" from each anchor location.
14. Plywood was used during testing to simulate the finished exterior of the structure. Actual finished exteriors will vary.

 ■ WINDOWS & DOORS ■		1323 South 11th Ave. Wausau, WI 54401 715-842-5666
Vistaluxe Stretta Sliding Door		
FL# 47463	R&D No24102	
Revision	Drawn By: KML	
A	Date: 5/18/2025	
B	Sheet: 1 of 2	
C	Drawing No.: 24102A	

Installation Clip Installation Side Jambs Only

Screw Installation

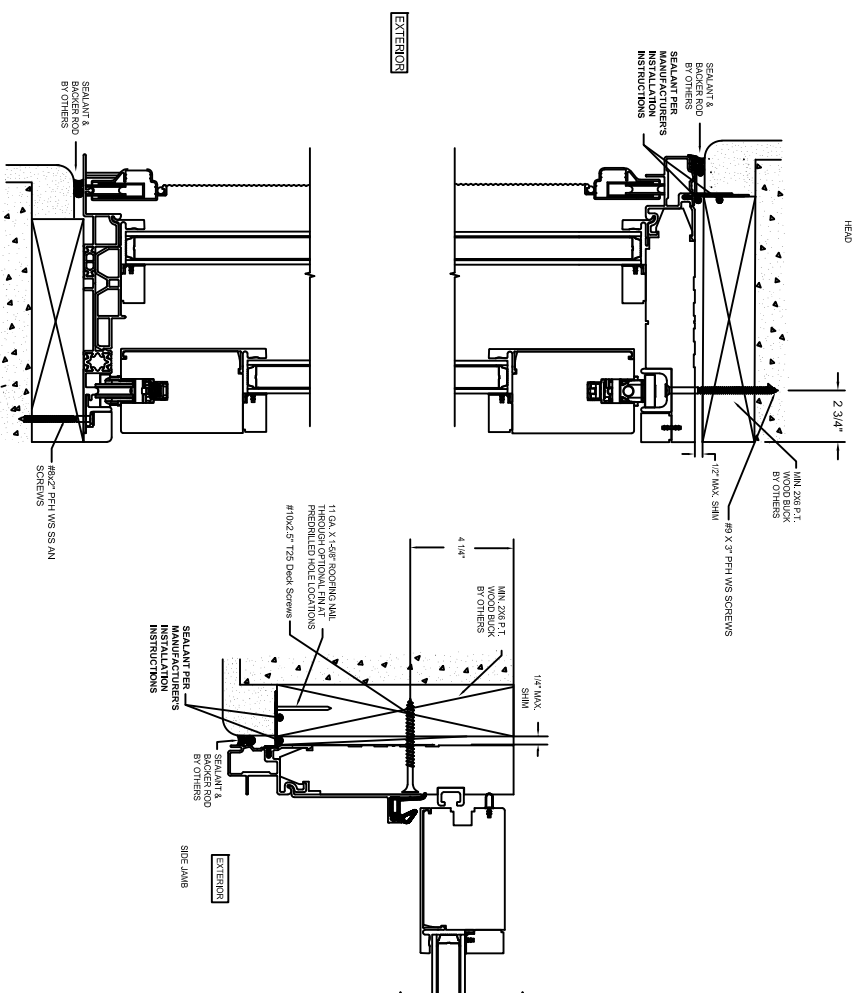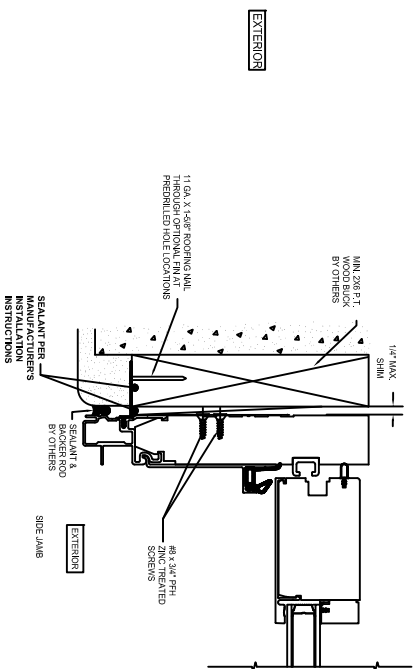

GENERAL NOTES

1. These units have been tested, analyzed, Hallmark certified, and FBC approved.
2. Buckling, openings, and buckling fasteners must be properly designed and installed to transfer wind loads to the structure. The unit was tested with 1/2" rough opening gap.
3. These units were tested with ponderosa pine bucks. Florida building code requires preservative treated southern pine bucks.
4. All hardware and fasteners shall be in accordance with these drawings and may not vary unless specifically mentioned on the drawings.
5. These units have been tested in accordance with and meet the requirements of the Florida Building Code.
6. Impact studluts are required only with non-impact units.
7. All anchors shall be installed as specified on these drawings. Specified embedment base material shall be beyond wall finish or stucco.
8. Testing of one wood species covers all other species with an equal or higher modulus of elasticity and modulus of rupture.
9. Testing of primed covers testing of clad as long as cladding is not structural (extruded), or wraps around the gasket.
10. Testing of windows and doors with a given width and thickness of solid sills and rails, covers products with wider and thicker solid sills and rails provided that construction details are consistent.
11. Any fixed geometric shape that fits within the tested/approved size for a particular product type is qualified by the rectangular shape(s) provided that the frame, sash, panels, components, and construction remain the same.
12. All fixed shaped units must fit inscribed into the allowable rectangular units and be governed by allowable design pressure or the respective rectangular unit.
13. Shims need to be located a maximum of 4" from each corner and a maximum of 4" from each anchor location.

 1323 South 11th Ave Wausau, WI 54401 715-842-5666	
■ WINDOWS & DOORS ■	
Vistaluxe Stretta Sliding Door	
FL# 47463	R&D No. 24702
Revision	Drawn By: KML
A	Date: 4/28/2025
B	Sheet: 2 of 2
C	Drawing No. 24102B