


c:\users\harley\desktop\building drops, inc\building drops, inc\projects\amscowindows\pvc-non-impact products\dwgs\pz1 hampton casement picture window\amsc003.dwg 6/12/2025 7:51 AM

AMSCO WINDOWS

VZ1 HAMPTON SERIES CASEMENT PICTURE WINDOW (NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

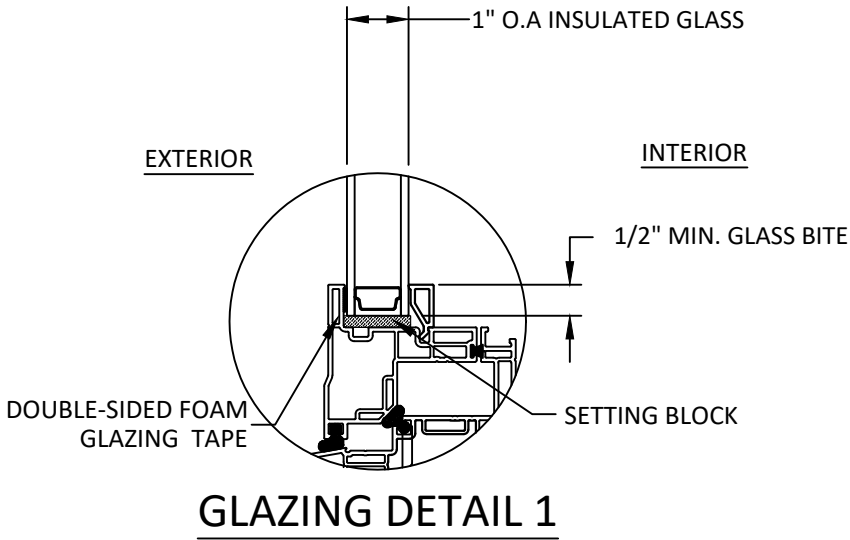

GLAZING NOTES:

- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	ELEVATION AND DESIGN PRESSURE TABLES
3	ELEVATION AND DESIGN PRESSURE TABLES
4	ANCHOR LAYOUTS
5	VERTICAL SECTION
6	HORIZONTAL SECTIONS
7	ANCHOR DETAILS AND INSTALLATION NOTES

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
O	SEE SHEET 2	SEE SHEET 2	SEE SHEET 2	NON-IMPACT
OO	SEE SHEET 3	SEE SHEET 3	SEE SHEET 3	NON-IMPACT



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661

TITLE:
VZ1 HAMPTON SERIES
CASEMENT PICTURE
WINDOW
(NON-HVHZ)(NON-IMPACT)
GENERAL NOTES &
GLAZING DETAIL


PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.06.10 17:49:00 -04'00'

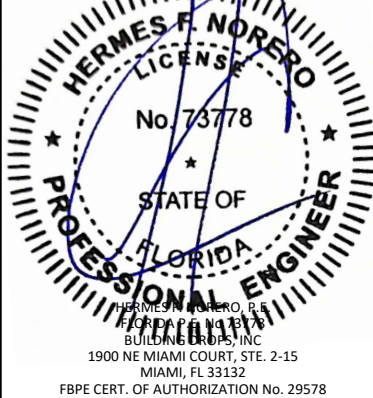

FL #:
FL47559

DATE: **05.20.25**

DWG. BY: **HJ** CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **AMS003**

SHEET:

1


OF 7

c:\users\harley\desktop\building drops, inc\building drops landing - common\projects\amscowindows\bc-25-0376 - fbc submittal - pvc non-impact products\divgs\21 hampton casement picture window\ams003.dwg 6/12/2025 7:51 AM

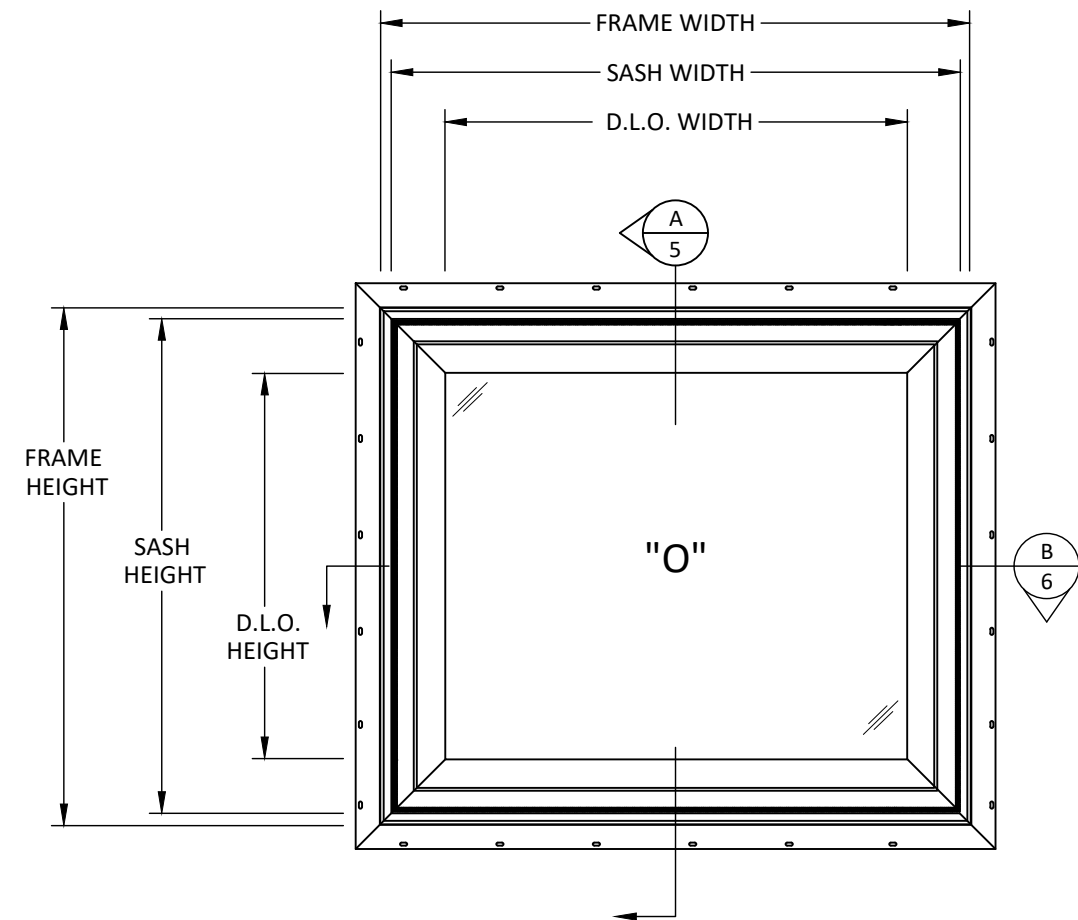

ELEVATION
SINGLE

SIZE NOTES:
SASH WIDTH = FRAME WIDTH - 1-7/8"
SASH HEIGHT = FRAME HEIGHT - 1-7/8"
D.L.O. WIDTH = FRAME WIDTH - 6-15/16"
D.L.O. HEIGHT = FRAME HEIGHT - 6-15/16"

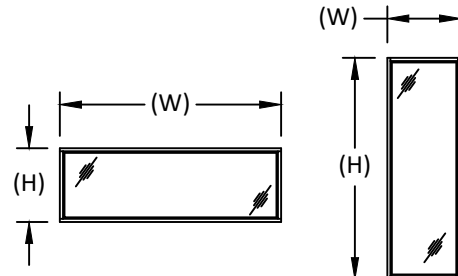

NOTE:
WINDOW WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FOOT AREA.

SINGLE DESIGN PRESSURE TABLE (PSF)			
WIDTH (IN)	HEIGHT (IN.)	POS. (+)	NEG. (-)
36	60	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
36	66	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	72	45.0	45.0
72		45.0	45.0
78		45.0	45.0
84		45.0	45.0
90		45.0	45.0
36	84	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	90	45.0	45.0
72		45.0	45.0
78		45.0	45.0
84		45.0	45.0
90		45.0	45.0
36	96	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	102	45.0	45.0
72		45.0	45.0
78		44.1	44.1
84		45.0	45.0
90		45.0	45.0
96	108	45.0	45.0
102		45.0	45.0
108		44.3	44.3
114		45.0	45.0
120		45.0	45.0
36	114	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	120	45.0	45.0
72		45.0	45.0
78		45.0	45.0
84		44.4	44.4
90		45.0	45.0
96	126	45.0	45.0
102		45.0	45.0
108		45.0	45.0
114		45.0	45.0
120		45.0	45.0
36	132	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	138	45.0	45.0
72		45.0	45.0
78		45.0	45.0
84		45.0	45.0
90		45.0	45.0
96	144	45.0	45.0
102		45.0	45.0
108		45.0	45.0
114		45.0	45.0
120		45.0	45.0

SINGLE DESIGN PRESSURE TABLE (PSF)			
WIDTH (IN)	HEIGHT (IN.)	POS. (+)	NEG. (-)
36	102	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	108	45.0	45.0
72		45.0	45.0
78		44.1	44.1
84		45.0	45.0
90		45.0	45.0
96	114	45.0	45.0
102		45.0	45.0
108		44.3	44.3
114		45.0	45.0
120		45.0	45.0
36	120	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	126	45.0	45.0
72		45.0	45.0
78		45.0	45.0
84		44.4	44.4
90		45.0	45.0
96	132	45.0	45.0
102		45.0	45.0
108		45.0	45.0
114		45.0	45.0
120		45.0	45.0
36	138	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	144	45.0	45.0
72		45.0	45.0
78		45.0	45.0
84		45.0	45.0
90		45.0	45.0




1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661

TITLE:
VZ1 HAMPTON SERIES
CASEMENT PICTURE
WINDOW
(NON-HVHZ)/(NON-IMPACT)
ELEVATION AND DESIGN
PRESSURE TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

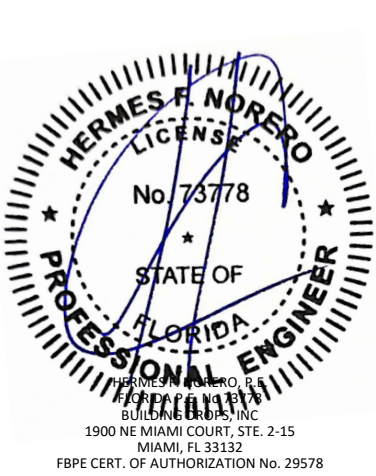

FL #:
FL47559

DATE: **05.20.25**


DWG. BY: **HJ** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **AMS003**


SHEET:
2
OF 7

c:\users\harley\desktop\building drops, inc\building drops, inc\common\projects\amscowindows\fb\25-0376 - fbc submittal - pvc non-impact products\dwgs\pz1 hampton casement picture window\amso03.dwg 6/12/2025 7:51 AM

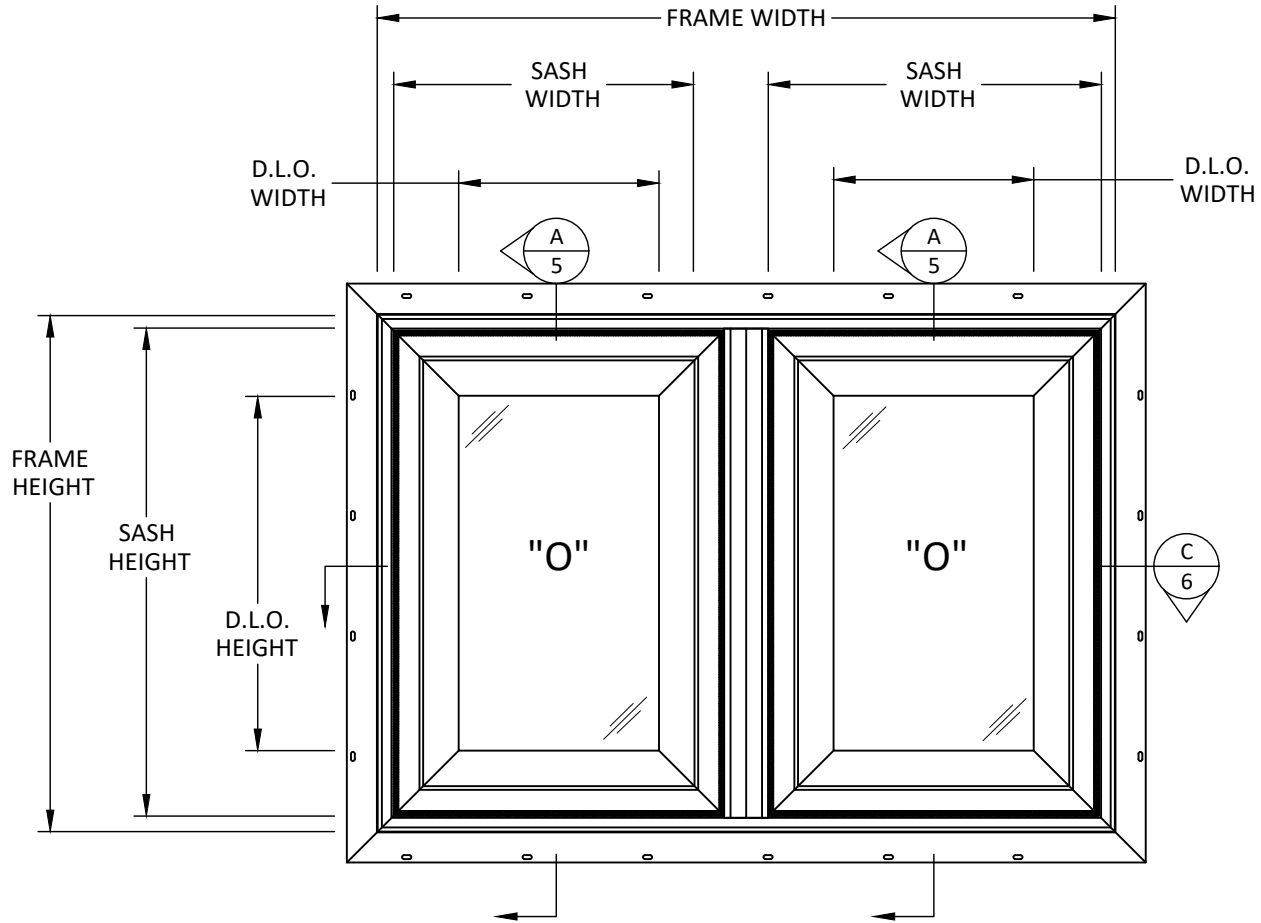

ELEVATION
TWIN
AREA CANNOT EXCEED 96 FT²

SIZE NOTES:
SASH WIDTH = FRAME WIDTH/2 - 15/16"
SASH HEIGHT = FRAME HEIGHT - 1-7/8"
WIDTH = FRAME WIDTH/2 - 3-7/8"
D.L.O. HEIGHT = FRAME HEIGHT - 6-15/16"

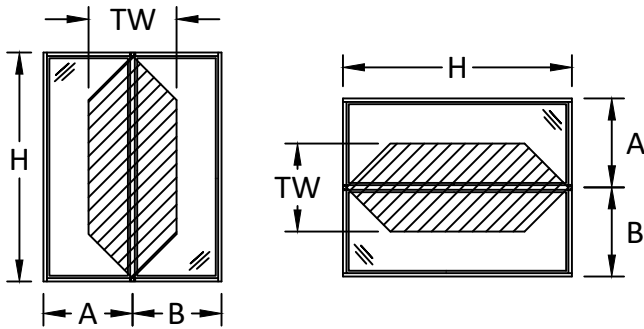

$$\frac{A + B}{2} = TW$$

TWIN DESIGN PRESSURE TABLE (PSF)			
TRIB. WIDTH TW (IN)	HEIGHT (IN.)	POS. (+)	NEG. (-)
54	66	50.0	50.0
57		50.0	50.0
60		50.0	50.0
63		50.0	50.0
66		50.0	50.0
69		50.0	50.0
72		50.0	50.0
75		50.0	50.0
78		30.0	30.0
81		30.0	30.0
84		30.0	30.0
87		30.0	30.0
90		30.0	30.0
93		30.0	30.0
96		30.0	30.0
99		30.0	30.0
102		30.0	30.0
54	72	50.0	50.0
57		50.0	50.0
60		50.0	50.0
63		50.0	50.0
66		50.0	50.0
69		50.0	50.0
72		30.0	30.0
75		30.0	30.0
78		30.0	30.0
81		30.0	30.0
84		30.0	30.0
87		30.0	30.0
90		30.0	30.0
93		30.0	30.0
96		30.0	30.0
54	78	50.0	50.0
57		50.0	50.0
60		50.0	50.0
63		50.0	50.0
66		50.0	50.0
69		50.0	50.0
72		30.0	30.0
75		30.0	30.0
78		30.0	30.0
81		30.0	30.0
84		30.0	30.0
87		30.0	30.0
90		30.0	30.0
93		30.0	30.0

TWIN DESIGN PRESSURE TABLE (PSF)			
TRIB. WIDTH TW (IN)	HEIGHT (IN.)	POS. (+)	NEG. (-)
54	84	50.0	50.0
57		50.0	50.0
60		50.0	50.0
63		30.0	30.0
66		30.0	30.0
69		30.0	30.0
72		30.0	30.0
75		30.0	30.0
78		30.0	30.0
81		30.0	30.0
54	90	42.3	42.3
57		30.0	30.0
60		30.0	30.0
63		30.0	30.0
66		30.0	30.0
69		30.0	30.0
72		30.0	30.0
75		30.0	30.0
54	96	30.0	30.0
57		30.0	30.0
60		30.0	30.0
63		30.0	30.0
66		30.0	30.0
69		30.0	30.0
54	102	29.5	29.5
57		28.3	28.3
60		27.3	27.3
63		26.4	26.4
66		25.6	25.6
54	108	24.5	24.5
57		23.5	23.5
60		22.6	22.6
63		21.8	21.8
54	114	20.6	20.6
57		19.8	19.8
60		19.0	19.0
54	120	17.5	17.5
57		16.8	16.8

NOTE: THE LOWER DESIGN PRESSURE BETWEEN THE VALUES ON THESE TABLES AND THE TABLES ON SHEET 2 SHALL APPLY TO THE TWIN CONFIGURATION.



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661


TITLE: VZ1 HAMPTON SERIES
CASEMENT PICTURE
WINDOW
(NON-HVHZ)/(NON-IMPACT)

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

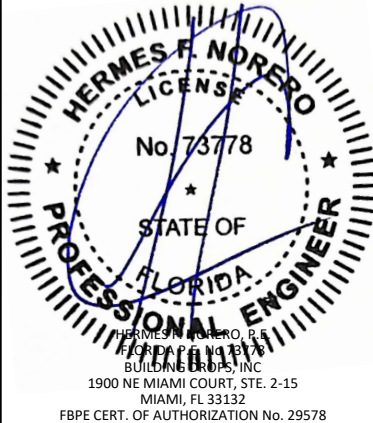

FL #:	FL47559
DATE:	05.20.25
DWG. BY:	HJ
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	AMS003
SHEET:	3

c:\users\harley\desktop\amscowindows\bc-25-0376 - fbc submittal - pvc non-impact products\dwgs\pz1 hampton casement picture window\amso03.dwg 6/12/2025 7:51 AM



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661


TITLE: VZ1 HAMPTON SERIES
CASEMENT PICTURE
WINDOW
(NON-HVHZ)(NON-IMPACT)
ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

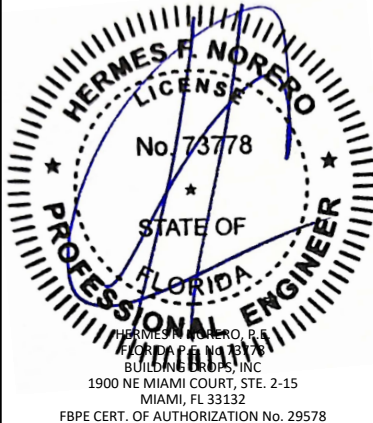

FL #:
FL47559

DATE: **05.20.25**

DWG. BY: **HJ**
CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **AMS003**


SHEET:

4


OF 7

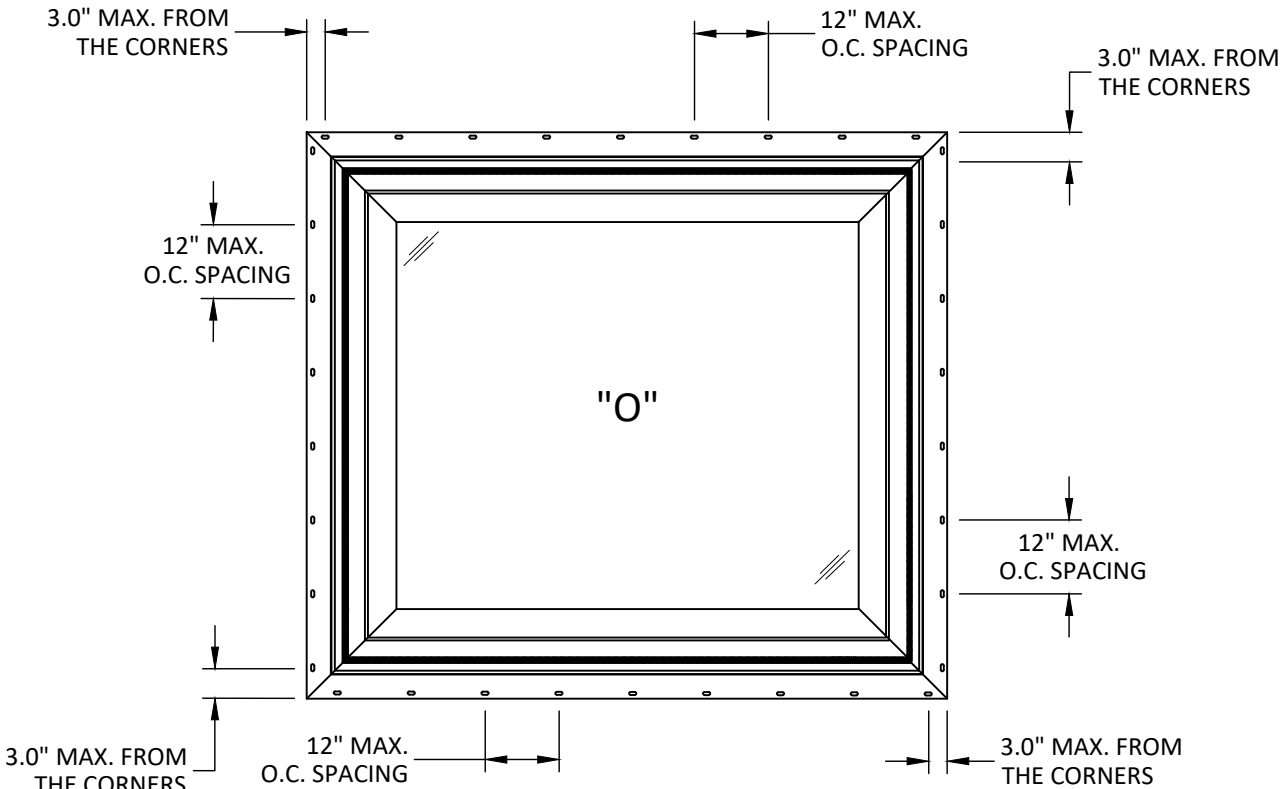

ANCHOR LAYOUT
NAIL-FIN INSTALLATION
SINGLE

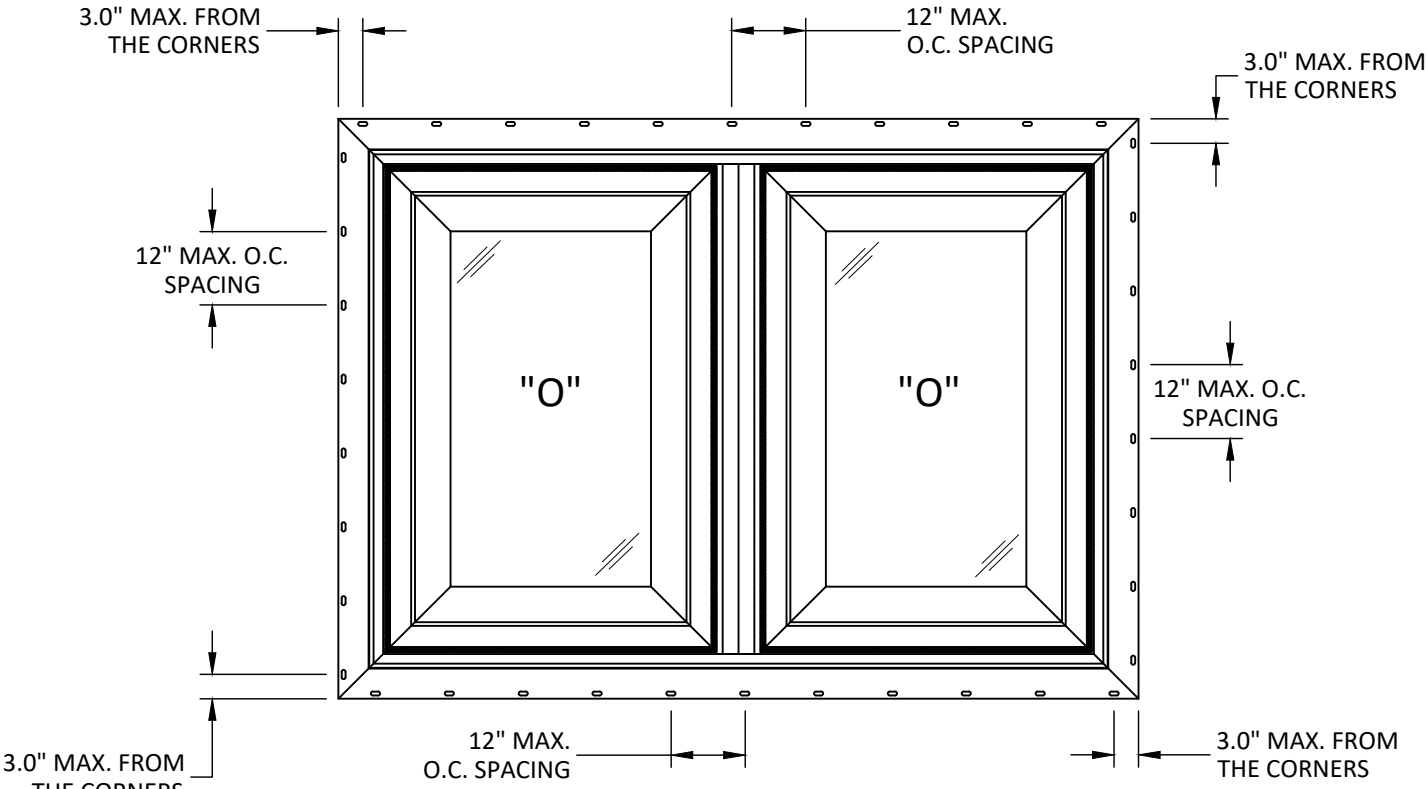


ANCHOR LAYOUT
NAIL-FIN INSTALLATION
TWIN



BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 4744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

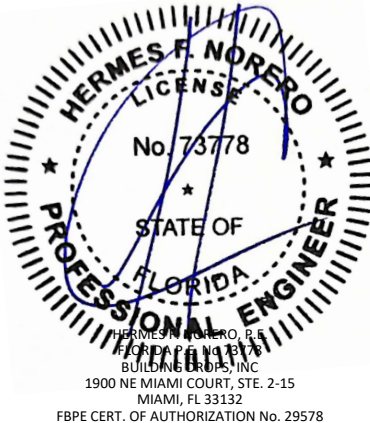

FL #: **FL47559**

DATE: 05.20.25

DWG. BY: HJ	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: **AMS003**

SHEET:

5


OF 7



BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 309-8478
FAX: (954) 744,4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

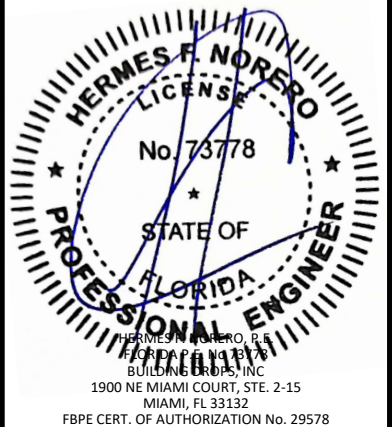

FL #: **FL47559**

DATE: 05.20.25

DWG. BY: HJ	CHK. BY: HFN
-----------------------	------------------------


SCALE: NTS

DWG. #: AMS003


SHEET:

6

OF 7

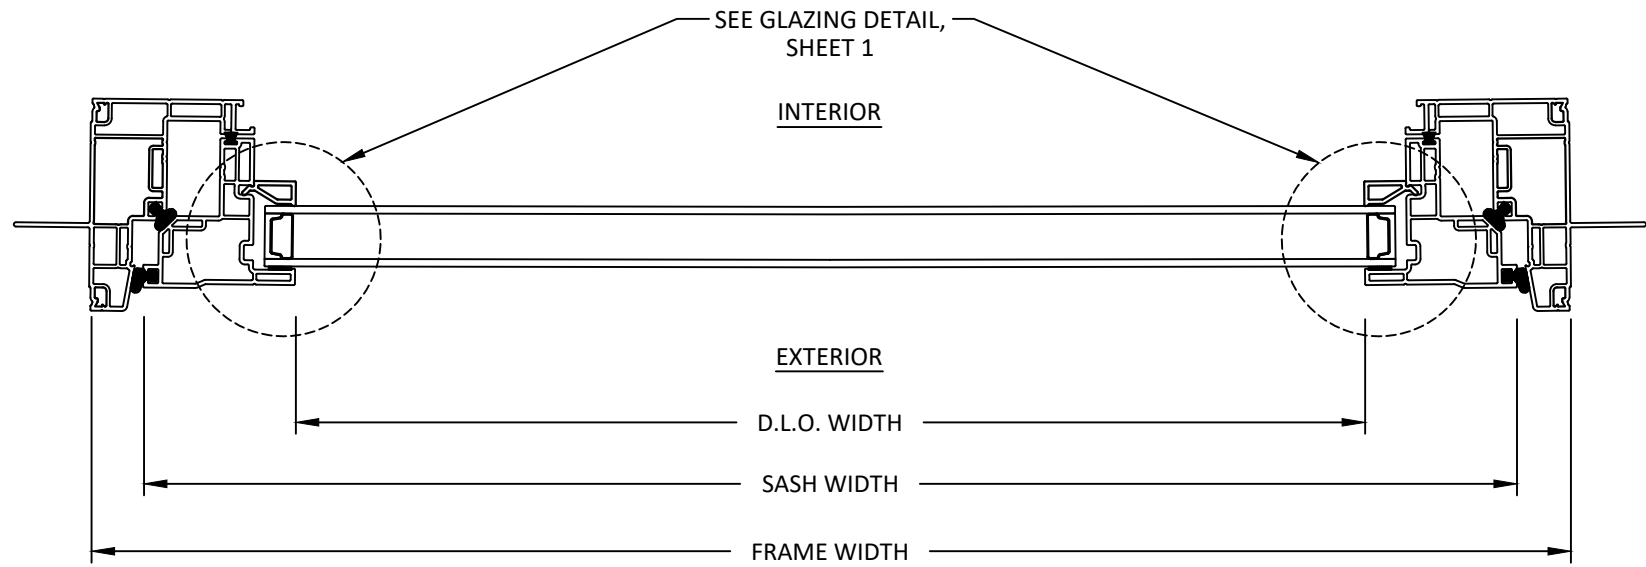


B HORIZONTAL SECTION

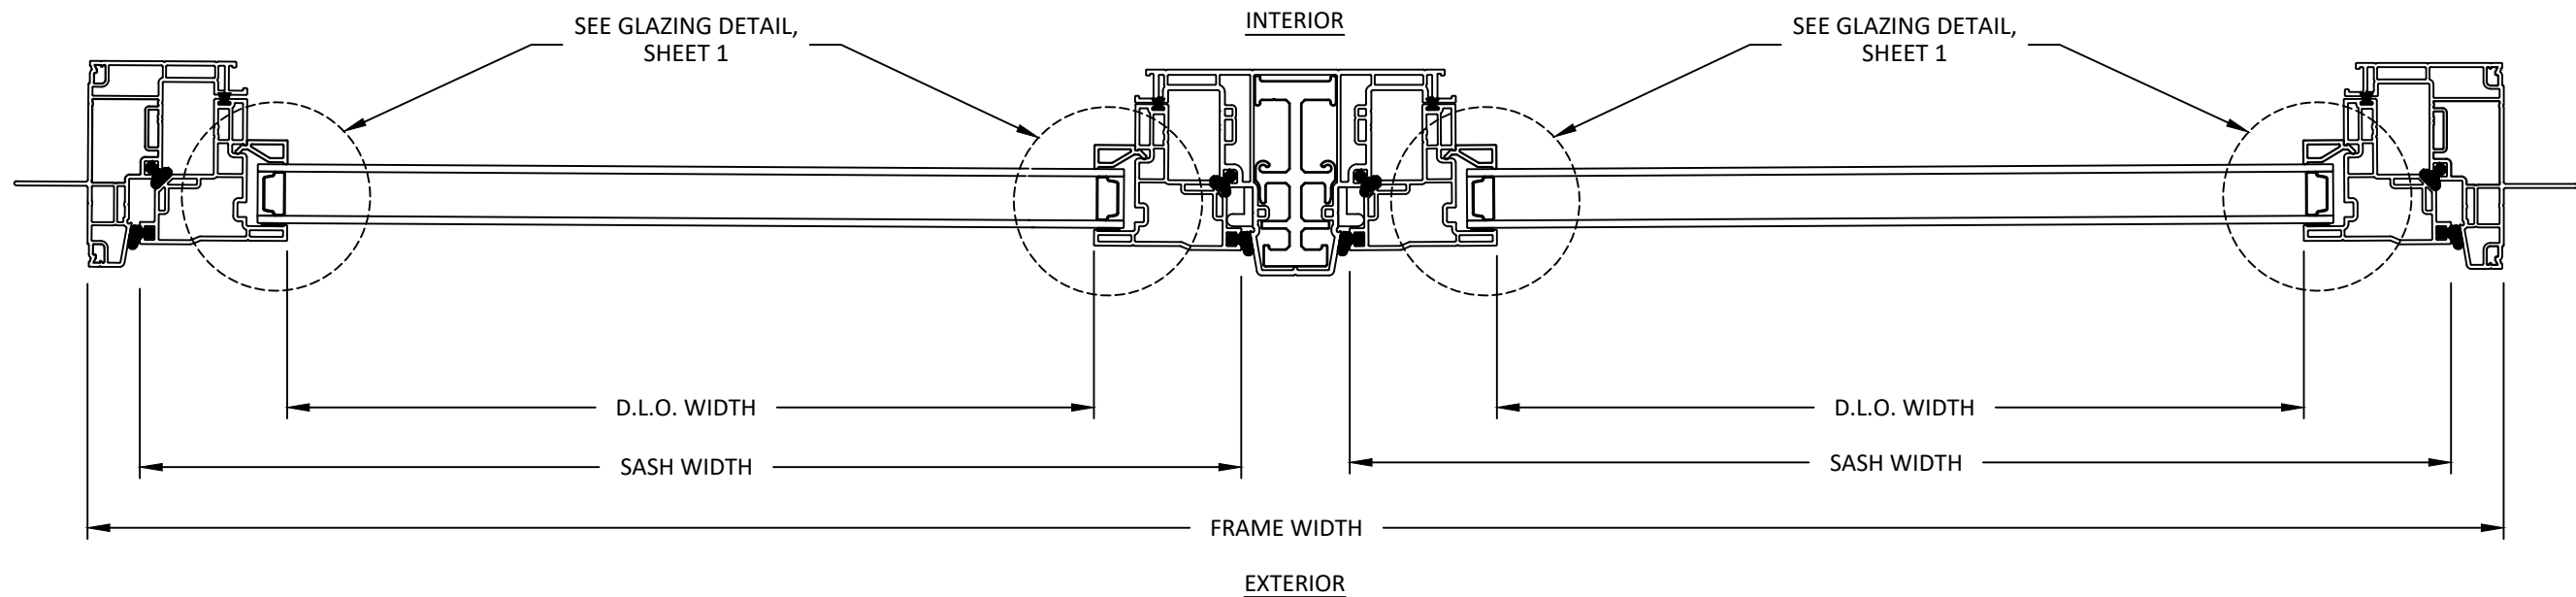

C HORIZONTAL SECTION

6/12/2025 7:51 AM

c:\users\harley\desktop\projects\amscowindows\pbc-25-0376 - fbc submittal - pvc non-impact products\dwgs\pz1 hampton casement picture window\amsc003.dwg

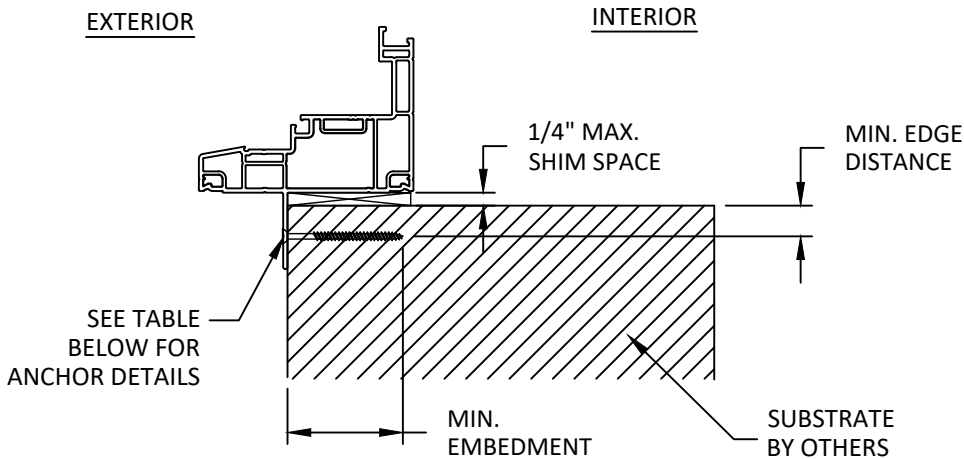

A
7

VERTICAL SECTION

SILL - NAIL-FIN

NOTE: HEAD AND
JAMB SIMILAR

INSTALLATION NOTES:

- ONE INSTALLATION ANCHOR ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 4.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
NAIL FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#8 SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661


TITLE: VZ1 HAMPTON SERIES
CASEMENT PICTURE
WINDOW
(NON-HVHZ/(NON-IMPACT))
ANCHOR DETAILS
AND INSTALLATION NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

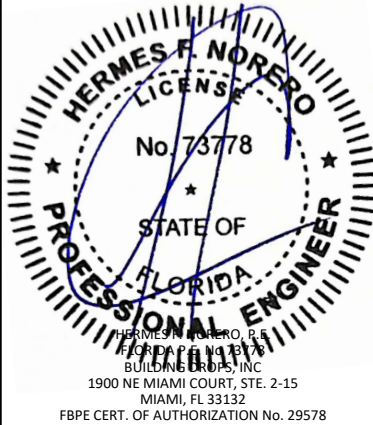

FL #: **FL47559**

DATE: **05.20.25**

DWG. BY: **HJ** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **AMS003**

SHEET:

7

OF 7