

c:\Users\dylanivata\building_drops, inc\building_drops, inc\projects\2026 code change projects\amscos\windows\cc-26-0524-1 - 2026 code change\dwgs\147561\ams008.dwg 8/16/2026 3:19 PM


AMSCO WINDOWS

VZ1 HAMPTON SERIES PICTURE WINDOW

(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

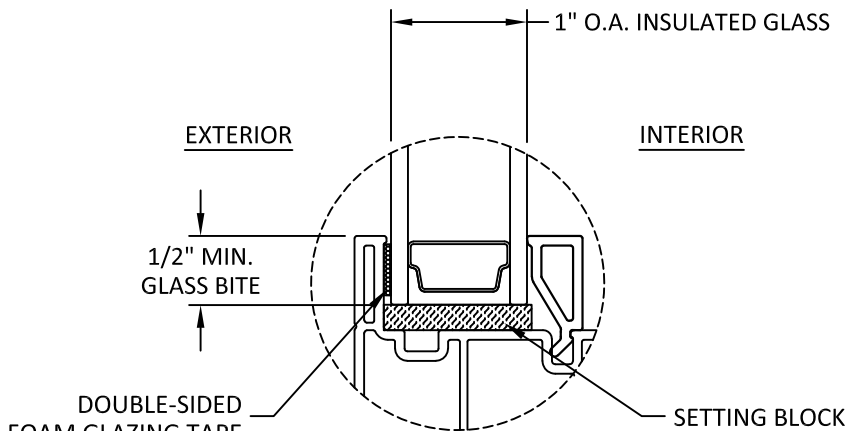

GLAZING DETAIL 1

GLAZING NOTES:

- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES AND GLAZING DETAIL
2	ELEVATION AND DESIGN PRESSURE TABLES
3	ELEVATION AND DESIGN PRESSURE TABLES
4	ANCHOR LAYOUTS
5	VERTICAL SECTION
6	HORIZONTAL SECTIONS
7	ANCHOR DETAILS AND INSTALLATION NOTES

DESIGN PRESSURE RATING (PSF)				
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
O	SEE SHEET 2	SEE SHEET 2	SEE SHEET 2	NON-IMPACT
OO	SEE SHEET 3	SEE SHEET 3	SEE SHEET 3	NON-IMPACT



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661

TITLE:
VZ1 HAMPTON SERIES
PICTURE WINDOW
(NON-HVHZ)(NON-IMPACT)

GENERAL NOTES &
GLAZING DETAIL

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738


WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.15 11:47:51 -0400

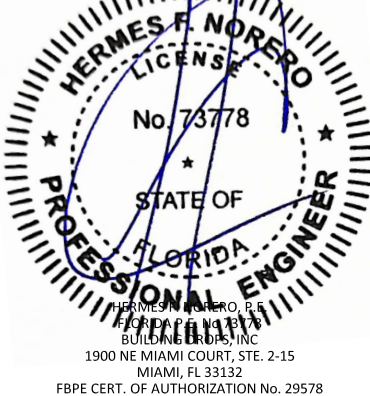


FL #:	FL47561	
DATE:	06.05.25	
DWG. BY:	SH	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	AMS008	
SHEET:	1	REV. A
OF 7		

c:\Users\dyantawata\building_drops, inc\building_drops landing - common\projects\2026 code change projects\amscos windows\cc-26-0524-1 - 2026 code change projects\amscos windows\147561\ams008.dwg 8/16/2026 3:19 PM

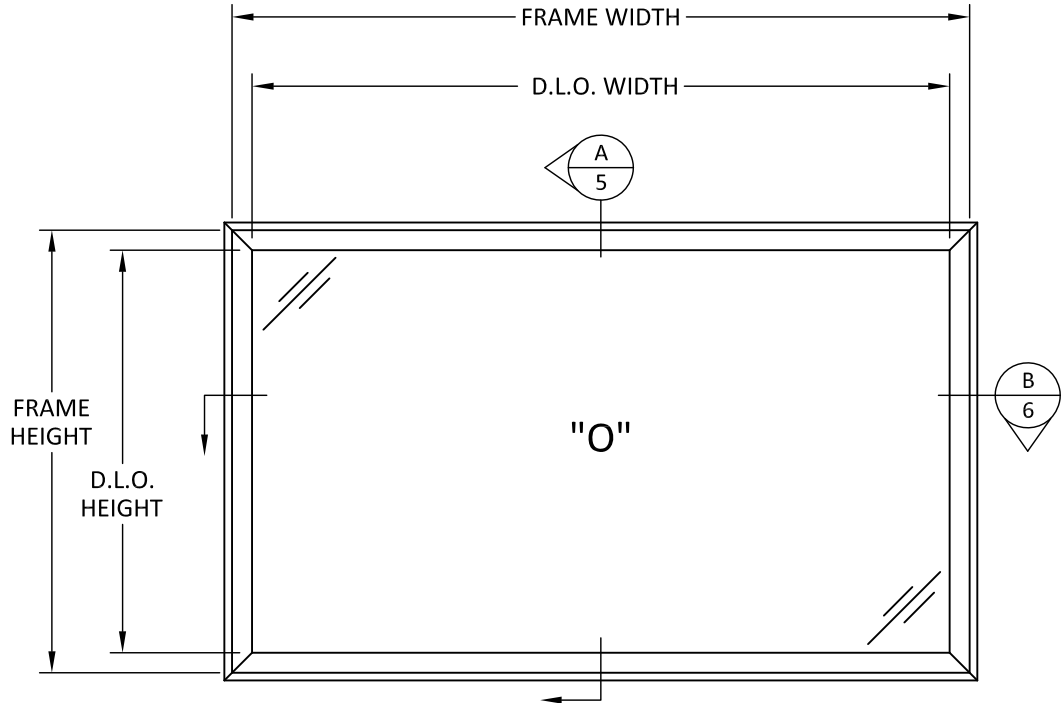

ELEVATION
SINGLE

SIZE NOTES:
D.L.O. HEIGHT = FRAME HEIGHT - 6 1/2"
D.L.O. WIDTH = FRAME WIDTH - 6 1/2"

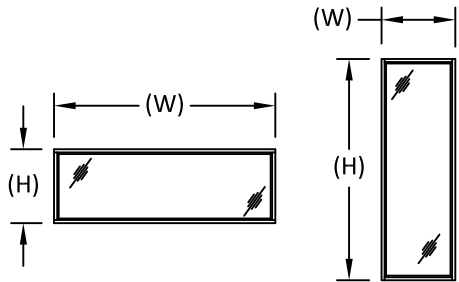

NOTE:
WINDOW WIDTH (W) AND HEIGHT (H) ARE INTERCHANGEABLE FOR ALL SIZES SHOWN HEREIN NOT TO EXCEED MAXIMUM TESTED SQUARE FOOT AREA.

SINGLE DESIGN PRESSURE TABLE (PSF)			
WIDTH (IN)	HEIGHT (IN.)	POS. (+)	NEG. (-)
36	60	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
36	66	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
36	72	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	72	45.0	45.0
72		45.0	45.0
36	84	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	84	45.0	45.0
72		45.0	45.0
78		41.5	41.5
84		21.4	21.4
36	90	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	90	45.0	45.0
72		45.0	45.0
78		23.1	23.1
84		21.4	21.4
90		20.0	20.0
36	96	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	96	45.0	45.0
72		45.0	45.0
78		23.1	23.1
84		21.4	21.4
90		20.0	20.0

SINGLE DESIGN PRESSURE TABLE (PSF)			
WIDTH (IN)	HEIGHT (IN.)	POS. (+)	NEG. (-)
36	102	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	102	45.0	45.0
72		25.0	25.0
78		23.1	23.1
84		21.4	21.4
36	108	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	108	25.0	25.0
72		25.0	25.0
78		23.1	23.1
36	114	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		45.0	45.0
66	114	25.0	25.0
72		25.0	25.0
36	120	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		25.0	25.0
66	120	25.0	25.0
72		25.0	25.0
36	126	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		45.0	45.0
60		25.0	25.0
66	126	25.0	25.0
72		25.0	25.0
36	132	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		25.0	25.0
60		25.0	25.0
66	132	25.0	25.0
72		25.0	25.0
36	144	45.0	45.0
42		45.0	45.0
48		45.0	45.0
54		25.0	25.0
60		25.0	25.0



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661

TITLE:
VZ1 HAMPTON SERIES
PICTURE WINDOW
(NON-HVHZ)/(NON-IMPACT)

ELEVATION &
DESIGN PRESSURE TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL47561

DATE: **06.05.25**

DWG. BY: **SH** CHK. BY: **HFN**


SCALE: **NTS**

DWG. #: **AMS008**

SHEET: **2** REV. **A**


OF 7

c:\users\jvanivata\building_drops, inc\building_drops landing - common\projects\2026 code change projects\amsc windows\cc-26-0524-1 - 2026 code change projects\amsc windows\147561\ams008.dwg 8/16/2026 3:19 PM

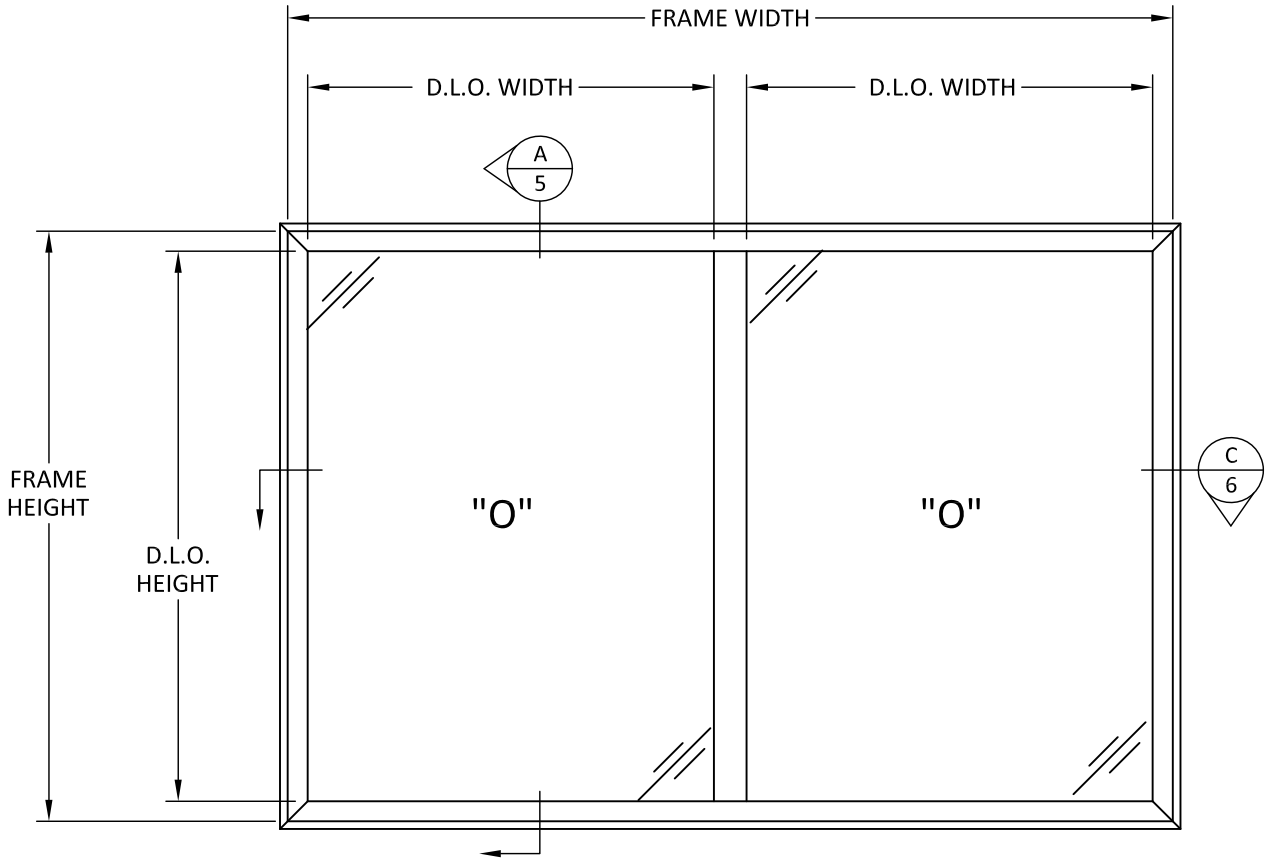

ELEVATION
TWIN
AREA CANNOT EXCEED 96 FT²

SIZE NOTES:
D.L.O. HEIGHT = FRAME HEIGHT - 6 1/2"
D.L.O. WIDTH = FRAME WIDTH/2 - 5 7/8"

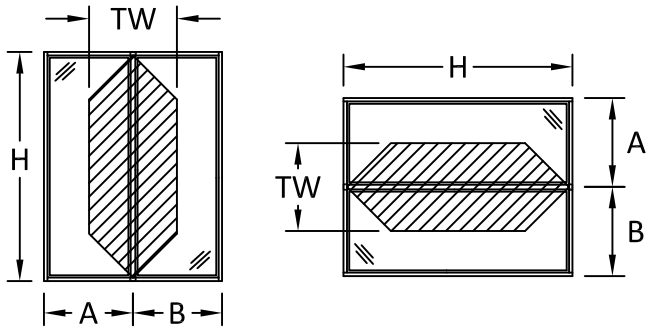

$$\frac{A + B}{2} = TW$$

TWIN DESIGN PRESSURE TABLE (PSF)			
TRIB. WIDTH [TW] (IN)	HEIGHT [H] (IN.)	POS. (+)	NEG. (-)
54	66	40.0	40.0
57		40.0	40.0
60		40.0	40.0
63		40.0	40.0
66		40.0	40.0
69		40.0	40.0
72		40.0	40.0
75		40.0	40.0
78		25.0	25.0
81		25.0	25.0
84		25.0	25.0
87		25.0	25.0
90		25.0	25.0
93		25.0	25.0
96		25.0	25.0
99	72	25.0	25.0
102		25.0	25.0
54		40.0	40.0
57		40.0	40.0
60		40.0	40.0
63		40.0	40.0
66		40.0	40.0
69		40.0	40.0
72		25.0	25.0
75		25.0	25.0
78		25.0	25.0
81		25.0	25.0
84		25.0	25.0
87		25.0	25.0
90	78	25.0	25.0
93		25.0	25.0
96		25.0	25.0
54		40.0	40.0
57		40.0	40.0
60		40.0	40.0
63		40.0	40.0
66		25.0	25.0
69		25.0	25.0
72		25.0	25.0
75		25.0	25.0
78		25.0	25.0
81		25.0	25.0
84		25.0	25.0
87		25.0	25.0

TWIN DESIGN PRESSURE TABLE (PSF)			
TRIB. WIDTH [TW] (IN)	HEIGHT [H] (IN.)	POS. (+)	NEG. (-)
54	84	40.0	40.0
57		40.0	40.0
60		40.0	40.0
63		25.0	25.0
66		25.0	25.0
69		25.0	25.0
72		25.0	25.0
75		25.0	25.0
78		25.0	25.0
81		25.0	25.0
54	90	33.8	33.8
57		25.0	25.0
60		25.0	25.0
63		25.0	25.0
66		25.0	25.0
69		25.0	25.0
72		25.0	25.0
75		25.0	25.0
54	96	25.0	25.0
57		25.0	25.0
60		25.0	25.0
63		25.0	25.0
66		25.0	25.0
69		25.0	25.0
72		25.0	25.0
54	102	24.6	24.6
57		23.6	23.6
60		22.7	22.7
63		22.0	22.0
66		21.3	21.3
54	108	20.4	20.4
57		19.6	19.6
60		18.9	18.9
63		18.2	18.2
54	114	17.2	17.2
57		16.5	16.5
60		15.8	15.8

NOTE: THE LOWER DESIGN PRESSURE BETWEEN THE VALUES ON THESE TABLES AND THE TABLES ON SHEET 2 SHALL APPLY TO THE TWIN CONFIGURATION.



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661

TITLE: VZ1 HAMPTON SERIES
PICTURE WINDOW
(NON-HVHZ/(NON-IMPACT))

ELEVATION &
DESIGN PRESSURE TABLES

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #: FL47561

DATE: 06.05.25


DWG. BY: SH
CHK. BY: HFN

SCALE: NTS


DWG. #: AMS008

SHEET: 3
REV. A

c:\users\dylanivata\building_drops, inc\building_drops landing - common\projects\2026 code change projects\amsco windows\cc-26-0524-1 - 2026 code change projects\amsco windows\147561\ams008.dwg 8/16/2026 3:19 PM

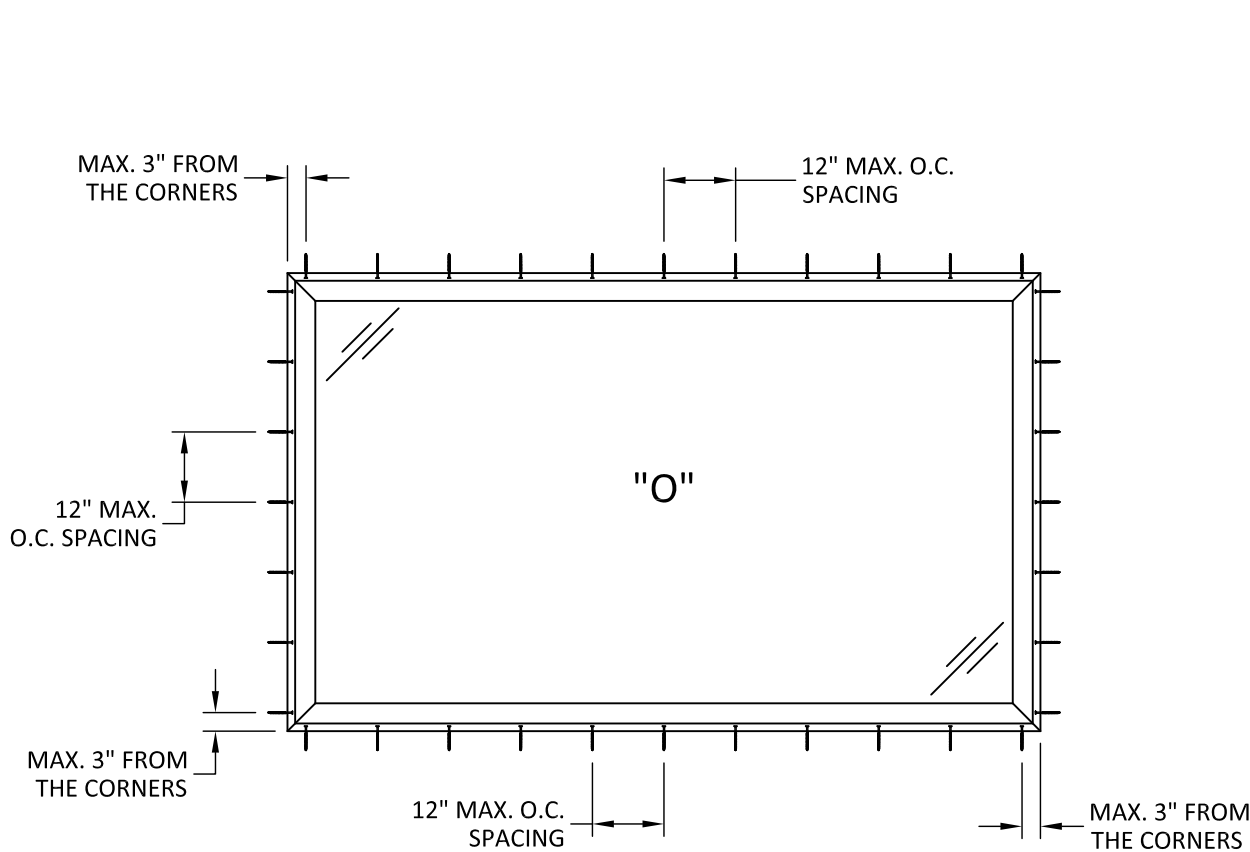

ANCHOR LAYOUT
NAIL-FIN INSTALLATION
SINGLE

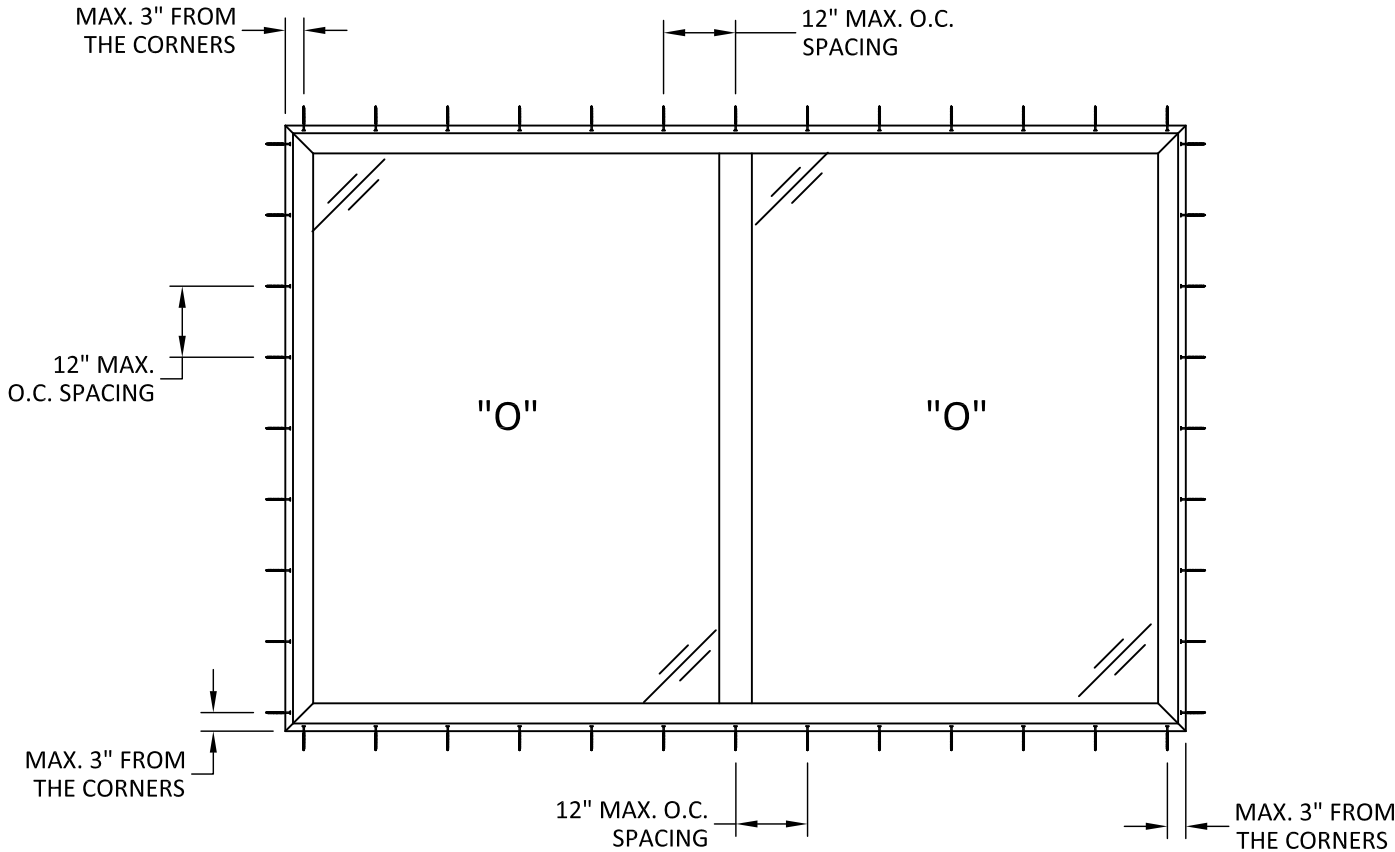

ANCHOR LAYOUT
NAIL-FIN INSTALLATION
TWIN



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661

TITLE:
VZ1 HAMPTON SERIES
PICTURE WINDOW
(NON-HVHZ)/(NON-IMPACT)


ANCHOR LAYOUTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com


BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26


THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

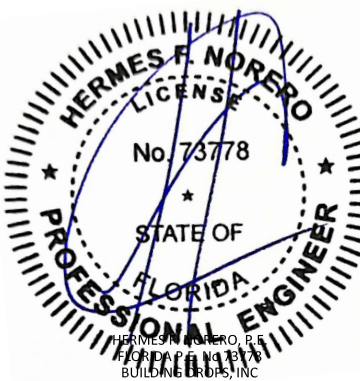

HERMES F. NORERO, P.E.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:	FL47561	
DATE:	06.05.25	
DWG. BY:	SH	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	AMS008	
SHEET:	4	REV. A
OF 7		

c:\users\j\antivata\building_drops, inc\building_drops landing - common\projects\2026 code change projects\amsc windows\cc-26-0524-1 - 2026 code change\dwgs\147561\ams008.dwg 8/16/2026 3:19 PM

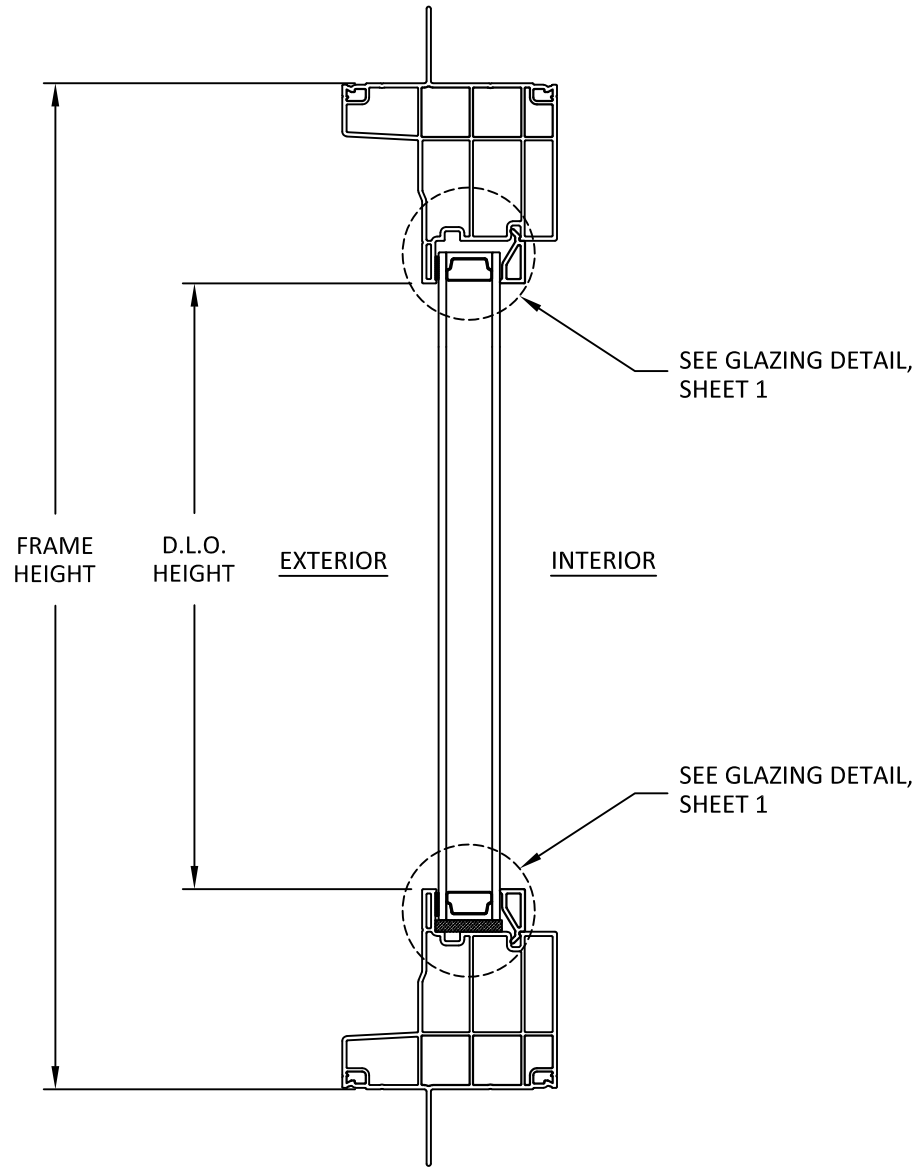

A
5 VERTICAL SECTION



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661

TITLE: VZ1 HAMPTON SERIES
PICTURE WINDOW
(NON-HVHZ)/(NON-IMPACT)

VERTICAL SECTION

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:		FL47561	
DATE:		06.05.25	
DWG. BY:	SH	CHK. BY:	HFN
SCALE:		NTS	
DWG. #:		AMS008	
SHEET:		REV. A	
5		OF 7	

c:\users\yvanivata\building_drops, inc\building_drops landing - common\projects\2026 code change projects\amscowindows\cc-26-0524-1 - 2026 code change projects\amscowindows\l147561\ams008.dwg 8/16/2026 3:19 PM

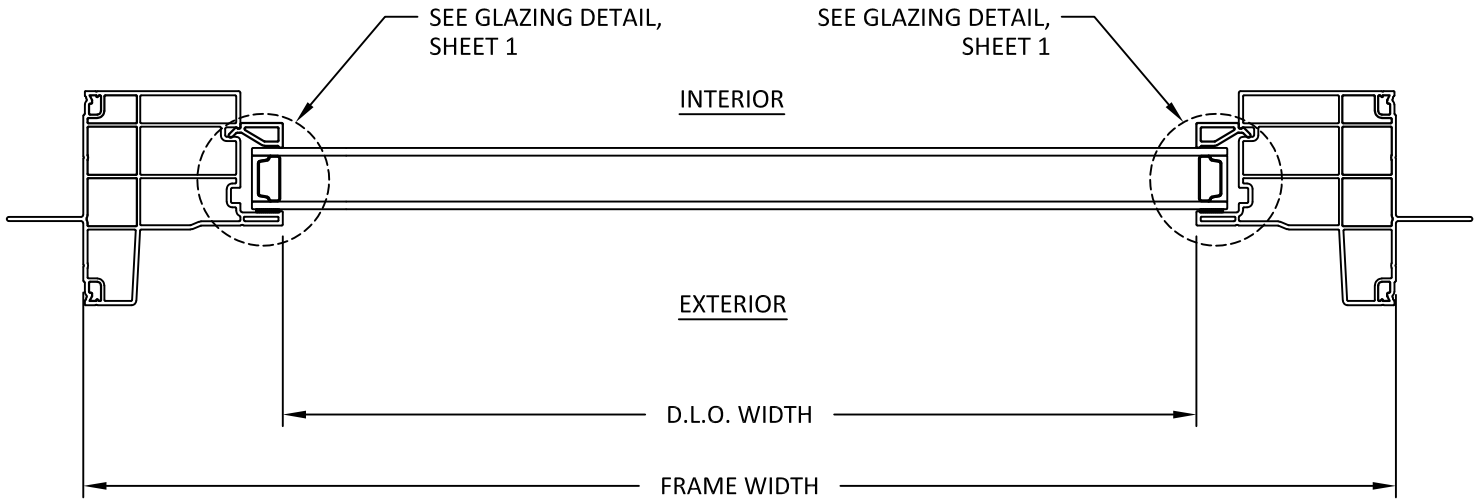

B
6 HORIZONTAL SECTION
SINGLE

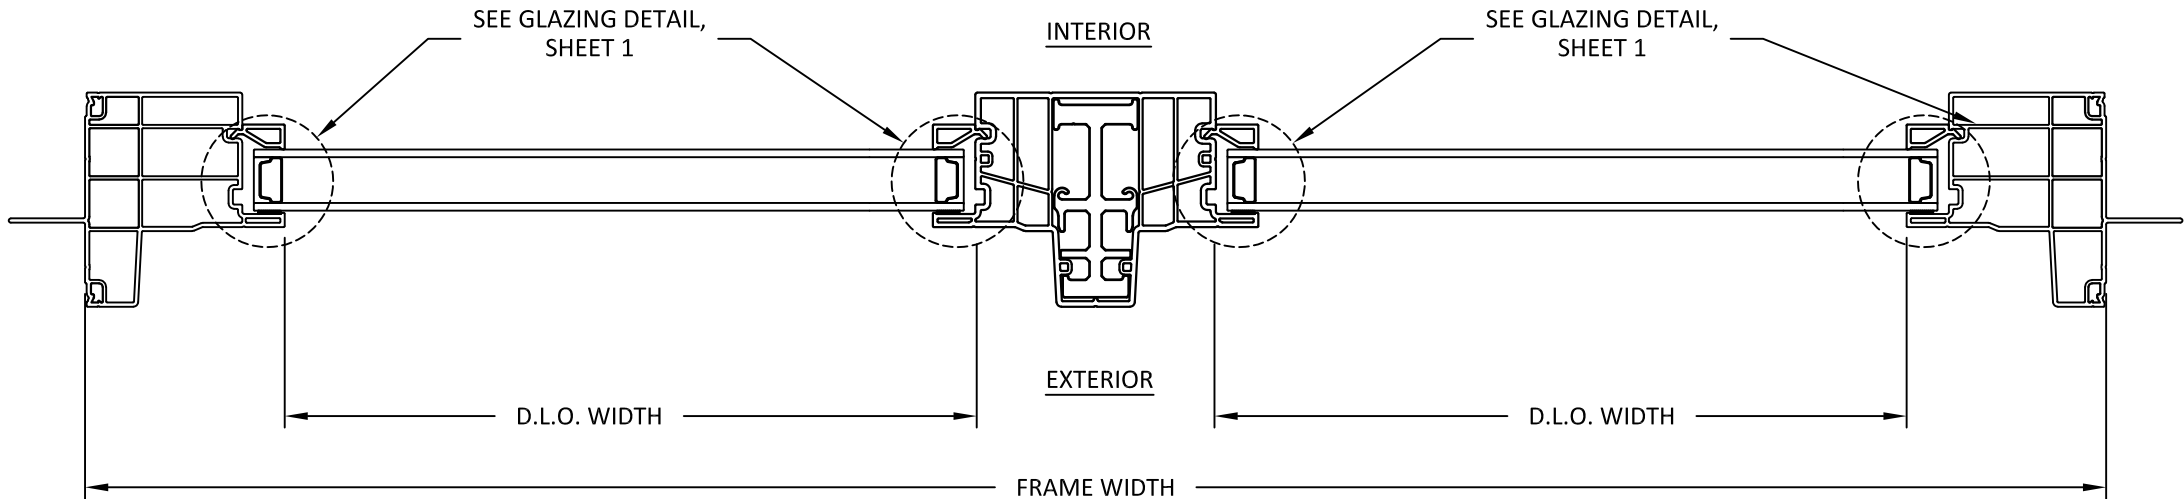

C
6 HORIZONTAL SECTION
TWIN



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661

TITLE: VZ1 HAMPTON SERIES
PICTURE WINDOW
(NON-HVHZ)/(NON-IMPACT)

HORIZONTAL SECTIONS


PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

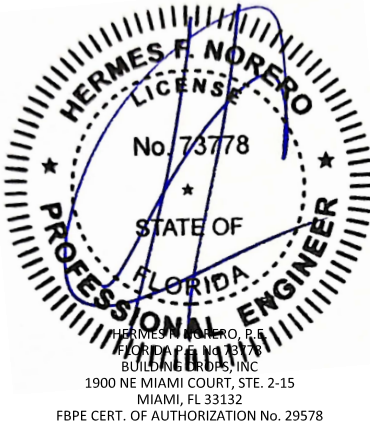

FL #:	FL47561
DATE:	06.05.25
DWG. BY:	SH
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	AMS008
SHEET:	6
REV.	A

c:\users\j\antivata\building_drops, inc\building_drops\projects\2026 code change projects\amsco windows\cc-26-0524-1 - 2026 code change\dwgs\147561\ams008.dwg 8/16/2026 3:19 PM

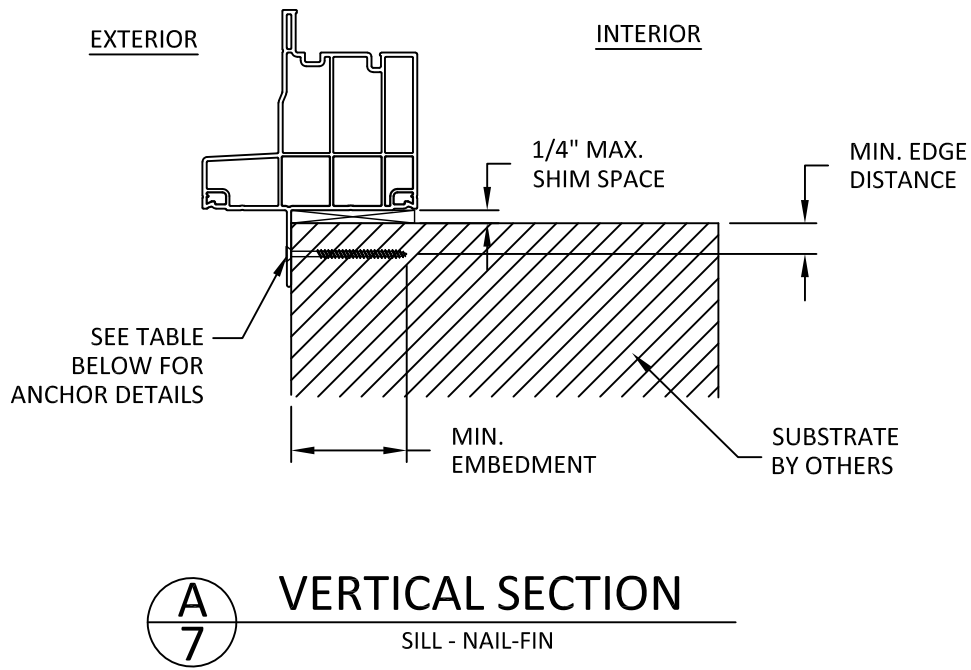

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEET 4.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

NOTE: HEAD AND JAMB SIMILAR

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR SCHEDULE	MIN EMBEDMENT	MIN. EDGE DISTANCE
NAIL-FIN	WOOD: MIN. SG = 0.55	#8 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE Steel, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#8 GR. 5 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"



1880 South 1045 West
Salt Lake City, UT 84104
PH: +1-800-748-4661

TITLE: VZ1 HAMPTON SERIES
PICTURE WINDOW
(NON-HVHZ)/(NON-IMPACT)

ANCHOR DETAILS &
INSTALLATION NOTES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954)399-8478

FAX: (954)744-4738

WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:

FL47561

DATE: 06.05.25

DWG. BY:
SH

CHK. BY:
HFN

SCALE: NTS

DWG. #: AMS008

SHEET:

7

REV.

A

OF 7