

Nailstrip or Fastening Flange

ISOMETRIC VIEW

Panel Sealant Required


#10 Low profile panhead screw 3" from ends, 6" o.c. max.

16" nom. max. coverage

#10 Low profile panhead screw.
3" from ends and 6" max. o.c.

1/2" (15/32" min.) 4-Ply CDX Plywood or 3/4" min.
thick wood plank (See min. substrate notes in Eval. Report)

Approved underlayment. Comply with FBC 1507.1.1 (non-HVHZ)
or 1518.2 (HVHZ), Residential Code 905.1, 905.1.1, 905.1.1.1

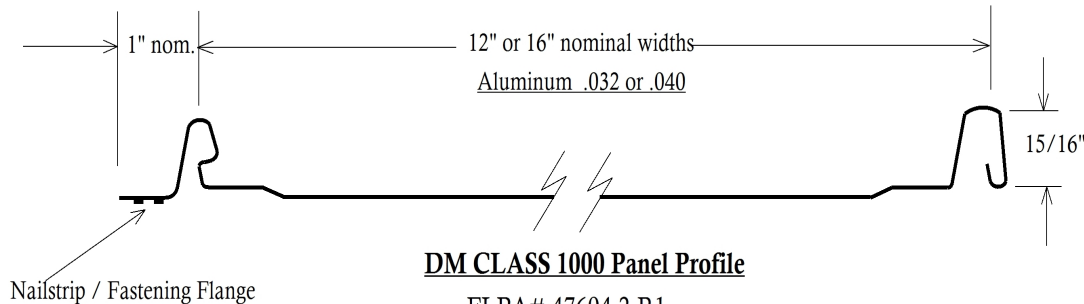

MAX. DESIGN PRESSURE
.032 Aluminum tested FLPA# 47604.2-R1
APPROVED FOR USE IN HVHZ


#10 Screws 3" from ends, 6" o.c. max.
with continuous bead of Geocel 2300 or 2320
(at nailstrip) side of seam = -175 psf

GENERAL NOTES:

1. Roof slope is limited per the requirements of FBC Section 1507.4.2 or 1515.2. Residential Code 905.10.2
2. Design of substrate is by others and not a part of this approval. Perimeters and woodblocking should comply with (RAS 111 where applicable).
3. All panel system perimeters, penetrations, and transitions to be flashed and sealed per the requirements of DYME Metals' Installation Instructions and (RAS 133 where applicable).

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982



Digitally signed
by Scott Wolters
Date: 2025.09.06
10:58:52 -04'00'



DRAWN
RWM
CHECKED

DATE
8-28-25

SCALE
NTS