

Nailstrip or Fastening Flange

ISOMETRIC VIEW

Panel Sealant Required

19" nom. max. coverage

#10 Low profile panhead screw.
3" from ends and 6" max. o.c.

1/2" (15/32" min.) 4-Ply CDX Plywood or 3/4" min.
thick wood plank (See min. substrate notes in Eval. Report)

Approved underlayment. Comply with FBC 1507.1.1 (non-HVHZ)
or 1518.2 (HVHZ), Residential Code 905.1, 905.1.1, 905.1.1.1

11", 15", or 19" nominal widths available
Galvalume 24ga

1" nom.

1-1/2" nom.

Nailstrip / Fastening Flange

DM CLASS 1050 Panel Profile

FLPA# 47604.4-R1

MAX. DESIGN PRESSURE
24ga galvalume tested FLPA# 47604.4-R1
APPROVED FOR USE INSIDE HVHZ


#10 Screws 3" from ends, 6" o.c. max. with
continuous bead of Geocel 2300 or 2320
(at Nailstrip) side of seam = -112.5 psf

GENERAL NOTES:

1. Roof slope is limited per the requirements of FBC Section 1507.4.2 or 1515.2. Residential Code 905.10.2
2. Design of substrate is by others and not a part of this approval. Perimeters and woodblocking should comply with (RAS 111 where applicable).
3. All panel system perimeters, penetrations, and transitions to be flashed and sealed per the requirements of DYME Metals' Installation Instructions and (RAS 133 where applicable).

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982

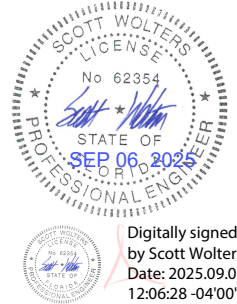

Digitally signed
by Scott Wolters
Date: 2025.09.06
12:06:28 -04'00'



DRAWN
RWM
CHECKED

DATE
8-28-25

SCALE
NTS