



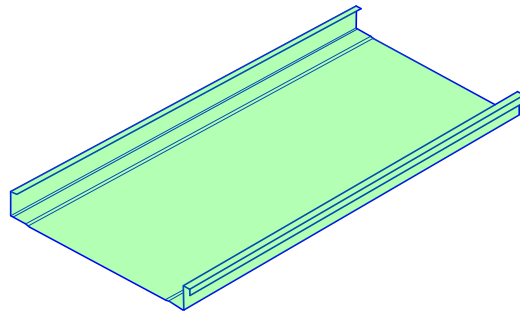


ISOMETRIC VIEW




26ga Stainless Steel clip

Sealant required in the HVHZ when slope is $< 2^{\circ}/12^{\circ}$.

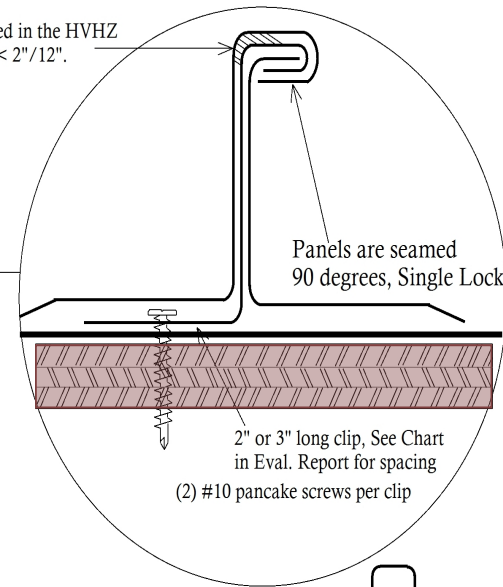

Panels are seamed 90 degrees, Single Lock

2" or 3" long clip, See Chart in Eval. Report for spacing
(2) #10 pancake screws per clip

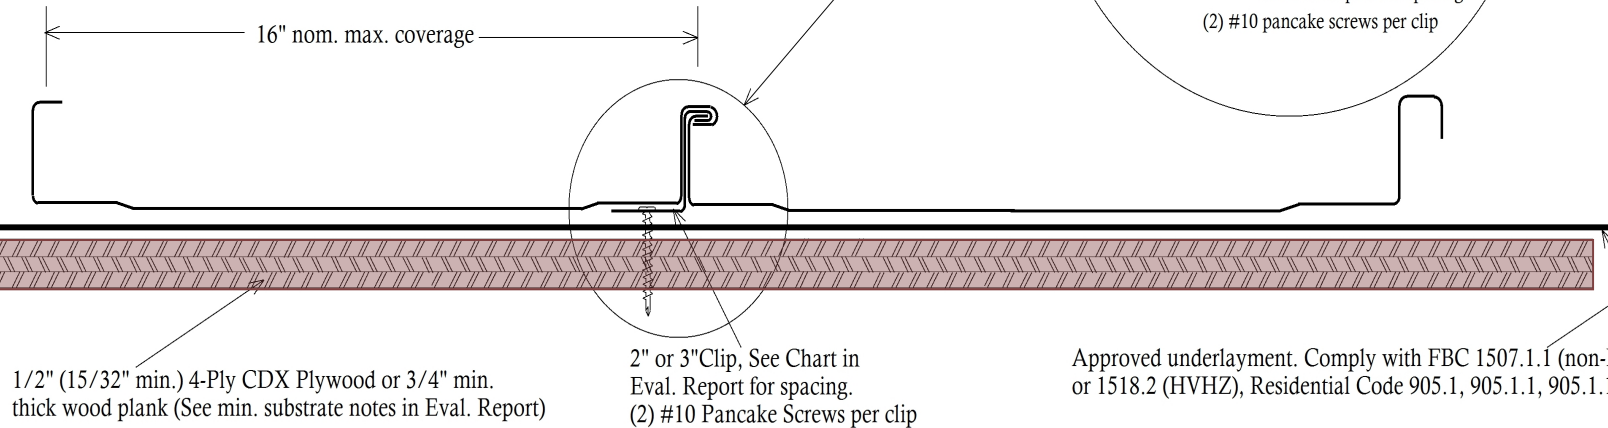


1/2" (15/32" min.) 4-Ply CDX Plywood or 3/4" min. thick wood plank (See min. substrate notes in Eval. Report)

2" or 3" Clip, See Chart in Eval. Report for spacing.
(2) #10 Pancake Screws per clip

Approved underlayment. Comply with FBC 1507.1.1 (non-HVHZ) or 1518.2 (HVHZ), Residential Code 905.1, 905.1.1, 905.1.1.1

FLPA# 47604.9-R1

DM CLASS 1500 Panel Profile

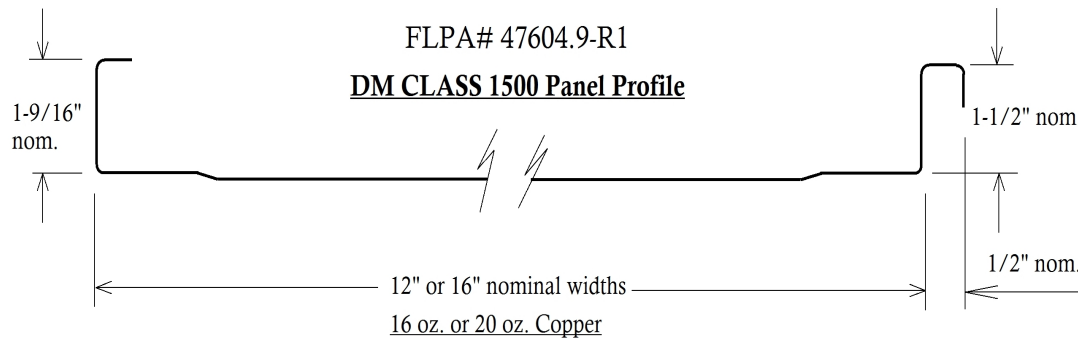

MAX. DESIGN PRESSURE
16 oz. Copper Tested FLPA# 47604.9-R1
APPROVED FOR USE IN HVHZ

Option #1, 2" Clips spaced 4" from ends,
16" o.c. max. = -149 psf


Option #2, 3" Clips spaced 4" from ends,
12" o.c. max. = -198.5 psf

GENERAL NOTES:

1. Roof slope is limited per the requirements of FBC Section 1507.4.2 or 1515.2. Residential Code 905.10.2
2. Design of substrate is by others and not a part of this approval. Perimeters and woodblocking should comply with (RAS 111 where applicable).
3. All panel system perimeters, penetrations, and transitions to be flashed and sealed per the requirements of DYME Metals' Installation Instructions and (RAS 133 where applicable).

SCOTT WOLTERS
FL PE# 62354

WOLTERS ENGINEERING
(COA# 27194)
15211 97TH ROAD N
WEST PALM BEACH, FL 33412
PH/FAX: (561) 225-1982



Digitally signed
by Scott Wolters
Date: 2025.09.07
10:06:03 -04'00'



DRAWN
RWM
CHECKED

DATE
8-28-25

SCALE
NTS