

INSTALLATION NOTES:

1.

ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION, UNLESS OTHERWISE SHOWN.
2.

THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION OF THE MAXIMUM SIZE LISTED.
3.

INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH NOT TO EXCEED THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
4.

SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
5.

**THROUGH FRAME:** FOR INSTALLATION INTO WOOD FRAMING USE **#10 WOOD SCREWS** OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
6.

**THROUGH FRAME:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE **#10 GR. 5 SELF TAPPING SCREWS** OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM PENETRATION OF 3 THREADS BEYOND METAL FRAME SUBSTRATE.
7.

**THROUGH FRAME:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE **3/16" DIAMETER ITW TAPCONS** OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4" MINIMUM EMBEDMENT.
8.

CLIPS SHALL BE FASTENED TO THE WINDOW FRAME WITH (1) **#8 X 3/4" SCREWS**. CLIPS ARE 18 GAUGE (0.0478" THICKNESS) F<sub>y</sub>=33 KSI MIN STEEL WITH OVERALL DIMENSIONS OF 1" WIDE, 4.327" ALONG THE LONG LEG, AND 0.246" ALONG THE SHORT LEG.
9.

**CLIP ANCHOR:** FOR INSTALLATION INTO WOOD FRAMING USE (1) **#10 WOOD SCREW** PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
10.

**CLIP ANCHOR:** FOR INSTALLATION INTO METAL STUD USE (1) **#10 GR. 5 SELF-TAPPING SCREW** PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM PENETRATION OF 3 THREADS BEYOND THE METAL STRUCTURE.
11.

**CLIP ANCHOR:** FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE (1) **3/16" DIAMETER ITW TAPCON** PER CLIP OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4" MINIMUM EMBEDMENT.
12.

**NAIL FIN:** FOR INSTALLATION INTO WOOD FRAMING USE **#8 WOOD SCREWS** OR USE **2 1/2" ROOFING NAILS** PER LOCATION OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2" MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
13.

**NAIL FIN:** FOR INSTALLATION INTO METAL STUD OR APPROVED MULLION USE **#8 GR. 5 SELF TAPPING SCREWS** OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM PENETRATION OF 3 THREADS BEYOND METAL FRAME SUBSTRATE.
14.

MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
15.

INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:

• FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).

• CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).

16.

FOR GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION NOTES (CONTINUED):
17.

INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

18.

INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:

A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.

B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.

C. GROUT- FILLED CMU-UNIT STRENGTH CONFORMS TO ASTM C-90 WITH MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI AND GROUT CONFORMS TO ASTM C 476, MINIMUM GROUT COMPRESSIVE STRENGTH OF 2000 PSI.

D. STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.

E. ALUMINUM - MINIMUM ALLOY 6063-T5. MINIMUM WALL THICKNESS OF 1/8" (0.125").
- GENERAL NOTES:
1.

THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:

• AAMA/WDMA/CSA 101/I.S.2/A440-22

• ASTM E330-14

2.

ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.

3.

1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.

4.

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT IN NON-HVHZ AREAS.

5.

APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT.

6.

WINDOW FRAME MATERIAL: VINYL  
REINFORCEMENT MATERIAL: ALUMINUM 6063-T6

7.

GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 7 FOR GLAZING DETAIL.
- | TABLE OF CONTENTS |                                                              |
|-------------------|--------------------------------------------------------------|
| SHEET             | SHEET DESCRIPTION                                            |
| 1                 | INSTALLATION AND GENERAL NOTES                               |
| 2                 | ELEVATIONS AND ANCHOR LAYOUTS                                |
| 3                 | ELEVATIONS AND ANCHOR LAYOUTS                                |
| 4                 | VERTICAL AND HORIZONTAL SECTIONS - NAIL FIN                  |
| 5                 | VERTICAL AND HORIZONTAL SECTIONS - THROUGH FRAME             |
| 6                 | VERTICAL AND HORIZONTAL SECTIONS - CLIP                      |
| 7                 | GLAZING DETAIL, OPTIONAL FLUSH FINs, AND MEETING RAIL DETAIL |
- | DESIGN PRESSURE TABLE |        |                 |                            |               |                                 |                       |
|-----------------------|--------|-----------------|----------------------------|---------------|---------------------------------|-----------------------|
| TYP. OVERALL SIZE     |        | DESIGN PRESSURE | REINFORCEMENT LOCATION     | CONFIGURATION | INSTALLATION METHOD             | MISSILE IMPACT RATING |
| WIDTH                 | HEIGHT |                 |                            |               |                                 |                       |
| 35.5"                 | 71.5"  | +40/-40 PSF     | MEETING RAIL               | "X/X"         | THROUGH FRAME, NAIL FIN, & CLIP | NON-IMPACT            |
| 47.5"                 | 83.5"  | +50/-50 PSF     | MEETING RAIL & SASH STILES | "X/X"         | THROUGH FRAME, NAIL FIN, & CLIP |                       |
- 
- WINDSOR WINDOWS & DOORS
- 900 S. 19TH STREET.  
WEST DES MOINES, IA 50265  
PH: (515)223-6660 FAX: (515)224-1938
- TITLE:

NEXT DIMENSION  
DOUBLE HUNG WINDOW  
(NON-HVHZ)(NON-IMPACT)

PREPARED BY:

BUILDING DROPS, INC.  
1900 NE MIAMI CT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com
- | REMARKS         | BY | DATE  |
|-----------------|----|-------|
| 2026 FBC UPDATE | LS | 06/26 |
|                 |    |       |
|                 |    |       |
|                 |    |       |
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- Digitally signed by Hermes F. Norero, P.E.  
Reason: I am approving this document  
Date: 2026.09.21 16:21:41 -0400'
- 
- FL47662
- DATE:

05.20.24

DWG. BY:

RN

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

WWD072

SHEET:


1

REV.

A


OF

7

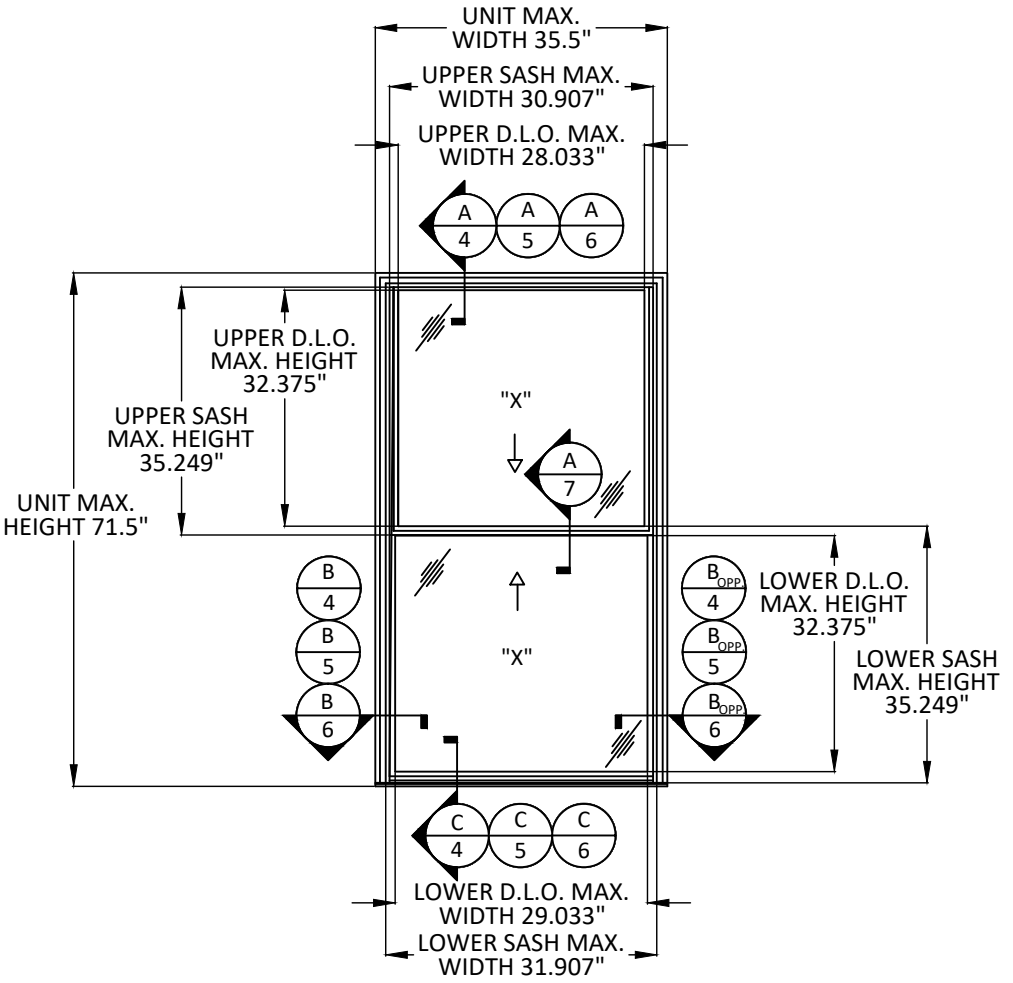


**TYPICAL ELEVATION**

DOUBLE HUNG EQUAL

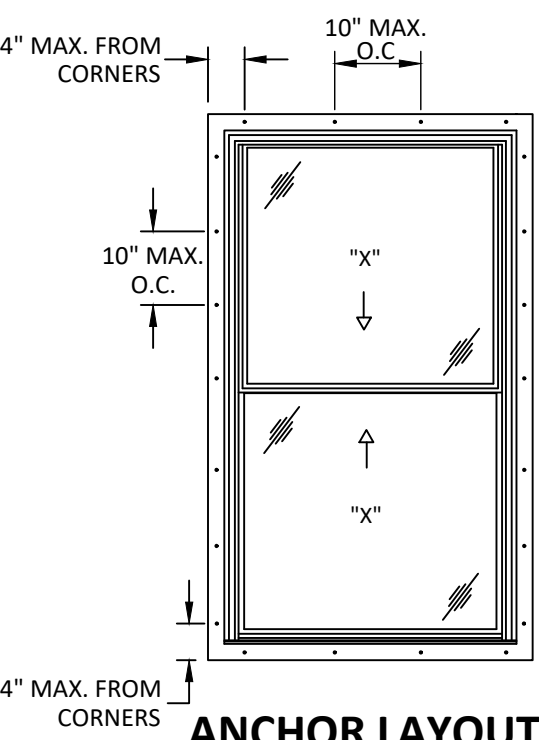


**ANCHOR LAYOUT**

NAILFIN INSTALLATION

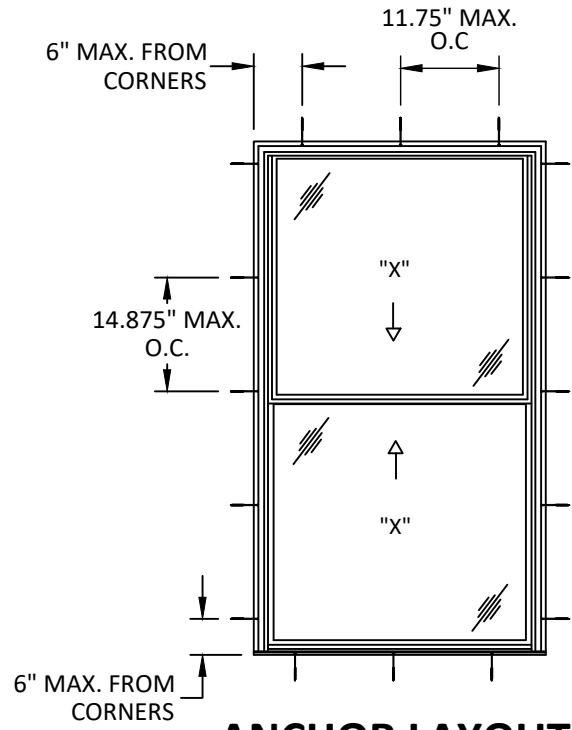

**ANCHOR LAYOUT**

THROUGH FRAME INSTALLATION

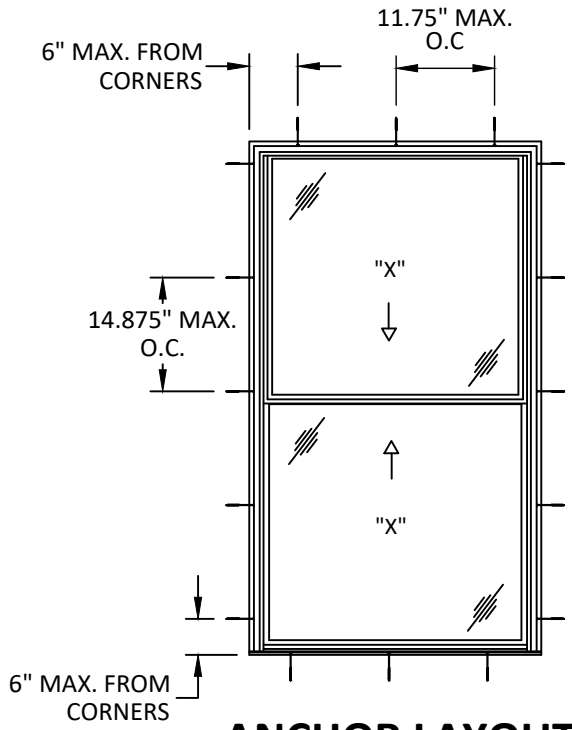

**ANCHOR LAYOUT**

CLIP INSTALLATION



**WINDSOR WINDOWS & DOORS**

900 S. 19TH STREET.  
WEST DES MOINES, IA 50265  
PH: (515)223-6660 FAX: (515)224-1938


TITLE: NEXT DIMENSION  
DOUBLE HUNG WINDOW  
(NON-HVHZ)(NON-IMPACT)  
ELEVATIONS AND ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.  
1900 NE MIAMI CT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



| REMARKS         | BY | DATE  |
|-----------------|----|-------|
| 2026 FBC UPDATE | LS | 06/26 |
|                 |    |       |
|                 |    |       |
|                 |    |       |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

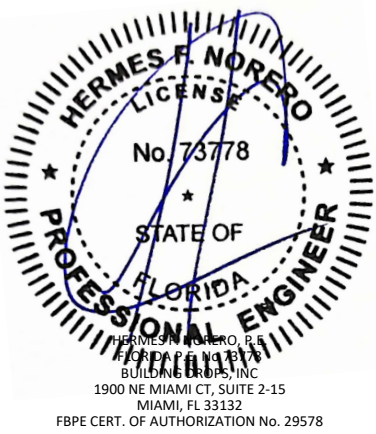


**FL47662**

|          |          |
|----------|----------|
| DATE:    | 05.20.24 |
| DWG. BY: | RN       |
| CHK. BY: | HFN      |
| SCALE:   | NTS      |
| DWG. #:  | WWD072   |
| SHEET:   | 2        |


REV. A

OF 7

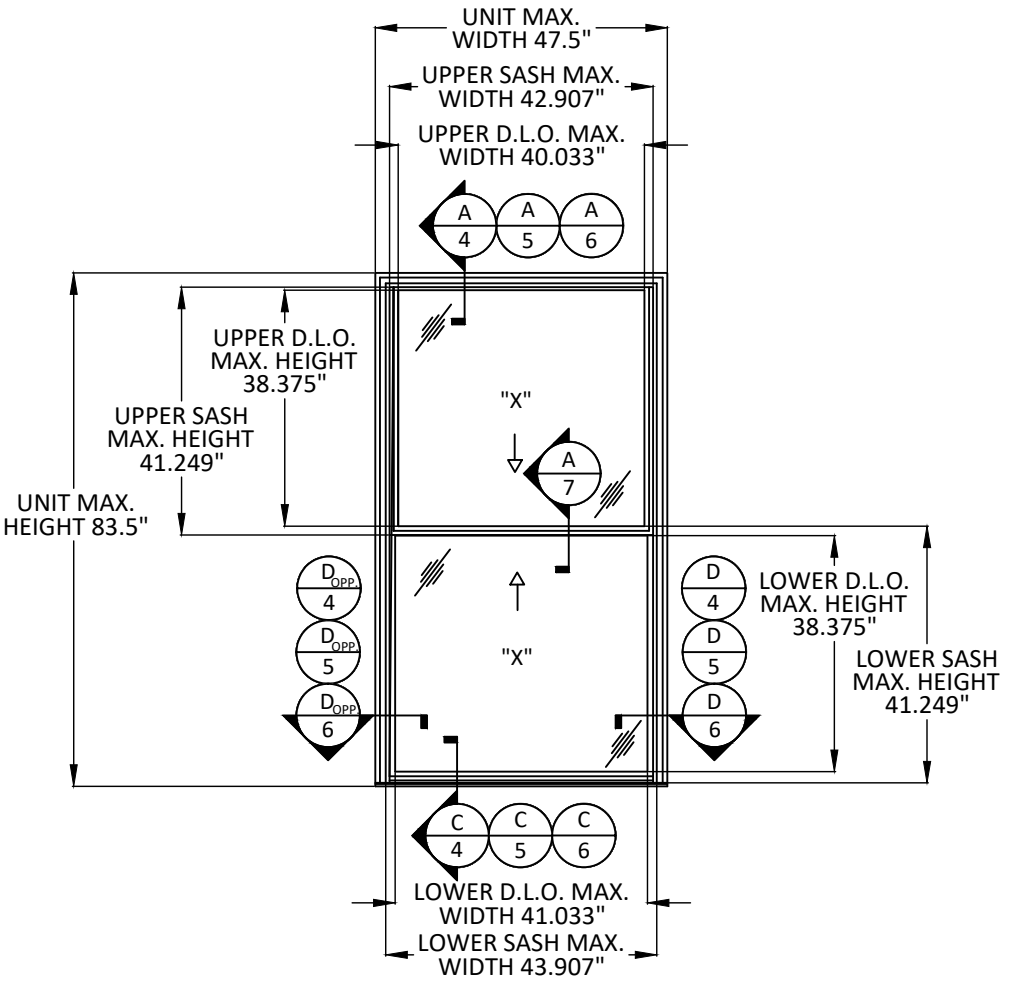


**TYPICAL ELEVATION**

DOUBLE HUNG EQUAL

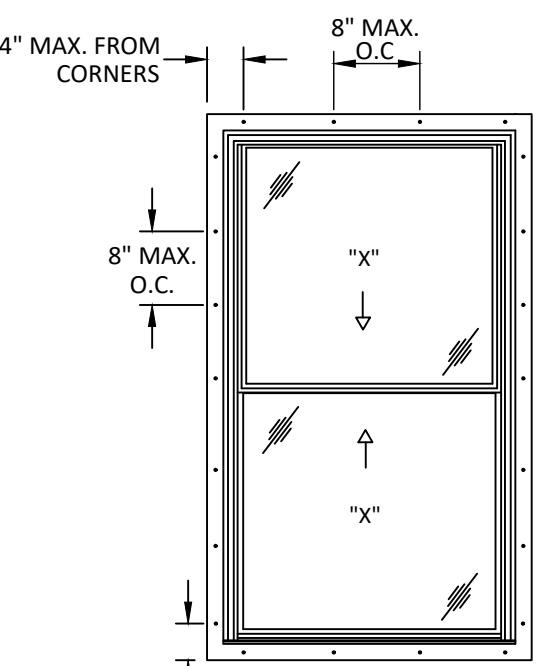


**ANCHOR LAYOUT**

NAILFIN INSTALLATION

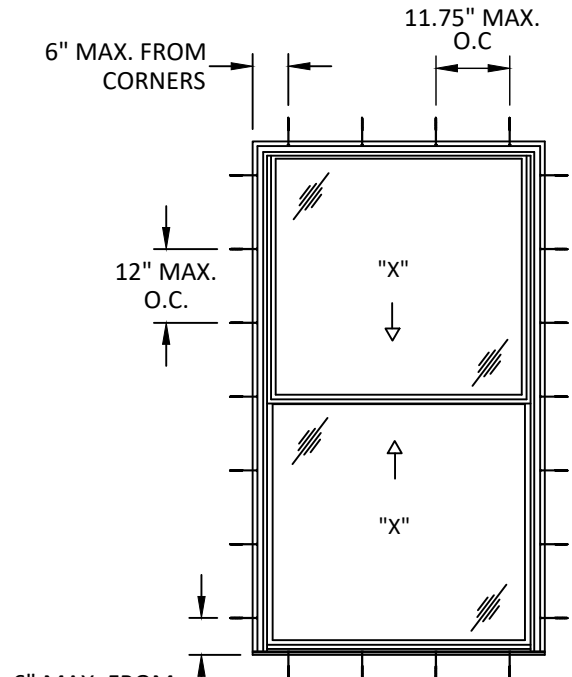

**ANCHOR LAYOUT**

THROUGH FRAME INSTALLATION

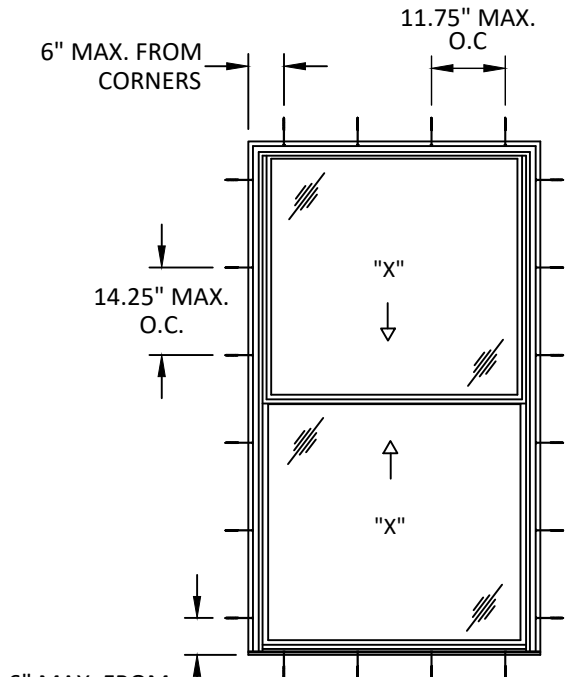

**ANCHOR LAYOUT**

CLIP INSTALLATION



**WINDSOR WINDOWS & DOORS**

900 S. 19TH STREET.  
WEST DES MOINES, IA 50265  
PH: (515)223-6660 FAX: (515)224-1938


TITLE: NEXT DIMENSION  
DOUBLE HUNG WINDOW  
(NON-HVHZ)(NON-IMPACT)  
ELEVATIONS AND ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.  
1900 NE MIAMI CT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



| REMARKS         | BY | DATE  |
|-----------------|----|-------|
| 2026 FBC UPDATE | LS | 06/26 |
|                 |    |       |
|                 |    |       |
|                 |    |       |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

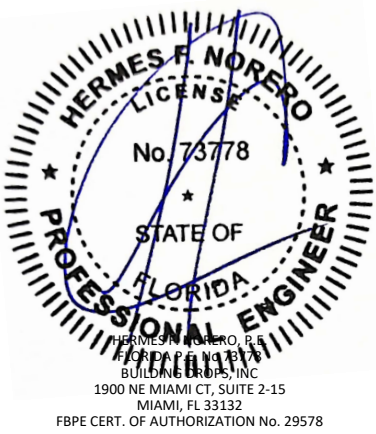

**FL47662**

|          |          |
|----------|----------|
| DATE:    | 05.20.24 |
| DWG. BY: | CHK. BY: |
| RN       | HFN      |
| SCALE:   | NTS      |
| DWG. #:  | WWD072   |
| SHEET:   | REV.     |

3 OF 7  
A

TITLE: NEXT DIMENSION  
DOUBLE HUNG WINDOW  
(NON-HVHZ)(NON-IMPACT)  
VERTICAL AND HORIZONTAL  
SECTIONS - NAIL FIN

PREPARED BY:  
**BUILDING DROPS, INC.**  
1900 NE MIAMI CT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



| REMARKS         | BY | DATE  |
|-----------------|----|-------|
| 2026 FBC UPDATE | LS | 06/26 |
|                 |    |       |
|                 |    |       |
|                 |    |       |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.



**FL47662**

DATE: **05.20.24**


DWG. BY: **RN**      CHK. BY: **HFN**

SCALE: **NTS**


DWG. #: **WWD072**

SHEET: **4**      REV. **A**


OF 7

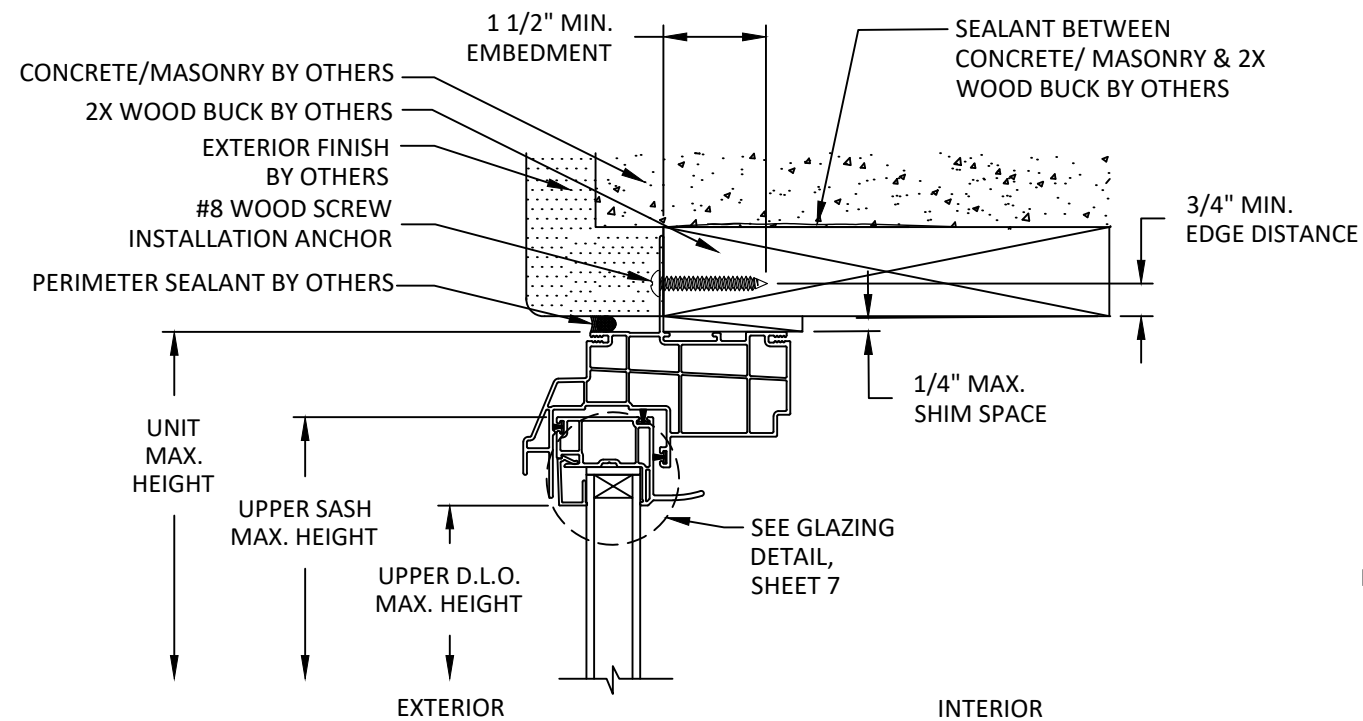


**A**  
**4** **VERTICAL SECTION**  
NAIL FIN INSTALLATION  
WOOD BUCK

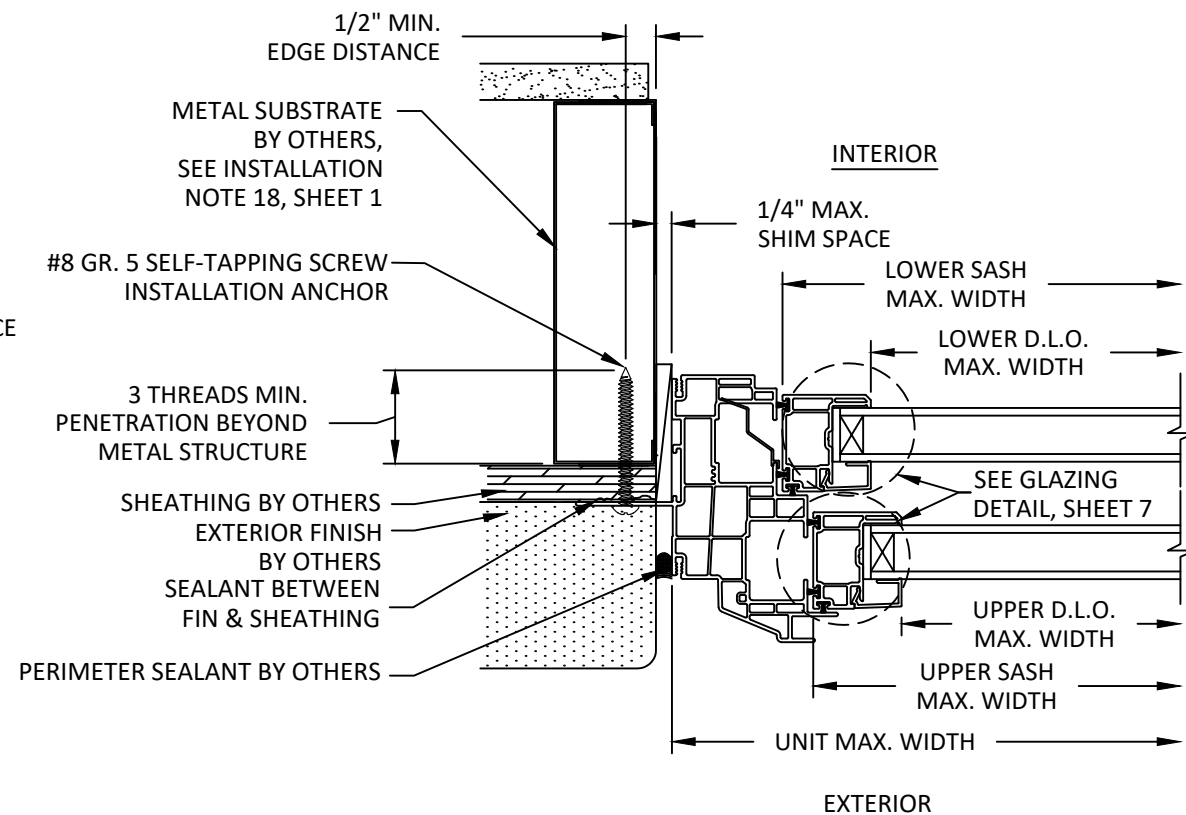

**B**  
**4** **HORIZONTAL SECTION**  
NAIL FIN INSTALLATION  
METAL STUD

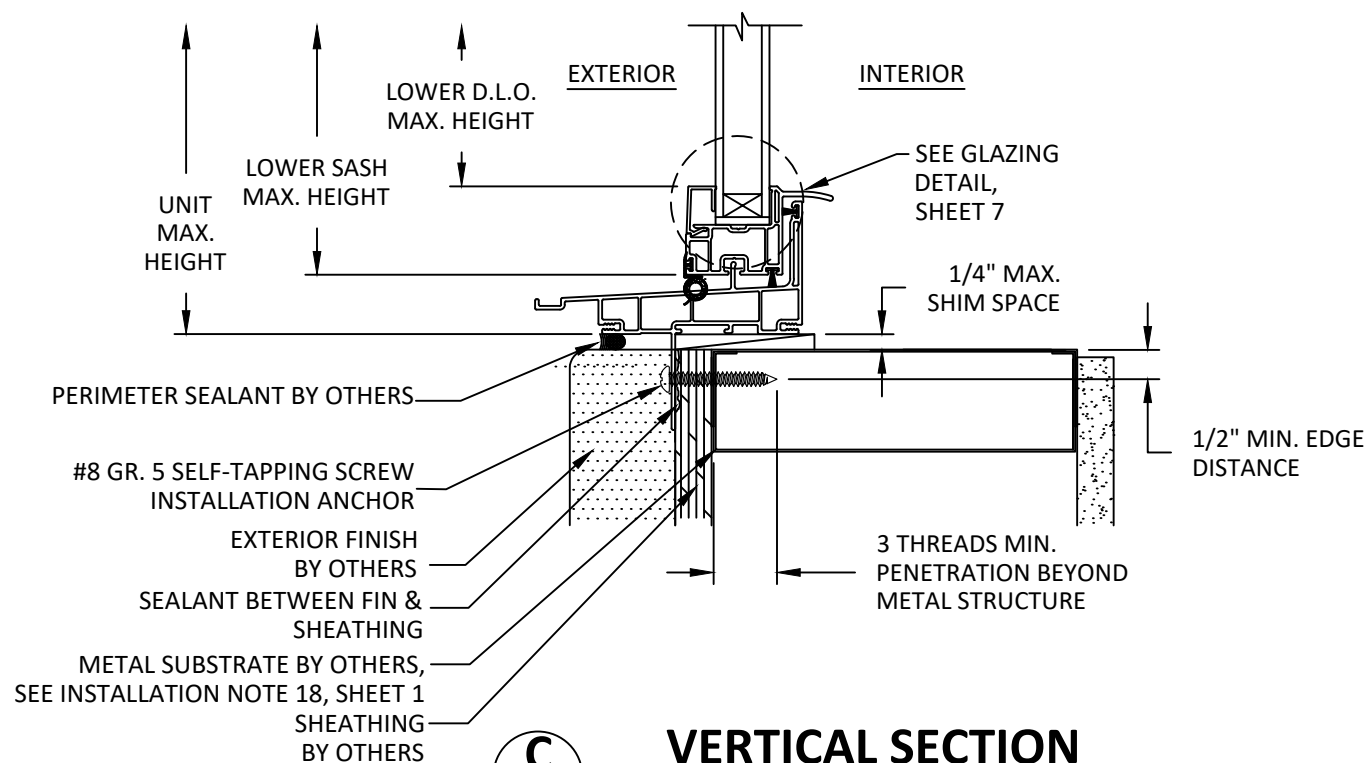

**C**  
**4** **VERTICAL SECTION**  
NAIL FIN INSTALLATION  
METAL STUD

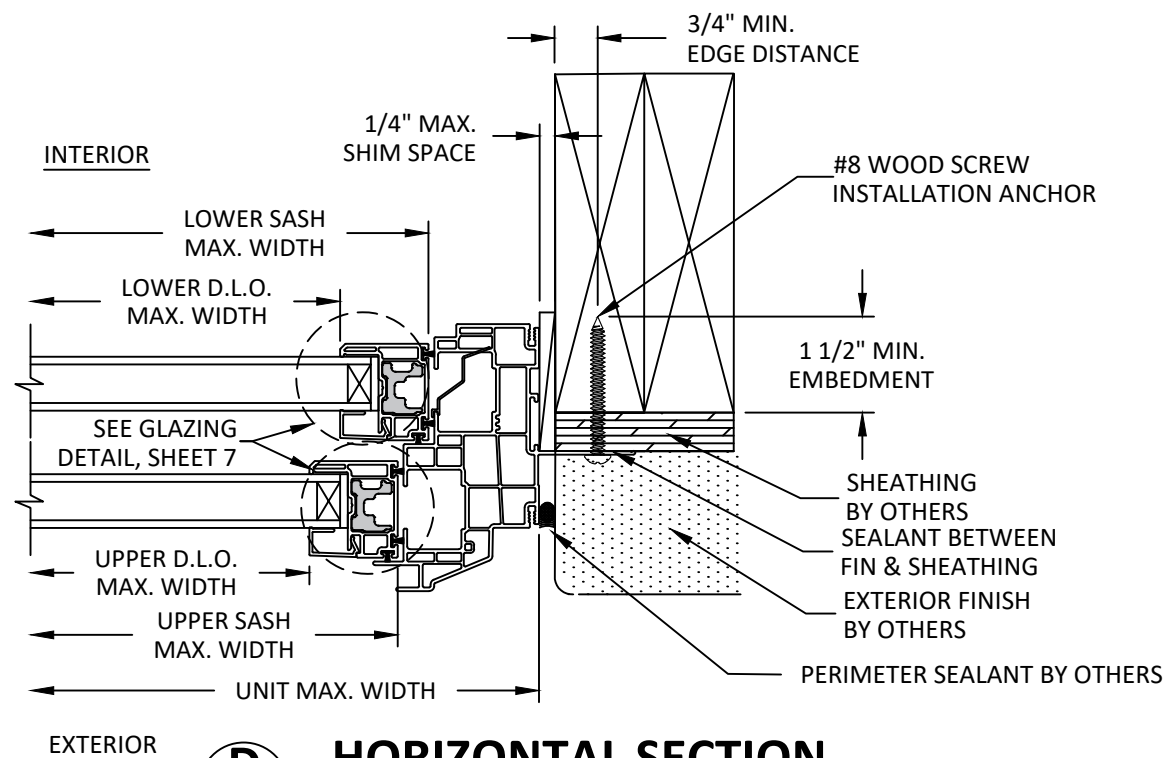

**D**  
**4** **HORIZONTAL SECTION**  
NAIL FIN INSTALLATION  
WOOD BUCK


TITLE:  
NEXT DIMENSION  
DOUBLE HUNG WINDOW  
(NON-HVHZ)(NON-IMPACT)  
VERTICAL AND HORIZONTAL  
SECTIONS - THROUGH FRAME

PREPARED BY:  
**BUILDING DROPS, INC.**  
1900 NE MIAMI CT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



| REMARKS         | BY | DATE  |
|-----------------|----|-------|
| 2026 FBC UPDATE | LS | 06/26 |
|                 |    |       |
|                 |    |       |
|                 |    |       |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

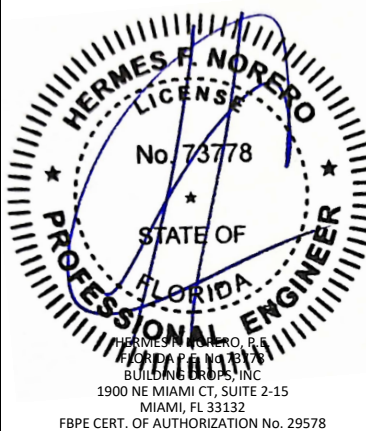

**FL47662**

DATE: **05.20.24**


|           |            |
|-----------|------------|
| DWG. BY:  | CHK. BY:   |
| <b>RN</b> | <b>HFN</b> |

SCALE: **NTS**


DWG. #: **WWD072**

|          |          |
|----------|----------|
| SHEET:   | REV.     |
| <b>5</b> | <b>A</b> |

OF 7

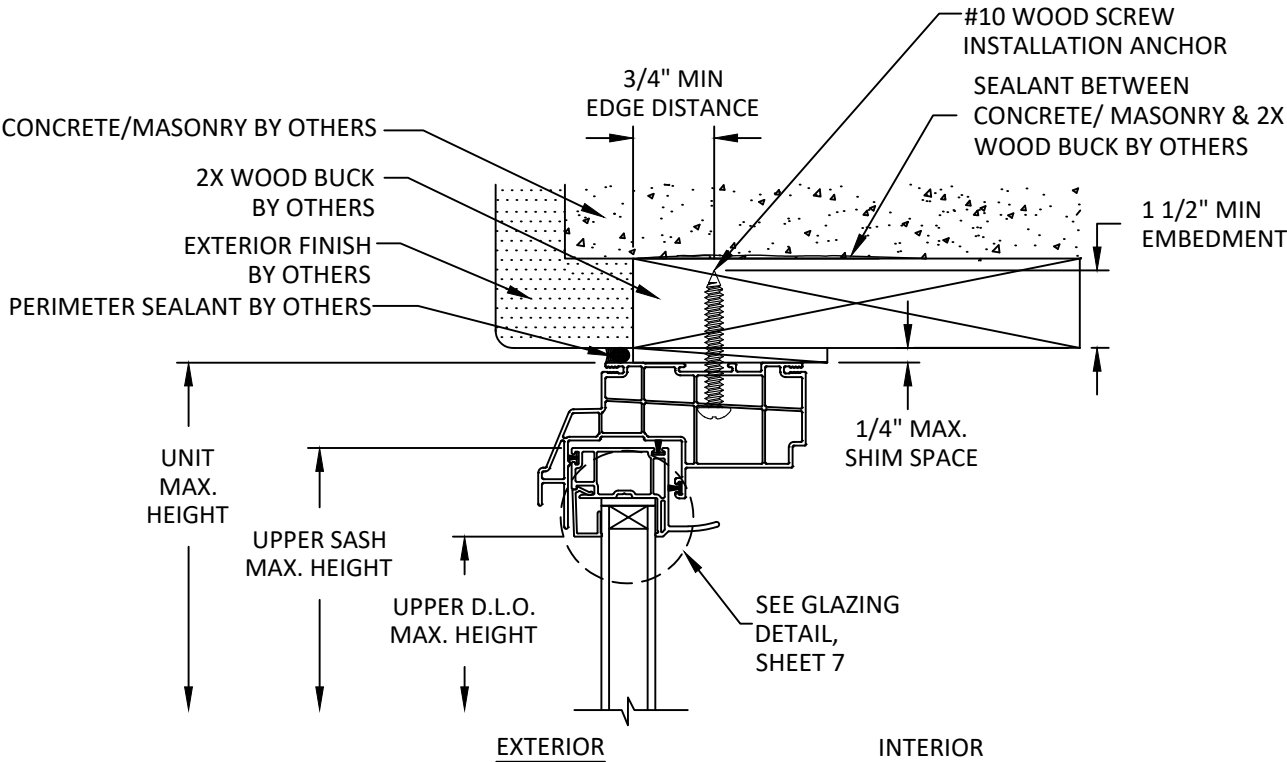


**A**  
**5**  
**VERTICAL SECTION**  
THROUGH FRAME INSTALLATION  
WOOD BUCK

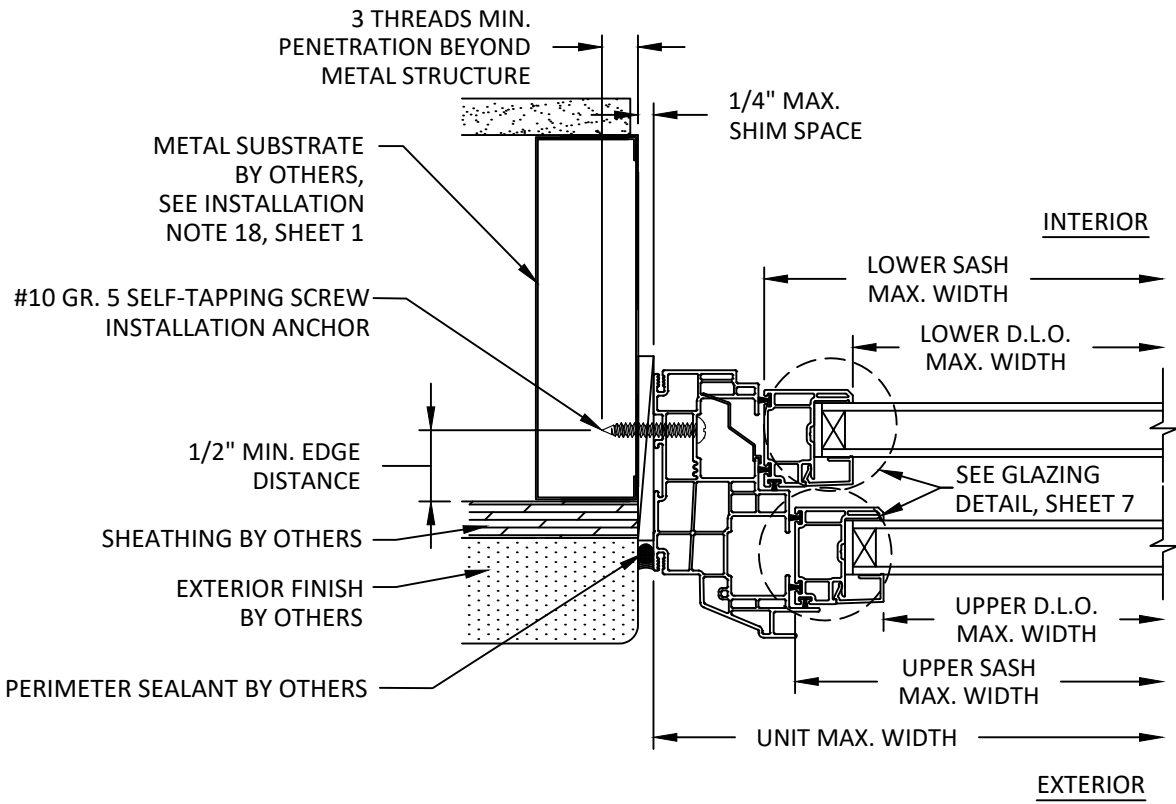


**B**  
**5**  
**HORIZONTAL SECTION**  
THROUGH FRAME INSTALLATION  
METAL STUD

SEE SHEET 7 FOR OPTIONAL  
FLUSH NAIL FINIS AND  
INSTALLATION REQUIREMENTS

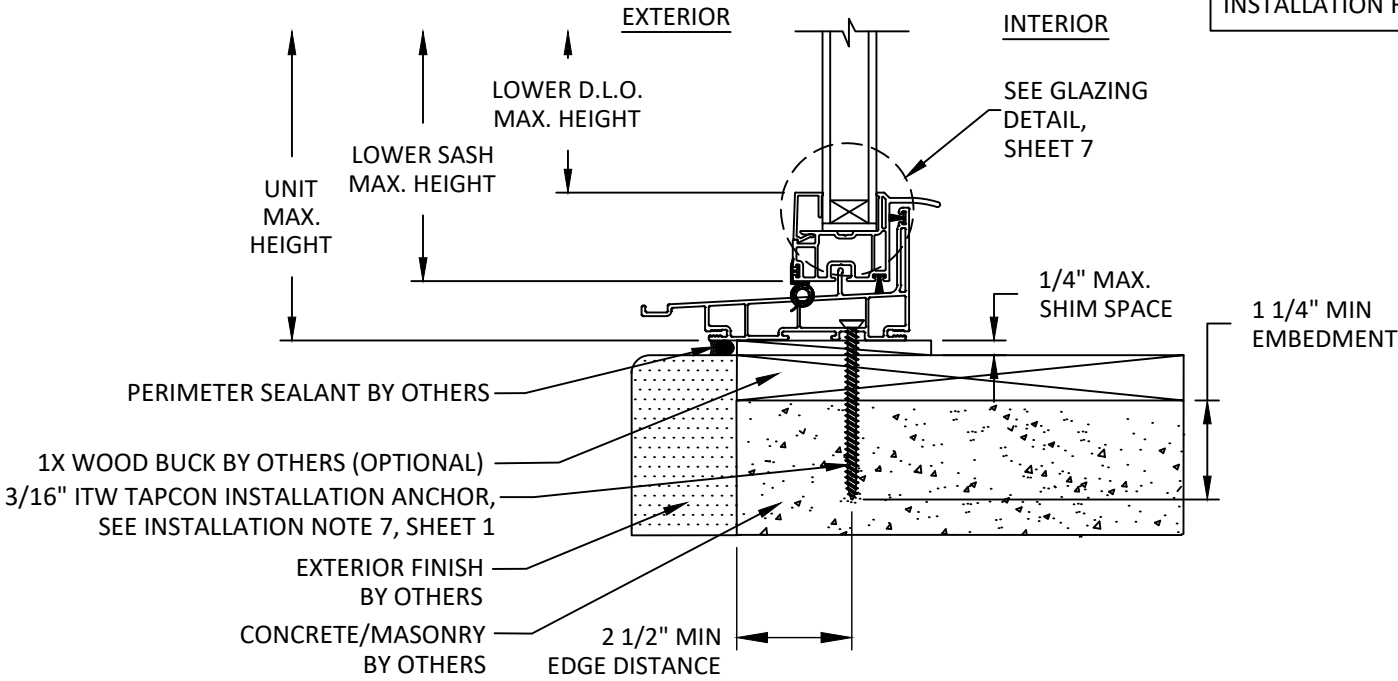

**C**  
**5**  
**VERTICAL SECTION**  
THROUGH FRAME INSTALLATION  
CONCRETE/CMU

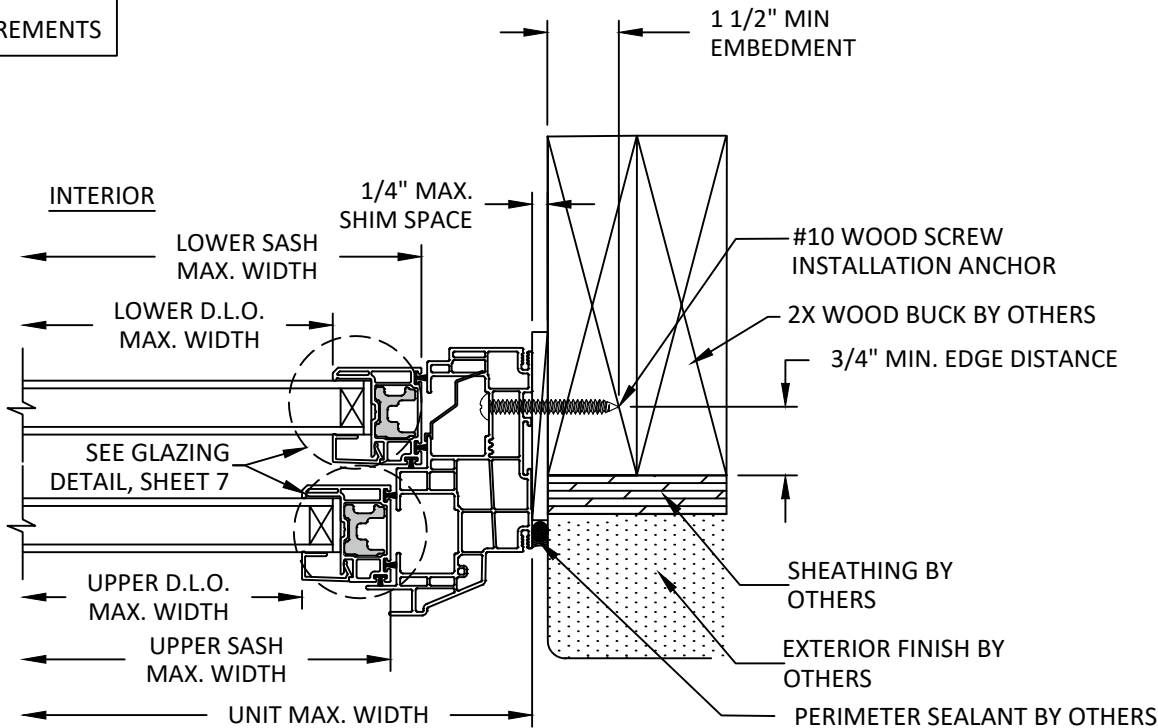

**D**  
**5**  
**HORIZONTAL SECTION**  
THROUGH FRAME INSTALLATION  
WOOD BUCK


TITLE: NEXT DIMENSION  
DOUBLE HUNG WINDOW  
(NON-HVHZ)(NON-IMPACT)  
VERTICAL AND HORIZONTAL  
SECTIONS - CLIP

PREPARED BY:  
**BUILDING DROPS, INC.**  
1900 NE MIAMI CT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



| REMARKS         | BY | DATE  |
|-----------------|----|-------|
| 2026 FBC UPDATE | LS | 06/26 |
|                 |    |       |
|                 |    |       |
|                 |    |       |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

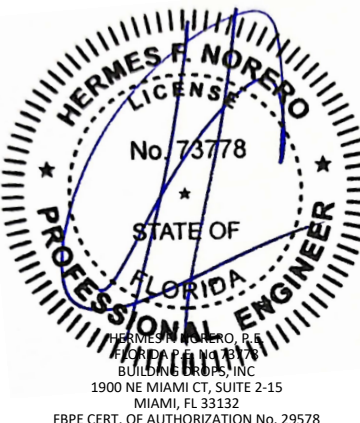


**FL47662**

|          |          |
|----------|----------|
| DATE:    | 05.20.24 |
| DWG. BY: | CHK. BY: |
| RN       | HFN      |
| SCALE:   | NTS      |
| DWG. #:  | WWD072   |
| SHEET:   | REV.     |


6

A

OF 7

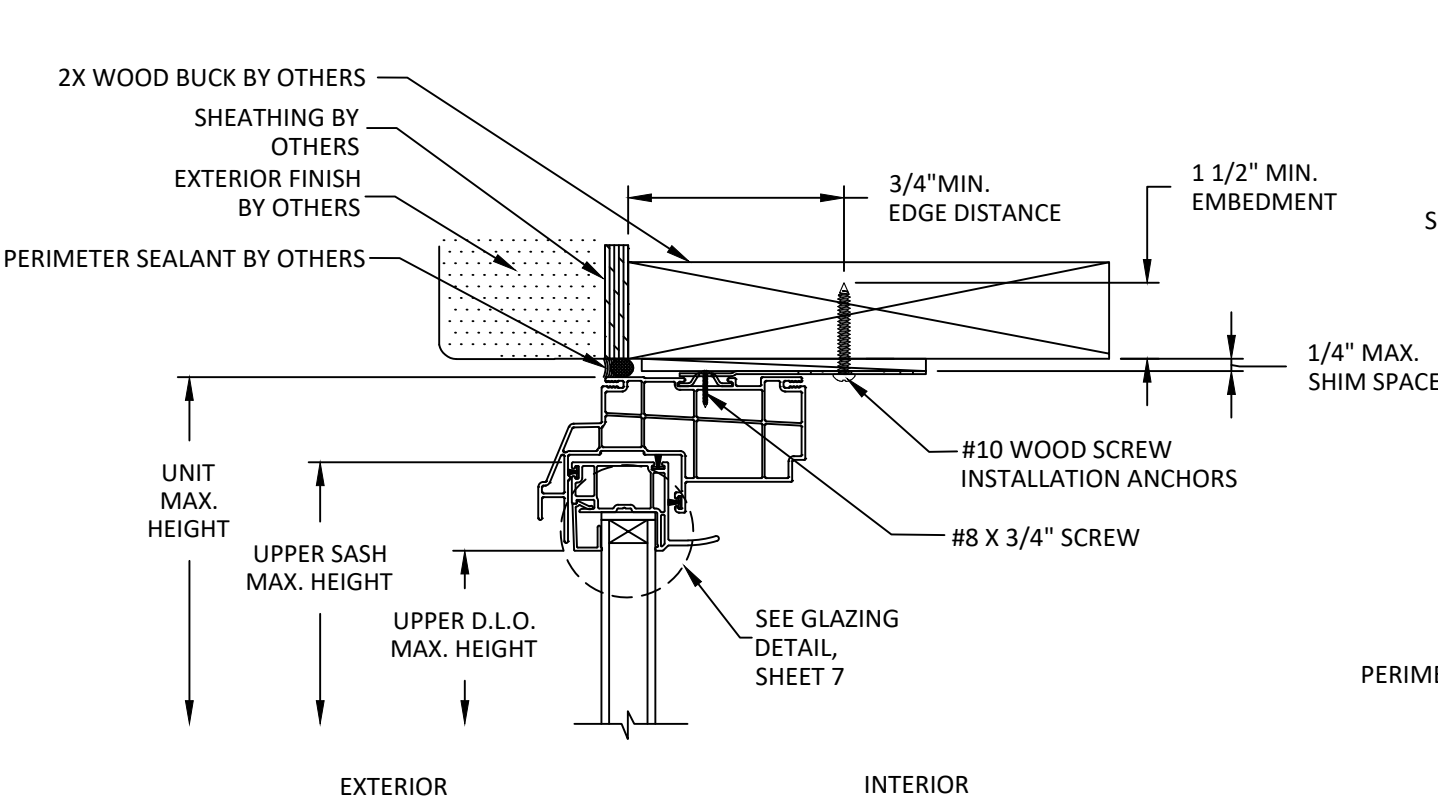


**A**  
**6**  
**VERTICAL SECTION**  
CLIP INSTALLATION  
WOOD BUCK

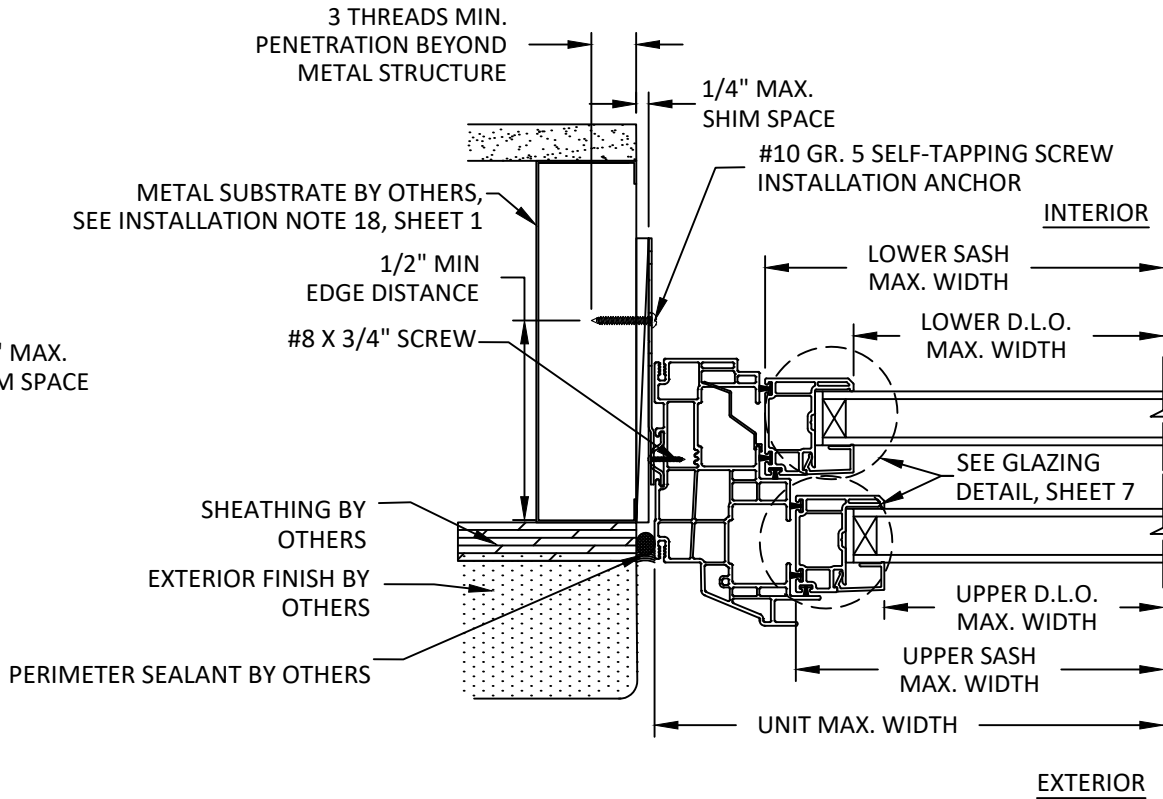


**B**  
**6**  
**HORIZONTAL SECTION**  
CLIP INSTALLATION  
METAL STUD

SEE SHEET 7 FOR OPTIONAL  
FLUSH NAIL FINS AND  
INSTALLATION REQUIREMENTS

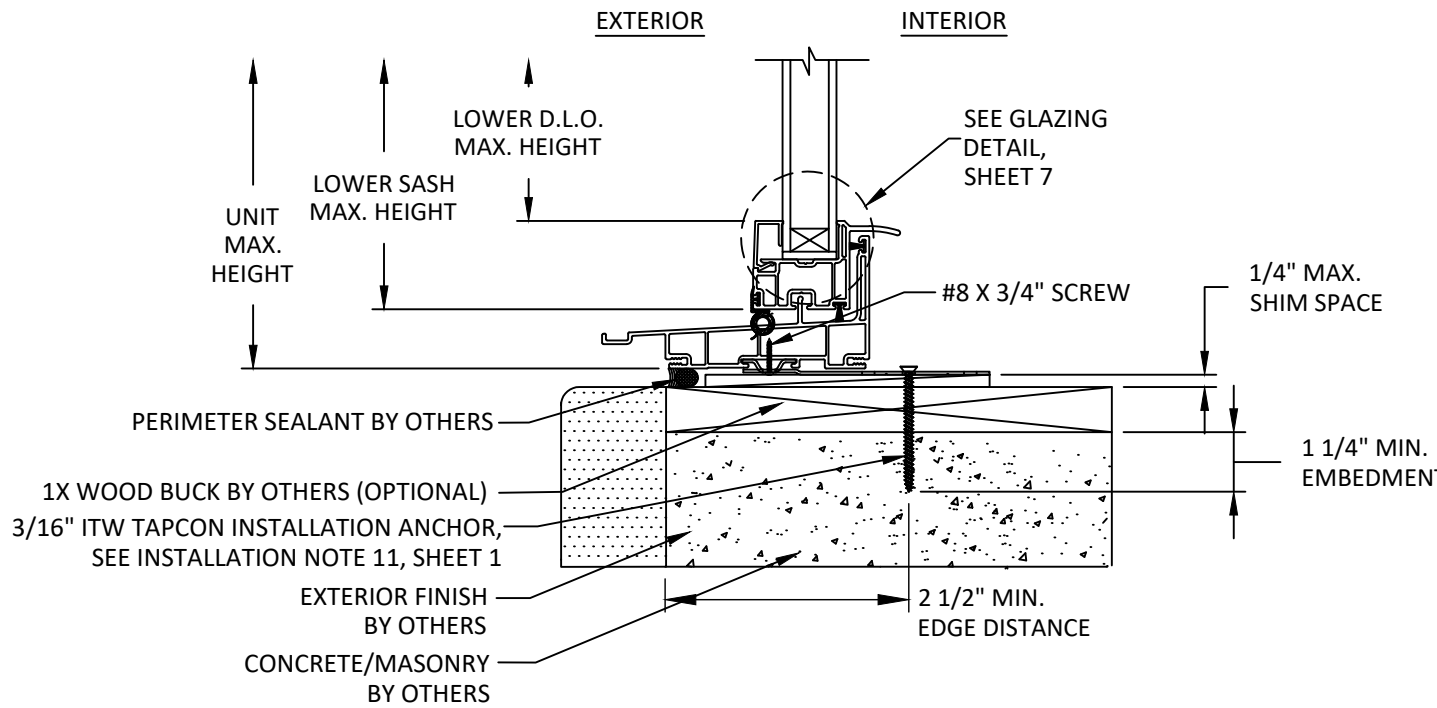

**C**  
**6**  
**VERTICAL SECTION**  
CLIP INSTALLATION  
CONCRETE/CMU

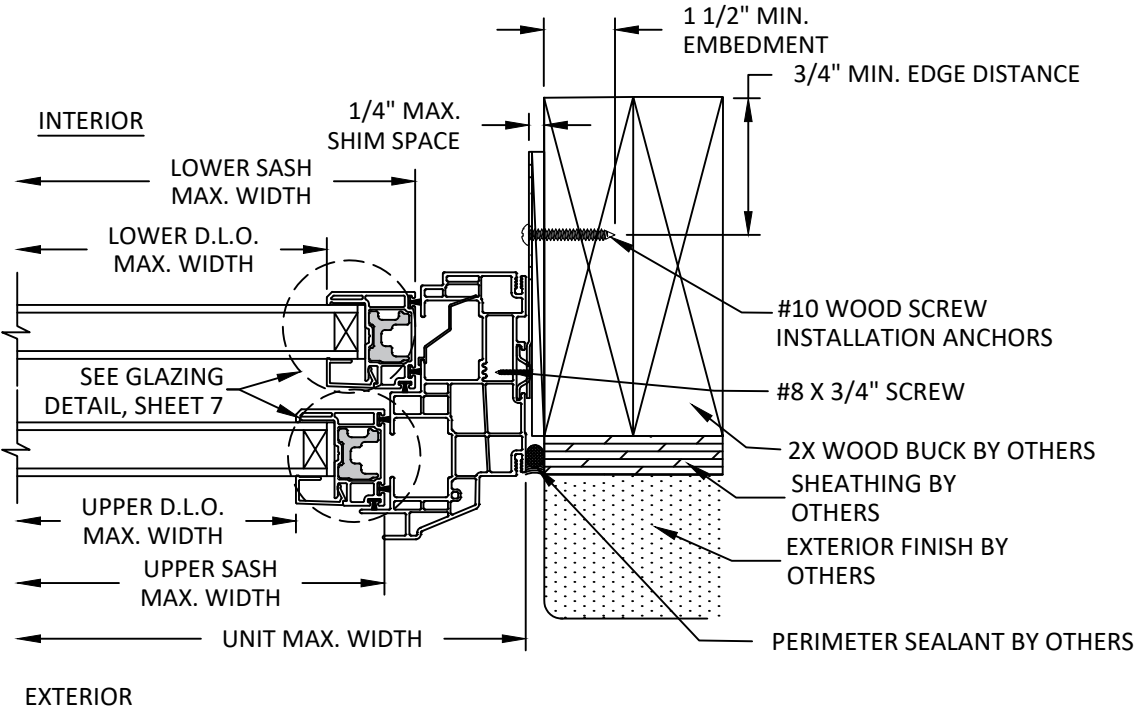

**D**  
**6**  
**HORIZONTAL SECTION**  
CLIP INSTALLATION  
WOOD BUCK


TITLE: NEXT DIMENSION  
DOUBLE HUNG WINDOW  
(NON-HVHZ)(NON-IMPACT)  
GLAZING DETAIL, OPTIONAL FLUSH FINS,  
AND MEETING RAIL DETAIL

PREPARED BY: **BUILDING DROPS, INC.**  
1900 NE MIAMI CT, SUITE 2-15  
MIAMI, FL 33132  
PH: (954)399-8478  
FAX: (954)744-4738  
WEB: www.buildingdrops.com



| REMARKS         | BY | DATE  |
|-----------------|----|-------|
| 2026 FBC UPDATE | LS | 06/26 |
|                 |    |       |
|                 |    |       |
|                 |    |       |

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC  
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC  
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE  
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED  
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC  
DOCUMENTS FOR USE WITH THIS DOCUMENT.

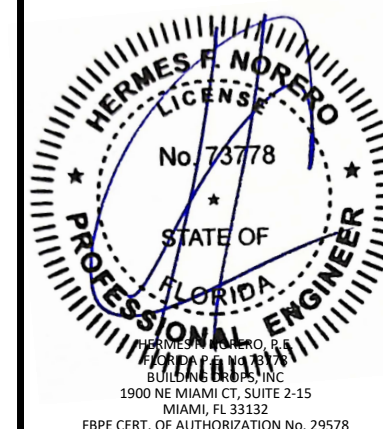

**FL47662**

DATE: **05.20.24**


DWG. BY: **RN**      CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **WWD072**

SHEET: **7**      REV. **A**  
**OF 7**


## OPTIONAL FLUSH FINS

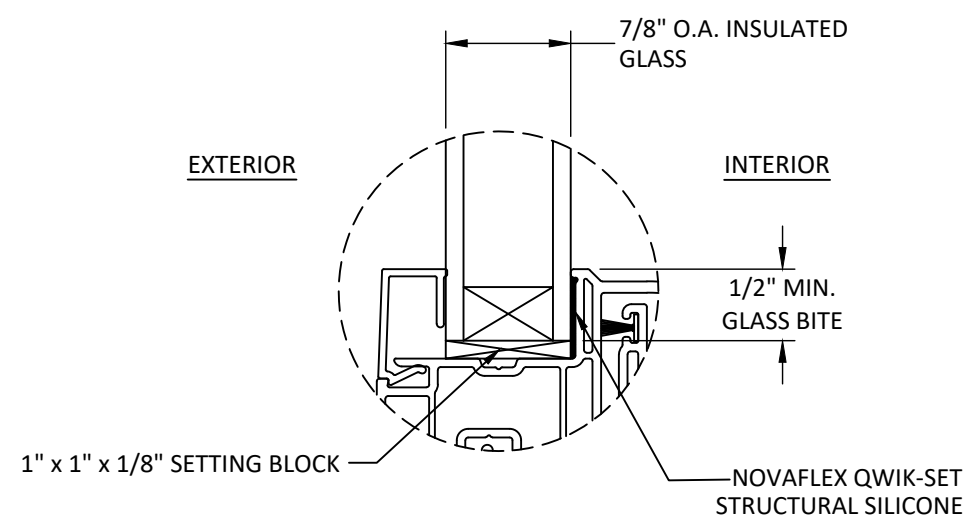


### GLAZING DETAIL

#### GLAZING NOTES:


- GLASS TYPE AND THICKNESS SHALL COMPLY WITH ASTM E1300 REQUIREMENTS AS WELL AS APPLICABLE SAFETY GLAZING REQUIREMENTS PER THE FBC. TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- DESIGN PRESSURES MAY NOT EXCEED MAX VALUES IN DESIGN PRESSURE TABLE ON SHEET 1.

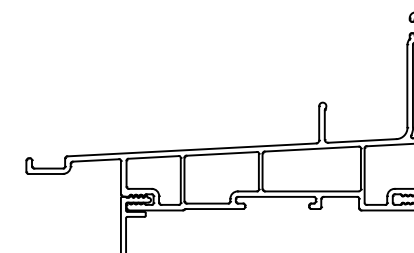

### 1/2" FLUSH FIN

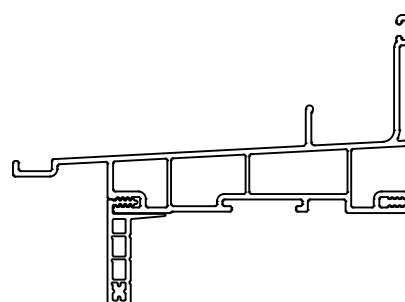


### 1" FLUSH FIN

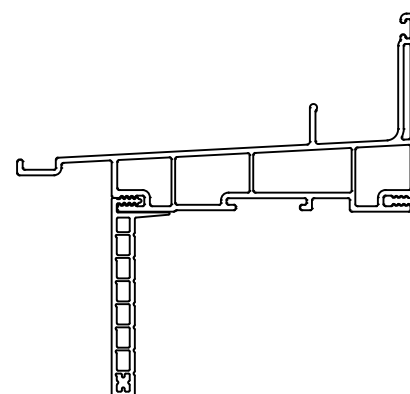

### 2" FLUSH FIN

#### FLUSH FIN NOTES:

- FLUSH FIN OPTIONS ARE NON-STRUCTURAL AND TO BE USED FOR SEALING PURPOSES ONLY.
- WINDOW FRAMES USING OPTIONAL FLUSH FINS SHALL BE INSTALLED USING THE THROUGH FRAME OR CLIP INSTALLATION METHOD.
- SILL SHOWN, HEAD AND JAMBS QUALIFIED.

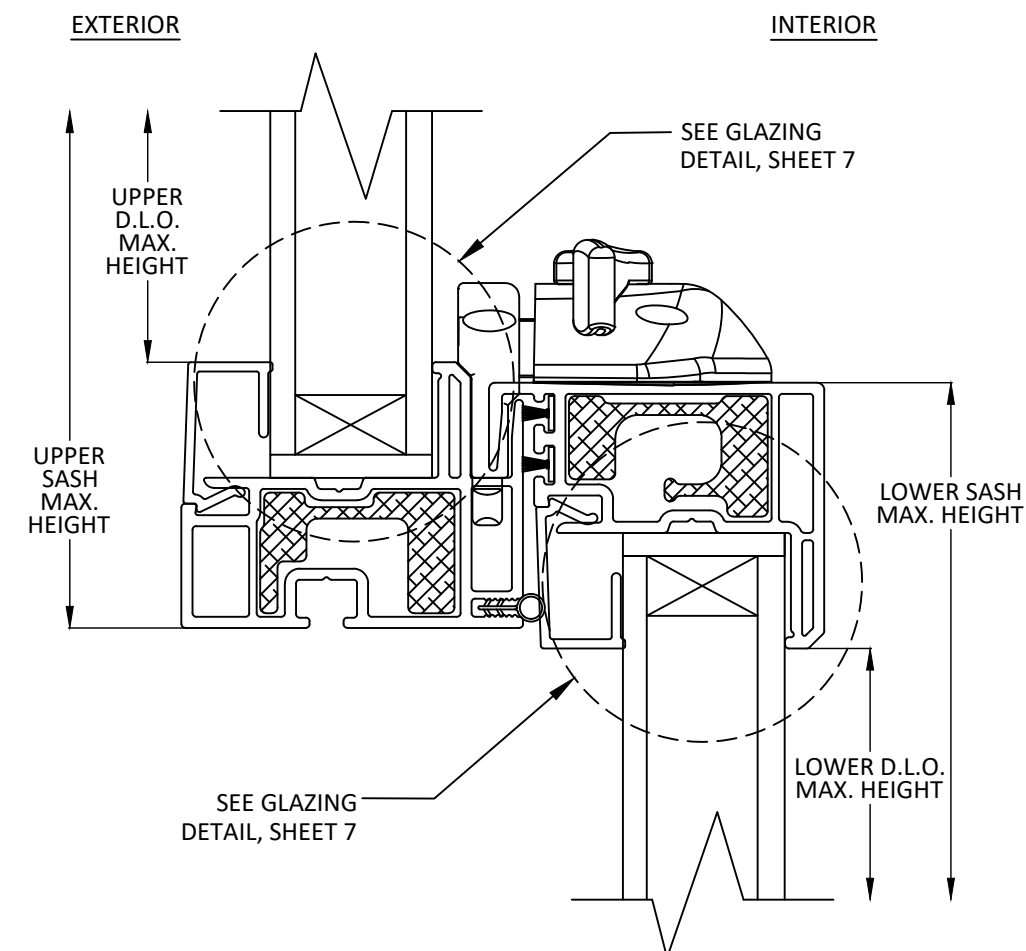

## VERTICAL SECTION

MEETING RAIL