

REILLY ARCHITECTURAL

W75 INSWING & OUTSWING DOOR

(WZ3)(IMPACT)

GENERAL NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
- ASTM E1886-19
 - ASTM E1996-20
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
 - AAMA/WDMA/CSA 101/I.S.2/A440-11/17
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
5. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
6. APPROVED IMPACT PROTECTIVE SYSTEM **IS NOT REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 3 OR LESS.
7. APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE IN WIND ZONE 4.
8. WINDOW FRAME MATERIAL: BRONZE, GALVANIZED STEEL, COR-TEN STEEL, OR STAINLESS STEEL.
9. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEETS 2-3 FOR GLAZING DETAILS.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES
2	GLAZING DETAILS
3	GLAZING DETAILS
4	ELEVATION & DESIGN PRESSURE TABLE
5	ELEVATION & DESIGN PRESSURE TABLE
6	ELEVATION
7	MULLION DESIGN PRESSURE TABLES
8	ANCHOR LAYOUT
9	ANCHOR LAYOUT
10	ANCHOR CAPACITY TABLES
11	ANCHOR CAPACITY TABLES
12	VERTICAL SECTIONS
13	VERTICAL SECTIONS
14	VERTICAL SECTIONS
15	HORIZONTAL SECTIONS
16	HORIZONTAL SECTIONS
17	HORIZONTAL SECTIONS
18	MULLION SECTIONS
19	ANCHOR DETAILS, ANCHOR SCHEDULE, & INSTALLATION NOTES
20	ANCHOR DETAILS
21	ANCHOR DETAILS
22	ANCHOR DETAILS
23	PROFILE OPTIONS
24	BILL OF MATERIALS & COMPONENTS
25	COMPONENTS
26	COMPONENTS

DESIGN PRESSURE RATING (PSF)			
WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	MISSILE IMPACT RATING
78.75" X 96"		+/- 60 PSF	LARGE & SMALL MISSILE IMPACT

REILLY ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com


TITLE: W75 INSWING & OUTSWING DOOR (WZ3) (IMPACT) GENERAL NOTES

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.08.15 17:26:27 -03'00'

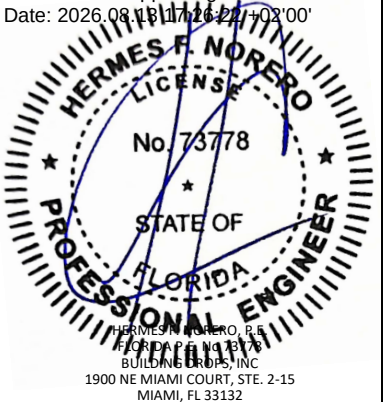

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL47695

DATE: **05.21.2025**

DWG. BY: JR

CHK. BY: HFN

SCALE: **NTS**






DWG. #: **RWD021**

SHEET:
1

REV.
A

OF 26

c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:27 PM

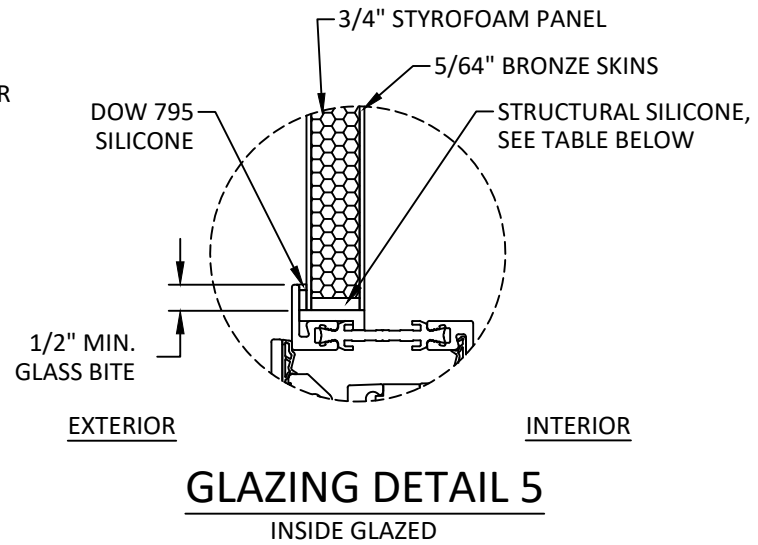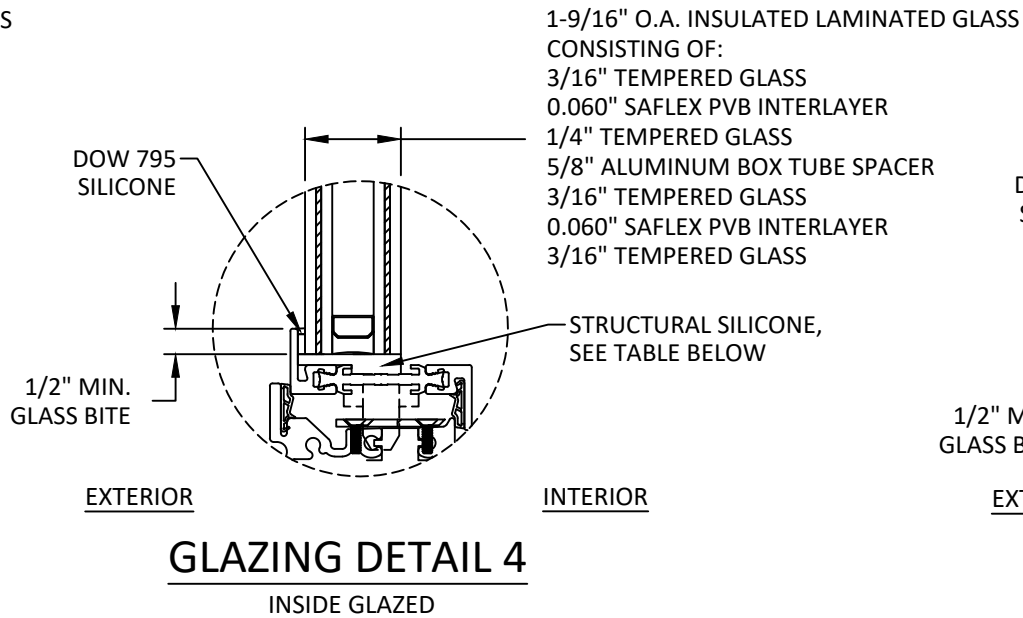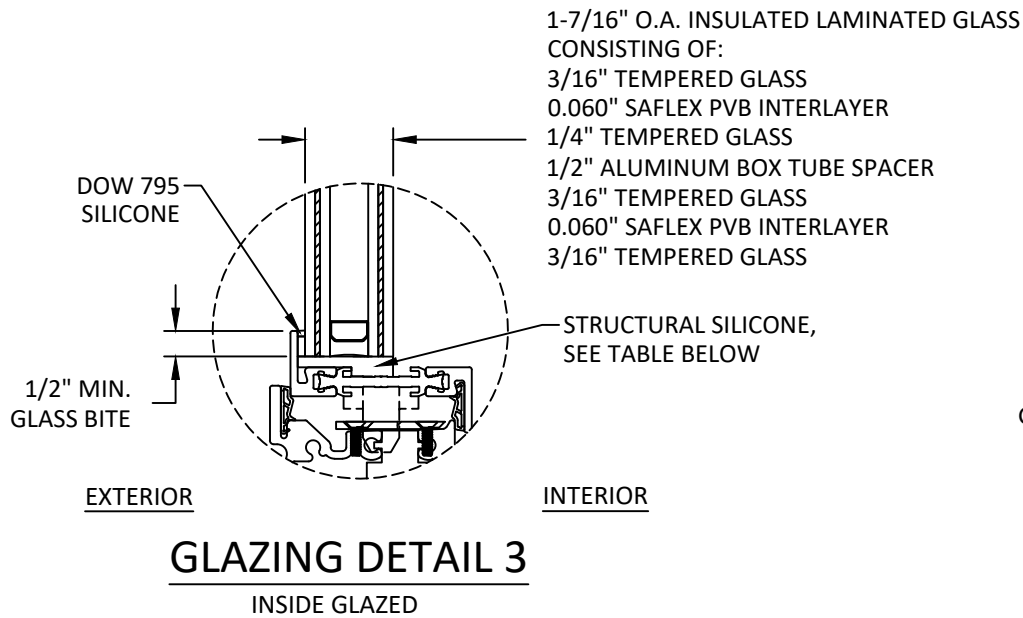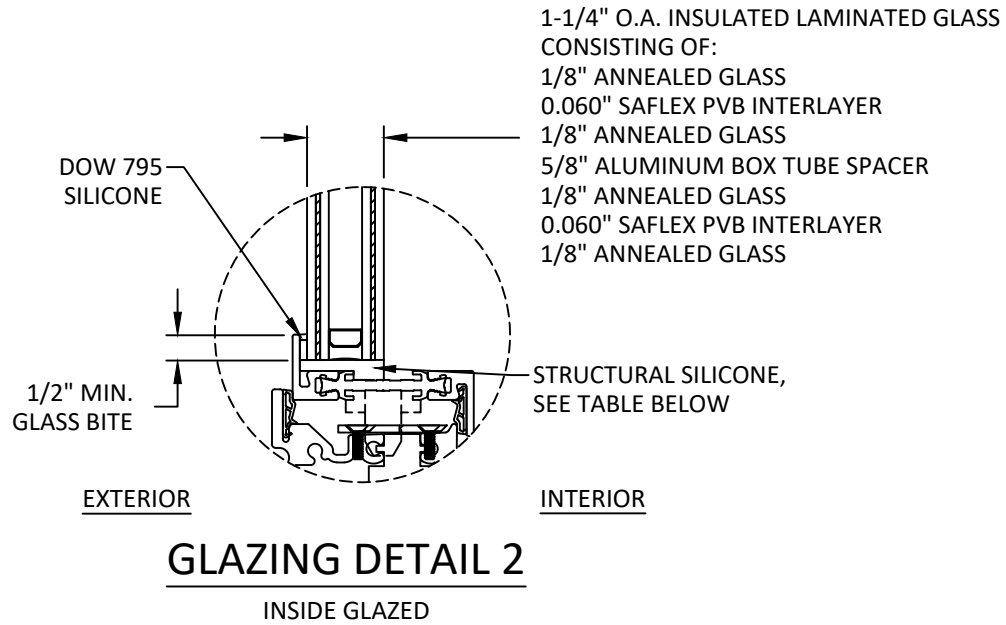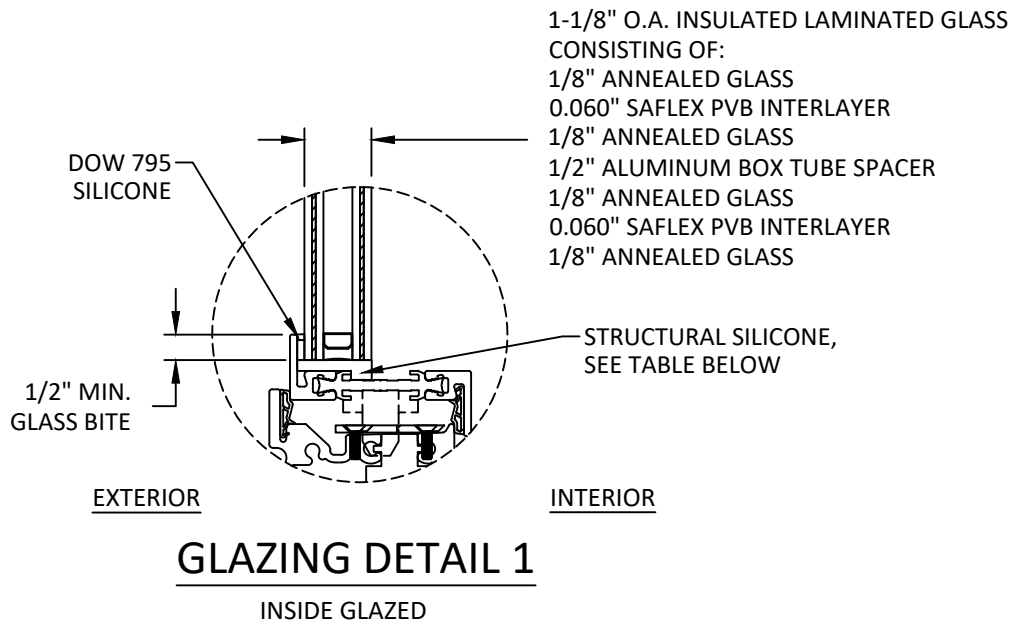

QUALIFIED SILICONE OPTIONS
DOW 995
DOW 121
SIKA SG-20

GLAZING NOTES:

- GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC, TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
- SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
- SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
- D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.
- PRODUCT TESTED WITHOUT GLAZING BEAD.

REILLY ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)

GLAZING DETAILS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	REV.
2	A
OF 26	

INTERIOR

OUTSIDE GLAZED

INTERIOR

OUTSIDE GLAZED

INTERIOR

OUTSIDE GLAZED

INTERIOR

OUTSIDE GLAZED

A detailed cross-section diagram of a window assembly. The diagram shows a vertical section of a window frame. At the top, a label '5/64" BRONZE SKINS' points to the thin outer layers. Below these is a '3/4" STYROFOAM PANEL' with a honeycomb pattern. The entire assembly is sealed with 'STRUCTURAL SILICONE, SEE TABLE BELOW'. To the right, 'DOW 795 SILICONE' is indicated at the bottom of the seal. A '1/2" MIN. GLASS BITE' is shown as the distance from the bottom of the frame to the bottom of the glass pane. The diagram is enclosed in a dashed circle.

INTERIOR


OUTSIDE GLAZED

QUALIFIED SILICONE OPTIONS
DOW 995
DOW 121
SIKA SG-20

1. GLASS TYPE COMPLIES WITH ASTM E1300 REQUIREMENTS. PER THE FBC, TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
2. SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
3. SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
4. D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.
5. PRODUCT TESTED WITHOUT GLAZING BEAD.

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

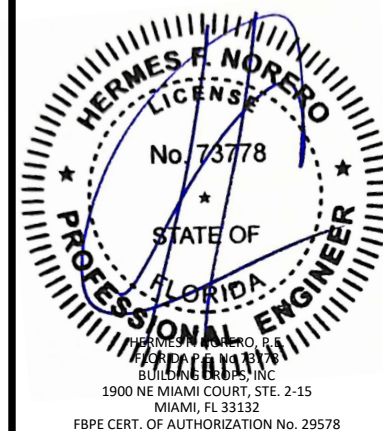

FL47695

DATE: 05.21.2025

CHK. BY:
HFN

SCALE: NTS


DWG. #: RWD021

REV. A

3

OF 26

c:\users\sebastianh\appdata\local\temp\project\reilly\2026 code change\dwgs\147695-0\rvwd021 - a.dwg 8/4/2026 3:27 PM

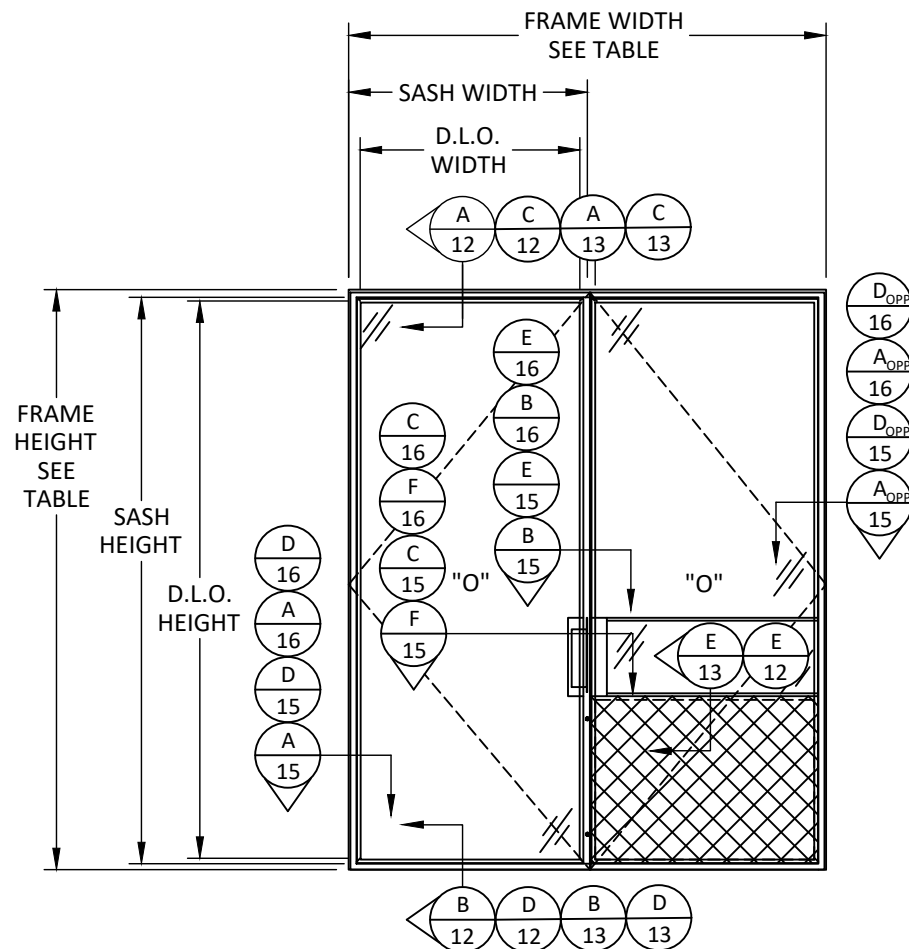

ELEVATION
W75 INSWING & OUTSWING
FRENCH DOOR

W75 INSWING & OUTSWING FRENCH
DOOR SIZE NOTES:
D.L.O. WIDTH = FRAME WIDTH/2 - 3.78"
D.L.O. HEIGHT = FRAME HEIGHT - 5.55"


SASH WIDTH = FRAME WIDTH/2 - 0.47"
SASH HEIGHT = FRAME HEIGHT - 2.25"

W75 INSWING & OUTSWING FRENCH DOOR
DESIGN PRESSURE TABLE

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
60	60	60.00	60.00
72		60.00	60.00
78		60.00	60.00
90		52.49	52.49
102		46.32	46.32
114	66	41.44	41.44
60		60.00	60.00
72		60.00	60.00
78		60.00	60.00
90		52.49	52.49
102	72	46.32	46.32
114		41.44	41.44
60		60.00	60.00
72		60.00	60.00
78		60.00	60.00
90	78	52.49	52.49
60		60.00	60.00
72		60.00	60.00
78		60.00	60.00
90		52.49	52.49
60	84	60.00	60.00
72		60.00	60.00
78		60.00	60.00
90		60.00	60.00
72	90	60.00	60.00
78		60.00	60.00
60		60.00	60.00
72		60.00	60.00
78		60.00	60.00
60	96	60.00	60.00
72		60.00	60.00
78		60.00	60.00
90		60.00	60.00
72	102	53.73	53.73
60		60.00	60.00
72		53.73	53.73
60		53.28	53.28
60		45.15	45.15
60	120	38.61	38.61
48		41.25	41.25
48		35.83	35.83

MIDRAIL DESIGN PRESSURE TABLE

DESIGN PRESSURE CHART (PSF)			
TRIBUTARY HEIGHT (IN.)	MIDRAIL SPAN (IN.)	EXT. (+)	INT. (-)
30	27	60.00	60.00
32.3		60.00	60.00
36		60.00	60.00
30	30	60.00	60.00
32.3		60.00	60.00
36		60.00	60.00
30	33	60.00	60.00
32.3		60.00	60.00
36		60.00	60.00
30	34.2	60.00	60.00
32.3		60.00	60.00
36		50.94	50.94

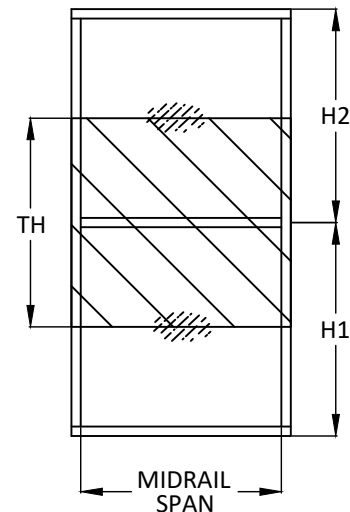

$$\text{TRIBUTARY HEIGHT (TH)} = \frac{H1 + H2}{2}$$

REILLY
ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
ELEVATION & DESIGN
PRESSURE TABLE

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	REV.
4	A
OF 26	

c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:27 PM

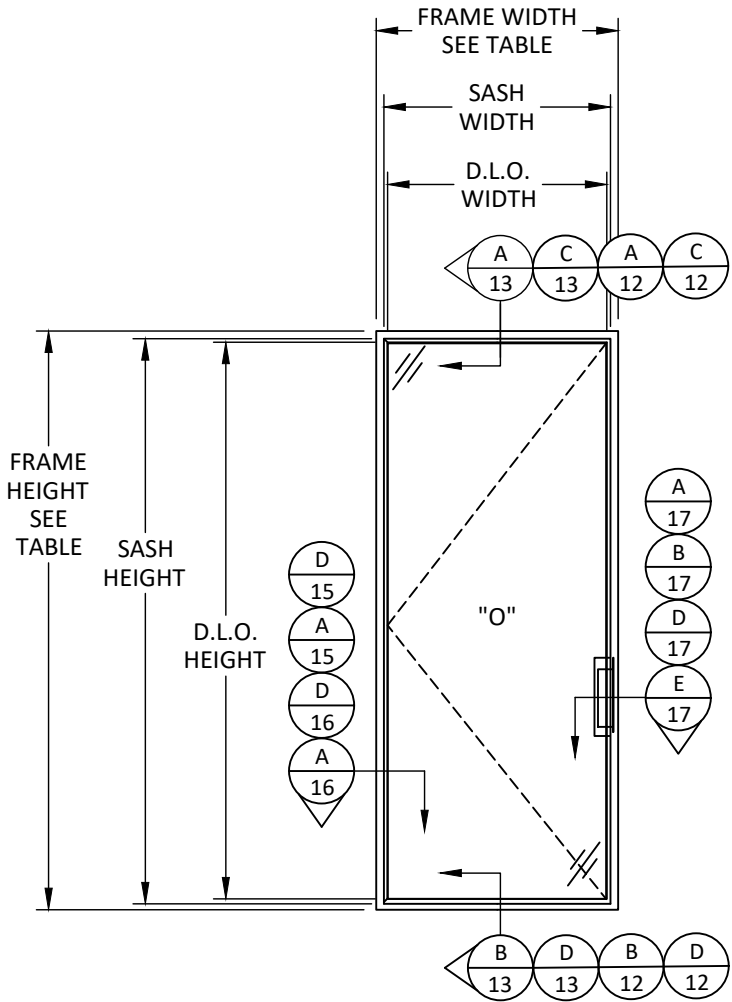

ELEVATION
W75 INSWING & OUTSWING
SINGLE DOOR

W75 INSWING & OUTSWING SINGLE DOOR
SIZE NOTES:
D.L.O. WIDTH = FRAME WIDTH - 3.78"
D.L.O. HEIGHT = FRAME HEIGHT - 5.55"

SASH WIDTH = FRAME WIDTH - 0.47"
SASH HEIGHT = FRAME HEIGHT - 2.25"

W75 INSWING & OUTSWING SINGLE DOOR
DESIGN PRESSURE TABLE

DESIGN PRESSURE CHART (PSF)			
FRAME WIDTH (IN.)	FRAME HEIGHT (IN.)	EXT. (+)	INT. (-)
30	60	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	66	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	72	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	78	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	84	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	90	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	96	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	102	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	108	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	114	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	120	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	126	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44
30	132	60.00	60.00
36		60.00	60.00
39		60.00	60.00
45		52.49	52.49
51		46.32	46.32
57		41.44	41.44

REILLY

ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933

P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING DOOR (WZ3) (IMPACT) ELEVATION & DESIGN PRESSURE TABLE

PREPARED BY: BUILDING DROPS, INC. 1900 NE MIAMI COURT, STE. 2-15 MIAMI, FL 33132 PH: (954) 399-8478 FAX: (954) 744-4738 WEB: www.buildingdrops.com

REMARKS

2026 FBC UPDATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO

LICENSE

No. 73778

STATE OF FLORIDA

PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E. BUILDING DROPS, INC. 1900 NE MIAMI COURT, STE. 2-15 MIAMI, FL 33132 FBPE CERT. OF AUTHORIZATION No. 29578

FL #: FL47695

DATE: 05.21.2025

DWG. BY: JR

CHK. BY: HFN

SCALE: NTS


DWG. #: RWD021

SHEET: 5

REV. A

OF 26

c:\users\sebastianh\documents\projects\2026 code change\projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:27 PM

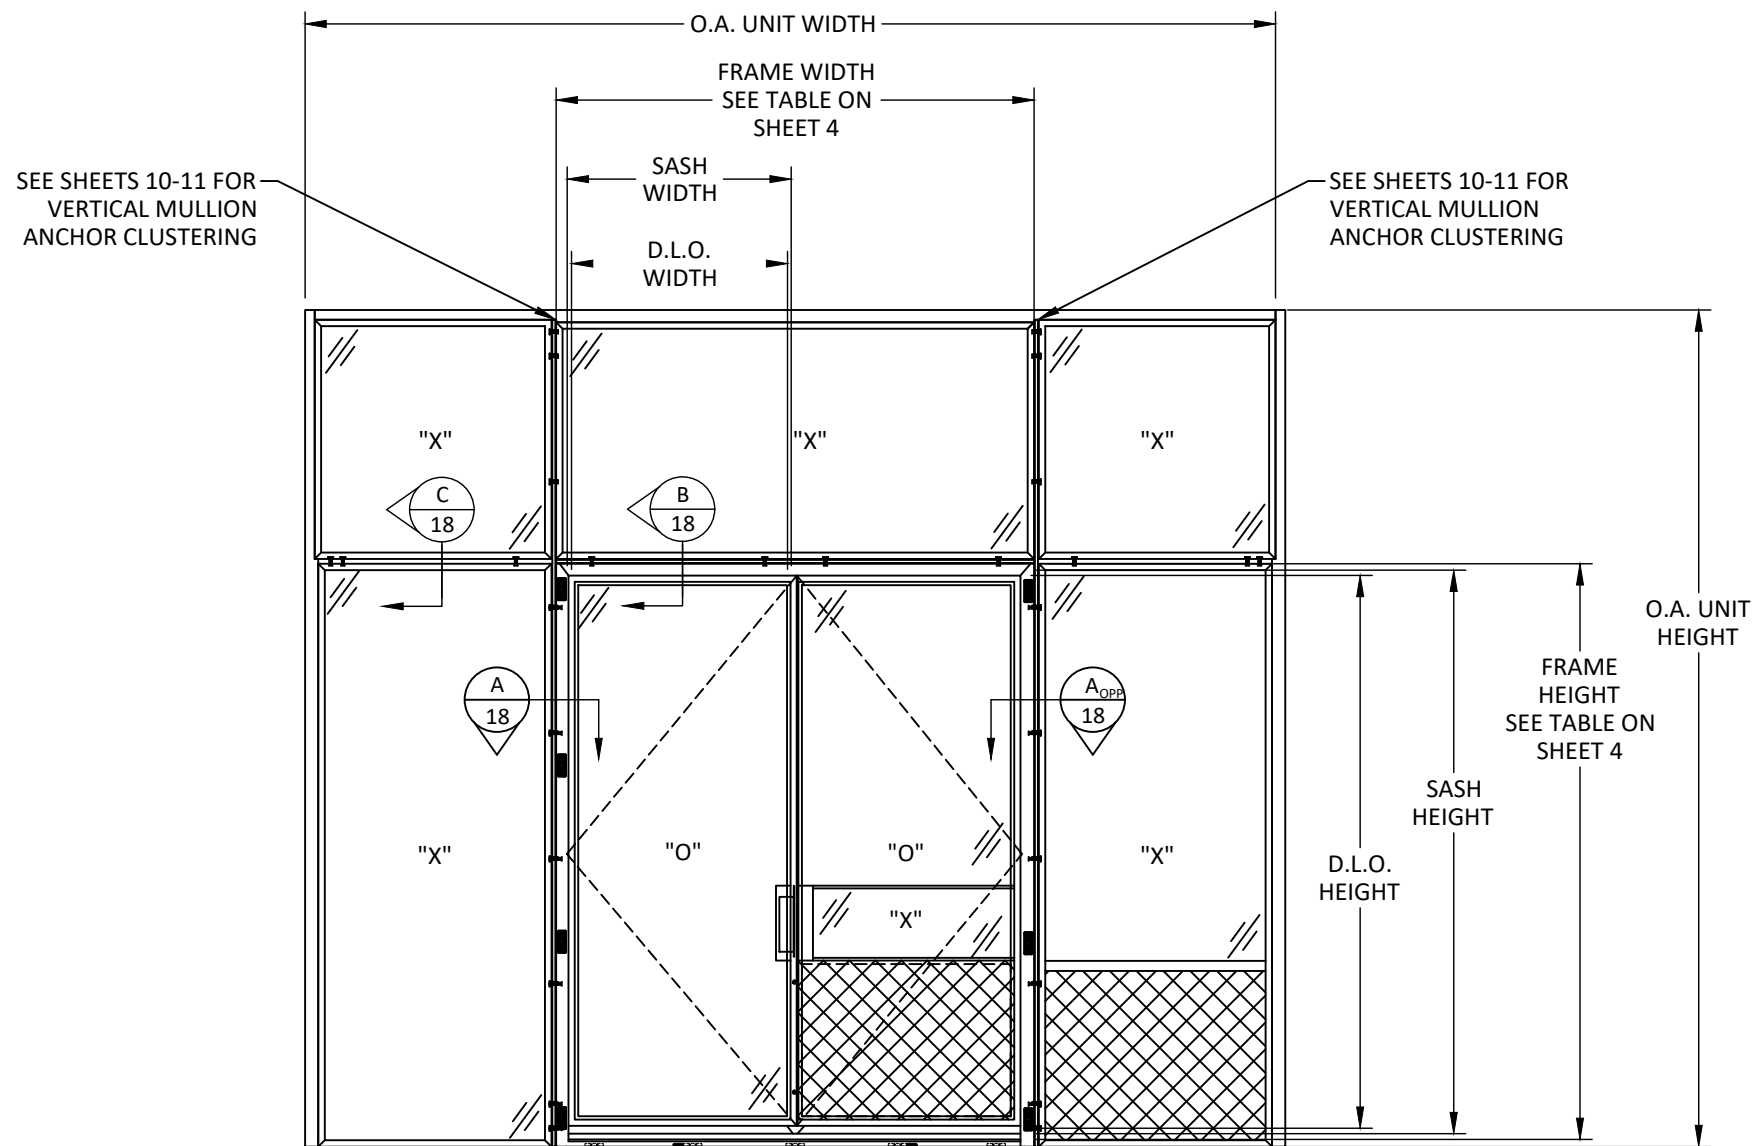


ELEVATION
W75 INSWING & OUTSWING FRENCH
DOOR WITH SIDELITES AND TRANSOM

NOTE:
SIDELITES AND TRANSOM ARE UNDER THE
W75 FLORIDA PRODUCT APPROVAL.

NOTE:
REFER TO SHEET 7 FOR MULLION DESIGN
PRESSURE TABLES.

**QUALIFIED
CONFIGURATIONS**

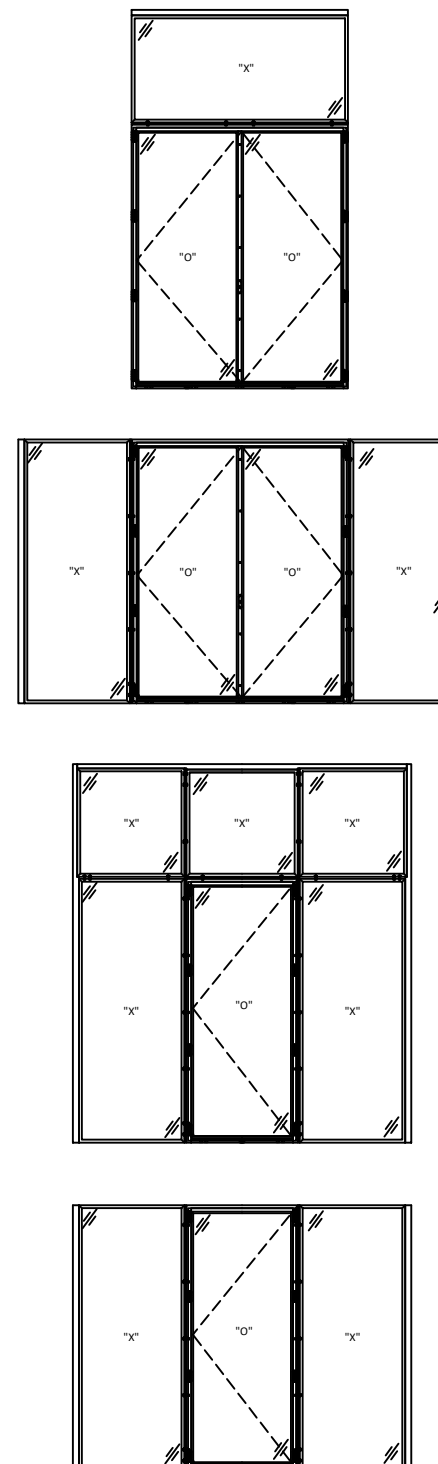

NOTE: ADDITIONAL CONFIGURATIONS
QUALIFIED. ASK MANUFACTURER FOR
ADDITIONAL INFORMATION.


**REILLY
ARCHITECTURAL**
901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
ELEVATION

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com


REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

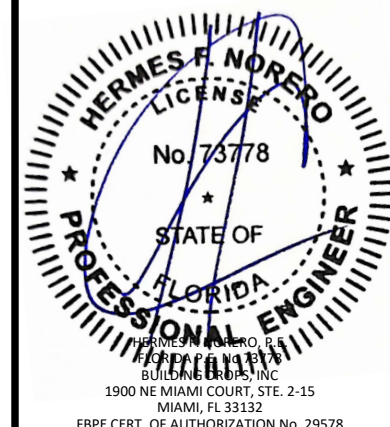


FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	REV.
6	A

DESIGN PRESSURE CHART (PSF)			
TRIBUTARY WIDTH (IN.)	MULLION SPAN (IN.)	EXT. (+)	INT. (-)
48	60	60.00	60.00
54		60.00	60.00
60		60.00	60.00
68.5		60.00	60.00
72		60.00	60.00
78		60.00	60.00
84		60.00	60.00
48	66	60.00	60.00
54		60.00	60.00
60		60.00	60.00
68.5		60.00	60.00
72		60.00	60.00
78		60.00	60.00
48		72	60.00
54	60.00		60.00
60	60.00		60.00
68.5	60.00		60.00
72	60.00		60.00
48	78.7		60.00
54		60.00	60.00
60		60.00	60.00
68.5		60.00	60.00
48	84	58.11	58.11
54		53.62	53.62
60		50.37	50.37
48	90	46.40	46.40
54		42.60	42.60
48	96	37.68	37.68
54		34.45	34.45
48	102	31.04	31.04
48	108	25.89	25.89

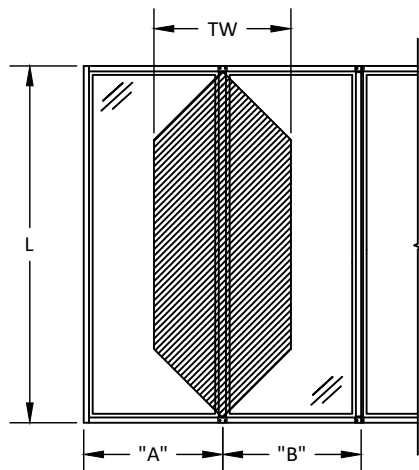


$$\text{TRIBUTARY WIDTH (TW)} = \frac{A + B}{2}$$

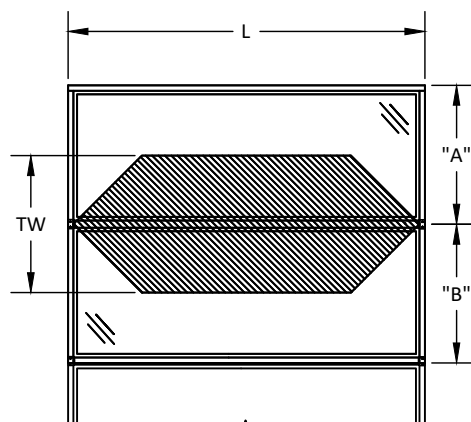


NOTE: ONLY QUALIFIED FOR ONE-WAY APPLICATION

DESIGN PRESSURE CHART (PSF)			
TRIBUTARY WIDTH (IN.)	MULLION SPAN (IN.)	EXT. (+)	INT. (-)
48	84	60.00	60.00
54		60.00	60.00
59.6		60.00	60.00
66		60.00	60.00
72		60.00	60.00
78		60.00	60.00
84		60.00	60.00
90		60.00	60.00
96		60.00	60.00
48		90	60.00
54	60.00		60.00
59.6	60.00		60.00
66	60.00		60.00
72	60.00		60.00
78	60.00		60.00
84	60.00		60.00
90	60.00		60.00
48	96		60.00
54		60.00	60.00
59.6		60.00	60.00
66		60.00	60.00
72		60.00	60.00
78		60.00	60.00
84		60.00	60.00
48		102	60.00
54	60.00		60.00
59.6	60.00		60.00
66	60.00		60.00
72	60.00		60.00
78	60.00		60.00

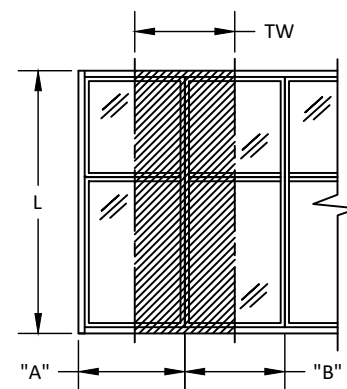

NOTE: QUALIFIED FOR
ONE-WAY AND TWO-WAY
APPLICATIONS


$$\text{TRIBUTARY WIDTH (TW)} = \frac{A + B}{2}$$

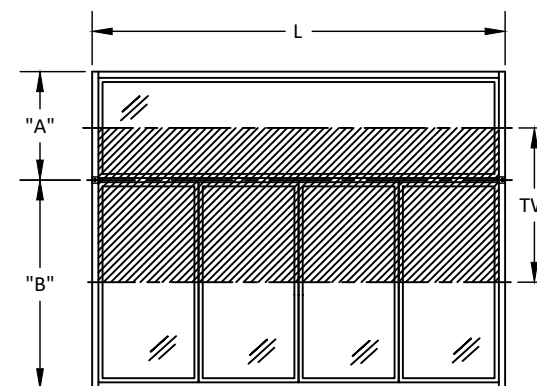

DESIGN PRESSURE CHART (PSF)			
TRIBUTARY WIDTH (IN.)	MULLION SPAN (IN.)	EXT. (+)	INT. (-)
48	108	60.00	60.00
54		60.00	60.00
59.6		60.00	60.00
66		60.00	60.00
72		60.00	60.00
48	114	60.00	60.00
54		60.00	60.00
59.6		60.00	60.00
66		60.00	60.00
48	120	60.00	60.00
54		60.00	60.00
59.6		60.00	60.00
66		60.00	60.00
48	126	60.00	60.00
54		60.00	60.00
59.6		60.00	60.00
48	132	60.00	60.00
54		60.00	60.00
59.6		60.00	60.00
48	136.1	60.00	60.00
54		60.00	60.00
59.6		60.00	60.00
48	144	60.00	60.00
54		56.05	56.05
48	150	55.79	55.79
54		49.59	49.59
48	156	49.60	49.60

FL #:	
FL47695	
DATE: 05.21.2025	
DWG. BY: JR	CHK. BY: HFN
SCALE: NTS	
DWG. #: RWD021	
SHEET: 7	REV. A
OF 26	

c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:27 PM

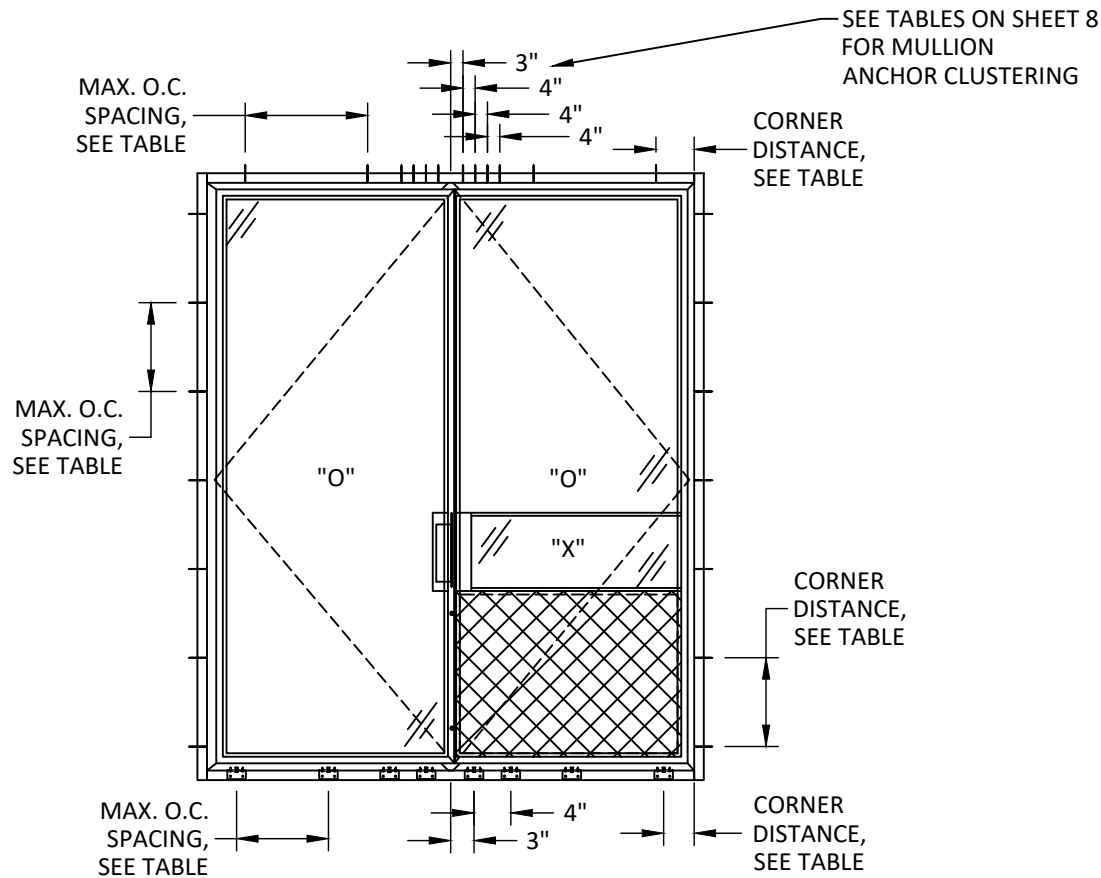

ANCHOR LAYOUT
W75 INSWING & OUTSWING
FRENCH DOOR

W75 DOOR ANCHOR SPACING TABLE - ALTERNATE SILL INSTALLATION OPTIONS							
INSTALLATION METHOD	ANCHOR CAPACITY TABLE DESIGNATION	DP (PSF)	ANCHOR	SHIM SPACE	SILL	TOTAL QTY. OF ANCHORS PER MULL ENDS	CORNER DISTANCE
ALUMINUM ANGLE: 1/2" X 1-4/5"	H	+/- 40	#10	1/4"	34-1/2"	2	7"
				1/2"	34-1/2"	4	
		+/- 60	#12	1/4"	34-1/2"	2	
				1/2"	34-1/2"	4	
STEEL ANGLE: 1/2" X 1-4/5"	I	+/- 40	#10	1/2"	34-1/2"	2	7"
		+/- 60	#12	1/4"	34-1/2"	2	
				1/2"	34-1/2"	4	
ALUMINUM ANGLE: 3/4" X 3/4"	J	+/- 40	#10	1/4"	16"	2	6"
				1/2"	16"	4	
		+/- 60	#12	1/4"	16"	2	
				1/2"	16"	4	
STEEL ANGLE: 3/4" X 3/4"	K	+/- 40	#10	1/2"	16"	2	6"
		+/- 60	#12	1/4"	16"	2	
				1/2"	16"	4	

W75 DOOR ANCHOR SPACING TABLE								
INSTALLATION METHOD	ANCHOR CAPACITY TABLE DESIGNATION	DP (PSF)	ANCHOR	SHIM SPACE	HEAD	JAMBS	TOTAL QTY. OF ANCHORS PER MULL ENDS	CORNER DISTANCE
THROUGH FRAME	A	+/- 40	#10	1/4"	18-3/4"	18-3/4"	4	6"
				1/2"	18-3/4"	18-3/4"	8	
		+/- 60	#12	1/4"	18-3/4"	18-3/4"	4	
				1/2"	18-3/4"	18-3/4"	6	
ALUMINUM FLAT CLIP	B	+/- 40	#10	1/4"	29"	29"	2	6"
		+/- 60	#12	1/2"	29"	29"	4	
STEEL FLAT CLIP	C	+/- 40	#10	1/4"	29"	29"	2	6"
				1/2"	29"	29"	4	
		+/- 60	#12	1/4"	29"	29"	2	
				1/2"	29"	29"	4	
ALUMINUM/STEEL BENT EXTERIOR CLIP	D, E	+/- 40	#10	1/2"	18-3/4"	18-3/4"	2	6"
		+/- 60	#12	1/2"	18-3/4"	18-3/4"	2	
ALUMINUM BENT INTERIOR CLIP	F	+/- 40	#10	1/4"	34-1/2"	29"	2	HEAD/SILL: 7" JAMBS: 4.25"
				1/2"	34-1/2"	29"	4	
		+/- 60	#12	1/4"	34-1/2"	29"	2	
				1/2"	34-1/2"	29"	4	
STEEL BENT INTERIOR CLIP	G	+/- 40	#10	1/2"	34-1/2"	29"	2	HEAD/SILL: 7" JAMBS: 4.25"
		+/- 60	#12	1/4"	34-1/2"	29"	2	
				1/2"	34-1/2"	29"	4	

NOTE: 1/2" SHIM SPACE QUALIFIES 1/4" SHIM SPACE.

REILLY
ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
ANCHOR LAYOUT

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	REV.
8	A
OF 26	

c:\users\sebastianh\appdata\local\temp\project\reilly\architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:27 PM

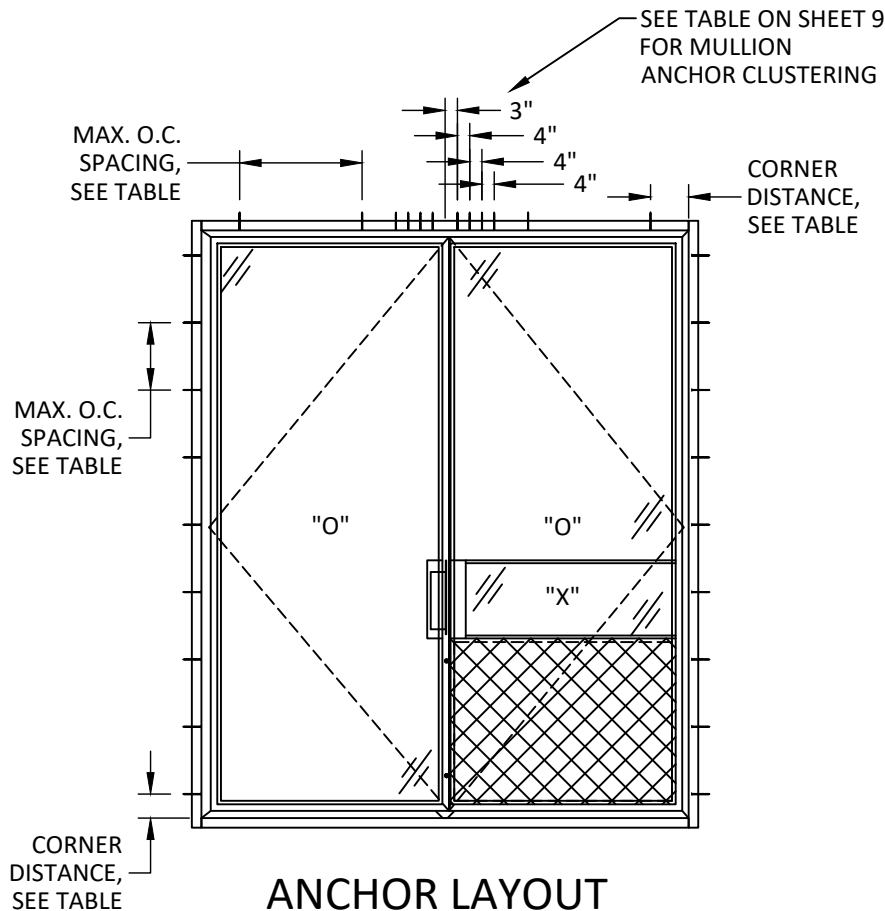

ANCHOR LAYOUT
W75 INSWING & OUTSWING FRENCH DOOR
WITH SILICONE AT SILL

NOTE: 1/2" SHIM SPACE QUALIFIES 1/4" SHIM SPACE.

W75 DOOR ANCHOR SPACING TABLE								
INSTALLATION METHOD	ANCHOR CAPACITY TABLE DESIGNATION	DP (PSF)	ANCHOR	SHIM SPACE	HEAD	JAMBS	TOTAL QTY. OF ANCHORS PER MULL ENDS	CORNER DISTANCE
THROUGH FRAME	A	+/- 40	#10	1/4"	18-3/4"	18-3/4"	4	6"
				1/2"	18-3/4"	8-1/2"	6	
		+/- 60	#12	1/4"	18-3/4"	14"	4	
				1/2"	18-3/4"	10-1/2"	6	
ALUMINUM FLAT CLIP	B	+/- 40	#10	1/4"	29"	29"	2	6"
				1/2"	29"	22-1/2"	4	
		+/- 60	#12	1/4"	29"	29"	2	
				1/2"	29"	18"	4	
STEEL FLAT CLIP	C	+/- 40	#10	1/2"	29"	29"	2	6"
		+/- 60	#12	1/4"	29"	29"	2	
				1/2"	29"	22-1/2"	4	
ALUMINUM/STEEL BENT EXTERIOR CLIP	D, E	+/- 40	#10	1/2"	18-3/4"	18-3/4"	2	6"
		+/- 60	#12	1/2"	18-3/4"	18-3/4"	2	
ALUMINUM BENT INTERIOR CLIP	F	+/- 40	#10	1/4"	34-1/2"	29"	2	HEAD/SILL: 7" JAMBS: 4.25"
				1/2"	34-1/2"	22"	4	
		+/- 60	#12	1/4"	34-1/2"	29"	2	
				1/2"	34-1/2"	17-1/2"	4	
STEEL BENT INTERIOR CLIP	G	+/- 40	#10	1/4"	34-1/2"	29"	2	HEAD/SILL: 7" JAMBS: 4.25"
				1/2"	34-1/2"	29"	2	
		+/- 60	#12	1/4"	34-1/2"	29"	2	
				1/2"	34-1/2"	21-3/4"	4	


TITLE: W75 INSWING & OUTSWING DOOR (WZ3) (IMPACT) ANCHOR LAYOUT

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

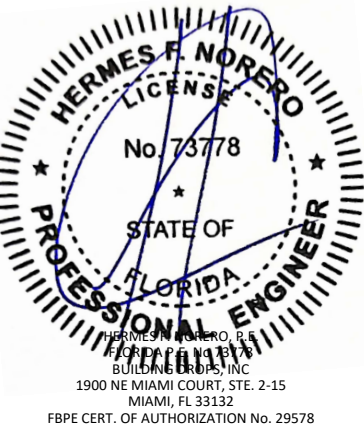

FL #: **FL47695**

DATE: **05.21.2025**

DWG. BY: **JR** CHK. BY: **HFN**

SCALE: **NTS**

DWG. #: **RWD021**

SHEET: **9** REV. **A**

OF 26


c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-r0\rvd021 - a.dwg 8/4/2026 3:27 PM

ANCHOR CAPACITY TABLE AT MULLION END FOR
#10 ANCHORS WITH 1/4" SHIM SPACE

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)			
NOMINAL DIMS.		ANCHORS TYPE 'A'	ANCHORS TYPE 'B-K'
TRIBUTARY WIDTH	FRAME HEIGHT	A8	(B-K)8
48	84	40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
66		40.00	40.00
72		40.00	40.00
78		40.00	40.00
84		40.00	40.00
90	90	40.00	40.00
96		40.00	40.00
48		40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
66		40.00	40.00
72		40.00	40.00
78		40.00	40.00
84	96	40.00	40.00
90		40.00	40.00
48		40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
66		40.00	40.00
72		40.00	40.00
78	102	40.00	40.00
84		40.00	40.00
90		40.00	40.00
48		40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
66		40.00	40.00
72	108	40.00	40.00
78		40.00	40.00
84		40.00	40.00
90		40.00	40.00
48		40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
66	114	40.00	40.00
72		40.00	40.00
78		40.00	40.00

NOTE: SEE SHEET 6 FOR VERTICAL
MULLION.

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)			
NOMINAL DIMS.		ANCHORS TYPE 'A'	ANCHORS TYPE 'B-K'
TRIBUTARY WIDTH	FRAME HEIGHT	A8	(B-K)8
48	120	40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
66		40.00	40.00
48	126	40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
66		40.00	40.00
48	132	40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
48	136.1	40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
66		40.00	40.00
48	144	40.00	40.00
54		40.00	40.00
59.6		40.00	40.00
48	150	40.00	40.00
54		40.00	40.00
48	156	40.00	40.00

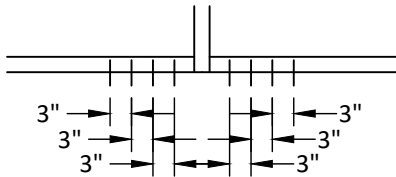


A8, (B-K)8

ANCHOR CAPACITY TABLE AT MULLION END FOR
#10 ANCHORS WITH 1/2" SHIM SPACE


ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)					
NOMINAL DIMS.		ANCHORS TYPE 'A-C, F-K'			ANCHORS TYPE 'D-E'
TRIBUTARY WIDTH	FRAME HEIGHT	(A-C, F-K)8	(A-C, F-K)10	(A-C, F-K)12	(D-E)8
48	84	40.00	40.00	40.00	40.00
54		40.00	40.00	40.00	40.00
59.6		40.00	40.00	40.00	40.00
66		40.00	40.00	40.00	40.00
72		40.00	40.00	40.00	40.00
78		40.00	40.00	40.00	40.00
84		40.00	40.00	40.00	40.00
90	90	40.00	40.00	40.00	40.00
96		40.00	40.00	40.00	40.00
48		40.00	40.00	40.00	40.00
54		40.00	40.00	40.00	40.00
59.6		40.00	40.00	40.00	40.00
66		40.00	40.00	40.00	40.00
72		40.00	40.00	40.00	40.00
78	96	40.00	40.00	40.00	40.00
84		40.00	40.00	40.00	40.00
90		40.00	40.00	40.00	40.00
48		40.00	40.00	40.00	40.00
54		40.00	40.00	40.00	40.00
59.6		39.54	40.00	40.00	40.00
66		38.06	40.00	40.00	40.00
72	102	36.98	40.00	40.00	40.00
78		36.25	40.00	40.00	40.00
84		40.00	40.00	40.00	40.00
48		40.00	40.00	40.00	40.00
54		40.00	40.00	40.00	40.00
59.6		38.21	40.00	40.00	40.00
66		36.10	40.00	40.00	40.00
72	108	34.60	40.00	40.00	40.00
78		33.46	40.00	40.00	40.00
84		40.00	40.00	40.00	40.00
48		40.00	40.00	40.00	40.00
54		37.59	40.00	40.00	40.00
59.6		35.28	40.00	40.00	40.00
66		33.22	40.00	40.00	40.00
72	114	31.72	39.65	40.00	40.00
78		38.06	40.00	40.00	40.00
84		35.00	40.00	40.00	40.00
90		32.76	40.00	40.00	40.00
96	114	30.76	38.44	40.00	40.00
102					

NOTE: SEE SHEET 6 FOR VERTICAL
MULLION.


ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)					
NOMINAL DIMS.		ANCHORS TYPE 'A-C, F-I'			ANCHORS TYPE 'D-E'
TRIBUTARY WIDTH	FRAME HEIGHT	(A-C, F-K)8	(A-C, F-K)10	(A-C, F-K)12	(D-E)8
48	120	35.68	40.00	40.00	40.00
54		32.74	40.00	40.00	40.00
59.6		30.58	38.23	40.00	40.00
66		28.63	35.79	40.00	40.00
48	126	33.58	40.00	40.00	40.00
54		30.76	38.44	40.00	40.00
59.6		28.68	35.85	40.00	40.00
66		31.72	39.65	40.00	40.00
48	132	29.00	36.25	40.00	40.00
54		26.99	33.74	40.00	40.00
59.6		30.56	38.20	40.00	40.00
66		27.91	34.89	40.00	40.00
48	136.1	25.95	32.44	40.00	40.00
54		28.54	35.68	40.00	40.00
59.6		26.02	32.53	40.00	40.00
66		27.19	33.98	40.00	40.00
48	150	24.75	30.94	40.00	40.00
54		25.95	32.44	40.00	40.00
59.6					
66					

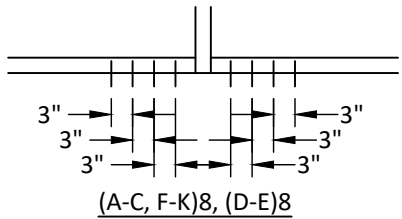

(A-C, F-K)8, (D-E)8

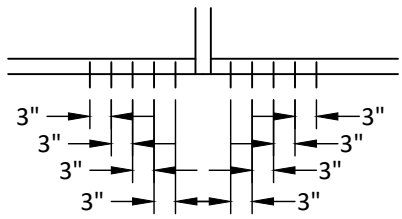

(A-C, F-K)10

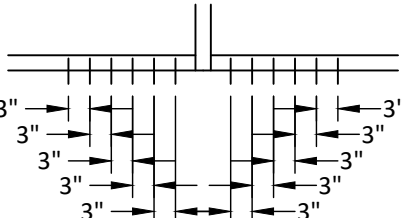

(A-C, F-K)12

REILLY ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
ANCHOR CAPACITY TABLES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	REV. A
10	
OF 26	

8/4/2026 3:27 PM



c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change\dwgs\147695-rwd021 - a.dwg

ANCHOR CAPACITY TABLE AT MULLION END FOR
#12 ANCHORS WITH 1/4" SHIM SPACE

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)				
NOMINAL DIMS.		ANCHORS TYPE 'A'		ANCHORS TYPE 'B-K'
TRIBUTARY WIDTH	FRAME HEIGHT	A8	A10	(B-K)8
48	84	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
66		60.00	60.00	60.00
72		60.00	60.00	60.00
78		60.00	60.00	60.00
84		60.00	60.00	60.00
90		60.00	60.00	60.00
48	90	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
66		60.00	60.00	60.00
72		60.00	60.00	60.00
78		60.00	60.00	60.00
84		60.00	60.00	60.00
90		60.00	60.00	60.00
48	96	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
66		60.00	60.00	60.00
72		60.00	60.00	60.00
78		60.00	60.00	60.00
84		60.00	60.00	60.00
48		60.00	60.00	60.00
48	102	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
66		60.00	60.00	60.00
72		60.00	60.00	60.00
78		60.00	60.00	60.00
84		60.00	60.00	60.00
48		60.00	60.00	60.00
48	108	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
66		60.00	60.00	60.00
72		60.00	60.00	60.00
78		60.00	60.00	60.00
84		60.00	60.00	60.00
48		60.00	60.00	60.00
48	114	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
66		60.00	60.00	60.00
72		60.00	60.00	60.00
78		60.00	60.00	60.00
84		60.00	60.00	60.00
48		60.00	60.00	60.00
48	120	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
66		60.00	60.00	60.00
72		60.00	60.00	60.00
78		60.00	60.00	60.00
84		60.00	60.00	60.00
48		60.00	60.00	60.00

NOTE: SEE SHEET 6 FOR VERTICAL
MULLION.

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)				
NOMINAL DIMS.		ANCHORS TYPE 'A'		ANCHORS TYPE 'B-K'
TRIBUTARY WIDTH	FRAME HEIGHT	A8	A10	(B-K)8
48	126	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
48	132	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
48	136.1	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
48	144	60.00	60.00	60.00
54		60.00	60.00	60.00
59.6		60.00	60.00	60.00
48	150	60.00	60.00	60.00
54		58.97	60.00	60.00
59.6		60.00	60.00	60.00
48	156	60.00	60.00	60.00


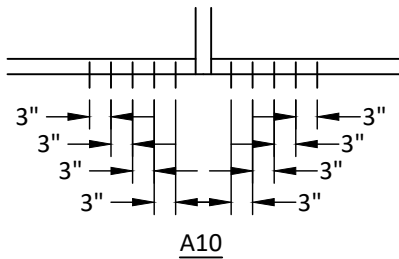
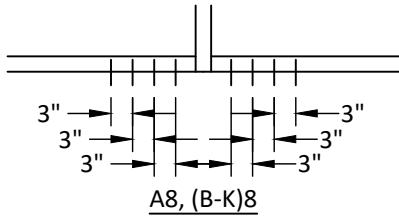


ANCHOR CAPACITY TABLE AT MULLION END FOR
#12 ANCHORS WITH 1/2" SHIM SPACE

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)						
NOMINAL DIMS.		ANCHORS TYPE 'A'			ANCHORS TYPE 'B-C'	ANCHORS TYPE 'D-K'
TRIBUTARY WIDTH	FRAME HEIGHT	A8	A10	A12	(B-C)8	(D-K)8
48	84	60.00	60.00	60.00	60.00	60.00
54		60.00	60.00	60.00	60.00	60.00
59.6		60.00	60.00	60.00	60.00	60.00
66		60.00	60.00	60.00	60.00	60.00
72		60.00	60.00	60.00	60.00	60.00
78		60.00	60.00	60.00	60.00	60.00
84		60.00	60.00	60.00	60.00	60.00
90		60.00	60.00	60.00	60.00	60.00
48	90	60.00	60.00	60.00	60.00	60.00
54		60.00	60.00	60.00	60.00	60.00
59.6		60.00	60.00	60.00	60.00	60.00
66		60.00	60.00	60.00	60.00	60.00
72		60.00	60.00	60.00	60.00	60.00
78		60.00	60.00	60.00	60.00	60.00
84		60.00	60.00	60.00	60.00	60.00
90		60.00	60.00	60.00	60.00	60.00
48	96	60.00	60.00	60.00	60.00	60.00
54		60.00	60.00	60.00	60.00	60.00
59.6		60.00	60.00	60.00	60.00	60.00
66		60.00	60.00	60.00	60.00	60.00
72		60.00	60.00	60.00	60.00	60.00
78		60.00	60.00	60.00	60.00	60.00
84		60.00	60.00	60.00	60.00	60.00
48		60.00	60.00	60.00	60.00	60.00
48	102	60.00	60.00	60.00	60.00	60.00
54		60.00	60.00	60.00	60.00	60.00
59.6		60.00	60.00	60.00	60.00	60.00
66		60.00	60.00	60.00	60.00	60.00
72		60.00	60.00	60.00	60.00	60.00
78		60.00	60.00	60.00	60.00	60.00
84		60.00	60.00	60.00	60.00	60.00
48		60.00	60.00	60.00	60.00	60.00
48	108	60.00	60.00	60.00	60.00	60.00
54		60.00	60.00	60.00	60.00	60.00
59.6		60.00	60.00	60.00	60.00	60.00
66		60.00	60.00	60.00	60.00	60.00
72		60.00	60.00	60.00	60.00	60.00
78		60.00	60.00	60.00	60.00	60.00
84		60.00	60.00	60.00	60.00	60.00
48		60.00	60.00	60.00	60.00	60.00
48	114	60.00	60.00	60.00	60.00	60.00
54		60.00	60.00	60.00	60.00	60.00
59.6		60.00	60.00	60.00	60.00	60.00
66		60.00	60.00	60.00	60.00	60.00
72		59.70	60.00	60.00	60.00	60.00
78		60.00	60.00	60.00	60.00	60.00
84		60.00	60.00	60.00	60.00	60.00
48		60.00	60.00	60.00	60.00	60.00
48	120	60.00	60.00	60.00	60.00	60.00
54		60.00	60.00	60.00	60.00	60.00
59.6		60.00	60.00	60.00	60.00	60.00
66		57.89	60.00	60.00	60.00	60.00
72		60.00	60.00	60.00	60.00	60.00
78		60.00	60.00	60.00	60.00	60.00
84		60.00	60.00	60.00	60.00	60.00
48		60.00	60.00	60.00	60.00	60.00

NOTE: SEE SHEET 6 FOR VERTICAL
MULLION.

ANCHOR LOAD CAPACITY - PSF EXT. (+) & INT. (-)						
NOMINAL DIMS.		ANCHORS TYPE 'A'			ANCHORS TYPE 'B-C'	ANCHORS TYPE 'D-K'
TRIBUTARY WIDTH	FRAME HEIGHT	A8	A10	A12	(B-C)8	(D-K)8
48	126	60.00	60.00	60.00	60.00	60.00
54		57.89	60.00	60.00	60.00	60.00
59.6		53.97	60.00	60.00	60.00	60.00
48	132	59.70	60.00	60.00	60.00	60.00
54		54.58	60.00	60.00	60.00	60.00
59.6		50.81	60.00	60.00	60.00	60.00
48	136.1	57.51	60.00	60.00	60.00	60.00
54		52.53	60.00	60.00	60.00	60.00
59.6		48.85	60.00	60.00	60.00	60.00
48	144	53.73	60.00	60.00	60.00	60.00
54		48.98	60.00	60.00	60.00	60.00
59.6		51.17	60.00	60.00	60.00	60.00
48	150	46.59	58.24	60.00	60.00	60.00
54		48.84	60.00	60.00	60.00	60.00
59.6		48.84	60.00	60.00	60.00	60.00

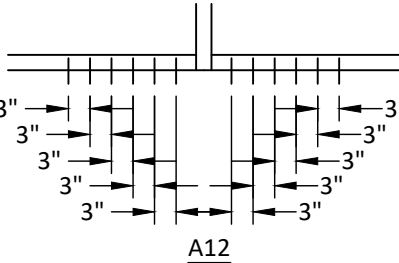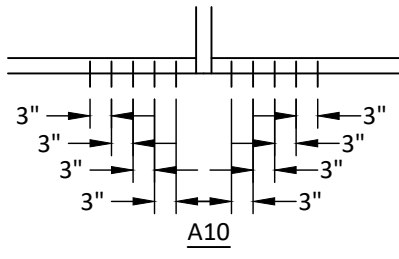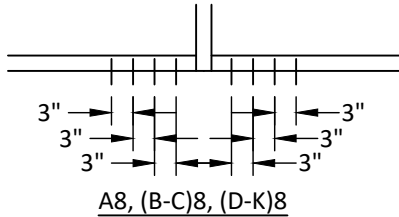

REILLY
ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING

DOOR
(WZ3) (IMPACT)

ANCHOR CAPACITY TABLES

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15

MIAMI, FL 33132

PH: (954) 399-8478

FAX: (954) 744-4738

WEB: www.buildingdrops.com



REMARKS

BY

DATE

2026 FBC UPDATE

LS

06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:

FL47695

DATE: 05.21.2025

DWG. BY:

JR

CHK. BY:

HFN

SCALE:

NTS

DWG. #:

RWD021

SHEET:


11

REV.


A

OF 26


c:\users\sebastianhereros\building drops, including drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:27 PM

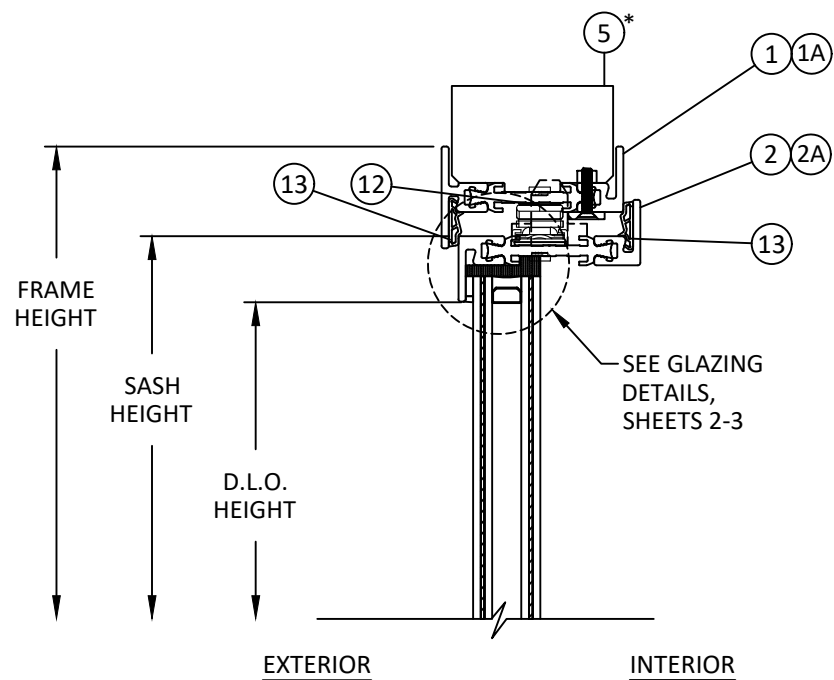

A
12 VERTICAL SECTION
INSIDE GLAZED - HEAD
INSWING DOOR

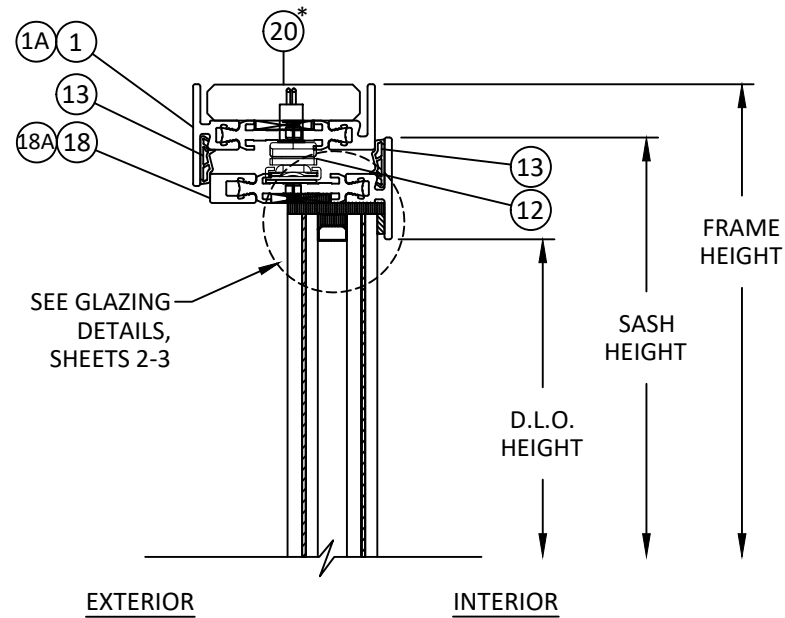


C
12 VERTICAL SECTION
OUTSIDE GLAZED - HEAD
INSWING DOOR

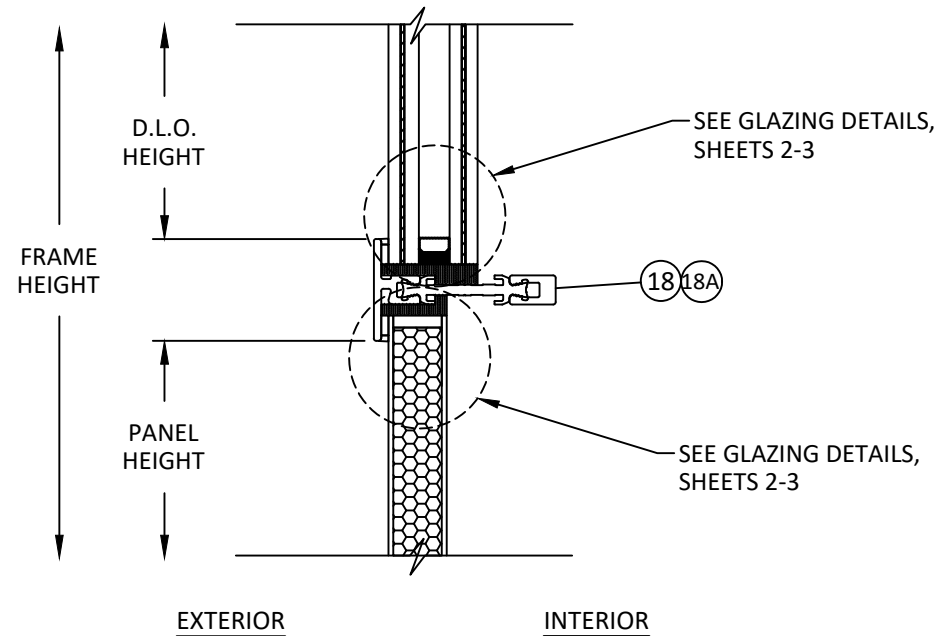


E
12 VERTICAL SECTION
INSIDE GLAZED - MIDRAIL


*NOTE: BLOCKING DEPENDENT
ON INSTALLATION. REFER TO
SHEETS 24-26 FOR MORE
DETAILS.

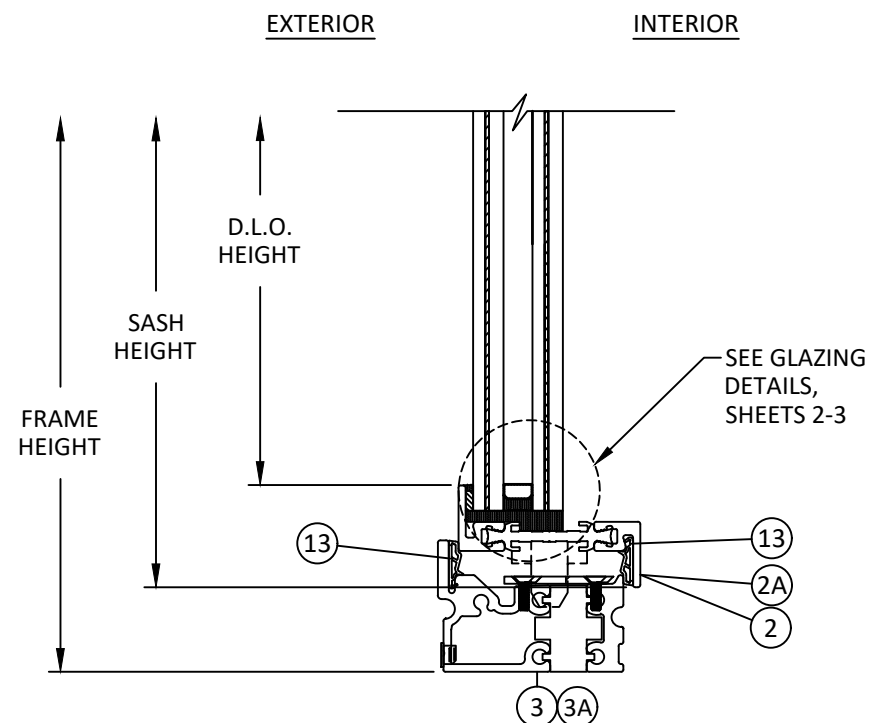

B
12 VERTICAL SECTION
INSIDE GLAZED - SILL
INSWING DOOR

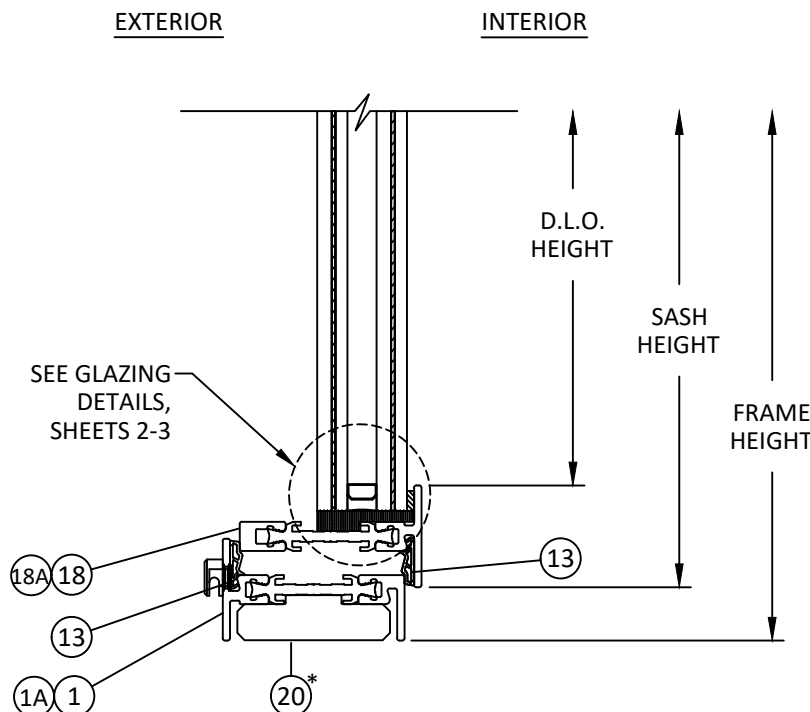

D
12 VERTICAL SECTION
OUTSIDE GLAZED - SILL
INSWING DOOR

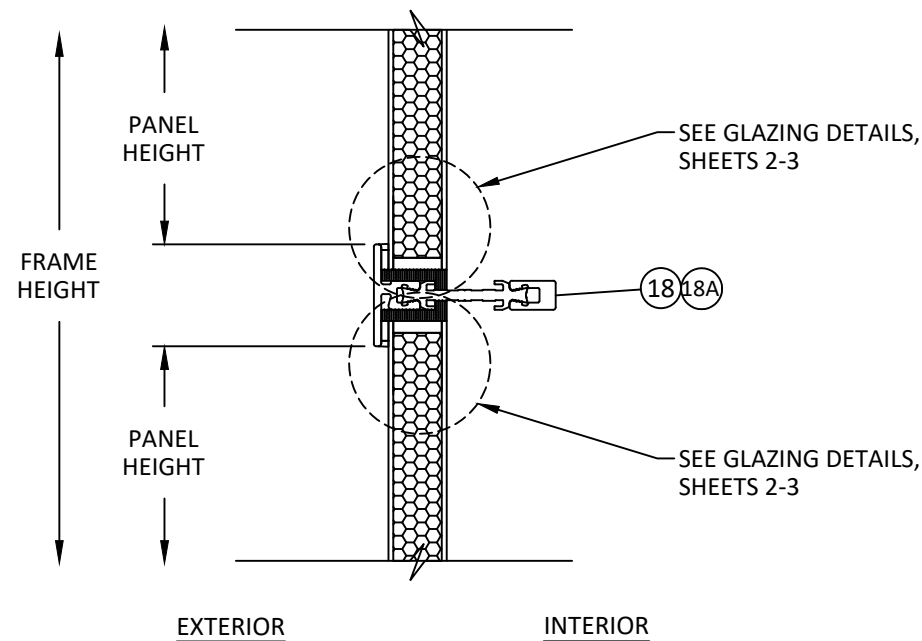

F
12 VERTICAL SECTION
INSIDE GLAZED - MIDRAIL

REILLY
ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
VERTICAL SECTIONS

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

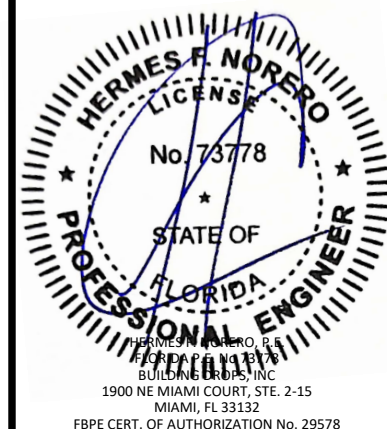


FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	REV.
12	A
OF 26	


c:\users\sebastianhereros\building drops, including drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:27 PM

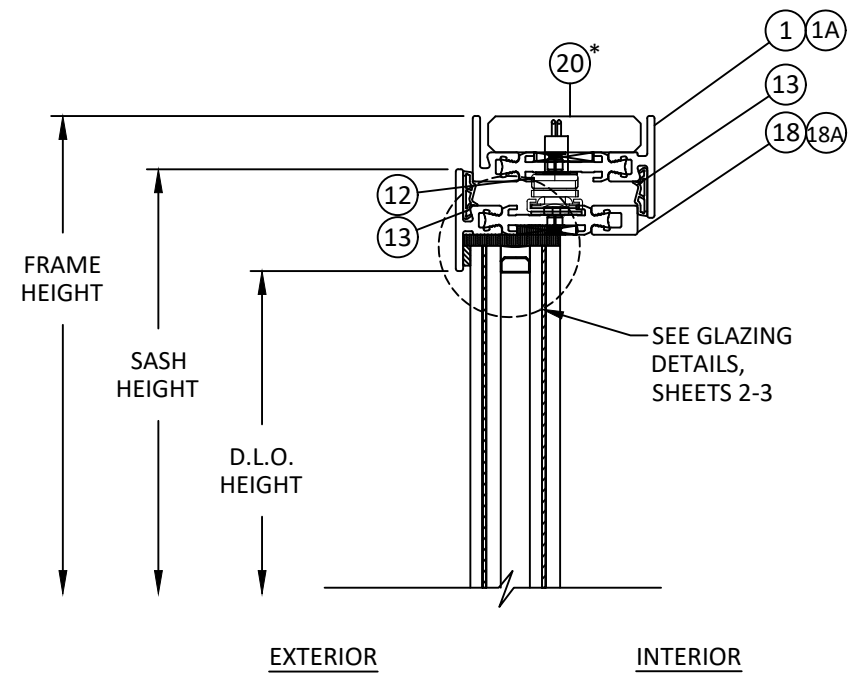

A
13
VERTICAL SECTION
INSIDE GLAZED - HEAD
OUTSWING DOOR

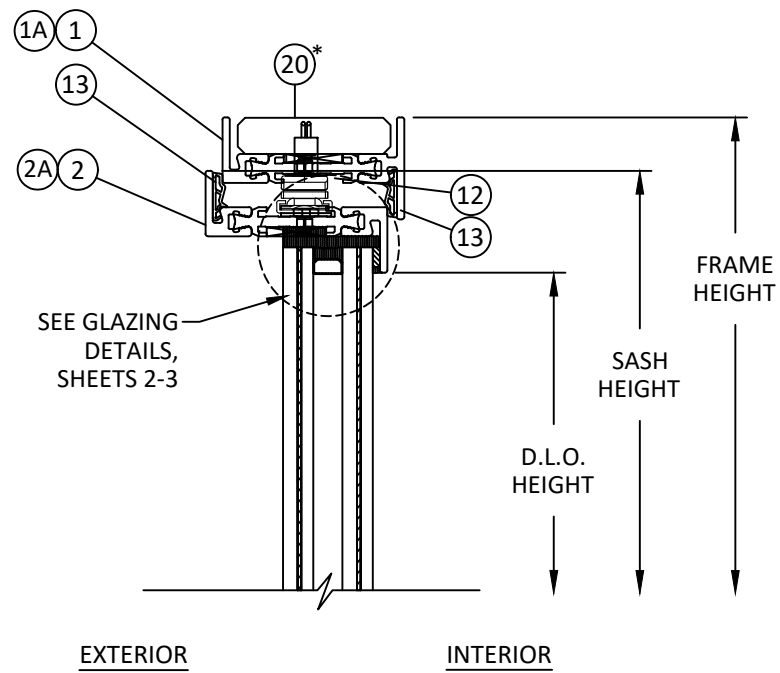


C
13
VERTICAL SECTION
OUTSIDE GLAZED - HEAD
OUTSWING DOOR

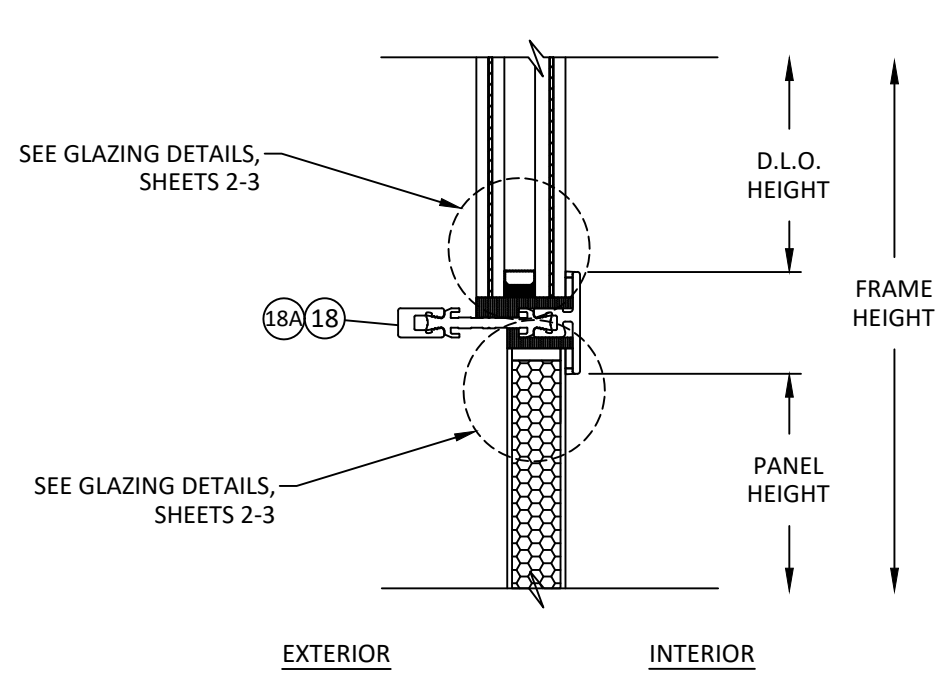


E
13
VERTICAL SECTION
OUTSIDE GLAZED - MIDRAIL


*NOTE: BLOCKING DEPENDENT
ON INSTALLATION. REFER TO
SHEETS 24-26 FOR MORE
DETAILS.

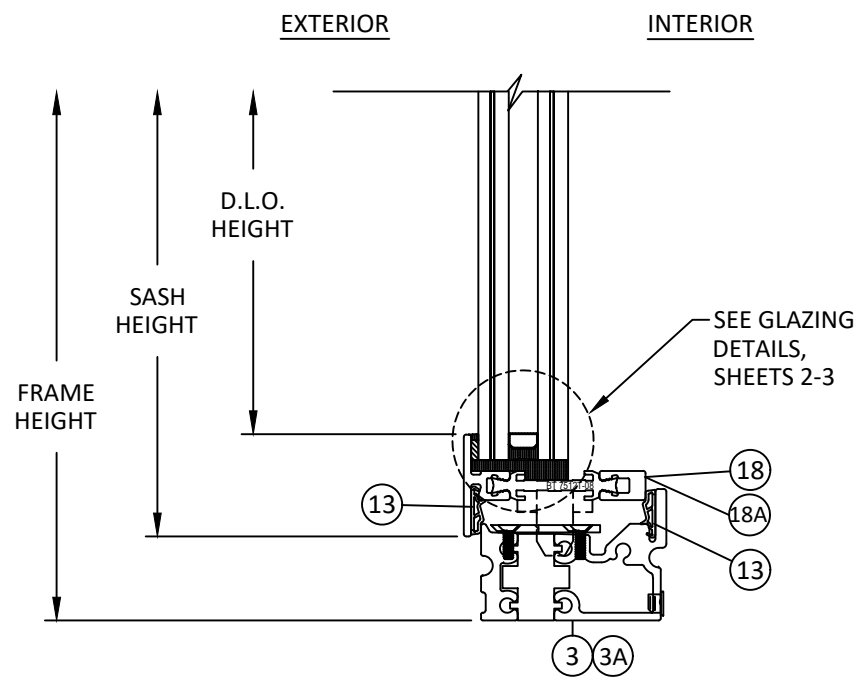

B
13
VERTICAL SECTION
INSIDE GLAZED - SILL
OUTSWING DOOR

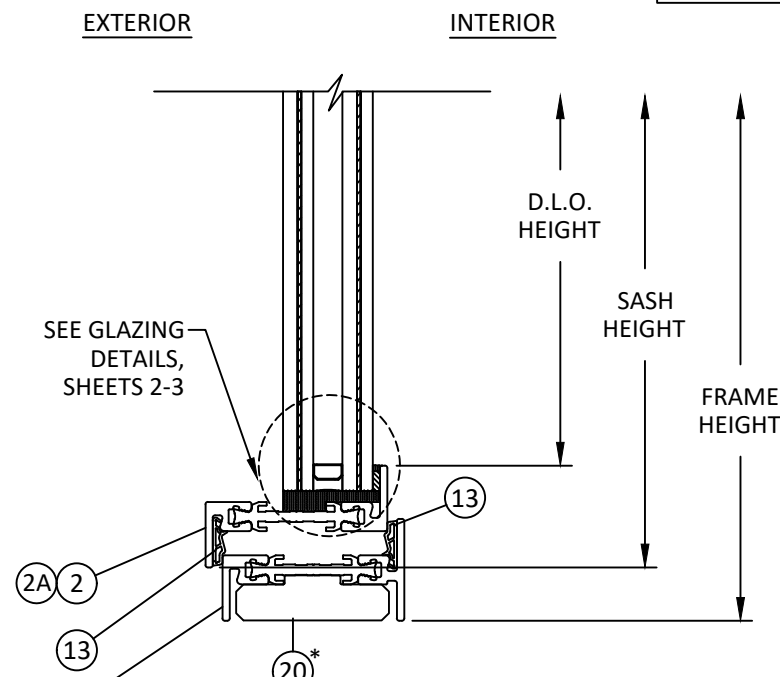

D
13
VERTICAL SECTION
OUTSIDE GLAZED - SILL
OUTSWING DOOR

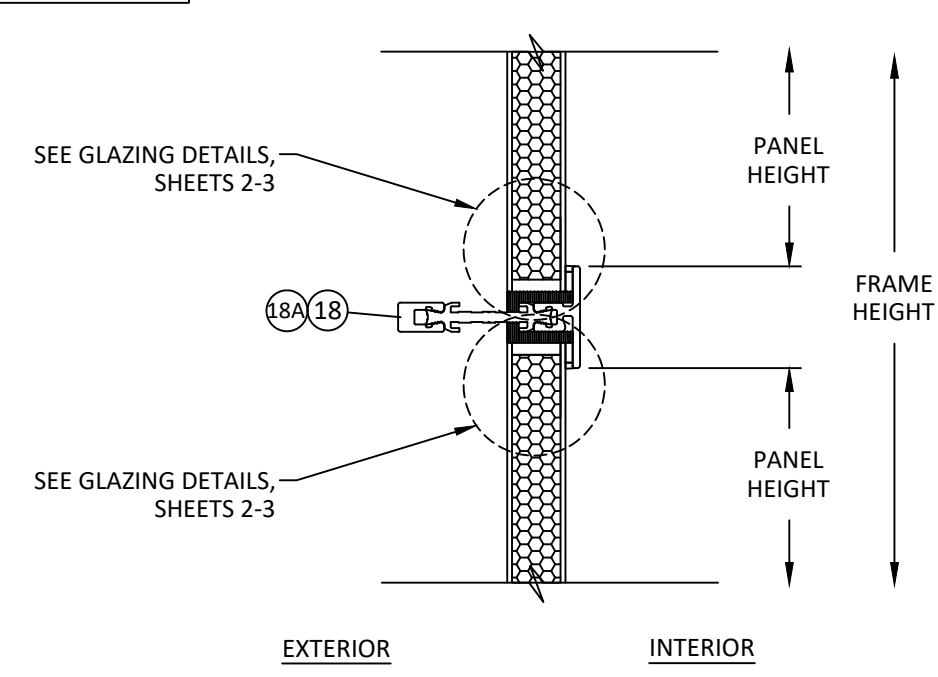


F
13
VERTICAL SECTION
OUTSIDE GLAZED - MIDRAIL

REILLY
ARCHITECTURAL
901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
VERTICAL SECTIONS
PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com


REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

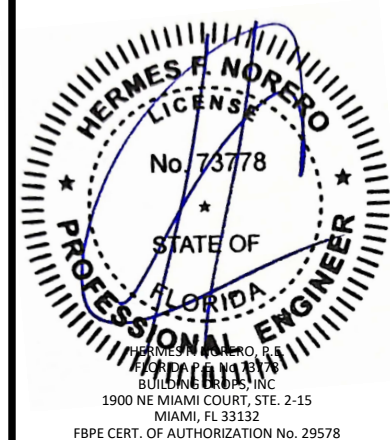


FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	13
REV.	A
	OF 26

c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-r0\rwd021 - a.dwg 8/4/2026 3:27 PM

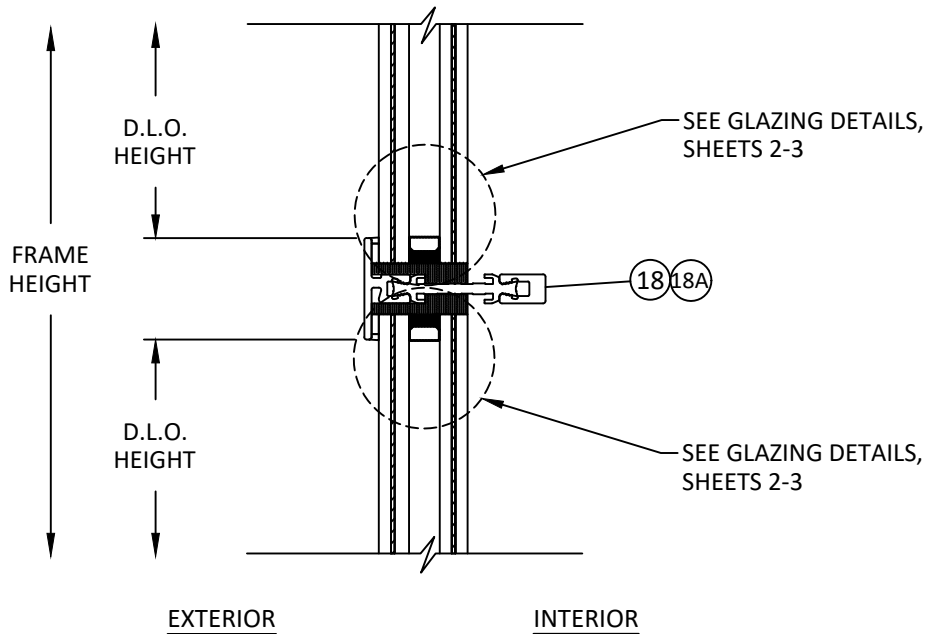

A
14 VERTICAL SECTION
INSIDE GLAZED - MIDRAIL

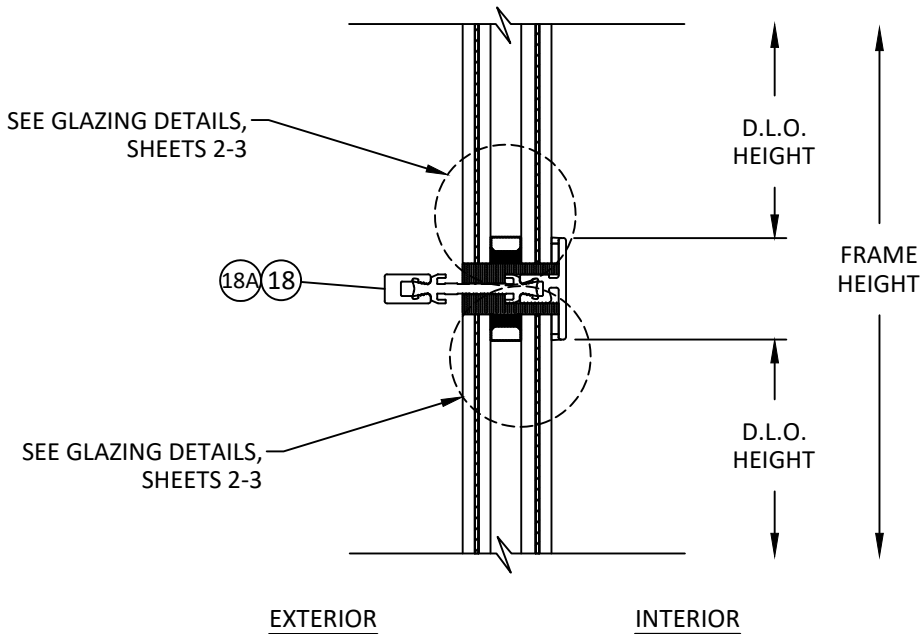

B
14 VERTICAL SECTION
OUTSIDE GLAZED - MIDRAIL

REILLY ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
VERTICAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL47695	
DATE:	05.21.2025	
DWG. BY:	JR	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	RWD021	
SHEET:	14	REV. A
OF 26		


c:\users\sebastianhereros\building drops, including drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change drawings\147695-rwd021 - a.dwg 8/4/2026 3:28 PM

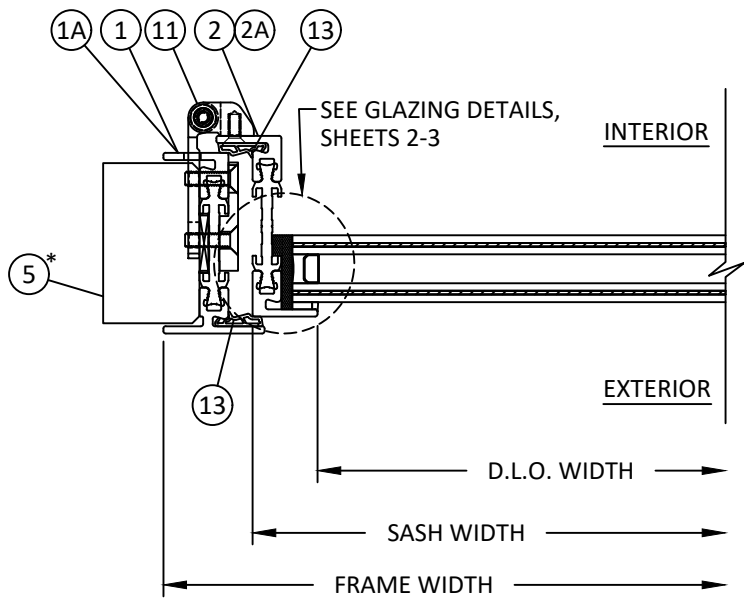

A HORIZONTAL SECTION
15 INSIDE GLAZED - HINGE JAMB
INSWING DOOR

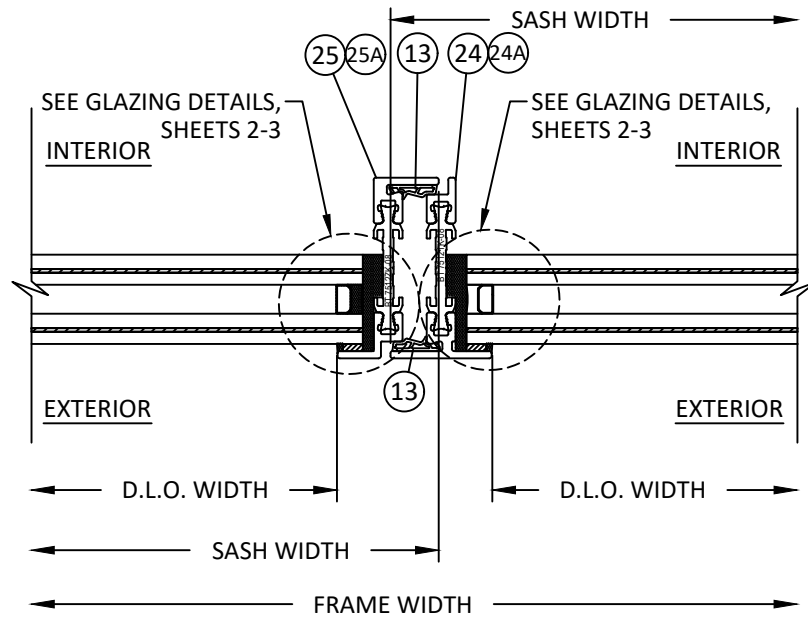


B HORIZONTAL SECTION
15 INSIDE GLAZED - ASTRAGAL
INSWING DOOR

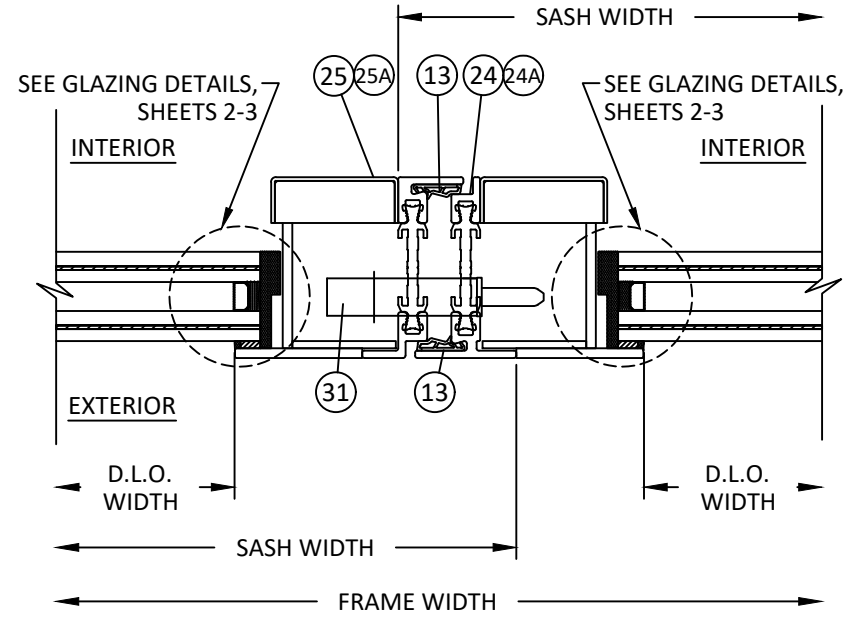


C HORIZONTAL SECTION
15 INSIDE GLAZED - LOCK BOX
INSWING DOOR


*NOTE: BLOCKING DEPENDENT
ON INSTALLATION. REFER TO
SHEETS 24-26 FOR MORE
DETAILS.

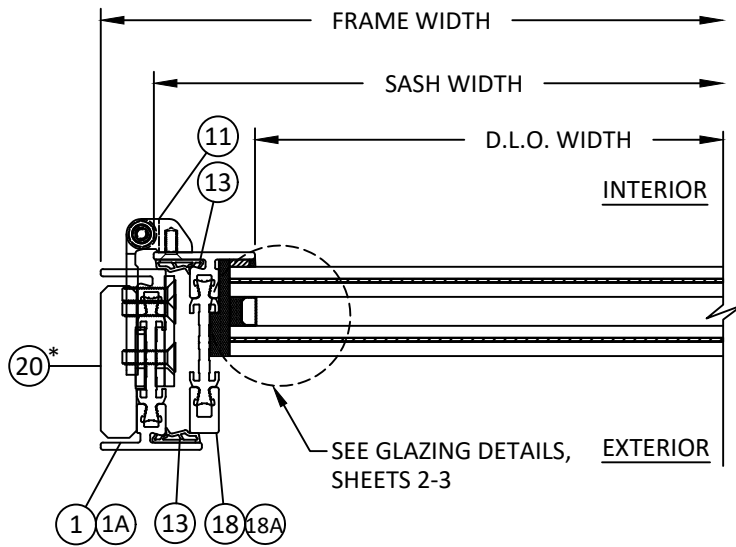

D HORIZONTAL SECTION
15 OUTSIDE GLAZED - HINGE JAMB
INSWING DOOR

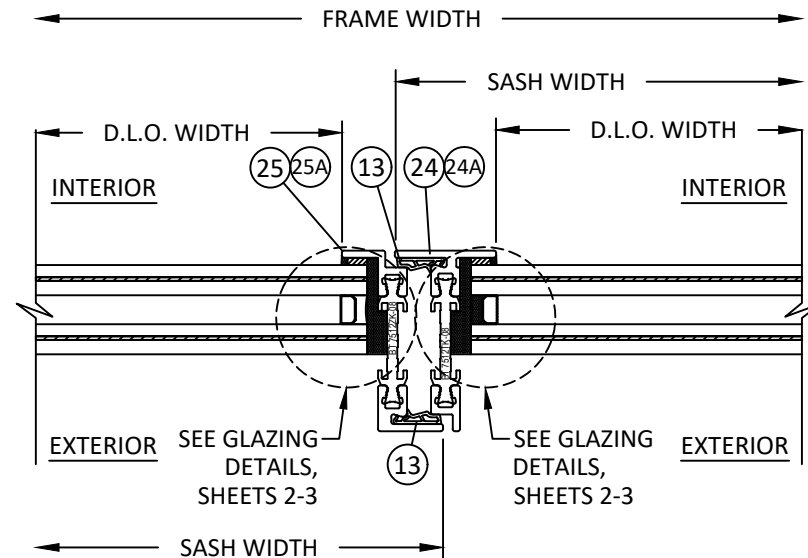

E HORIZONTAL SECTION
15 OUTSIDE GLAZED - ASTRAGAL
INSWING DOOR

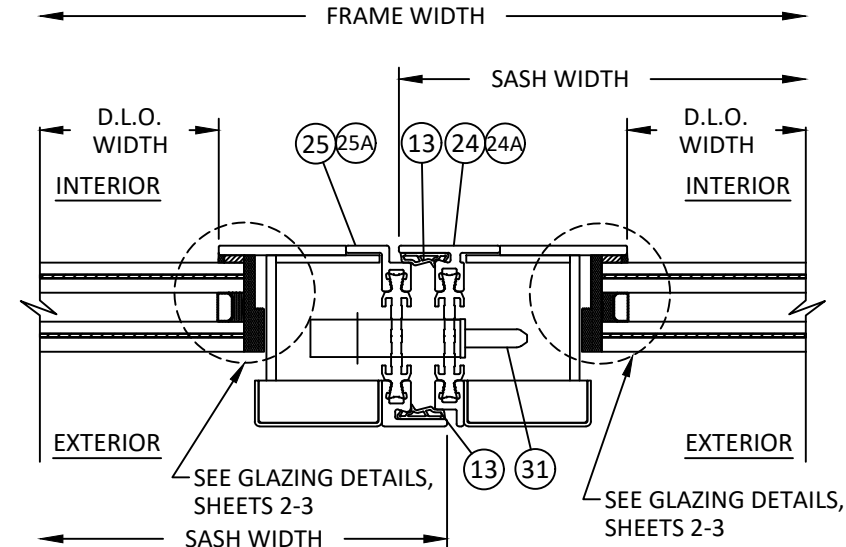

F HORIZONTAL SECTION
15 OUTSIDE GLAZED - LOCK BOX
INSWING DOOR

REILLY
ARCHITECTURAL
901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)

HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	15
REV.	A




***NOTE: BLOCKING DEPENDENT
ON INSTALLATION. REFER TO
SHEETS 24-26 FOR MORE
DETAILS.**




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

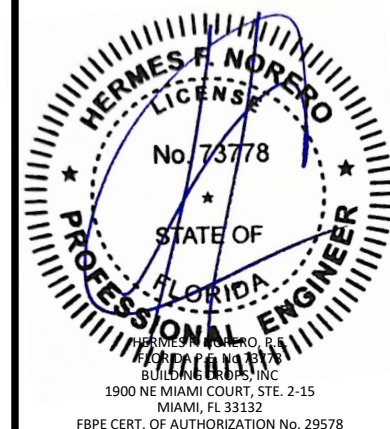


FL #:	
FL47695	
DATE: 05.21.2025	
DWG. BY: JR	CHK. BY: HFN
SCALE: NTS	
DWG. #: RWD021	
SHEET:	REV. A
16	
OF 26	

c:\users\sebastianhereros\building drops, inc\building drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change projects\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:28 PM

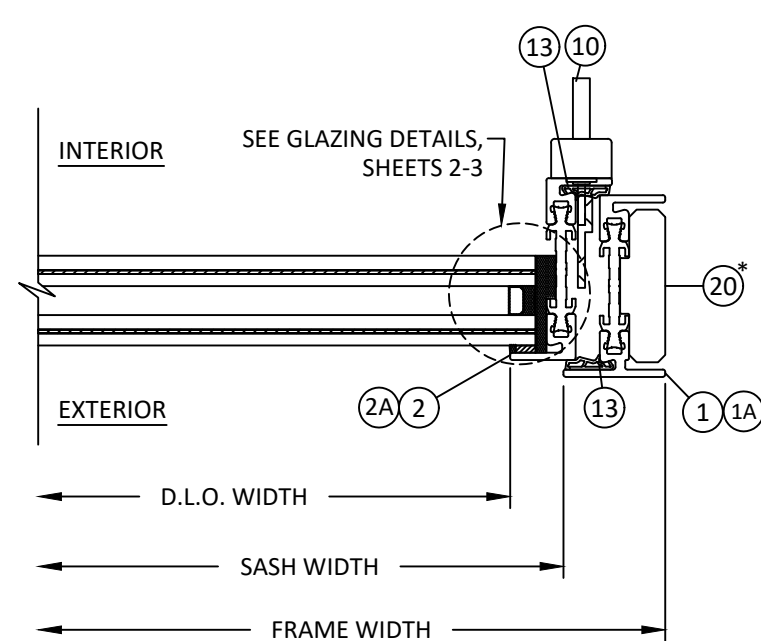


A
17 HORIZONTAL SECTION
INSIDE GLAZED - LOCK JAMB
INSWING DOOR

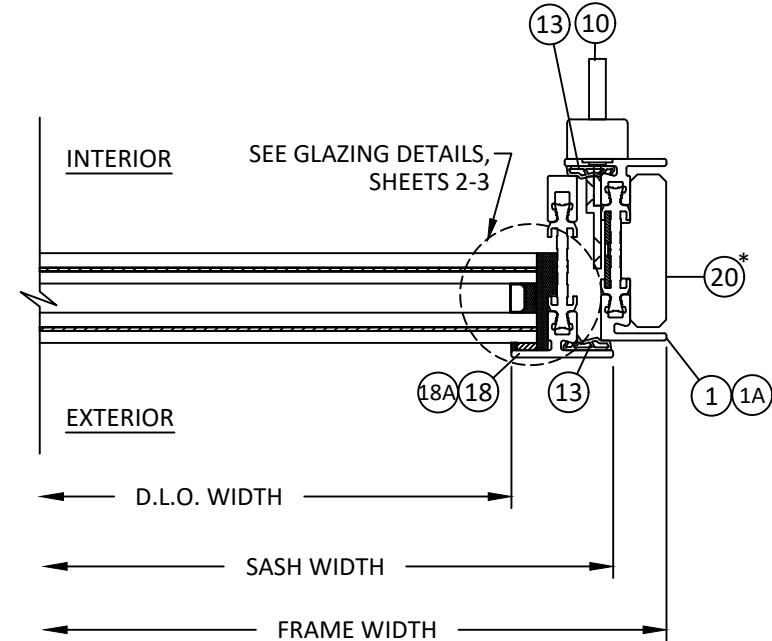


B
17 HORIZONTAL SECTION
INSIDE GLAZED - LOCK JAMB
OUTSWING DOOR


*NOTE: BLOCKING DEPENDENT
ON INSTALLATION. REFER TO
SHEETS 24-26 FOR MORE
DETAILS.

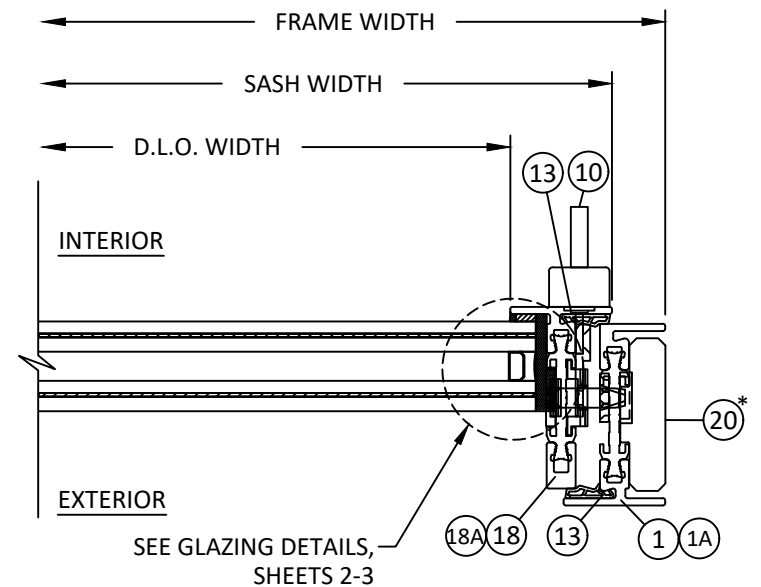


D
17 HORIZONTAL SECTION
OUTSIDE GLAZED - LOCK JAMB
INSWING DOOR

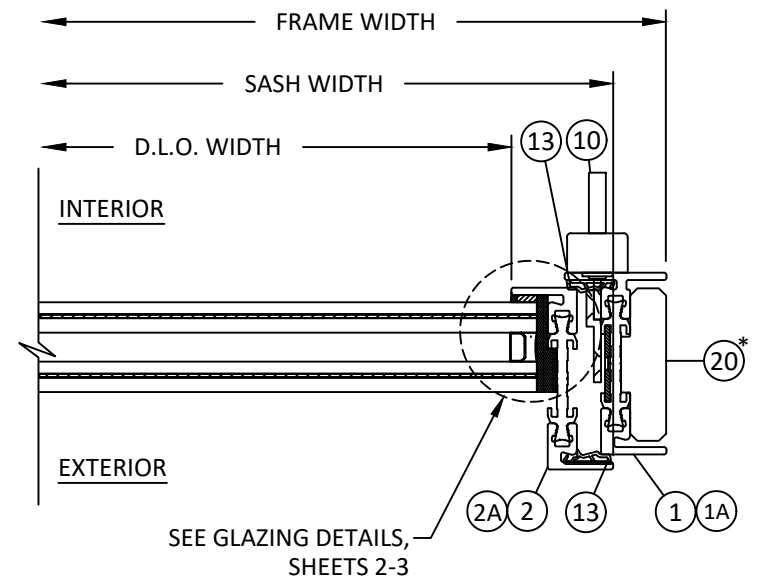

E
17 HORIZONTAL SECTION
OUTSIDE GLAZED - LOCK JAMB
OUTSWING DOOR

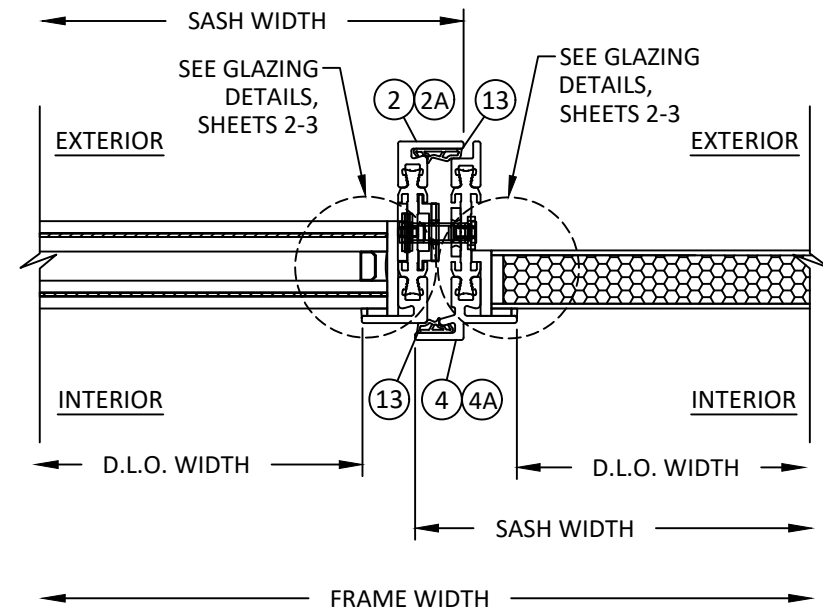

C
17 HORIZONTAL SECTION
INSIDE GLAZED - MEETING STILE
INSWING DOOR

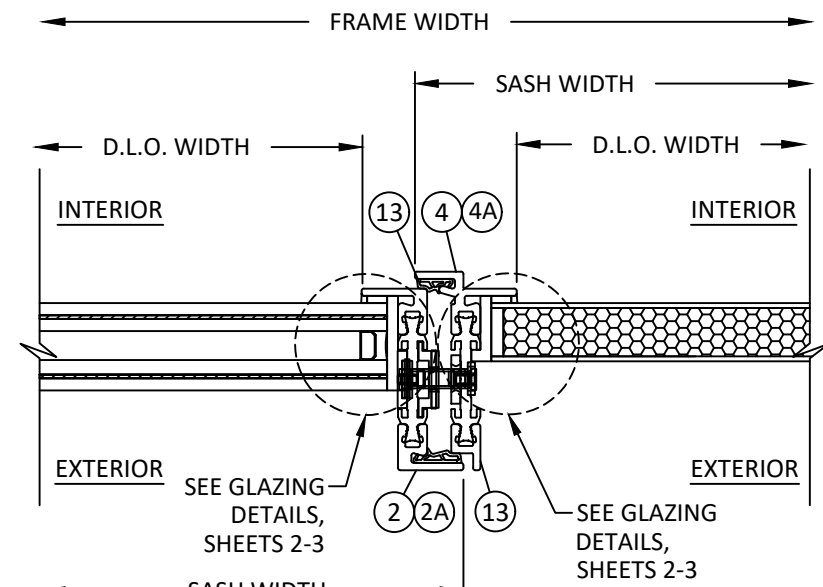

F
17 HORIZONTAL SECTION
OUTSIDE GLAZED - MEETING STILE
OUTSWING DOOR

REILLY
ARCHITECTURAL
901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
HORIZONTAL SECTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

B.D.
BUILDING DROPS

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL47695

DATE: **05.21.2025**

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------


SCALE: **NTS**

DWG. #: **RWD021**

SHEET: 17	REV. A
---------------------	------------------


OF 26

c:\users\sebastianherrerros\building drops, including drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587-1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:28 PM

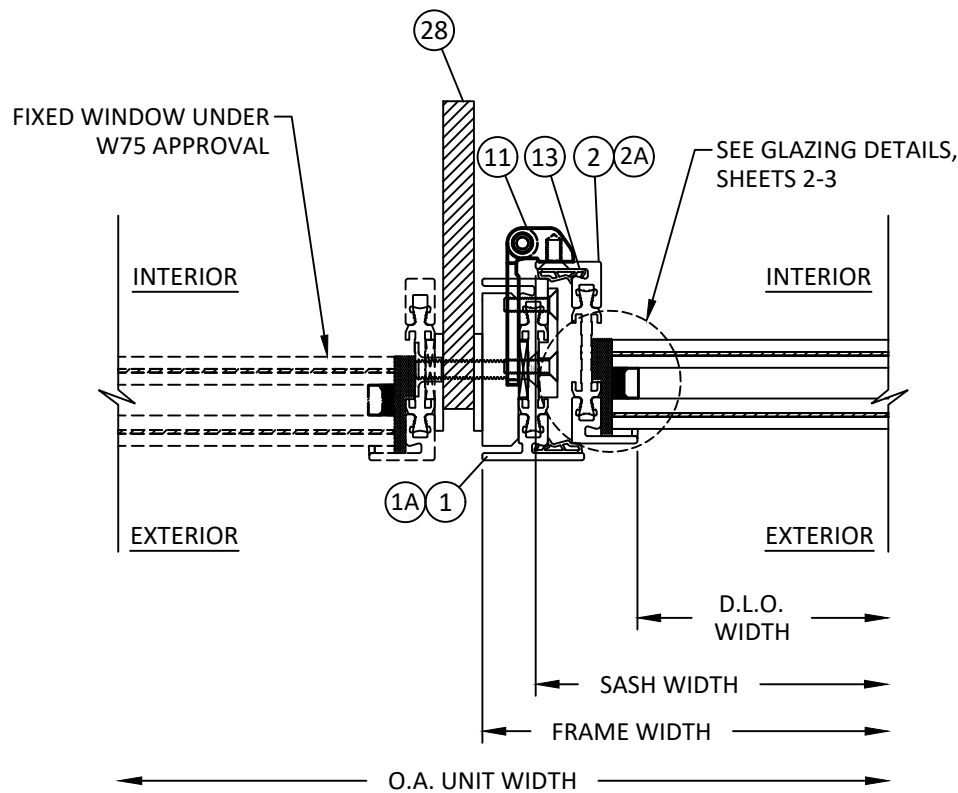


A
18 HORIZONTAL SECTION
1/2" X 5" MULLION DETAIL

NOTE: VERTICAL MULLION DETAIL SHOWN
QUALIFIED AS HORIZONTAL MULLION.

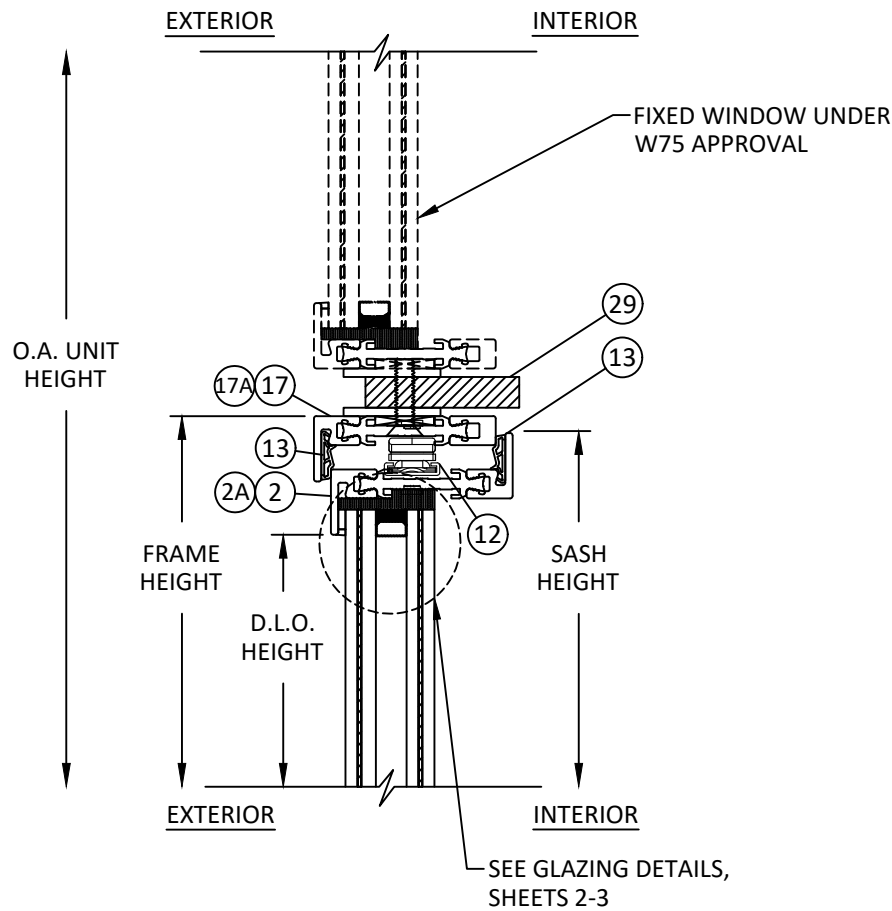

B
18 VERTICAL SECTION
1/2" X 2-1/2" MULLION DETAIL

NOTE: HORIZONTAL MULLION DETAIL SHOWN
QUALIFIED AS VERTICAL MULLION.

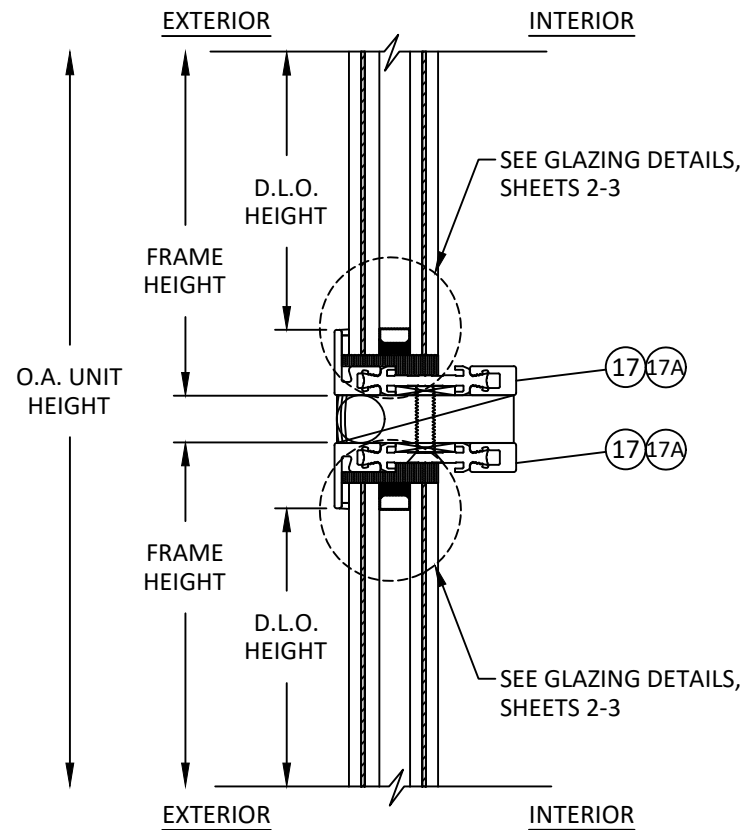

C
18 VERTICAL SECTION
TRANSOM TO SIDELITE MULLION

REILLY ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)

MULLION SECTIONS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	18
REV.	A

c:\users\sebastian\hereros\building drops, including drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-r0\rvd021 - a.dwg 8/4/2026 3:28 PM

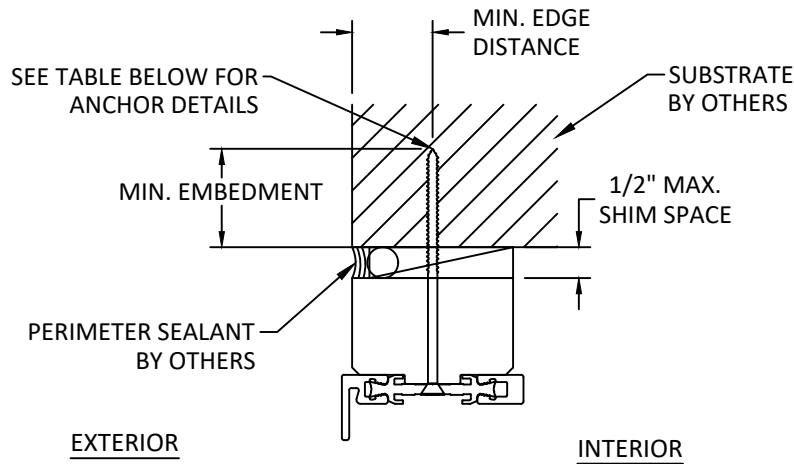

A
19 **VERTICAL SECTION**
HEAD - THROUGH FRAME
JAMB AND SILL SIMILAR
INSIDE GLAZED

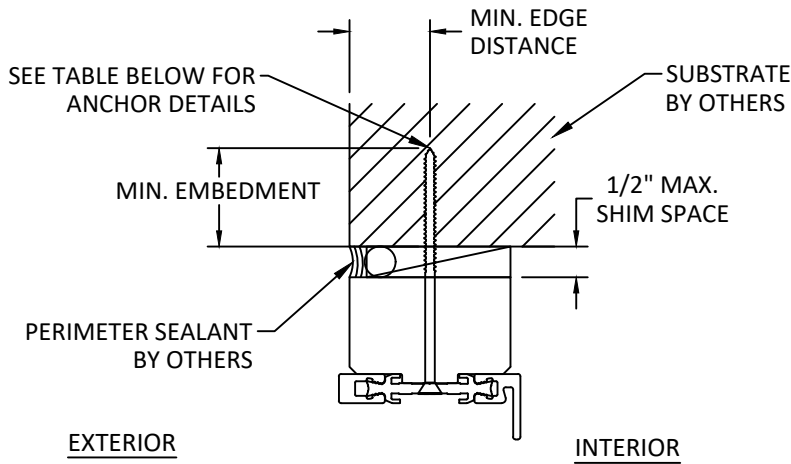

B
19 **VERTICAL SECTION**
HEAD - THROUGH FRAME
JAMB AND SILL SIMILAR
OUTSIDE GLAZED

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN FOR THROUGH FRAME INSTALLATION AND TWO (2) INSTALLATION ANCHORS ARE REQUIRED AT EACH ANCHOR LOCATION SHOWN FOR CLIP AND ANGLE INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/2 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING:
 - FASTENERS USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE AND INSTALLED IN ENCLOSED SPACES SHALL BE GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.1 (E.G., ASTM A153 CLASS D, ASTM A641 CLASS 3S, OR EQUIVALENT CORROSION RESISTANCE).
 - CONNECTORS AND METAL PLATES USED WITHIN 3,000 FEET OF A SALTWATER COASTLINE SHALL BE STANDARD GALVANIZED IN ACCORDANCE WITH SECTION 1711.1.2 (E.G., ASTM A653 G90, ASTM A123, OR PROTECTIVE COATING PER TPI 1).
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE					
METHOD	QUANTITY PER LOCATION	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	1	WOOD: MIN. SG = 0.55	#10 / #12 WOOD SCREW	1.50"	0.75"
		METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#10 / #12 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"
		CONCRETE: f'c=3000PSI	3/16" / 1/4" ITW TAPCON	1.25"	2.50"
		MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" / 1/4" ITW TAPCON	1.00"	4.00"
ALUMINUM / STEEL FLAT CLIP, ALUMINUM / STEEL BENT EXTERIOR CLIP, ALUMINUM / STEEL BENT INTERIOR CLIP, ALUMINUM / STEEL ANGLE	2	WOOD: MIN. SG = 0.55	#10 / #12 WOOD SCREW	1.50"	0.75"
		METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#10 / #12 SELF-DRILLING SCREW	3 THREADS MIN PENETRATION BEYOND STRUCTURE	0.50"
		CONCRETE: f'c=3000PSI	3/16" / 1/4" ITW TAPCON	1.25"	2.50"
		MASONRY: CMU per ASTM C90 MIN. 2000 PSI	3/16" / 1/4" ITW TAPCON	1.00"	4.00"

REILLY
ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
ANCHOR DETAILS,
ANCHOR SCHEDULE, &
INSTALLATION NOTES

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:
FL47695

DATE: **05.21.2025**

DWG. BY: JR	CHK. BY: HFN
-----------------------	------------------------


SCALE: **NTS**

DWG. #: **RWD021**


SHEET: 19	REV. A
---------------------	------------------

OF 26


c:\users\sebastianherrerros\building drops, including drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:28 PM

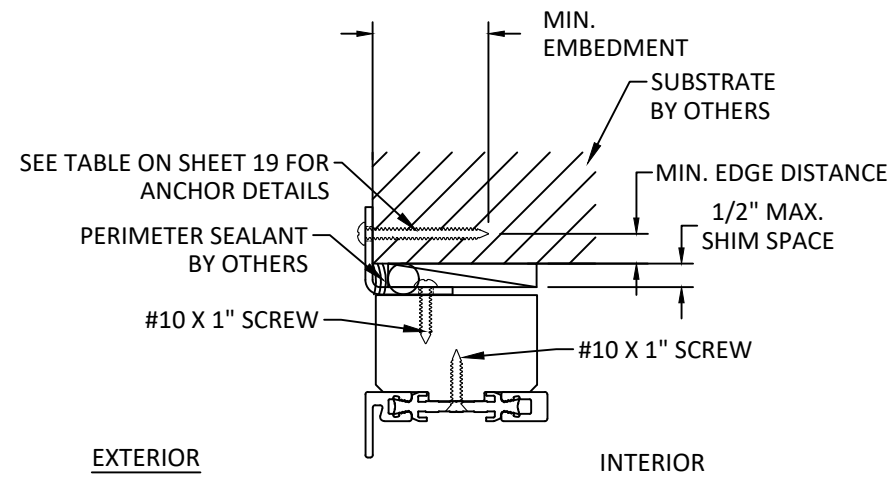

A
20 VERTICAL SECTION
HEAD - ALUMINUM/STEEL BENT EXT. CLIP
JAMB AND SILL SIMILAR
INSIDE GLAZED

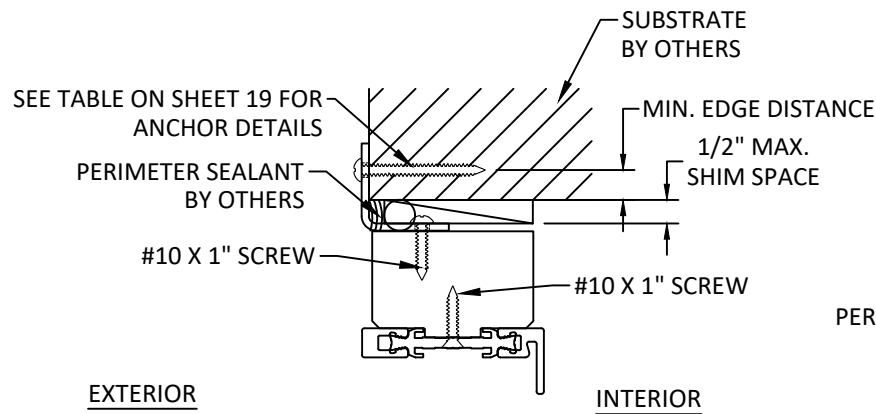


B
20 VERTICAL SECTION
HEAD - ALUMINUM/STEEL BENT EXT. CLIP
JAMB AND SILL SIMILAR
OUTSIDE GLAZED

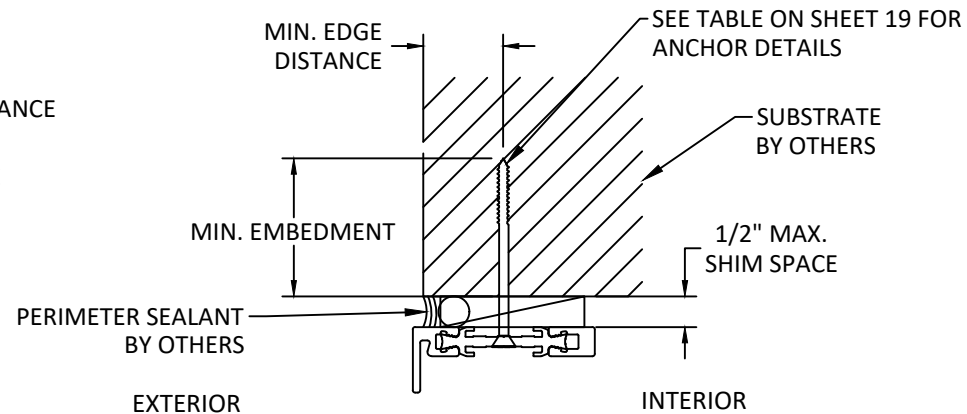


C
20 VERTICAL SECTION
HEAD - THROUGH FRAME
JAMB AND SILL SIMILAR
INSIDE GLAZED

NOTE: THROUGH FRAME INSTALLATION WITHOUT
BLOCKING ONLY QUALIFIED FOR FLAT PROFILE.

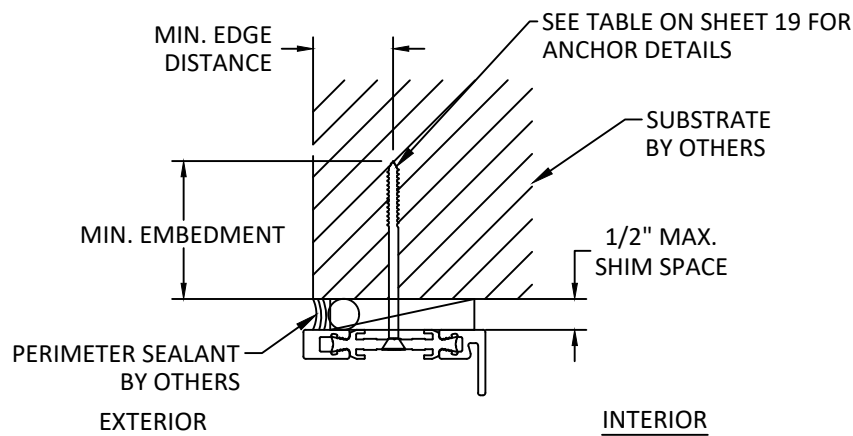


D
20 VERTICAL SECTION
HEAD - THROUGH FRAME
JAMB AND SILL SIMILAR
OUTSIDE GLAZED

NOTE: THROUGH FRAME INSTALLATION WITHOUT
BLOCKING ONLY QUALIFIED FOR FLAT PROFILE.

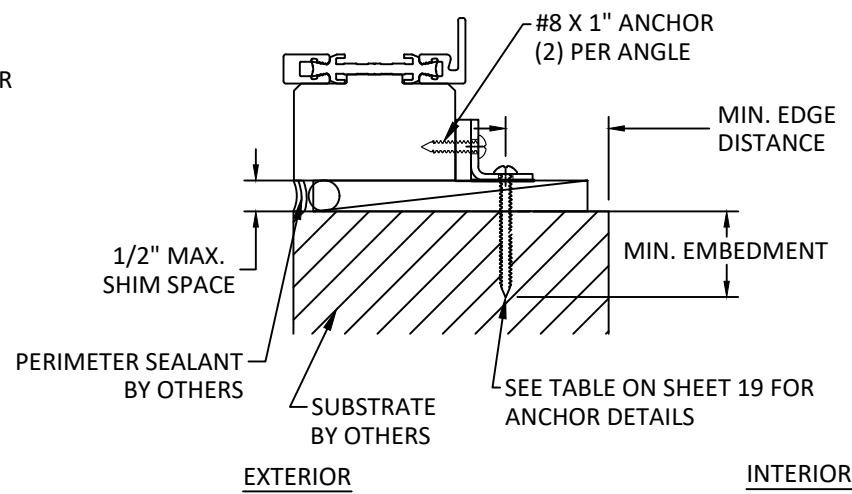

E
20 VERTICAL SECTION
SILL - 3/4" X 3/4" ALUMINUM/STEEL ANGLE
OUTSIDE GLAZED

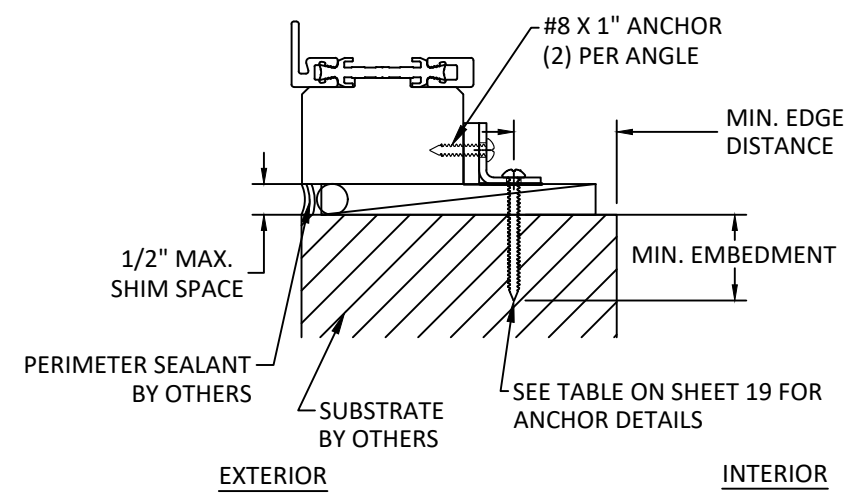

F
20 VERTICAL SECTION
SILL - 3/4" X 3/4" ALUMINUM/STEEL ANGLE
INSIDE GLAZED


TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
ANCHOR DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.

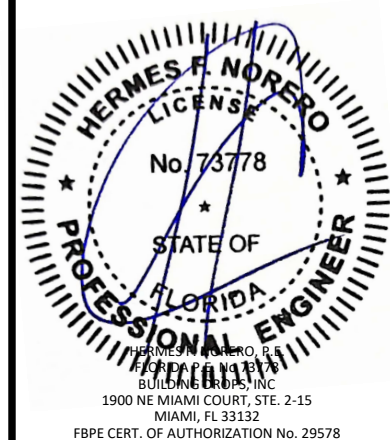


FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	JR
CHK. BY:	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	20
REV.	A
OF 26	

c:\users\sebastianhereros\building drops, including drops landing - common\projects\2026 code change projects\reilly architectural\c-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:28 PM

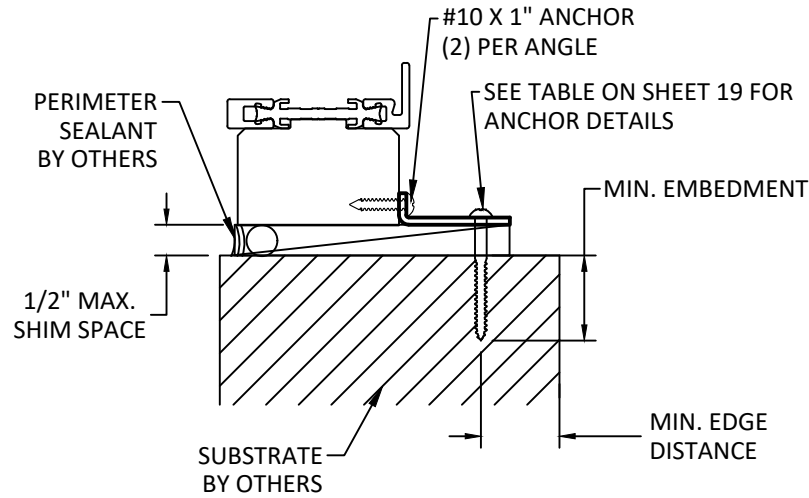


EXTERIOR INTERIOR

A
21 VERTICAL SECTION
SILL - 1/2" X 1-4/5" ALUMINUM/STEEL ANGLE
OUTSIDE GLAZED

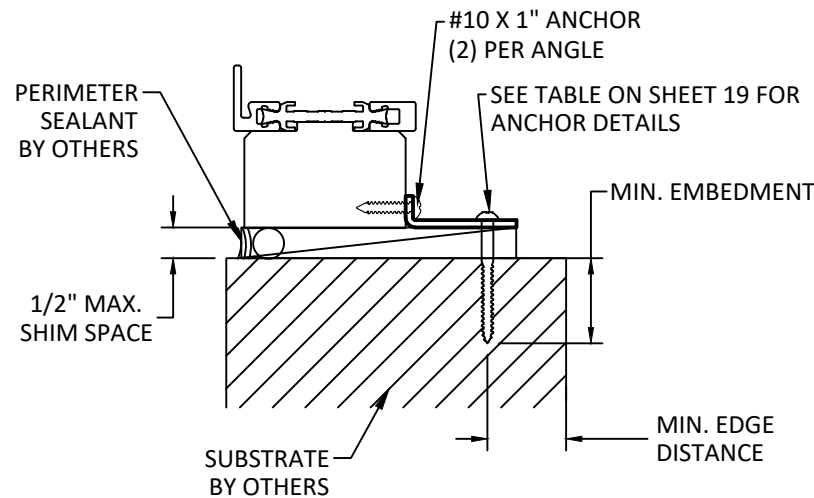


EXTERIOR INTERIOR

B
21 VERTICAL SECTION
SILL - 1/2" X 1-4/5" ALUMINUM/STEEL ANGLE
INSIDE GLAZED

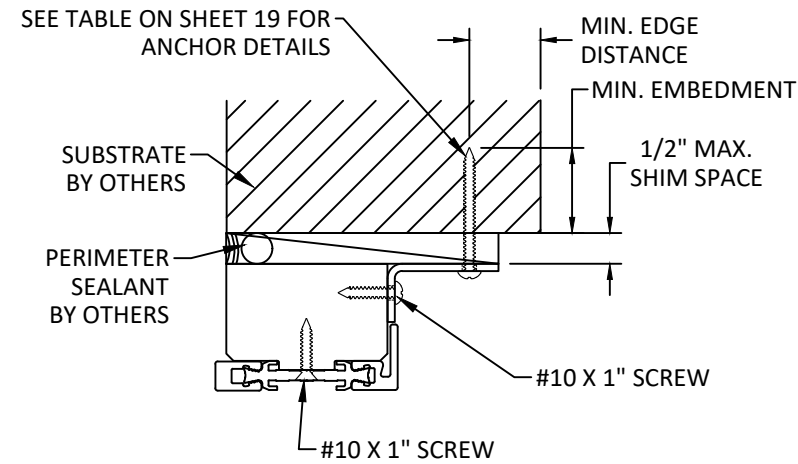


EXTERIOR INTERIOR

C
21 VERTICAL SECTION
HEAD - ALUMINUM/STEEL BENT INT. CLIP
JAMB SIMILAR
OUTSIDE GLAZED

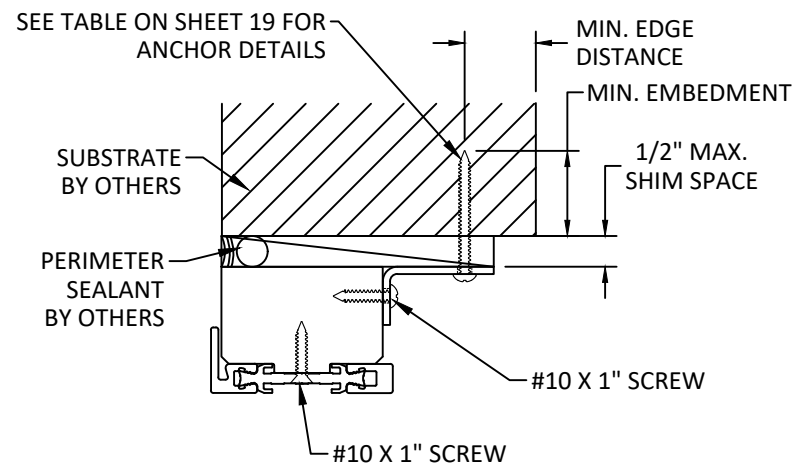


EXTERIOR INTERIOR

D
21 VERTICAL SECTION
HEAD - ALUMINUM/STEEL BENT INT. CLIP
JAMB SIMILAR
INSIDE GLAZED

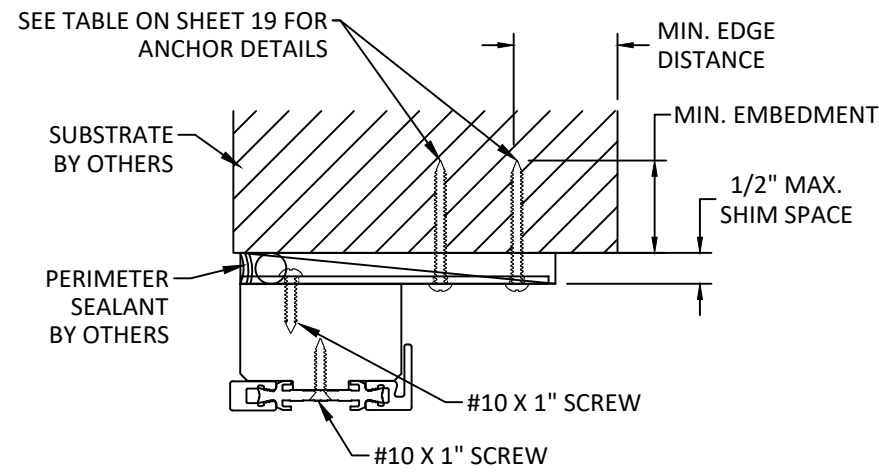

EXTERIOR INTERIOR

E
21 VERTICAL SECTION
HEAD - ALUMINUM/STEEL FLAT CLIP
JAMB SIMILAR
OUTSIDE GLAZED

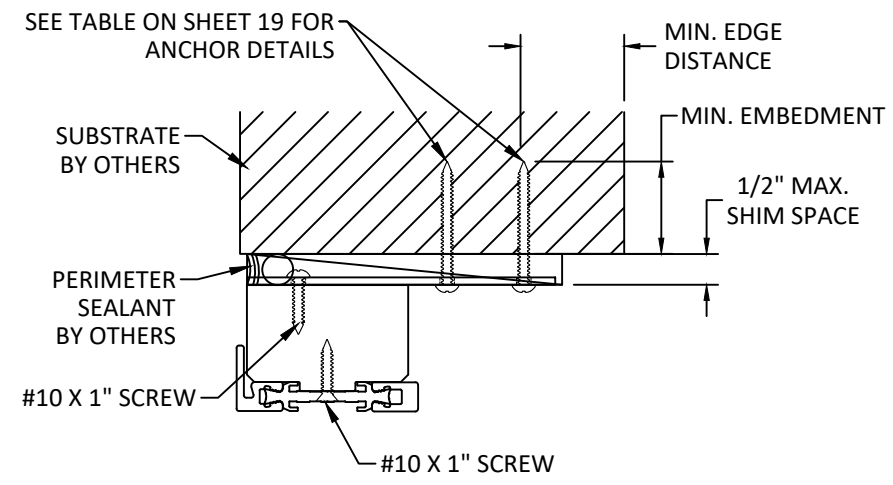

EXTERIOR INTERIOR

F
21 VERTICAL SECTION
HEAD - ALUMINUM/STEEL FLAT CLIP
JAMB SIMILAR
INSIDE GLAZED

REILLY ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
ANCHOR DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL47695	
DATE:	05.21.2025	
DWG. BY:	JR	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	RWD021	
SHEET:	21	REV. A
OF 26		

c:\users\sebastianherrerros\building drops, inc\building drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:28 PM

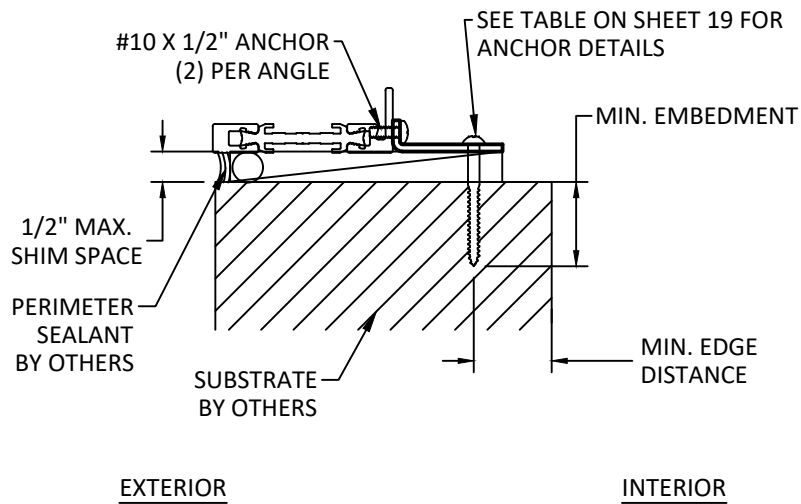

A
22 VERTICAL SECTION
SILL - 1/2" X 1-4/5" ALUMINUM/STEEL ANGLE
OUTSIDE GLAZED

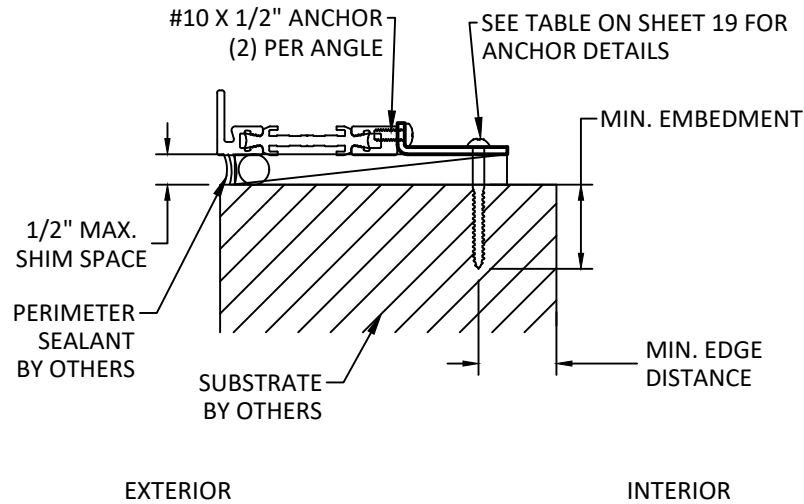

B
22 VERTICAL SECTION
SILL - 1/2" X 1-4/5" ALUMINUM/STEEL ANGLE
INSIDE GLAZED


TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
ANCHOR DETAILS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

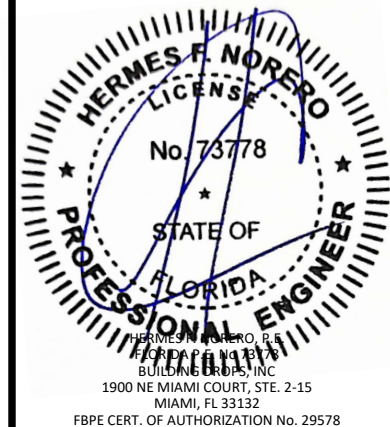

FL #:	FL47695	
DATE:	05.21.2025	
DWG. BY:	JR	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	RWD021	
SHEET:	22	REV. A
OF 26		

QUALIFIED FRAME PROFILE OPTIONS

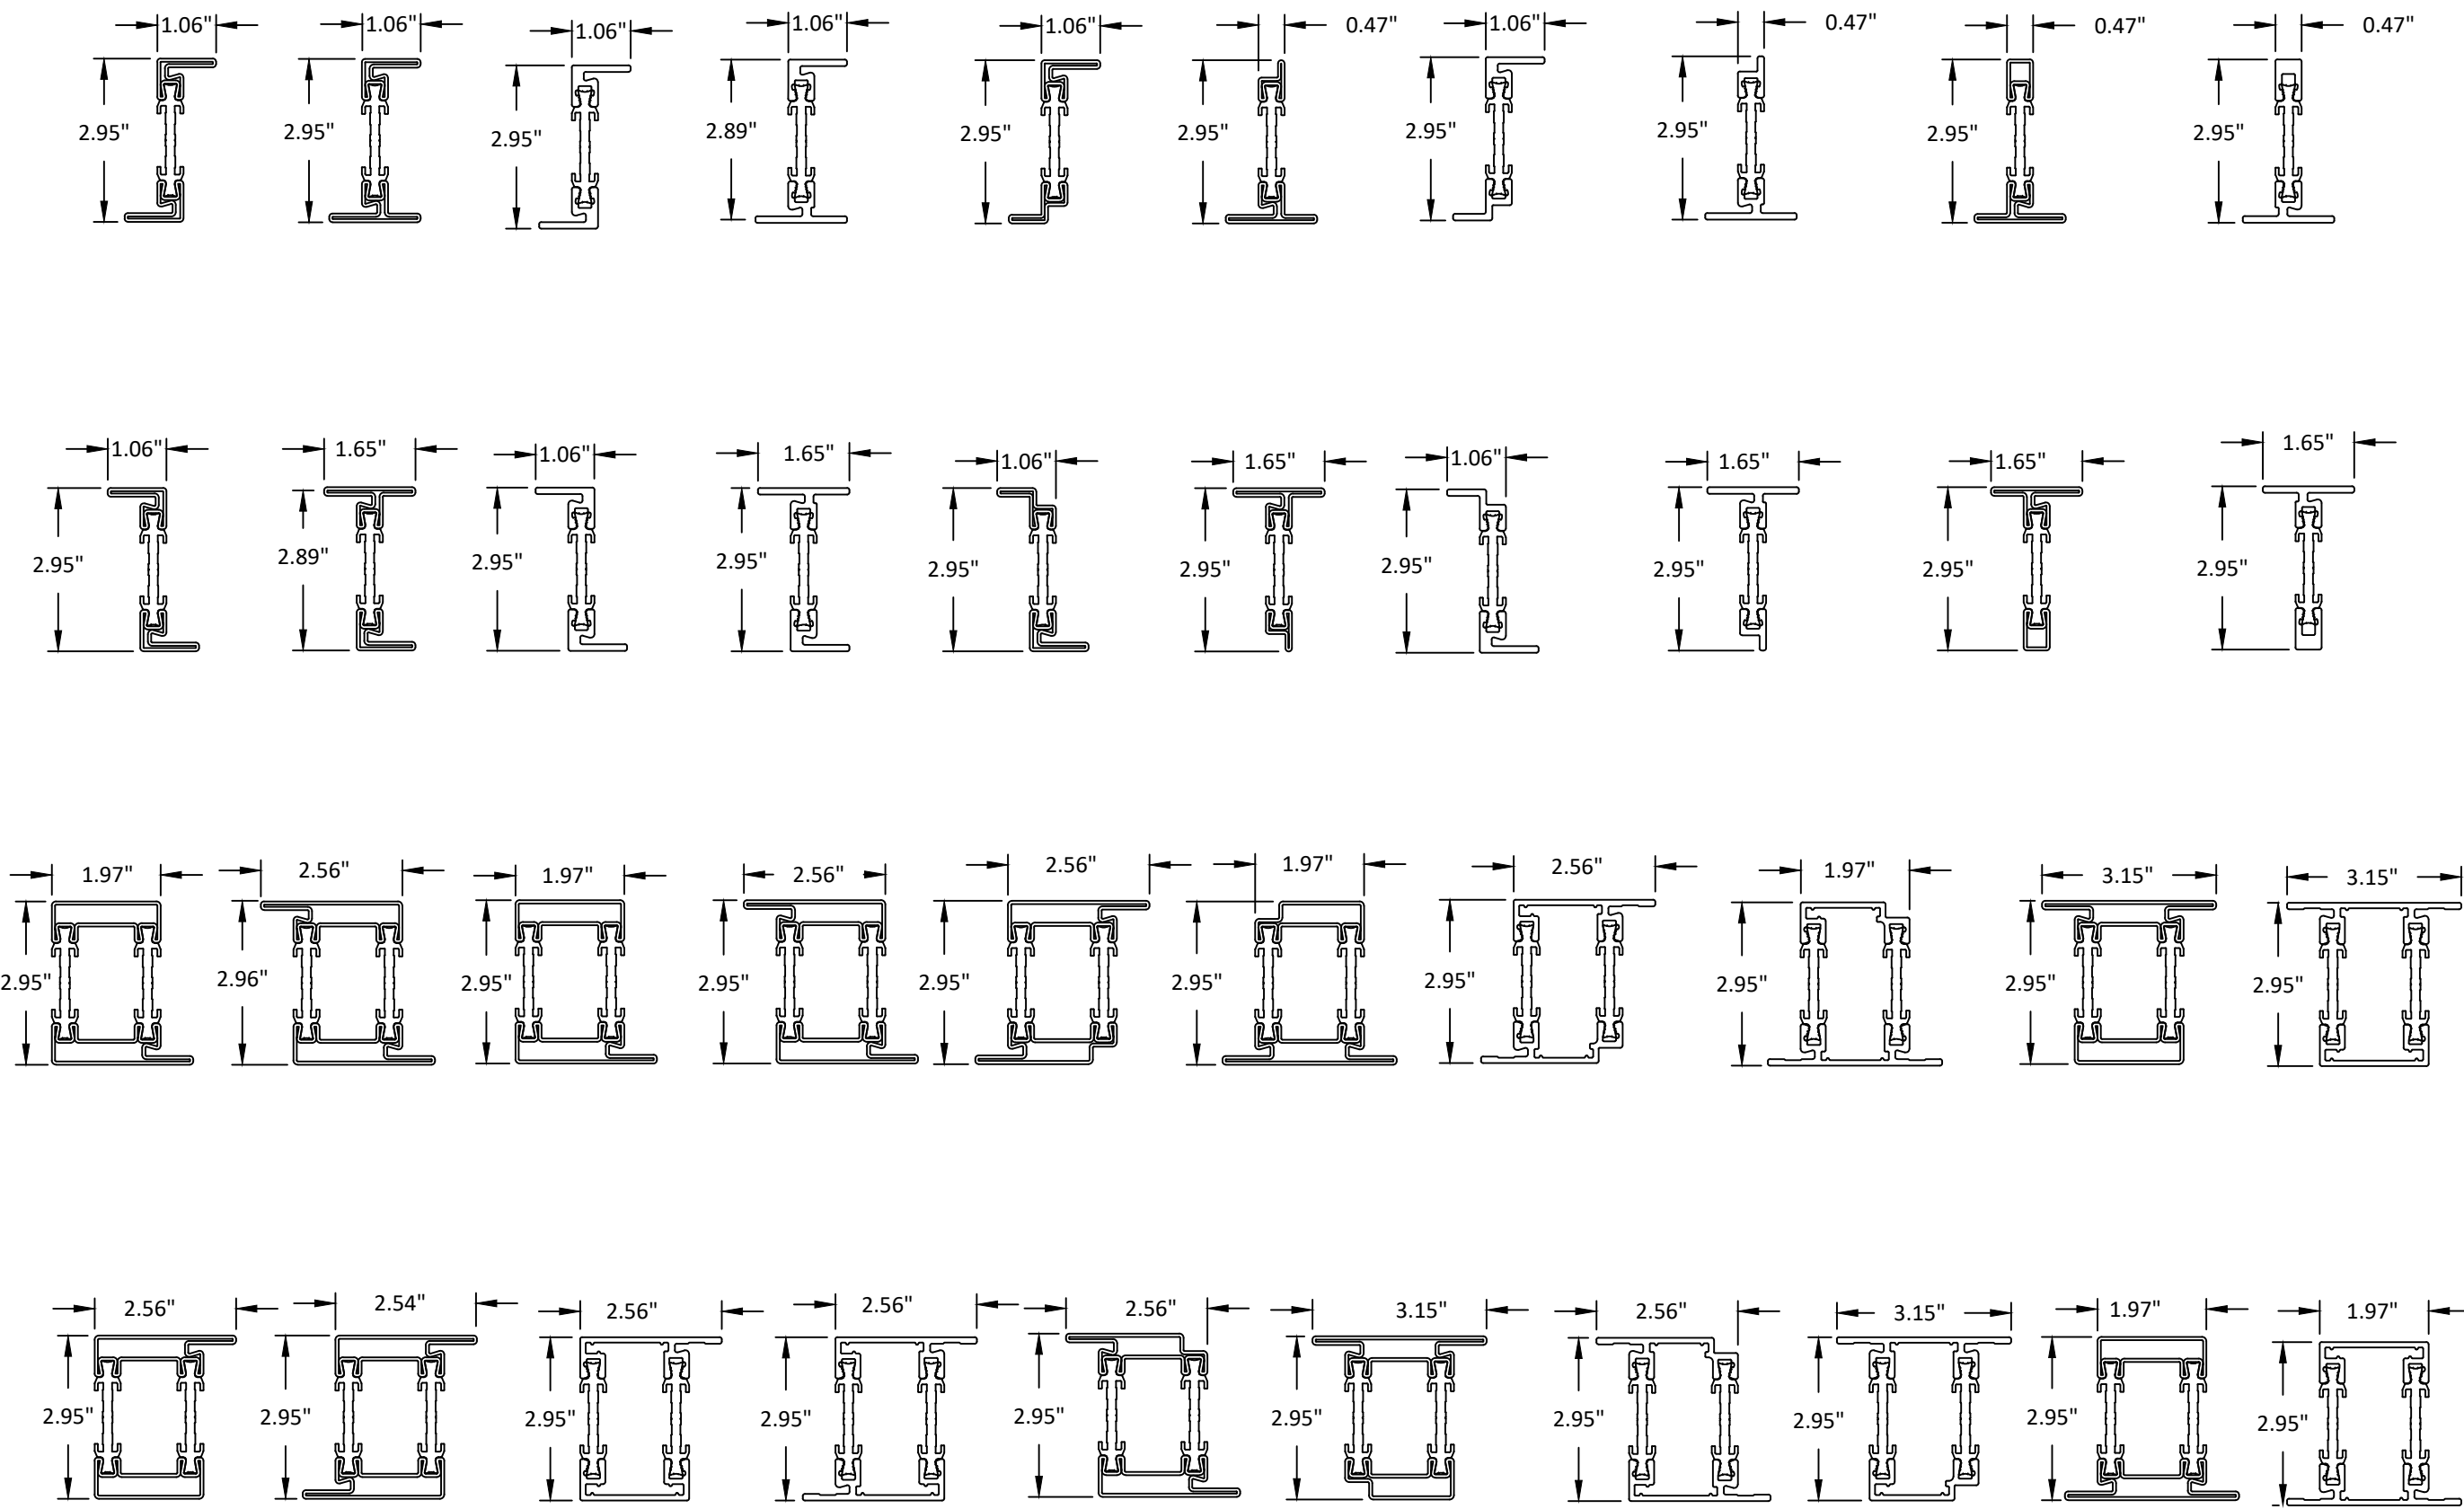

REILLY
ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
PROFILE OPTIONS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:
FL47695

DATE: **05.21.2025**

DWG. BY:
JR

CHK. BY:
HFN

SCALE: **NTS**

DWG. #: **RWD021**













SHEET:
23

REV.
A

OF 26

BILL OF MATERIALS			
ITEM#	DESCRIPTION	MATERIAL	MANUFACTURER
1	FRAME JAMB	BRONZE	OTTOSTUMM
1A	FRAME JAMB	VARIES	OTTOSTUMM
2	SASH	BRONZE	OTTOSTUMM
2A	SASH	VARIES	OTTOSTUMM
3	SILL	BRONZE	REILLY
3A	SILL	VARIES	REILLY
4	SASH	BRONZE	OTTOSTUMM
4A	SASH	VARIES	OTTOSTUMM
5	BLOCKING	PE	VARIES
6	KEEPER	STAINLESS STEEL	REILLY
7	NUT BAR	STAINLESS STEEL	REILLY
8	KEEPER	STAINLESS STEEL	REILLY
9	LOCKING POINT	VARIES	REILLY
10	OPPERATOR	STEEL	OTTOSTUMM
11	HINGE	BRASS	SWF
12	FRICTION ADJUSTER	STAINLESS STEEL	CALDWELL
13	WEATHER STRIPPING	N/A	OTTOSTUMM
14	WEATHER STRIPPING	N/A	OTTOSTUMM
15	END CAP	COMPOSITE	REILLY
16	1/2" X 1-4/5" ANGLE	6061-T6 ALUMINUM OR STAINLESS STEEL	REILLY
17	FRAME JAMB	BRONZE	OTTOSTUMM
17A	FRAME JAMB	VARIES	OTTOSTUMM
18	LOCKING RAIL	BRONZE	OTTOSTUMM
18A	LOCKING RAIL	VARIES	OTTOSTUMM

19	BLOCKING	PE	VARIES
20	BLOCKING	PE	VARIES
21	BLOCKING	PE	VARIES
22	BLOCKING	PE	VARIES
23	BENT EXTERIOR CLIP	6061-T6 ALUMINUM OR STAINLESS STEEL	REILLY
24	SASH	BRONZE	OTTOSTUMM
24A	SASH	VARIES	OTTOSTUMM
25	FRAME JAMB	BRONZE	OTTOSTUMM
25A	FRAME JAMB	VARIES	OTTOSTUMM
26	FLAT CLIP	6061-T6 ALUMINUM OR STAINLESS STEEL	REILLY
27	3/4" X 3/4" ANGLE	6061-T6 ALUMINUM OR STAINLESS STEEL	REILLY
28	1/2" X 5" BAR	STEEL	REILLY
29	2-1/2" X 1/2" BAR	STEEL	REILLY
30	BENT INTERIOR CLIP	6061-T6 ALUMINUM OR STAINLESS STEEL	REILLY
31	LOCK	VARIES	REILLY

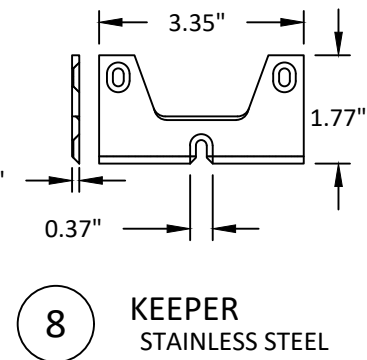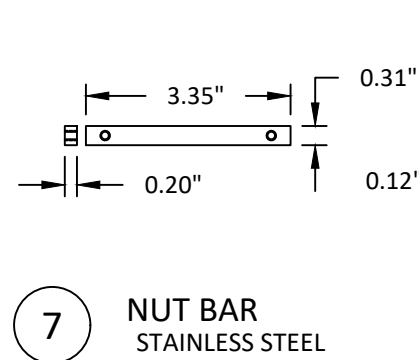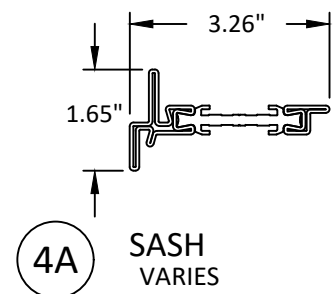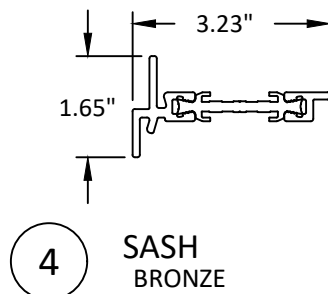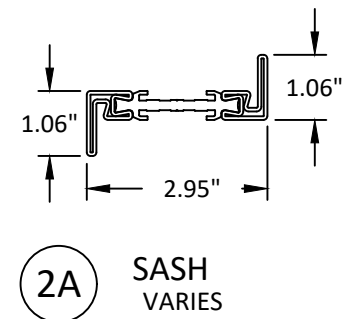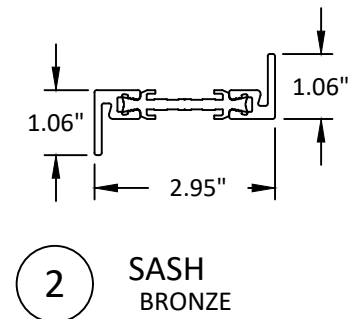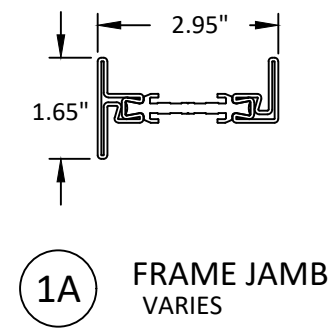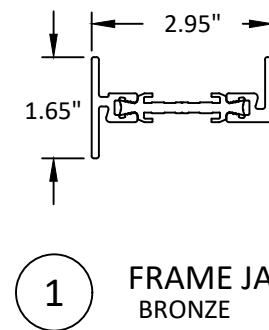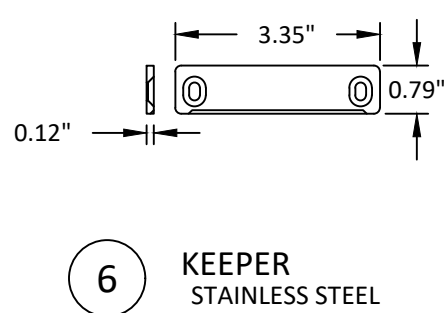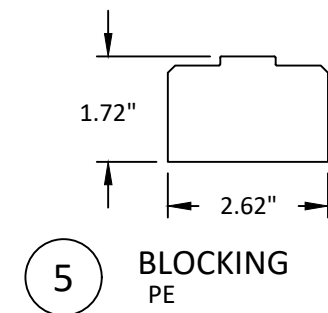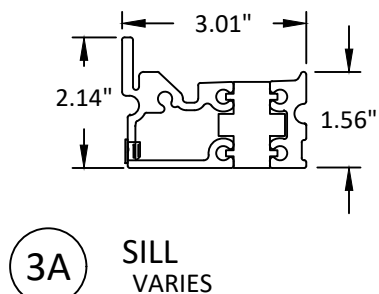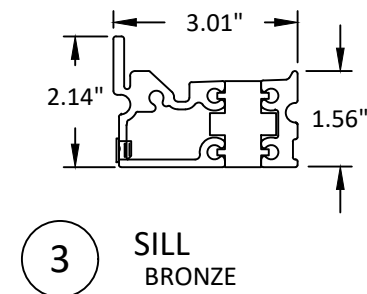

REILLY

ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)

BILL OF MATERIALS & COMPONENTS

PREPARED BY:

BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132

PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com

REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

HERMES F. NORERO, P.E.
FLBPCE 73778
BUILDING DROPS, INC
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #:

FL47695

DATE: 05.21.2025

DWG. BY: JR	CHK. BY: HFN
---	--

SCALE: NTS

DWG. #: RWD021

SHEET:


24

REV.


A

OF 26


c:\users\sebastianhereros\building drops, including drops landing - common\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change\dwgs\147695-r0\rvd021 - a.dwg 8/4/2026 3:28 PM

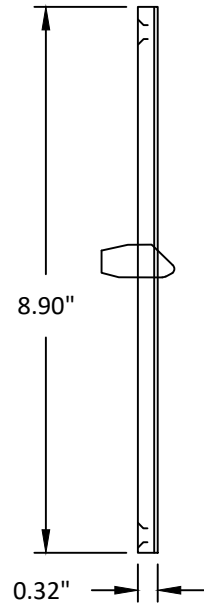


9 LOCKING POINT
VARIES

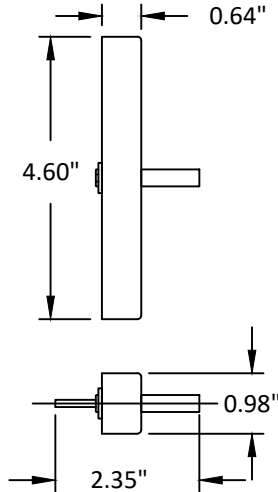


10 OPERATOR
STEEL

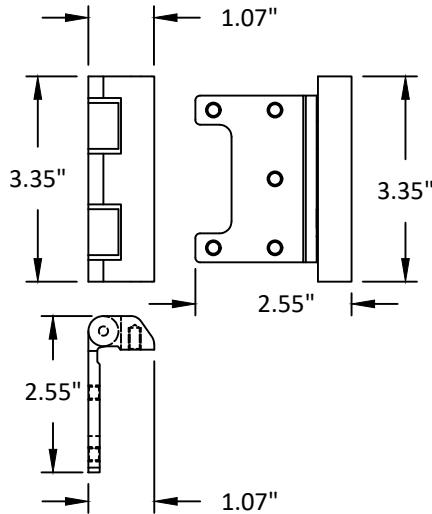


11 HINGE
BRASS

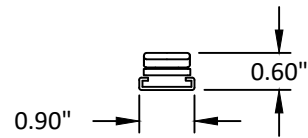


12 FRICTION ADJUSTER
STAINLESS STEEL




14 WEATHER STRIPPING




13 WEATHER STRIPPING

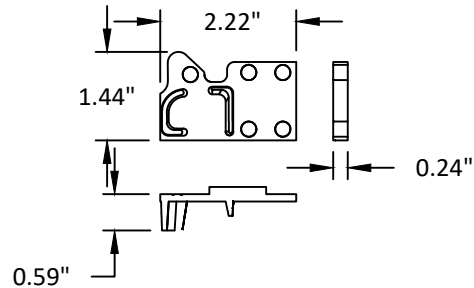


15 END CAP
COMPOSITE

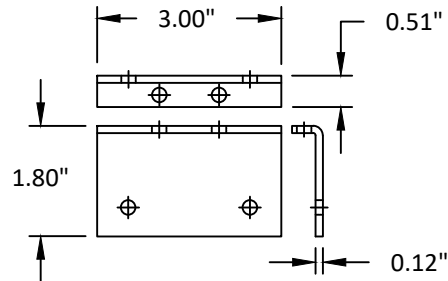


16 1/2" X 1-4/5" ANGLE
6061-T6 ALUMINUM
OR STAINLESS STEEL




17 FRAME JAMB
BRONZE




17A FRAME JAMB
VARIES




18 LOCKING RAIL
BRONZE




18A LOCKING RAIL
VARIES




19 BLOCKING
PE

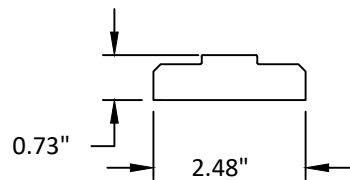


20 BLOCKING
PE

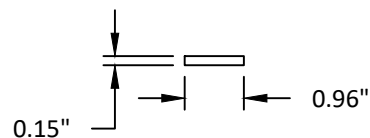

21 BLOCKING
PE

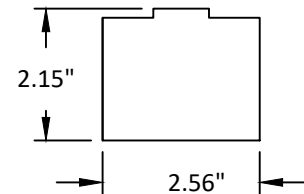

22 BLOCKING
PE

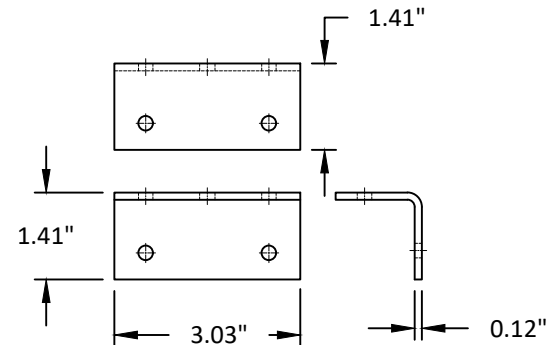

23 BENT EXTERIOR CLIP
6061-T6 ALUMINUM
OR STAINLESS STEEL

REILLY ARCHITECTURAL

901 Burman Blvd, Building 701 Calverton, NY 11933
P 631-208-0710 F 631-208-0711 www.reillyarch.com

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC
AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC
SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE
FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED
ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC
DOCUMENTS FOR USE WITH THIS DOCUMENT.




FL #:	FL47695
DATE:	05.21.2025
DWG. BY:	CHK. BY:
JR	HFN
SCALE:	NTS
DWG. #:	RWD021
SHEET:	REV.
25	A
OF 26	


c:\users\sebastianh\documents\projects\2026 code change projects\reilly architectural\cc-26-0587.1 - 2026 code change projects\dwgs\147695-rwd021 - a.dwg 8/4/2026 3:28 PM




24 SASH
BRONZE




24A SASH
VARIES




25 FRAME JAMB
BRONZE




25A FRAME JAMB
VARIES

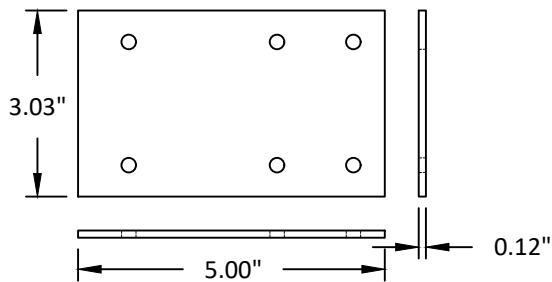


26 FLAT CLIP
6061-T6 ALUMINUM OR STAINLESS STEEL

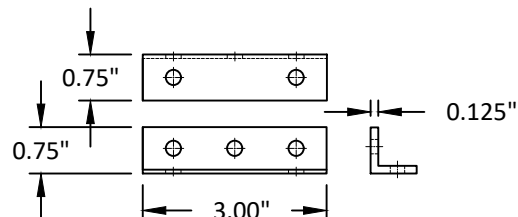


27 3/4" X 3/4" ANGLE
6061-T6 ALUMINUM OR STAINLESS STEEL

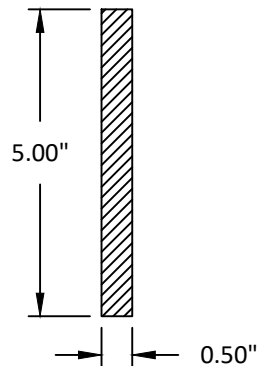


28 1/2" X 5" BAR
STEEL

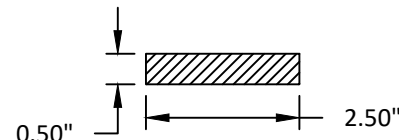

29 2-1/2" X 1/2" BAR
STEEL

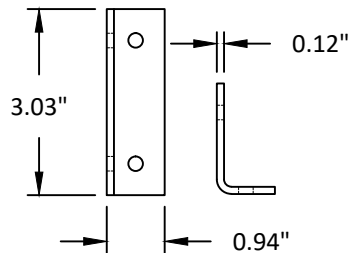

30 BENT INTERIOR CLIP
6061-T6 ALUMINUM
OR STAINLESS STEEL

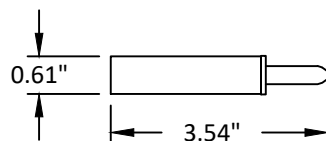

31 LOCK
VARIES

TITLE: W75 INSWING & OUTSWING
DOOR
(WZ3) (IMPACT)
COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE
2026 FBC UPDATE	LS	06/26

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:	FL47695	
DATE:	05.21.2025	
DWG. BY:	JR	CHK. BY: HFN
SCALE:	NTS	
DWG. #:	RWD021	
SHEET:	26	REV. A
OF 26		