


QUAKER WINDOW PRODUCTS

C200 SERIES SWING DOOR (NON-HVHZ)(NON-IMPACT)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC), **EXCLUDING** HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - AAMA/WDMA/CSA 101/I.S.2/A440-17
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING, AND METAL FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/4 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: ALUMINUM 6063-T6
- GLASS SHALL MEET THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS. SEE SHEET 1 FOR GLAZING DETAIL.

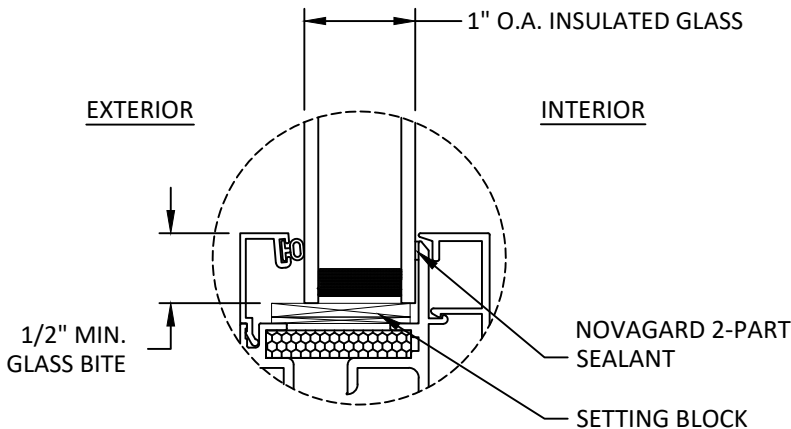

GLAZING DETAIL

- GLAZING NOTES:
- GLASS TYPE SHALL COMPLY WITH ASTM E1300 REQUIREMENTS. PER THE FBC TEMPER AND SAFETY GLAZING REQUIREMENTS SHALL BE REVIEWED ON A SITE SPECIFIC BASIS.
 - SETTING BLOCK DUROMETER HARDNESS OF 70-90 (SHORE A) AS REFERENCED IN FBC CHAPTER 24.
 - SETTING BLOCKS TO BE LOCATED AT 1/4 SPAN LENGTH FOR GLASS WIDER THAN 36" AS PER FBC CHAPTER 24.
 - D.L.O. AND DESIGN PRESSURES MAY NOT EXCEED MAX VALUES SHOWN HEREIN.

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	GENERAL NOTES & GLAZING DETAIL
2	ELEVATIONS & ANCHOR LAYOUTS
3	ELEVATIONS & ANCHOR LAYOUTS
4	VERTICAL SECTIONS
5	HORIZONTAL SECTIONS
6	HORIZONTAL SECTIONS
7	ANCHOR DETAILS & INSTALLATION NOTES
8	ANCHOR DETAILS

DESIGN PRESSURE RATING (PSF)					
CONFIGURATION	WIDTH (IN.)	HEIGHT (IN.)	DESIGN PRESSURE	SWING DIRECTION	MISSILE IMPACT RATING
X	37.0	96.0	+50/-50	INSWING	NON-IMPACT
X	37.0	96.0	+50/-50	OUTSWING	
XX	72.0	96.0	+50/-50	INSWING	
XX	72.0	96.0	+50/-50	OUTSWING	



PO BOX 128
504 HIGHWAY 63 SOUTH
FREEBURG, MO 65035
PH: (573) 744-5211 FX: (573) 744-5822

TITLE: C200 SERIES SWING DOOR
(NON-HVHZ)(NON-IMPACT)
GENERAL NOTES &
GLAZING DETAIL


PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2025.08.25 16:54:17 -0400

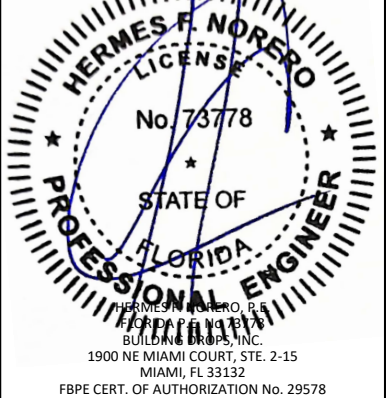

FL #: FL47720

DATE: 07.07.2025

DWG. BY: DB
CHK. BY: HFN

SCALE: NTS


DWG. #: QWP034

SHEET:


1

OF 8


c:\users\sebastianh\projects\quaker window products\fbx-25-0535-2 - fbx submittal - cw200 non-impact products\dwgs\swing door\qwp034.dwg 8/22/2025 1:47 PM

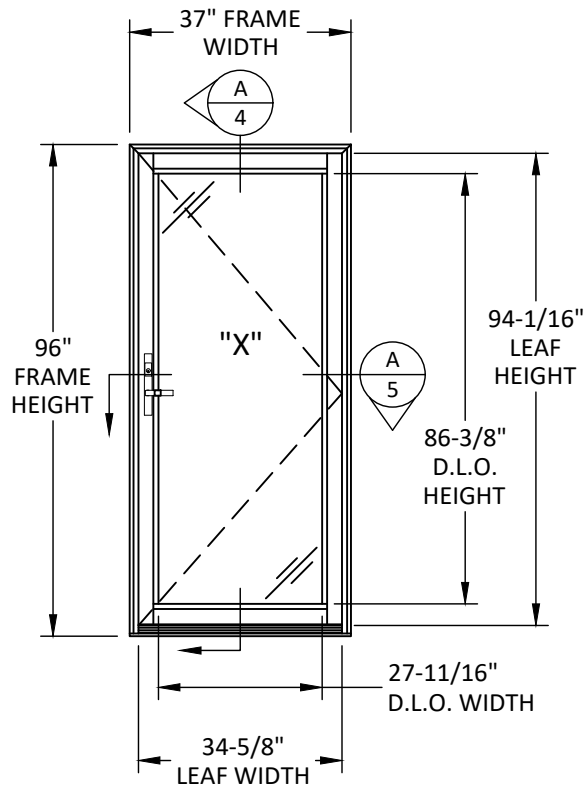


ELEVATION
SINGLE INSWING

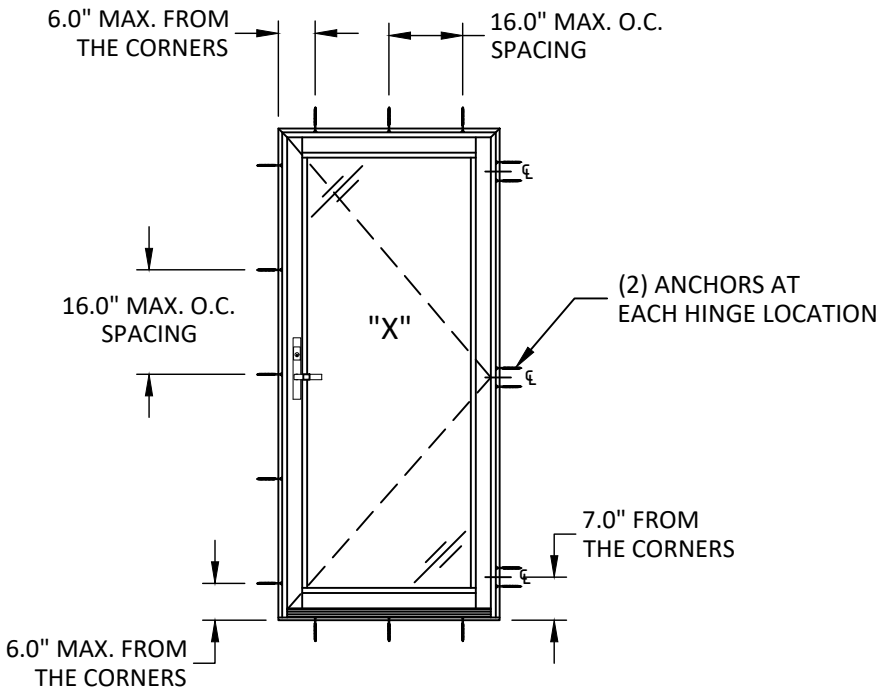

ANCHOR LAYOUT
SINGLE INSWING

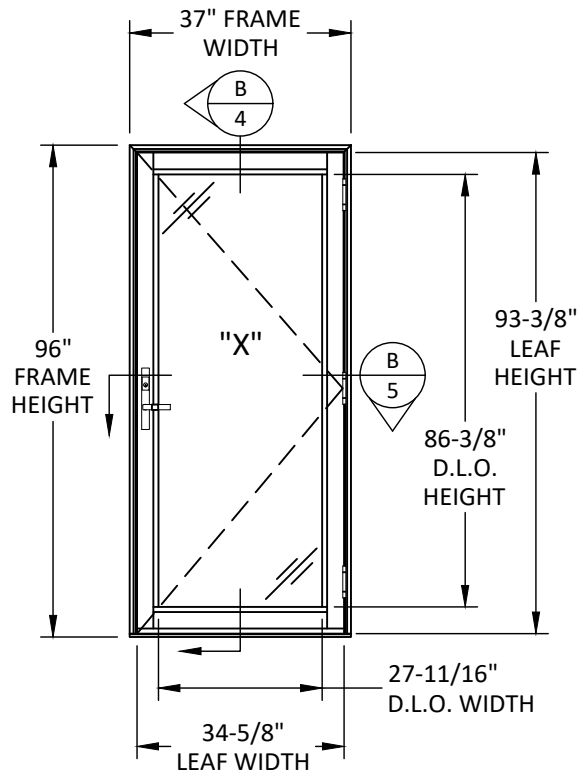

ELEVATION
SINGLE OUTSWING

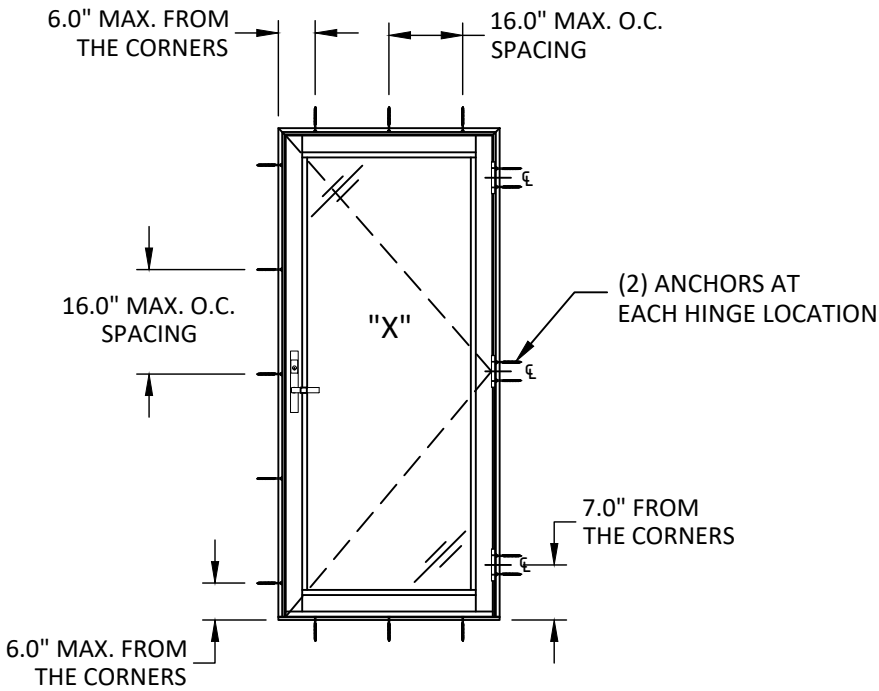

ANCHOR LAYOUT
SINGLE OUTSWING



PO BOX 128
504 HIGHWAY 63 SOUTH
FREEBURG, MO 65035
PH: (573) 744-5211 FX: (573) 744-5822

TITLE: C200 SERIES SWING DOOR
(NON-HVHZ)/(NON-IMPACT)

ELEVATIONS &
ANCHOR LAYOUTS

PREPARED BY: BUILDING DROPS, INC.

1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.



FL #:

FL47720

DATE: 07.07.2025

DWG. BY:
DB

CHK. BY:
HFN


SCALE: NTS

DWG. #: QWP034


SHEET:

2

OF 8

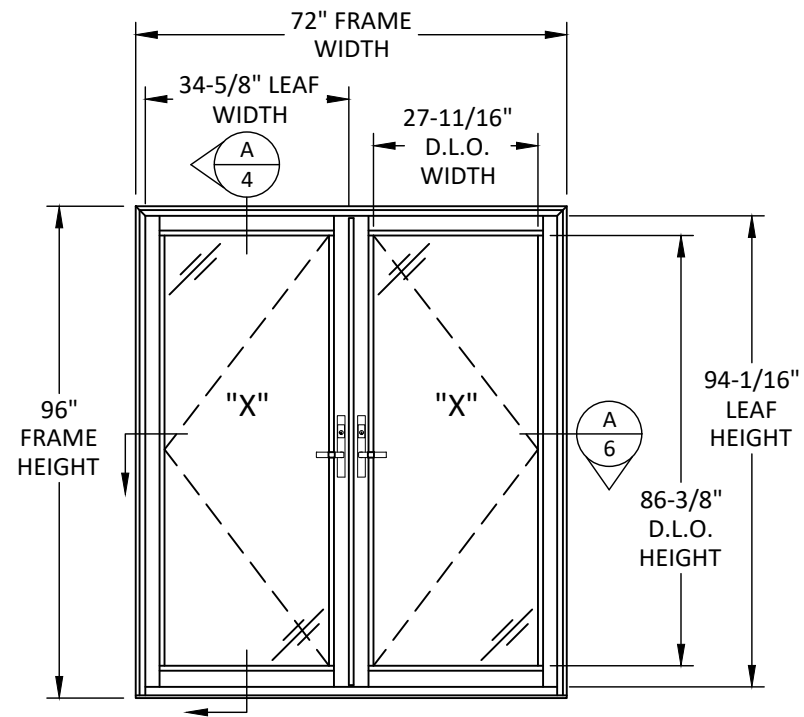


ELEVATION
DOUBLE INSWING

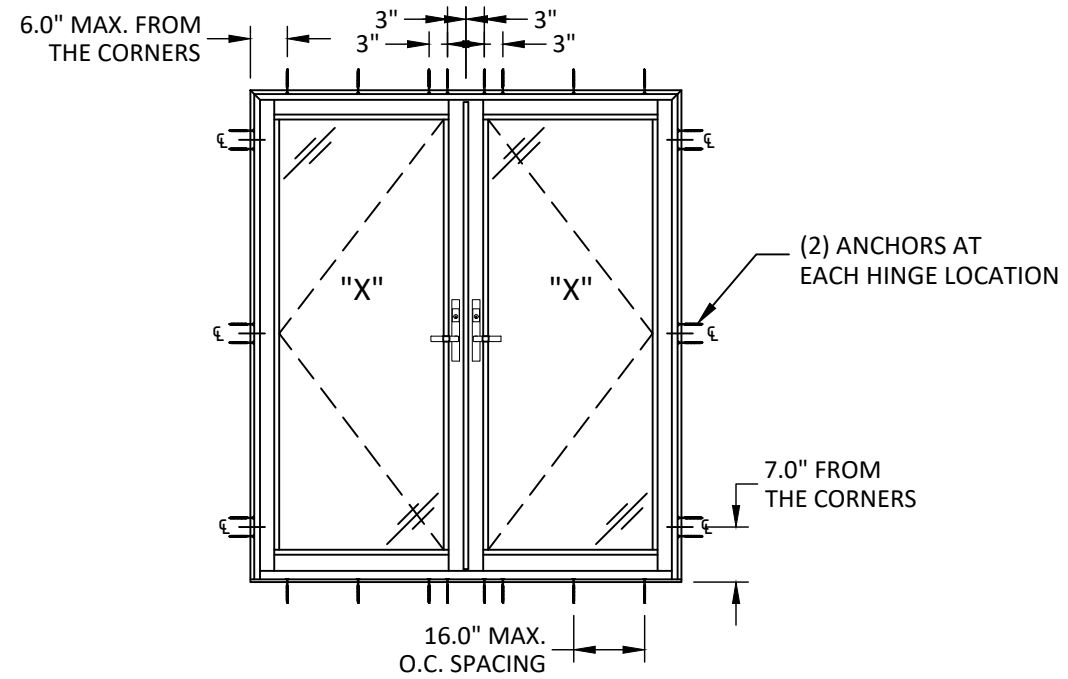


ANCHOR LAYOUT

DOUBLE INSWING

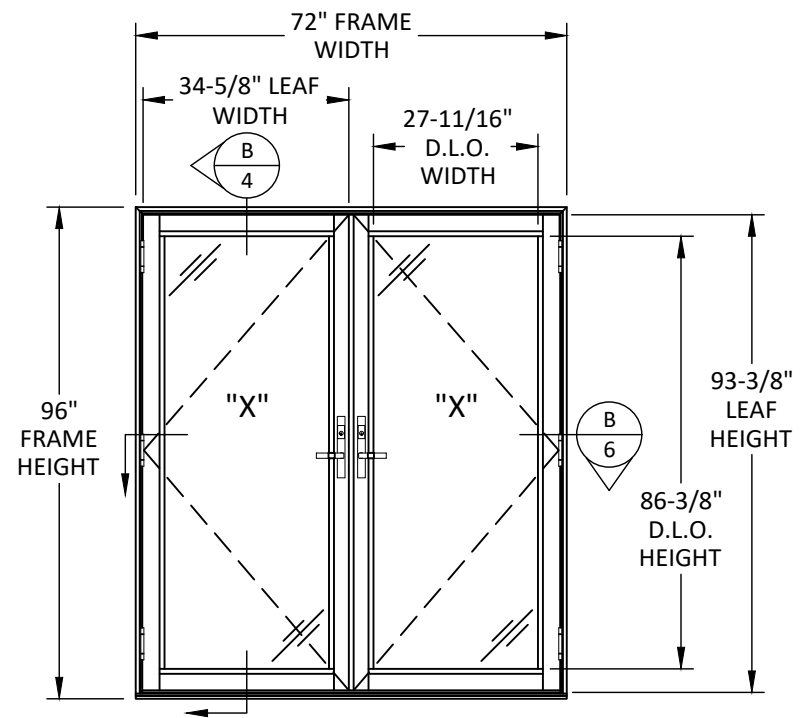

ELEVATION
DOUBLE OUTSWING

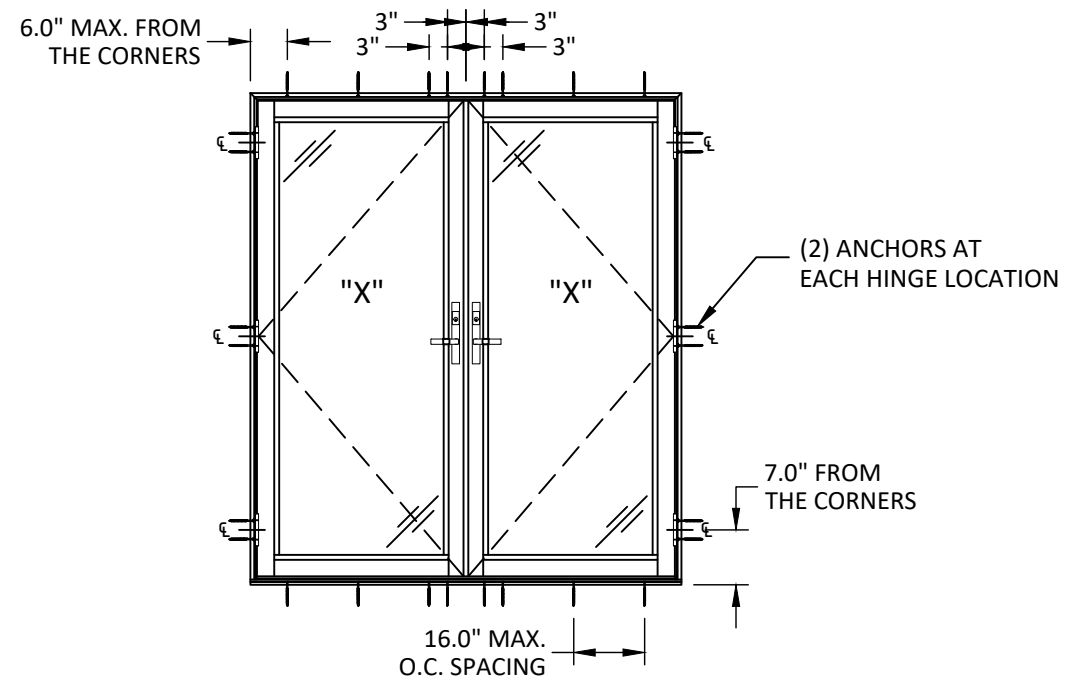

ANCHOR LAYOUT

DOUBLE OUTSWING



PO BOX 128
504 HIGHWAY 63 SOUTH
FREEBURG, MO 65035
PH: (573) 744-5211 FX: (573) 744-5822

TITLE: C200 SERIES SWING DOOR
(NON-HVHZ)(NON-IMPACT)

ELEVATIONS & ANCHOR LAYOUTS

PREPARED BY:


BUILDING DROPS, INC.

1900 NE MIAMI COURT STE 2-15

BD
BUILDING DROPS

REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

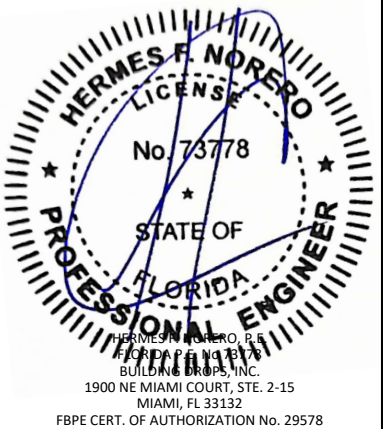

FL #: **FL47720**

DATE: 07.07.2025

DWG. BY: DB	CHK. BY: HFN
-----------------------	------------------------

SCALE: NTS

DWG. #: QWP034

SHEET:

3

DF 8

TITLE: C200 SERIES SWING DOOR
(NON-HVHZ)(NON-IMPACT)

VERTICAL SECTIONS


PREPARED BY:

BUILDING DROPS, INC.
100 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954)399-8478
FAX: (954)744.4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERAL IN NATURE AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC PROJECT OR SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC INSTALLATION DOCUMENTS FOR USE WITH THIS DOCUMENT.

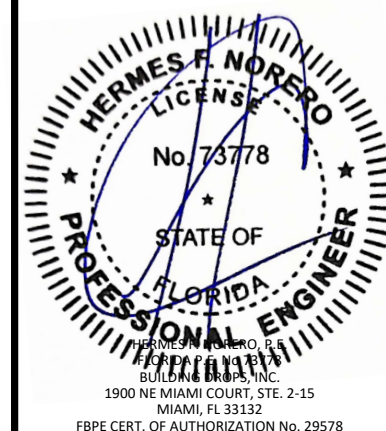

FL #:

FL47720

DATE: 07.07.2025

DWG. BY:
DB

CHK. BY:
HFN


SCALE: NTS

DWG. #: QWP034

SHEET:


4

OF 8

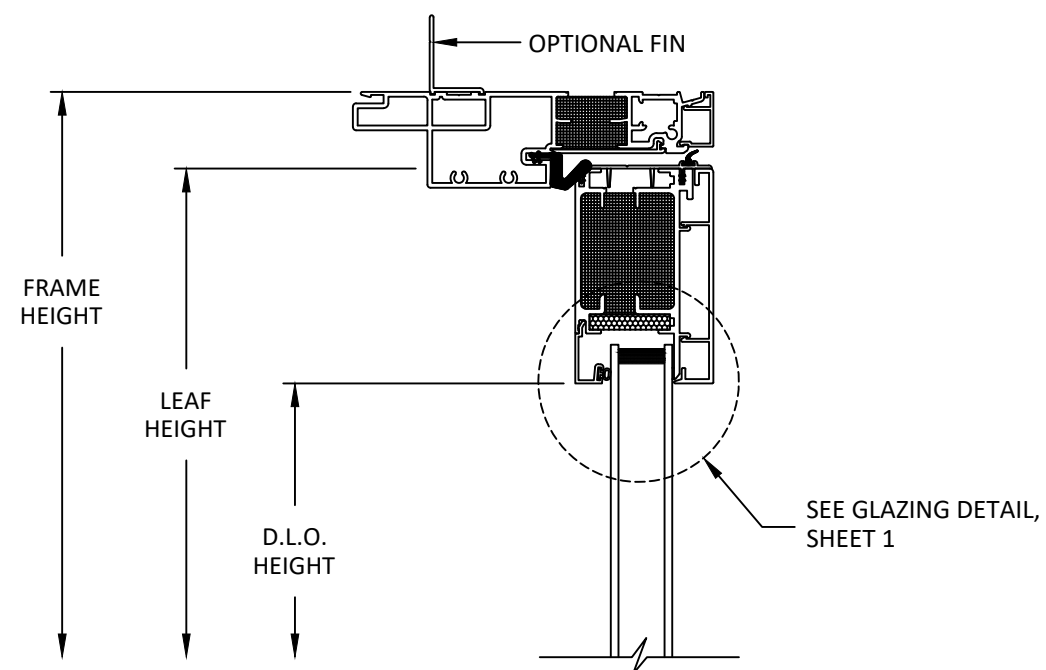

EXTERIOR


INTERIOR

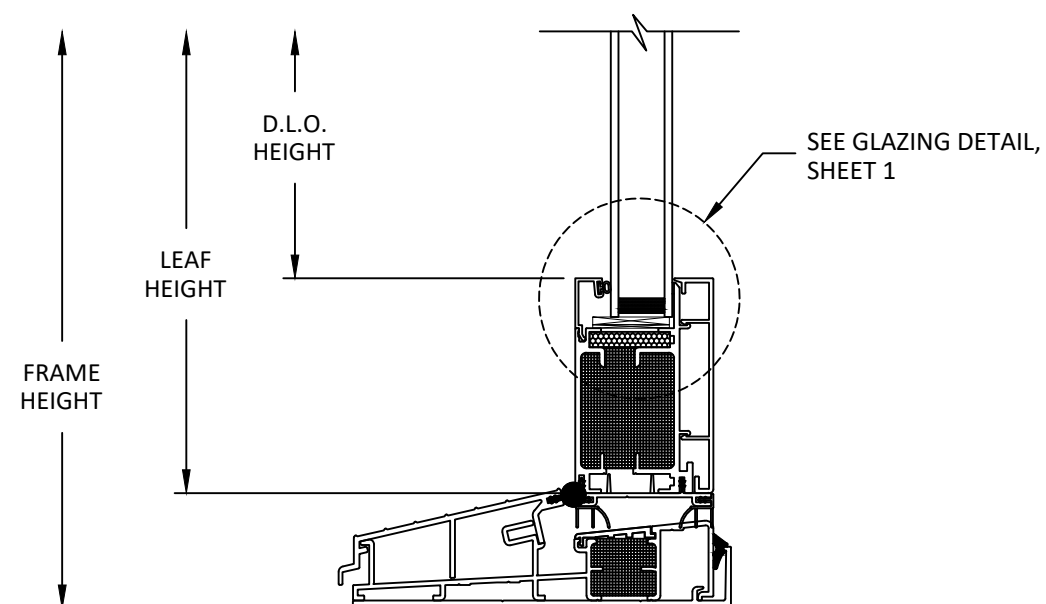

$\frac{A}{4}$


VERTICAL SECTION

INSWING

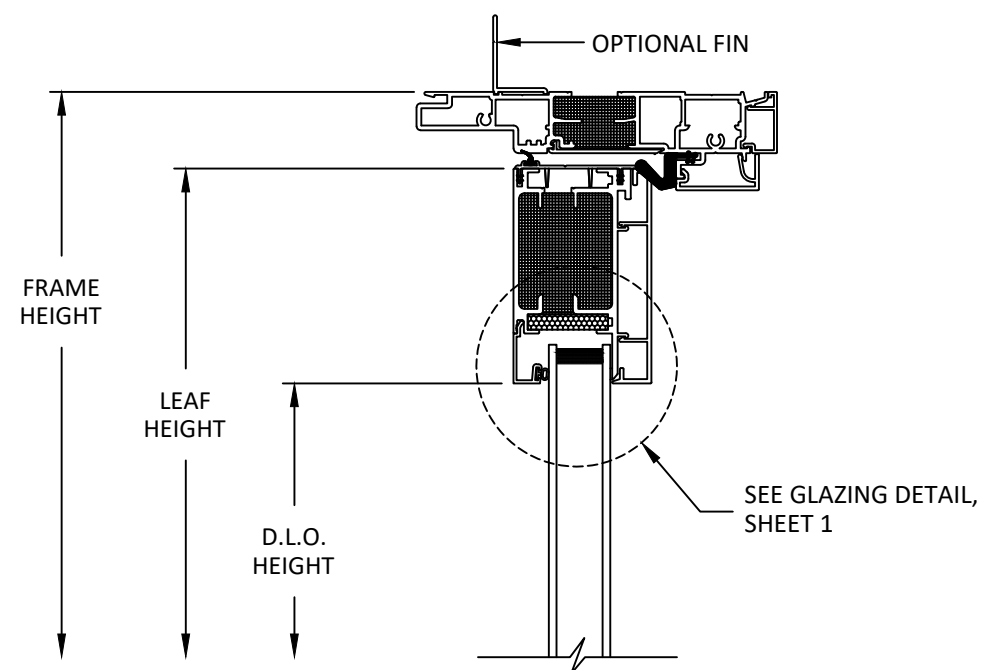

EXTERIOR


INTERIOR

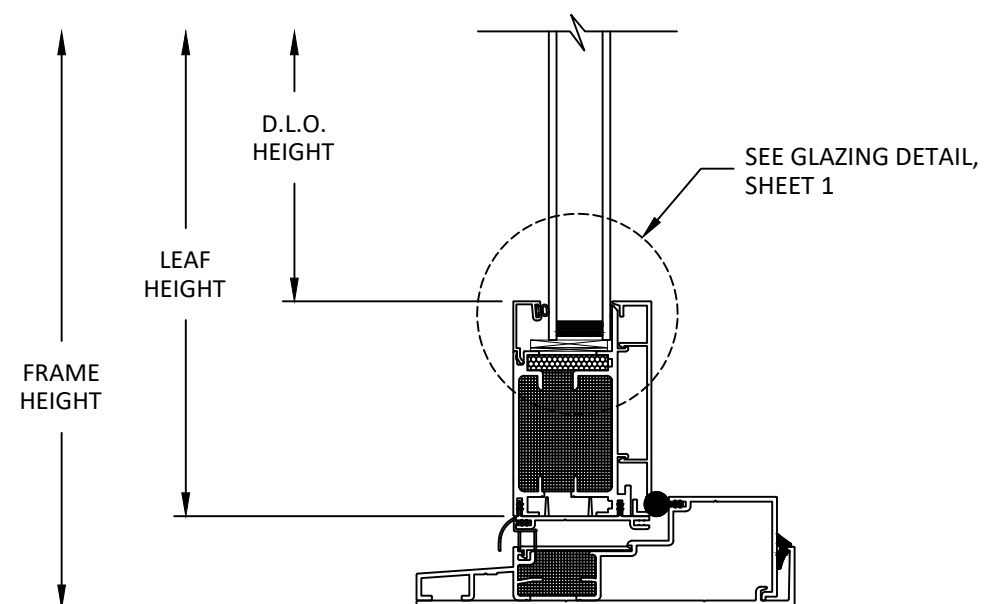


B
4

VERTICAL SECTION

OUTSWING




SINGLE INSWING




SINGLE OUTSWING



c:\users\sebastianh\documents\quaker window products\fbx submittal - cw200 non-impact products\dwgs\swing door\qwp034.dwg
8/22/2025 1:47 PM
c:\users\sebastianh\documents\quaker window products\fbx submittal - cw200 non-impact products\dwgs\swing door\qwp034.dwg

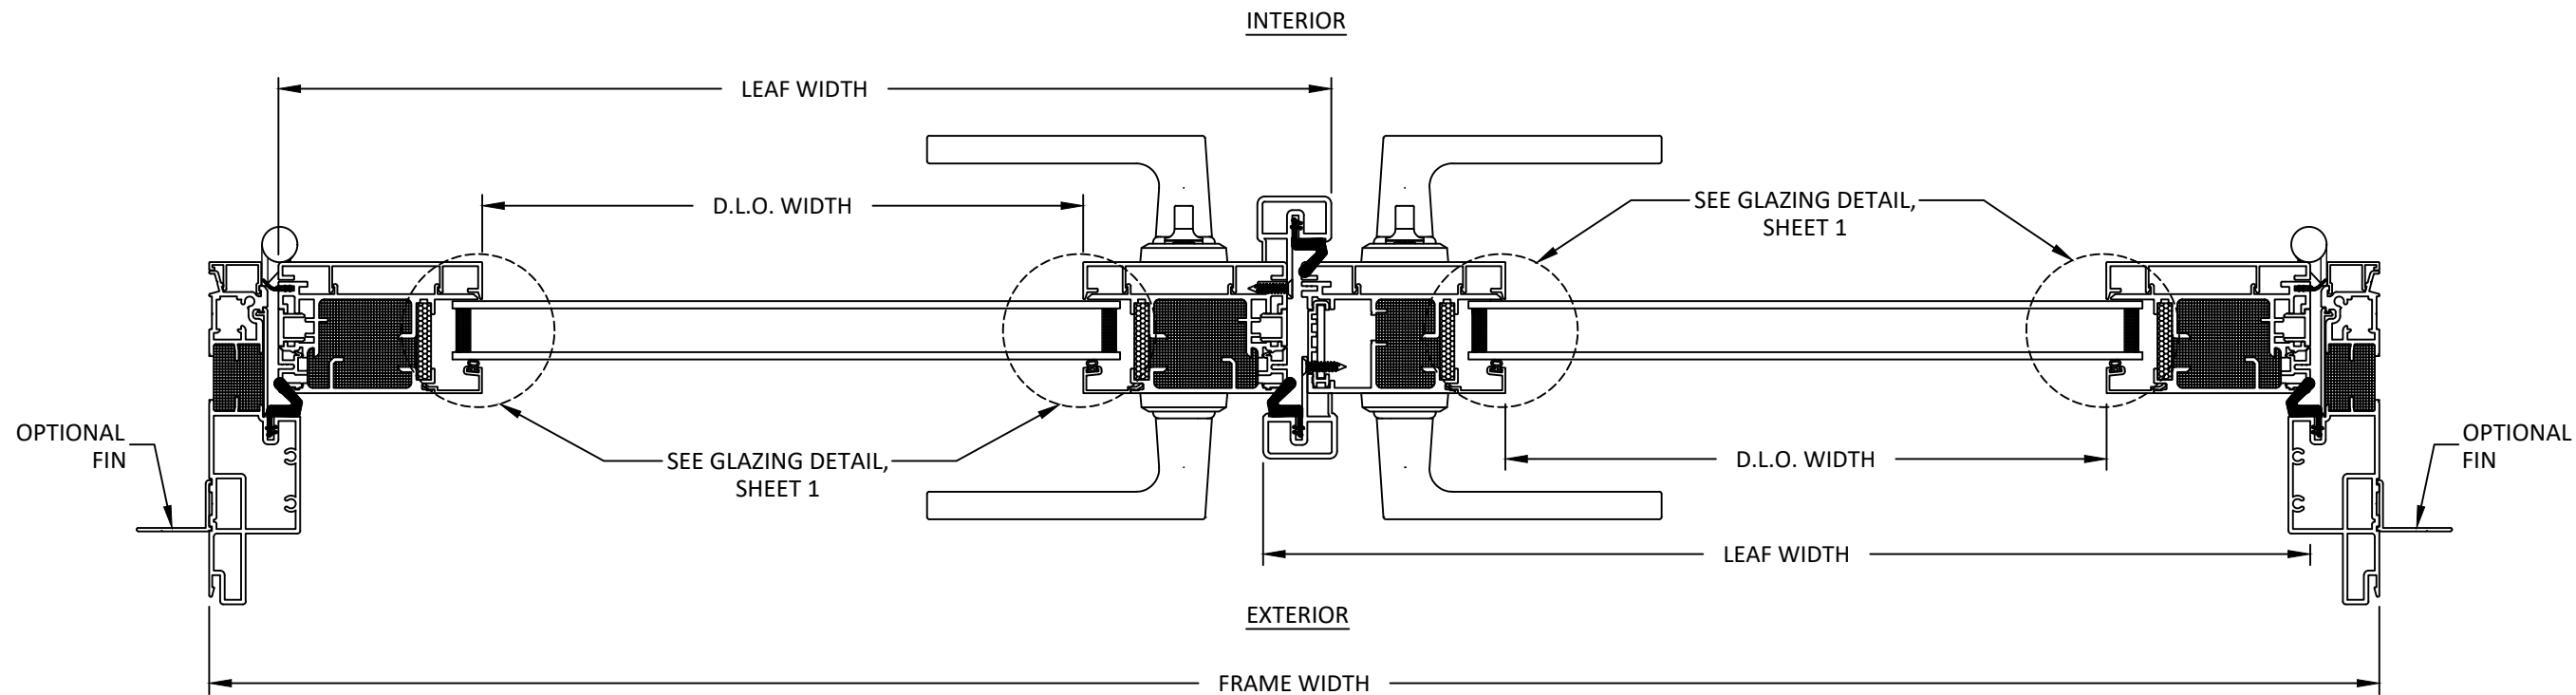

A
6 HORIZONTAL SECTION
DOUBLE INSWING

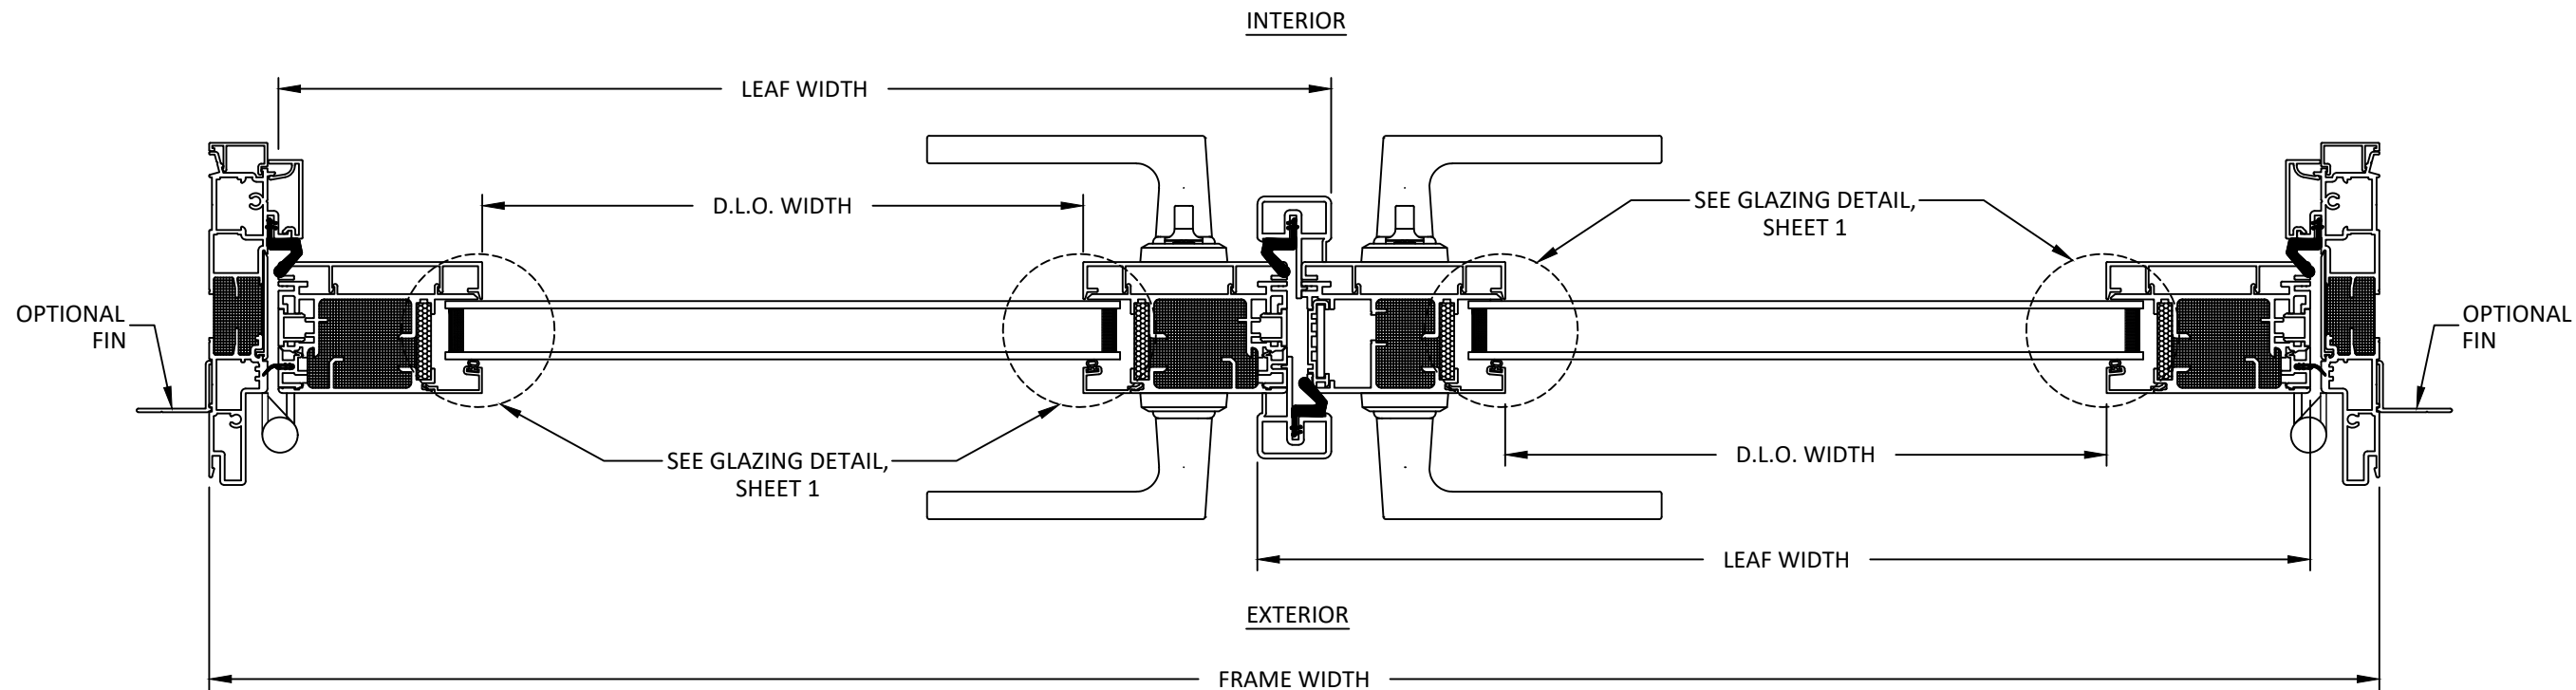

B
6 HORIZONTAL SECTION
DOUBLE OUTSWING



PO BOX 128
504 HIGHWAY 63 SOUTH
FREEBURG, MO 65035
PH: (573) 744-5211 FX: (573) 744-5822

TITLE: C200 SERIES SWING DOOR
(NON-HVHZ)/(NON-IMPACT)


HORIZONTAL SECTIONS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com




REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

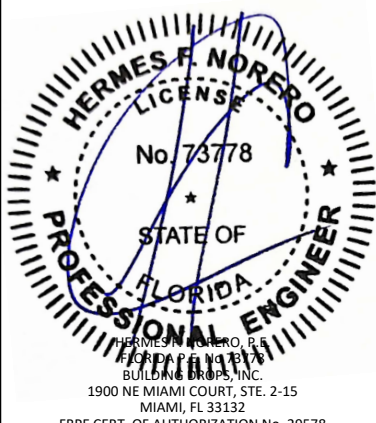

FL #:	FL47720
DATE:	07.07.2025
DWG. BY:	CHK. BY:
DB	HFN
SCALE:	NTS
DWG. #:	QWP034
SHEET:	6

c:\users\sebastianh\appdata\local\temp\quaker\quaker window products\fb-25-0535-2 - fbc submittal - cw200 non-impact products\dwgs\swing door\qwp034.dwg 8/22/2025 1:47 PM

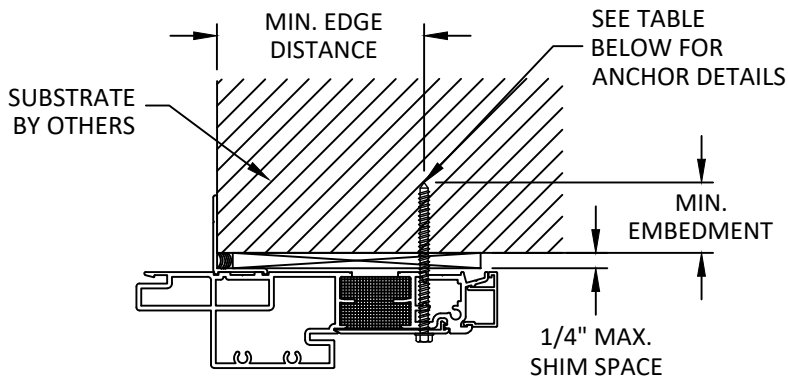

EXTERIOR


INTERIOR

A
7

ANCHOR DETAIL

IN SWING
HEAD

NOTE: JAMB SIMILAR

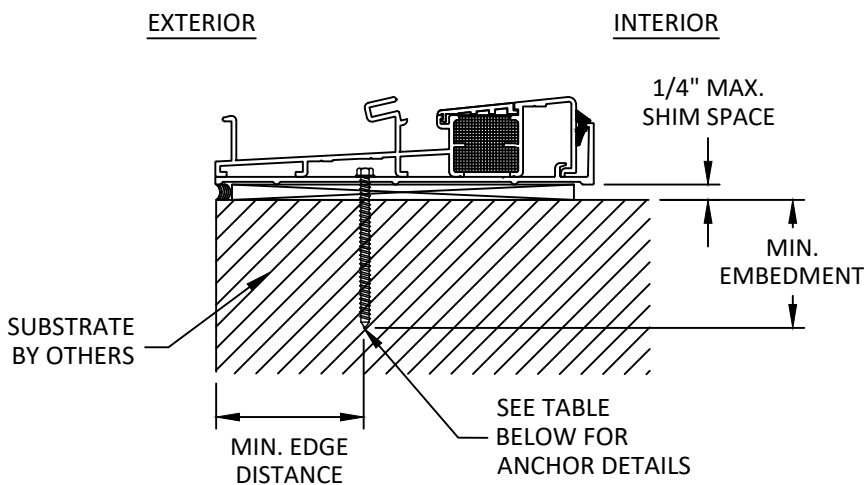

B
7

ANCHOR DETAIL

IN SWING
SILL

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN, UNLESS OTHERWISE STATED ON SHEETS 2 & 3.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/4$ INCH THE DEPICTED LOCATION & SPACING IN THE ANCHOR LAYOUT DETAILS (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR MASONRY OR CONCRETE OPENINGS, A 1X WOOD BUCK MAY BE USED (OPTIONAL) AS LONG AS THE MINIMUM EMBEDMENT AND EDGE DISTANCE REQUIREMENTS ARE STILL MET WITHIN THE CORRESPONDING HOST SUBSTRATE. SEE GENERAL NOTE #3 ON SHEET 1 FOR MORE INFORMATION.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. SG = 0.55	#10 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#10 SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"
	CONCRETE: f'c=3000 PSI MIN.	3/16" ITW TAPCON	1.00"	2.50"
	MASONRY: CMU per ASTM C90 2000 PSI MIN.			



QUAKER
COMMERCIAL

PO BOX 128
504 HIGHWAY 63 SOUTH
FREEBURG, MO 65035
PH: (573) 744-5211 FX: (573) 744-5822

TITLE: C200 SERIES SWING DOOR
(NON-HVHZ)(NON-IMPACT)


ANCHOR DETAILS &
INSTALLATION NOTES

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

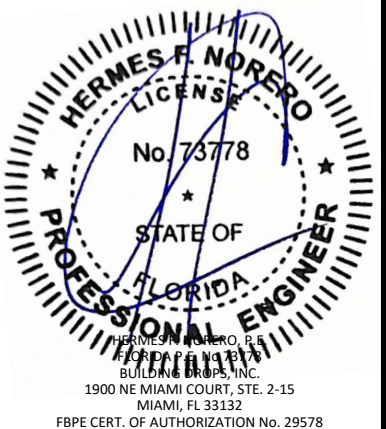

FL #:

FL47720

DATE: **07.07.2025**

DWG. BY:

DB

CHK. BY:

HFN

SCALE: **NTS**


DWG. #: **QWP034**

SHEET:

7


OF 8

c:\users\sebastianh\documents\projects\quaker window products\fbx-25-0535.2 - fbx submittal - cw200 non-impact products\dwgs\swing door\qwp034.dwg 8/22/2025 1:47 PM

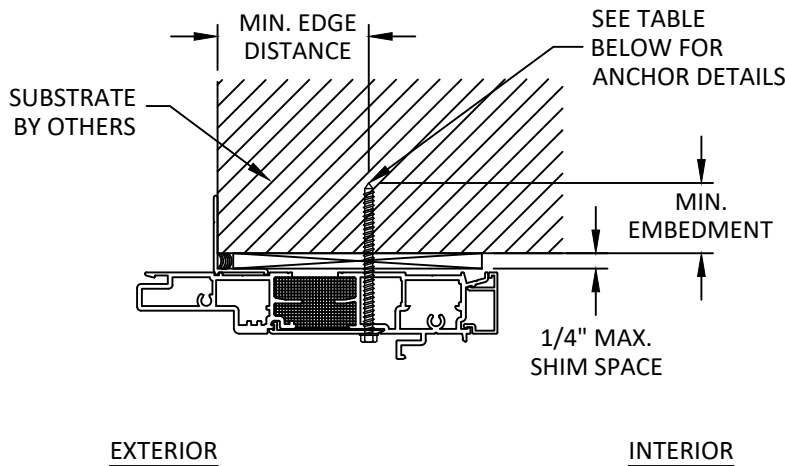

A
8 **ANCHOR DETAIL**
OUTSWING HEAD

NOTE: JAMB SIMILAR

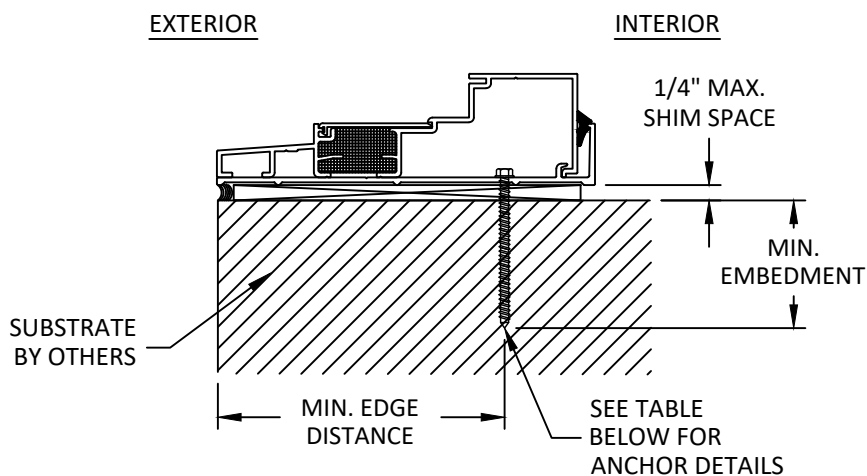

B
8 **ANCHOR DETAIL**
OUTSWING SILL

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR TYPE	MIN. EMBEDMENT	MIN. EDGE DISTANCE
THROUGH FRAME	WOOD: MIN. SG = 0.55	#10 WOOD SCREW	1.50"	0.75"
	METAL: 18 GAUGE STEEL, MIN. Fy = 33KSI ALUMINUM: 1/8" MIN., 6063-T5	#10 SELF-DRILLING SCREW	3 THREADS MIN. PENETRATION BEYOND STRUCTURE	0.50"
	CONCRETE: f'c=3000 PSI MIN.	3/16" ITW TAPCON	1.00"	2.50"
	MASONRY: CMU per ASTM C90 2000 PSI MIN.			



QUAKER
COMMERCIAL

PO BOX 128
504 HIGHWAY 63 SOUTH
FREEBURG, MO 65035
PH: (573) 744-5211 FX: (573) 744-5822

TITLE: C200 SERIES SWING DOOR (NON-HVHZ)(NON-IMPACT)


ANCHOR DETAILS

PREPARED BY: BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
PH: (954) 399-8478
FAX: (954) 744-4738
WEB: www.buildingdrops.com



REMARKS	BY	DATE

THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.

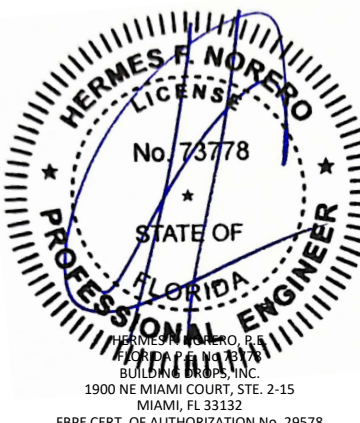

HERMES F. NORERO, P.E.
BUILDING DROPS, INC.
1900 NE MIAMI COURT, STE. 2-15
MIAMI, FL 33132
FBPE CERT. OF AUTHORIZATION No. 29578

FL #: **FL47720**

DATE: **07.07.2025**

DWG. BY: DB	CHK. BY: HFN
--------------------	---------------------

SCALE: **NTS**

DWG. #: **QWP034**

SHEET: **8** OF 8